


—●— nominal error

■ cold start selected worst

■ warm-start selected worst

Phase continuation (single outage)

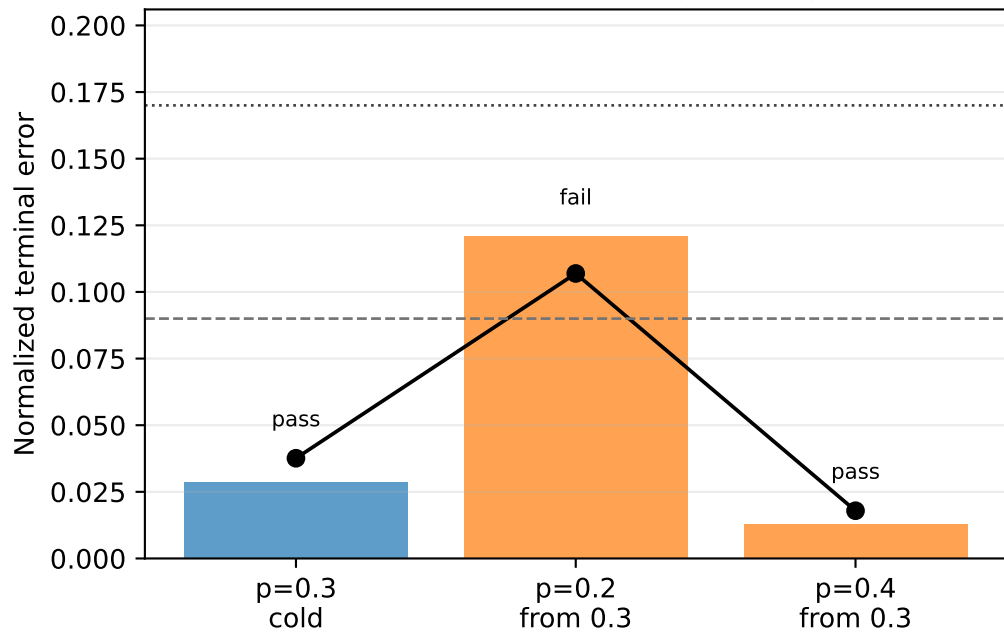

Hard catalog stress probe

