



# Platinum Resistance Thermometer (PRT) Selection Guide



[hken.rs-online.com](http://hken.rs-online.com) (Hong Kong (English))



[www.rs-components.com](http://www.rs-components.com) (International)

## ACTUAL BRIDGE CIRCUITS FOR 2, 3 AND 4 WIRE THERMOMETERS


The connection between the thermometer assembly and the instrumentation. The cabling introduces electrical resistance which is placed in series with the resistance thermometer. **The two resistances are therefore cumulative and could be interpreted as an increased temperature if the lead resistance is not allowed for.** The longer and/or the smaller the diameter of the cable, the greater the lead resistance will be and the measurement errors could be appreciable. In the case of a **2 wire connection**, little can be done about this problem and some measurement error will result according to the cabling and input circuit arrangement.

For this reason, a **2 wire arrangement is only suitable for short cable lengths**. If it is essential to use only 2 wires, ensure that the largest possible diameter of conductors is specified and

that the length of cable is minimised to keep cable resistance to as low a value as possible.

**The use of 3 wires**, when dictated either by probe construction or by the input termination of the measuring instrument, will allow for a good level of lead resistance compensation. **However the compensation technique is based on the assumption that the resistance of all three leads is identical** and that they all reside at the same ambient temperature; this is not always the case. **Optimum accuracy is therefore achieved with a 4 wire configuration.**

2 Wire Connections    3 Wire Connections    4 Wire Connection



## STEM CONDUCTION

This is the mechanism by which heat is conducted from or to the process medium by the probe itself; an apparent reduction or increase respectively in measured temperature results. The **immersion depth** (the length of that part of the probe which is directly in contact with the medium) must be such as to ensure that the "sensing" length is exceeded (double the sensing length is recommended). Small immersion depths result in a large temperature gradient between the sensor and the surroundings which results in a large heat flow.

The ideal immersion depth can be achieved in practice by moving the probe into or out of the process medium incrementally; with each adjustment, note any apparent change in indicated temperature. The correct depth will result in no change in indicated temperature. For calibration purposes 150 to 300mm immersion is required depending on the probe construction.

## SELF-HEATING

In order to measure the voltage dropped across the Pt sensing resistor, a current must be passed through it. The measuring current produces heat dissipation in the sensor. This results in an increased temperature indication. It is necessary to minimise the current flow as much as possible; 1mA or less is usually acceptable.

If the sensor is immersed in flowing liquid or gas, the effect is reduced because of more rapid heat removal. Conversely, in still gas for example, the effect may be significant. The self-heating coefficient E is expressed as:

$$E = \Delta t / (R - I^2)$$

Where  $\Delta t$  = (indicated temperature) – (temperature of the medium)

R = Pt resistance

I = measurement current

## RESISTANCE V TEMPERATURE AND TOLERANCES FOR PLATINUM RESISTORS TO IEC 751(1995)/BS EN60751(1996)

Temp (°C)	Resistance (Ω)	(±°C)	Tolerance	
			Class A (±Ω)	Class B (±Ω)
-200	18.52	0.55	0.24	1.3
-100	60.26	0.35	0.14	0.8
0	100.00	0.15	0.06	0.3
100	138.51	0.35	0.13	0.8
200	175.86	0.55	0.20	1.3
300	212.05	0.75	0.27	1.8
400	247.09	0.95	0.33	2.3
500	280.98	1.15	0.38	2.8
600	313.71	1.35	0.43	3.3
650	329.64	1.45	0.46	3.6
700	345.28	–	–	3.8
800	375.70	–	–	4.3
850	390.48	–	–	4.6

## NEW TOLERANCE CLASSES FOR RESISTORS to IEC 60751(2008)

For wire wound resistors		For film resistors		Tolerance value <sup>a</sup> °C
Tolerance class	Temperature range of validity °C	Tolerance class	Temperature range of validity °C	
W 0.1	–100 to +350	F 0.1	0 to +150	± (0.1 + 0.0017  t )
W 0.15	–100 to +450	F 0.15	–30 to +300	± (0.15 + 0.002  t )
W 0.3	–196 to +660	F 0.3	–50 to +500	± (0.3 + 0.005  t )
W 0.6	–196 to +660	F 0.6	–50 to +600	± (0.6 + 0.01  t )

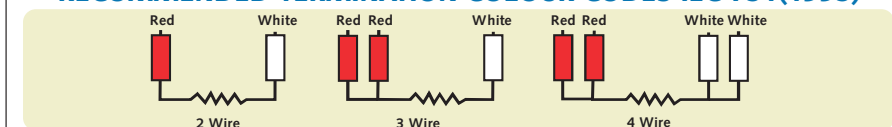
<sup>a</sup> |t| = modulus of temperature in °C without regard to sign. For any value of R<sub>0</sub>.

## NEW TOLERANCE CLASSES FOR THERMOMETERS to IEC 60751(2008)

Tolerance class	Temperature range of validity °C		Tolerance values <sup>a</sup> °C
	Wire wound resistors	Film resistors	
AA	–50 to +250	0 to +150	± (0.1 + 0.0017  t )
A	–100 to +450	–30 to +300	± (0.15 + 0.002  t )
B	–196 to +600	–50 to +500	± (0.3 + 0.005  t )
C	–196 to +600	–50 to +600	± (0.6 + 0.01  t )

<sup>a</sup> |t| = modulus of temperature in °C without regard to sign. For any value of R<sub>0</sub>.

## RECOMMENDED TERMINATION COLOUR CODES IEC 751(1995)



	Platinum Resistance Thermometer	Thermocouple	Thermistor
<b>Sensor</b>	Platinum-wire wound or flat-film resistor	Thermoelement, two dissimilar metals/alloys	Ceramic (metal oxides)
<b>Accuracy (typical values)</b>	0.1 to 1.0°C	0.5 to 5.0°C	0.1 to 1.5°C
<b>Long term Stability</b>	Excellent	Variable, Prone to ageing	Good
<b>Temperature range</b>	-200 to 650°C	-200 to 1750°C	-100 to 300°C
<b>Thermal response</b>	Wirewound – slow Film – faster 1-50 secs typical	Sheathed – slow Exposed tip – fast 0.1 to 10 secs typical	generally fast 0.05 to 2.5 secs typical
<b>Excitation</b>	Constant current required	None	None
<b>Characteristic</b>	PTC resistance	Thermovoltage	NTC resistance (some are PTC)
<b>Linearity</b>	Fairly linear	Most types non-linear	Exponential
<b>Lead resistance effect</b>	3 & 4 wire – low. 2 wire – high	Short cable runs satisfactory	Low
<b>Electrical “pick-up”</b>	Rarely susceptible	susceptible	Not susceptible
<b>Interface</b>	Bridge 2,3 or 4 wire	Potentiometric input. Cold junction compensation required	2 wire resistance
<b>Vibration effects/ shock</b>	wirewound – not suitable. Film – good	Mineral insulated types suitable	Suitable
<b>Output/ characteristic</b>	approx. 0.4 W/°C	From 10µV/°C to 40µV/°C depending on type	-4% / °C
<b>Extension Leads</b>	Copper	Compensating cable	Copper
<b>Cost</b>	Wirewound – more expensive Film – cheaper	Relatively low cost	Inexpensive to moderate

Comments and values shown in this chart are generalised and nominal. They are not intended to be definitive but are stated for general guidance.

## Choosing between a RTD Sensor and a Thermocouple

**Resistance Thermometers** utilise a high precision sensing resistor, usually platinum, the resistance value of which increases with temperature. The dominant standard adopted internationally is the Pt100 which has a resistance value of 100.0 Ohms at 0°C and a change of 38.50 Ohms between 0 and 100°C (the fundamental interval).

The platinum sensing resistor is highly stable and allows high accuracy temperature sensing. Resistance thermometer sensing resistors are 2 wire devices but the 2 wires will usually be extended in a 3 or 4 wire configuration according to the application, the associated instrumentation and accuracy requirements.

**Thermocouples** comprise a thermoelement which is a junction of two specified, dissimilar alloys and a suitable two wire extension lead. The junction is a short circuit only, the EMF is generated in the temperature gradient between the hot junction and the 'cold' or reference junction. This characteristic is reasonably stable and repeatable and allows for a family of alternative thermocouple types (e.g. J,K,T,N) to be used.

The alternative types are defined by the nature of the alloys used in the thermoelements and each type displays a different thermal EMF characteristic.

### RTD's are, generally:

- More expensive
- More accurate
- Highly stable (if used carefully)
- Capable of better resolution
- Restricted in their range of temperature
- Stem, not tip sensitive
- Rarely available in small diameters (below 3mm)

### Thermocouples are, generally:

- Relatively inexpensive
- More rugged
- Less accurate
- More prone to drift
- More sensitive
- Tip sensing
- Available in smaller diameters
- Available with a wider temperature range
- More versatile

**In both cases, the choice of thermocouple or RTD must be made to match the instrumentation and to suit the application.**

Sheath Material	Max Continuous ture	Notes	Applications
<b>Refractory Oxide recrystallised, e.g. Alumina Impervious</b>	1750°C	Good choice for rare metal thermocouples. Good resistance to chemical attack. Mechanically strong but severe thermal shock should be avoided.	Forging iron & steel. Incinerators carburizing and hardening in heat treatment. Continuous furnaces. Glass Lehrs.
<b>Silicon Carbide (Porous)</b>	1500°C	Good level of protection even in severe conditions. Good resistance to reasonable levels of thermal shock. Mechanically strong when thick wall is specified but becomes brittle when aged. Unsuitable for oxidising atmospheres but resists fluxes.	Forging iron & steel. Incinerators Billet heating, slab heating, butt welding. Soaking pits ceramic dryers.
<b>Impervious Mullite</b>	1600°C	Good choice for rare metal thermocouples under severe conditions. Resists Sulphurous and carbonaceous atmospheres. Good resistance to thermal shock should be avoided.	Forging iron & steel. Incinerators. Heat treatment. Glass flues. Continuous furnaces.
<b>Mild Steel (cold drawn seamless)</b>	600°C	Good physical protection but prone to rapid corrosion.	Annealing up to 500°C. Hardening pre-heaters. Baking ovens.
<b>Stainless steel 25/20</b>	1150°C	Resists corrosion even at elevated temperature. Can be used in Sulphurous atmospheres.	Heat treatment annealing, flues, many chemical processes. Vitreous enamelling. Corrosion resistant alternative to mild steel.
<b>Inconel 600/800*</b>	1200°C	Nickel-Chromium-Iron alloy which extends the properties of stainless steel 25/20 to higher operating temperatures. Excellent in Sulphur free atmospheres; superior corrosion resistance at higher temperatures. Good mechanical strength.	Annealing, carburizing, hardening. Iron and steel hot blast. Open hearth flue & stack. Waste heat boilers. Billet heating, slab heating. Continuous furnaces. Soaking pits. Cement exit flues & kilns. Vitreous enamelling. Glass flues and checkers. Gas superheaters. Incinerators up to 1000°C. Highly sulphurous atmospheres should be avoided above 800°C.
<b>Chrome Iron</b>	1100°C	Suitable for very adverse environments. Good mechanical strength. Resists severely corrosive and sulphurous atmospheres.	Annealing, carburizing, hardening. Iron & steel hot blast. Open hearth flue and stack. Waste heat boilers. Billet heating, slab heating. Continuous furnaces. Soaking pits. Cement exit flues & kilns. Vitreous enamelling. Glass flues and checkers. Gas superheaters. Incinerators up to 1000°C.
<b>Microbell*</b>	1300°C	Highly stable in vacuum and oxidising atmospheres. Corrosion resistance generally superior to stainless steels. Can be used in Sulphurous atmospheres at reduced temperatures. High operating temperature.	As Inconel plus excellent choice for vacuum furnaces and flues.

\* Tradenames

Sheath materials range from mild and stainless steels to refractory oxides (ceramics, so called) and a variety of exotic materials including rare metals. The choice of sheath must take account of operating temperature, media characteristics, durability and other considerations including the material relationship to the type of sensor.

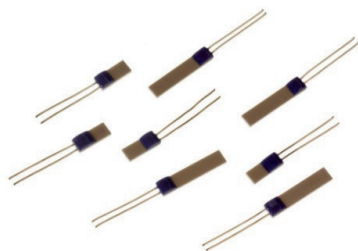
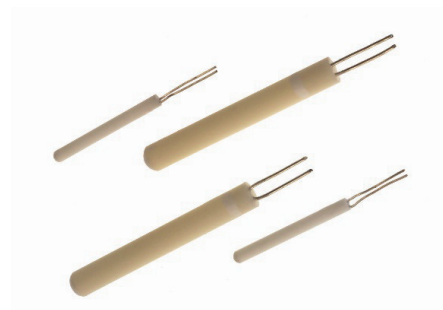

**A Thin Film Detectors**

**B Wire-Wound Detector Elements**

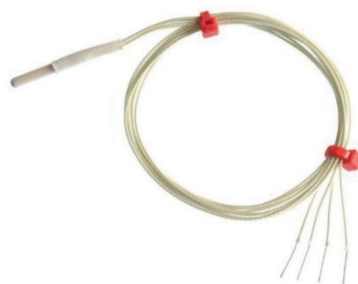
Image	Resistance	Dimensions (width x length)	Tolerance Class A		Tolerance Class B		Tolerance Class 1/3 Din	
			RS order code	Allied code	RS order code	Allied code	RS order code	Allied code
<b>A</b>	Pt100	2 x 5mm	611-7788	70646146	611-7801	70646148	-	-
<b>A</b>	Pt100	2 x 10mm	362-9799	70643577	237-1607	70641762	362-9812	70643578
<b>A</b>	Pt100	2 x 2.3mm	362-9834	70643579	362-9840	70643580	362-9856	70643581
<b>A</b>	Pt1000	2 x 10mm	362-9907	70643582	362-9913	70643583	814-0178	70656472
<b>A</b>	Pt1000	1 x 3mm	-	-	814-0171	70656470	-	-
<b>A</b>	Pt1000	1.25 x 1.7mm	-	-	814-0175	70656471	-	-

Image	Resistance	Dimensions (Dia x length)	Tolerance Class A		Tolerance Class B		Duel Element (Pt100 x2) Tolerance Class A	
			RS order code	Allied code	RS order code	Allied code	RS order code	Allied code
<b>B</b>	Pt100	1.5 x 8mm	611-7873	70646155	611-7851	70646153	-	-
<b>B</b>	Pt100	1.5 x 15mm	611-7839	70646151	611-7867	70646154	397-1595	70643873
<b>B</b>	Pt100	2.8 x 15mm	611-7845	70646152	611-7823	70646150	-	-
<b>B</b>	Pt100	2.8 x 25mm	611-7817	70646149	611-7794	70646147	-	-


This is just a small selection of Detectors offered by RS / Allied

**A**

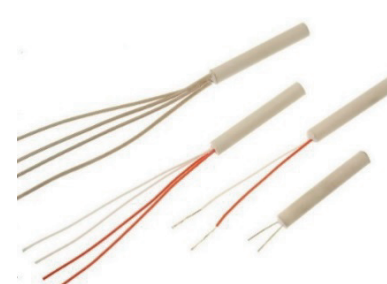**Platinum Resistance Pt100 & Pt1000 Detectors with Extended Leads**

**B**

**Pt100 Ceramic Wire-Wound**

**C**

**Pt100 Tubular Ceramic Insert Elements with tail wires**

Image	Type	Class	Detector (WxL)	Cable Length	AWG	Cable Type	Termination	RS Order Code	Allied Code
<b>A</b>	Pt100	B	2 x 10mm	300mm	24 AWG	Teflon® insulated	2 Wire	891-9132	-
<b>A</b>	Pt100	A	2 x 10mm	1000mm	26 AWG	Teflon® insulated	4 Wire	891-9145	-
<b>A</b>	Pt1000	B	2 x 10mm	500mm	24 AWG	Teflon® insulated	2 Wire	891-9157	-

Image	Type	Class	Detector (WxL)	Cable Length	AWG	Cable Type	Termination	RS Order Code	Allied Code
<b>B</b>	Pt100	B	2.8 x 15mm	300mm	26 AWG	Teflon® insulated	2 Wire	110-4460	-
<b>B</b>	Pt100	B	2.8 x 15mm	500mm	26 AWG	Teflon® insulated	4 Wire	891-9160	-
<b>B</b>	Pt100	B	2.8 x 15mm	1000mm	26 AWG	Teflon® insulated	4 Wire	891-9163	-

Image	Type	Ceramic Diameter	Ceramic Length	Lead Length	Cable Type	Termination	RS Order Code	Allied Code
<b>C</b>	Pt100	5mm	35mm	50mm	7/0.2mm SPC Teflon	2 Wire	237-1641	70641766
<b>C</b>	Pt100	5mm	35mm	450mm	7/0.2mm SPC Teflon	4 Wire	237-1657	70641767
<b>C</b>	Pt100	5mm	35mm	10mm	1/0.4mm Nickel	4 Wire	237-1629	70641764

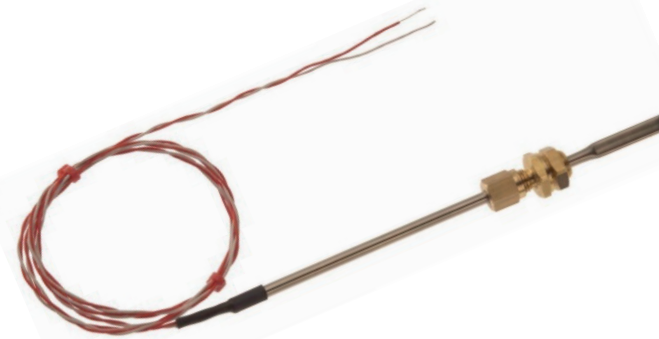
This is just a small selection of Pt100 Sensors offered by RS / Allied

**A**

**Pt100 Heavy Duty Sensor Probe,  
Class B**

**B**

**Pt100 Sheathed Thin Film  
Strip Sensor**

**C**

**PT100 'Flat Tip' Probe**

Image	Type	Class	Probe Diameter	Probe Length	Cable Length	Cable Type	RS Order Code	Allied Code
<b>A</b>	Pt100	B	6mm	50mm	2m	Flexible silicone rubber insulated, 7/0.2mm	455-3968	70644349
<b>A</b>	Pt100	B	6mm	100mm	2m	Flexible silicone rubber insulated, 7/0.2mm	611-8264	70646193

Image	Type	Class	Strip Dimensions (LxWxH)	Cable Length	Cable Type	RS Order Code	Allied Code
<b>B</b>	Pt100	B	35mm x 6mm x 2mm	1m	7/.02mm Teflon® insulated twin twisted lead	237-1613	70641763

Image	Type	Class	Probe Diameter	Probe Length	Cable Length	Cable Type	RS Order Code	Allied Code
<b>C</b>	Pt100	B	4mm	150mm	1m	7/0.2mm Teflon® insulated 2 twisted leads	237-1663	70641768

This is just a small selection of Pt100 Sensors offered by RS / Allied



**A**

**Platinum Resistance Thermometer Pt100 Precision Probe**

**B**

**Platinum Resistance Pt100 Dual Element Mineral Insulated Sensor Probe**

**C**

**Platinum Resistance Pt100 Dual Element Industrial Sensor Probe**

Image	Type	Class	Probe Length	Cable Length	Cable Type	Termination	Probe Temperature Range	RS Order Code	Allied Code
<b>A</b>	Pt100	1/5 <sup>th</sup> Din	250mm	2m	7/0.2mm PTFE insulated with silver plated copper screen	4 Wire	-50°C to +250°C	236-4299	70641759

Image	Type	Class	Probe Length	Cable Length	Cable Type	Termination	Probe Temperature Range	RS Order Code	Allied Code
<b>B</b>	Mineral Insulated Duplex PRT	B	150mm	1m	7/0.2mm flexible 6 core Teflon® insulated & screened	2 x 3 wire	-50°C to +500°C	397-1416	70643859

Image	Type	Class	Probe Length	Cable Length	Cable Type	Termination	Probe Temperature Range	RS Order Code	Allied Code
<b>C</b>	Pt100	B	150mm	1m	7/0.2mm flexible 6 core Teflon® insulated & screened	2 x 3 wire	-50°C to +250°C	397-1393	70643857

This is just a small selection of Pt100 Sensors offered by RS / Allied



**A** Platinum Resistance Pt100 Class B Sensors with Teflon Insulated lead in a Stainless-Steel Tube



**B** Platinum Resistance Pt1000 Class B Sensor with Teflon insulated lead in a Stainless-Steel Tube




**C** Platinum Resistance Thermometer Pt100 Industrial Sensor Probe, Class B, in a Stainless-Steel Tube

Image	Type	Class	Probe Diameter	Probe Length	Cable Length	Cable Type	Termination	RS Order Code	Allied Code
<b>A</b>	Pt100	B	3mm	25mm	1m	Teflon® insulated	4 Wire	762-1134	70651745
<b>A</b>	Pt100	B	3mm	100mm	1m	Teflon® insulated	4 Wire	158-985	70636467
<b>A</b>	Pt100	B	4mm	90mm	1m	Teflon® insulated	4 Wire	123-5610	-

Image	Type	Class	Probe Diameter	Probe Length	Cable Length	Cable Type	Termination	RS Order Code	Allied Code
<b>B</b>	Pt1000	B	4mm	40mm	1m	Teflon® insulated	2 Wire	123-5612	-

Image	Type	Class	Probe Diameter	Probe Length	Cable Length	Cable Type	Termination	RS Order Code	Allied Code
<b>C</b>	Pt100	B	3mm	150mm	1m	Teflon® insulated, Screened	4 Wire	362-9935	-
<b>C</b>	Pt100	B	4mm	25mm	2m	Teflon® insulated, Screened	4 Wire	123-5588	-
<b>C</b>	Pt100	B	4.5mm	125mm	2m	Teflon® insulated, Screened	4 Wire	123-5597	-
<b>C</b>	Pt100	B	6mm	300mm	2m	Teflon® insulated, Screened	4 Wire	123-5606	-

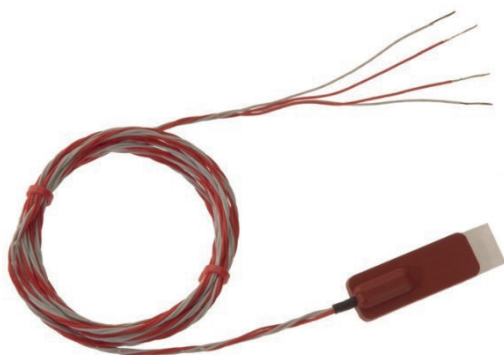This is just a small selection of Pt100 Sensors offered by RS / Allied



**A** Pt100 Silicone Patch Sensor



**B** Pt1000 Silicone Patch Sensor

Image	Type	Class	Patch Length	Patch Width	Patch Height	Cable Length	Cable Type	Termination	RS Order Code	Allied Code
<b>A</b>	Pt100	B	40mm	13mm	5mm	2m	Teflon Insulated, 7/0.2mm	4 Wire	285-661	70637793
<b>A</b>	Pt100	B	40mm	13mm	5mm	5m	Teflon Insulated, 7/0.2mm	4 Wire	762-1137	70651746

Image	Type	Class	Patch Length	Patch Width	Patch Height	Cable Length	Cable Type	Termination	RS Order Code	Allied Code
<b>B</b>	Pt1000	B	30mm	15mm	4mm	1m	Teflon Insulated, 7/0.2mm	2 Wire	762-1130	70651744

This is just a small selection of Pt100 Sensors offered by RS / Allied

**A**

**Platinum Resistance Pt100 Hygienic Thermometer, 1.5" RJT style fitting**

**B**

**Platinum Resistance Pt100 Hygienic Thermometer, 1.5" Tri-Clamp fitting**


Image	Sensor Type	Sheath Diameter	Sheath Length	Support Diameter	Support Length	Transmitter Fitted (3 Wire Configuration)		No Transmitter Fitted (4 Wire Configuration)	
						RS Order Code	Allied Code	RS Order Code	Allied Code
<b>A</b>	Pt100	6mm	75mm	8mm	50mm	872-2761	-	872-2764	-
<b>A</b>	Pt100	6mm	125mm	8mm	50mm	872-2770	-	872-2767	-

Image	Sensor Type	Sheath Diameter	Sheath Length	Support Diameter	Support Length	Transmitter Fitted (3 Wire Configuration)		No Transmitter Fitted (4 Wire Configuration)	
						RS Order Code	Allied Code	RS Order Code	Allied Code
<b>B</b>	Pt100	6mm	75mm	8mm	50mm	872-2786	-	872-2773	-
<b>B</b>	Pt100	6mm	125mm	8mm	50mm	872-2789	-	872-2777	-

**This is just a small selection of Pt100 Sensors offered by RS / Allied**



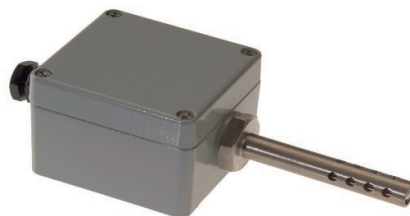**A** Platinum Resistance  
Pt100 Indoor Air  
Temperature Sensor



**B** Platinum Resistance Thermometer  
Pt100 Outdoor/Cold Store  
Temperature Sensors



**C** 4-20mA remote wall mounted housing,  
Platinum Resistance Pt100 input with 1 metre  
lead

Image	Class	Length	Width	Height	Indoor/Outdoor Use?	RS Order Code	Allied Code
<b>A</b>	B	85mm	85mm	30mm	Indoor Only	338-9491	70643384

Image	Class	Length	Width	Height	Elements Type	Pt100 Connection	4-20Ma Output	Indoor/Outdoor Use?	RS Order Code	Allied Code
<b>B</b>	B	80mm	74mm	54mm	Single	4 Wire	No	Indoor or Outdoor use	236-4283	70641758
<b>B</b>	B	80mm	74mm	54mm	Duplex	2 x 4 Wire	No	Indoor or Outdoor use	455-4208	70644358
<b>B</b>	B	80mm	74mm	54mm	Single	3 Wire	Yes [2 Wire]	Indoor or Outdoor use	455-4214	70644359

Image	Cable Glands	Cable Length	Cable Insulation	Transmitter Fitted?	Transmitter Range	Indoor/Outdoor Use?	RS Order Code	Allied Code
<b>C</b>	M16	1000mm	PFA Teflon	Yes	-50°C to +150°C	Indoor Only	872-2758	-
<b>C</b>	M16	1000mm	F/G + SSOB	Yes	0°C to + 400°C	Indoor Only	872-2751	-

This is just a small selection of Pt100 Sensors offered by RS / Allied



**A** Platinum Resistance Pt100 4 wire class B Resistance Thermometer with DIN B Head



**B** Platinum Resistance Pt100 4 wire class B Resistance Thermometer with Compact KNS Head



**C** Platinum Resistance Pt100 3 wire class B Resistance Thermometer with KNE Head and Fitted Transmitter

Image	Sensor Type	Probe Diameter	Probe Length	Head Termination	RS Order Code	Allied Code
<b>A</b>	Pt100	6mm	100	IP67 Din B Head	872-2736	-
<b>A</b>	Pt100	6mm	200	IP67 Din B Head	872-2733	-
<b>A</b>	Pt100	6mm	500	IP67 Din B Head	872-2749	-

Image	Sensor Type	Probe Diameter	Probe Length	Head Termination	RS Order Code	Allied Code
<b>B</b>	Pt100	6mm	150	IP67 KNS Head	872-2711	-
<b>B</b>	Pt100	6mm	250	IP67 KNS Head	872-2720	-
<b>B</b>	Pt100	6mm	300	IP67 KNS Head	872-2727	-

Image	Sensor Type	Probe Diameter	Probe Length	Head Termination	Transmitter Fitted?	Transmitter Range	RS Order Code	Allied Code
<b>C</b>	Pt100	6mm	150	IP67 KNE Head	Yes	-50°C to +150°C	872-2708	-
<b>C</b>	Pt100	6mm	150	IP67 KNE Head	Yes	0°C to 100°C	872-2701	-
<b>C</b>	Pt100	6mm	150	IP67 KNE Head	Yes	0°C to 200°C	872-2705	-
<b>C</b>	Pt100	6mm	150	IP67 KNE Head	Yes	0°C to 400°C	872-2714	-

This is just a small selection of Pt100 Sensors offered by RS / Allied

**A**

**4 wire sensor with 1/2"BSPP  
process connection**

**B**

**Replaceable insert for 4 wire sensor  
with 1/2"BSPP process connection**

Image	Type	Class	Probe Diameter	Probe Length Below 1/2" BSPP Process Connection	Lagging Length	Termination	RS Order Code	Allied Code
<b>A</b>	Pt100	B	8mm	250mm	75mm	KNE Head	455-3980	70644351

Image	Type	Class	Probe Diameter	Replaceable insert Length	RS Order Code	Allied Code
<b>B</b>	Pt100	B	6mm	275mm	455-4012	70644353

This is just a small selection of Pt100 Sensors offered by RS / Allied

## L200 Digital Thermometer & Data Logger



The Labfacility L200 Pt100 thermometer can be used in conjunction with a PC to provide accurate, Pt100 temperature measurement, scanning and logging of measured values. It can also be used as a “stand alone” indicator/logger and incorporates a digital display of measured temperature.

Self-calibration of Pt100 ranges is simple and uses plug-in precision resistors.

The L200 is designed to provide exceptional stability with high measurement resolution and represents an ideal crossover between plant practicality and laboratory performance at a very competitive price.

RS Code	Allied Code
910-6826	-

## L300 8-ZONE TEMPERATURE ALARM / ON-OFF CONTROLLER WITH 10A SWITCHING FOR LABORATORY / TRAINING APPLICATIONS



The Labfacility L300 Pt100 temperature alarm / on-off controller can be used in conjunction with a PC to provide accurate monitoring and alarm or on-off control of up to 8- zones simultaneously. It can also be used as a stand-alone instrument without the need for a PC.

The PC software supplied with the instrument allows control, configuration, measurement, logging, charting, alarm & relay configuration and calibration functions via a PC.

Self-calibration of Pt100 ranges is simple and uses plug-in precision resistors.

RS Code	Allied Code
910-6823	-



*Information given here is for general guidance only and is not definitive – it is not intended to be the basis for product installation or decision making.*

**Q. How accurately can I measure temperature using a standard sensor?**

A. To published, internationally specified tolerances as standard, typically  $\pm 2.5^{\circ}\text{C}$  for popular thermocouples,  $\pm 0.5^{\circ}\text{C}$  for PRT. Higher accuracy sensors can be supplied to order, e.g.  $\pm 0.5^{\circ}\text{C}$  for type T thermocouple,  $\pm 0.2^{\circ}\text{C}$  for PRT. All of these values are temperature dependent. A close tolerance, 4-wire PRT will give best absolute accuracy and stability.

**Q. How do I choose between a thermocouple and a PRT?**

A. Mainly on the basis of required accuracy, probe dimensions, speed of response and the process temperature.

**Q. What is the difference between a RTD and PRT sensor?**

A. Nothing. RTD means resistance thermometer detector (the sensing element) and PRT means Platinum resistance thermometer (the whole assembly) i.e. a PRT uses a RTD!

**Q. What is a Pt100?**

A. An industry standard Platinum RTD with a value of 100 Ohms @  $0^{\circ}\text{C}$  to IEC751; this is used in the vast majority of PRT assemblies in most countries.

**Q. Are there other types of temperature sensor apart from thermocouple and PRT Types?**

A. Several, but these two groups are the most common. Alternatives include thermistors, infra-red (non-contact), conventional thermometers (stem & dial types) and many others.

**Q. Why offer 2,3 or 4 wire PRT probes?**

A. Because all 3 are encountered. Two-wire should be avoided, three-wire is widely used and four-wire gives optimum accuracy. Your instrument will be configured for 2,3 or 4 wire.

**Q. What is the minimum immersion depth for a PRT probe?**

A. Usually 150mm or more; increase the immersion until the reading is unchanged.

**Q. What is the practical difference between wire-wound and film RTDs?**

A. Wire-wound type provides greater accuracy and stability but is vulnerable to shock; film type is resistant to shock and has quicker thermal response.

**Q. Is a sensor with a calibration certificate more accurate than an uncalibrated one?**

A. No. However, the errors and uncertainties compared with a reference sensor are published and corrected values can be used to obtain better measurement accuracy.

**Q. How long will my sensor last in the process?**

A. Not known but predictable in some cases; this will be a function of sensor type, construction, operating conditions and handling.

**Q. What is the longest thermocouple I can have without losing accuracy?**

A. Try to ensure a maximum sensor loop resistance of 100 Ohms for thermocouples and 4 wire PRTs. Exceeding 100 Ohms could result in a measurement error. Note By using a 4-20mA transmitter near the sensor, cable runs can be much longer and need only cheaper copper wire. The instrument must be suitable for a 4-20mA input though.

**Q. Do I need a power supply when using a transmitter, and what length of extension lead can I run with a transmitter fitted?**

A. A 24Vdc, 20mA supply will be needed if this is not incorporated in the measuring instrument. Long runs of copper cable can be used.

**Q. What accuracy will I get at a certain temperature using a Pt100 detector; if a better grade detector is used what effect will this have to the accuracy?**

A. Refer to this Labfacility Temperature Handbook for Pt100 tolerance information.

**Q. What accuracy loss will I get using a transmitter in line?**

A. This depends on the accuracy of the specified transmitter; there will always be some degradation.

**Q. As most instrumentation only takes 2 or 3 wire Pt100s, if I took the correction made on the 3 wire system and incorporated that on to the single leg could I achieve a 4 wire system?**

A. No; cable length and ambient temperature variations come into play.

**Q. What is the difference between a flat film and wire wound Pt100 element?**

A. Film uses platinum deposition on a substrate; wire wound uses a helically wound Pt wire in ceramic. Wire-wound type provides greater accuracy and stability but is vulnerable to shock; film type is resistant to shock and has quicker thermal response.

*Information given here is for general guidance only and is not definitive – it is not intended to be the basis for product installation or decision making.*