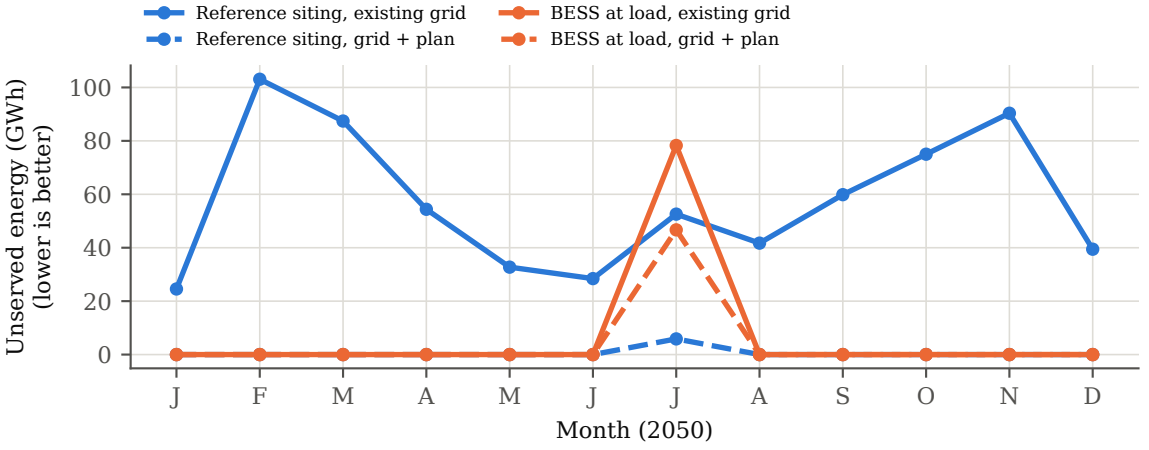
Reference siting, existing grid
Reference siting, grid + plan
BESS at load, existing grid
BESS at load, grid + plan
Unserved energy (GWh)
(lower is better)
100
80
60
40
20
0
J
F
M
A
M
J
J
A
S
O
N
D
Month (2050)