

-ARMOIRE

N° Armoire : X2

Matière du coffret : INOX

Taille du coffret : 600x600x300

Marque du coffret : IRINOX

Matière des boîtiers : INOX

Equipements utilisés :

Marque boutonnerie : SCHNEIDER ELECTRIC

Langue boutonnerie : /

Marque automate : /

Marque IHM : /

Câblage

Pouvoir de coupure Icc : 10kA

Câbles blindés sur les variateurs

Couleurs des fils :

Phase 230V : Noir

Neutre 230V : Bleu

Phase 115V : Marron

Neutre 115V : Marron bagué bleu

Terre : Vert/Jaune

Potentiel extérieur : Orange

Neutre extérieur : Orange bagué bleu

24VDC : Violet

12VDC ou 15VDC : Rouge

5VDC : Gris

48VDC : Jaune

0VDC : Blanc

Caractéristiques électriques estimées

Puissance nominale totale (kW) : 1

Courant nominal total (Amps) :

Disjoncteur principal conseillé (Client)

Calibre du disjoncteur (Amps) : 16A

Courbe du disjoncteur (type) : D

Section minimale du câble d'alimentation (Client) :

400V+3PH+N+GND

Section du fil (mm²) : 2,5mm²

Type de câble (Nombre de fils) : 5G2,5mm²

H07 RNF / U1000 R2V

Le disjoncteur principal et le câble d'alimentation peuvent être différents en fonction de l'installation électrique (Matériau du câble, longueur, méthode d'installation, ...)

CE DOCUMENT EST LA PROPRIETE DE ECAT-ID. IL EST REMIS A TITRE CONFIDENTIEL.
IL NE DOIT PAS ETRE REPRODUIT OU COMMUNIQUE A DES TIERS SANS NOTRE AUTORISATION ECRITE.

V1	Création	22/04/2026	YR	YR	
INDEX	MODIFICATION	DATE	DESSINÉ PAR	VÉRIFIÉ PAR	APPROUVÉ PAR

COFFRET CONVOYEUR DE SORTIE GENESYS

GENESYS OUTFEED CONVEYOR CABINET

DESSINÉ PAR : YR

VÉRIFIÉ PAR : JT

DATE DE CRÉATION : 21/04/2026

CLIENT : CMI

N° CONTRAT : C01554

N° PROCESS : PMXA_C015541

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tel : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

ENVIRONNEMENT IGE-XAO : Elec_IEC V5R2_ECATID Environment for electrical controls and automation systems (according to IEC standard)

FOLIO : 01/23



Ecat-iD Campus

PAYS :
HONDURAS

NUMÉRO DE SCHÉMA :
SMXA-OPT02-C015541

[illegible][illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36	Date of creation : 21/04/2026		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus					CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS			
			Fax : (33).2.98.85.31.38	Designed by : YR		FRENCH FOLIOS LIST									ARTICLE : MXA-OPT02-C015541						INDEX : V1	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								Folio : 02/23							

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A	
																				B	
																				C	
																				D	
																				E	
																				F	
																				G	
																				H	
																				I	
																				J	
																				K	
																				L	
																				M	
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE				Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
				Fax : (33).2.98.85.31.38		Designed by : YR		FRENCH FOLIOS LIST								ARTICLE : MXA-OPT02-C015541		INDEX : V1			
				E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								Folio : 03/23					


[illegible][illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		ENGLISH FOLIOS LIST								ARTICLE : V1				INDEX : V1	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								MXA-OPT02-C015541 04/23					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecaticid.service@ceva.com		Date of creation : 21/04/2026		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
					Designed by : YR		ENGLISH FOLIOS LIST								ARTICLE : MXA-OPT02-C015541				INDEX : V1	
					ENVIRONNEMENT : Elec_IEC V5R2_ECATICID				Folio : 05/23											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

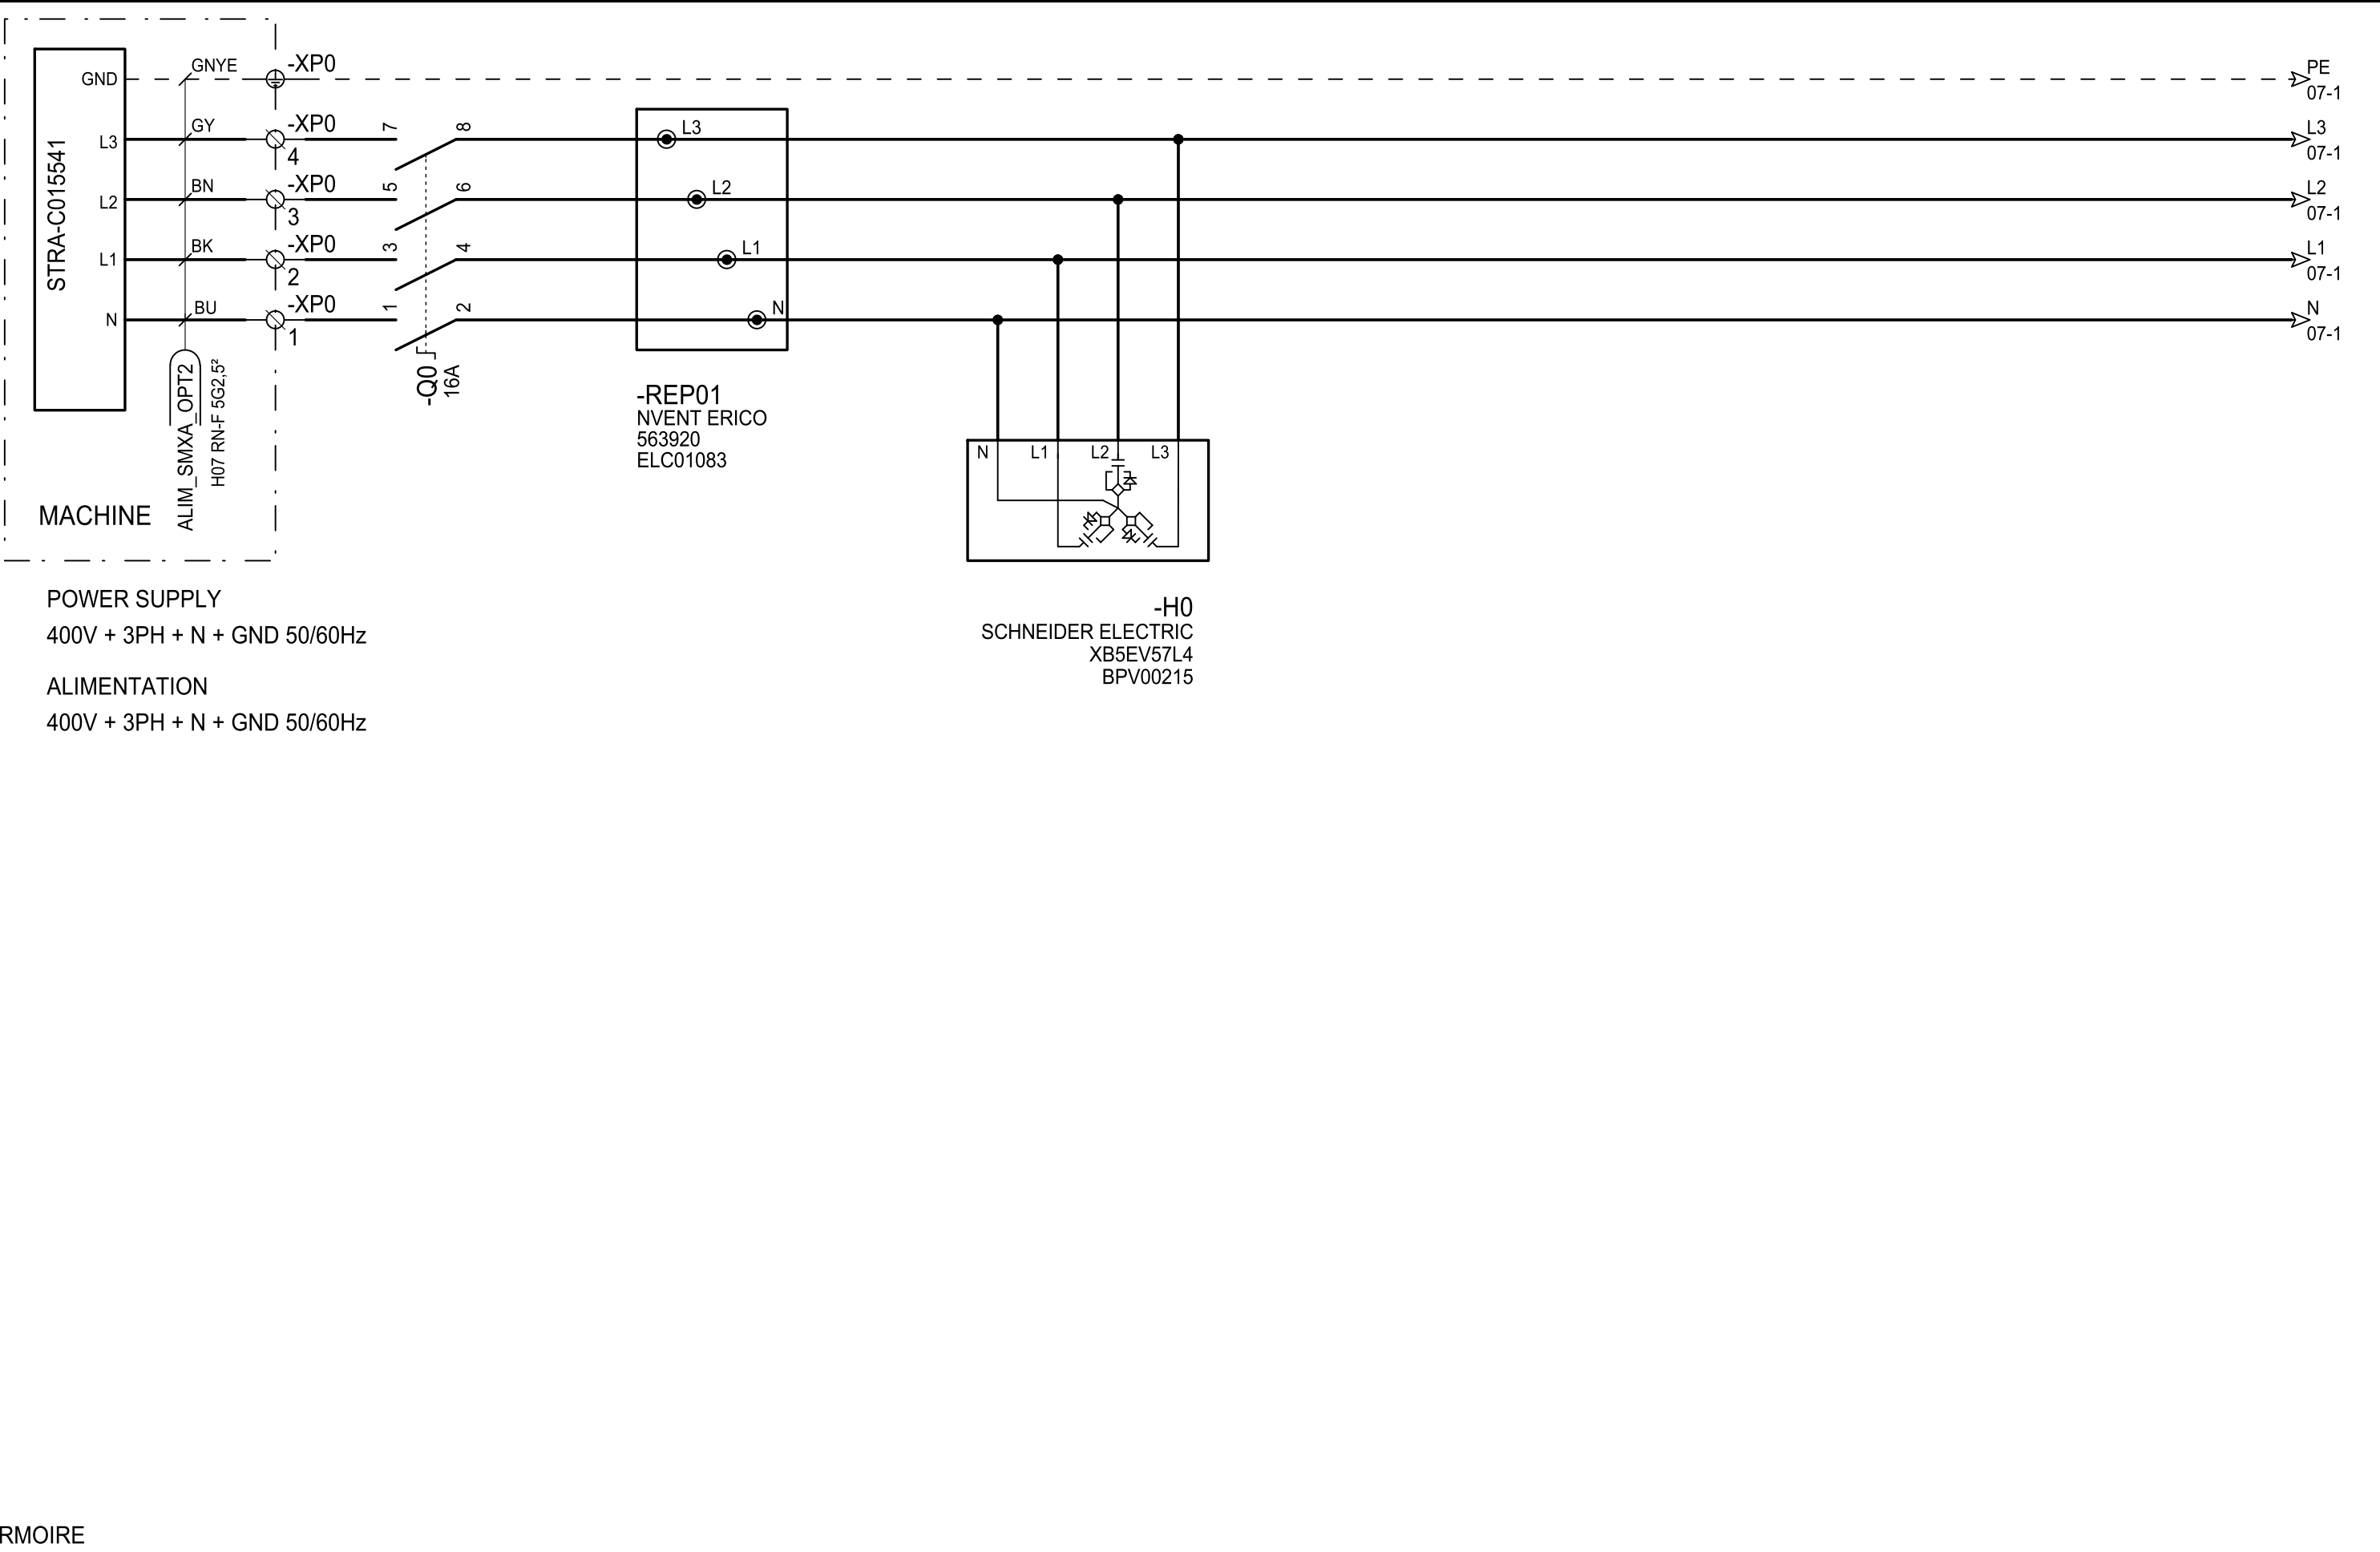

POWER SUPPLY

400V + 3PH + N + GND 50/60Hz

ALIMENTATION

400V + 3PH + N + GND 50/60Hz

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
21/04/2026

Designed by :
YR

SCHEMA DE PUISSANCE

POWER DIAGRAM

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :

C01554

CUSTOMER :

CMI

COUNTRY :

HONDURAS

ARTICLE :

MXA-OPT02-C015541


INDEX :

V1


Folio :

06/23

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

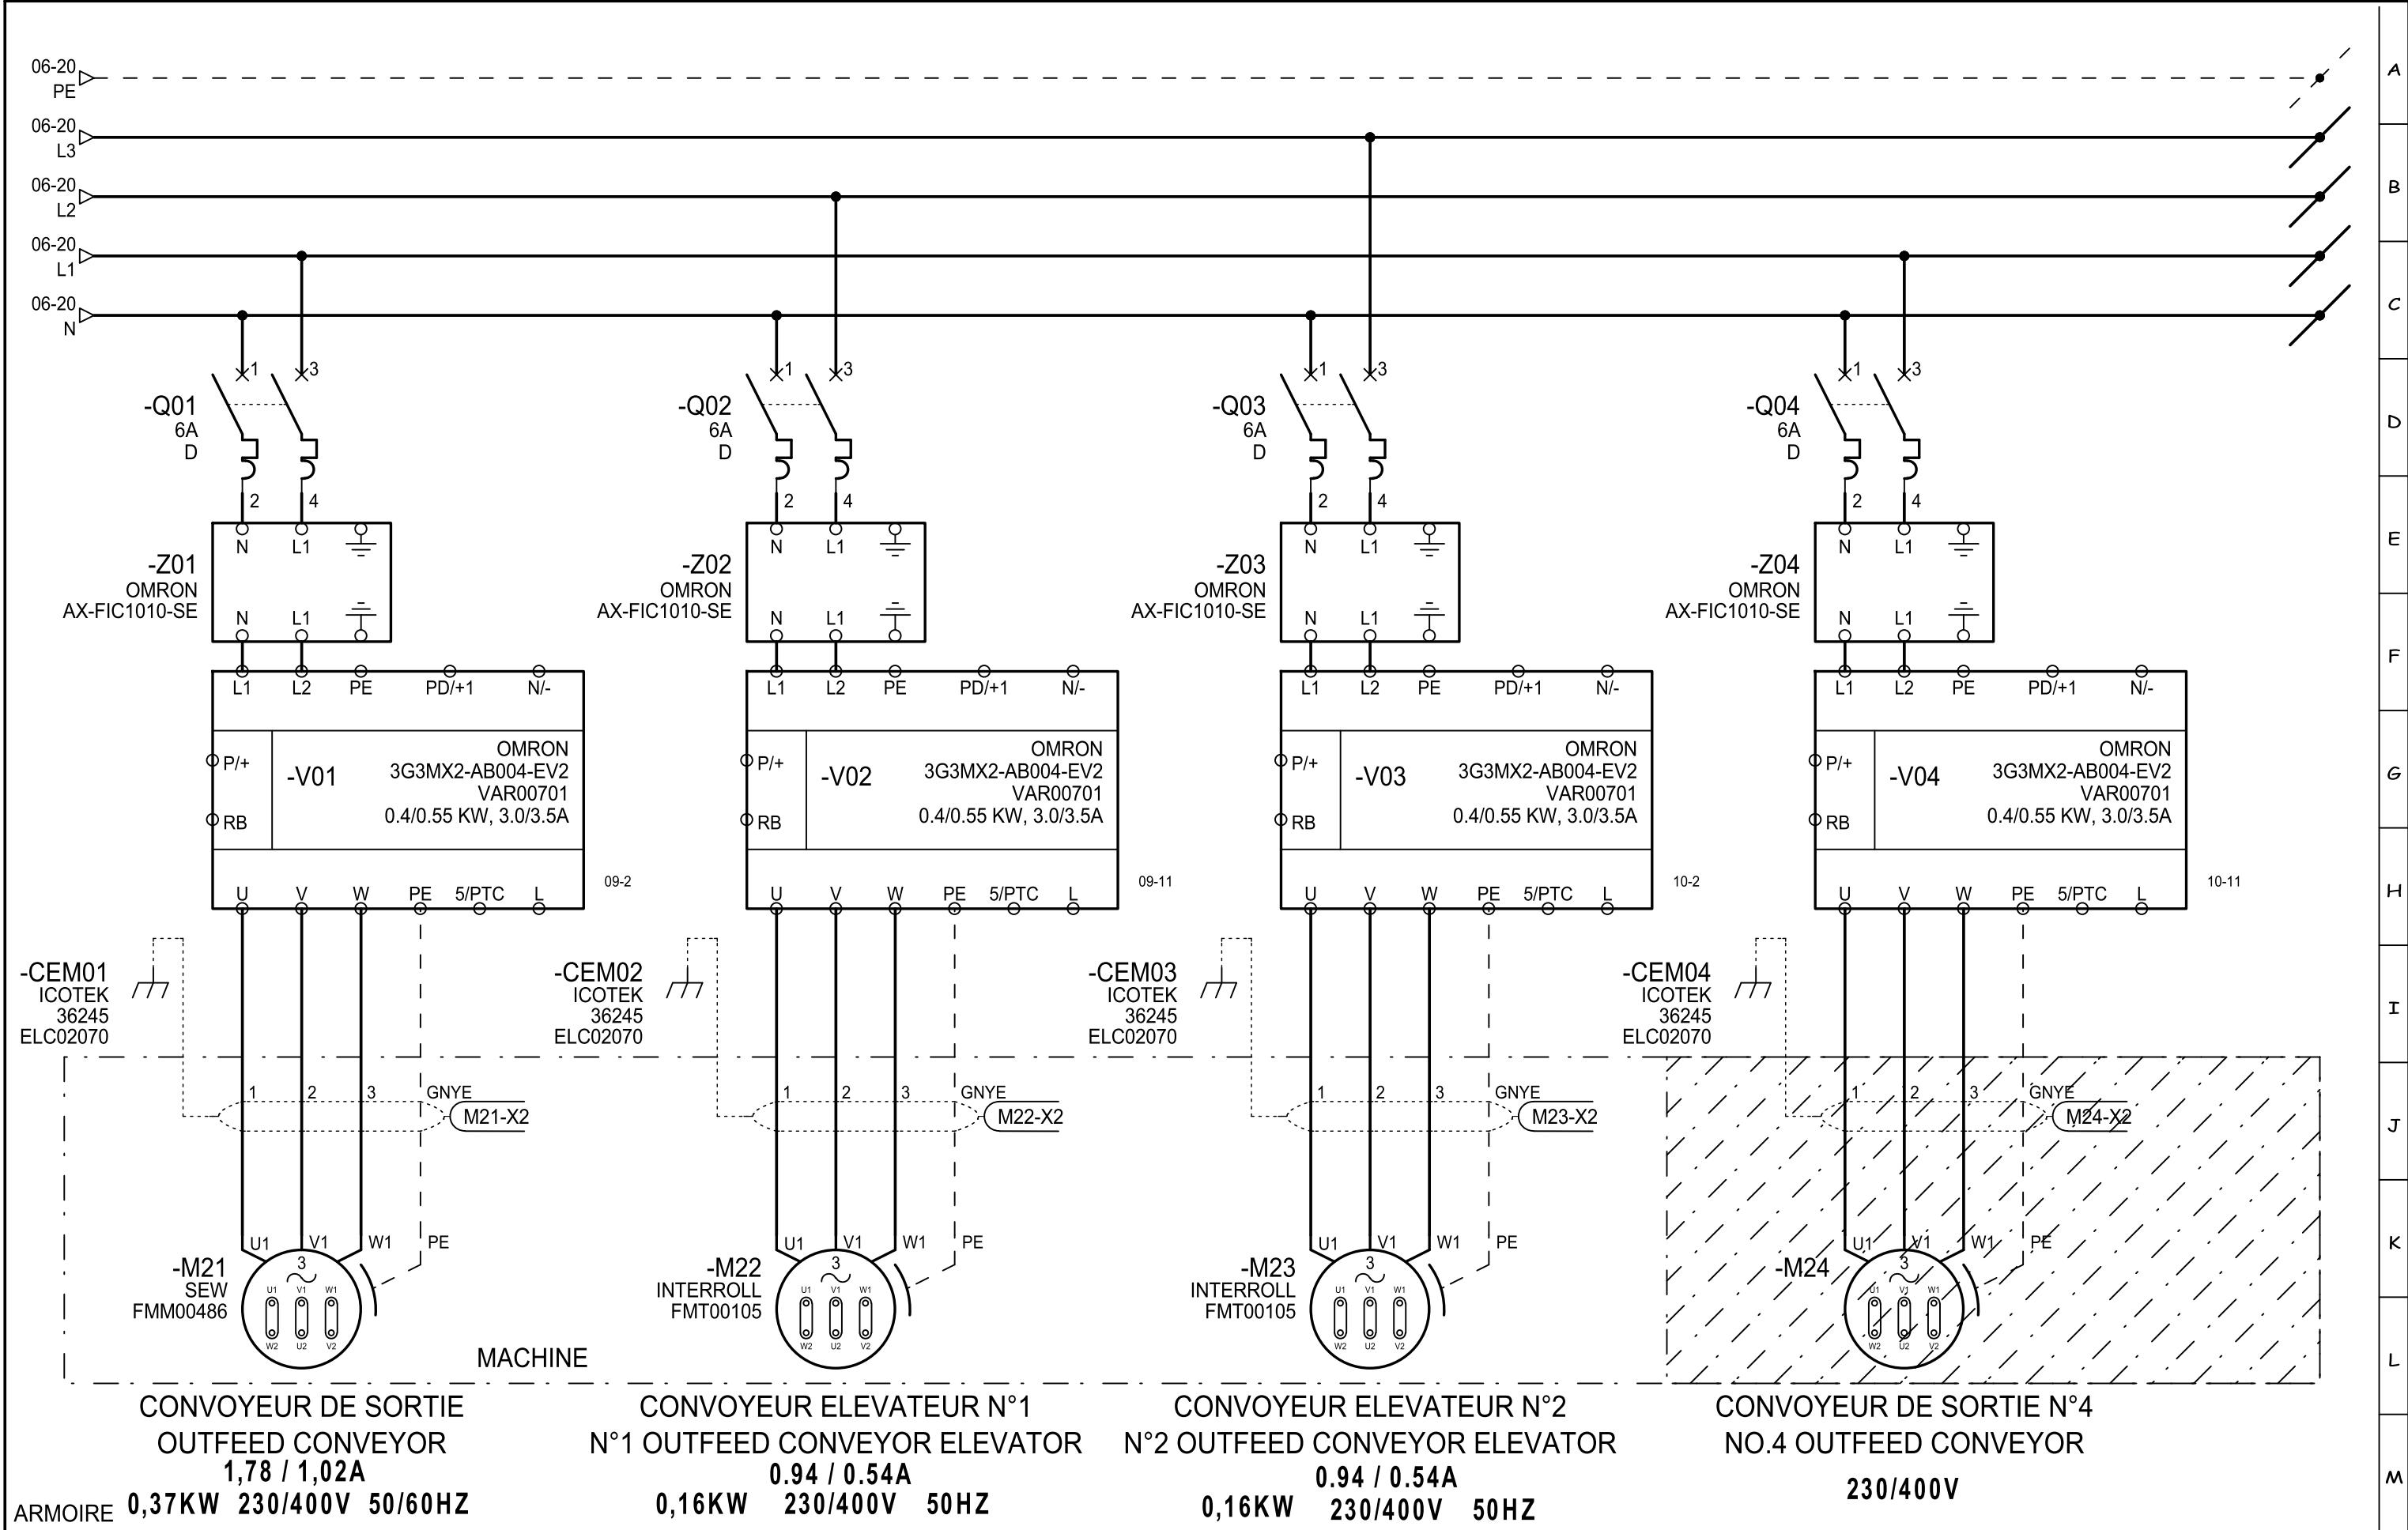

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		SCHEMA DE PUISSANCE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		POWER DIAGRAM								ARTICLE : MXA-OPT02-C015541		INDEX : V1			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								Folio : 07/23					

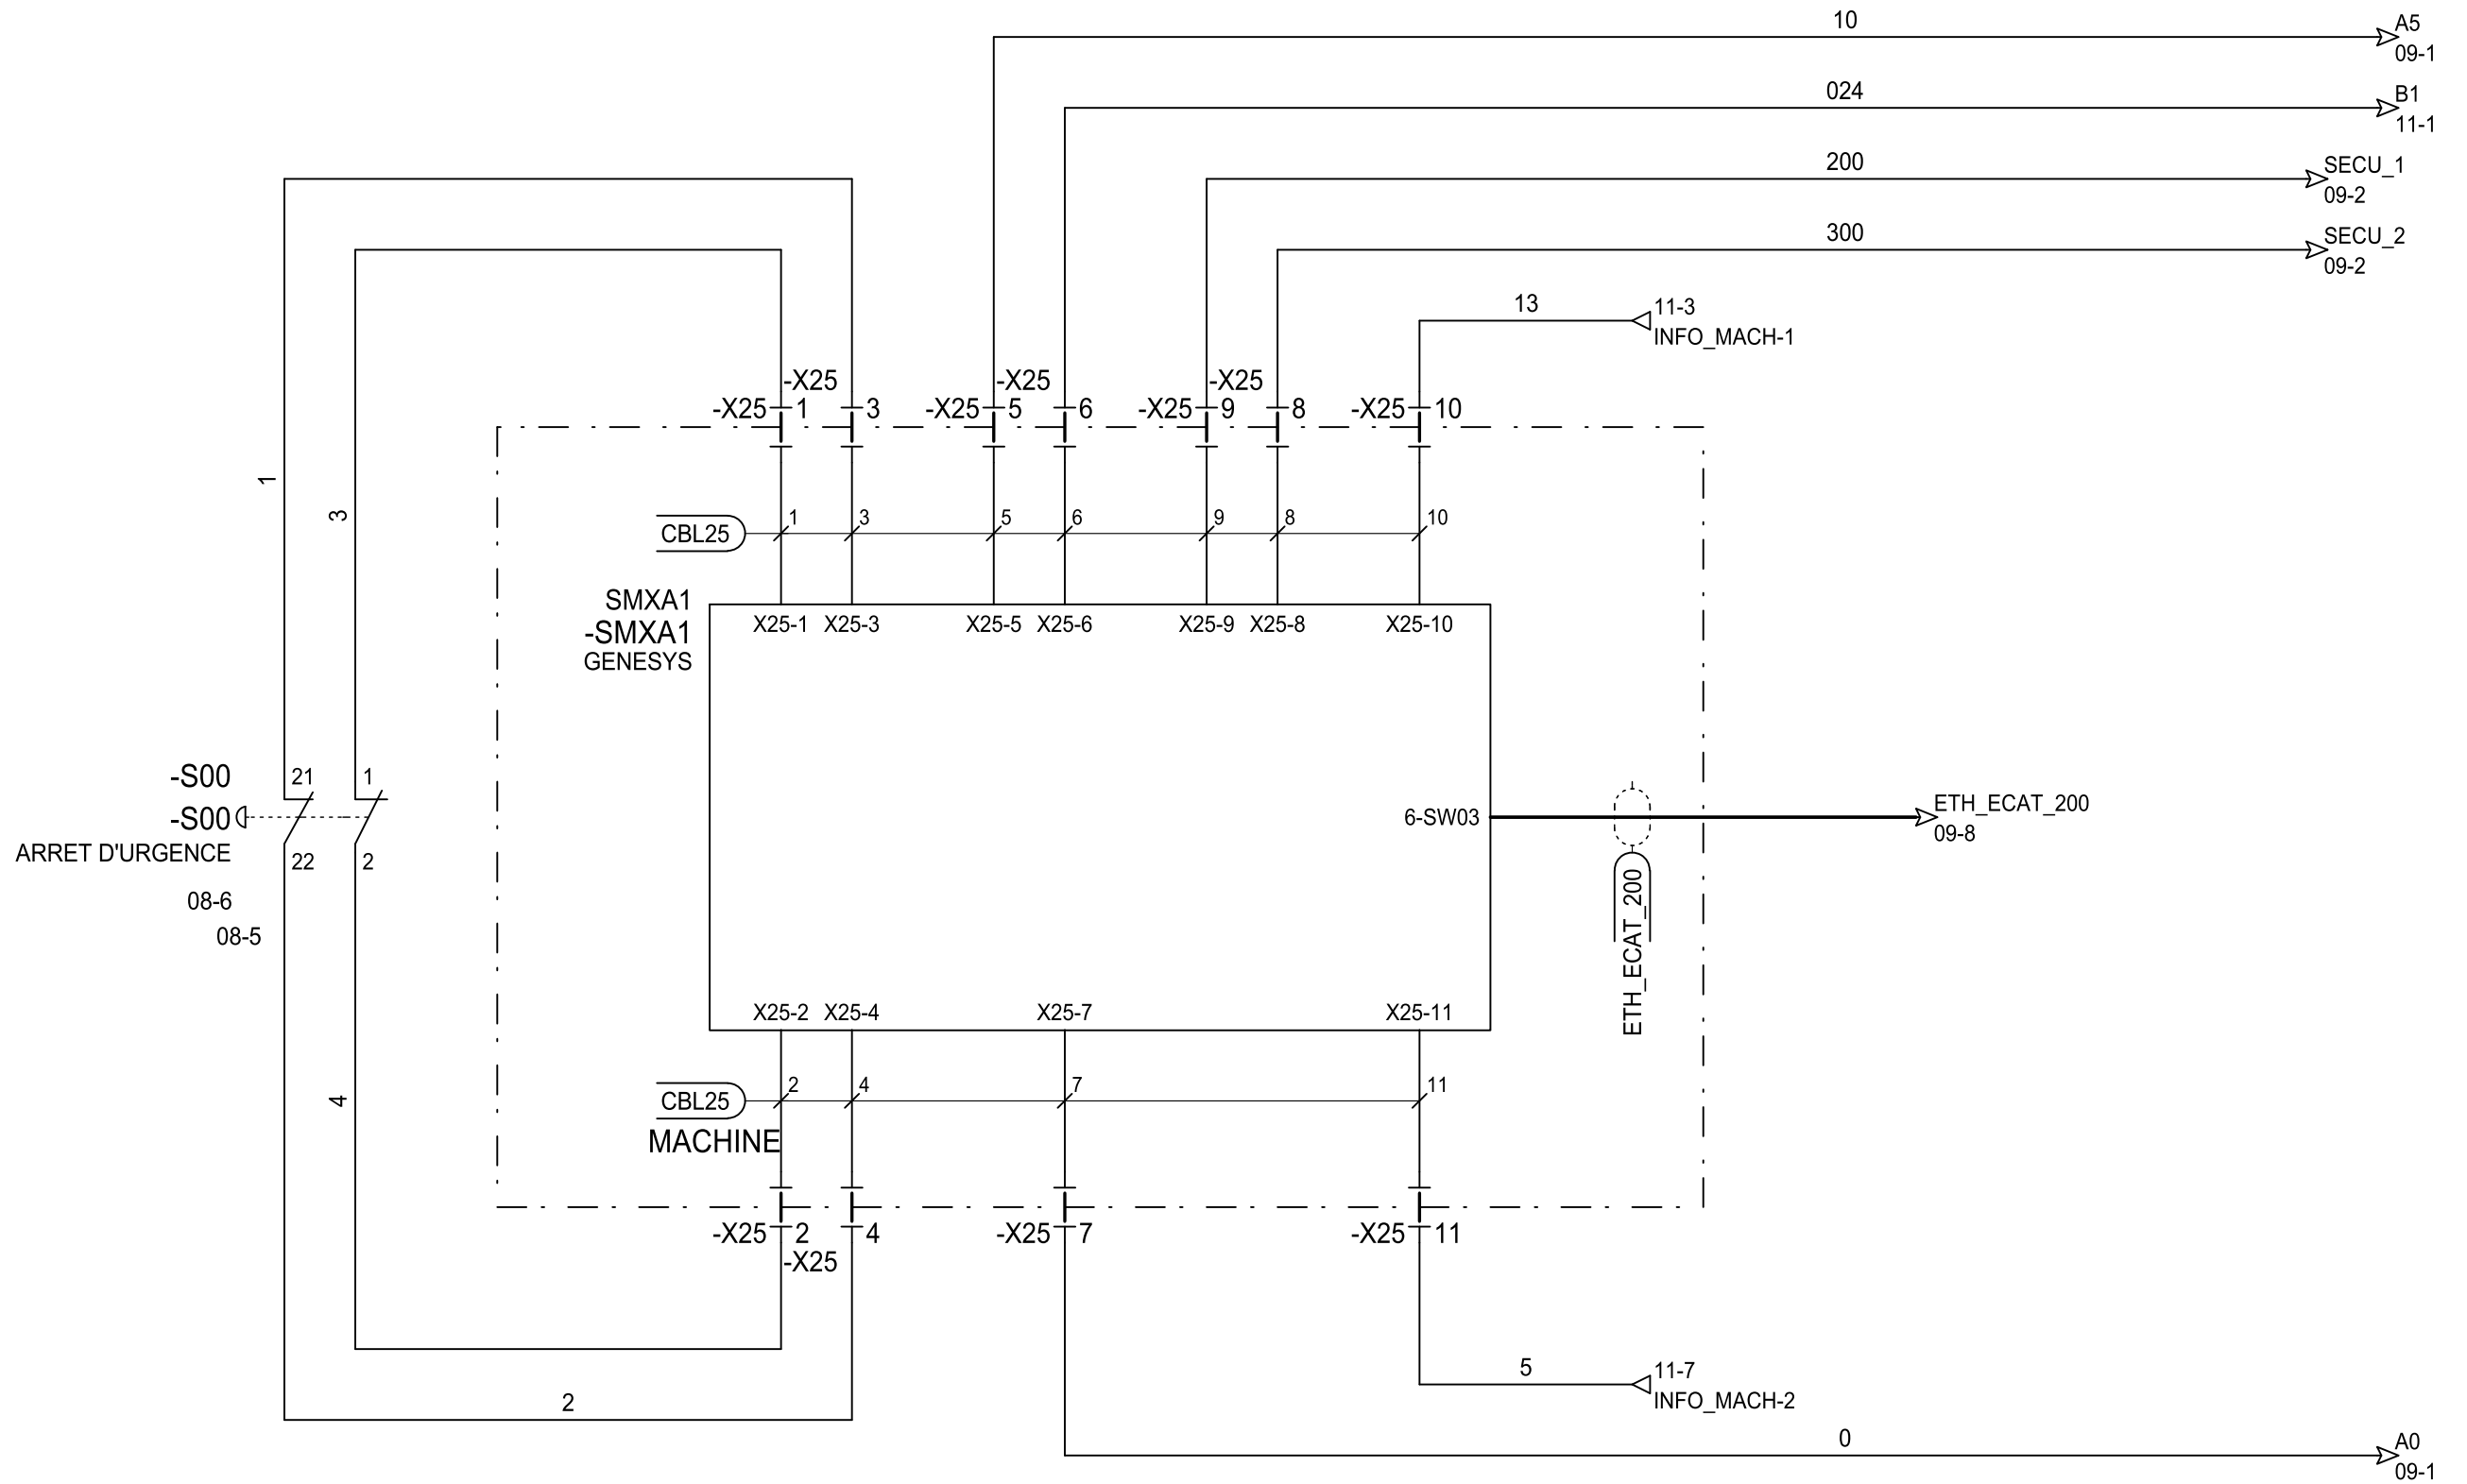


ECHANGE : SMXA => SMXA-OPT2
EXCHANGE : SMXA => SMXA-OPT2

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		SCHEMA DE COMMANDE				 Ecata-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		CONTROL DIAGRAM								ARTICLE : MXA-OPT02-C015541		INDEX : V1			
			E-mail : ecataid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATAID								Folio : 08/23					


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

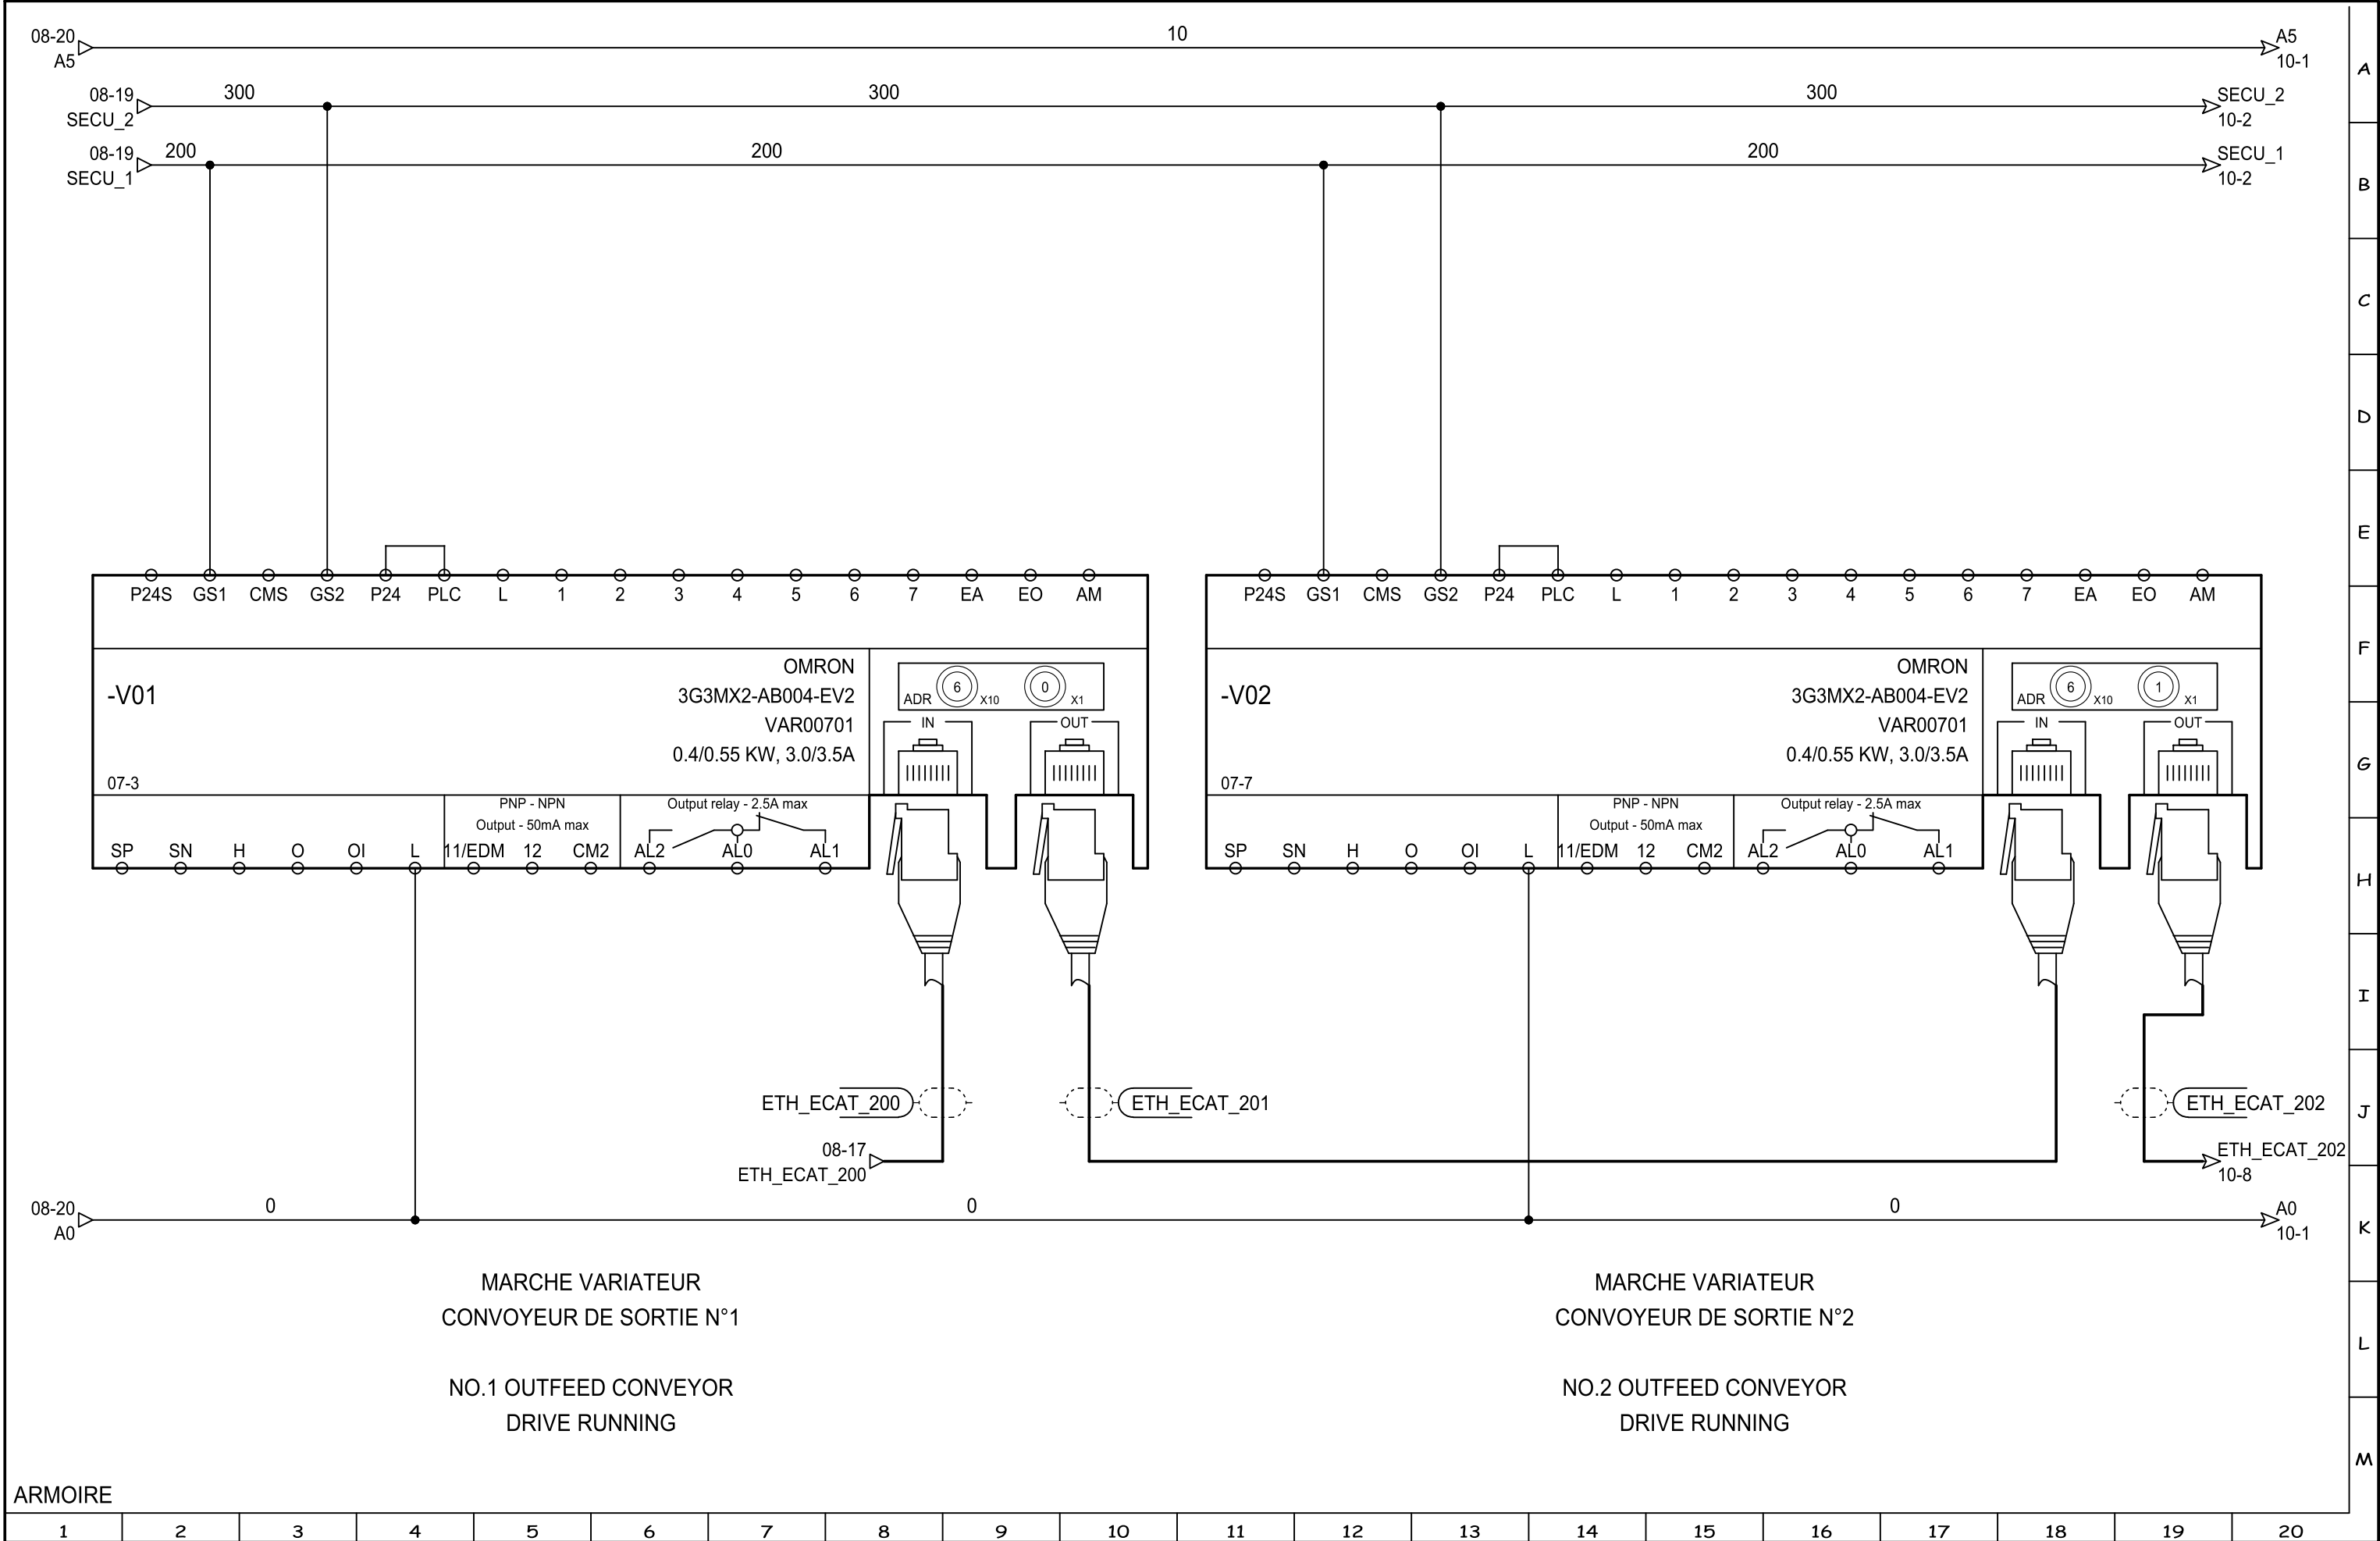

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI			COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		CONTROL DIAGRAM								ARTICLE : MXA-OPT02-C015541					INDEX : V1	
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								Folio: 09/23						


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

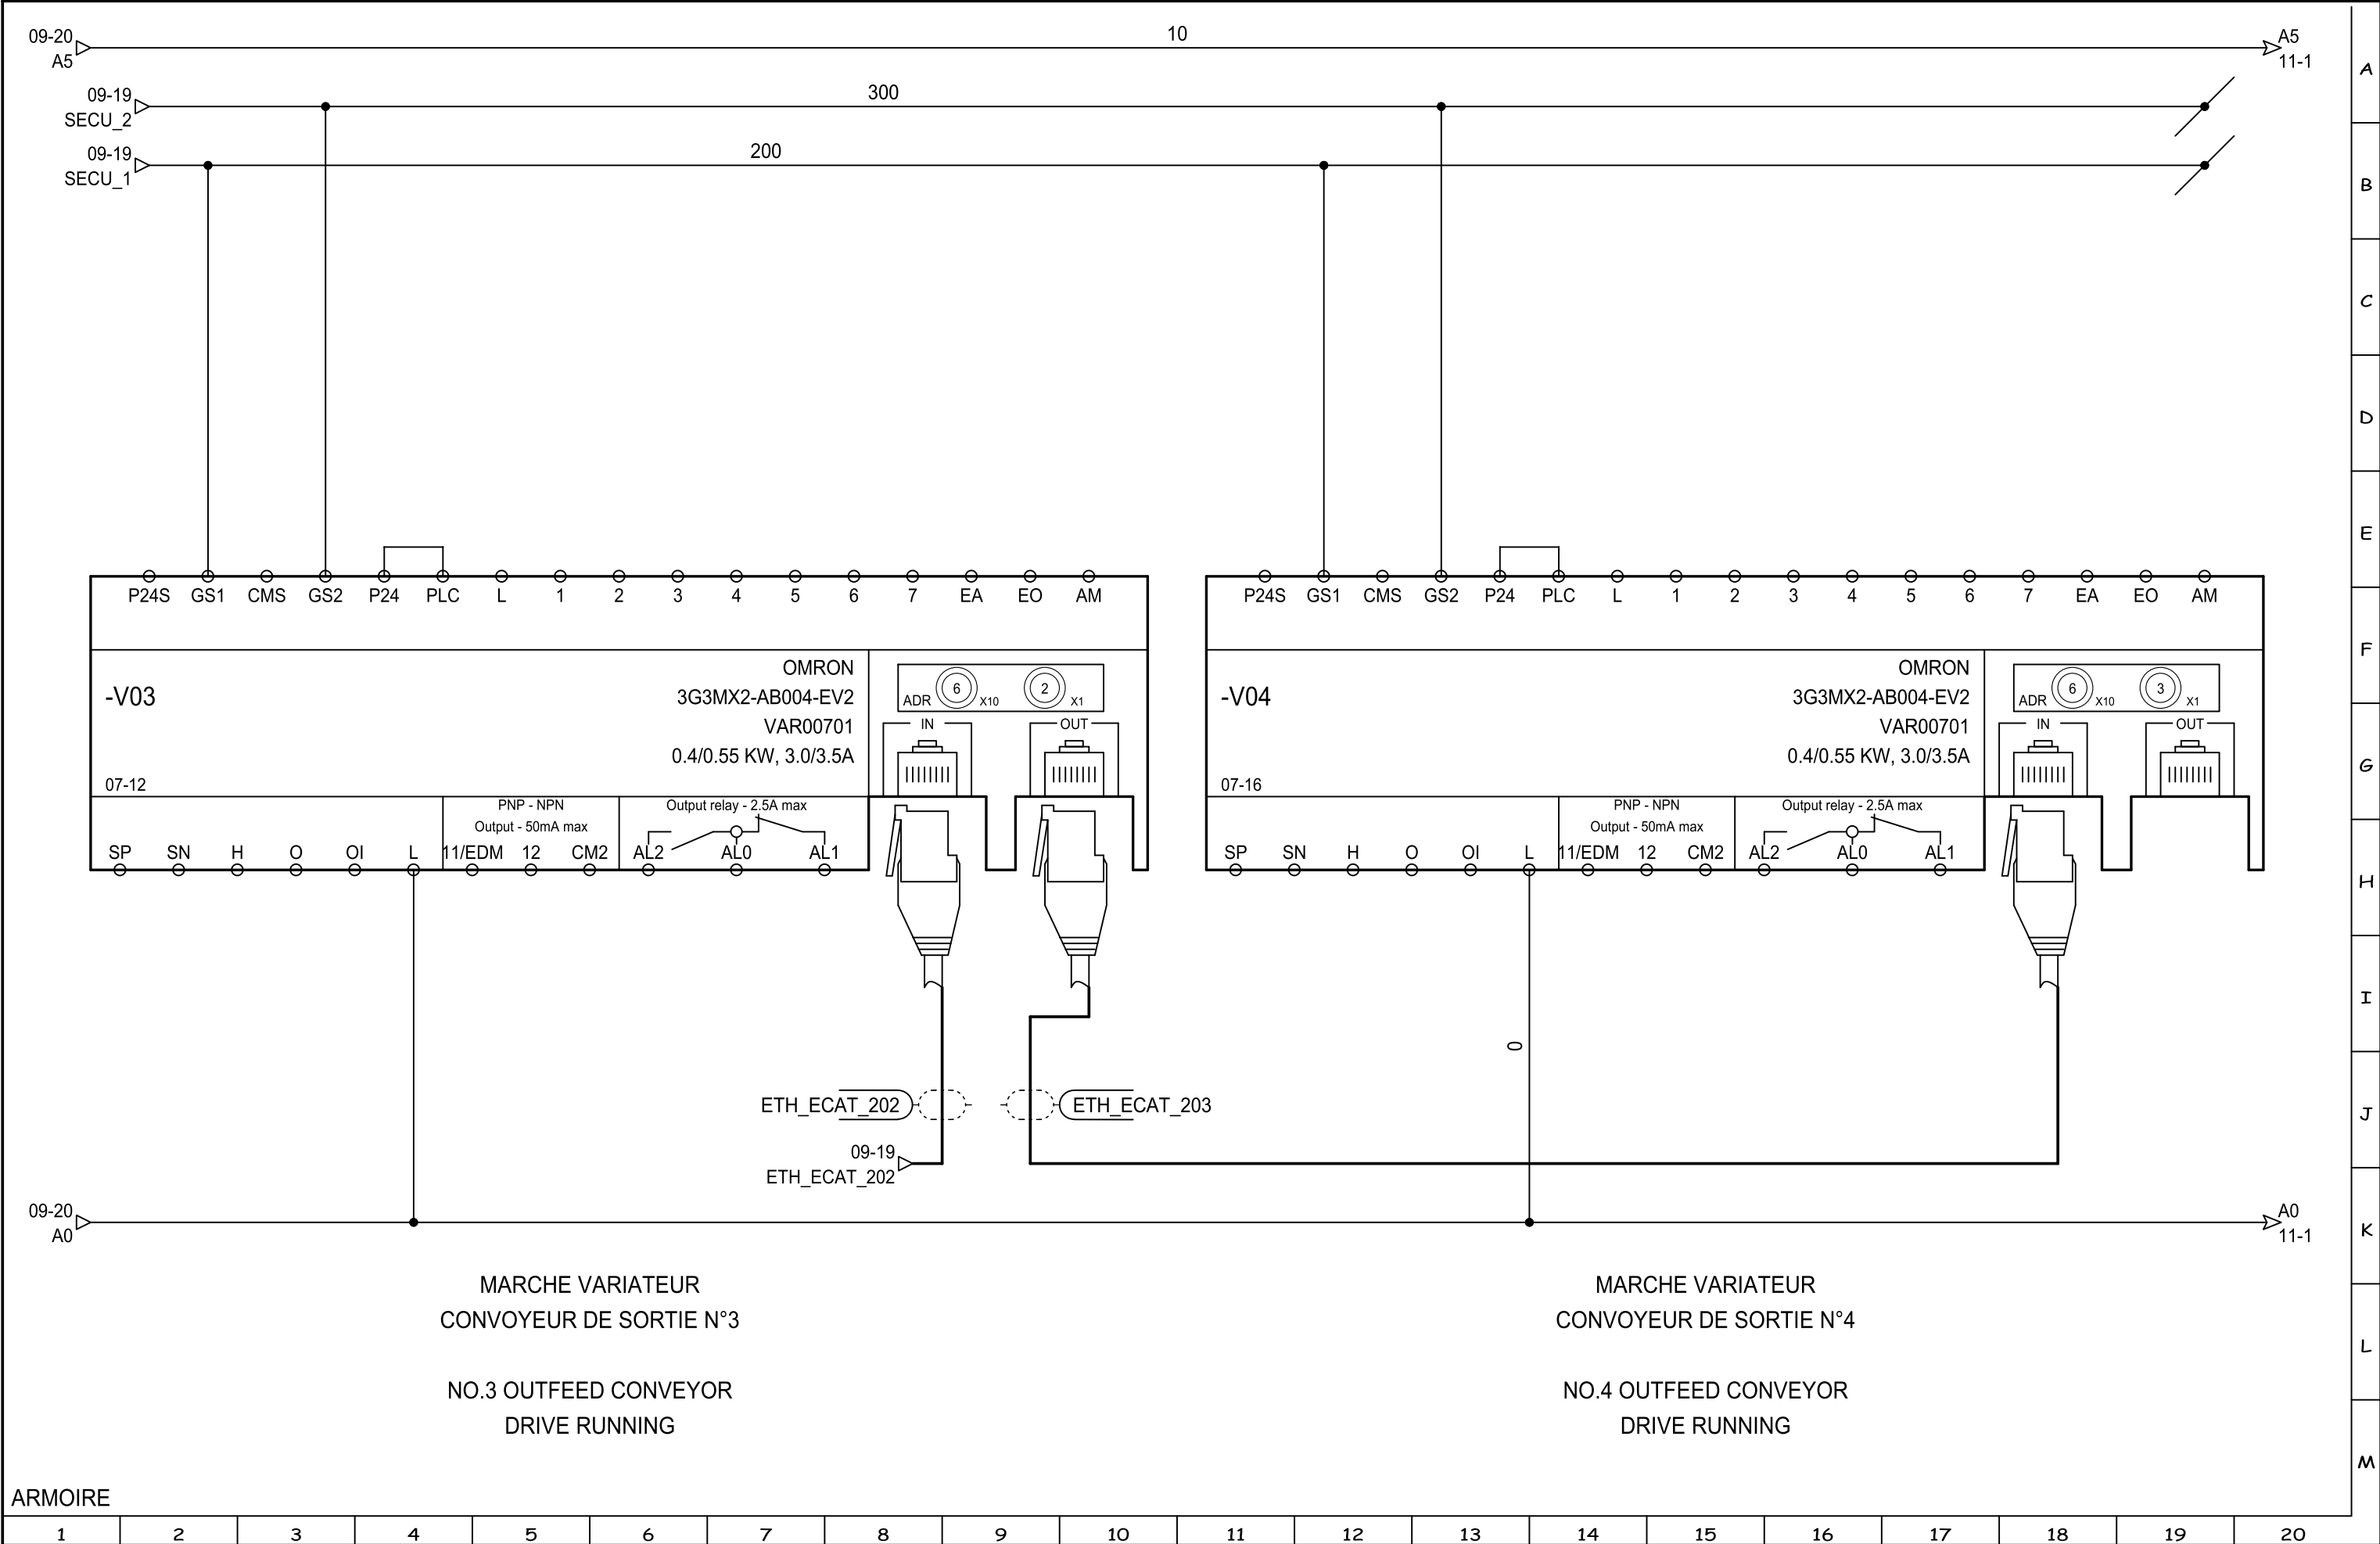

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		CONTROL DIAGRAM								ARTICLE : MXA-OPT02-C015541				INDEX : V1	
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								Folio : 10/23					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

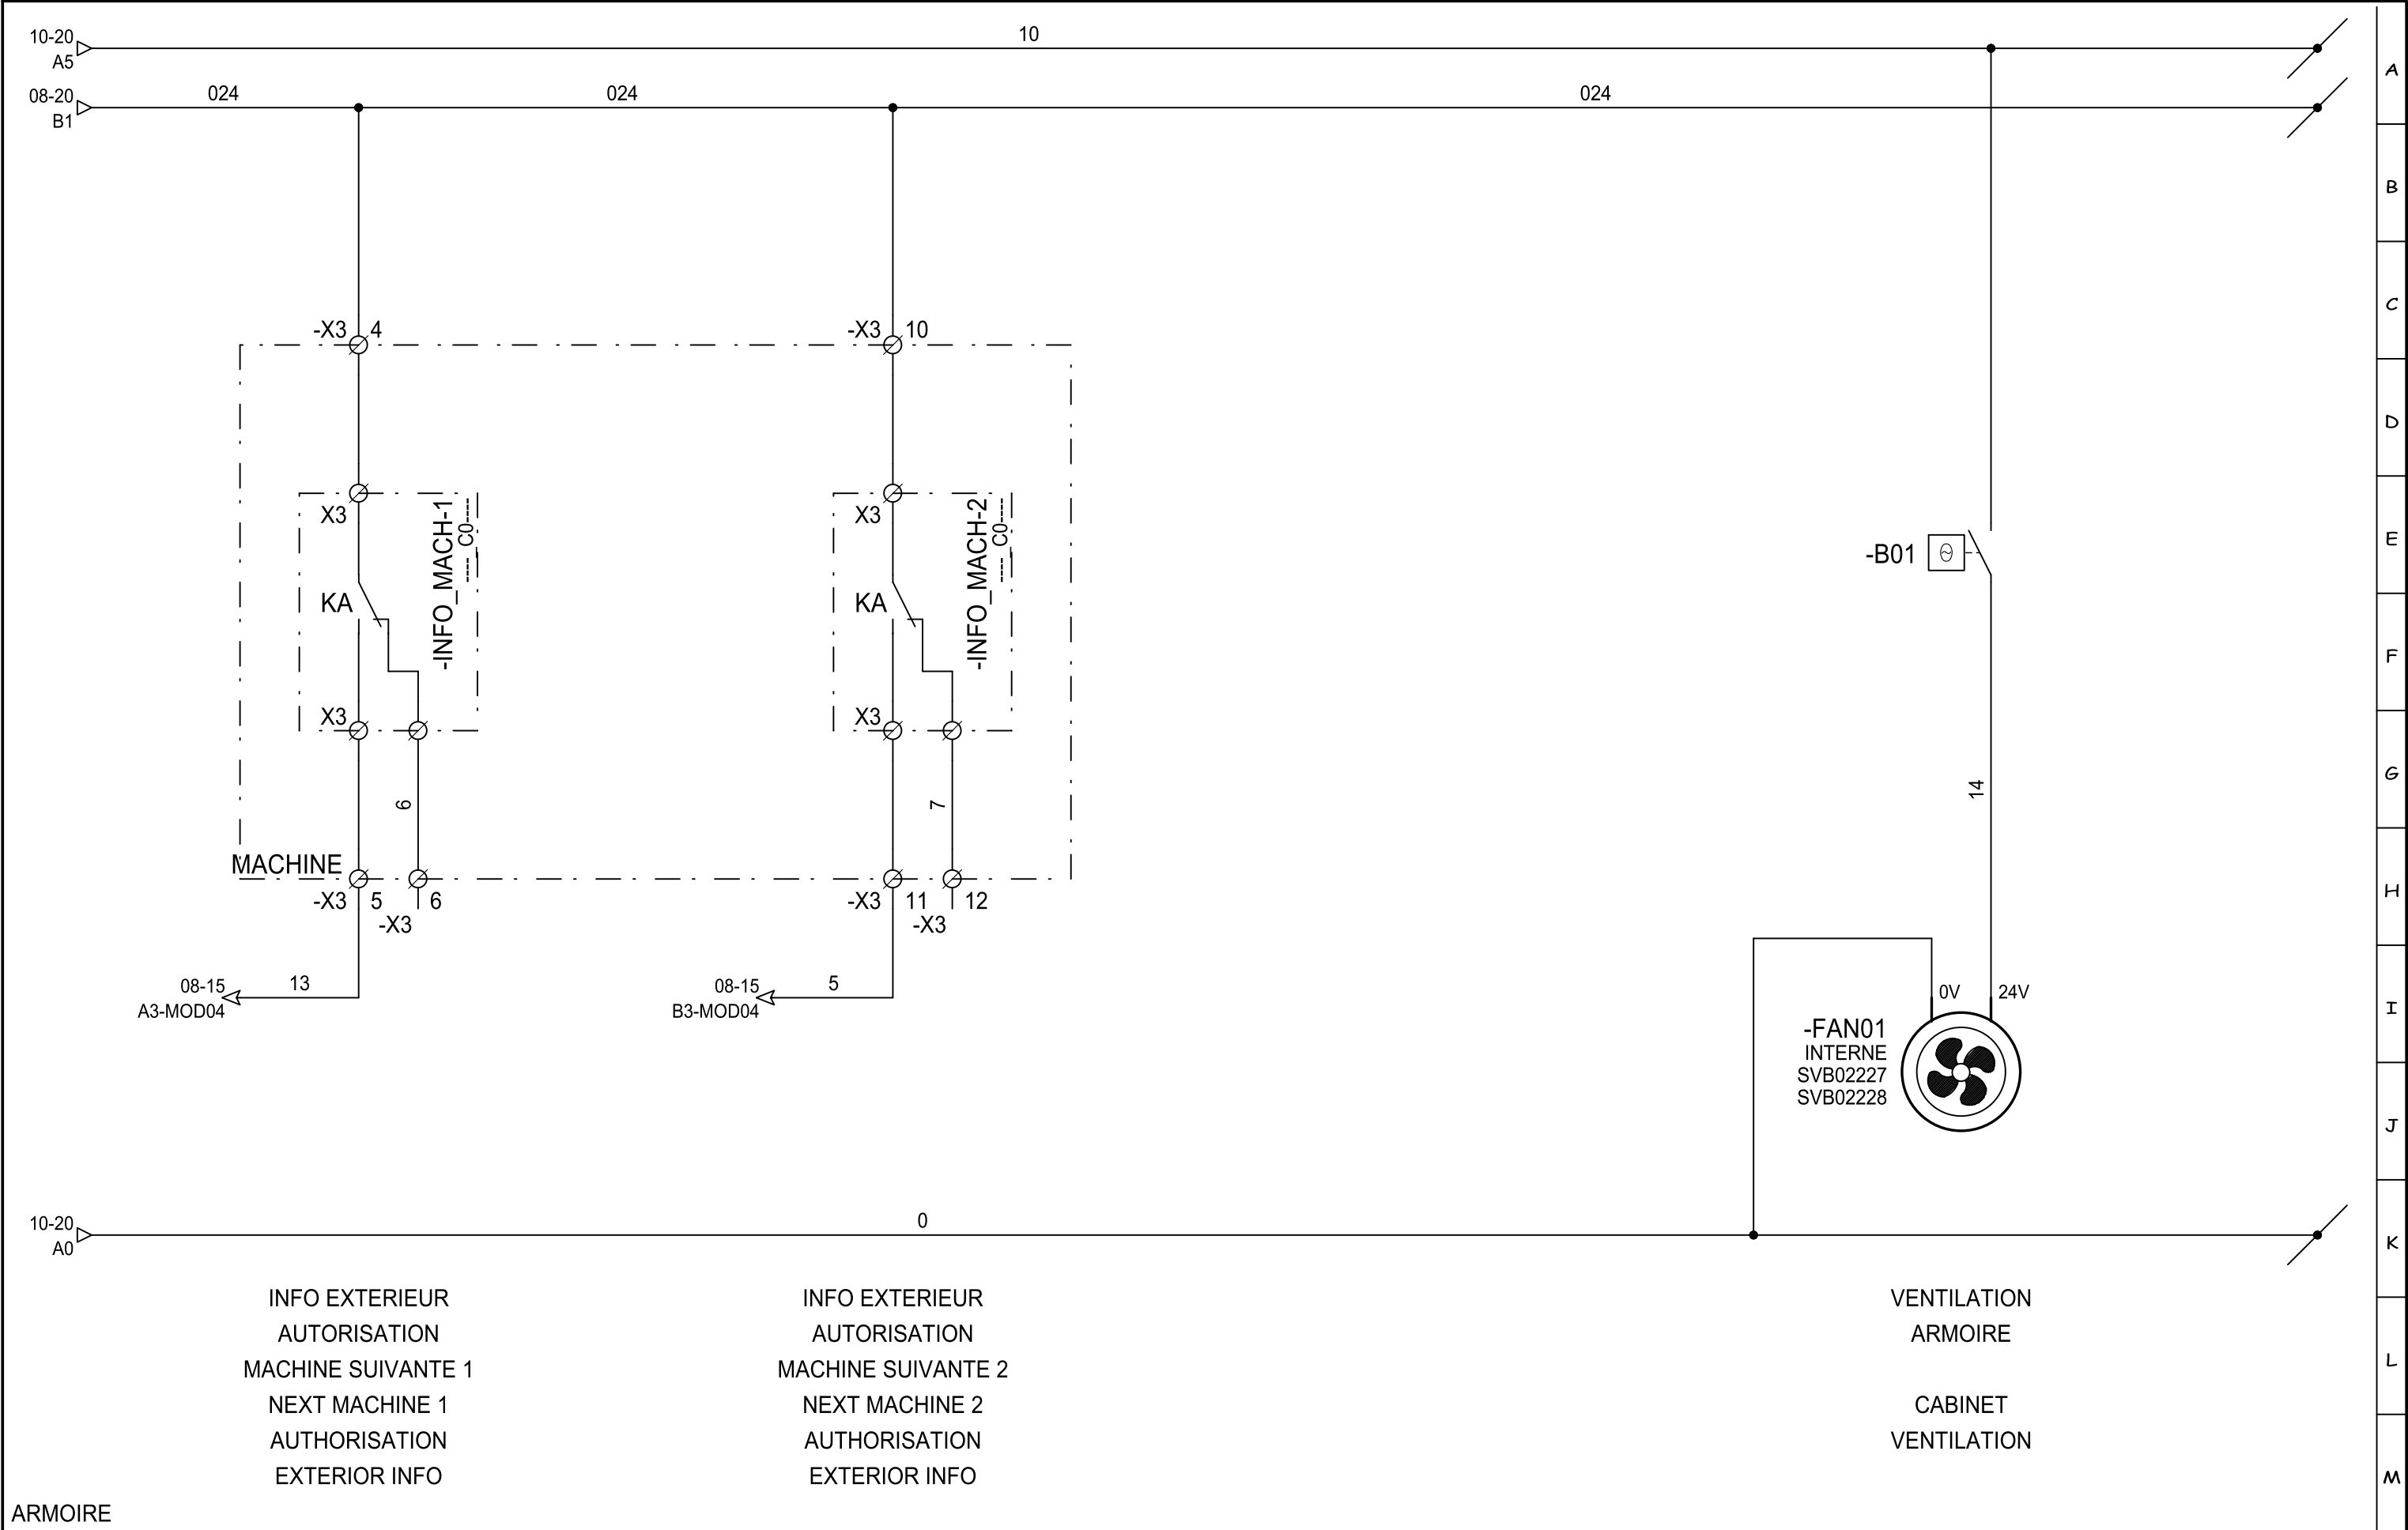

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		CONTROL DIAGRAM								ARTICLE :		INDEX : V1		Folio : 11/23	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								MXA-OPT02-C015541					



MXA-OPT02-C015541 12/23



MXA-OPT02-C015541 13/23

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE


Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

Date of creation : 21/04/2026	BORNIER : X25
Designed by : YR	TERMINAL BLOCK : X25
	ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus


CONTRACT : C01554	CUSTOMER : CMI	COUNTRY : HONDURAS
ARTICLE : MXA-OPT02-C015541		INDEX : V1
		Folio : 14/23

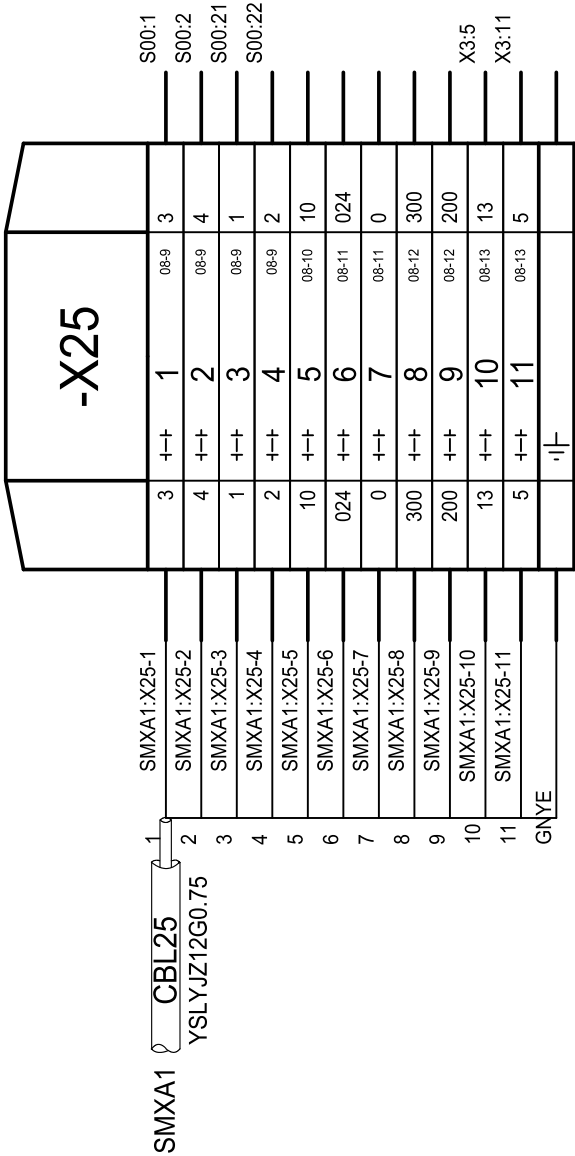

A
B
C
D
E
F
G
H
I
J
K
L
M

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACADE ARMOIRE
CABINET FRONT LAYOUT

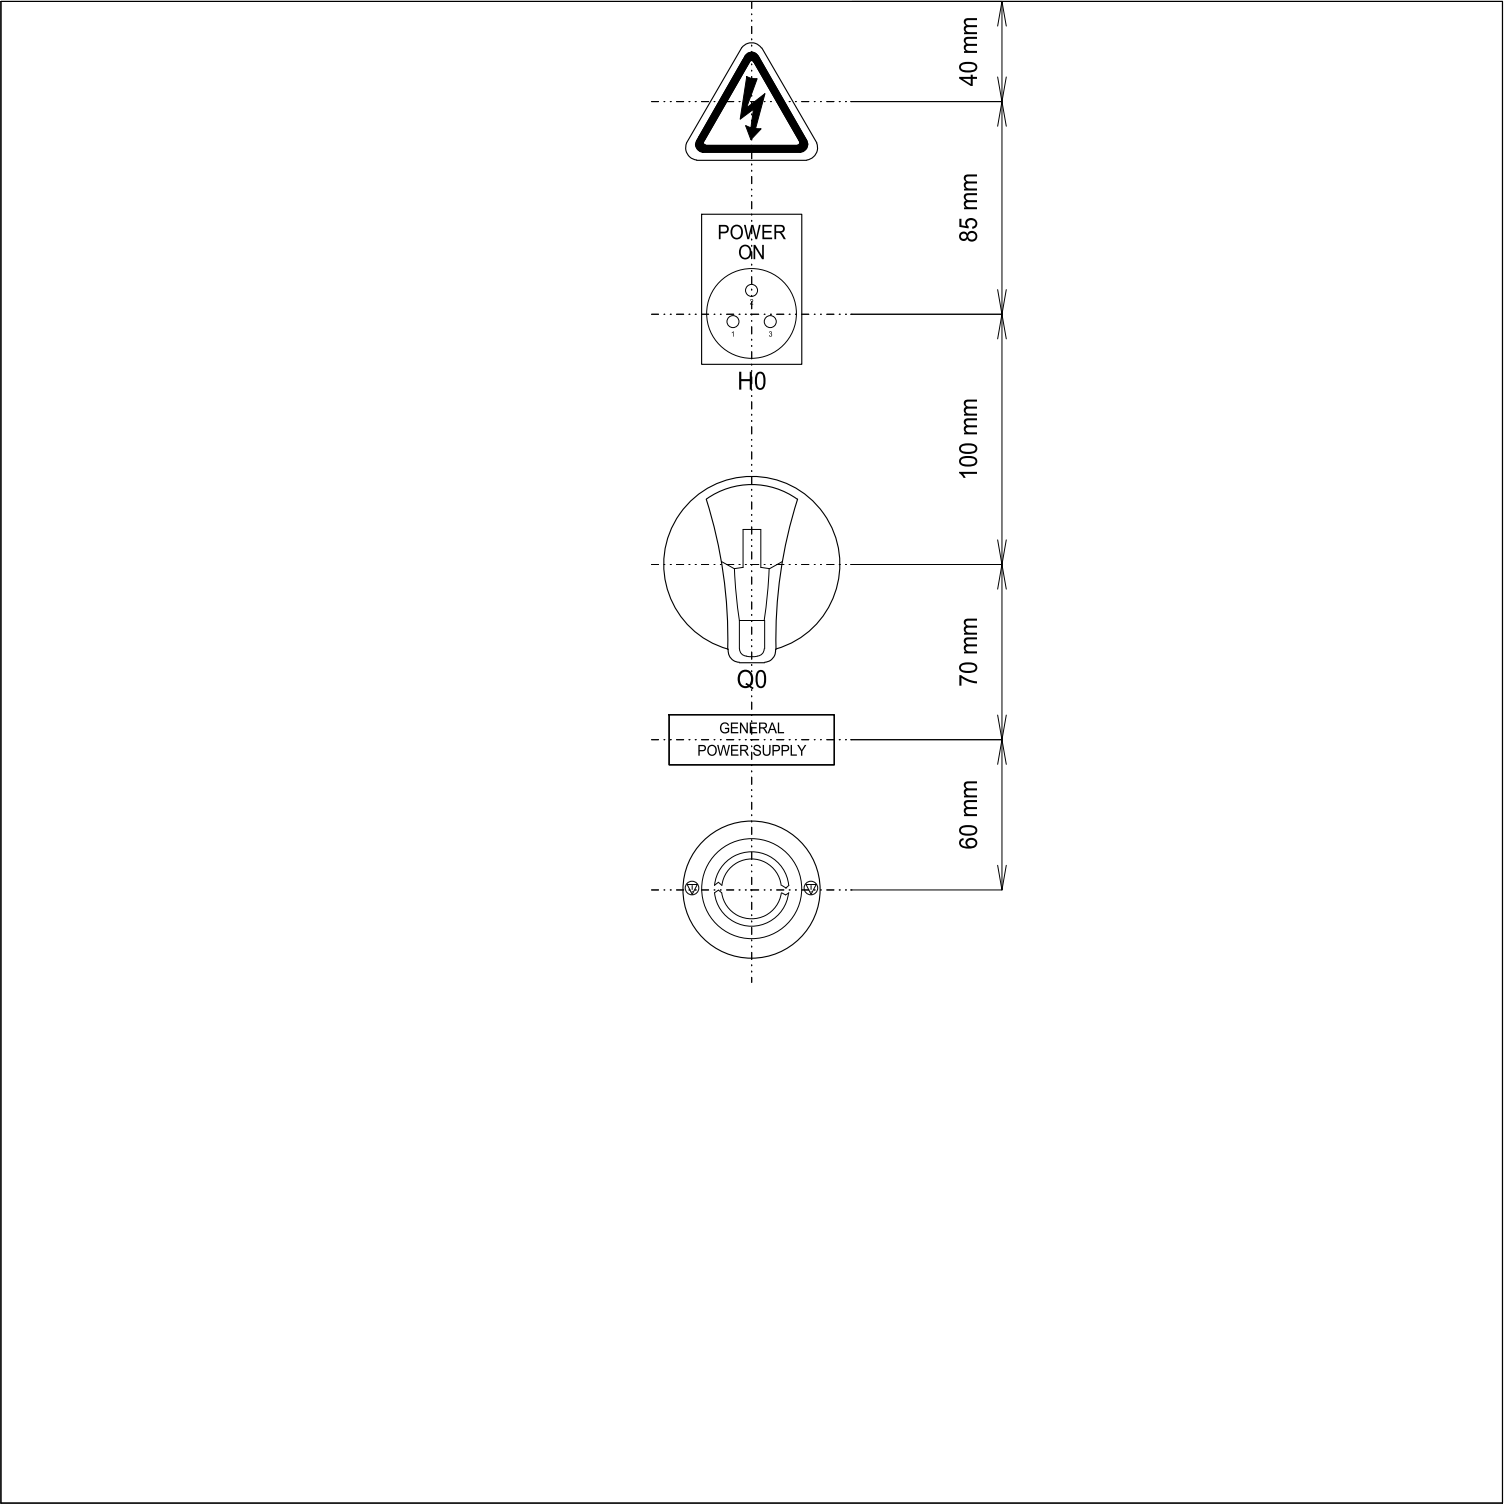

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

Date of creation : 21/04/2026	IMPLANTATION FACADE ARMOIRE
Designed by : YR	CABINET FRONT LAYOUT
	ENVIRONNEMENT : Elec_IEC V5R2_ECATID





Ecat-iD Campus

CONTRACT : C01554	CUSTOMER : CMI	COUNTRY : HONDURAS
ARTICLE : MXA-OPT02-C015541		INDEX : V1
		For 10 : 15/23

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION COTE ARMOIRE
CABINET SIDE LAYOUT

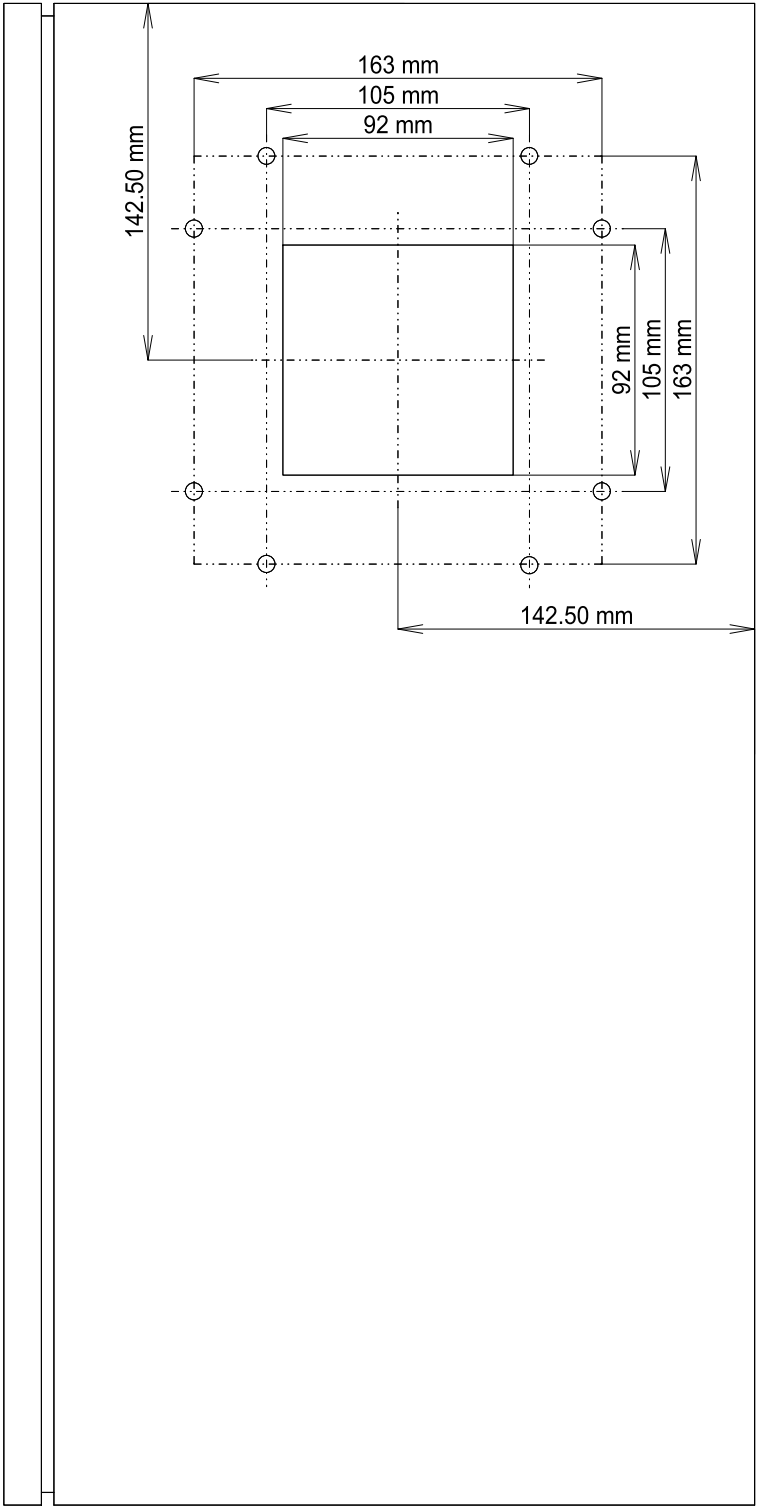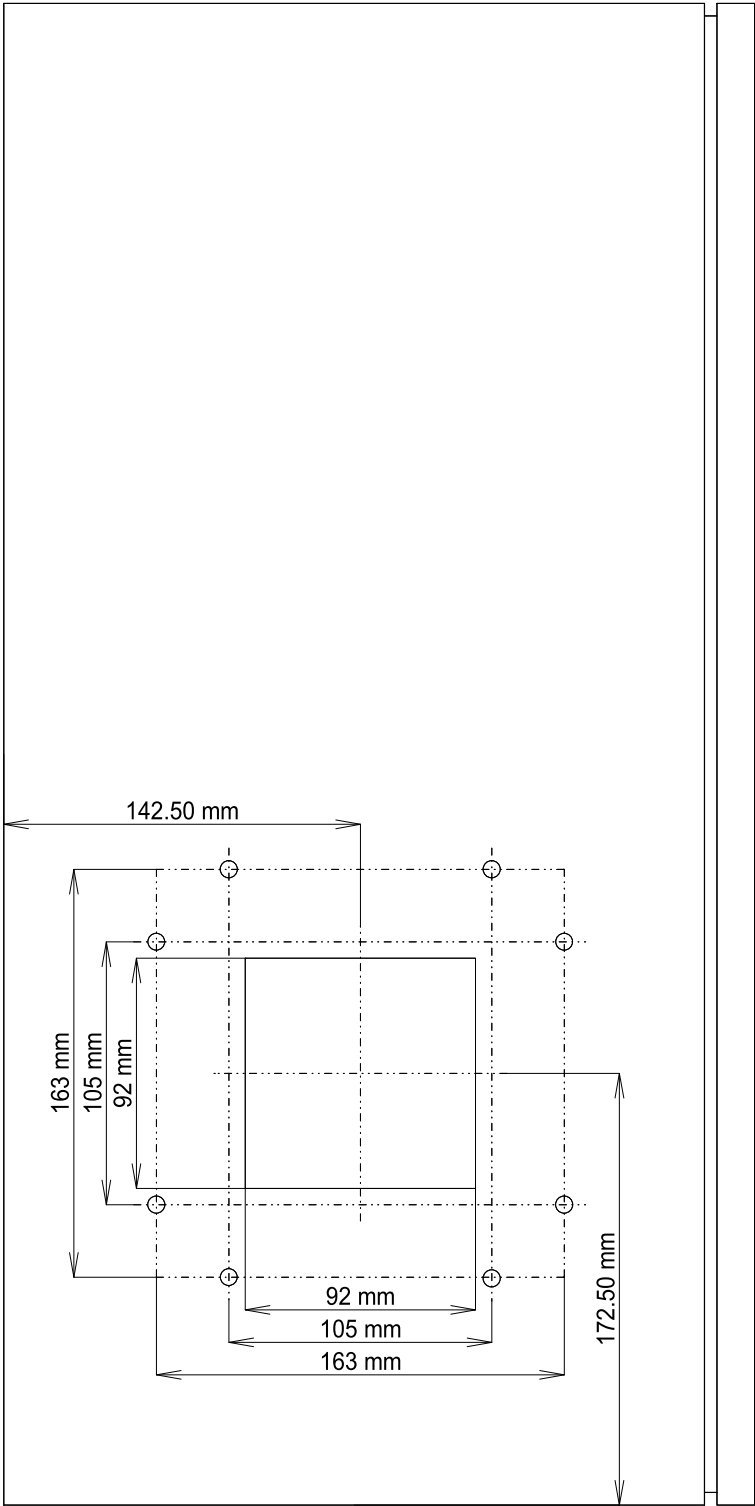

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

Date of creation : 21/04/2026	IMPLANTATION COTE ARMOIRE
Designed by : YR	CABINET SIDE LAYOUT
ENVIRONNEMENT : Elec_IEC V5R2_ECATID	



CONTRACT : C01554	CUSTOMER : CMI	COUNTRY : HONDURAS
ARTICLE : MXA-OPT02-C015541		INDEX : V1
		Folio : 16/23

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation : 21/04/2026

Designed by : YR

IMPLANTATION PLATINE ARMOIRE

CABINET BOARD LAYOUT



Ecat-ID Campus

CONTRACT : C01554

ARTICLE : MXA-OPT02-C01554

INDEX : V1

CUSTOMER : CMI

COUNTRY : HONDURAS

17/23

ARMOIRE

IMPLANTATION PLATINE ARMOIRE

CABINET BOARD LAYOUT

ESPACEMENT DE 30mm ENTRE CHAQUE VARIATEUR

The diagram illustrates the cabinet board layout for four variable frequency drives (V01-V04). Each drive is connected to a common terminal block (-CEM01 to -CEM04) and a relay (-B01). The layout includes a 25mm gap between the drives, a 40mm gap between the drives and the relay, and a 40mm gap between the relay and the terminal blocks. The terminal blocks are labeled X24V, X3, and X25. The dimensions are indicated on the right side of the diagram: 47.5 mm for the drive section, 77.5 mm for the relay section, 85 mm for the terminal block section, 80 mm for the terminal block section, and 60 mm for the terminal block section.

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	QTE	REFERENCE	CODE ECAT-ID	FABRICANT	FILTRE
ARMOIRE	01	COFFRET INOX 600x600x300	1	CPN606030	BOX00367	MP GAMMA	ARMOIRE
B01	11	THERMOSTAT MECANIQUE 0 60°C "F"	1	NSYCCOTH0	SEN00671	SCHNEIDER ELECTRIC	ARMOIRE
CEM01	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM02	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM03	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM04	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ETH_ECAT_200		CONNECTEUR RJ45 A MONTER IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
FAN01	11	KIT ENS CAPOT VENTILATEUR ELC00708 SANS VENTILATEUR PETIT MODELE	1	SVB02227	SVB02227	INTERNE	ARMOIRE
FAN01	11	KIT ENS CAPOT VENTILATEUR ELC00708 AVEC VENTILATEUR PETIT MODELE	1	SVB02228	SVB02228	INTERNE	ARMOIRE
Q0	06	POLE ADDITIONNEL PRINCIPAL SIRCO M 16A	1	22001000	SEC00052	SOCOMEK	ARMOIRE
Q0	06	INTERRUPTEUR-SECTIONNEUR SIRCO M 3x16A NU	1	22003000	SEC00066	SOCOMEK	ARMOIRE
Q0	06	CACHE-BORNES POUR SIRCO M 1P 16...40A	1	22941005	SEC00070	SOCOMEK	ARMOIRE
Q0	06	CACHE-BORNES POUR SIRCO M 3P 16...40A	1	22943005	SEC00071	SOCOMEK	ARMOIRE
Q01	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q02	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q03	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q04	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
REP01	06	REPARTITEUR TETRAPOLAIRE TD 80/100 A, 6 CONNEXIONS	1	563920	ELC01083	NVENT ERICO	ARMOIRE
V01	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V01	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V02	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V02	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V03	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V03	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V04	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V04	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
Z01	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
Z02	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
Z03	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
Z04	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

TAG	SHEET	DESCRIPTION	QTY	CATALOG No	CODE ECAT-ID	MANUFACTURER	FILTER
ARMOIRE	01	STAINLESS STEEL BOX 600X600X300	1	CPN606030	BOX00367	MP GAMMA	ARMOIRE
CEM01	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM02	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM03	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM04	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ETH_ECAT_200		RJ45 CONNECTOR TO MOUNT IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
FAN01	11	KIT SET FAN COVER WITHOUT FAN ELC00708 SMALL MODEL	1	SVB02227	SVB02227	INTERNE	ARMOIRE
FAN01	11	KIT SET FAN COVER WITH FAN ELC00708 SMALL MODEL	1	SVB02228	SVB02228	INTERNE	ARMOIRE
Q01	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q02	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q03	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q04	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
REP01	06	TD 80/100 A TETRAPOLAR SPLITTER, 6 CONNECTIONS	1	563920	ELC01083	NVENT ERICO	ARMOIRE
TH01	11	MECHANICAL THERMAL SENSOR 0 60°C "NC"	1	NSYCCOTH0	SEN00671	SCHNEIDER ELECTRIC	ARMOIRE
V01	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V01	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V02	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V02	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V03	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V03	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V04	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V04	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
Z01	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z02	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z03	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z04	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		NOMENCLATURE BOUTONNERIE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		FRENCH BUTTON PARTS LIST								ARTICLE : MXA-OPT02-C015541				INDEX : V1	
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								Folio : 20/23					

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		NOMENCLATURE BOUTONNERIE ANGLAISE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS			
			Fax : (33).2.98.85.31.38		Designed by : YR		BUTTON PARTS LIST								ARTICLE : MXA-OPT02-C015541				INDEX : V1		Folio : 21/23	
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec IEC V5R2 ECATIC															

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		CARNET DE CABLE				 Ecat-iD Campus				CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS	
			Fax : (33).2.98.85.31.38		Designed by : YR		FRENCH CABLE BOOKLET								ARTICLE : V1				INDEX : V1	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								MXA-OPT02-C015541				22/23	

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 21/04/2026		CARNET DE CABLE ANGLAIS			 Ecat-iD Campus					CONTRACT : C01554		CUSTOMER : CMI		COUNTRY : HONDURAS			
			Fax : (33).2.98.85.31.38		Designed by : YR		CABLE BOOKLET								ARTICLE : V1						INDEX : V1	
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID			MXA-OPT02-C015541							23/23							