

-ARMOIRE

Cabinet no. : XA

Cabinet material : INOX

Cabinet size : 600x600x300

Brand of enclosure : IRINOX

Enclosure material : INOX

Equipment used :

Button brand : SCHNEIDER ELECTRIC

Button language : /

PLC brand : /

HMI brand : /

Wiring

Breaking capacity lcc : 10kA

Shielded cables on drives

Wire colours :

Phase 230V: Black

Neutral 230V: Blue

115V phase: Brown

Neutral 115V: Brown with blue stripes

Earth: Green/Yellow

External potential : Orange

External neutral: Orange with blue stripes

24VDC: Violet

12VDC or 15VDC : Red

5VDC: Grey

48VDC : Yellow

0VDC : White

Estimated electrical characteristics

Total rated power (kW) : 1,27kW

Total rated current (Amps) : 3.17A

Recommended main circuit breaker (Customer)

Circuit breaker rating (Amps) : 16A

Circuit breaker curve (type) : D

Minimum cross-section of supply cable (Customer) :

400V 3PH+N+GND

Wire cross-section (mm²) : 2,5mm²

Cable type (Number of wires) : 5G2,5mm²

H07 RNF / U1000 R2V

The main circuit breaker and the supply cable may be different depending on the electrical installation
(Cable material, length, installation method, ...)

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID. IT IS PROVIDED ON A CONFIDENTIAL BASIS.
IT MUST NOT BE REPRODUCED OR COMMUNICATED TO THIRD PARTIES WITHOUT OUR WRITTEN AUTHORISATION.

V3	MAJ - Inversion fils d'A.U.	18/11/2025	MB		
V2	MAJ - Repères câblage commande + A.U.	17/11/2025	MB		
V1	CREATION	25/09/2025	BM	JT	JT
INDEX	MODIFICATION	DATE	DESIGNED BY	VERIFIED BY	APPROVED BY

COFFRET CONVOYEURS BYPASS

BYPASS CONVEYORS CABINET

DESIGNED BY : BM

VERIFIED BY : JT

DATE CREATED : 17/11/2025

CUSTOMER : PONDEX ALCALA DEL RIO

CONTRACT NO. : C01508

PROCESS N° : PDIV-C01508

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tel : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

ENVIRONNEMENT IGE-XAO : Elec_IEC V5R2_ECATID Environment for electrical controls and automation systems (according to IEC standard)

FOLIO : 01/26



Ecat-iD Campus

COUNTRY :

ESPAGNE

DRAWING NUMBER :

SMXA-OPT1-C015081

[illegible][illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH FOLIOS LIST								ARTICLE : SMXA-OPT1-C015081		INDEX : V3			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID				FOLIO : 02/26											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO			COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH FOLIOS LIST								ARTICLE : SMXA-OPT1-C015081				INDEX : V3		
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 03/26						

[illegible][illegible]


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO			COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		ENGLISH FOLIOS LIST								ARTICLE : SMXA-OPT1-C015081			INDEX : V3			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 04/26						

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		LISTE DE FOLIOS ANGLAIS			 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		ENGLISH FOLIOS LIST							ARTICLE : SMXA-OPT1-C015081		INDEX : V3			
			E-mail : ecaticid.service@ceva.com			ENVIRONNEMENT : Elec_IEC V5R2_ECATICID			FOLIO : 05/26										

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

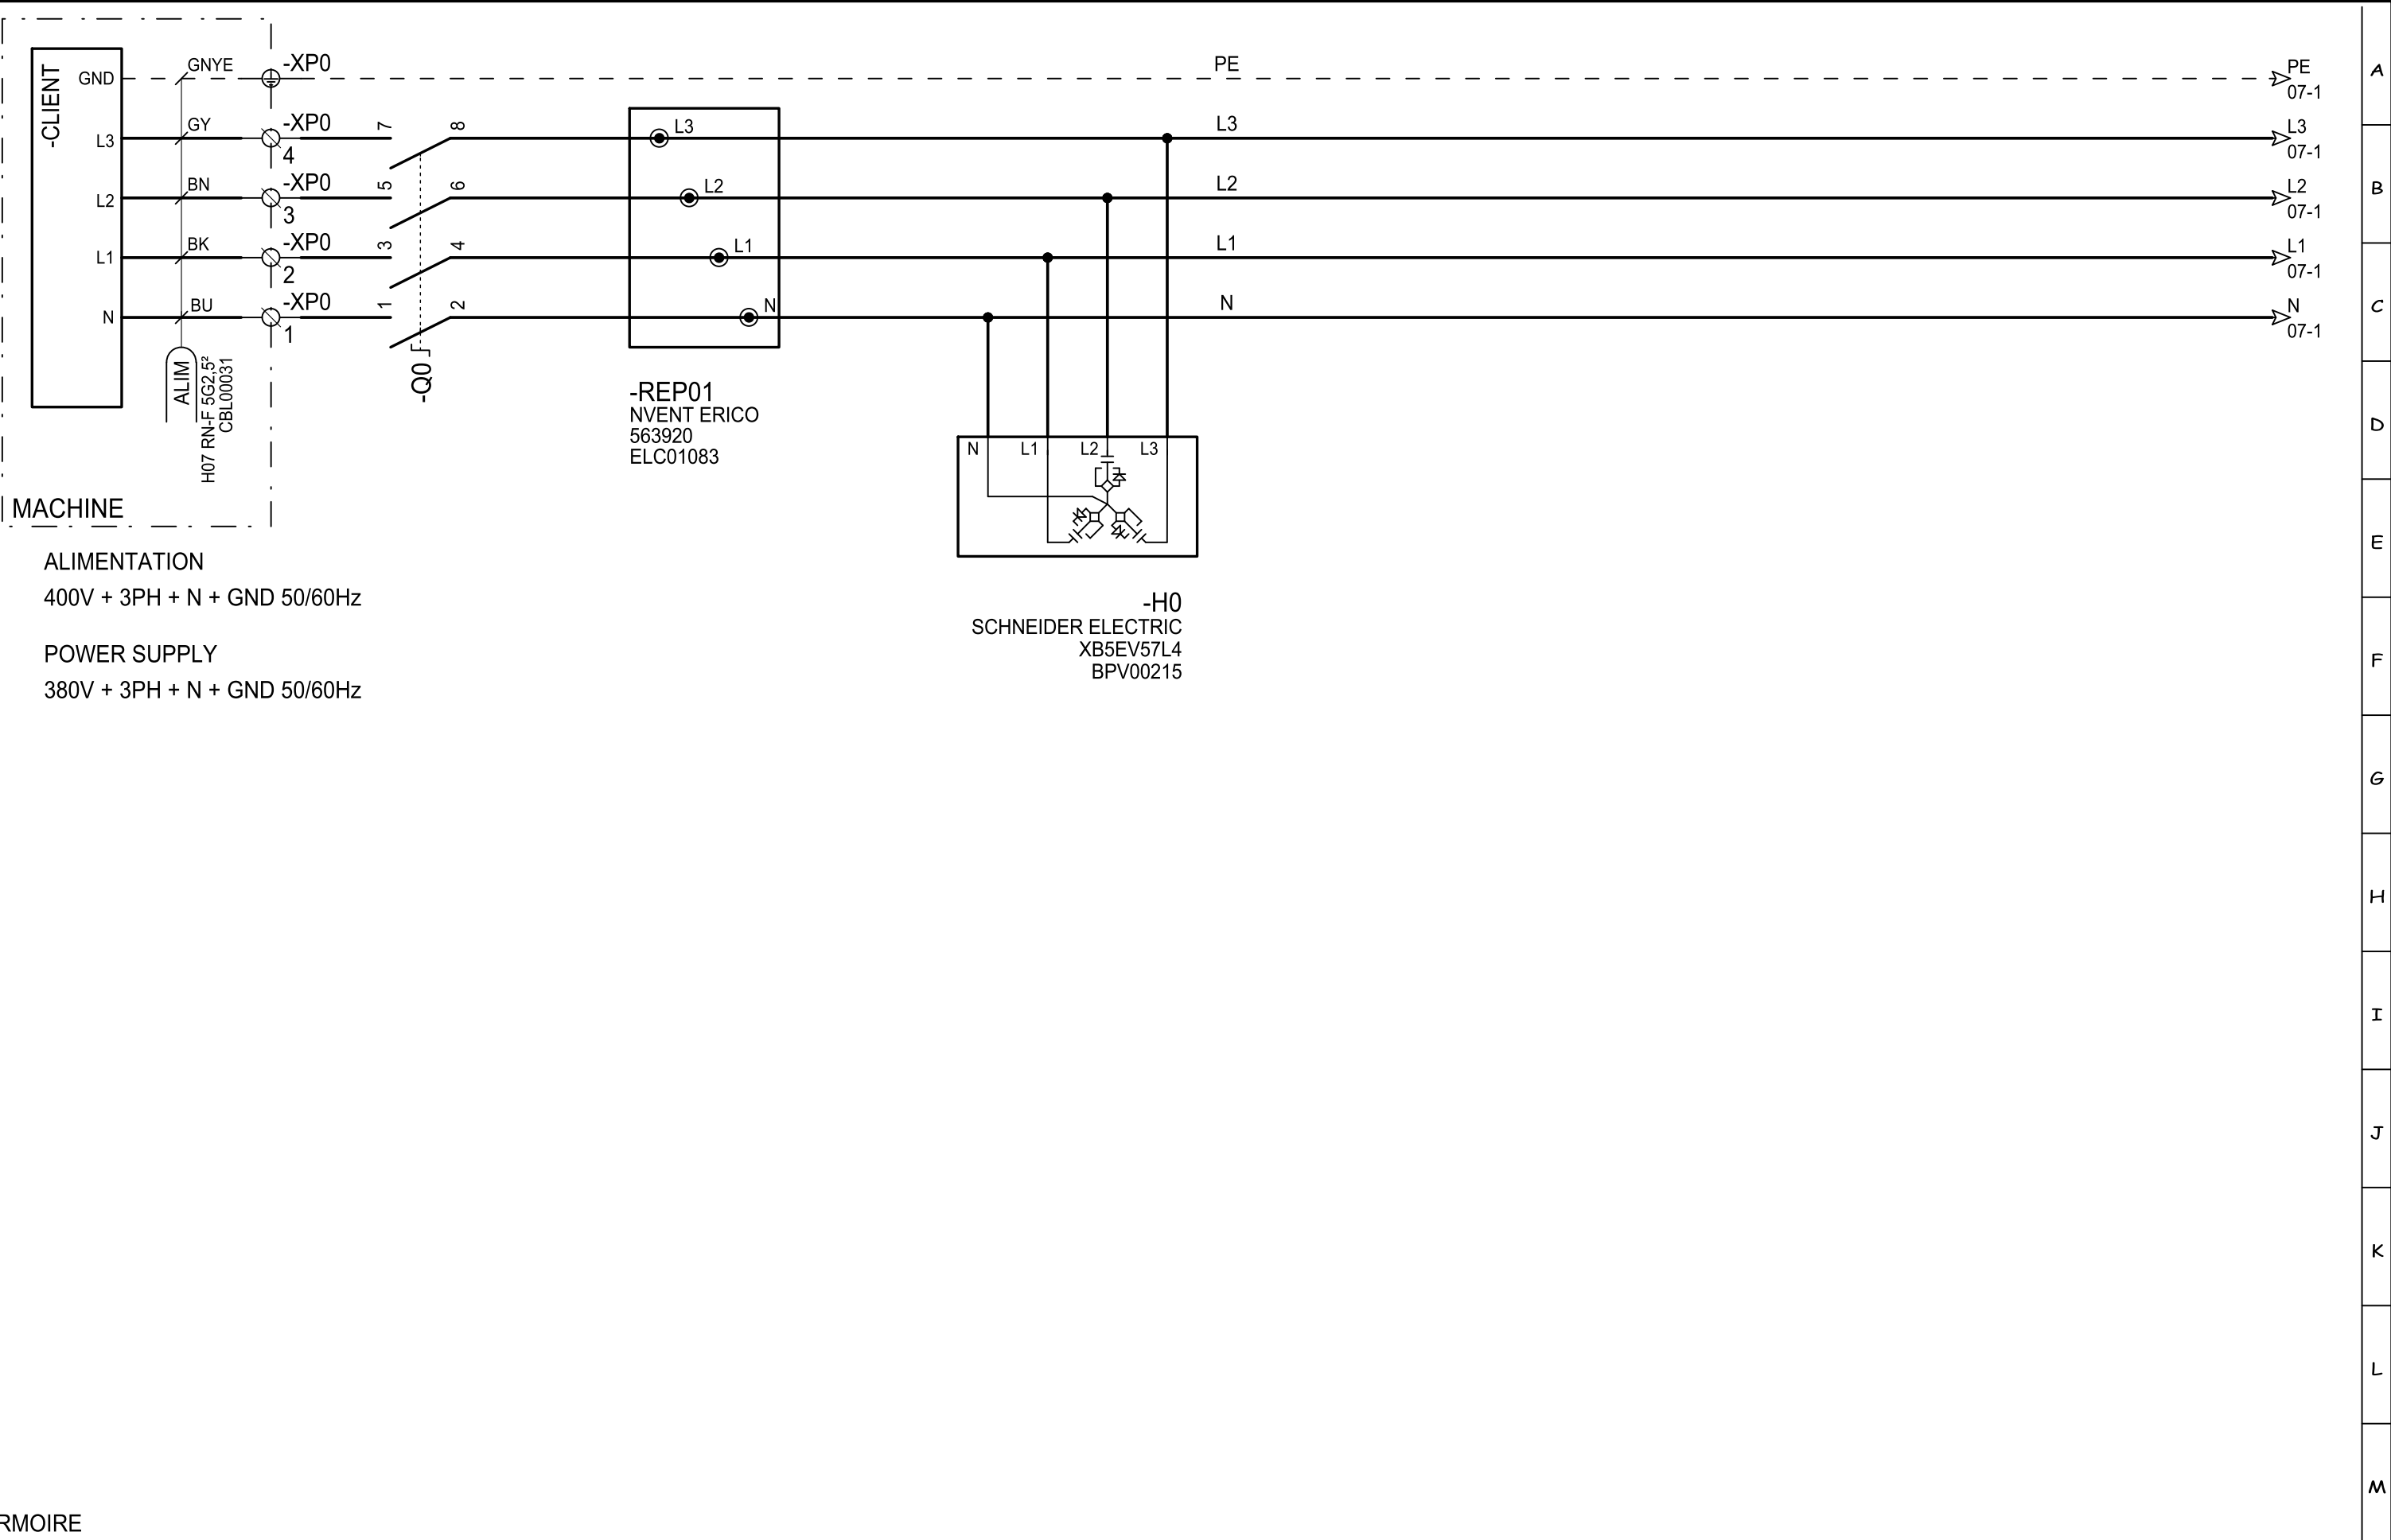

ALIMENTATION

400V + 3PH + N + GND 50/60Hz

POWER SUPPLY

380V + 3PH + N + GND 50/60Hz

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
17/11/2025

Designed by :
BM

SCHEMA DE PUISSANCE

POWER DIAGRAM

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
C01508

CUSTOMER :
PONDEX ALCALA DEL RIO

COUNTRY :
ESPAGNE


ARTICLE :

SMXA-OPT1-C015081

INDEX : V1

FOLIO :
06/26

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

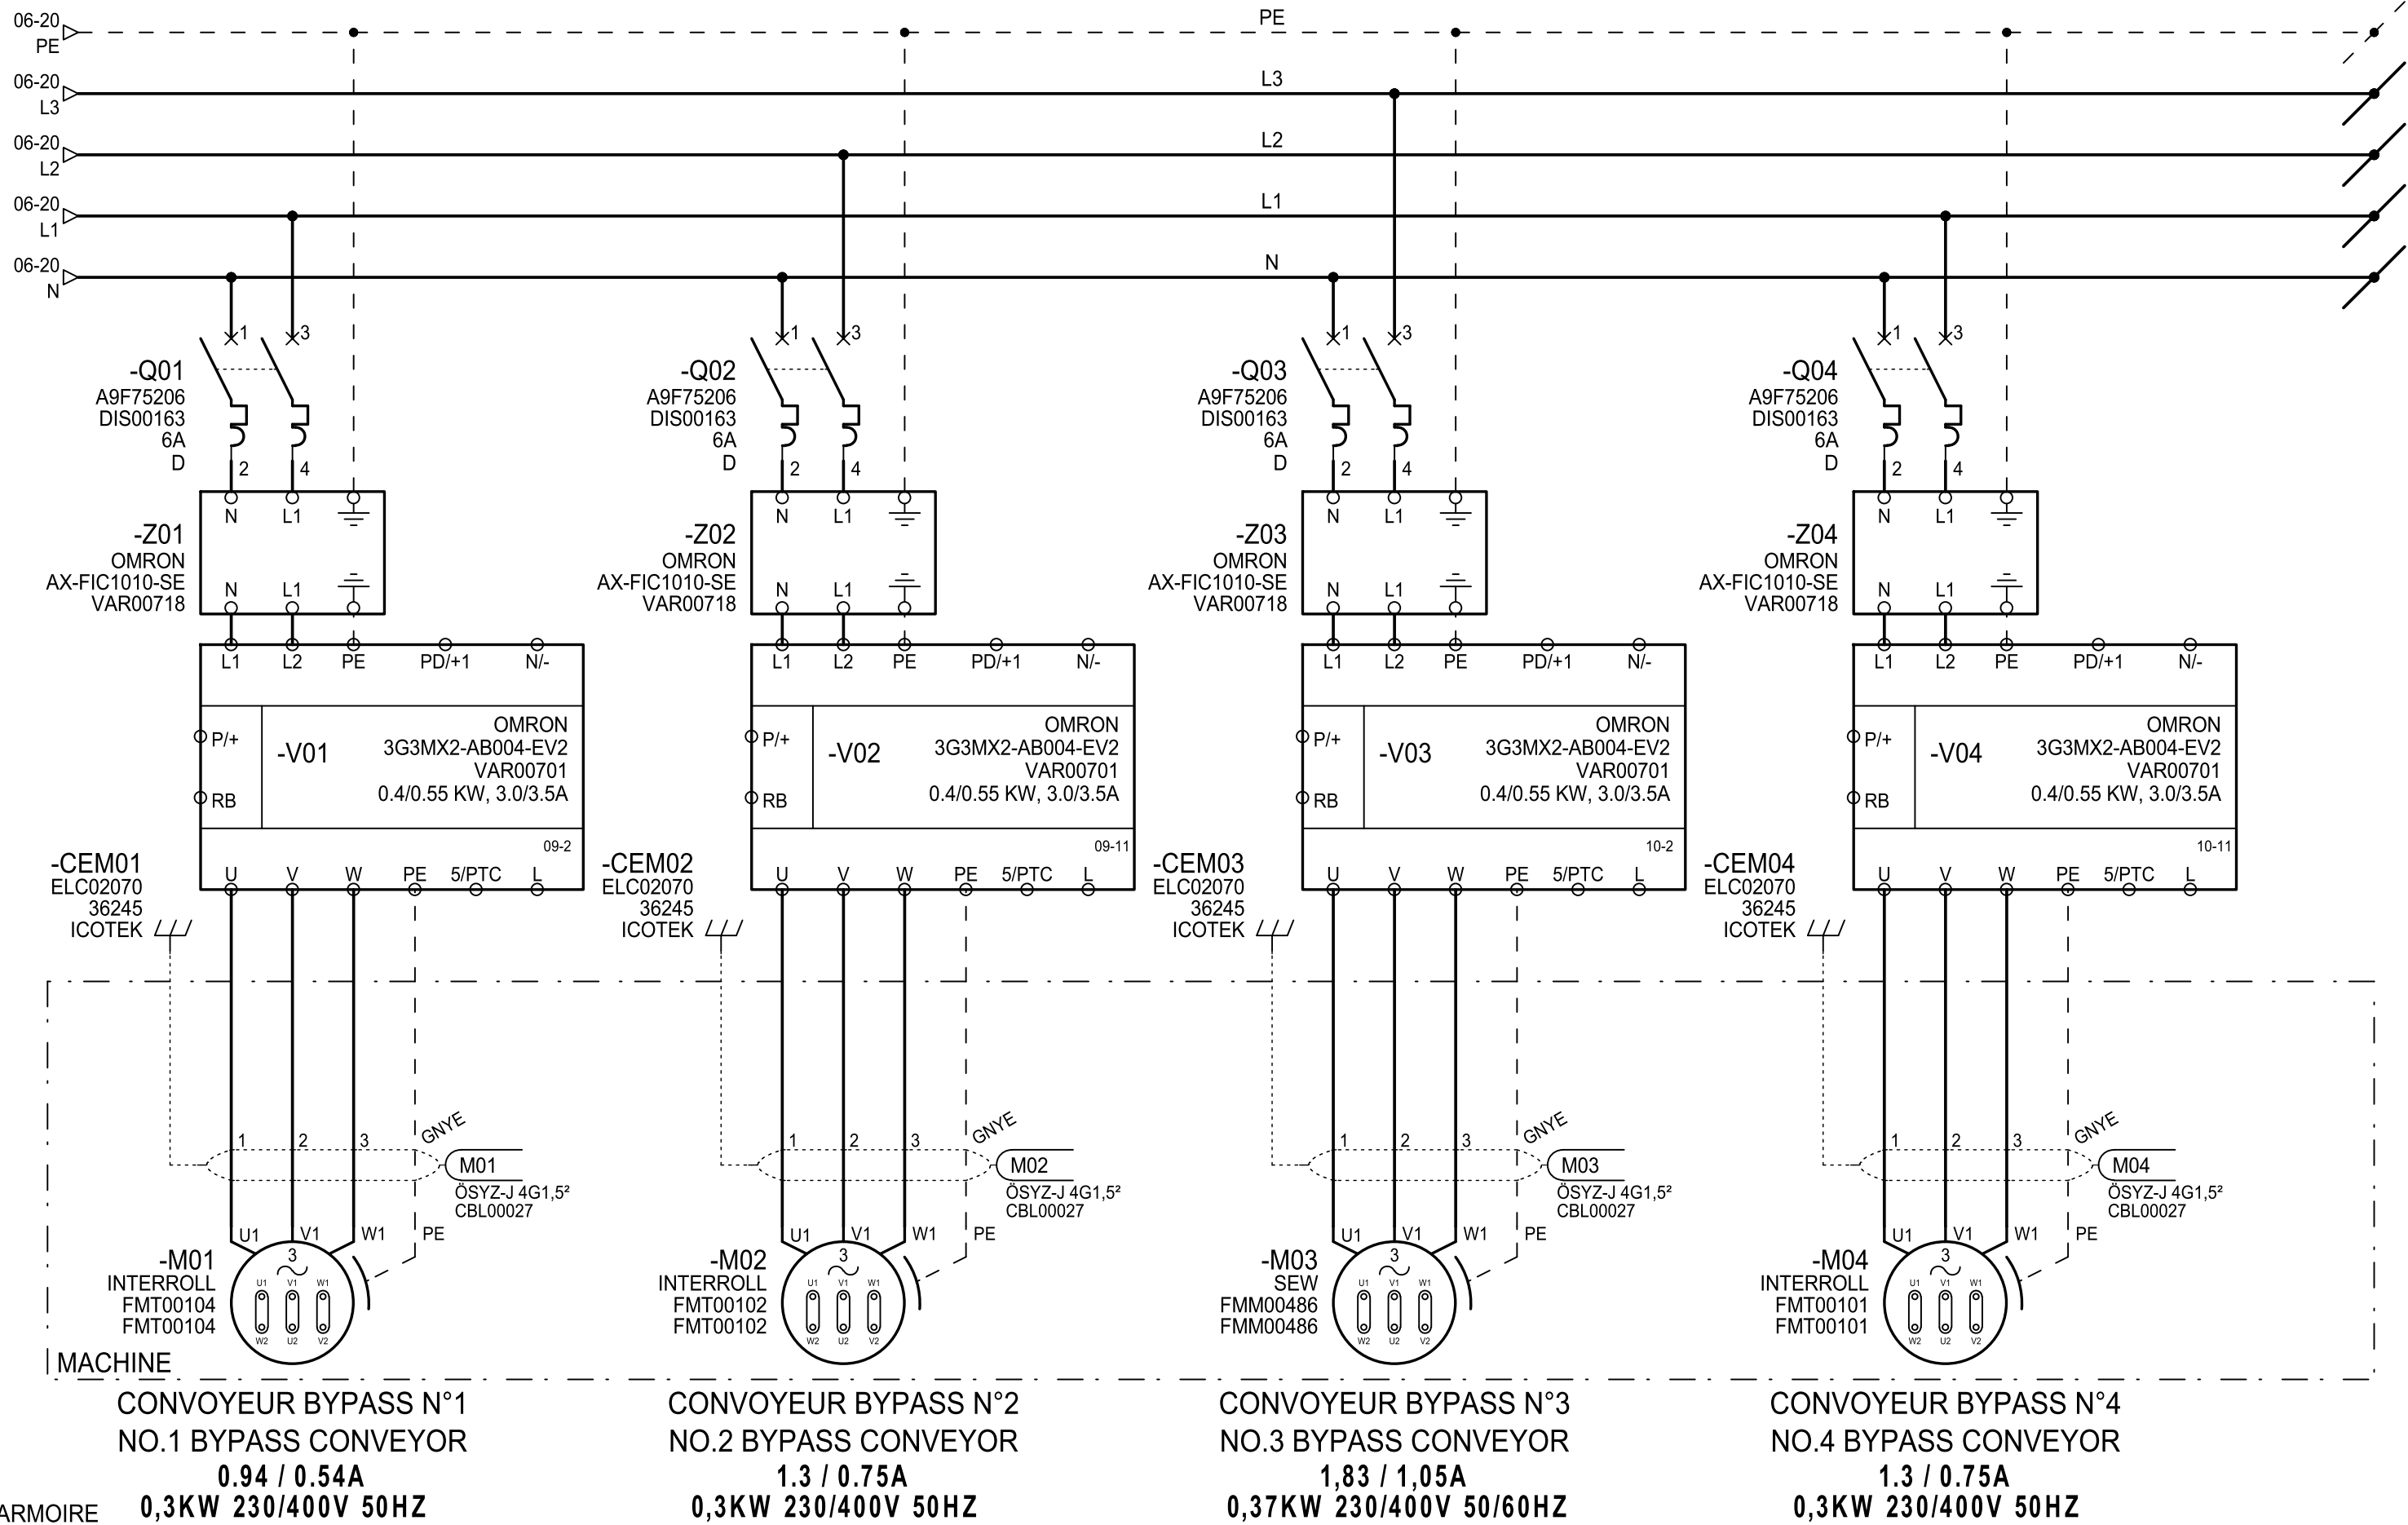

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com


Date of creation :
17/11/2025
Designed by :
BM

SCHEMA DE PUISSANCE
POWER DIAGRAM
ENVIRONNEMENT : Elec_IEC V5R2_ECATID



CONTRACT :
C01508
CUSTOMER :
PONDEX ALCALA DEL RIO
ARTICLE :
SMXA-OPT1-C015081

COUNTRY :
ESPAGNE
INDEX :
V1
FOLIO :
07/26

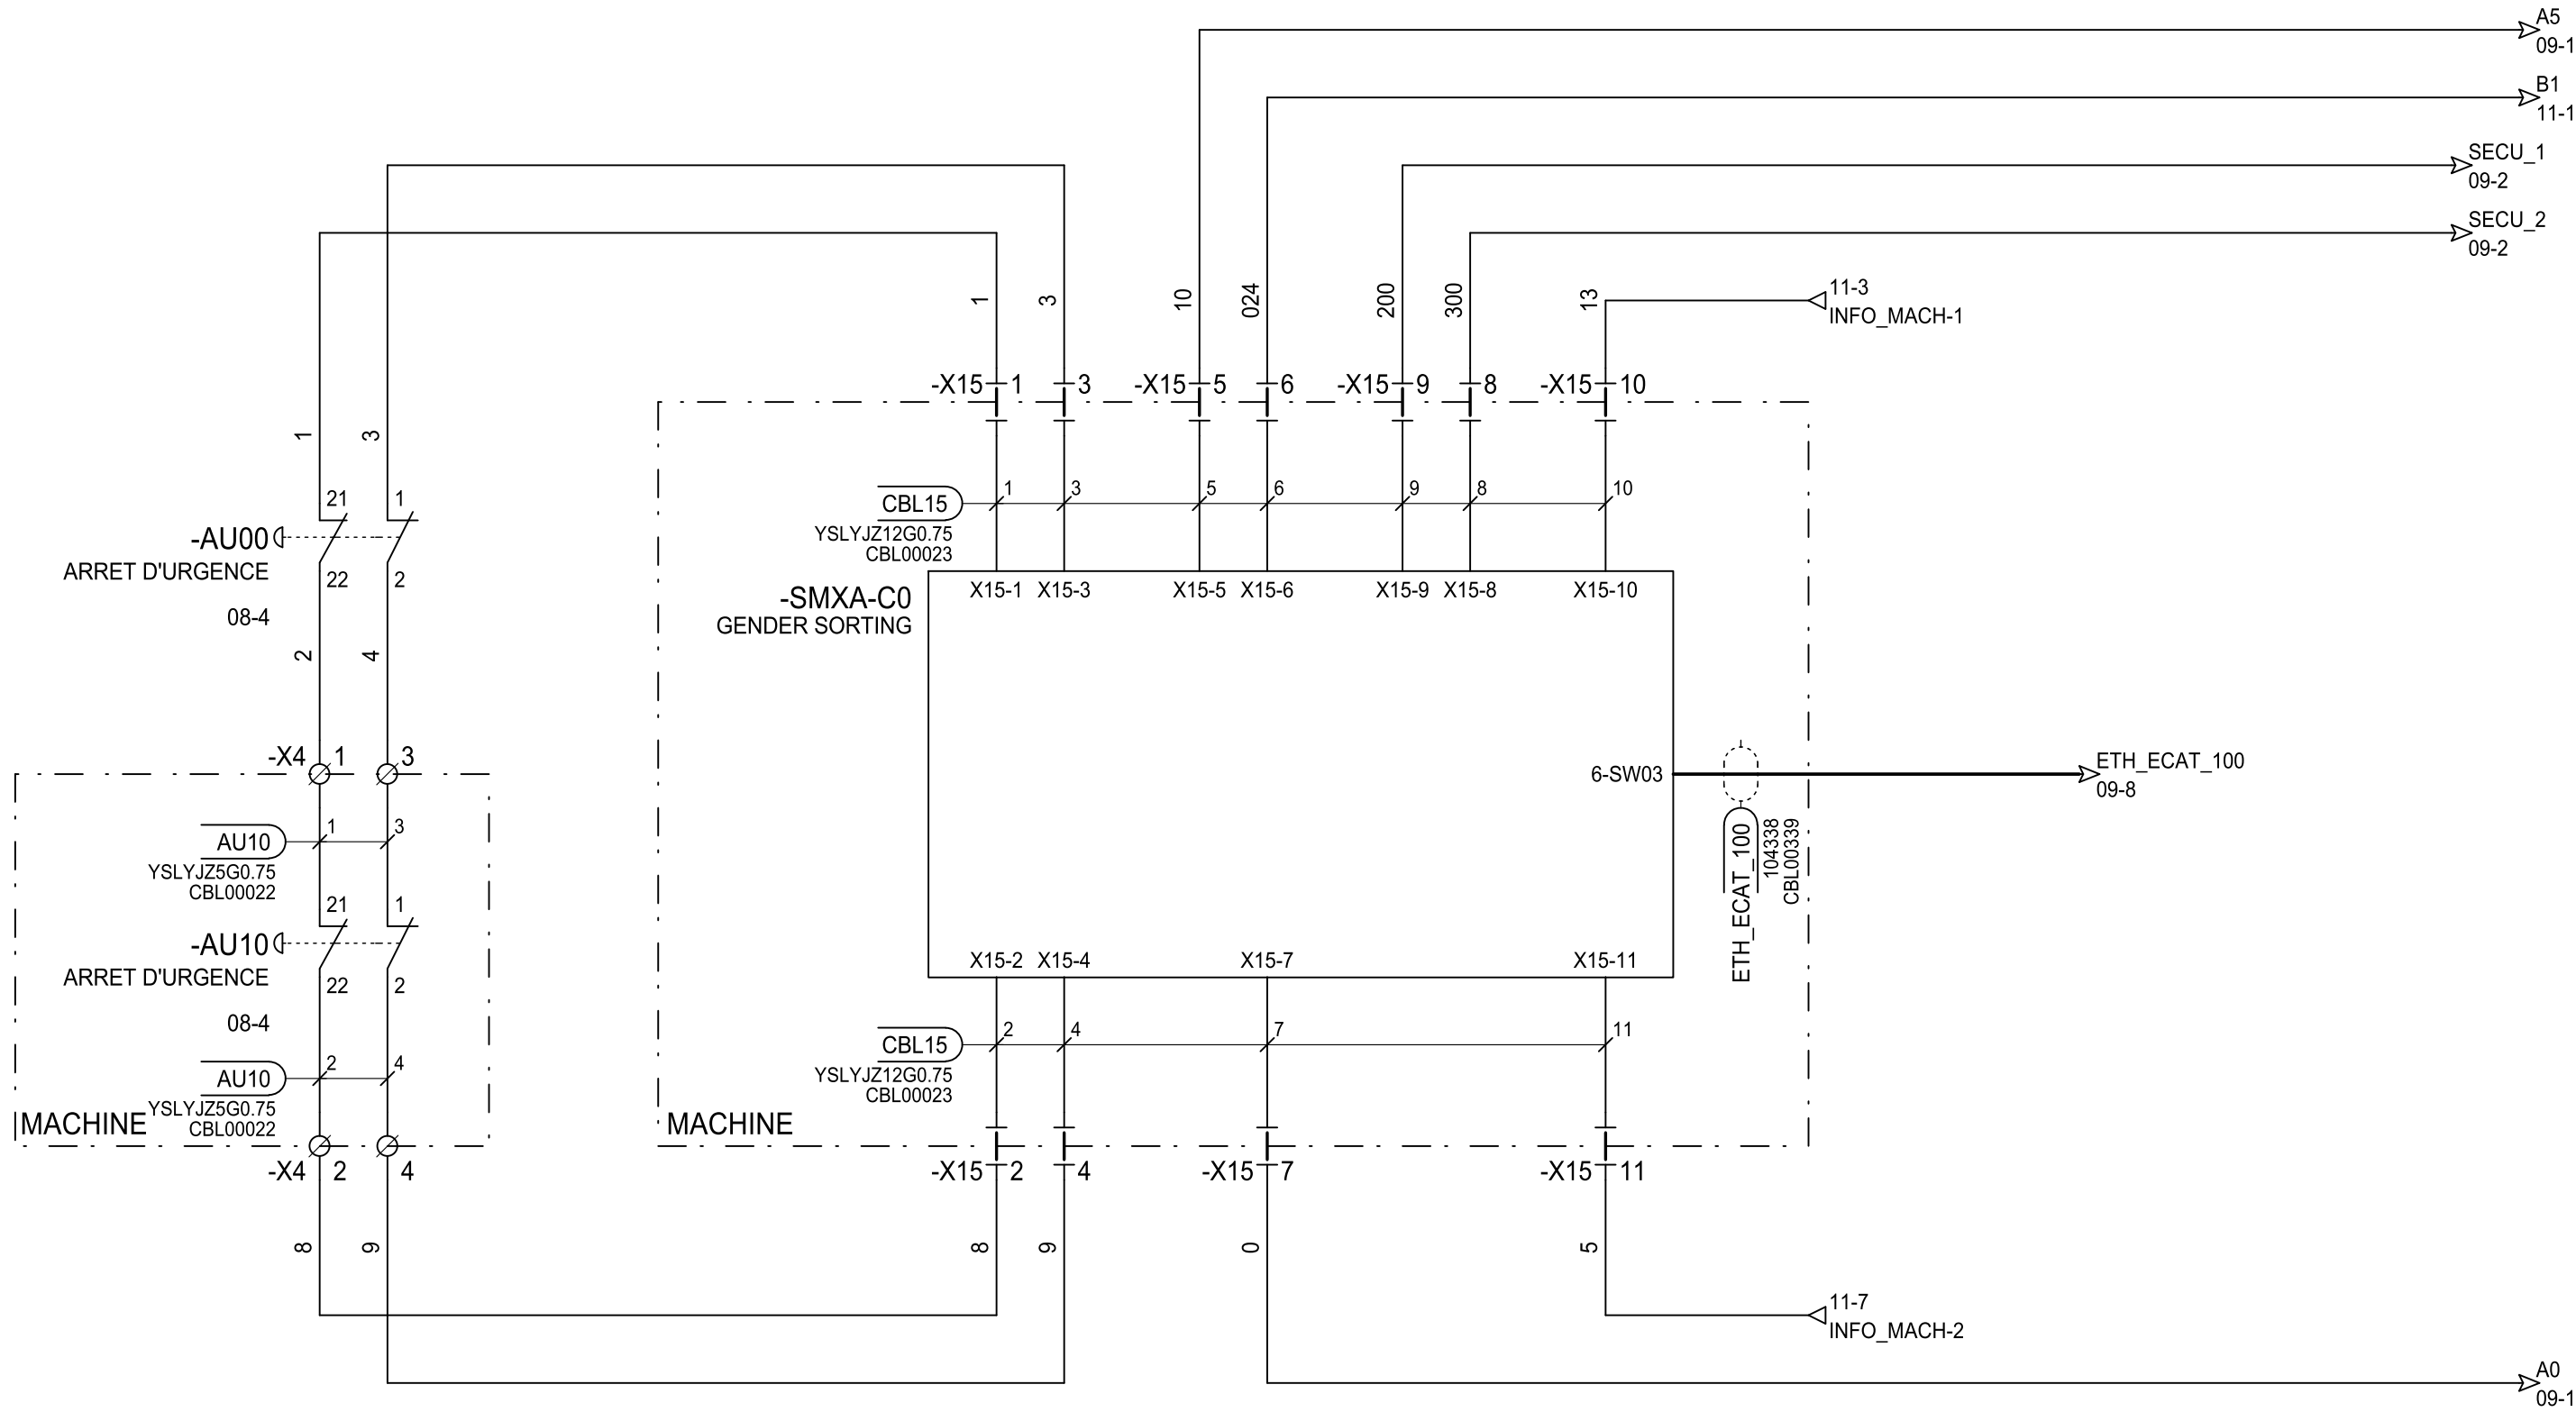


ECHANGE : SMXA => SMXA-OPT1
EXCHANGE : SMXA => SMXA-OPT1

ARMOIRE

ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE	Tél : (33).2.98.85.31.36	Date of creation : 17/11/2025	SCHEMA DE COMMANDE	 Ecat-iD Campus	CONTRACT : C01508	CUSTOMER : PONDEX ALCALA DEL RIO	COUNTRY : ESPAGNE
	Fax : (33).2.98.85.31.38	Designed by : BM	CONTROL DIAGRAM		ARTICLE : SMXA-OPT1-C015081		INDEX : V3
	E-mail : ecatic.service@ceva.com	ENVIRONNEMENT : Elec_IEC V5R2_ECATICID					FOLIO : 08/26


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

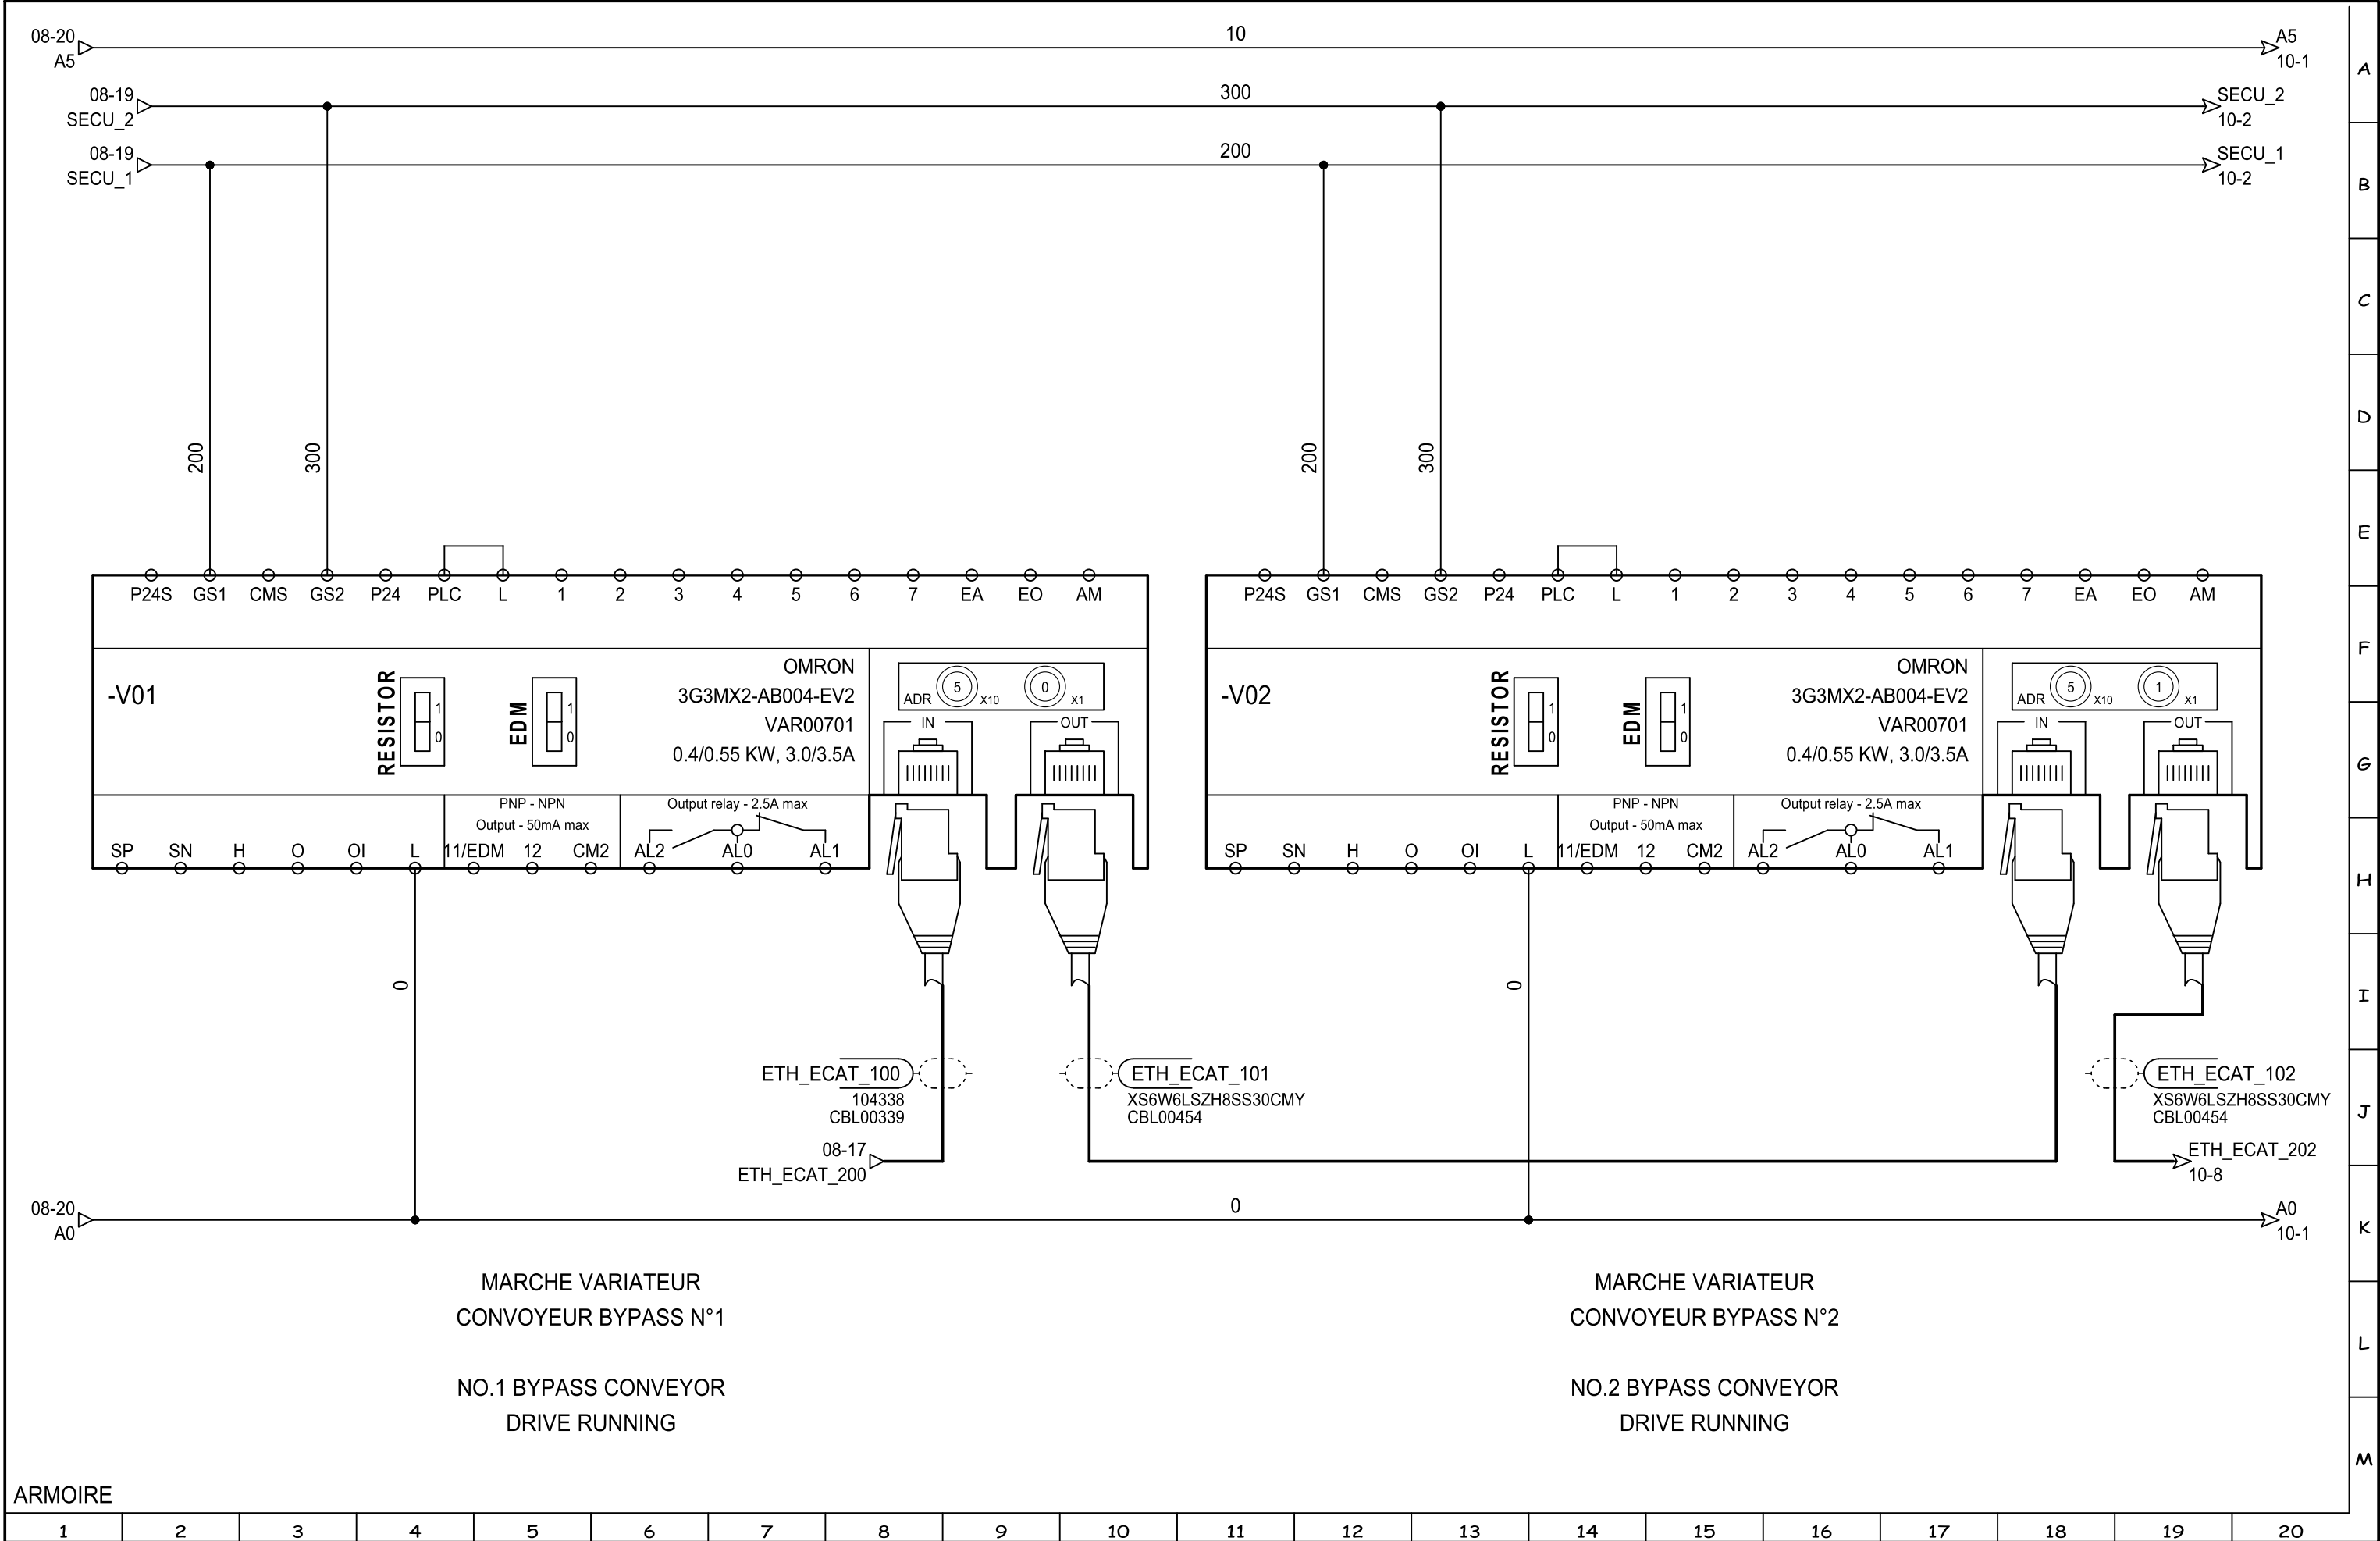

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		CONTROL DIAGRAM								ARTICLE : SMXA-OPT1-C015081		INDEX : V1			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID										FOLIO : 09/26			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

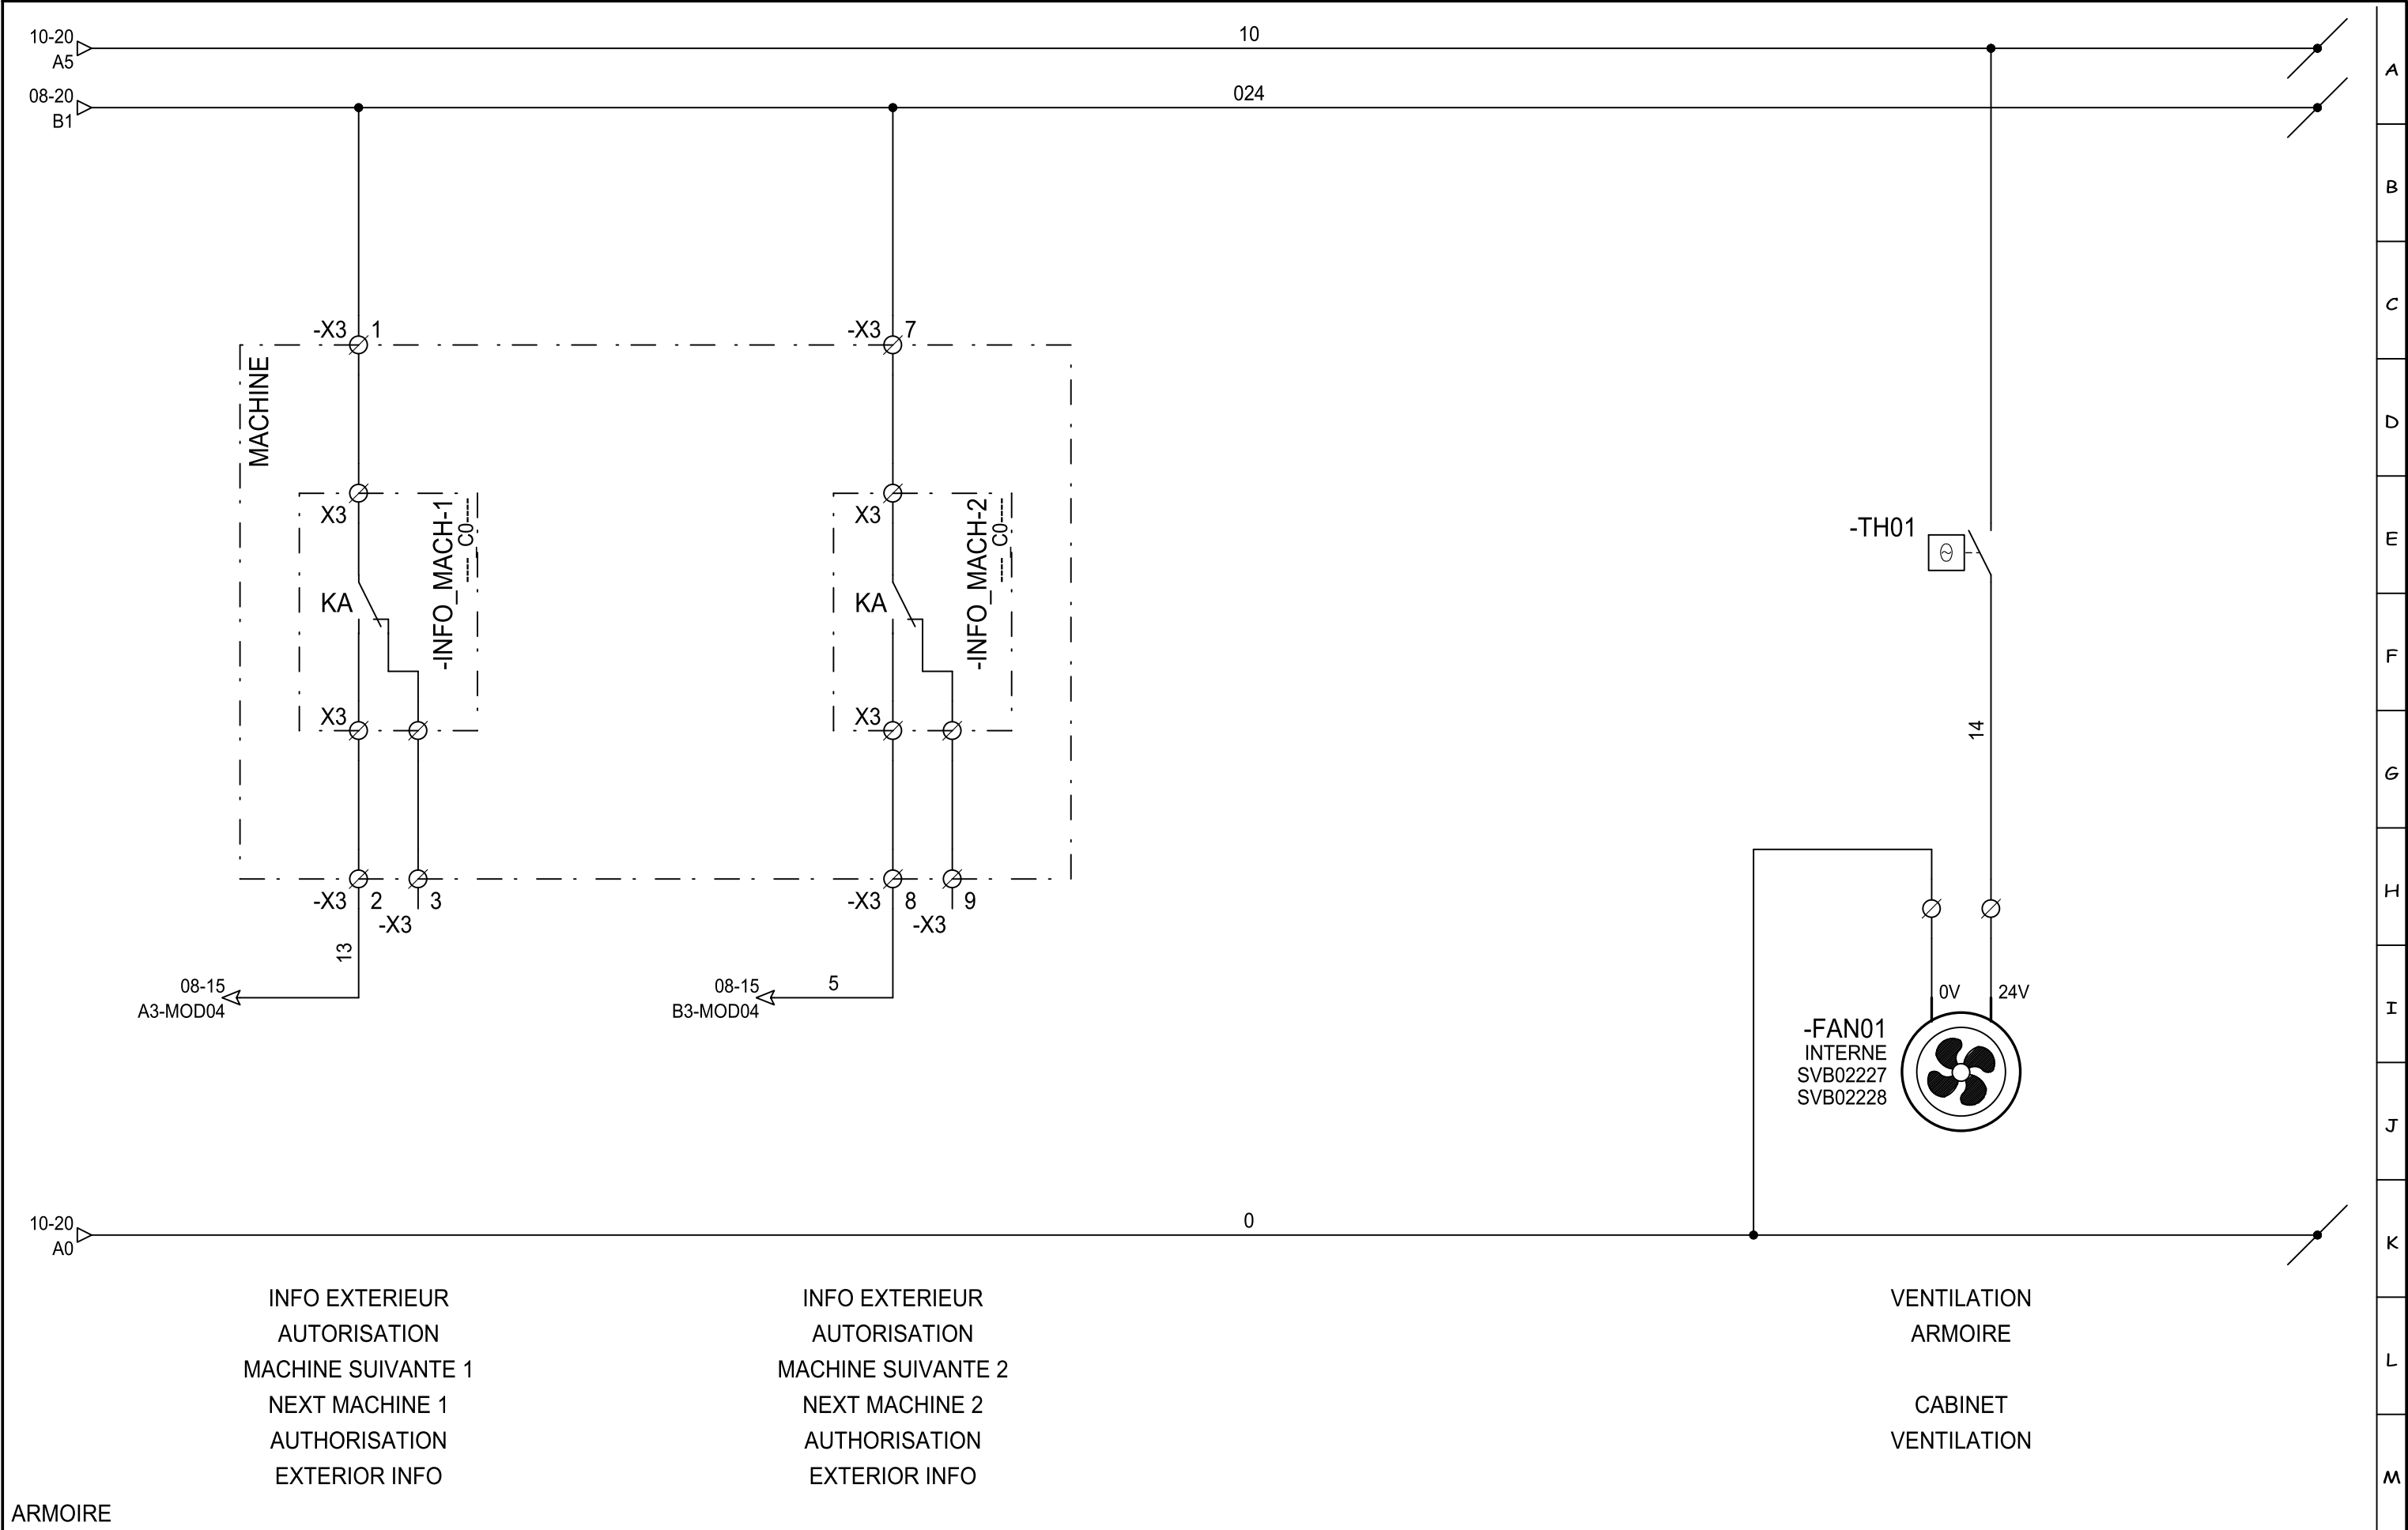

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		CONTROL DIAGRAM								ARTICLE : SMXA-OPT1-C015081		INDEX : V2			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 11/26					


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE PUISSANCE : XP0
POWER TERMINAL BLOCK : XP0

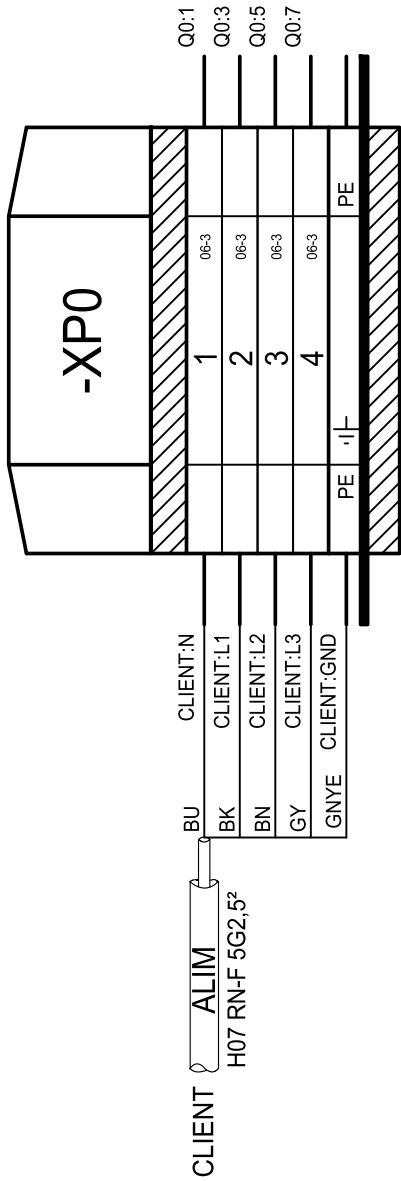

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		BORNIER : XP0			 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		TERMINAL BLOCK : XP0							ARTICLE : SMXA-OPT1-C015081		INDEX : V2			
			E-mail : ecaticid.service@ceva.com			ENVIRONNEMENT : Elec_IEC V5R2_ECATICID			FOLIO : 12/26										

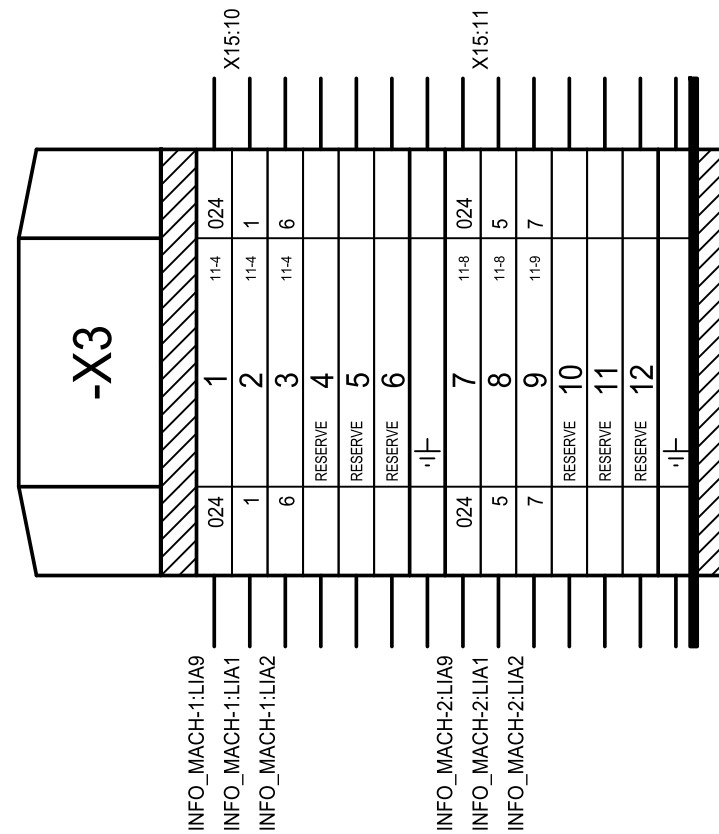

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com


Date of creation :
17/11/2025

Designed by :
BM

BORNIER : X3

TERMINAL BLOCK : X3

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :	C01508
------------	--------

CUSTOMER :	PONDEX ALCALA DEL RIO
------------	-----------------------

ARTICLE :

SMXA-OPT1-C015081

COUNTRY :	ESPAGNE
-----------	---------

INDEX :	V2
---------	----

FOLIO : 13/26

A

3 |

5

III

"

G

H

1

1


1

1

A

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X4
CONTROL TERMINAL BLOCK : X4

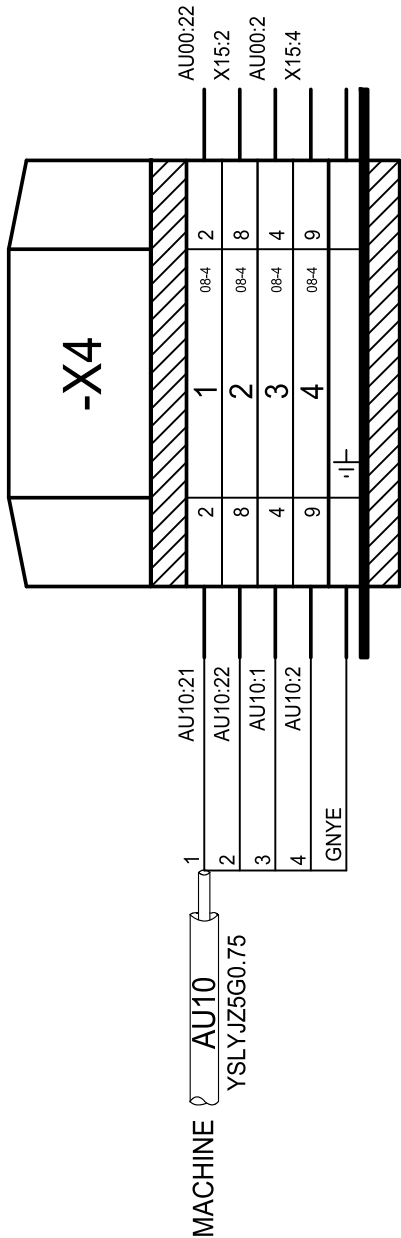

ARMOIRE


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		BORNIER : X4			 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		TERMINAL BLOCK : X4							ARTICLE : SMXA-OPT1-C015081				INDEX : V3	
			E-mail : ecaticid.service@ceva.com			ENVIRONNEMENT : Elec_IEC V5R2_ECATICID			FOLIO : 14/26										



A
B
C
D
E
F
G
H
I
J
K
L
M

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACADE ARMOIRE
CABINET FRONT LAYOUT

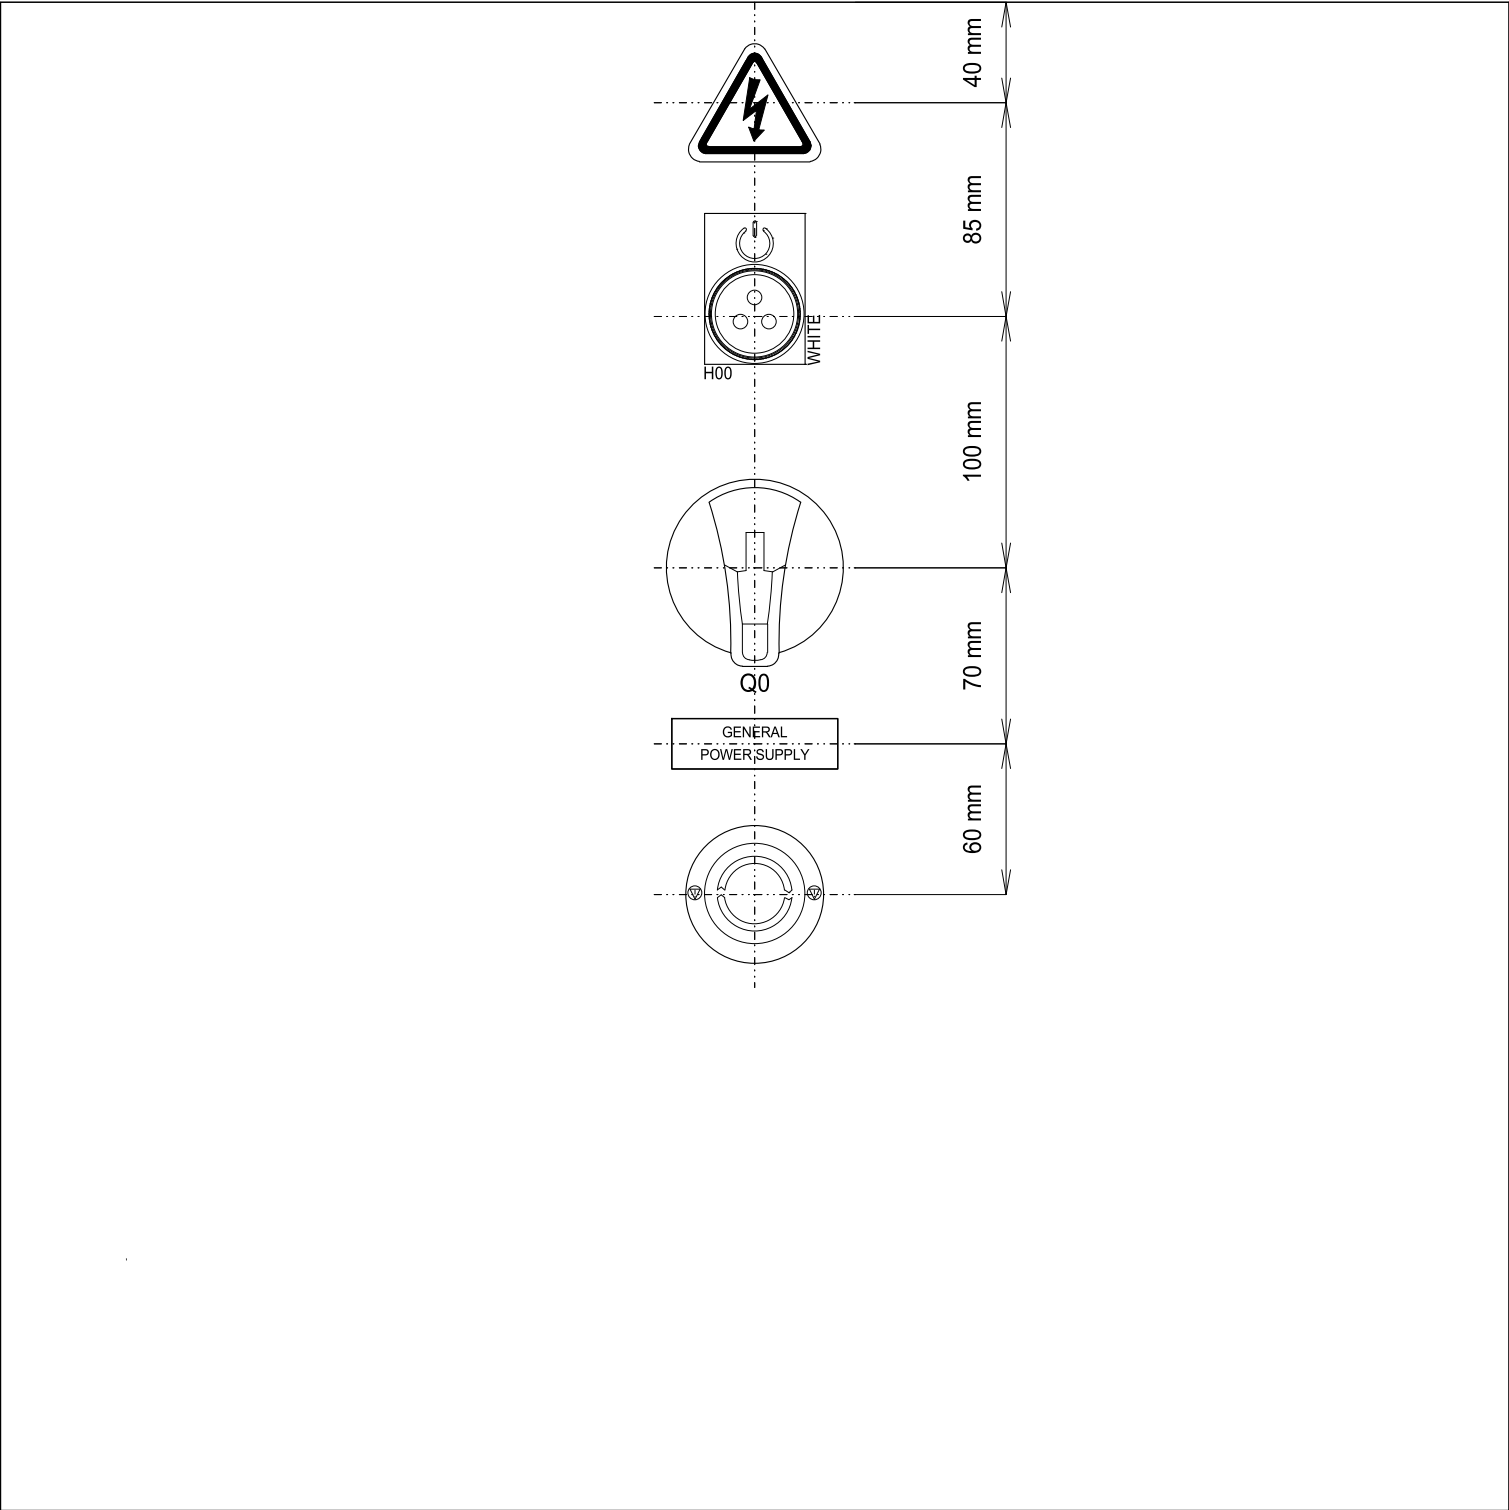

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
17/11/2025

Designed by :
BM

IMPLANTATION FACADE ARMOIRE

CABINET FRONT LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
C01508

CUSTOMER :
PONDEX ALCALA DEL RIO

ARTICLE :
SMXA-OPT1-C015081



COUNTRY :
ESPAGNE

INDEX :
V1

FOLIO :
16/26

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION COTE ARMOIRE
CABINET SIDE LAYOUT

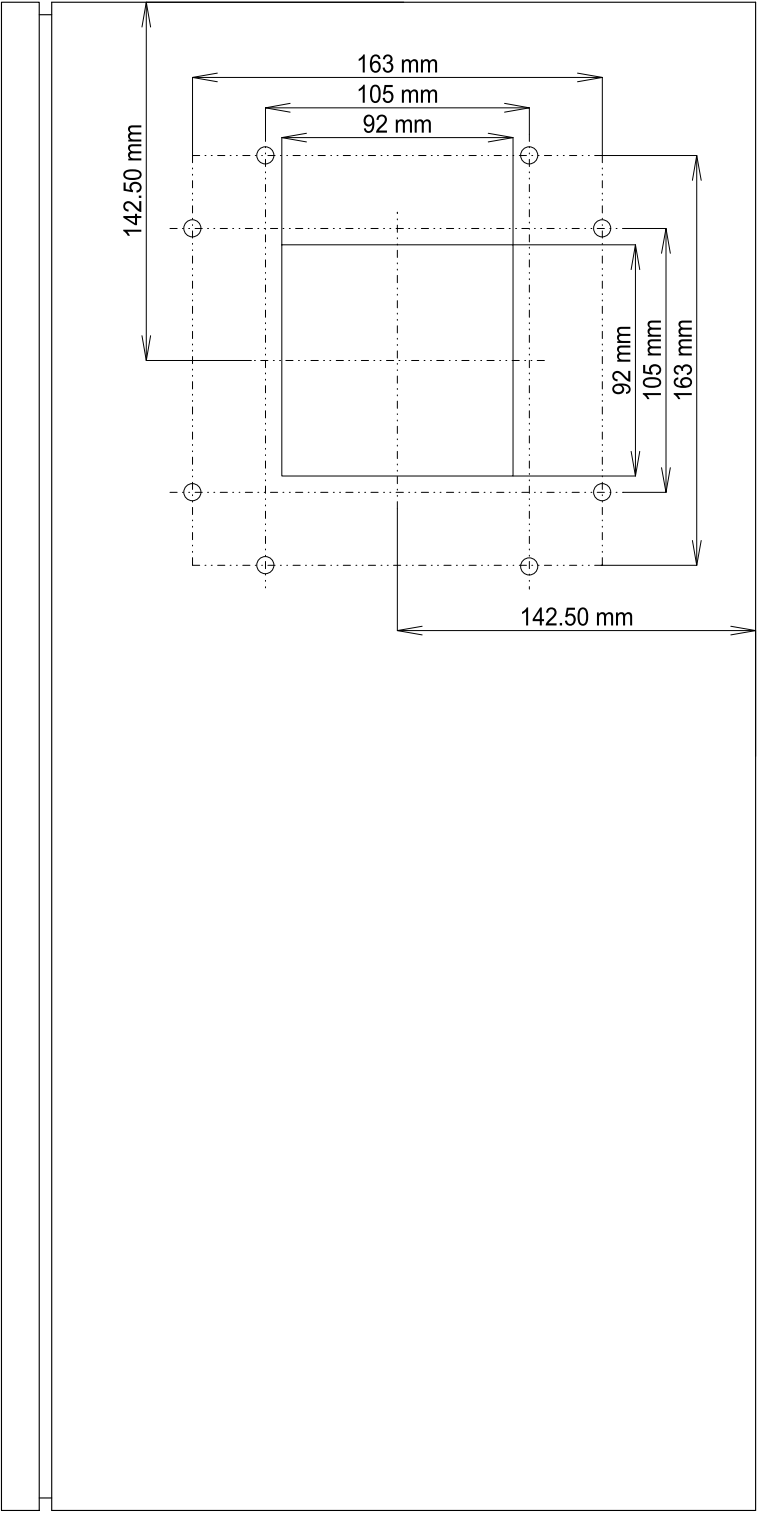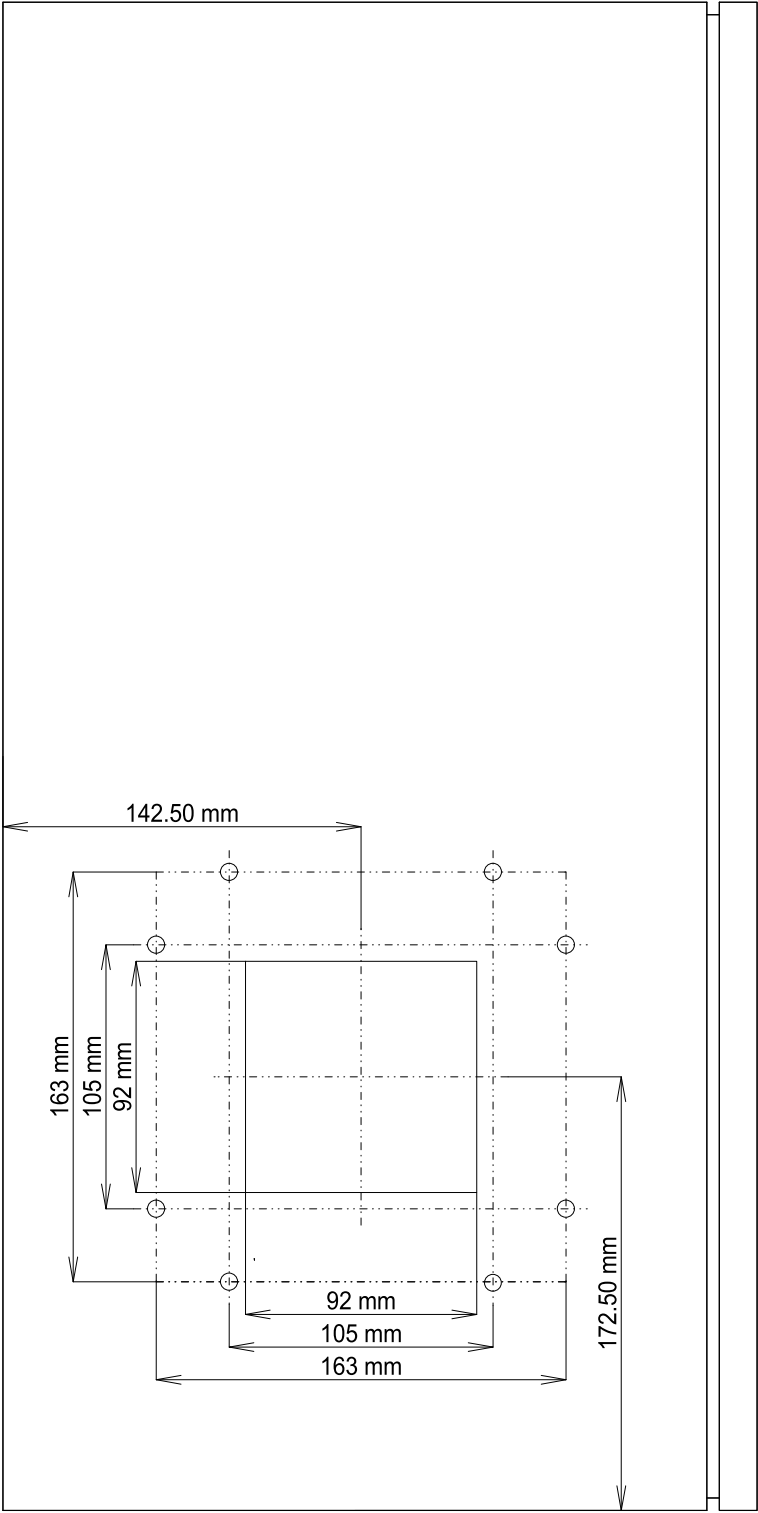

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
17/11/2025

Designed by :
BM

IMPLANTATION COTE ARMOIRE

CABINET SIDE LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
C01508

CUSTOMER :
PONDEX ALCALA DEL RIO

ARTICLE :

SMXA-OPT1-C015081

COUNTRY :
ESPAGNE

INDEX :
V1

FOLIO :
17/26

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tél : (33) 2.98.85.31.36

Fax : (33) 2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation : 17/11/2025

Designed by : BM

IMPLANTATION PLATINE ARMOIRE

CABINET BOARD LAYOUT



Ecat-ID Campus

CONTRACT : C01508

ARTICLE : SMXA-OPT1-C015081

CUSTOMER : PONDEX ALCALA DEL RIO

INDEX : V2

COUNTRY : ESPAGNE

FOLIO : 18/26

ARMOIRE

IMPLANTATION PLATINE ARMOIRE

CABINET BOARD LAYOUT

ESPACEMENT DE 30mm ENTRE CHAQUE VARIATEUR

The diagram illustrates the cabinet board layout for the ECAT-ID system. It features four inverters labeled -V01, -V02, -V03, and -V04, each with a control panel and a terminal block (-CEM01 to -CEM04). The inverters are spaced 30mm apart. Below the inverters is a terminal block (X24V) and a fuse (TH01). The layout is divided into sections with dimensions: 47.5 mm, 77.5 mm, 85 mm, 80 mm, and 60 mm. The diagram also shows various connectors (X3, X4, X15, 04X) and a terminal block (X24V).

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

LOCALISATION	FOLIO	REPERE	DESIGNATION	QTE	REFERENCE	CODE ECAT-ID	FABRICANT	FILTRE
		ETH_ECAT_100	CONNECTEUR RJ45 A MONTER IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
ARMOIRE	01	ARMOIRE	COFFRET INOX 600x600x300	1	CPN606030	BOX00367	MP GAMMA	ARMOIRE
ARMOIRE	06	REP01	REPARTITEUR TETRAPOLAIRE TD 80/100 A, 6 CONNEXIONS	1	563920	ELC01083	NVENT ERICO	ARMOIRE
ARMOIRE	07	CEM01	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	07	CEM02	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	07	CEM03	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	07	CEM04	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	07	Q01	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	07	Q02	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	07	Q03	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	07	Q04	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	07	V01	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	07	V01	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	07	V02	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	07	V02	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	07	V03	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	07	V03	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	07	V04	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	07	V04	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	07	Z01	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	07	Z02	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	07	Z03	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	07	Z04	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	11	FAN01	KIT ENS CAPOT VENTILATEUR ELC00708 SANS VENTILATEUR PETIT MO	1	SVB02227	SVB02227	INTERNE	ARMOIRE
ARMOIRE	11	FAN01	KIT ENS CAPOT VENTILATEUR ELC00708 AVEC VENTILATEUR PETIT MO	1	SVB02228	SVB02228	INTERNE	ARMOIRE
ARMOIRE	11	TH01	THERMOSTAT MECANIQUE 0 60°C "F"	1	NSYCCOTH0	SEN00671	SCHNEIDER ELECTRIC	ARMOIRE

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

LOCALISATION	TAG	SHEET	DESCRIPTION	QTY	CATALOG No	CODE ECAT-ID	MANUFACTURER	FILTER
ETH_ECAT_100			RJ45 CONNECTOR TO MOUNT IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
ARMOIRE	ARMOIRE	01	STAINLESS STEEL BOX 600X600X300	1	CPN606030	BOX00367	MP GAMMA	ARMOIRE
ARMOIRE	CEM01	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	CEM02	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	CEM03	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	CEM04	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	FAN01	11	KIT SET FAN COVER WITHOUT FAN ELC00708 SMALL MODEL	1	SVB02227	SVB02227	INTERNE	ARMOIRE
ARMOIRE	FAN01	11	KIT SET FAN COVER WITH FAN ELC00708 SMALL MODEL	1	SVB02228	SVB02228	INTERNE	ARMOIRE
ARMOIRE	Q01	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	Q02	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	Q03	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	Q04	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	REP01	06	TD 80/100 A TETRAPOLAR SPLITTER, 6 CONNECTIONS	1	563920	ELC01083	NVENT ERICO	ARMOIRE
ARMOIRE	TH01	11	MECHANICAL THERMAL SENSOR 0 60°C "NC"	1	NSYCCOTH0	SEN00671	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	V01	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	V01	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 K	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	V02	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	V02	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 K	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	V03	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	V03	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 K	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	V04	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
ARMOIRE	V04	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 K	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
ARMOIRE	Z01	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	Z02	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	Z03	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE
ARMOIRE	Z04	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIC1010-SE	VAR00718	OMRON	ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatic.service@ceva.com


Date of creation : 17/11/2025	NOMENCLATURE ARMOIRE ANGLAIS
Designed by : BM	ENGLISH ENCLOSURE PART LIST
	ENVIRONNEMENT : Elec_IEC V5R2_ECATIC





Ecat-iD Campus


CONTRACT : C01508	CUSTOMER : PONDEX ALCALA DEL RIO
ARTICLE : SMXA-OPT1-C015081	

COUNTRY : ESPAGNE	INDEX : V2
FOLIO : 20/26	

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36	Date of creation : 17/11/2025		NOMENCLATURE BOUTONNERIE FRANCAISE				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO			COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38	Designed by : BM		FRENCH BUTTON PARTS LIST								ARTICLE : SMXA-OPT1-C015081			INDEX : V2			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID										FOLIO : 21/26			

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		CARNET DE CABLE FRANCAIS				 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO			COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH CABLE BOOKLET								ARTICLE : SMXA-OPT1-C015081			INDEX : V2			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 23/26						

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 17/11/2025		CARNET DE CABLE ANGLAIS			 Ecat-iD Campus				CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO			COUNTRY : ESPAGNE		
			Fax : (33).2.98.85.31.38		Designed by : BM		ENGLISH CABLE BOOKLET							ARTICLE : SMXA-OPT1-C015081						INDEX : V2	
			E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Elec_IEC V5R2_ECATID						FOLIO : 24/26							

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36	Date of creation : 17/11/2025		NOMENCLATURE MOTEUR FRANCAIS		 Ecat-iD Campus						CONTRACT : C01508		CUSTOMER : PONDEX ALCALA DEL RIO		COUNTRY : ESPAGNE	
			Fax : (33).2.98.85.31.38	Designed by : BM		FRENCH MOTOR PART LIST								ARTICLE : SMXA-OPT1-C015081				INDEX : V2	
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID		FOLIO : 25/26												
