

ARMOIRE

PANEL TAG: A

Panel material: INOX
Panel size: 600X1800X370 + 600X1800X600
Panel brand: IRINOX
Junction boxes material: INOX

EQUIPMENTS USED

Buttons brand: SCHNEIDER
Button language: ANGLAIS
Security components: SICK or Phoenix Contact
Panel components: Schneider / Phoenix Contact / Omron / Siemens
Terminals (power and command): Phoenix Contact

WIRING

Icc breaking capacity: 10kA
Shielded cables on Inverters
Wire colors: +24Vdc = Purple
0Vdc = White
External command: Orange

110Vac = Brown
>110Vac = Black
Neutral = Blue
Ground = Yellow/Green

Estimated electrical characteristics

(machine)

Total nominal power (kW): 9
Total nominal current (Amps): 22

Main circuit breaker advisable

(customer)

Breaker grade (Amps): 32
Breaker curve (type): C OR D

Minimum section power supply cable requirement

(customer) :

3 PH+N+GND 400V 50HZ
Wire section (mm²): 6mm²
Cable type (wires number): 5G6² H07 RNF / U1000 R2V

Main breaker and power supply cable can be different
depending of the electrical installation
(cable material, lenght, installation method, ...)

CE DOCUMENT EST LA PROPRIETE DE ECAT-ID. IL EST REMIS A TITRE CONFIDENTIEL.
IL NE DOIT PAS ETRE REPRODUIT OU COMMUNIQUE A DES TIERS SANS NOTRE AUTORISATION ECRITE.
THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL.
IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING FORM.

V8	MODIF IMPLANTATION BORNIER B10	15/04/2024	JT	JT	JT
V7	MAJ BORNIER X20 + CABLES CODEUR	09/04/2024	JT	JT	JT
V6	AJOUT CAPTEUR D'ENTREE ET CAPTEUR I/O LINK	03/04/2024	DB	JT	JT
V5	MODIF FOLIO 01/02/03/10/23/27/31/53/76/100/104	28/03/2024	DB	JT	JT
V4	MODIF FOLIO 09/23/27/31/35/74/78/79/104	27/03/2024	DB	JT	JT
V3	MODIF FOLIO 21/24/28/32/75/102	19/03/2024	DB	JT	JT
V2	MODIF FOLIO 06/07/19/20/65/90/91/92/93	04/03/2024	DB	JT	JT
V1	CREATION	04/03/2024	DB	JT	JT
INDEX	MODIFICATION	DATE	DESIGNED	VERIFIED	APPROVED

SEXAGE POUSSINS

DESIGNED BY : DB

VERIFIED : JT

DATE OF CREATION : 04/03/2024

CUSTOMER : INTERNE

CONTRACT : INTERNE

PROCESS : PMXA

ECAT-ID

ZI de KERIEL
29800 PLOUEDERN
- FRANCE -

FOLIO : 01/144

Tel : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

ENVIRONNEMENT IGE-XACT-ECAT-ID_V4R3 240110 on 4.49.F - 23/09/2020



Ecat-iD Campus

COUNTRY :

FRANCE

DRAWING NUM:

SMXA00002

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

FOLIO	DESIGNATION	DATE DERNIERE MODIFICATION
01	SEXAGE POUSSINS	03/04/2024
02	LISTE DE FOLIO	03/04/2024
03	LISTE DE FOLIO	03/04/2024
04	LISTE DE FOLIO	03/04/2024
05	LISTE DE FOLIO	03/04/2024
06	SCHEMA PUISSANCE	03/04/2024
07	SCHEMA PUISSANCE	03/04/2024
08	SCHEMA PUISSANCE	03/04/2024
09	SCHEMA PUISSANCE	03/04/2024
10	SCHEMA PUISSANCE	03/04/2024
11	SCHEMA PUISSANCE UAC	03/04/2024
12	SCHEMA PUISSANCE UAC	03/04/2024
13	SCHEMA PUISSANCE UAC	03/04/2024
14	SCHEMA COMMANDE	03/04/2024
15	SCHEMA COMMANDE	03/04/2024
16	SCHEMA COMMANDE	03/04/2024
17	SCHEMA COMMANDE	03/04/2024
18	SCHEMA COMMANDE	03/04/2024
19	SCHEMA COMMANDE	03/04/2024
20	SCHEMA COMMANDE	03/04/2024
21	SCHEMA COMMANDE	03/04/2024
22	SCHEMA COMMANDE	03/04/2024
23	SCHEMA COMMANDE UAC	03/04/2024
24	SCHEMA COMMANDE UAC	03/04/2024
25	IMPLANTATION UAC100	03/04/2024
26	IMPLANTATION CAMERA VOIE 1 & 2	03/04/2024
27	IMPLANTATION ECLAIRAGE VOIE 1	03/04/2024
28	IMPLANTATION ECLAIRAGE VOIE 2	03/04/2024
29	IMPLANTATION UAC200	03/04/2024
30	IMPLANTATION CAMERA VOIE 3 & 4	03/04/2024
31	IMPLANTATION ECLAIRAGE VOIE 3	03/04/2024
32	IMPLANTATION ECLAIRAGE VOIE 4	03/04/2024
33	IMPLANTATION UAC300	03/04/2024
34	IMPLANTATION CAMERA VOIE 5 & 6	03/04/2024
35	IMPLANTATION ECLAIRAGE VOIE 5	03/04/2024

FOLIO	DESIGNATION	DATE DERNIERE MODIFICATION
36	IMPLANTATION ECLAIRAGE VOIE 6	03/04/2024
37	SCHEMA COMMANDE UAC	03/04/2024
38	SORTIES MOD2	03/04/2024
39	SORTIES MOD2	03/04/2024
40	SORTIES MOD3	03/04/2024
41	SORTIES MOD3	03/04/2024
42	SORTIES MOD102	03/04/2024
43	SORTIES MOD103	03/04/2024
44	SORTIES MOD104	03/04/2024
45	SORTIES MOD105	03/04/2024
46	SORTIES MOD105	03/04/2024
47	SORTIES MOD106	03/04/2024
48	SORTIES MOD106	03/04/2024
49	IMPLANTATION AUTOMATE	03/04/2024
50	IMPLANTATION AUTOMATE	03/04/2024
51	IMPLANTATION WAGO B10	03/04/2024
52	IMPLANTATION IHM	03/04/2024
53	IMPLANTATION RESEAU	03/04/2024
54	IMPLANTATION RESEAU B10	03/04/2024
55	ENTREES MOD4	03/04/2024
56	ENTREES MOD4	03/04/2024
57	ENTREES MOD5	03/04/2024
58	ENTREES MOD5	03/04/2024
59	ENTREES MOD6	03/04/2024
60	ENTREES MOD6	03/04/2024
61	ENTREES MOD7	03/04/2024
62	ENTREES MOD7	03/04/2024
63	I/O LINK MOD8	03/04/2024
64	I/O LINK MOD8	03/04/2024
65	I/O LINK MOD9	03/04/2024
66	I/O LINK MOD9	03/04/2024
67	I/O LINK MOD10	03/04/2024
68	I/O LINK MOD10	03/04/2024
69	ENTREES MOD106	03/04/2024
70	ENTREES MOD105	03/04/2024

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		LISTE DE FOLIO				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		LISTING								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020										FOLIO : 02/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

FOLIO	DESIGNATION	DATE DERNIERE MODIFICATION
71	Bornier : XP0	03/04/2024
72	Bornier : XP1	03/04/2024
73	Bornier : X2	03/04/2024
74	Bornier : X3	03/04/2024
75	Bornier : X4	03/04/2024
76	Bornier : X4	03/04/2024
77	Bornier : X10	03/04/2024
78	Bornier : X20	03/04/2024
79	Bornier : XT10	03/04/2024
80	Bornier : XP100	03/04/2024
81	Bornier : XP101	03/04/2024
82	Bornier : X100	03/04/2024
83	Bornier : X103	03/04/2024
84	Bornier : X104	03/04/2024
85	Bornier : X105	03/04/2024
86	Bornier : X106	03/04/2024
87	Bornier : X110	03/04/2024
88	Bornier : X120	03/04/2024
89	Bornier : X130	03/04/2024
90	Bornier : X140	03/04/2024
91	Bornier : X150	03/04/2024
92	Bornier : X160	03/04/2024
93	Bornier : X200	03/04/2024
94	Bornier : XT100	03/04/2024
95	Connecteur: PRM-M01 & PRF-M01	03/04/2024
96	Connecteur: PRM-M07 & PRF-M07	03/04/2024
97	Connecteur: PRM-M08 & PRF-M08	03/04/2024
98	Connecteur: PRM-M09 & PRF-M09	03/04/2024
99	Connecteur: PRM-X200 & PRF-X200	03/04/2024
100	IMPLANTATION FACADE ARMOIRE	03/04/2024
101	IMPLANTATION ARRIERE ARMOIRE	03/04/2024
102	IMPLANTATION ARMOIRE	03/04/2024
103	IMPLANTATION COTE BOITIER B10	03/04/2024
104	IMPLANTATION FACADE BOITIER B10	03/04/2024
105	IMPLANTATION ARRIERE BOITIER B10	03/04/2024

FOLIO	DESIGNATION	DATE DERNIERE MODIFICATION
106	IMPLANTATION INTERNE BOITIER B10	03/04/2024
107	PLAN DE PERCAGE BOITIER T10	03/04/2024
108	PLAN DE PERCAGE BOITIER T10	03/04/2024
109	IMPLANTATION BOITIER T10	03/04/2024
110	IMPLANTATION BOITIER T20	03/04/2024
111	IMPLANTATION BOITIER T30	03/04/2024
112	PARAMETRE VARIATEUR V1	03/04/2024
113	PARAMETRE VARIATEUR V2	03/04/2024
114	PARAMETRE VARIATEUR V3	03/04/2024
115	PARAMETRE VARIATEUR V4	03/04/2024
116	PARAMETRE VARIATEUR V5	03/04/2024
117	PARAMETRE VARIATEUR V6	03/04/2024
118	PARAMETRE VARIATEUR V7	03/04/2024
119	PARAMETRE VARIATEUR V8	03/04/2024
120	PARAMETRE VARIATEUR V9	03/04/2024
121	Nomenclature Armoire	03/04/2024
122	Nomenclature Armoire	03/04/2024
123	Nomenclature Armoire	03/04/2024
124	Nomenclature Armoire	03/04/2024
125	Nomenclature Armoire	03/04/2024
126	Components List	03/04/2024
127	Components List	03/04/2024
128	Components List	03/04/2024
129	Components List	03/04/2024
130	Components List	03/04/2024
131	Nomenclature FI	03/04/2024
132	Nomenclature FI	03/04/2024
133	Nomenclature FI	03/04/2024
134	Nomenclature FI	03/04/2024
135	Components List	03/04/2024
136	Components List	03/04/2024
137	Components List	03/04/2024
138	Components List	03/04/2024
139	Nomenclature Boutonnerie	03/04/2024
140	Nomenclature Boutonnerie	03/04/2024

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		LISTE DE FOLIO				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		LISTING								ARTICLE : SMXA0002				INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								03/144					

[illegible][illegible]

3

■

●

•

1

1

I

11

•

1

1

1

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		LISTE DE FOLIO				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		LISTING								ARTICLE : SMXA0002				INDEX : V6	
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020				04/144											


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		LISTE DE FOLIO				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		LISTING								ARTICLE : SMXA0002				INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								FOLIO : 05/144					

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA PUISSANCE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		POWER PLAN								ARTICLE :		INDEX : V6			
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				SMXA0002						FOLIO : 06/144					


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

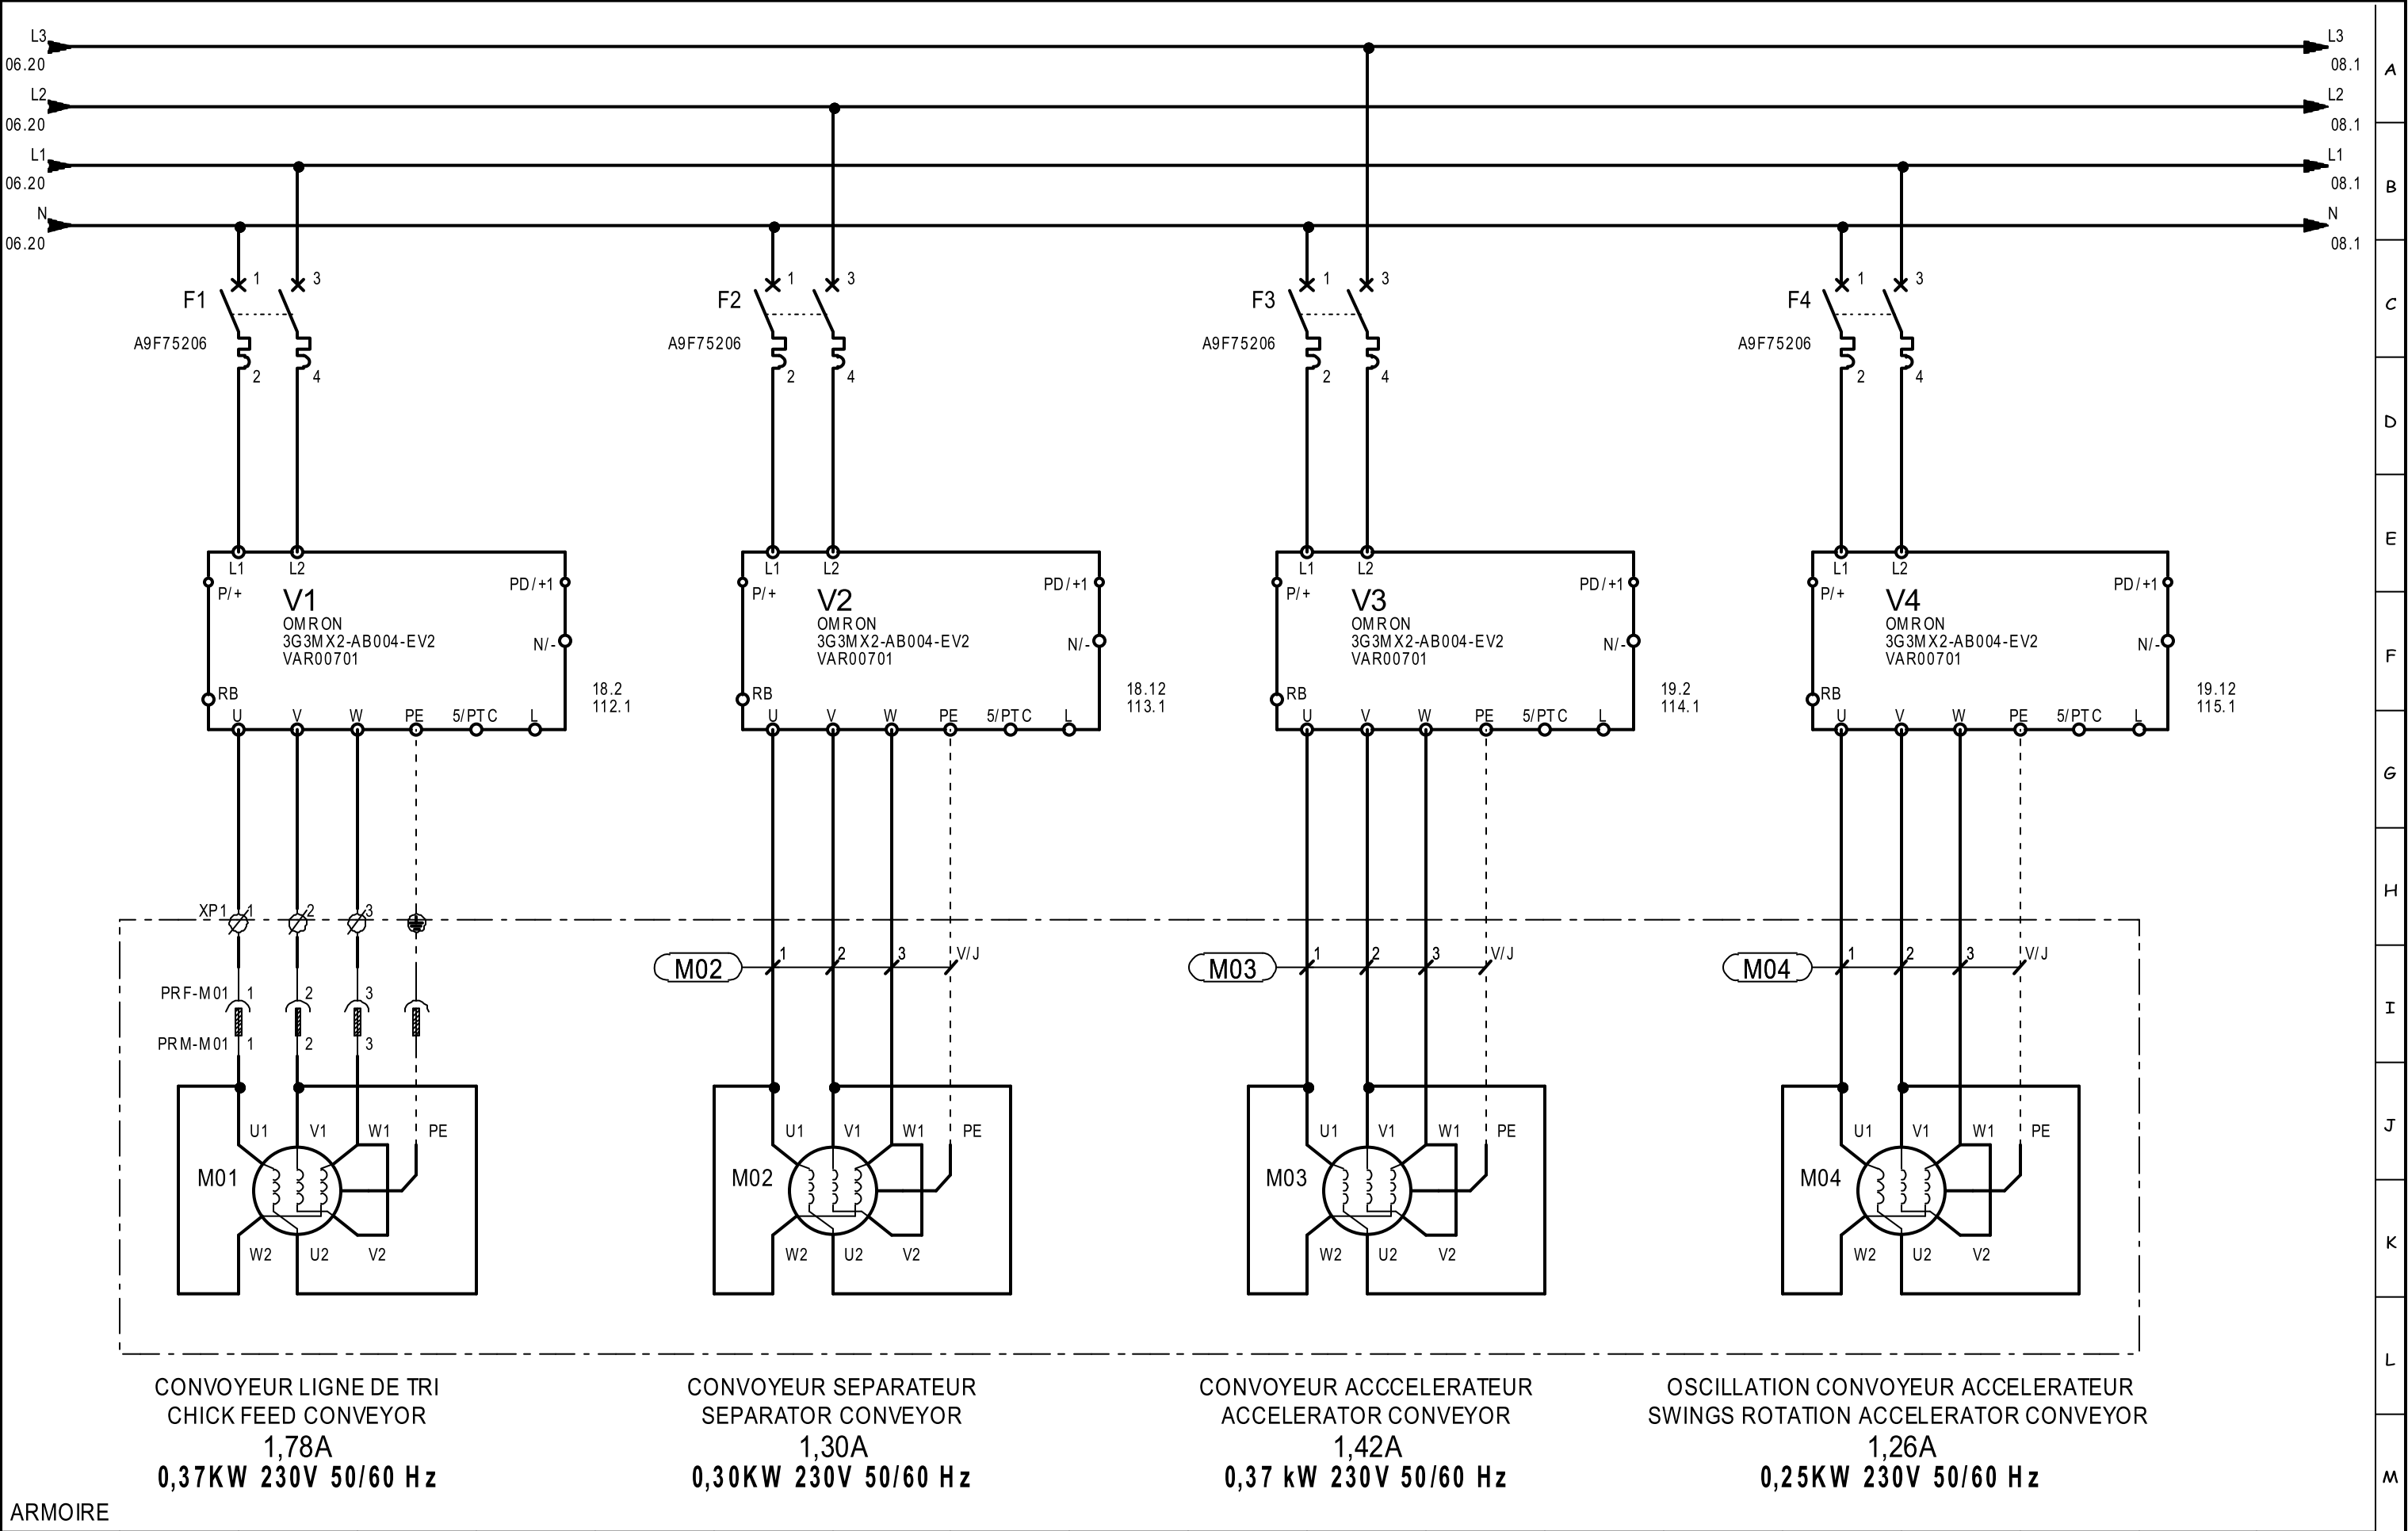

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID			Tél : (33).2.98.85.31.36			Date of creation :			SCHEMA PUISSANCE					CONTRACT :		CUSTOMER :		COUNTRY :	
ZI de KERIEL			Fax : (33).2.98.85.31.38			Designed by :			POWER PLAN					INTERNE		INTERNE		FRANCE	
29800 PLOUEDERN			E-mail : ecaticid.service@ceva.com			DB			ENVIRONNEMENT : Version 4.49.F - 23/09/2020					ARTICLE :				INDEX : V6	
- FRANCE -																		FOLIO : 07/144	


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

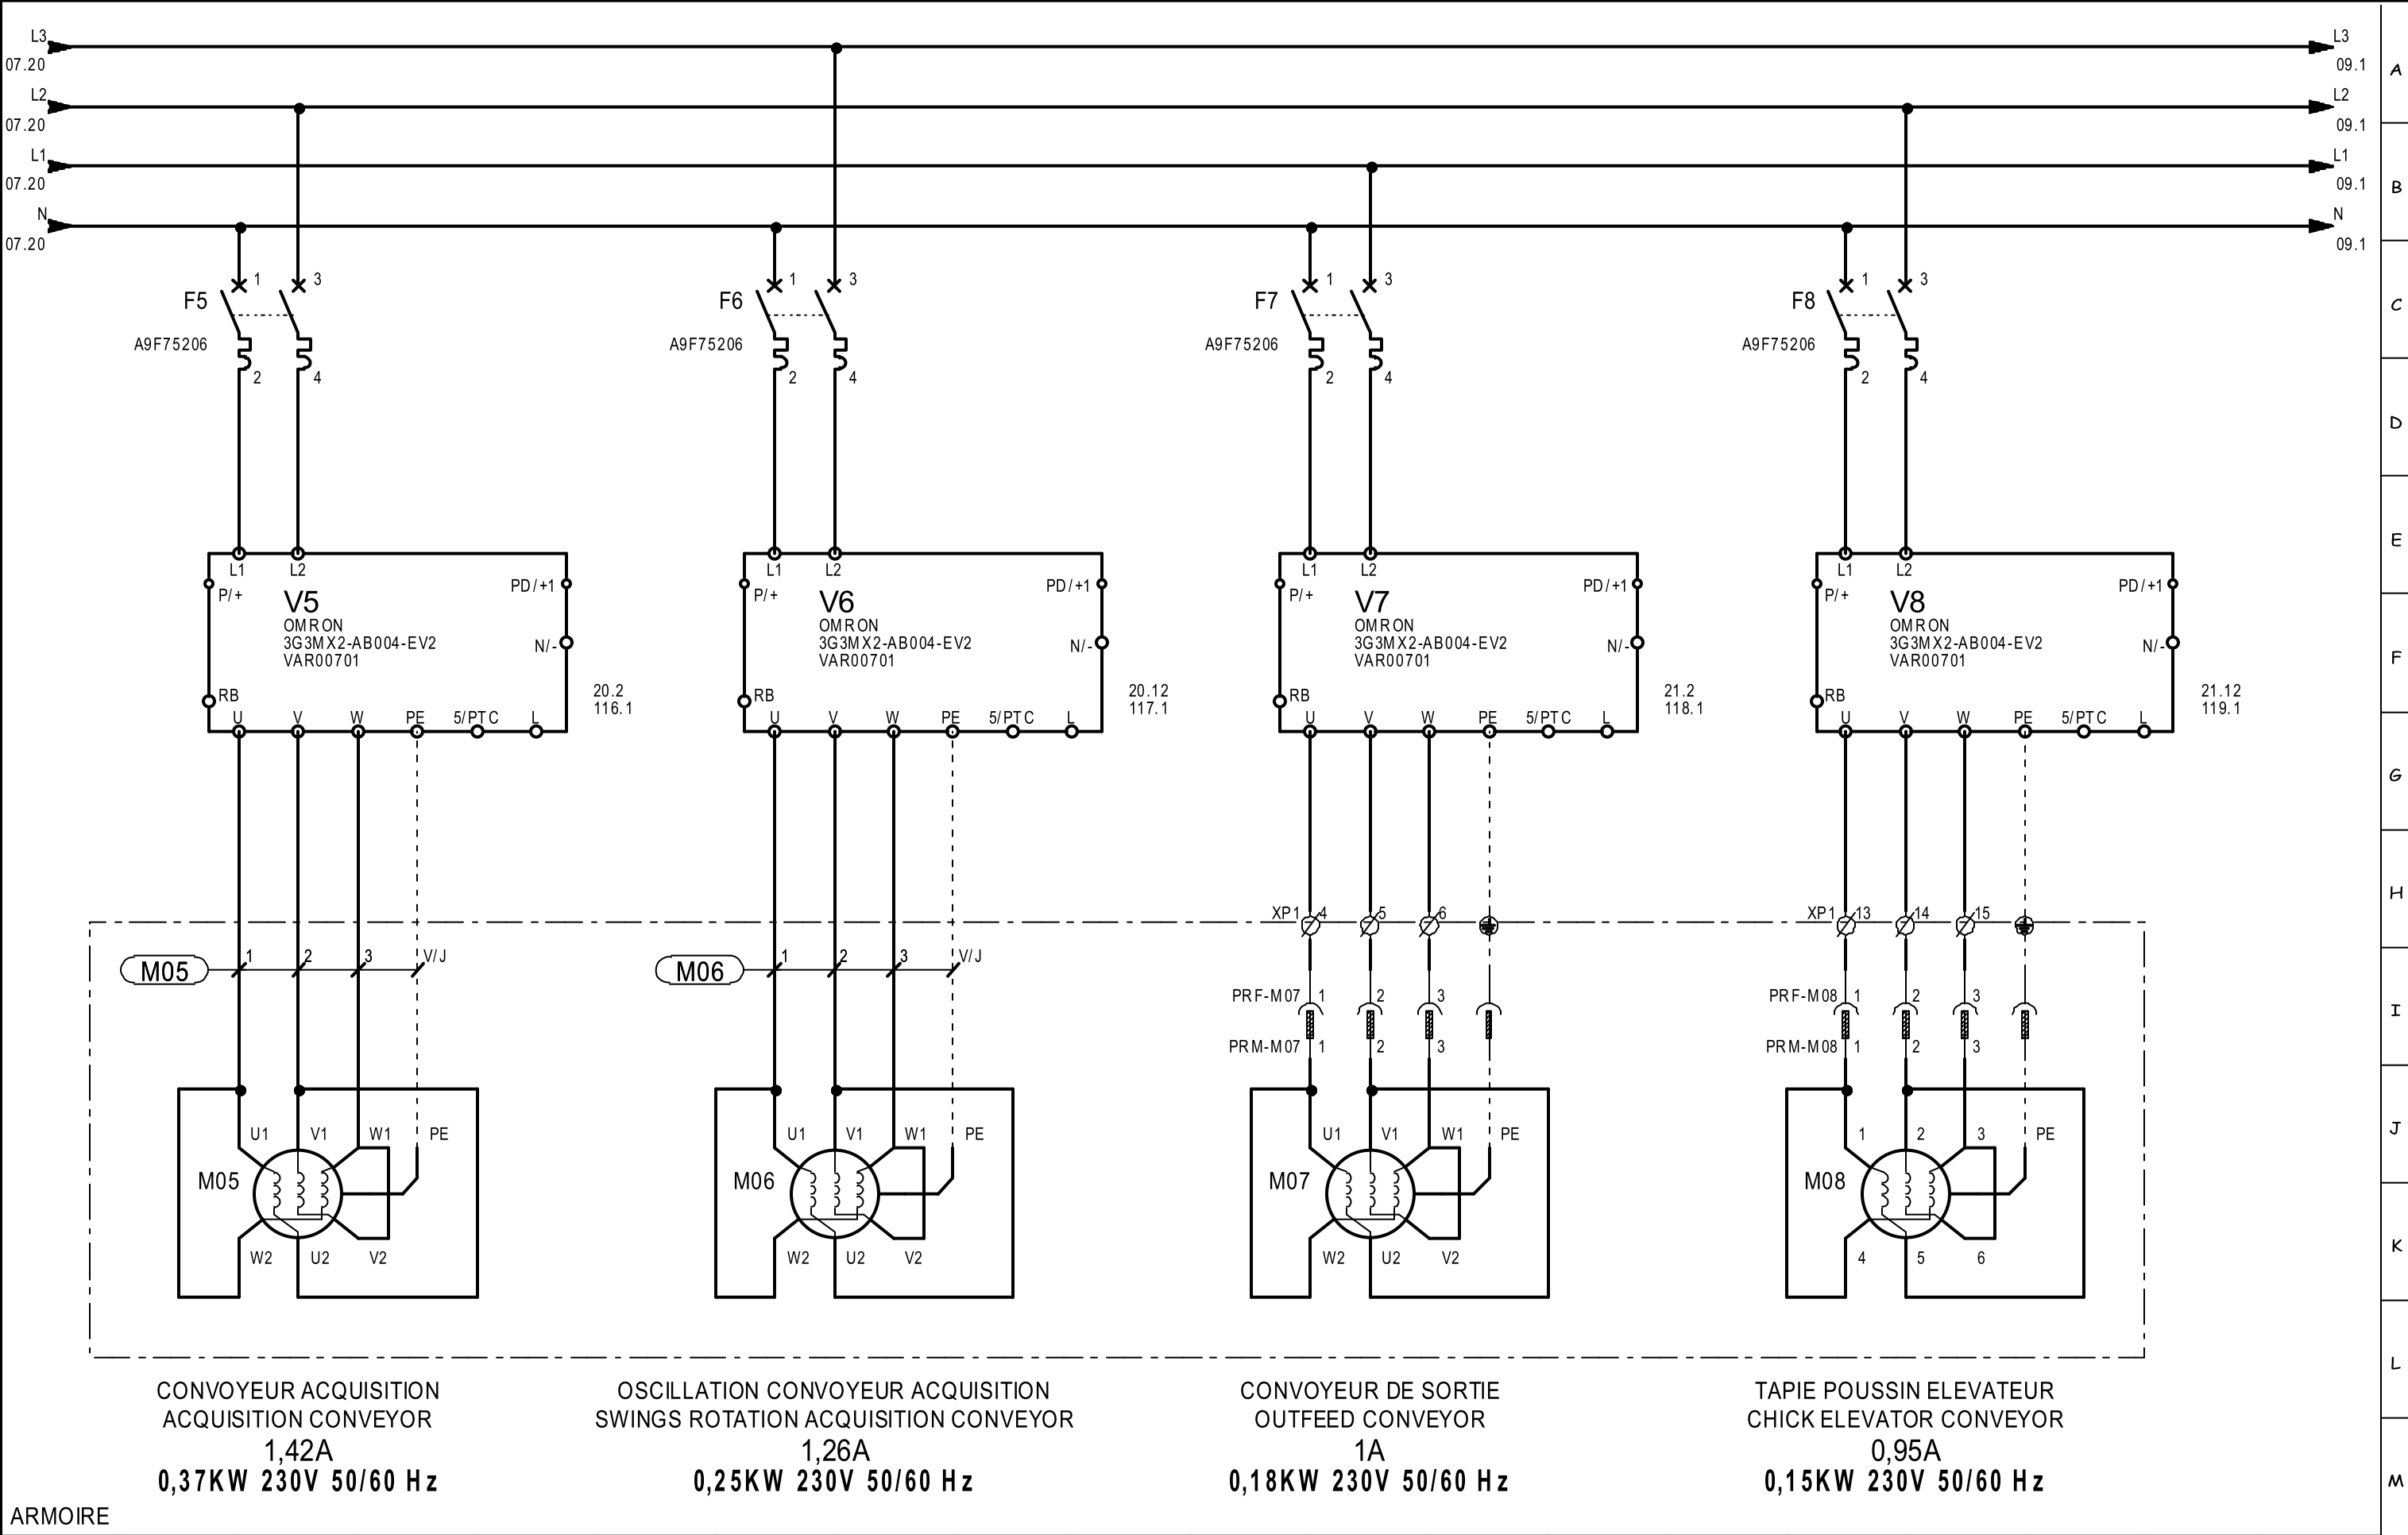

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA PUISSANCE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		POWER PLAN								ARTICLE :				INDEX : V6	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002				FOLIO : 08/144	


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

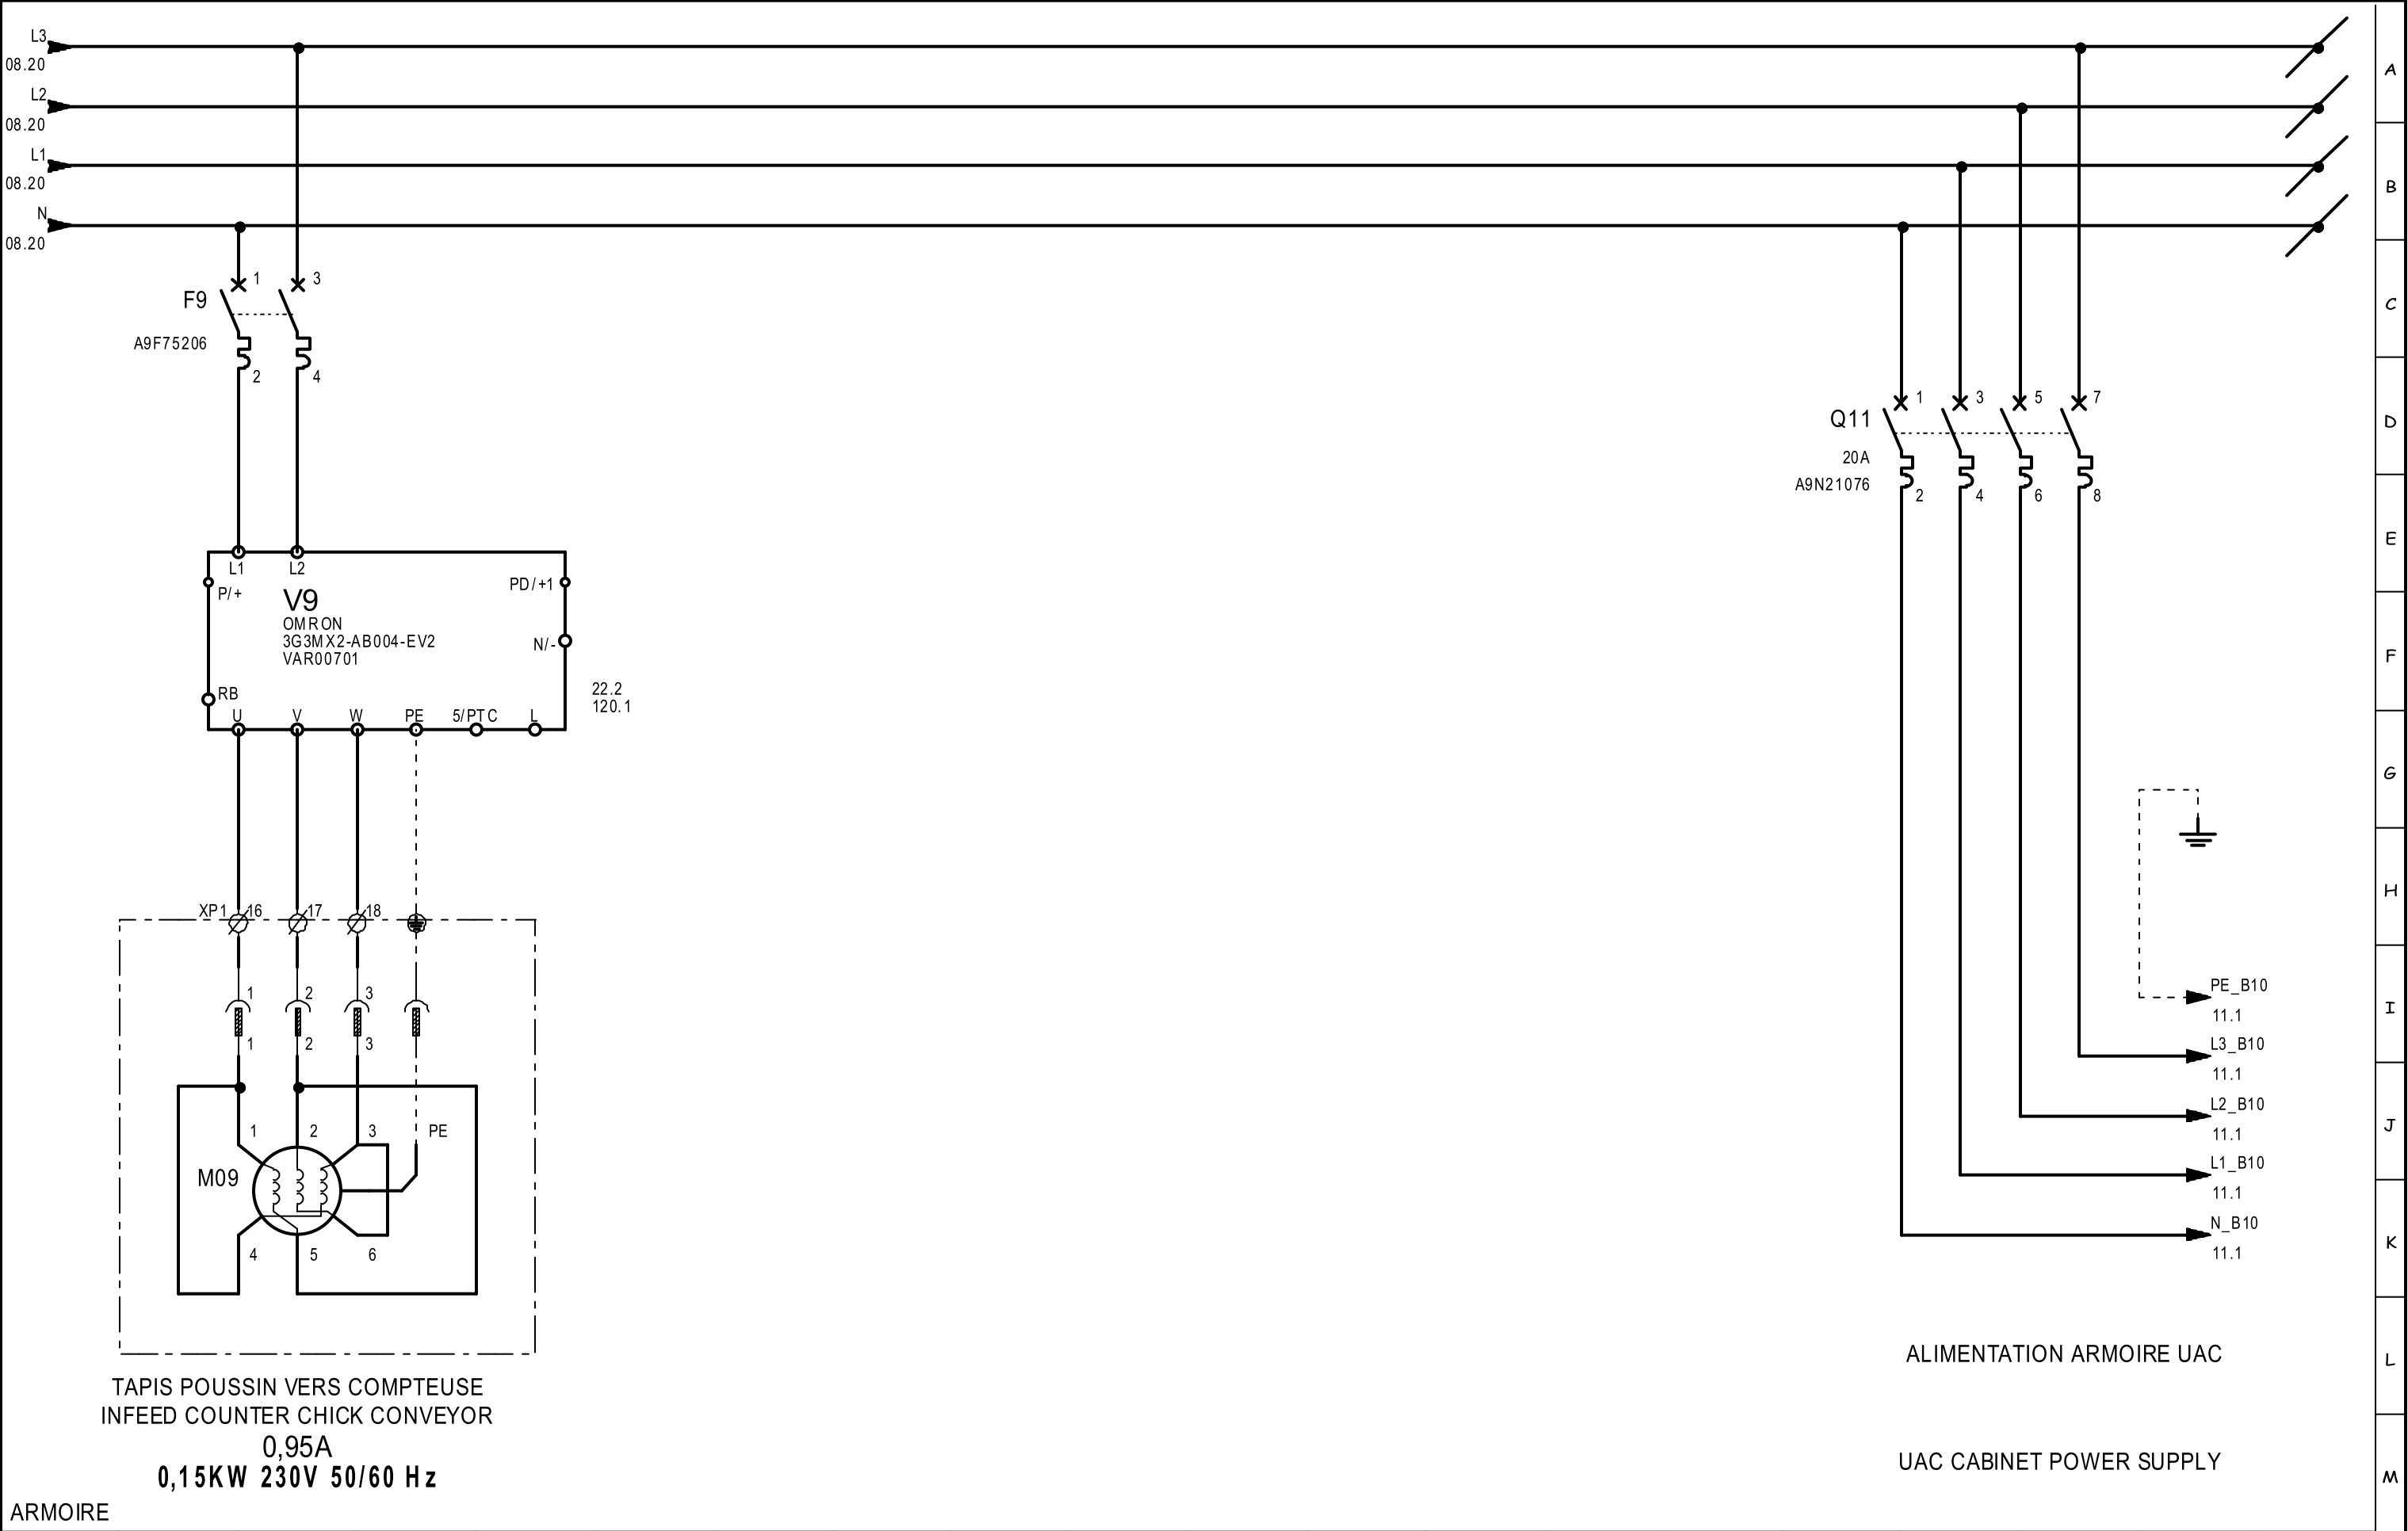


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA PUISSANCE				 Ecat-iD Campus			CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		POWER PLAN							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				FOLIO : 09/144										

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

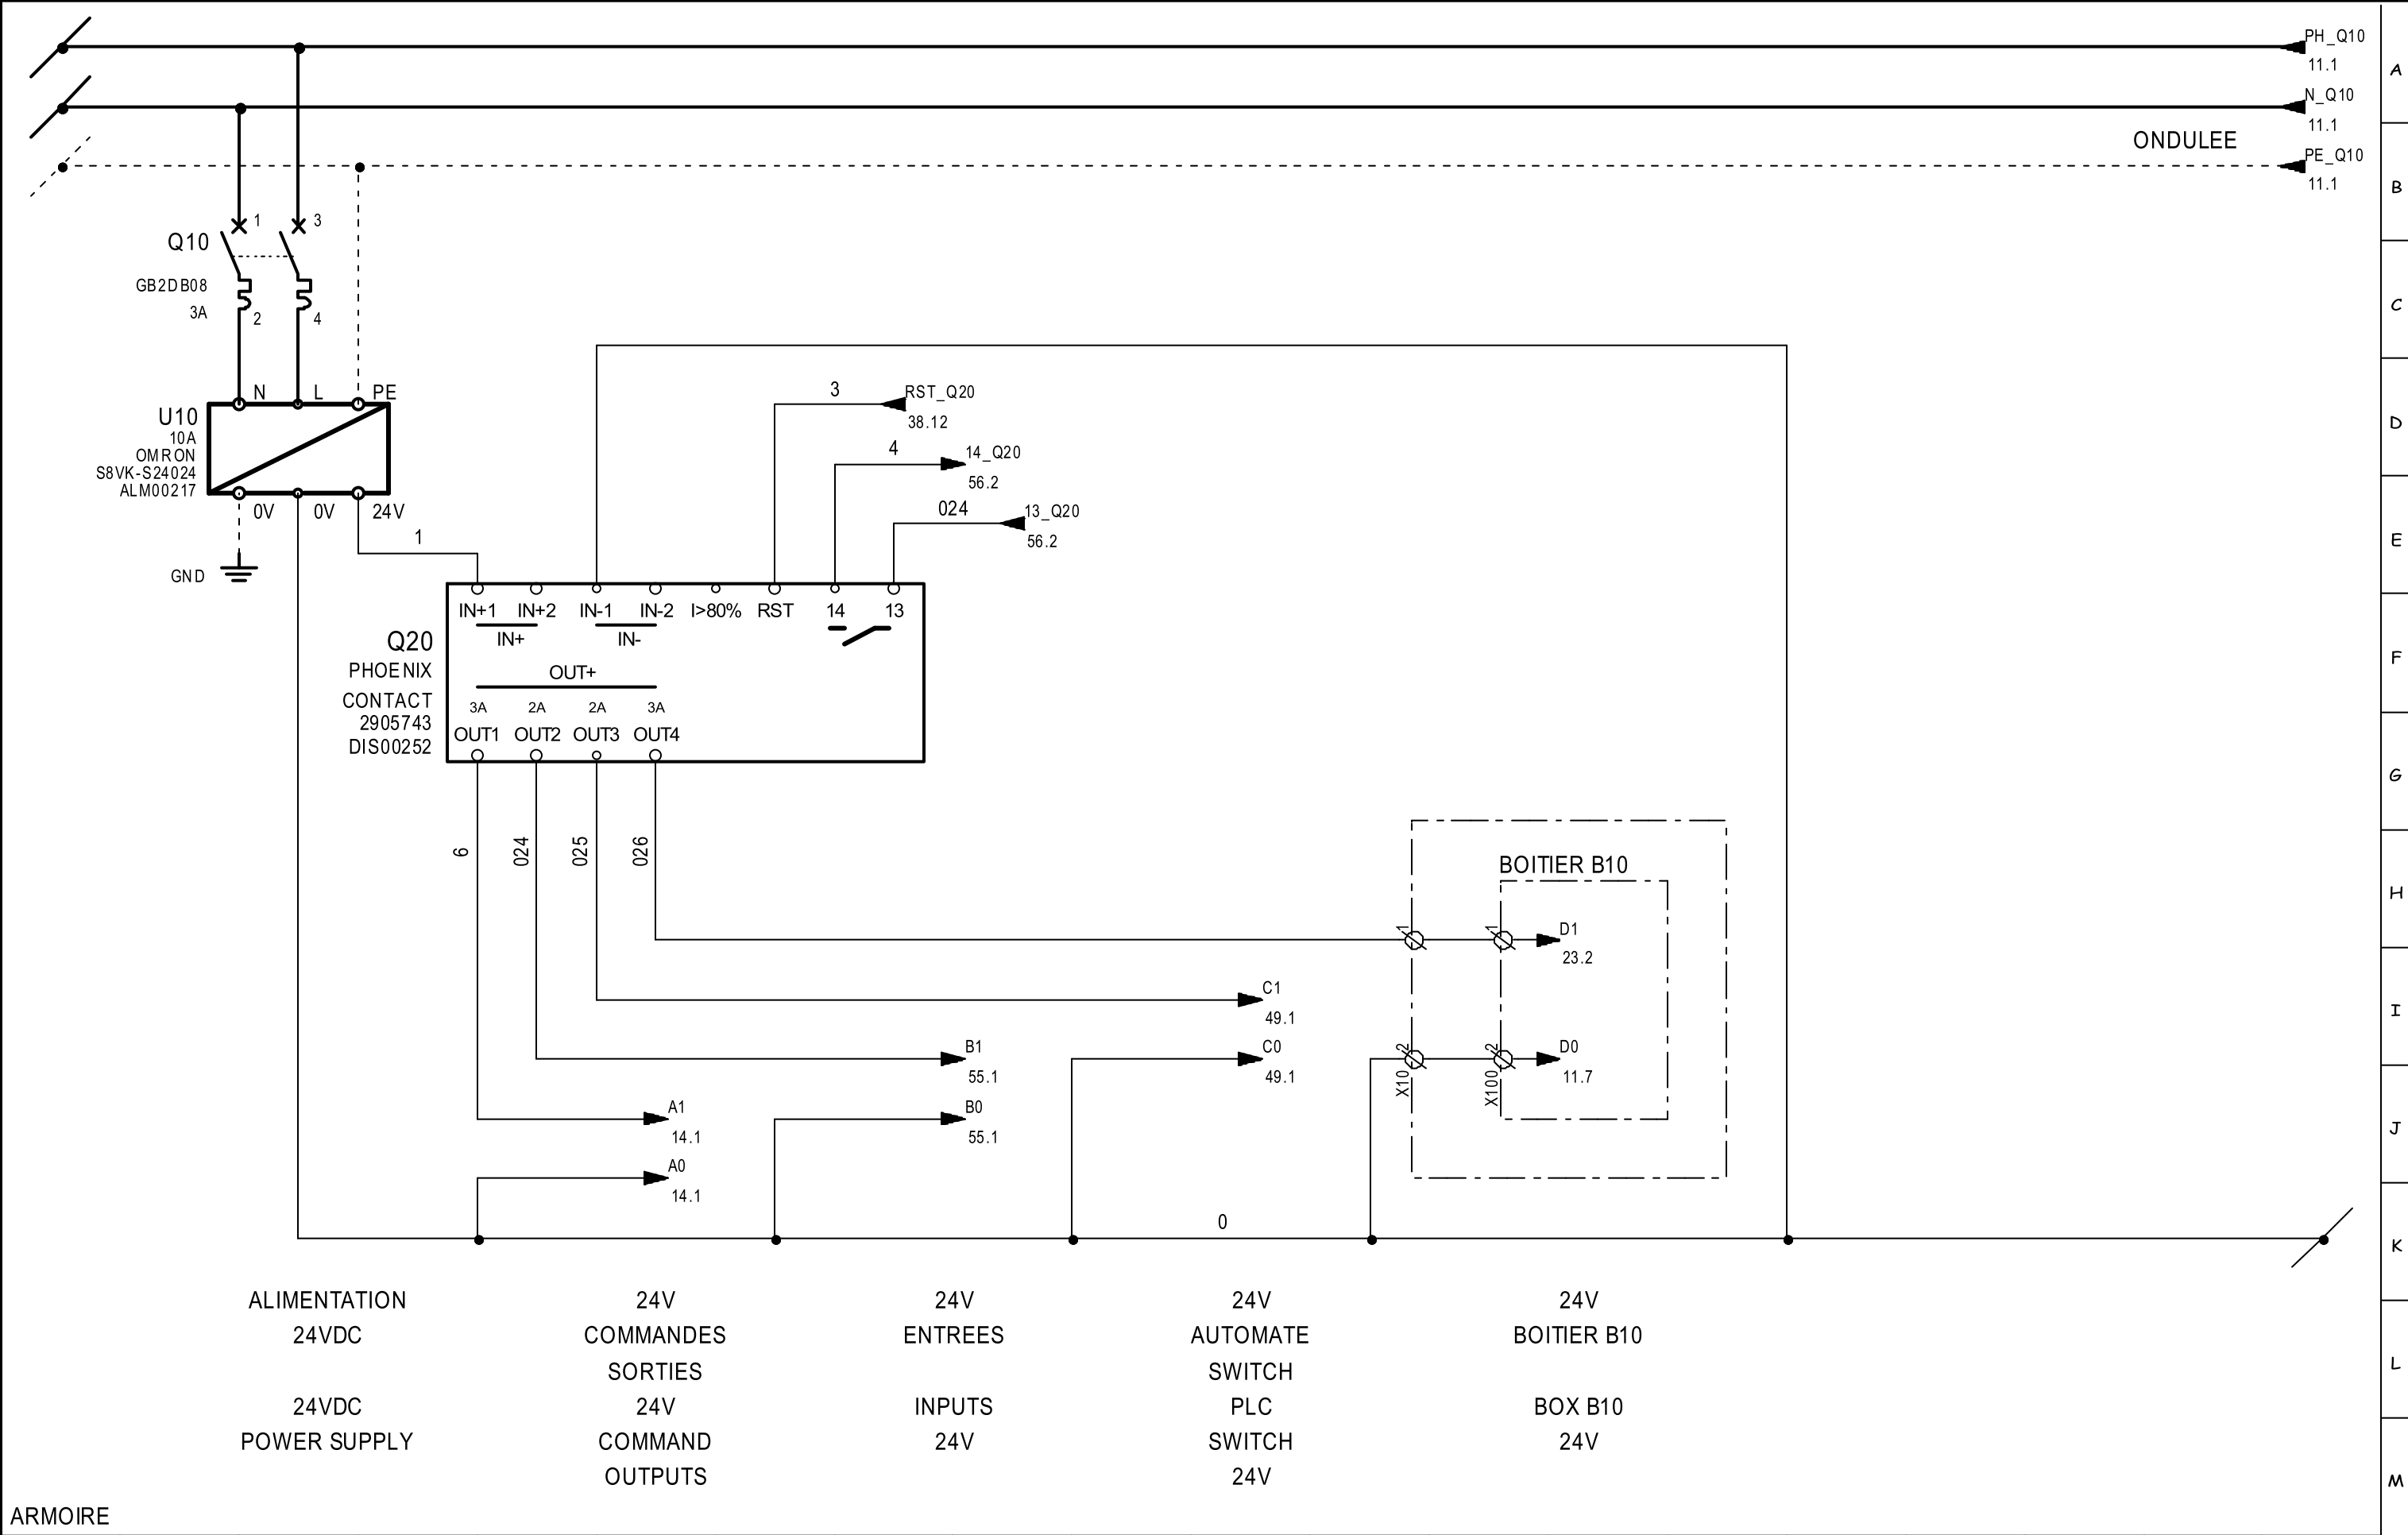


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

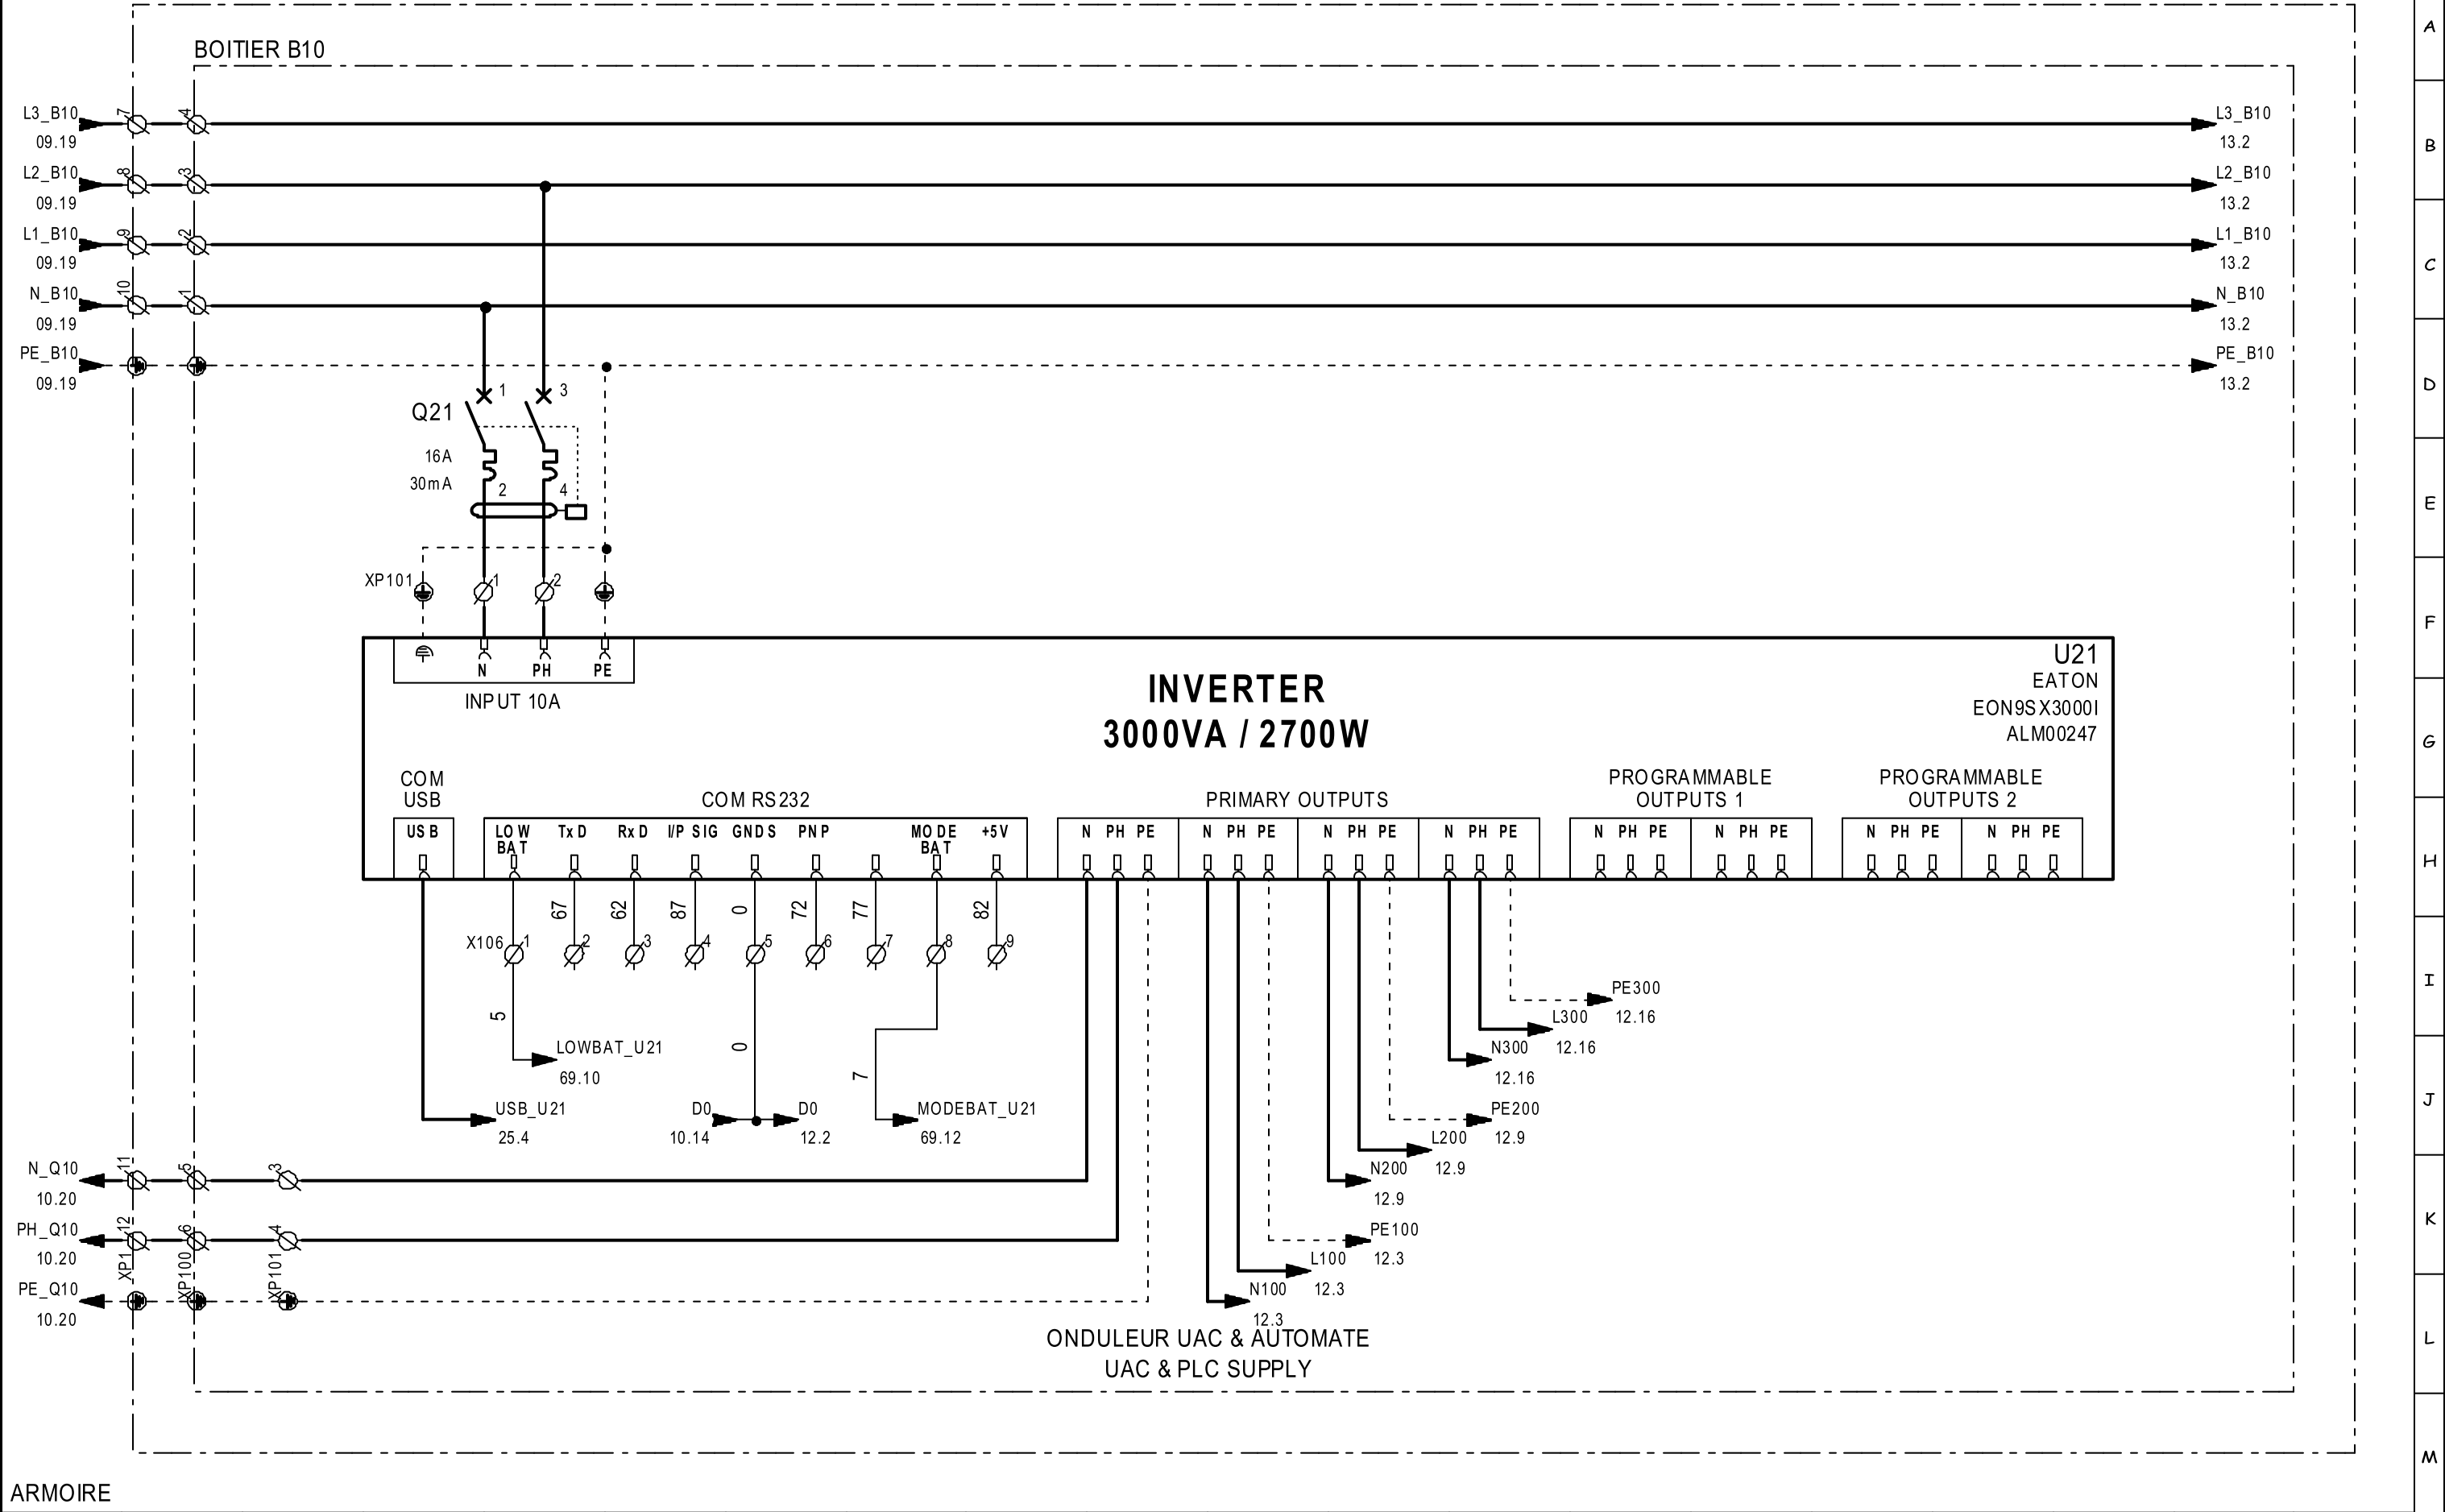


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA PUISSANCE UAC				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		UAC POWER PLAN								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				11/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

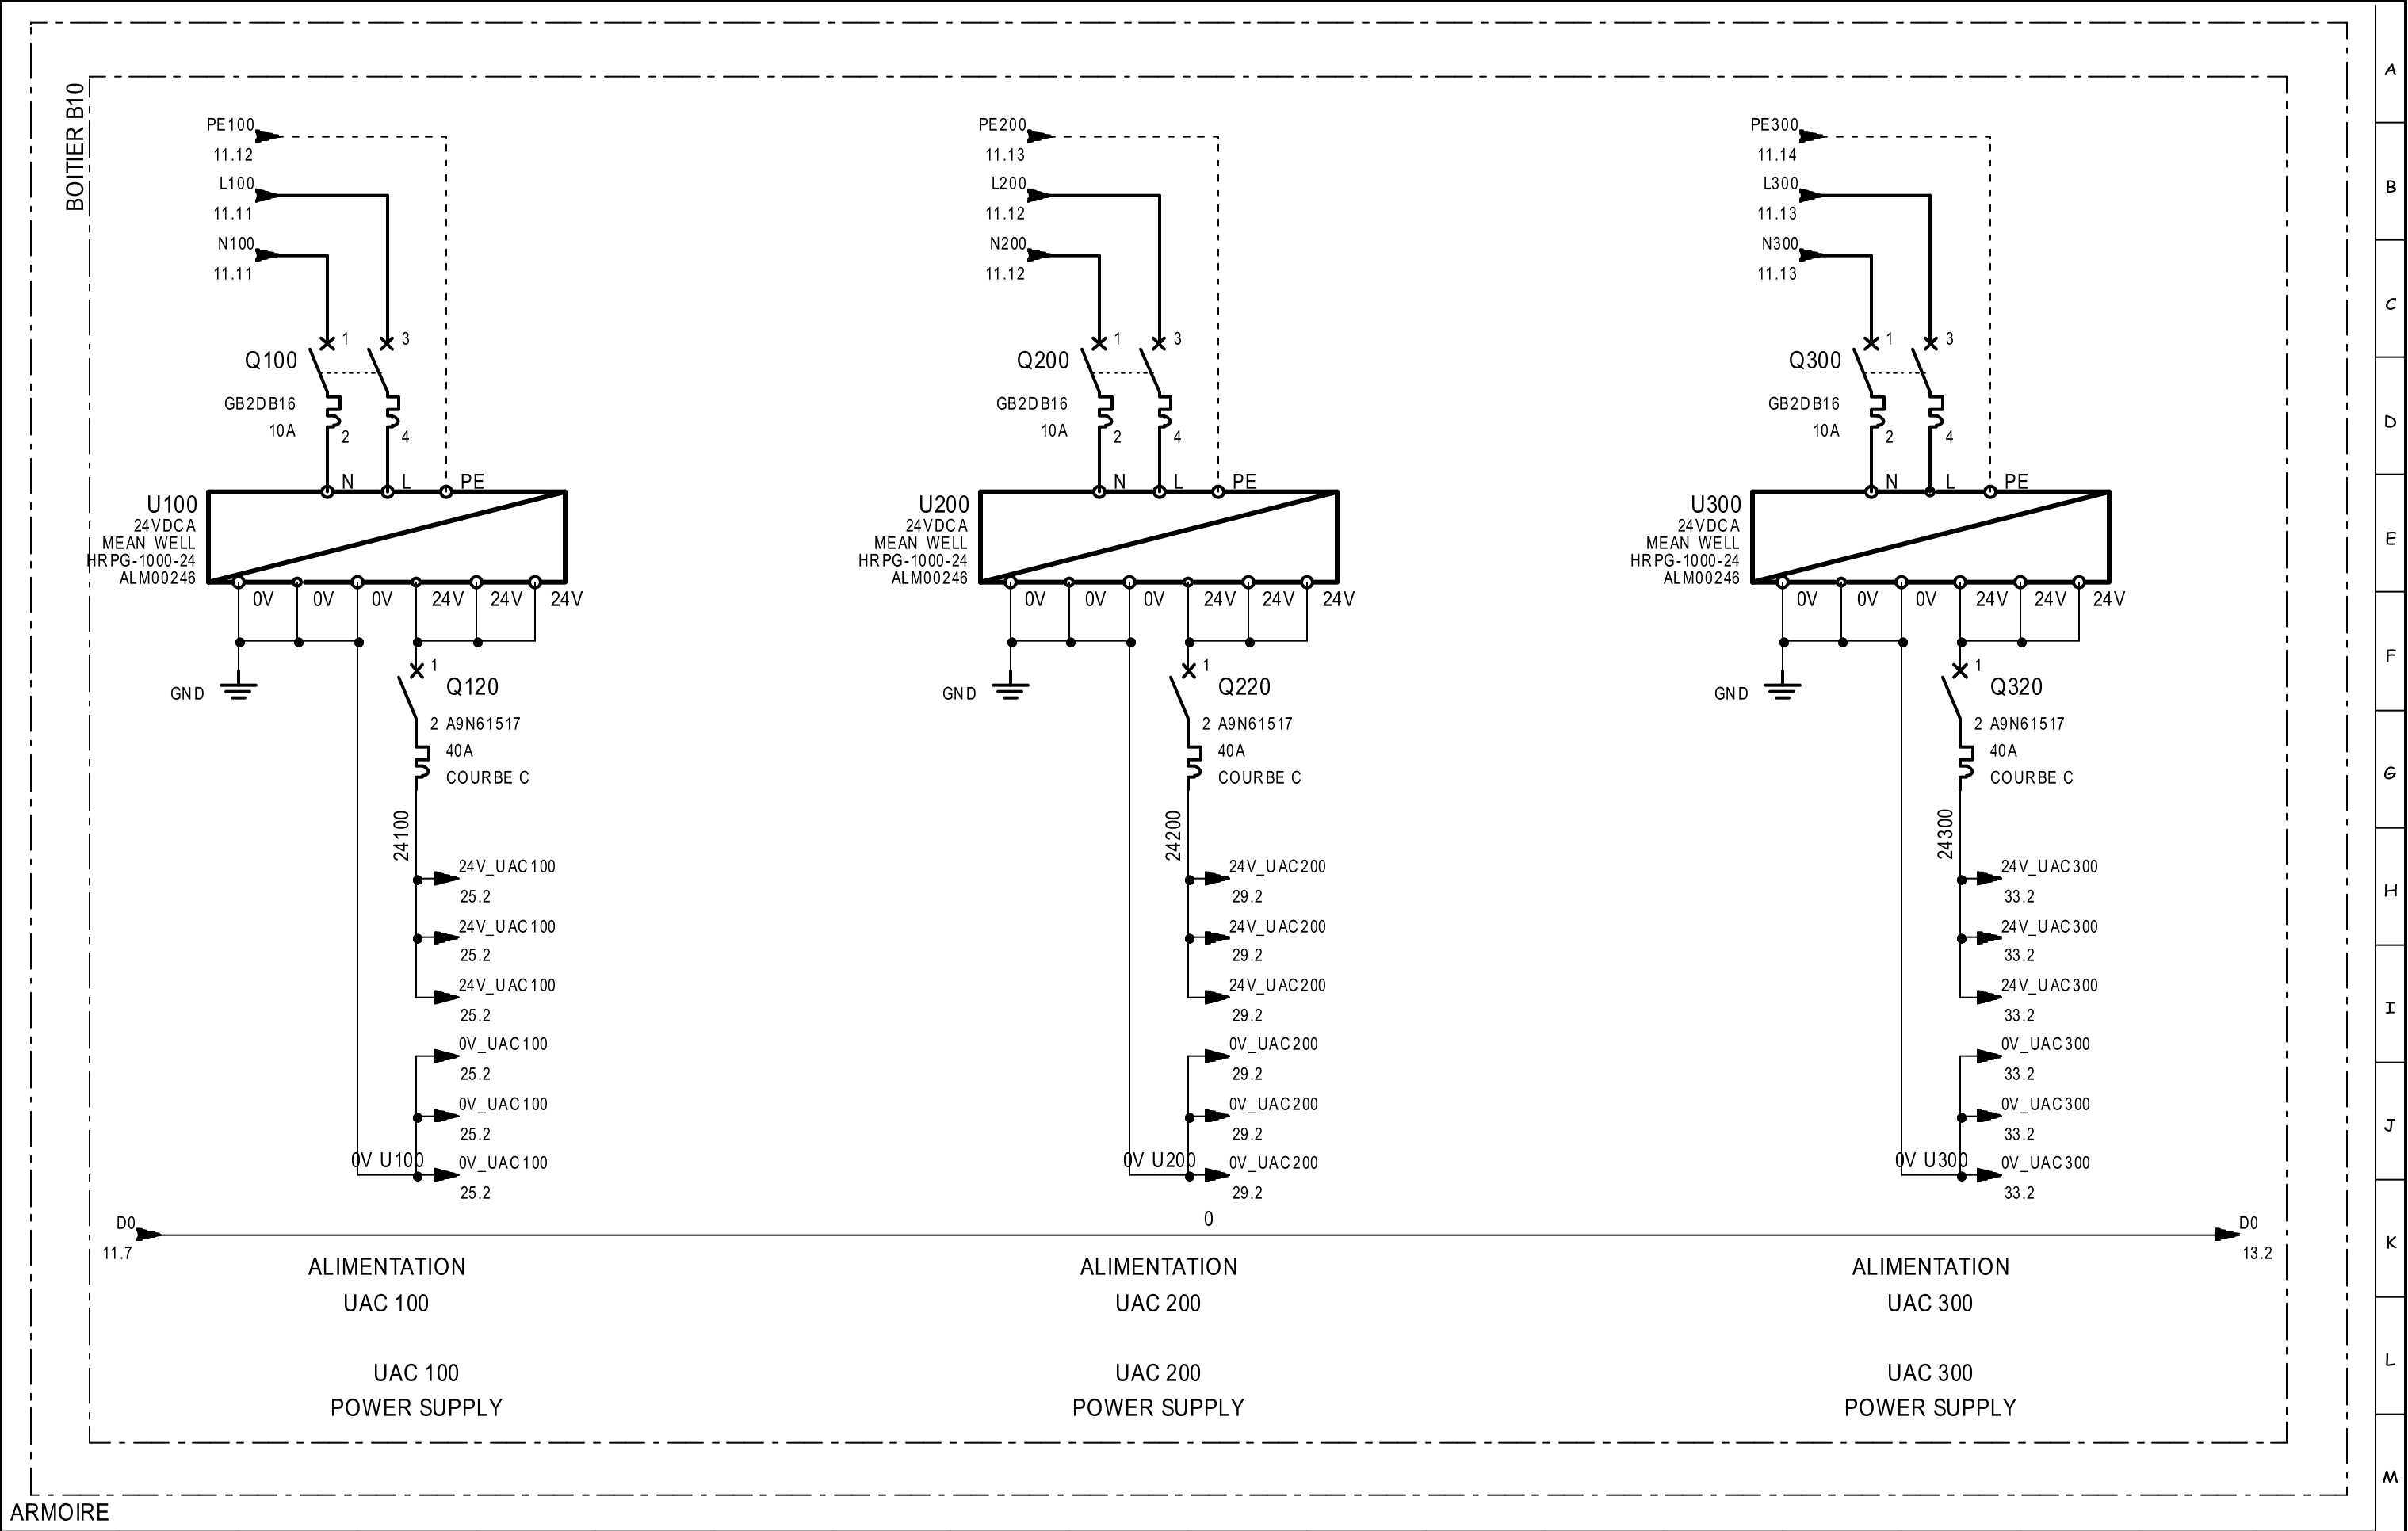


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

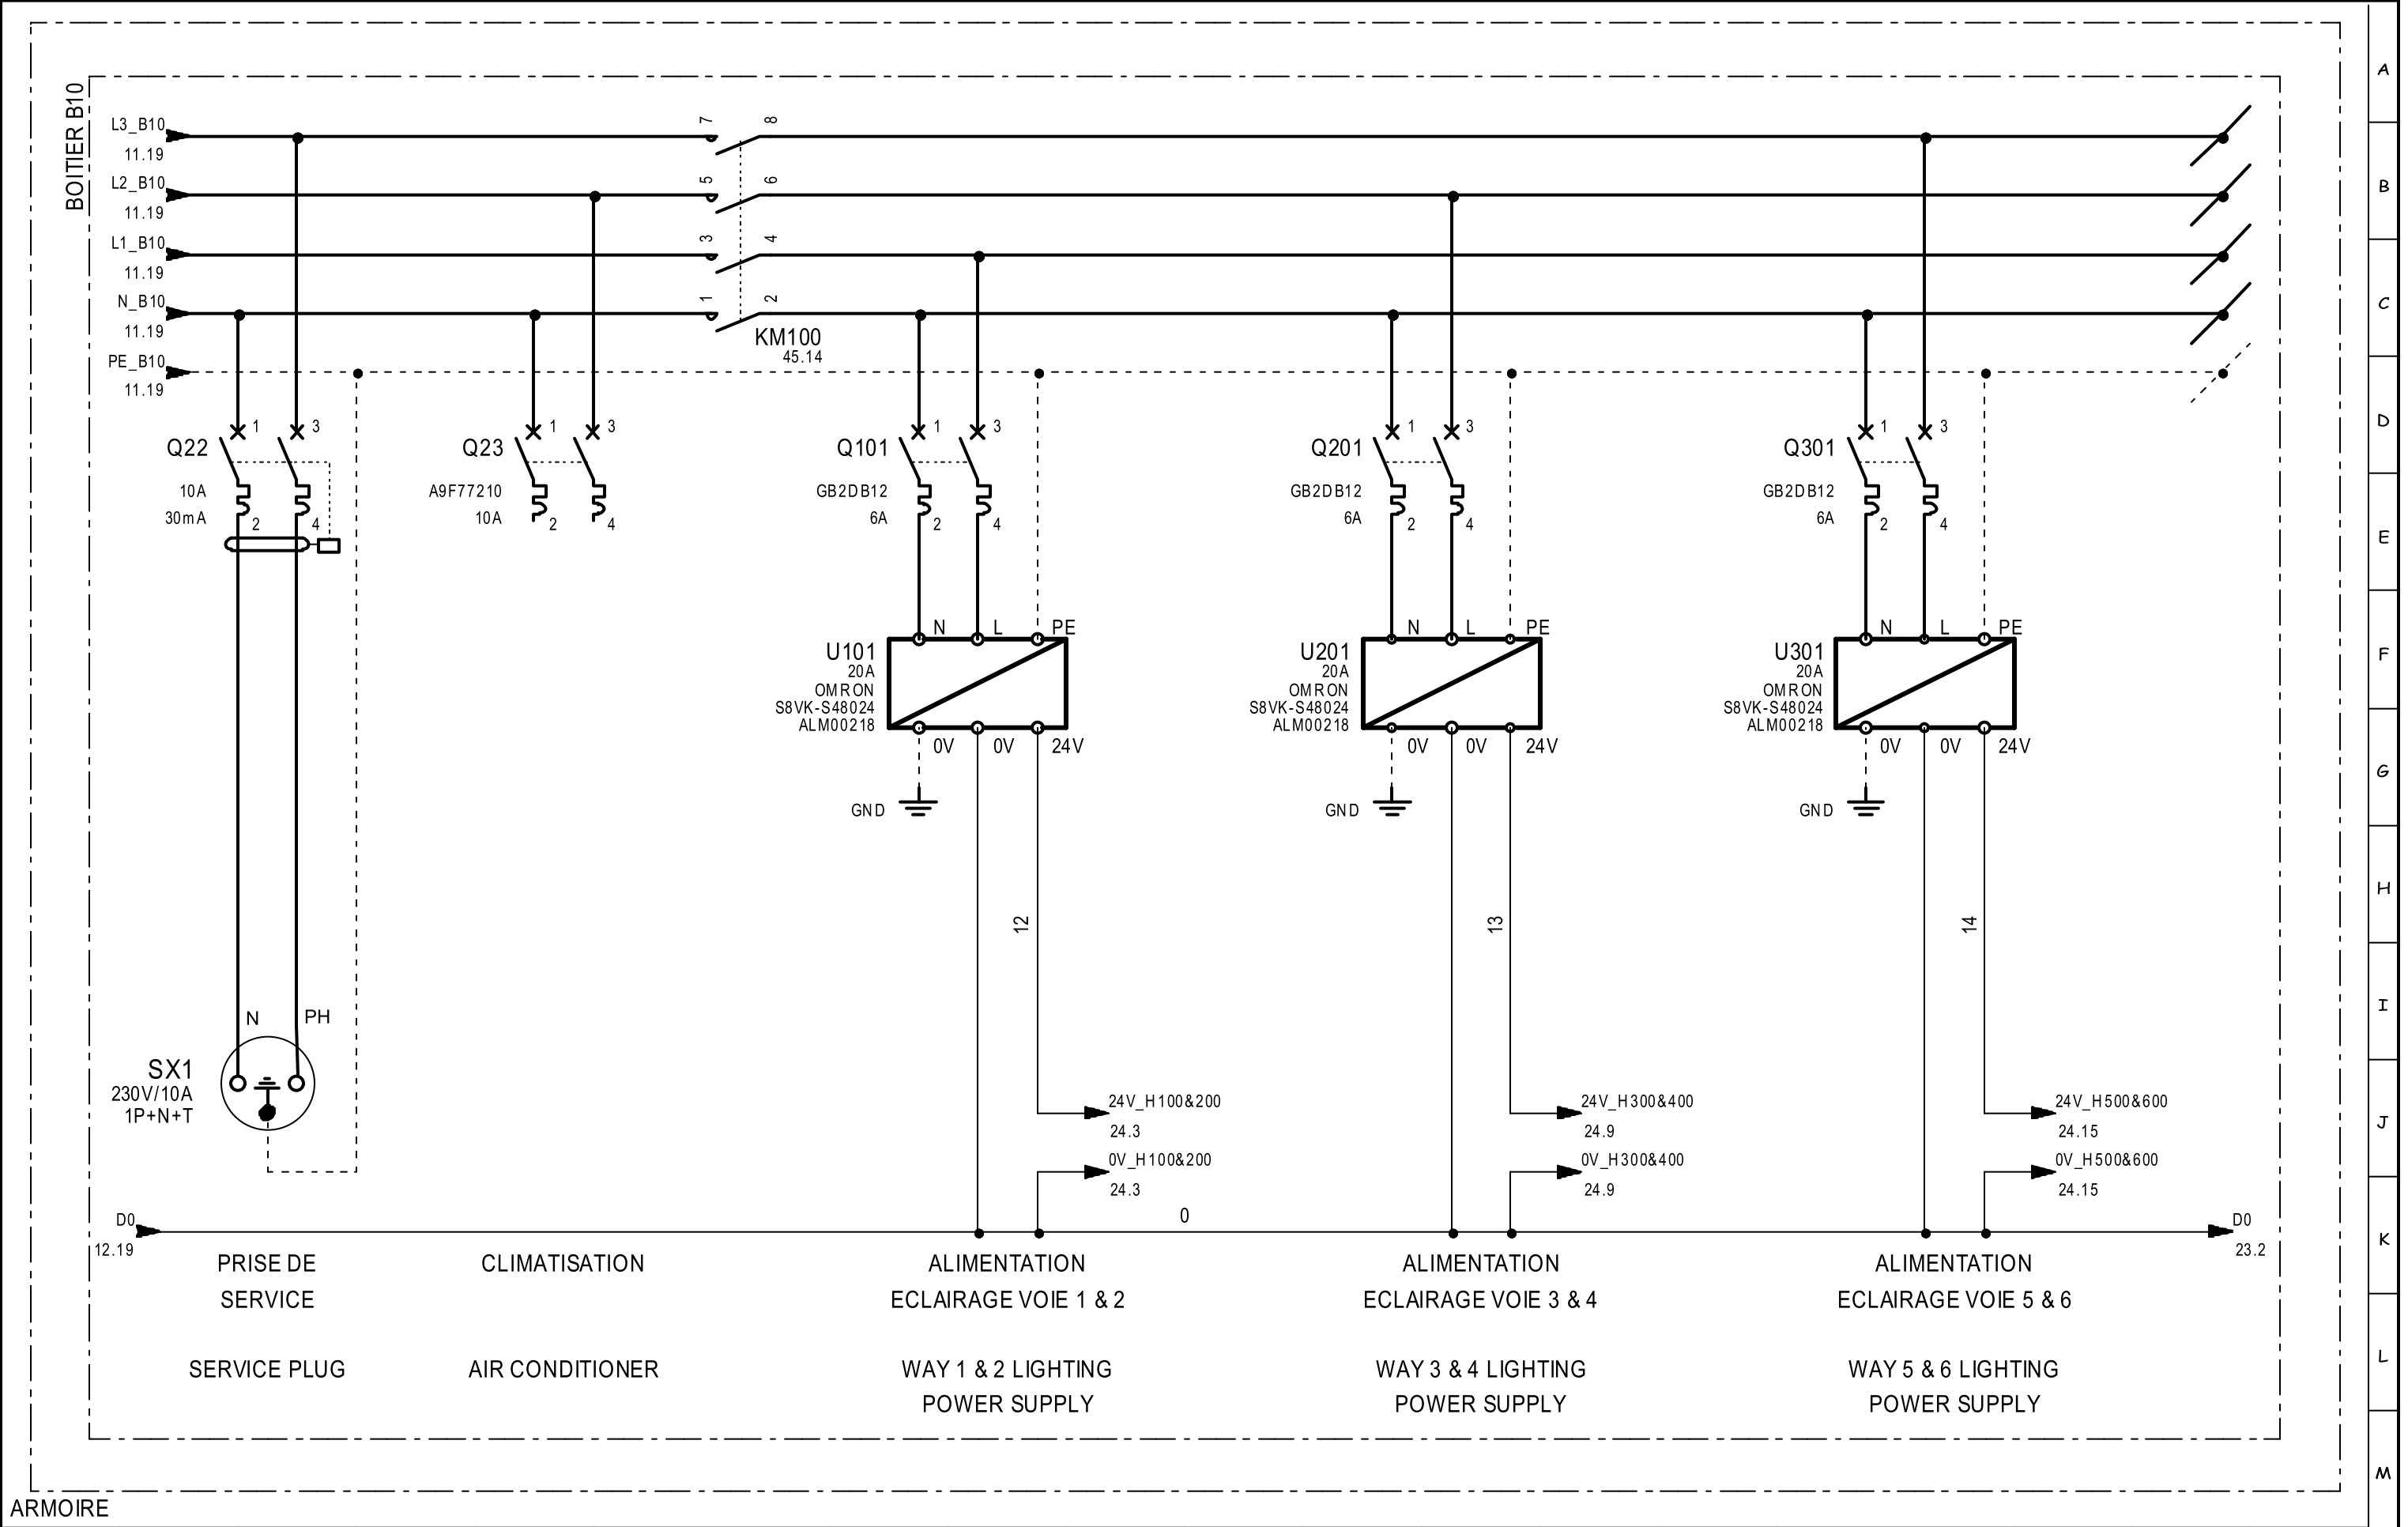

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA PUISSANCE UAC				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		UAC POWER PLAN								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020				SMXA0002						FOLIO : 13/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

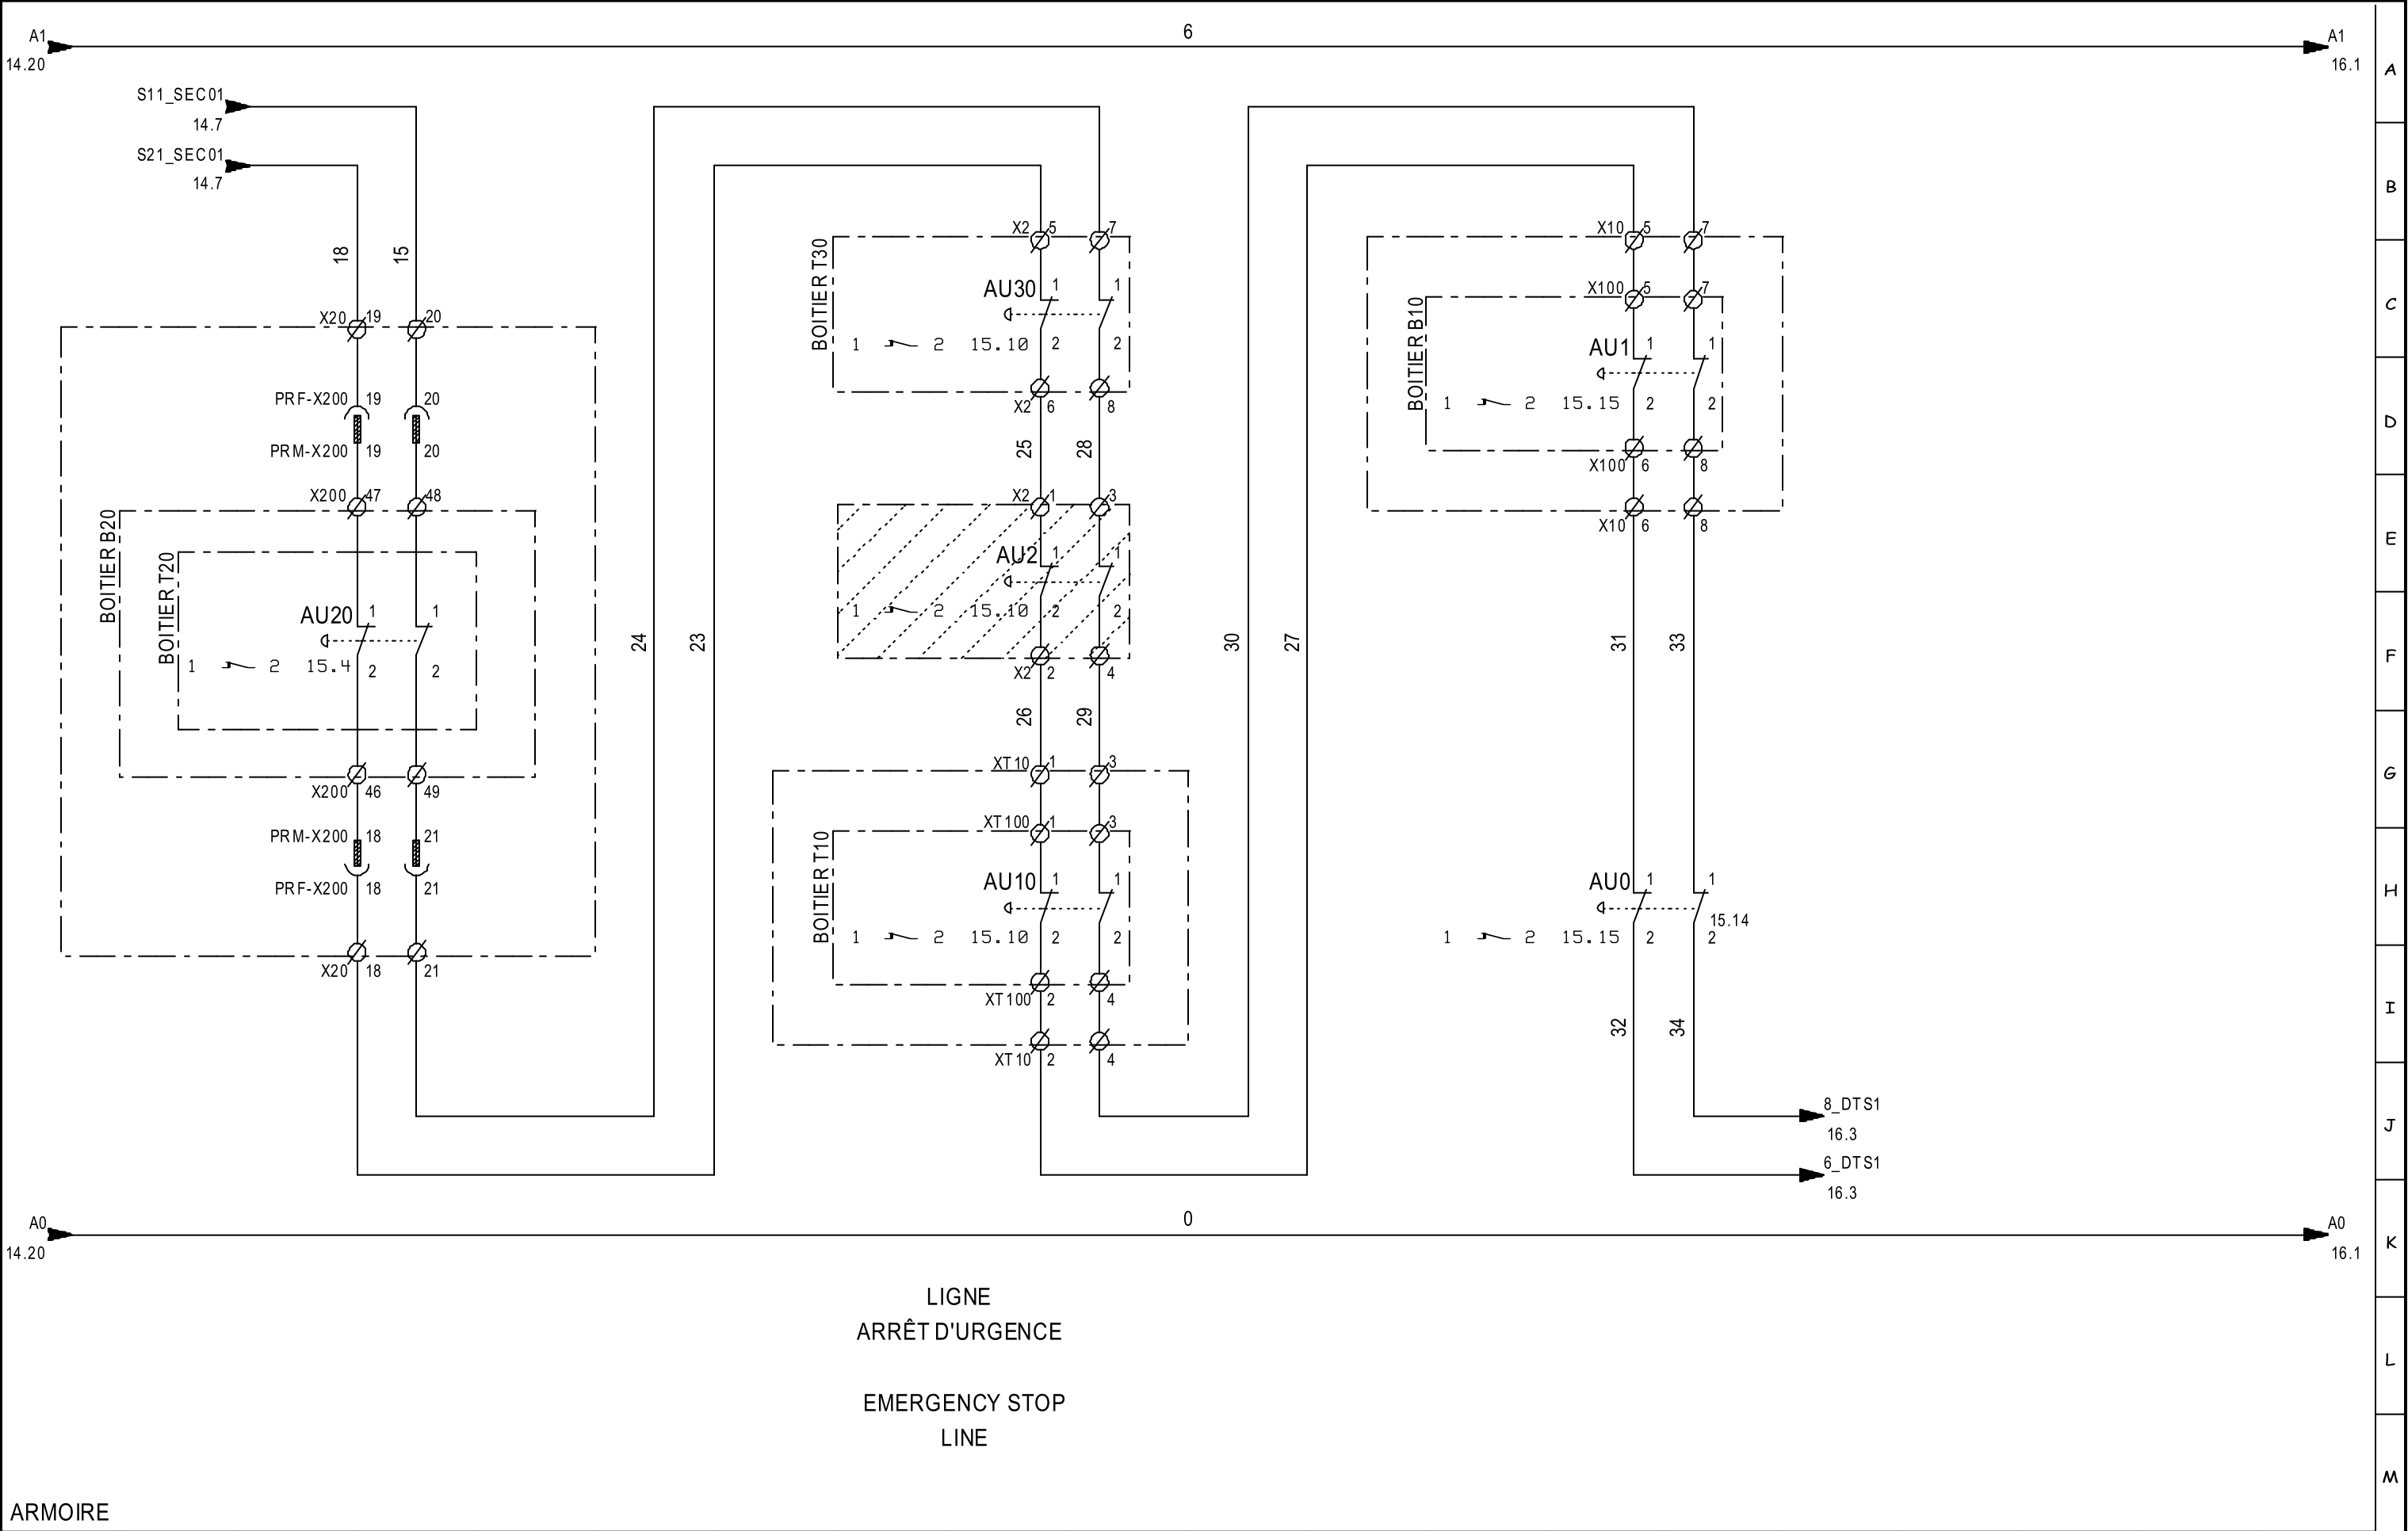


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 15/144	


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE :		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020				SMXA0002						FOLIO : 16/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

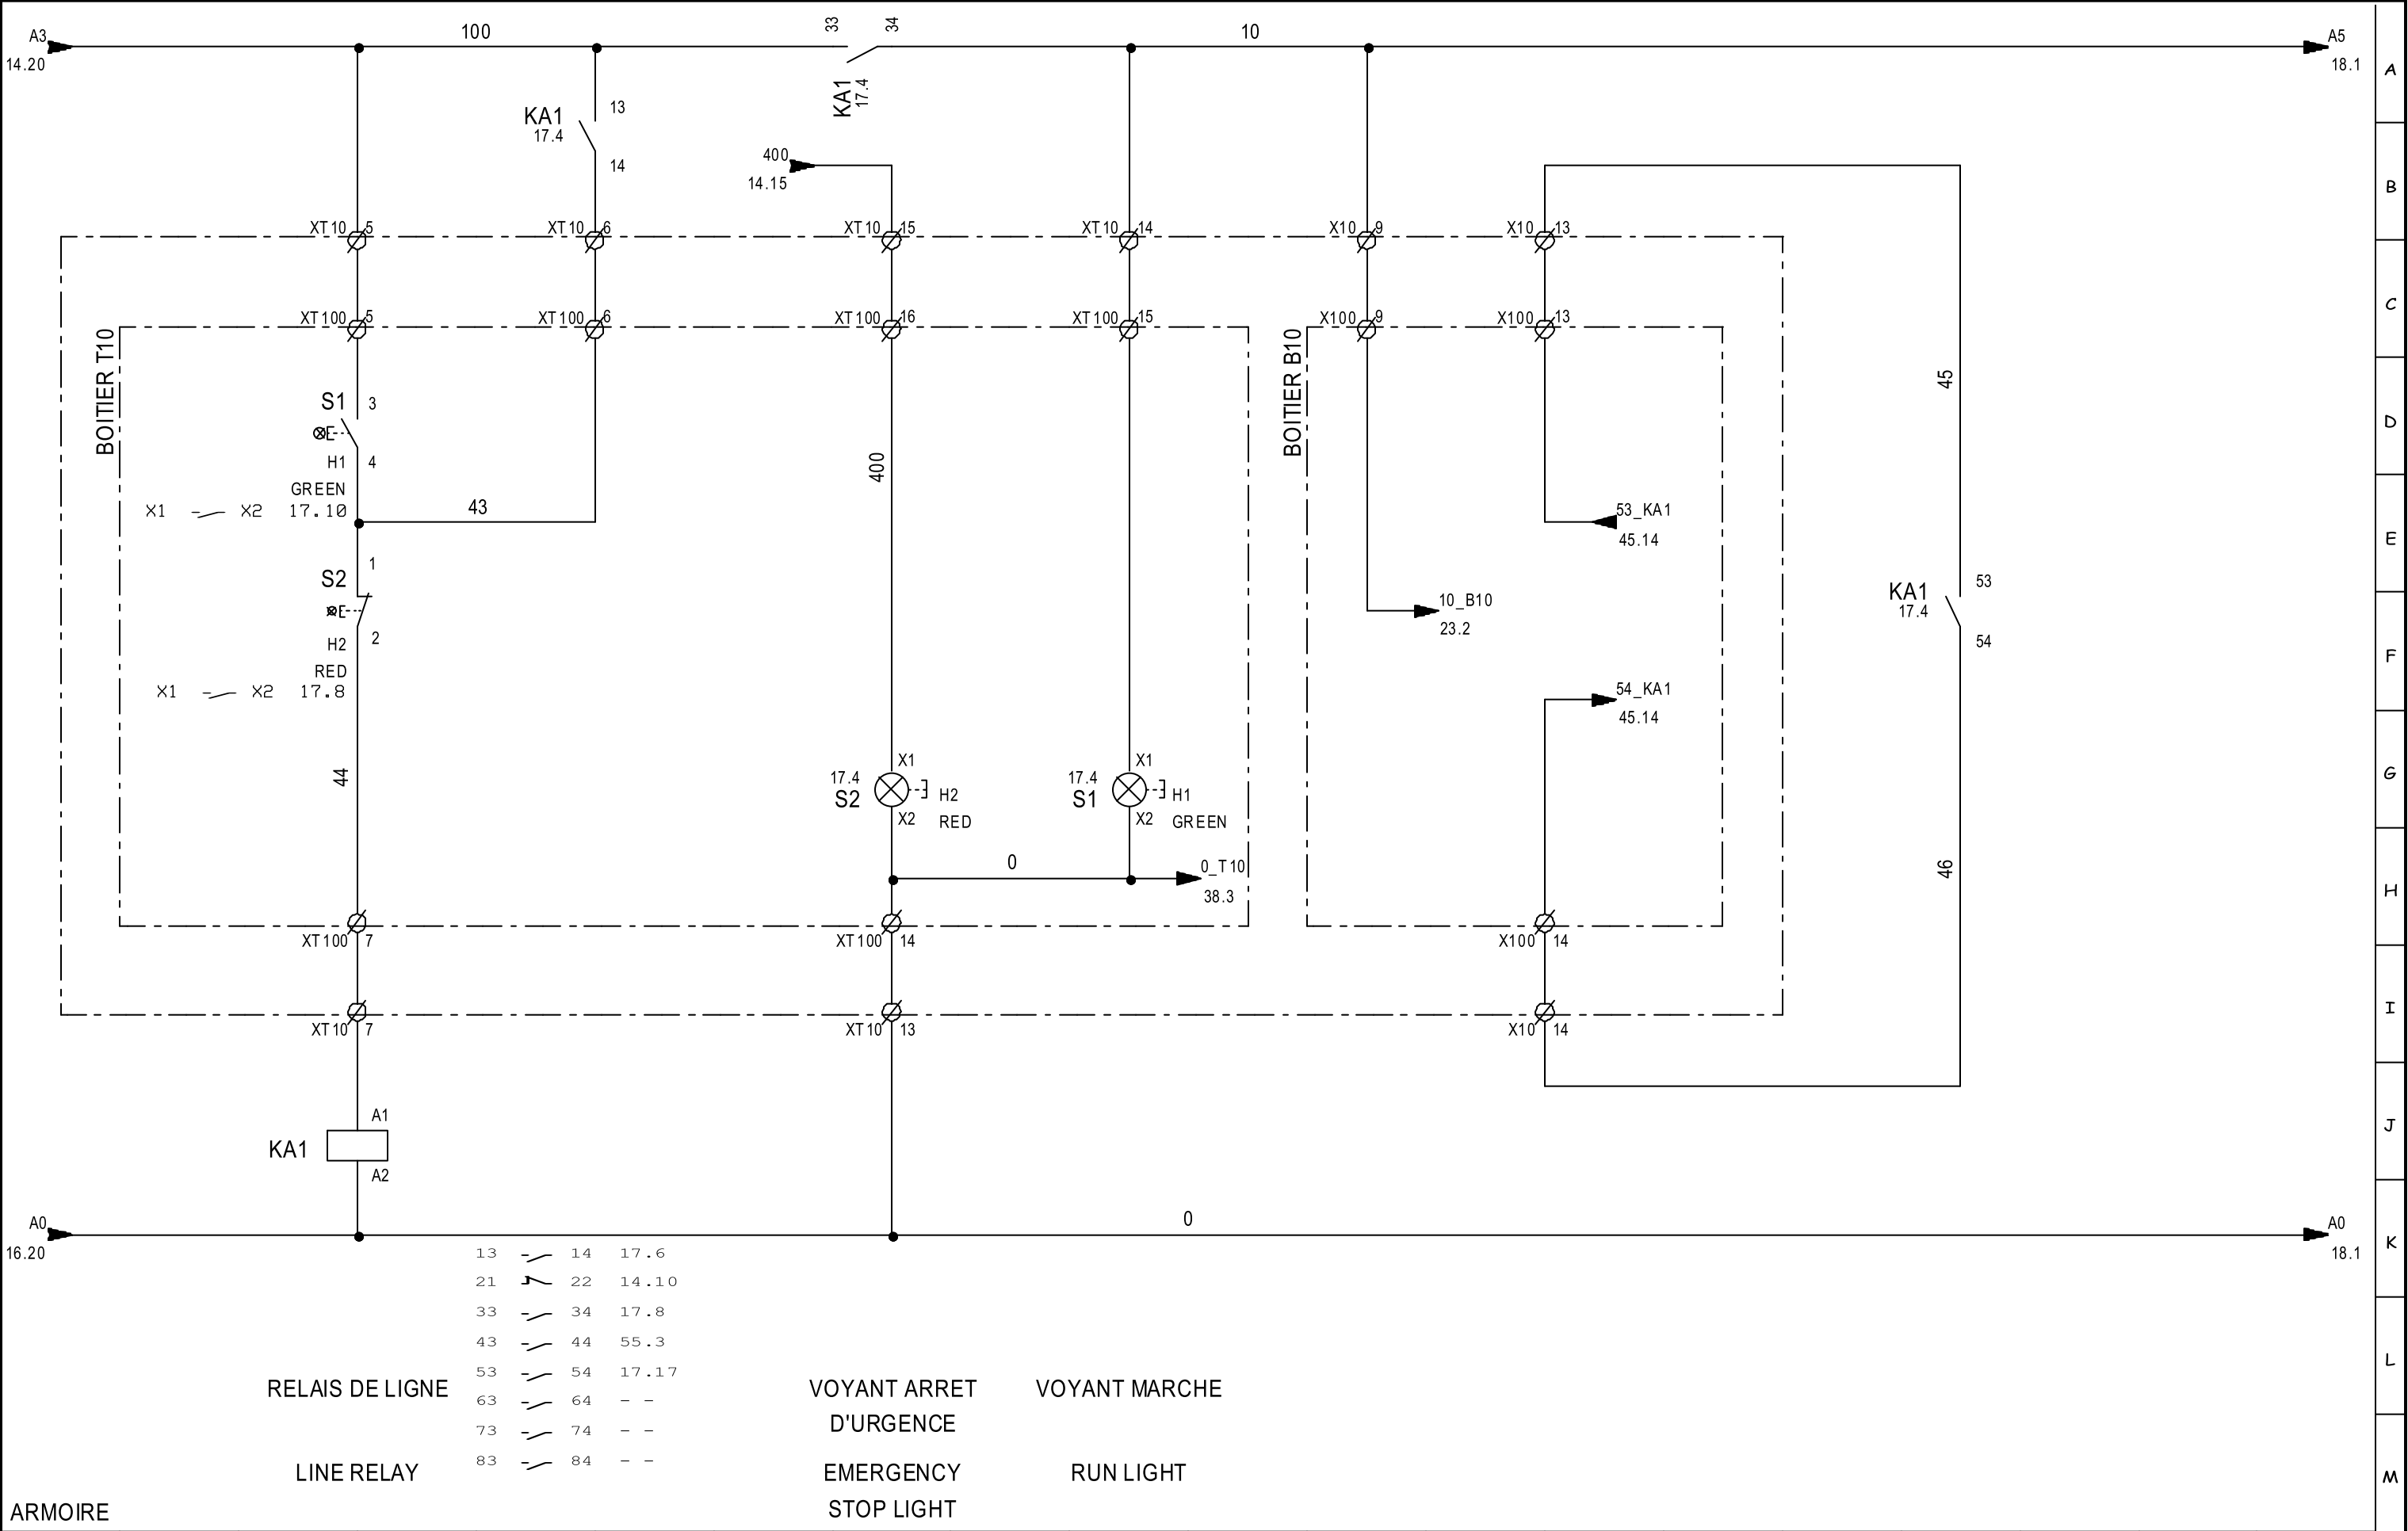


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE :				INDEX : V6	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002				FOLIO : 17/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

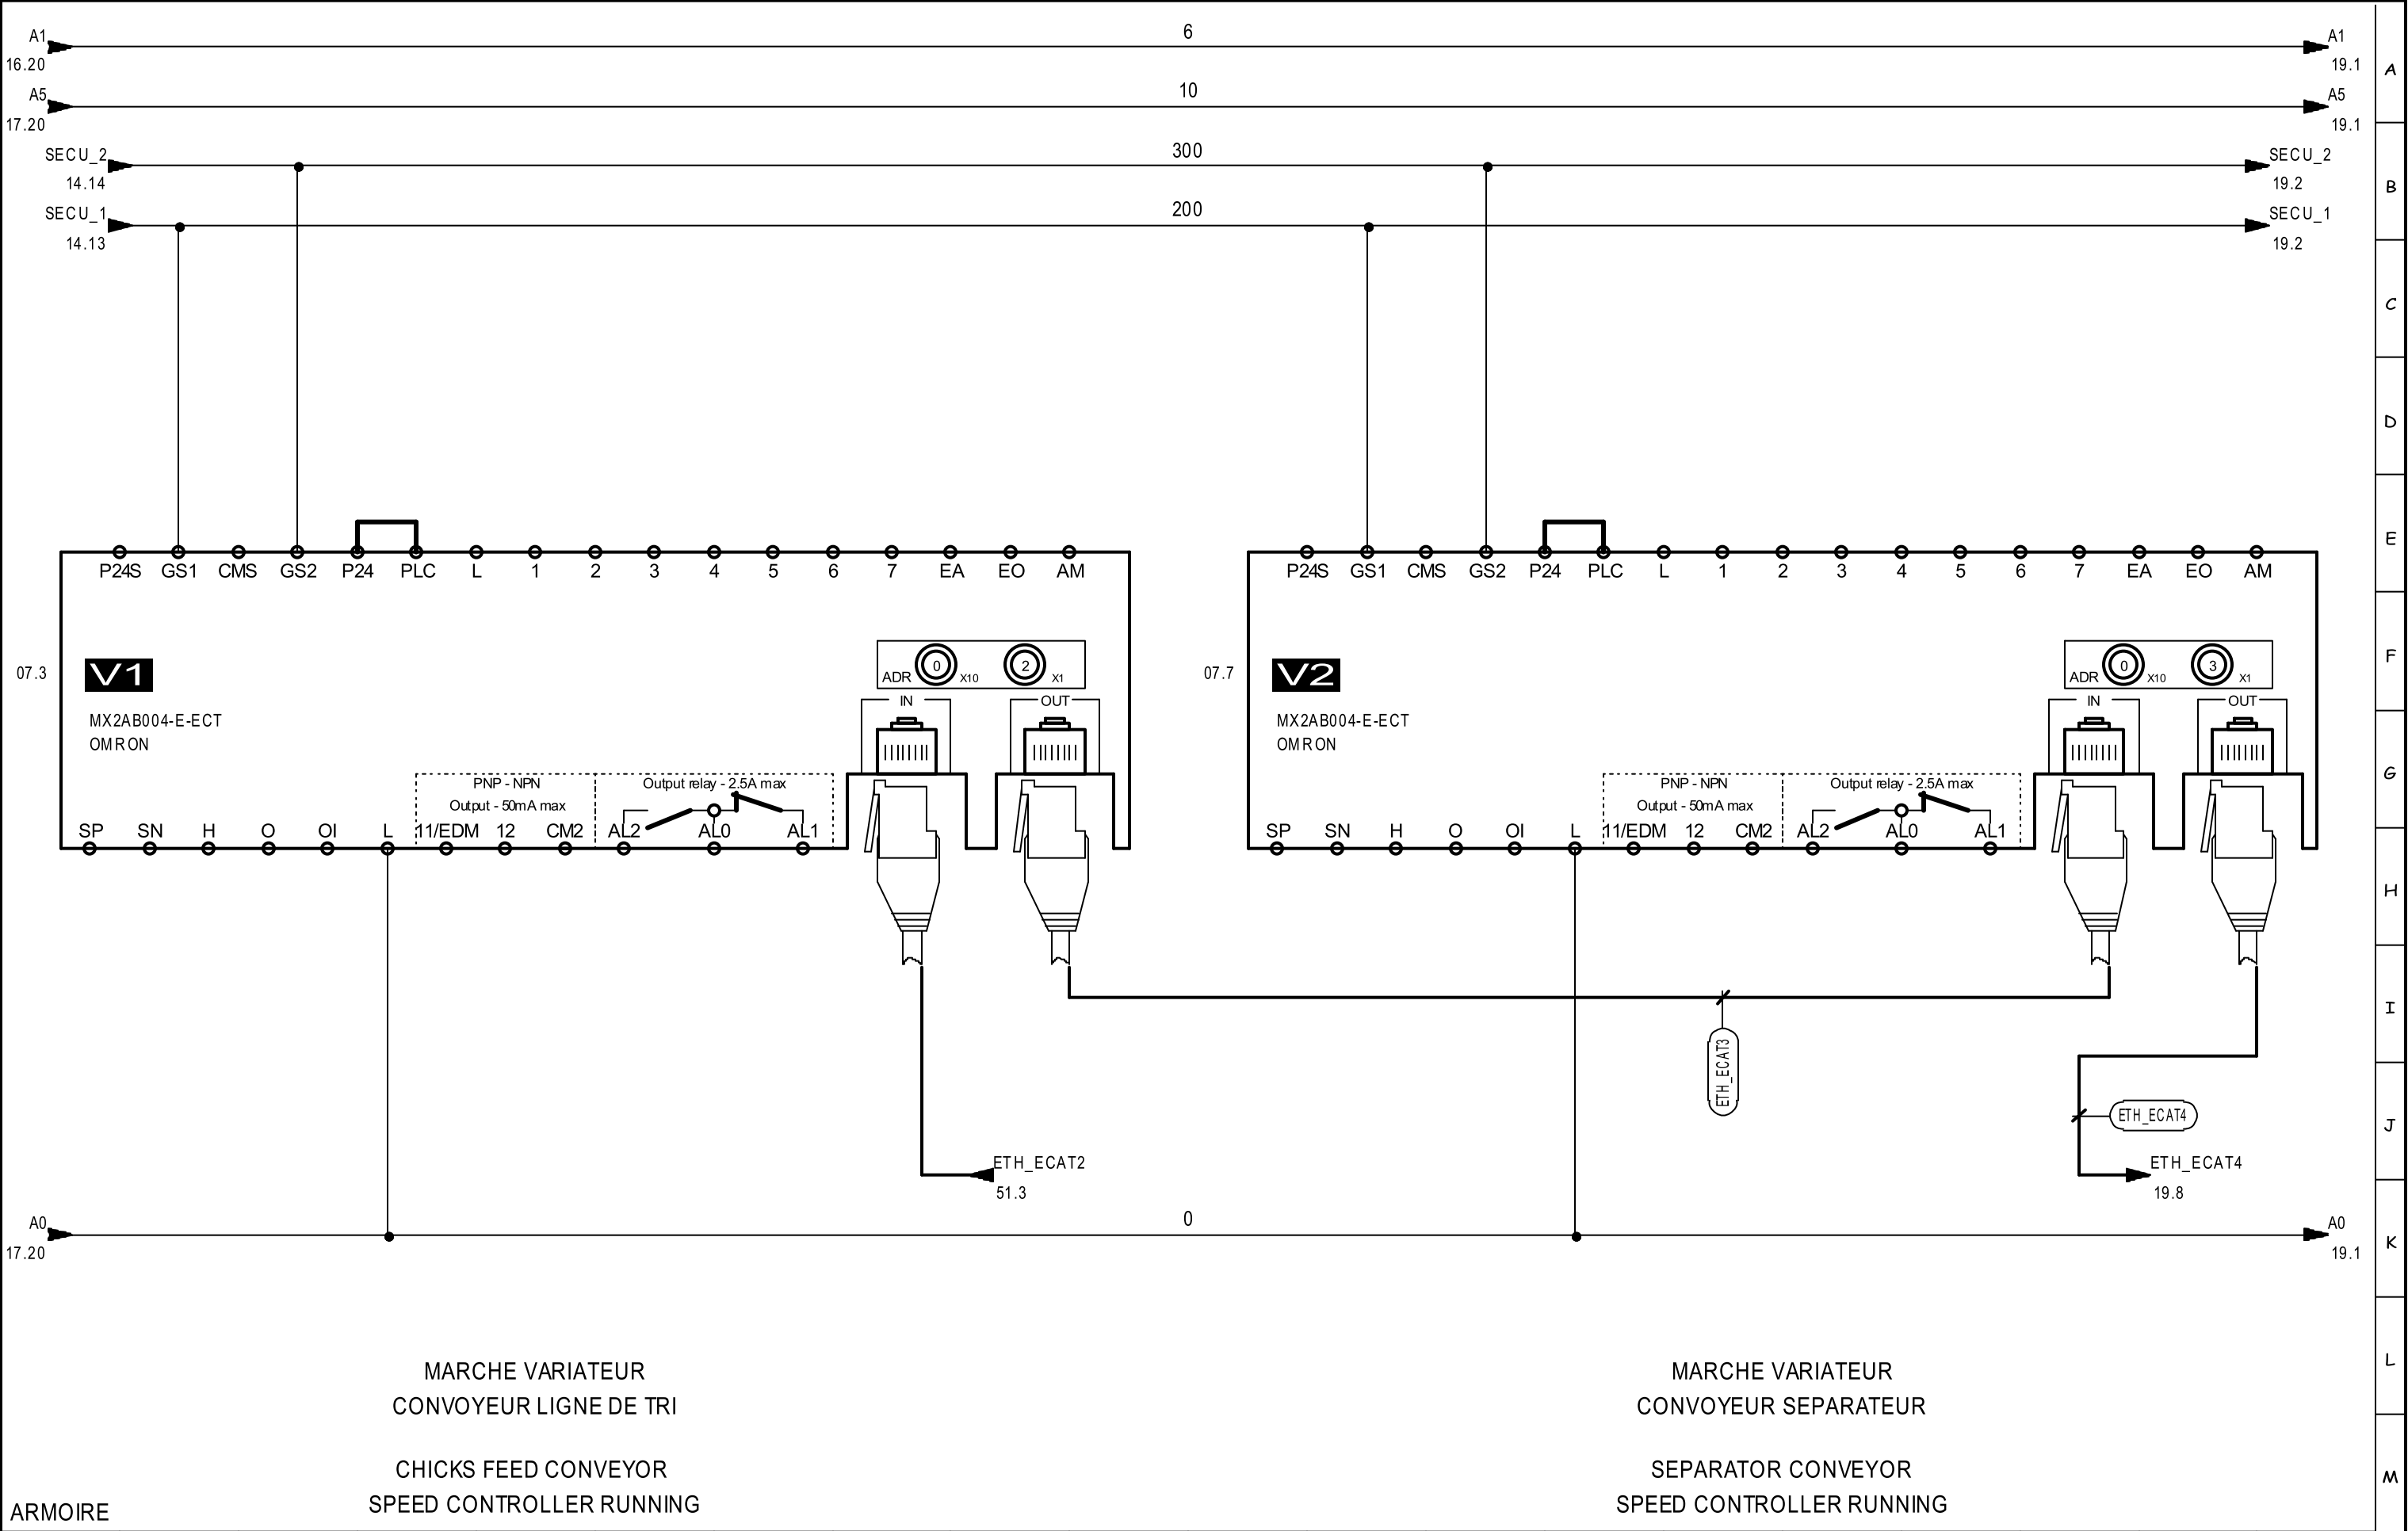


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				18/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

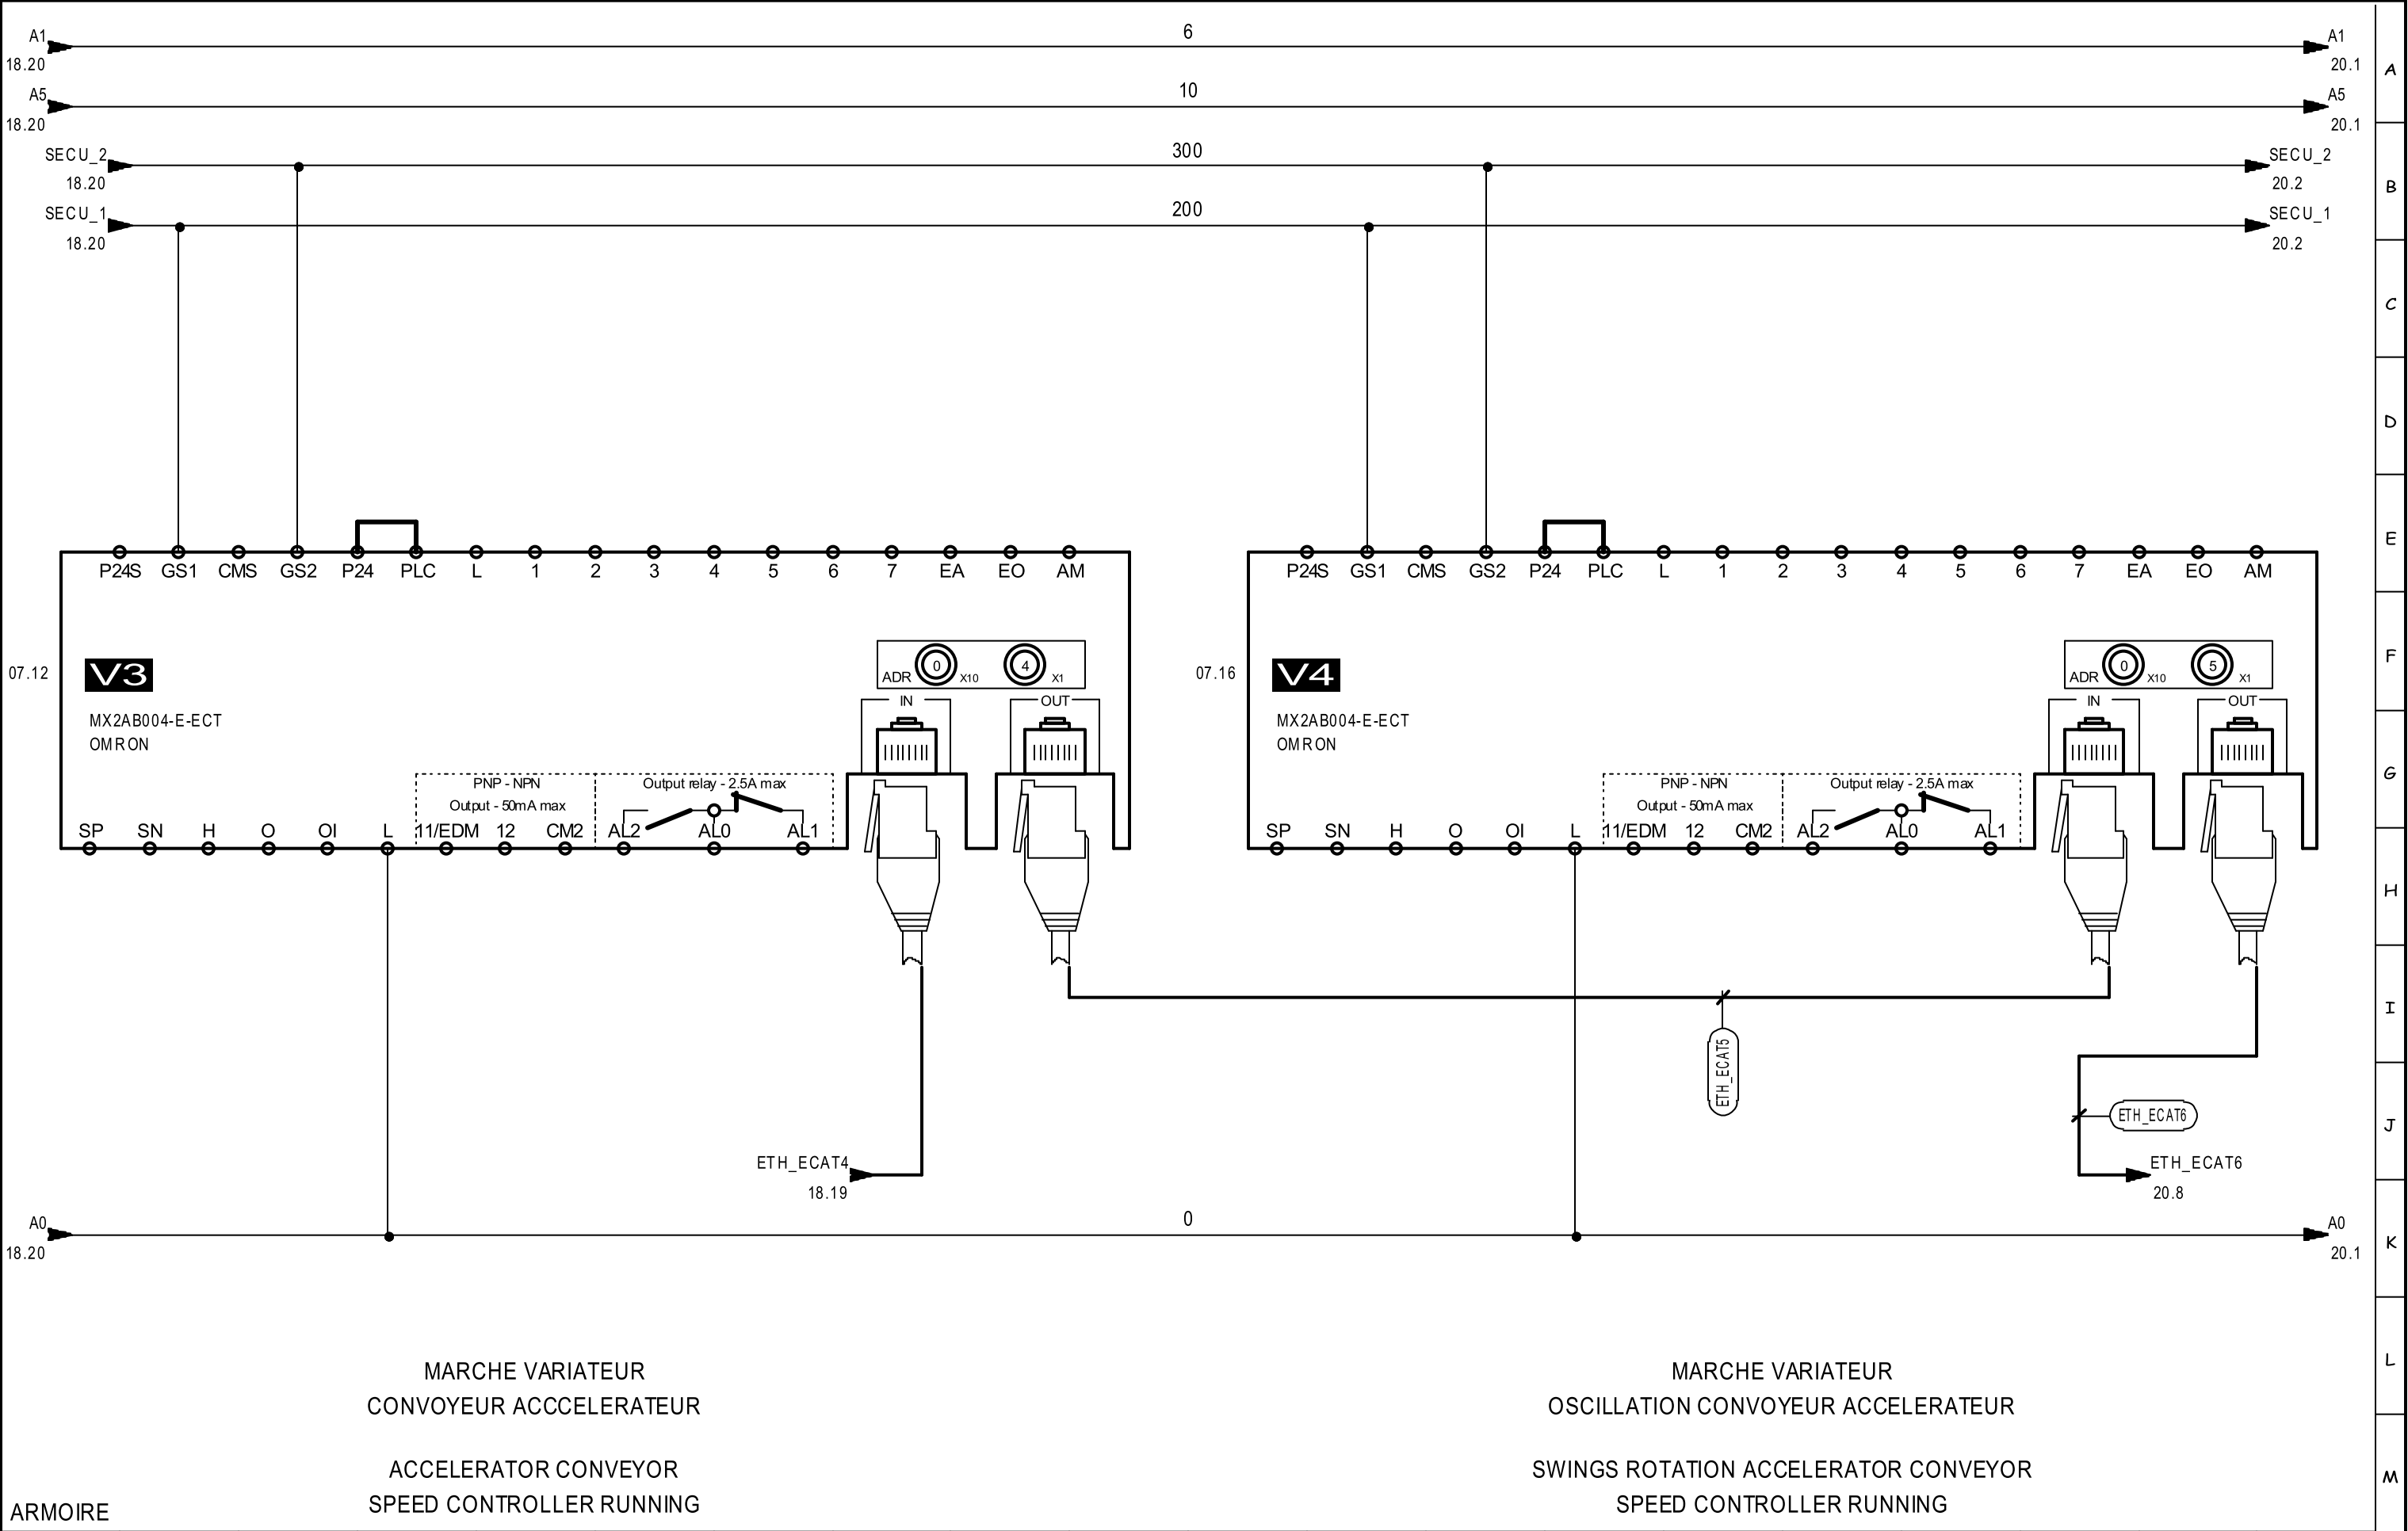

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE :				INDEX : V6	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002				FOLIO : 19/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

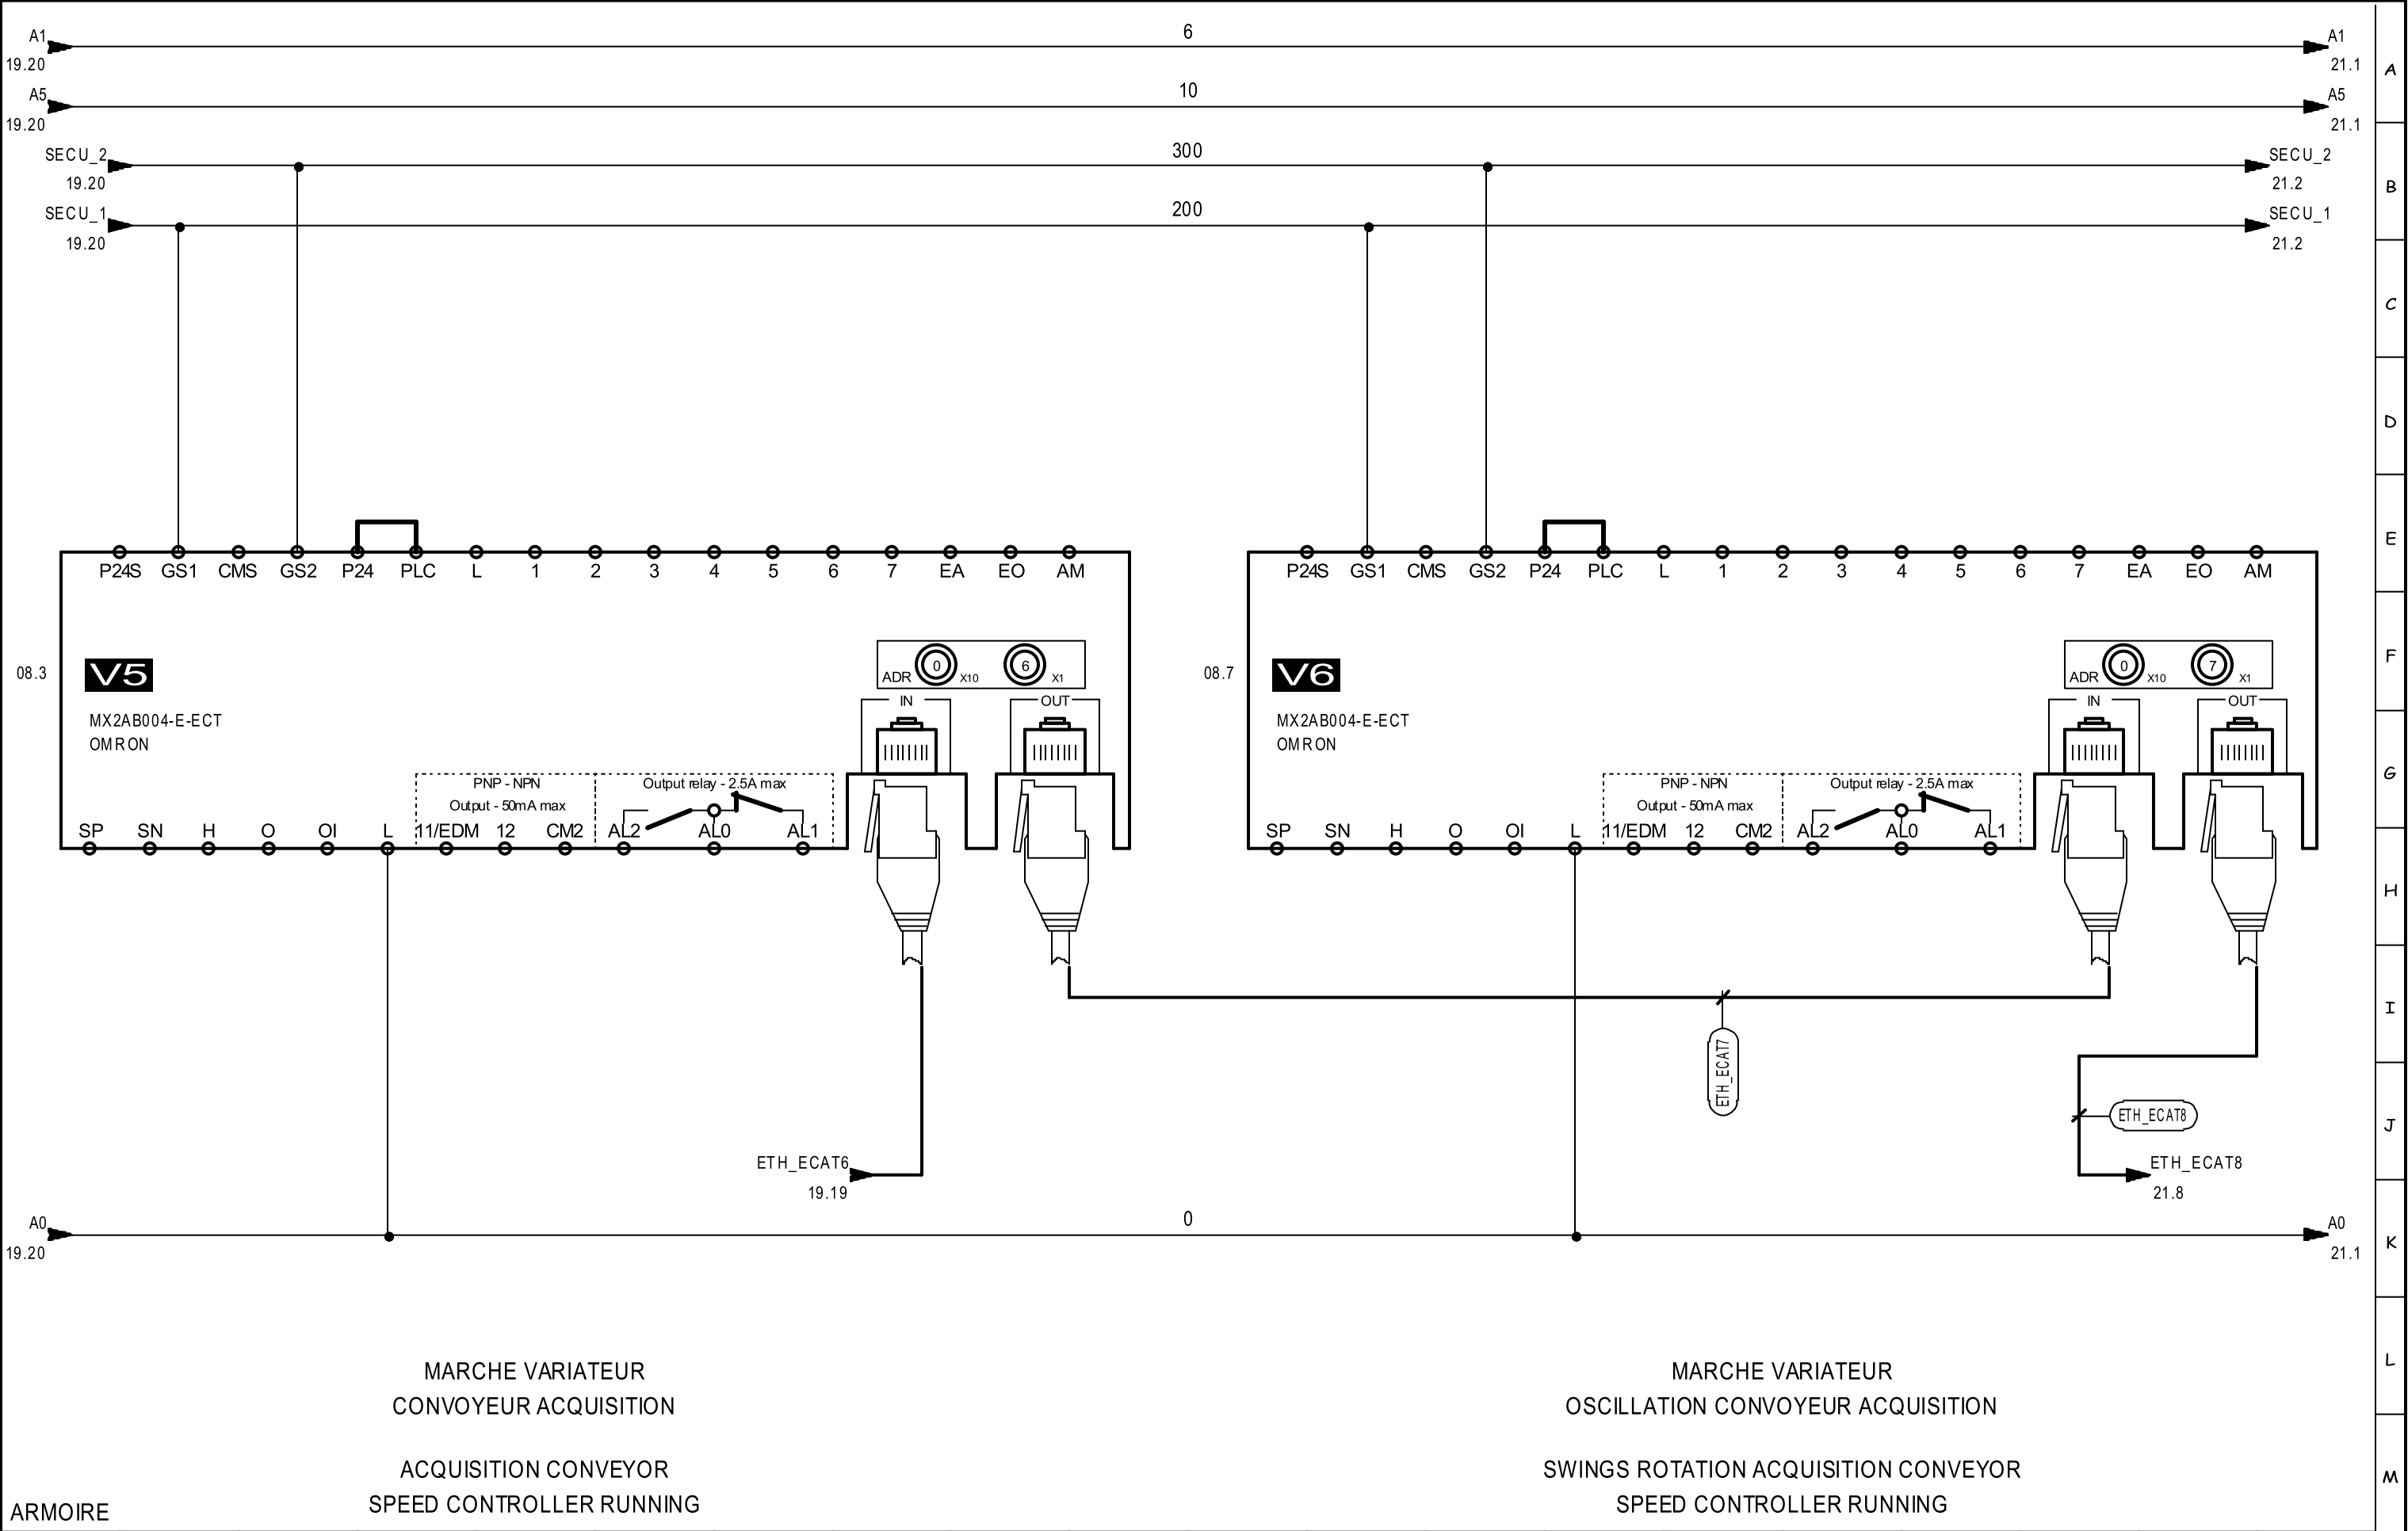

MARCHE VARIATEUR
CONVOYEUR ACQUISITION

ACQUISITION CONVEYOR
SPEED CONTROLLER RUNNING


MARCHE VARIATEUR
OSCILLATION CONVOYEUR ACQUISITION

SWINGS ROTATION ACQUISITION CONVEYOR
SPEED CONTROLLER RUNNING

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus			CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		CONTROL PLAN							ARTICLE :		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				SMXA0002					FOLIO : 20/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

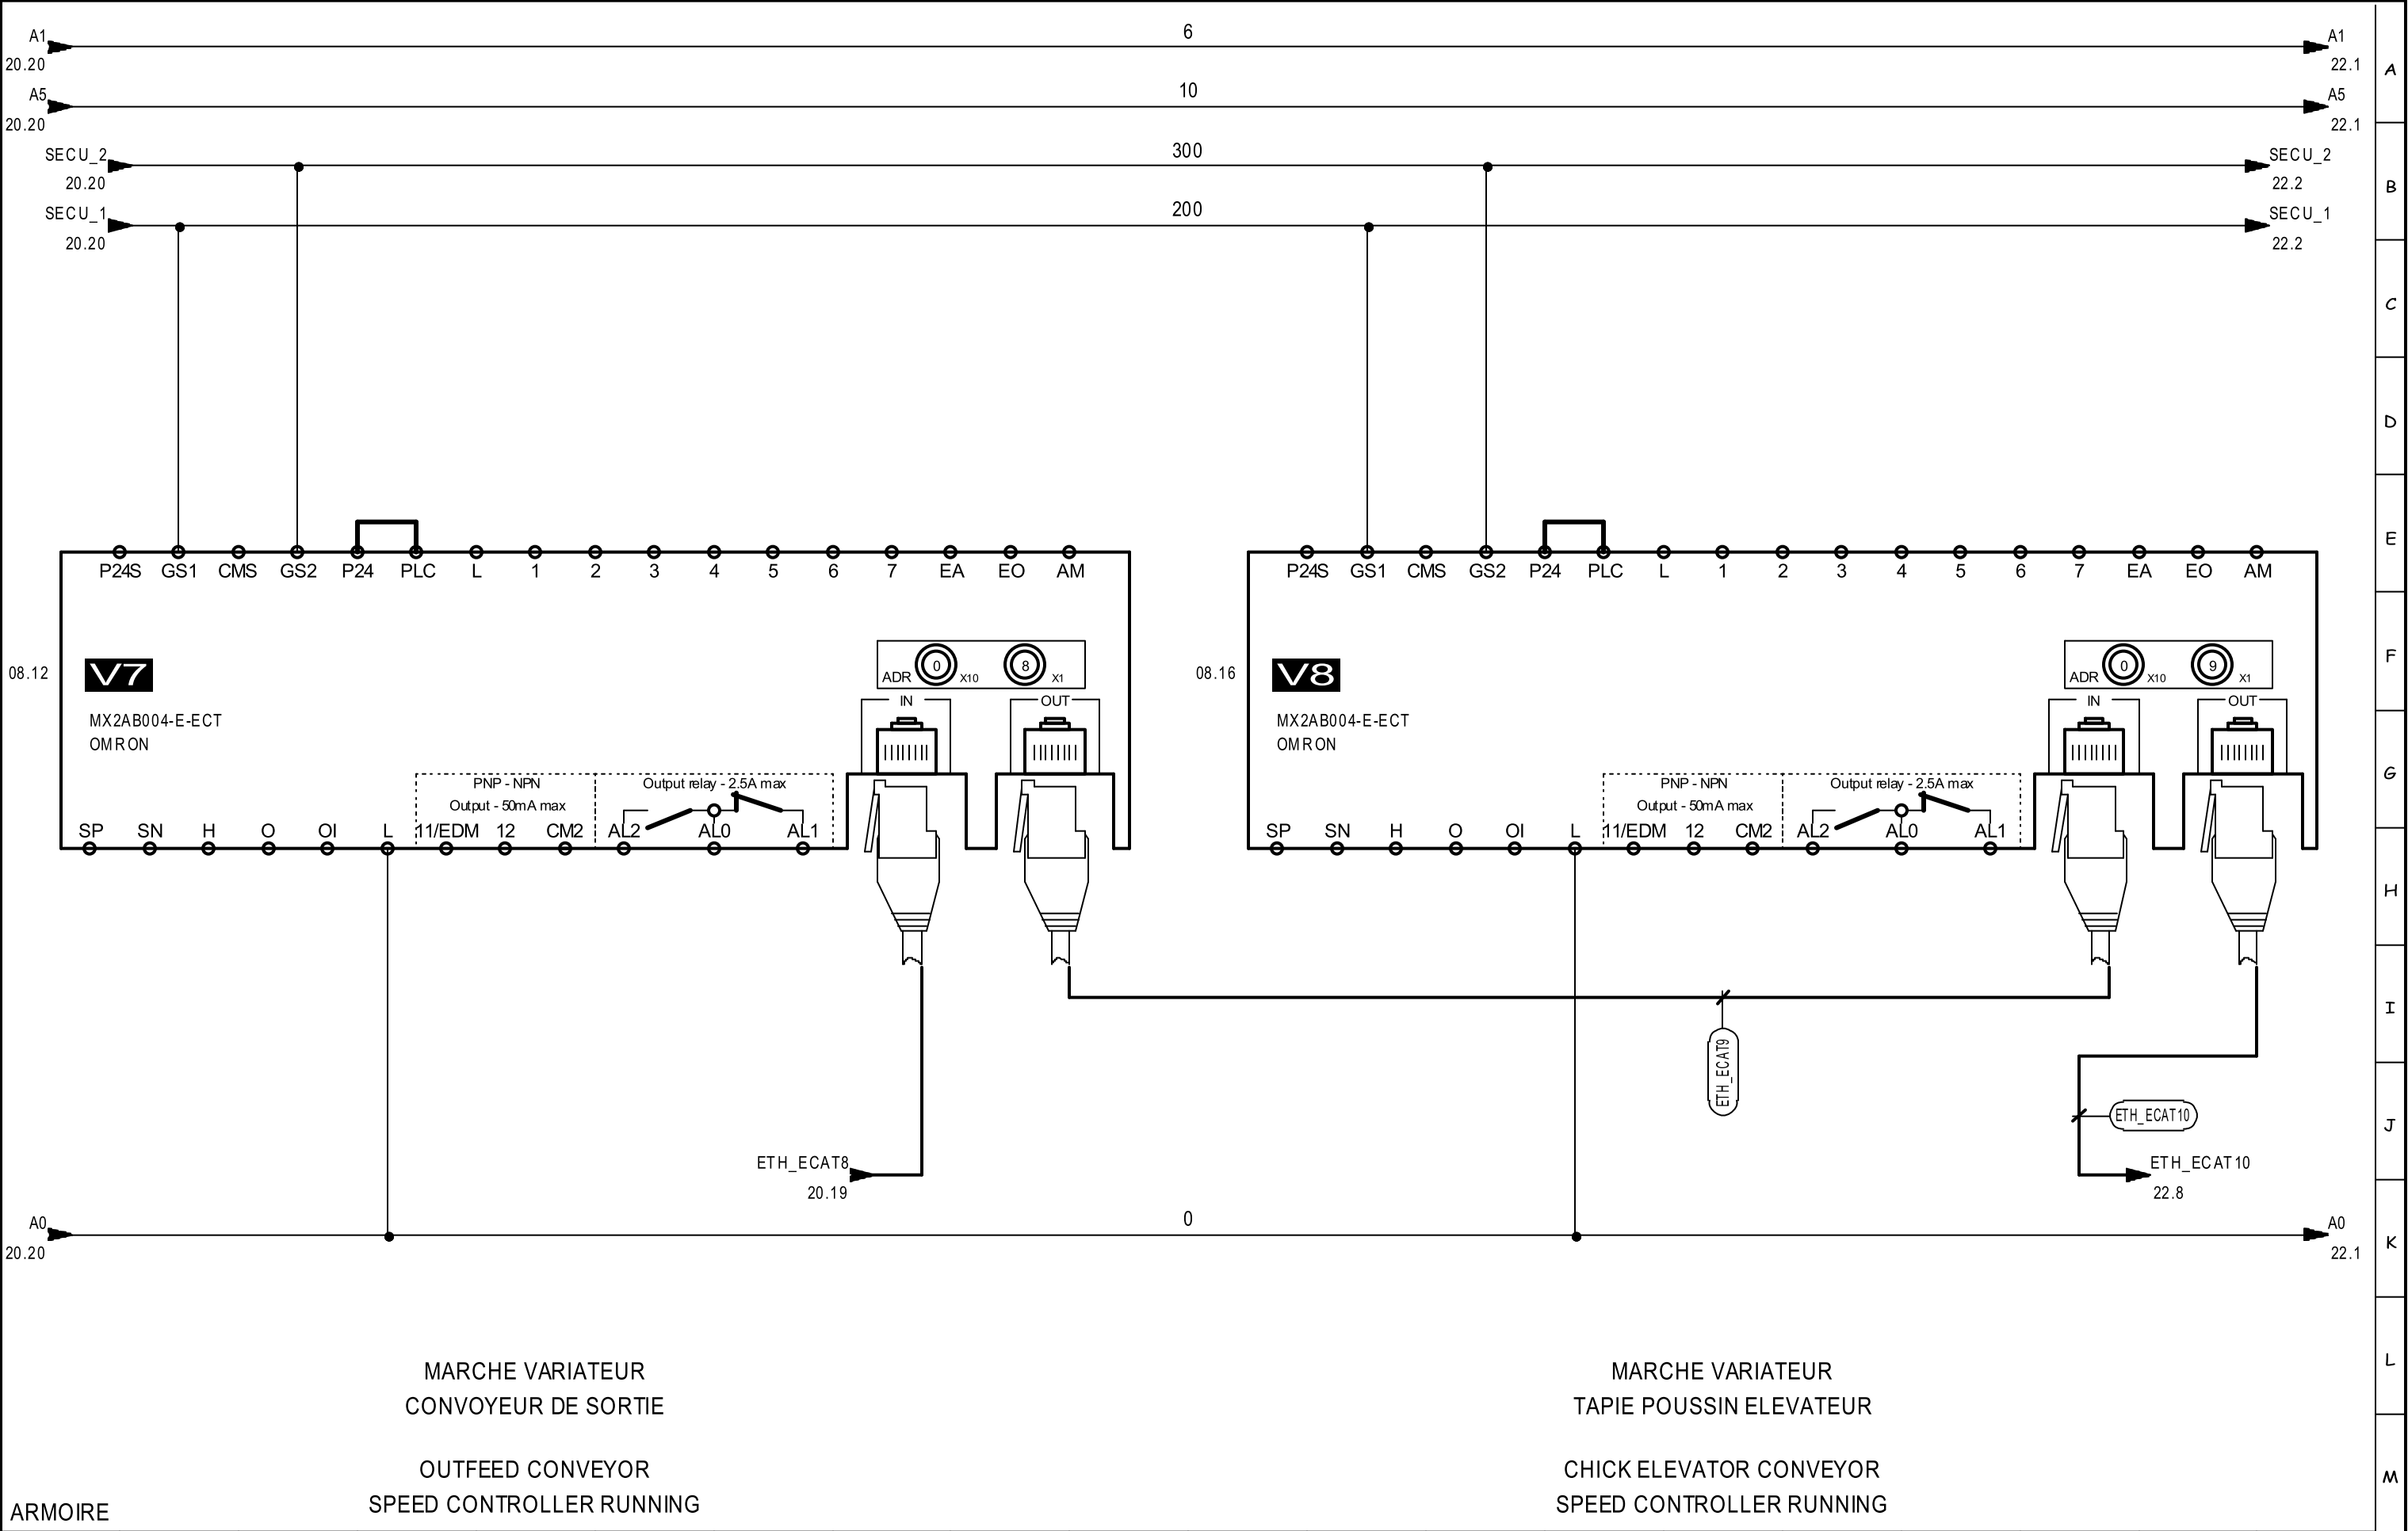


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE :		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 21/144			


INFEED COUNTER CHICK CONVEYOR
SPEED CONTROLLER RUNNING

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36	Date of creation :		SCHEMA COMMANDE					 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38	Designed by : DB		CONTROL PLAN									ARTICLE : SMXA0002				INDEX : V6	
			E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Version 4.49.F - 23/09/2020							FOLIO : 22/144					


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

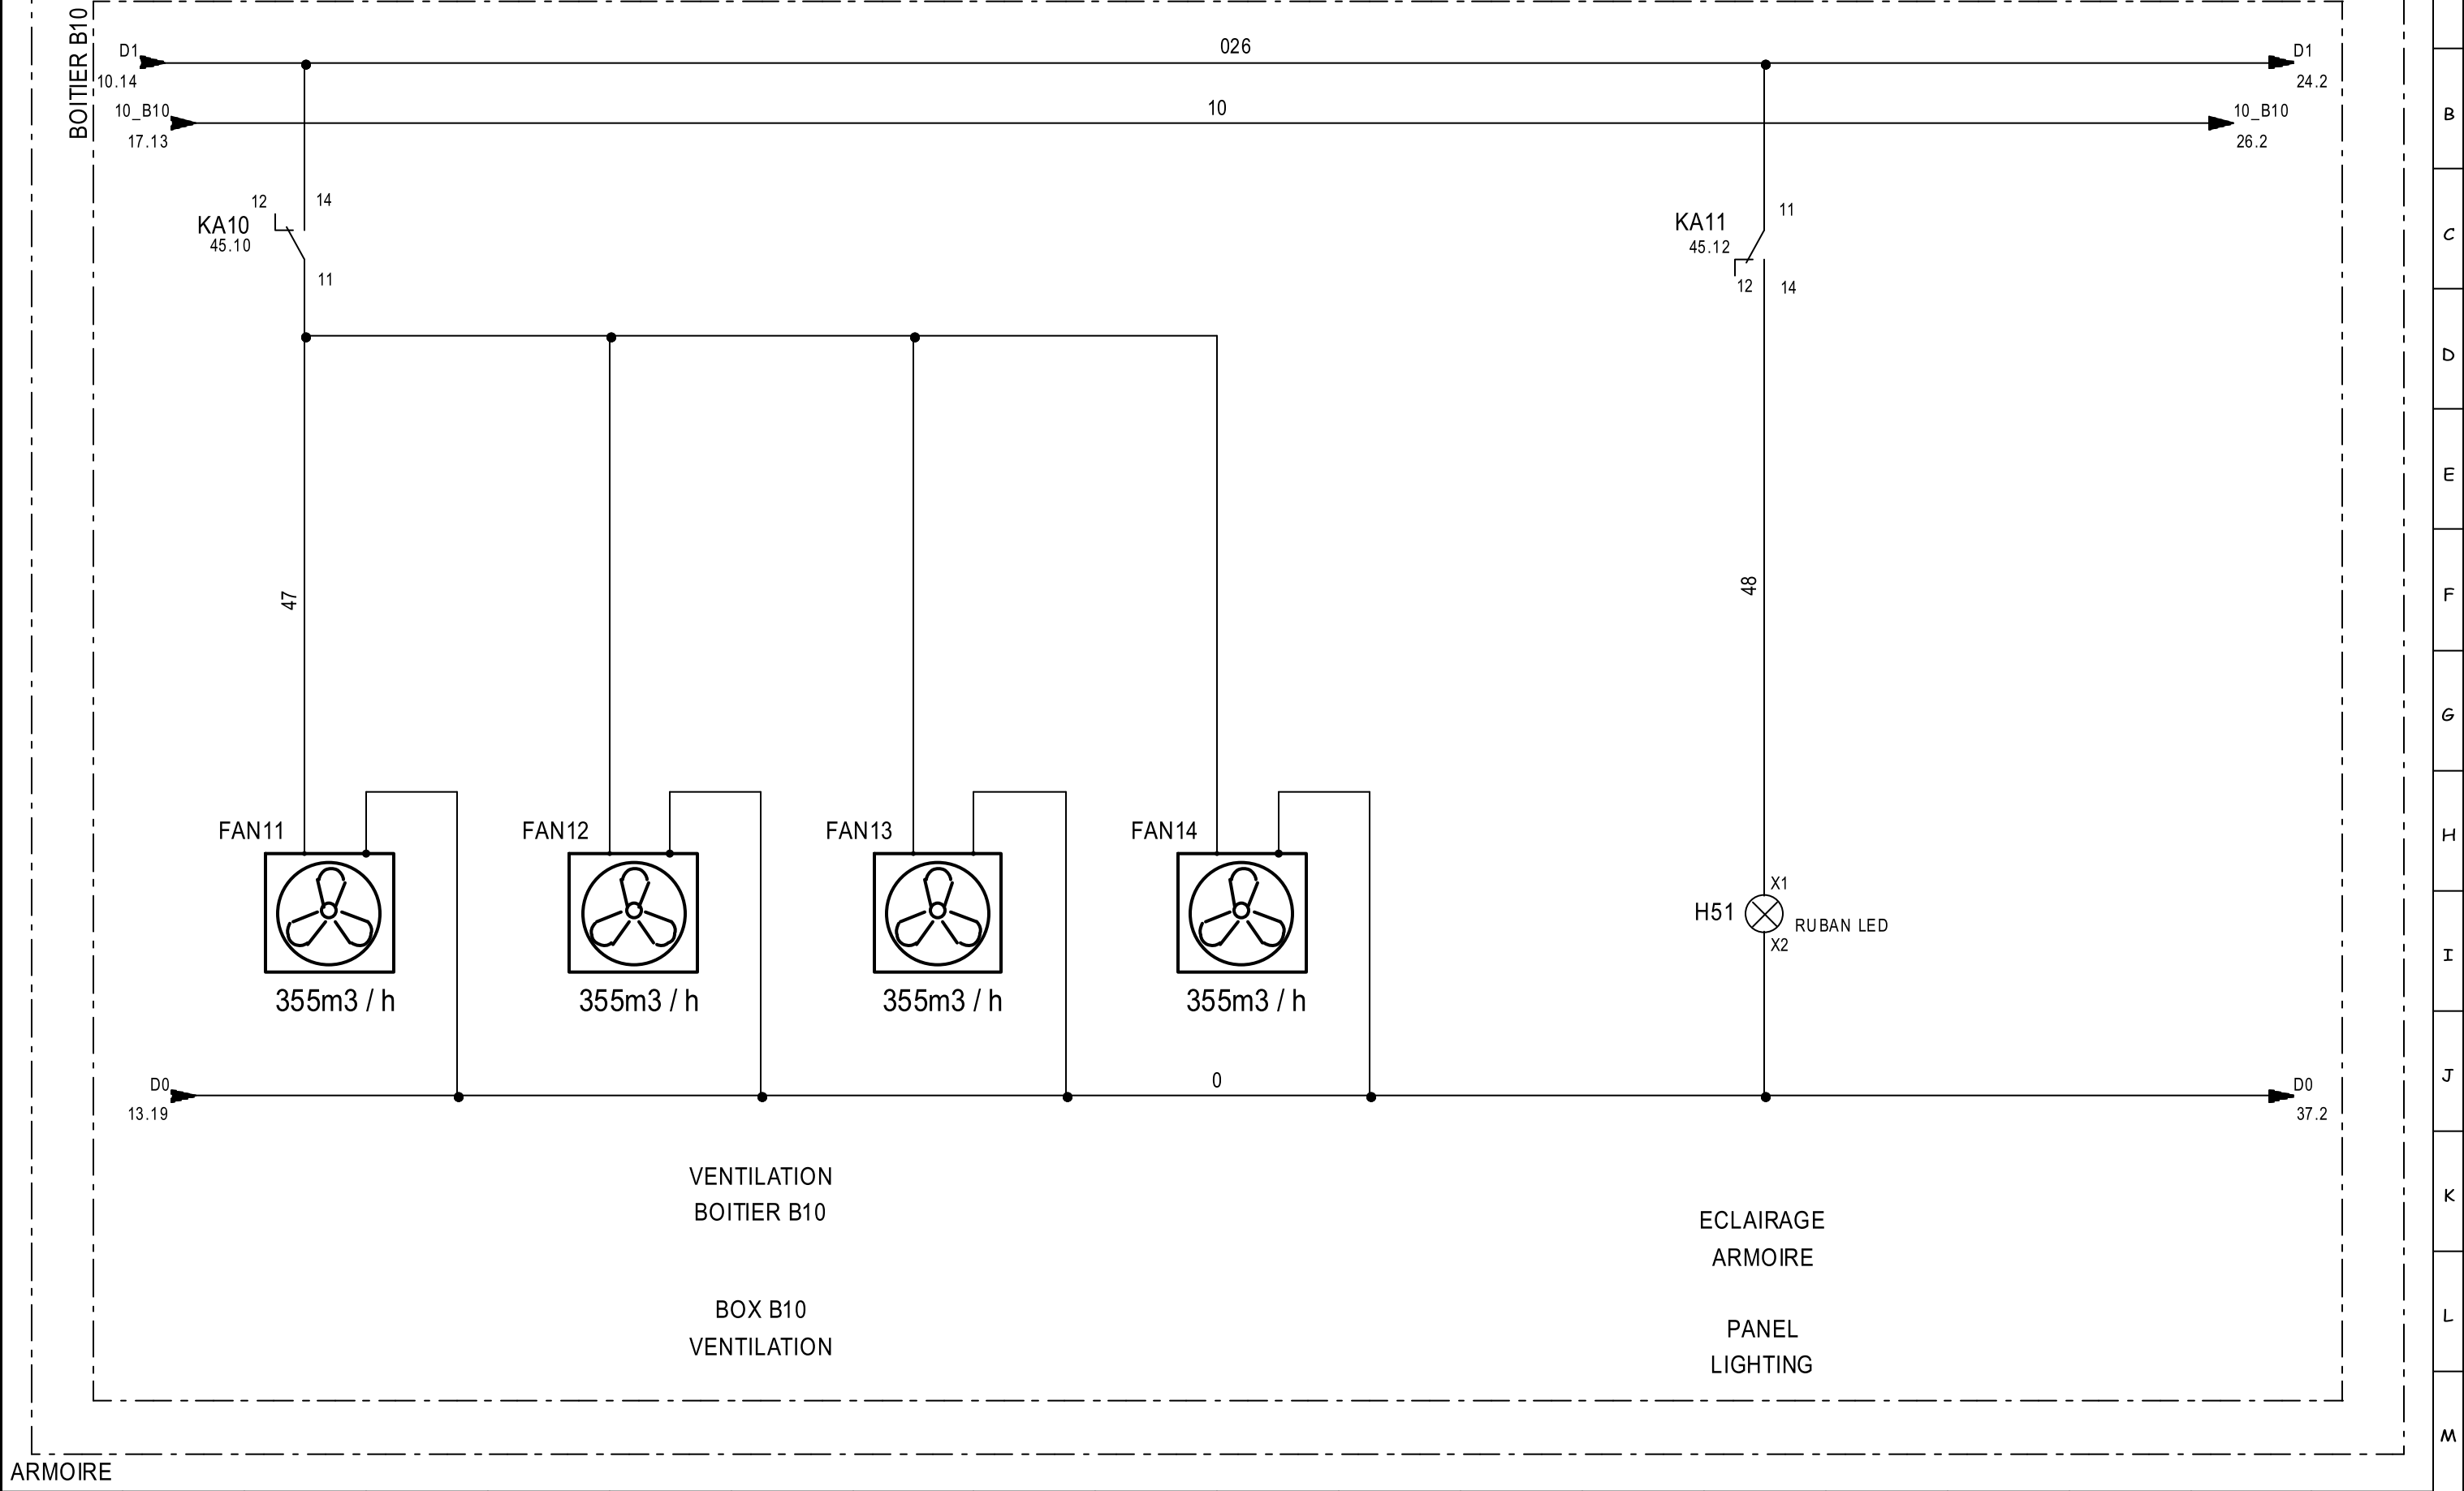

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE UAC				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		UAC CONTROL PLAN								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								FOLIO : 23/144					

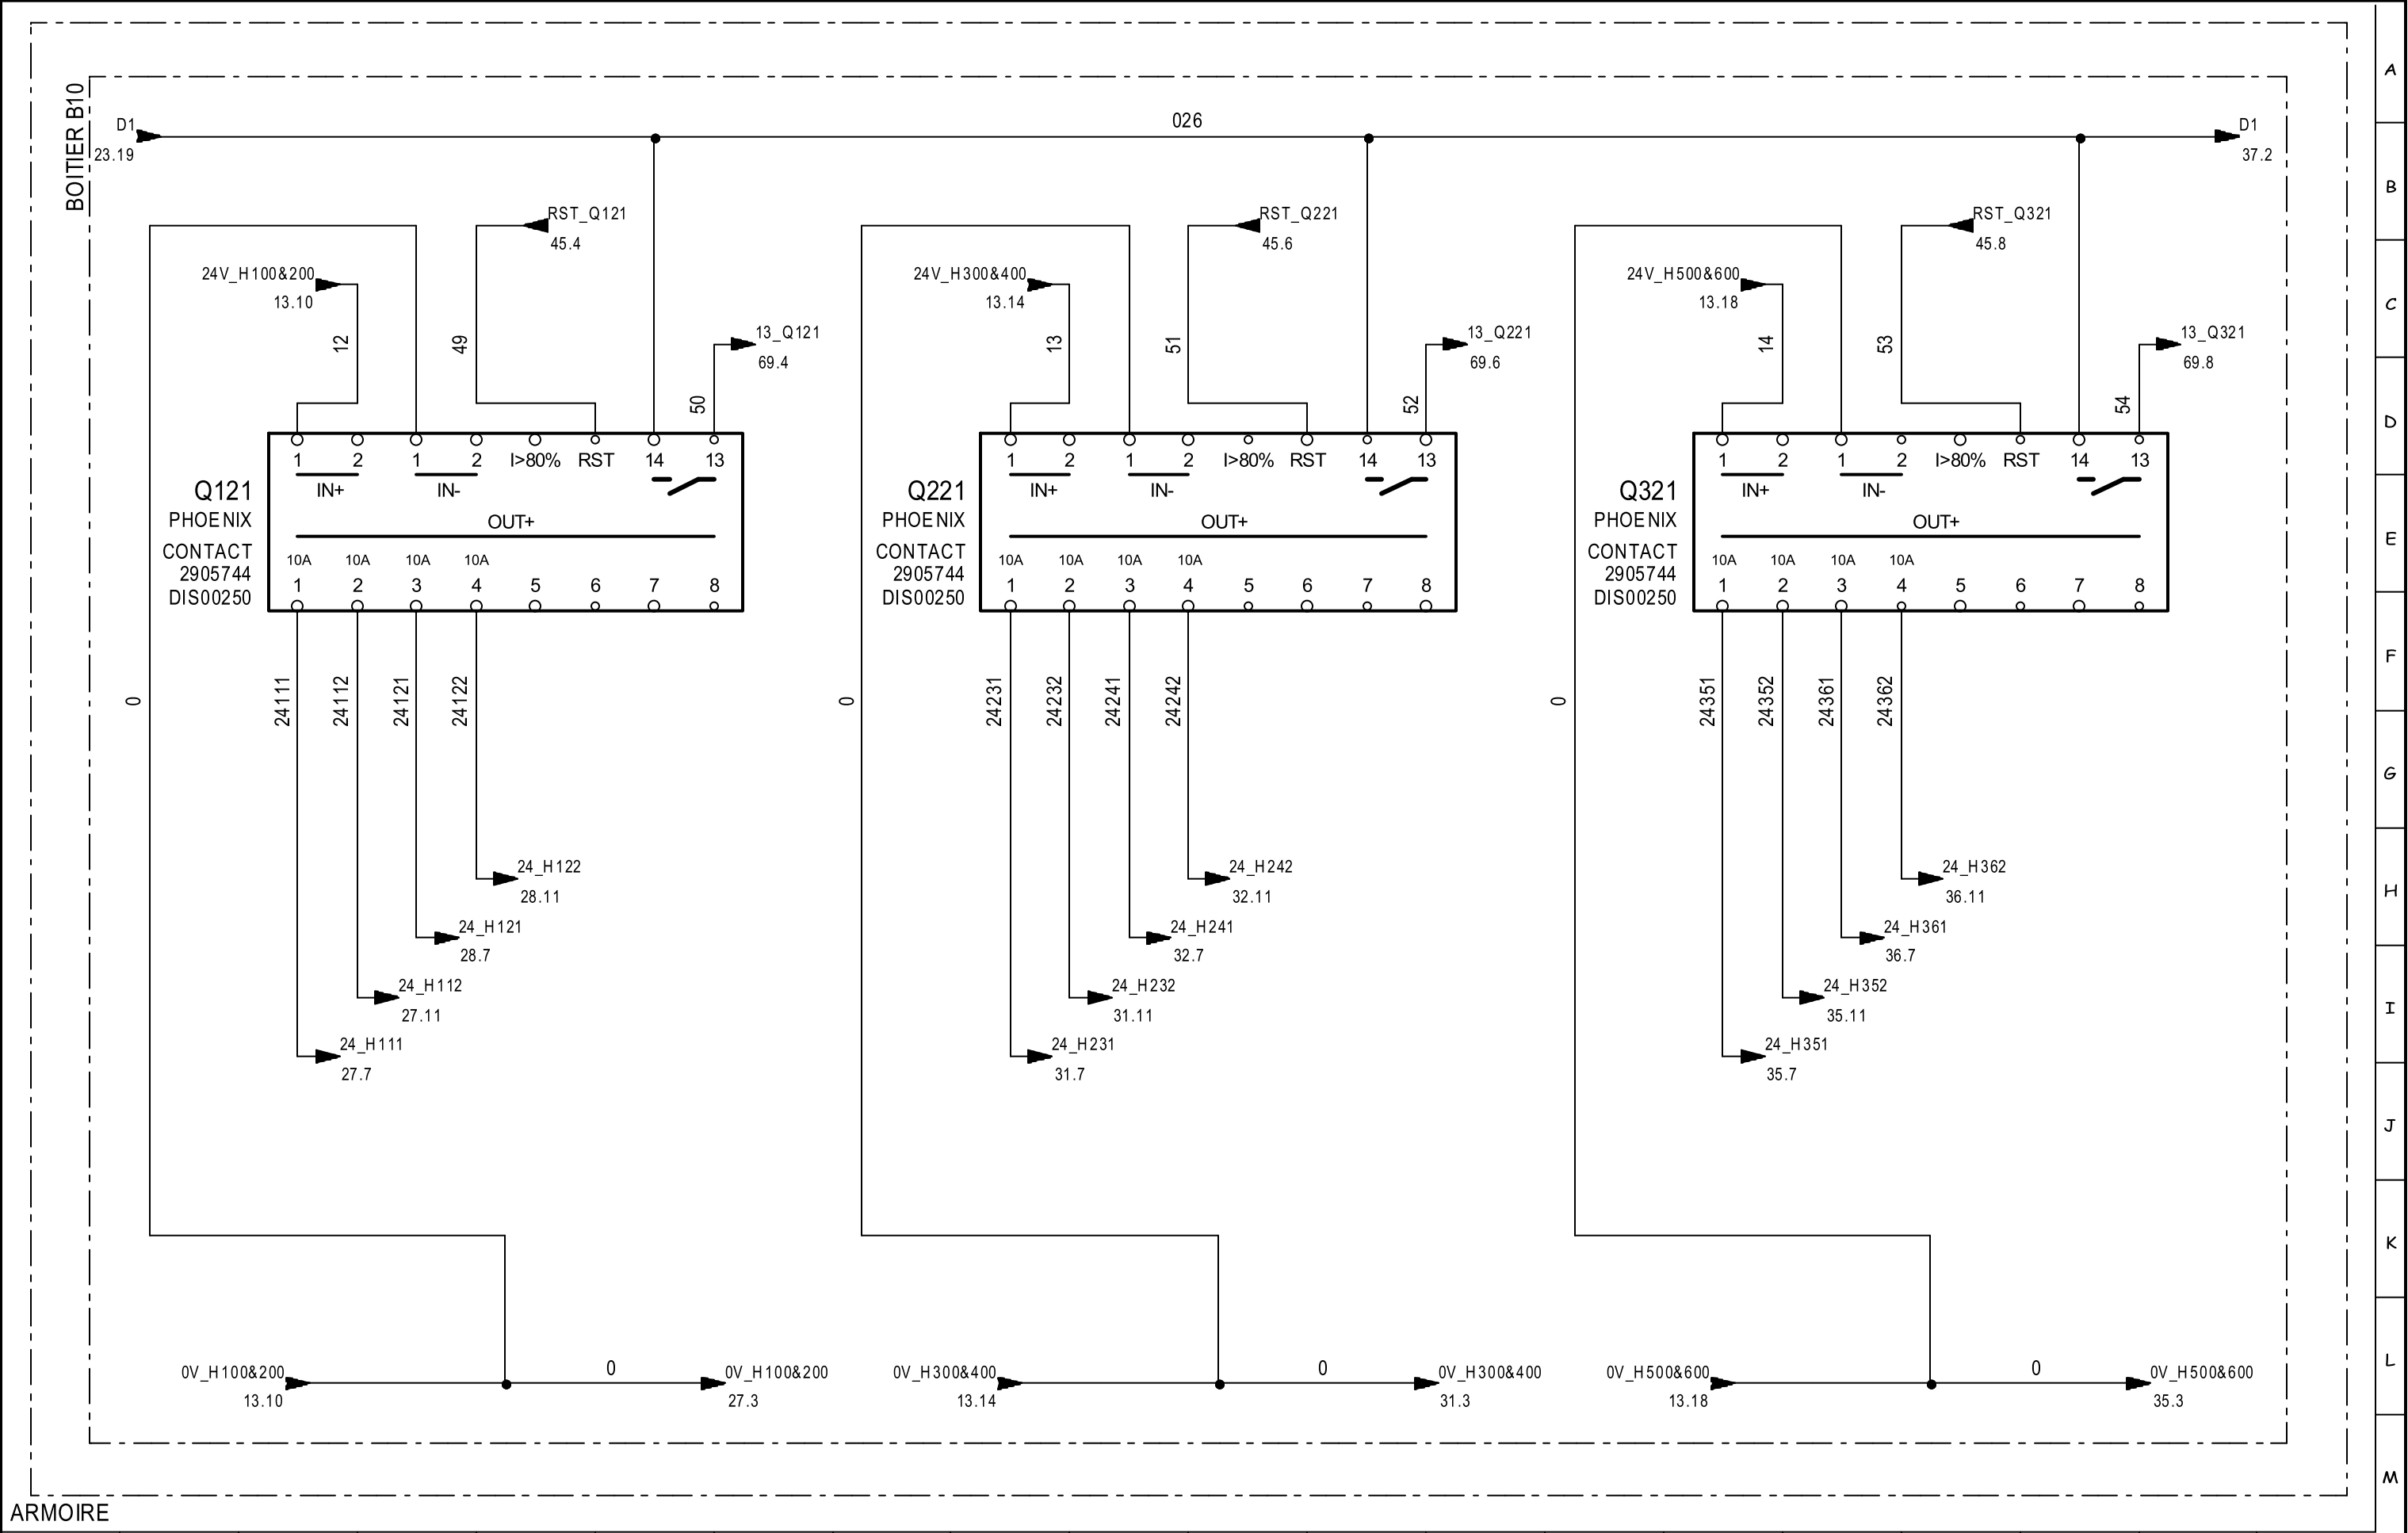


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SCHEMA COMMANDE UAC				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		CONTROL PLAN								ARTICLE :		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 24/144			

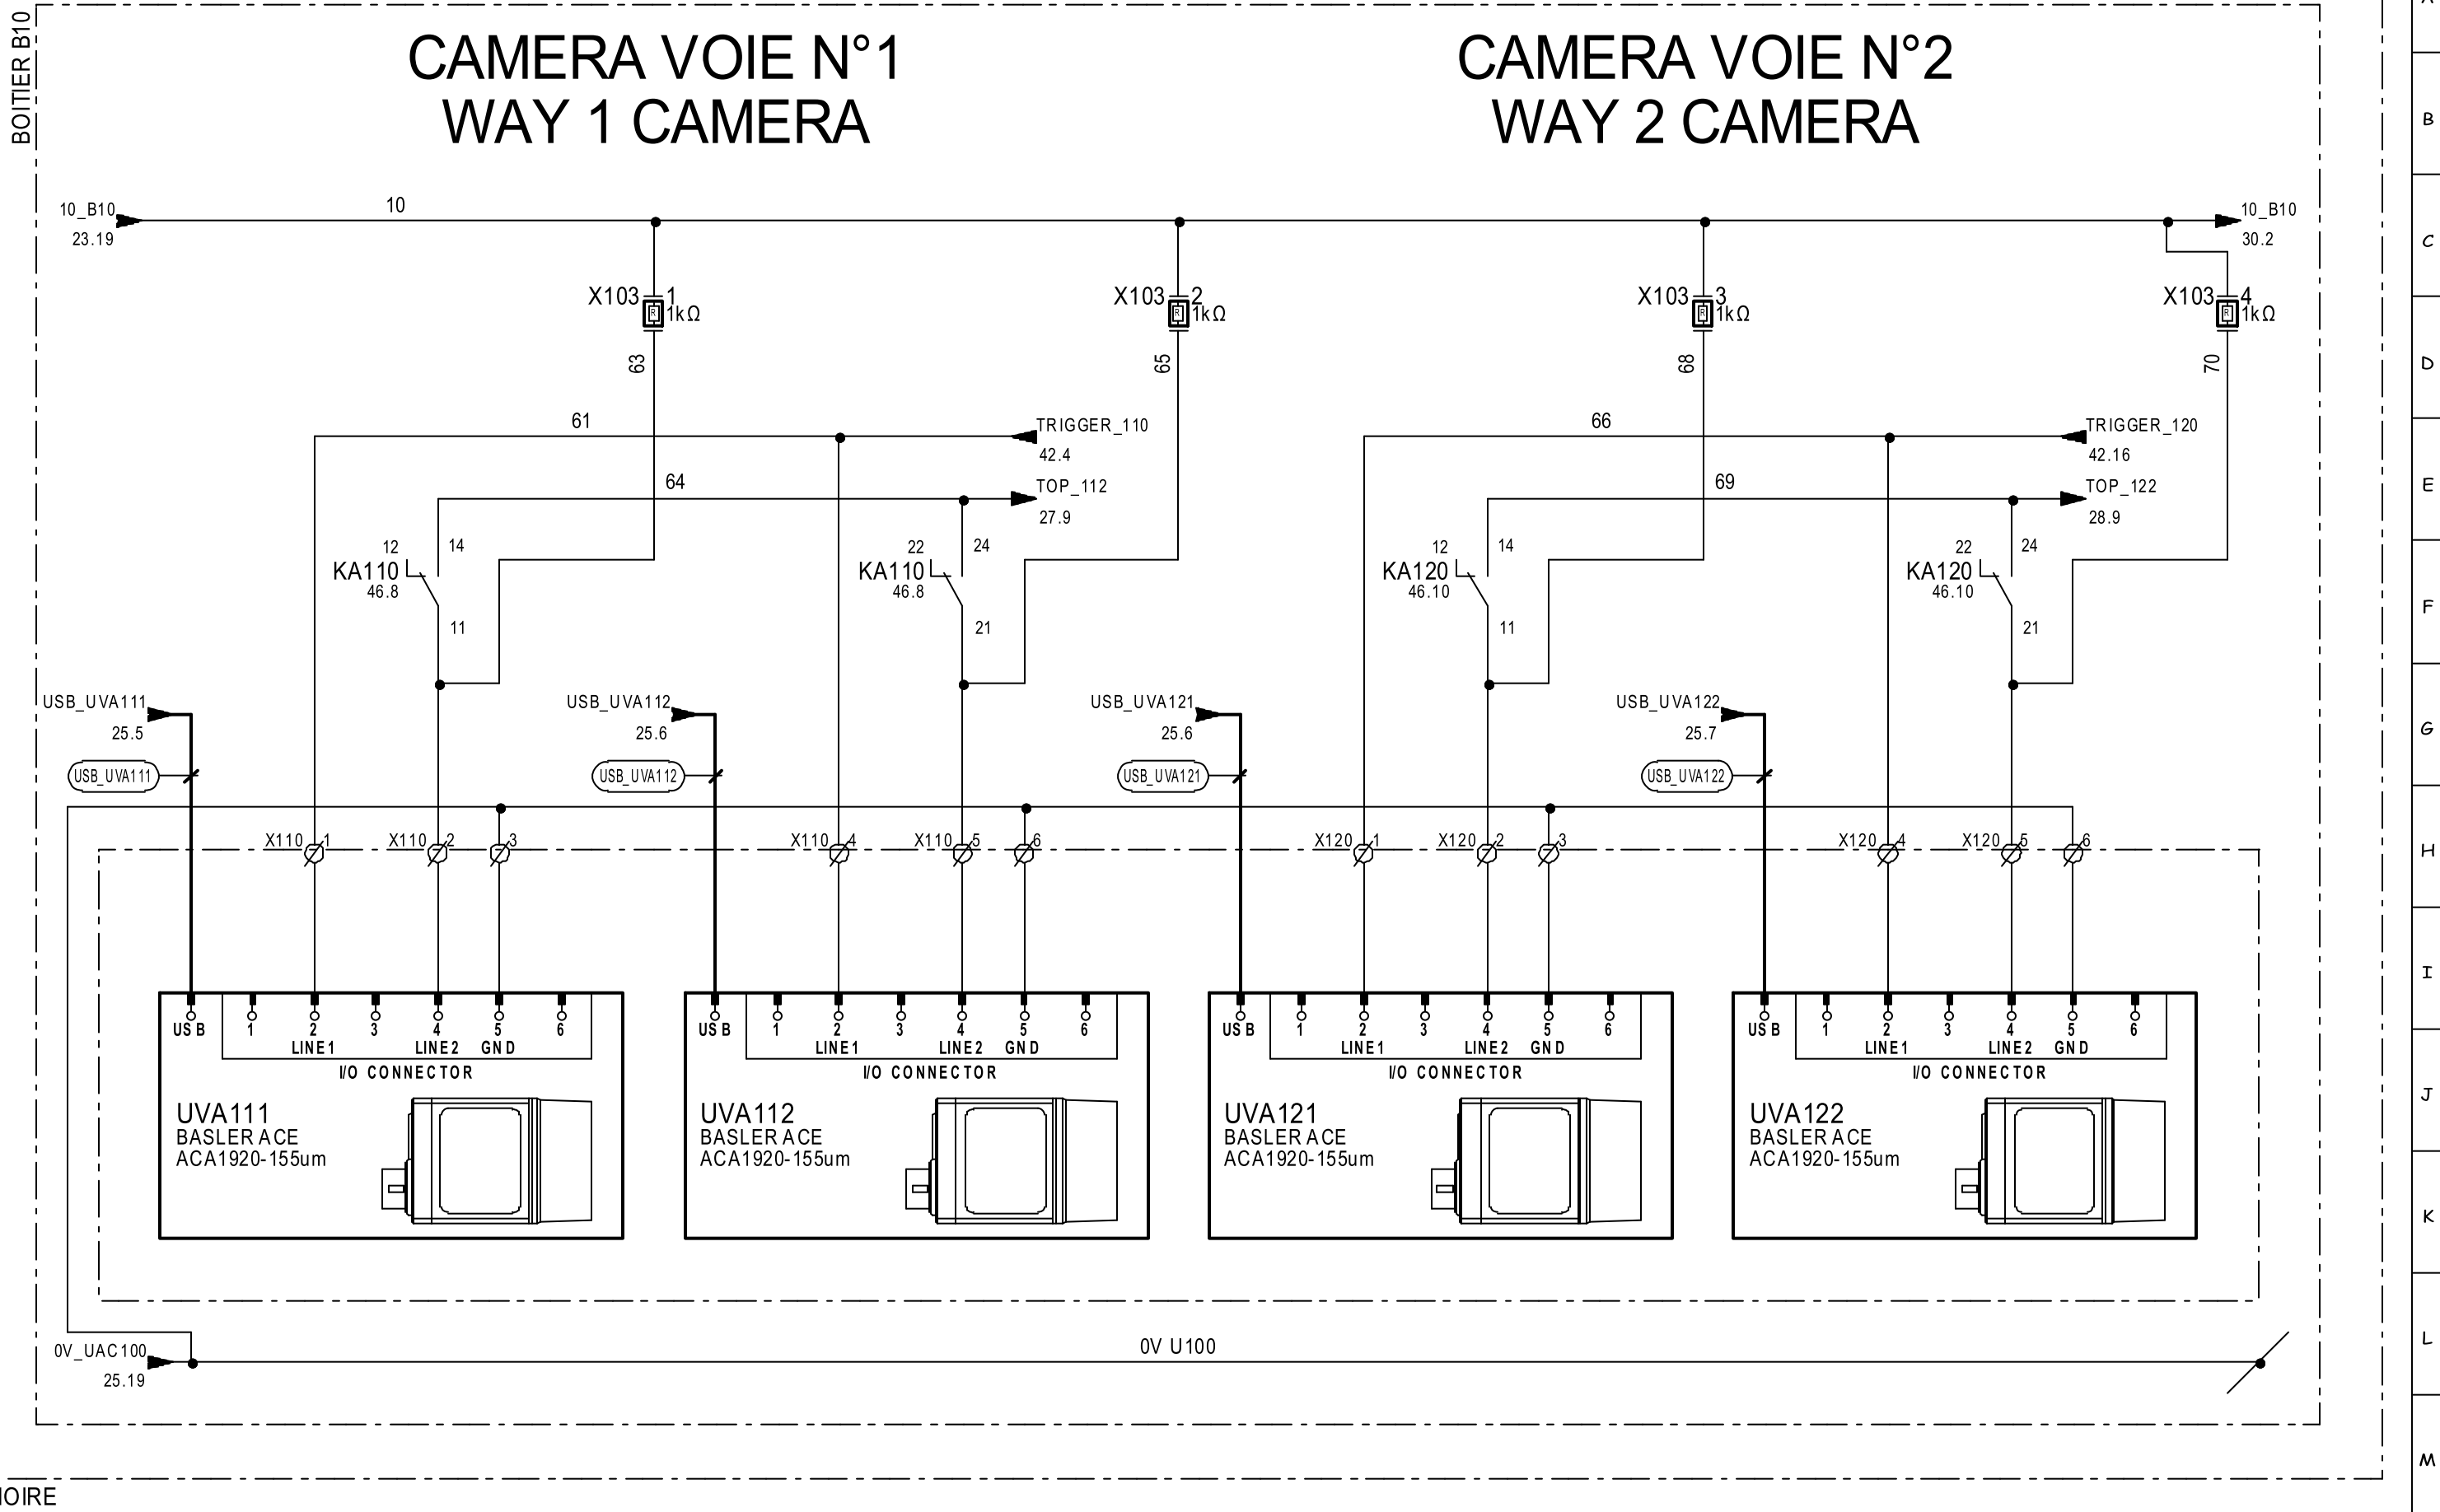


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION CAMERA VOIE 1 & 2				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 1 & 2 CAMERA LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 26/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

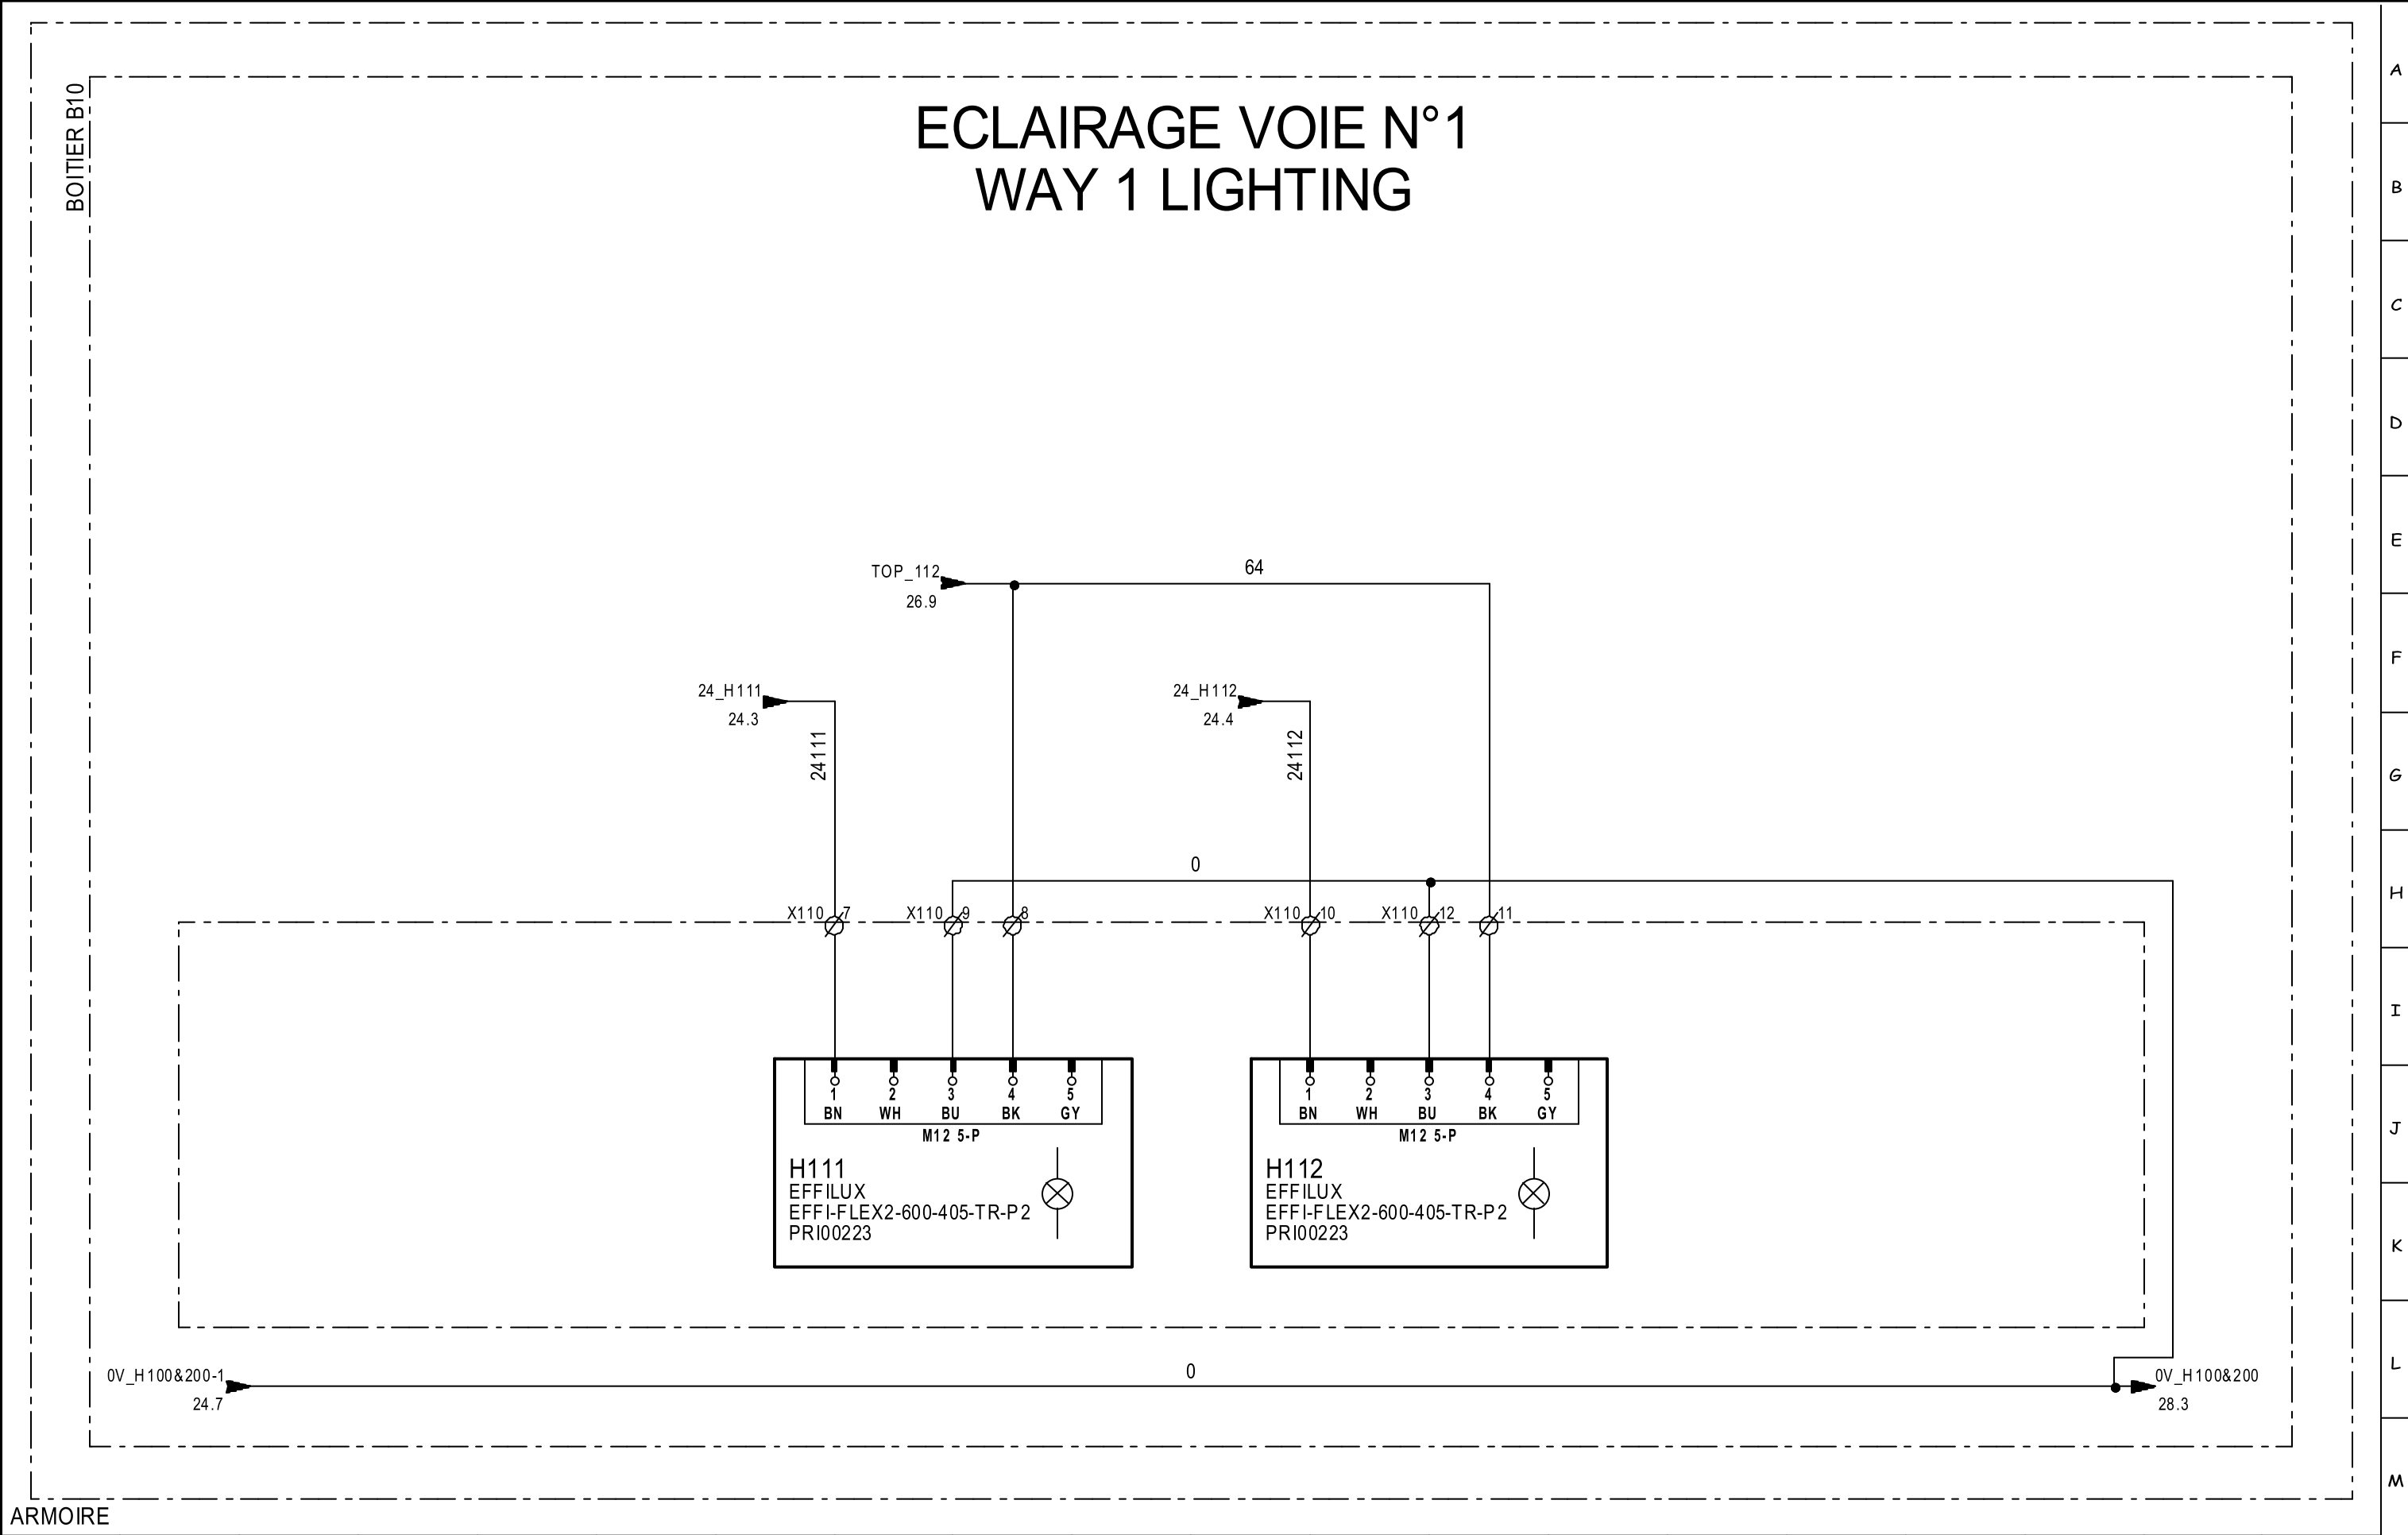


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION ECLAIRAGE VOIE 1				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 1 LIGHTING LAY OUT								ARTICLE :		INDEX : V6			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 27/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

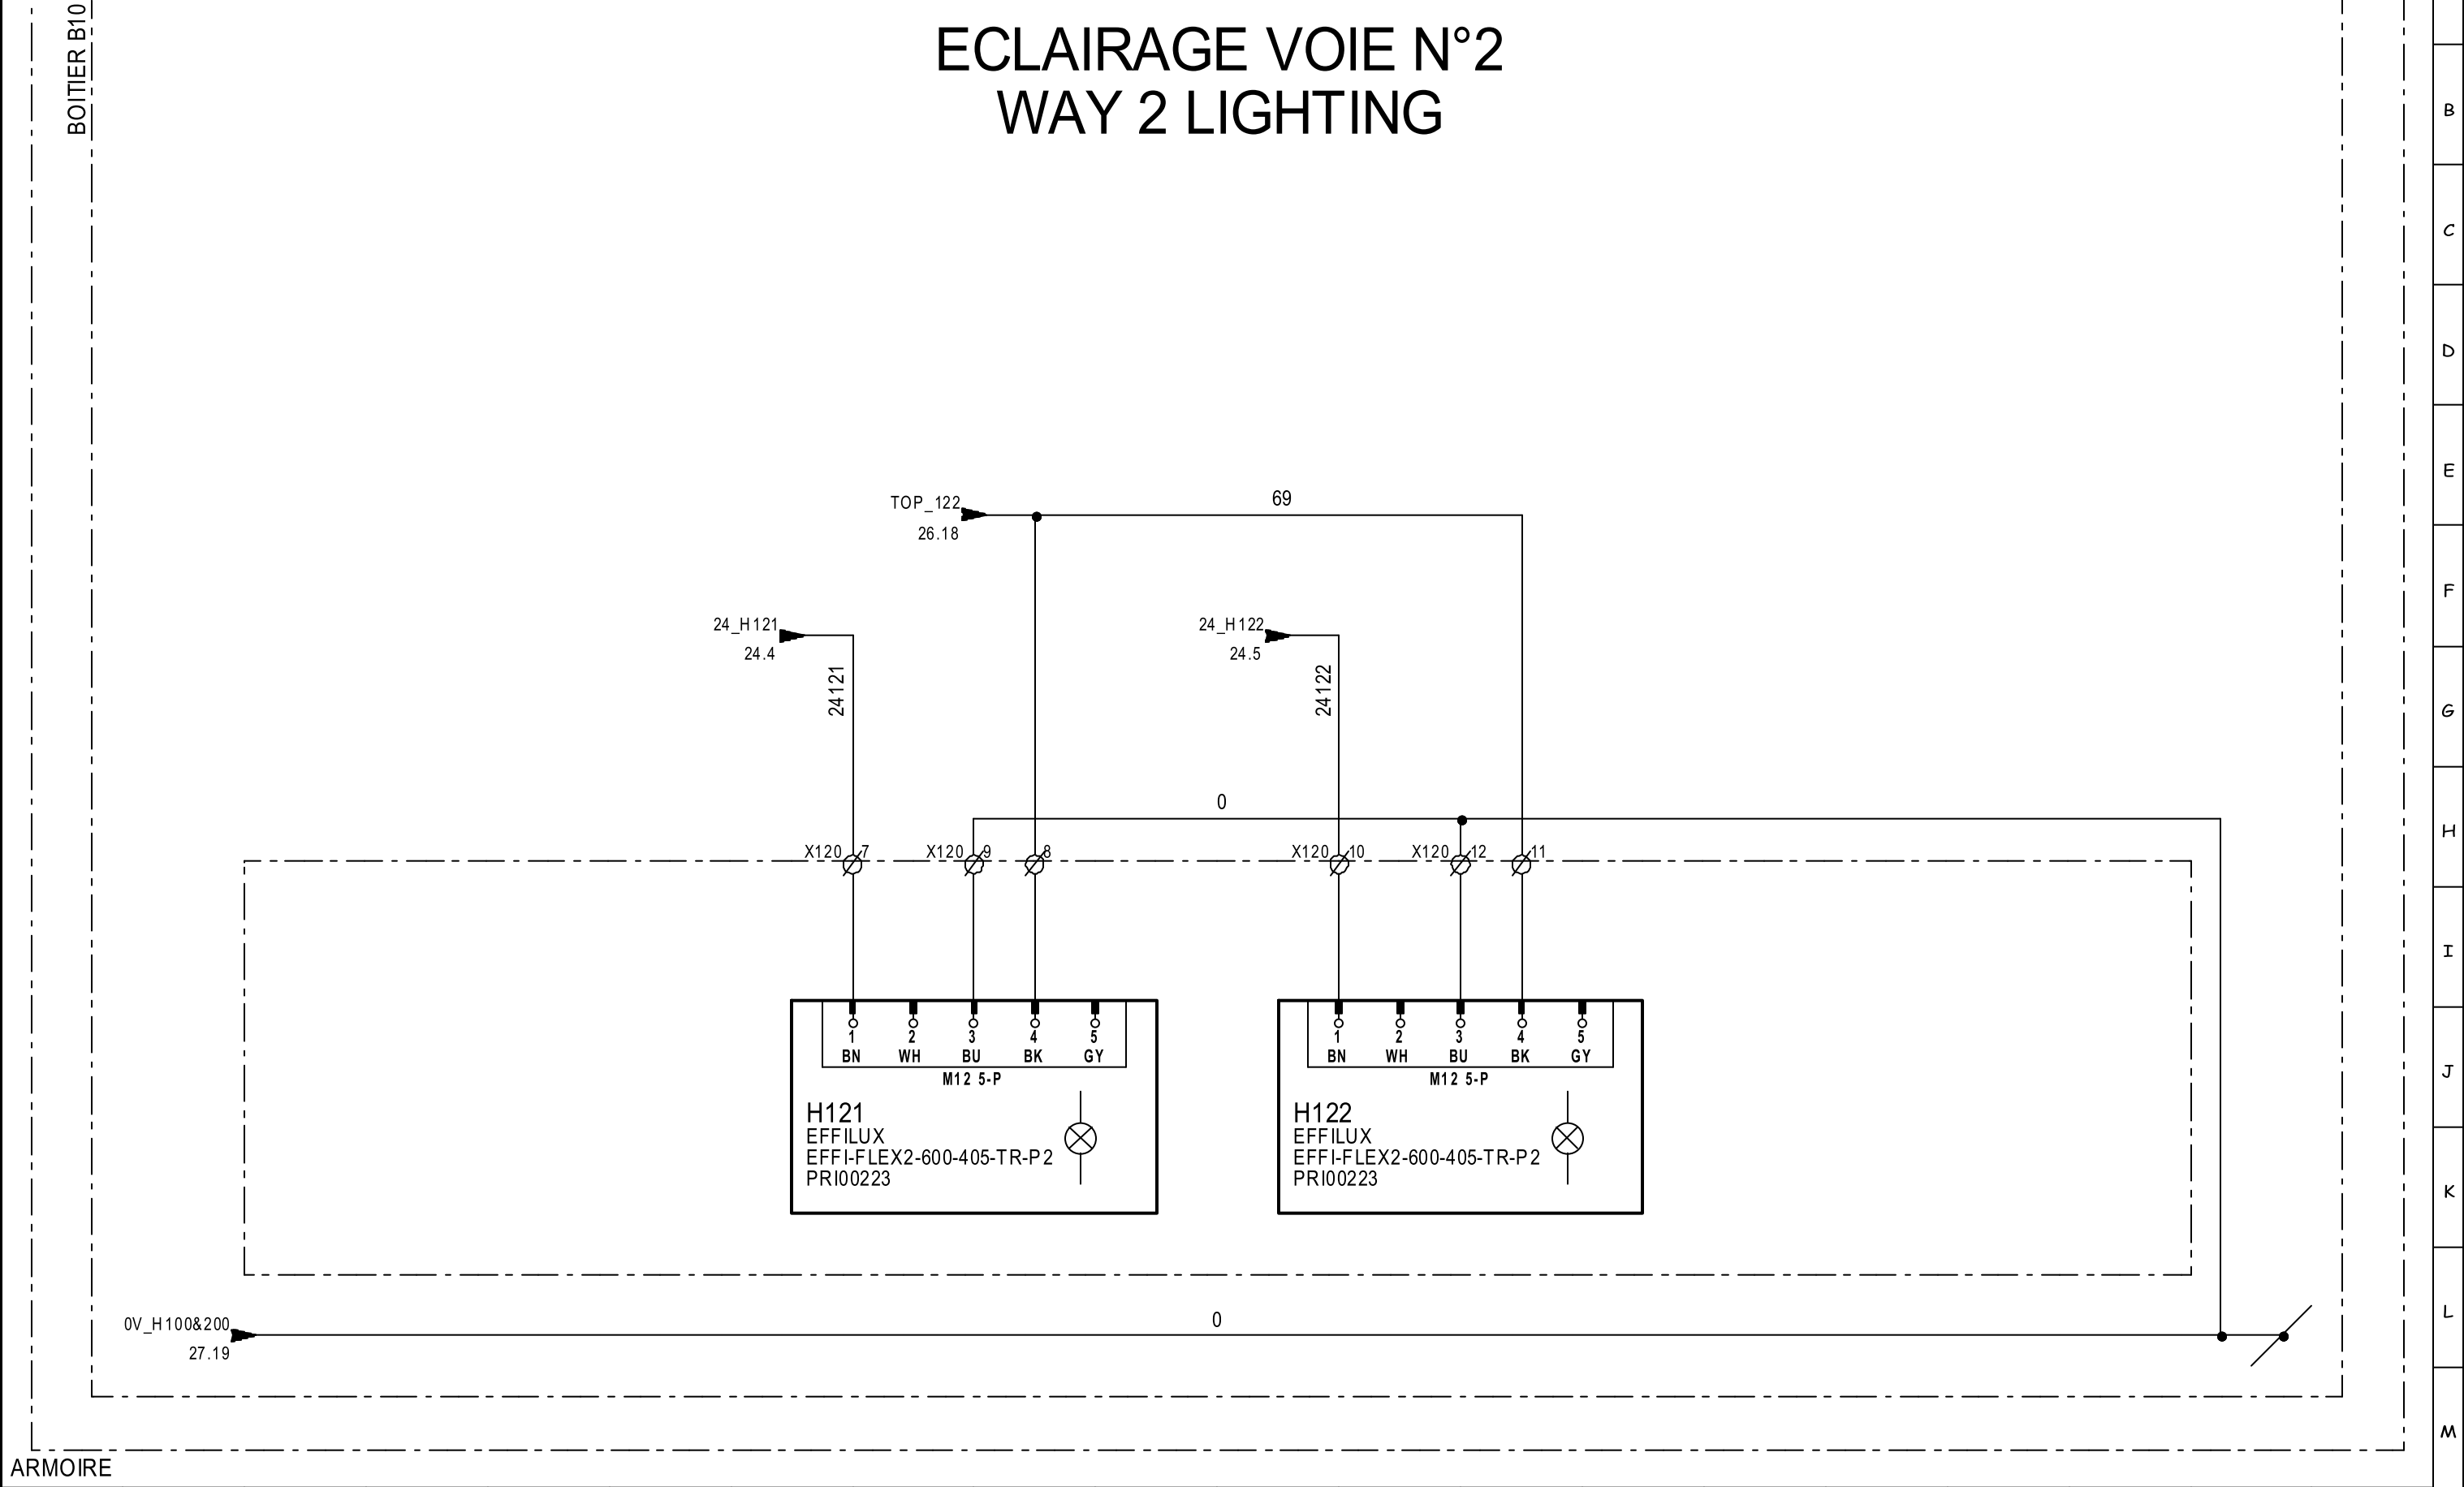

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION ECLAIRAGE VOIE 2				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 2 LIGHTING LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 28/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

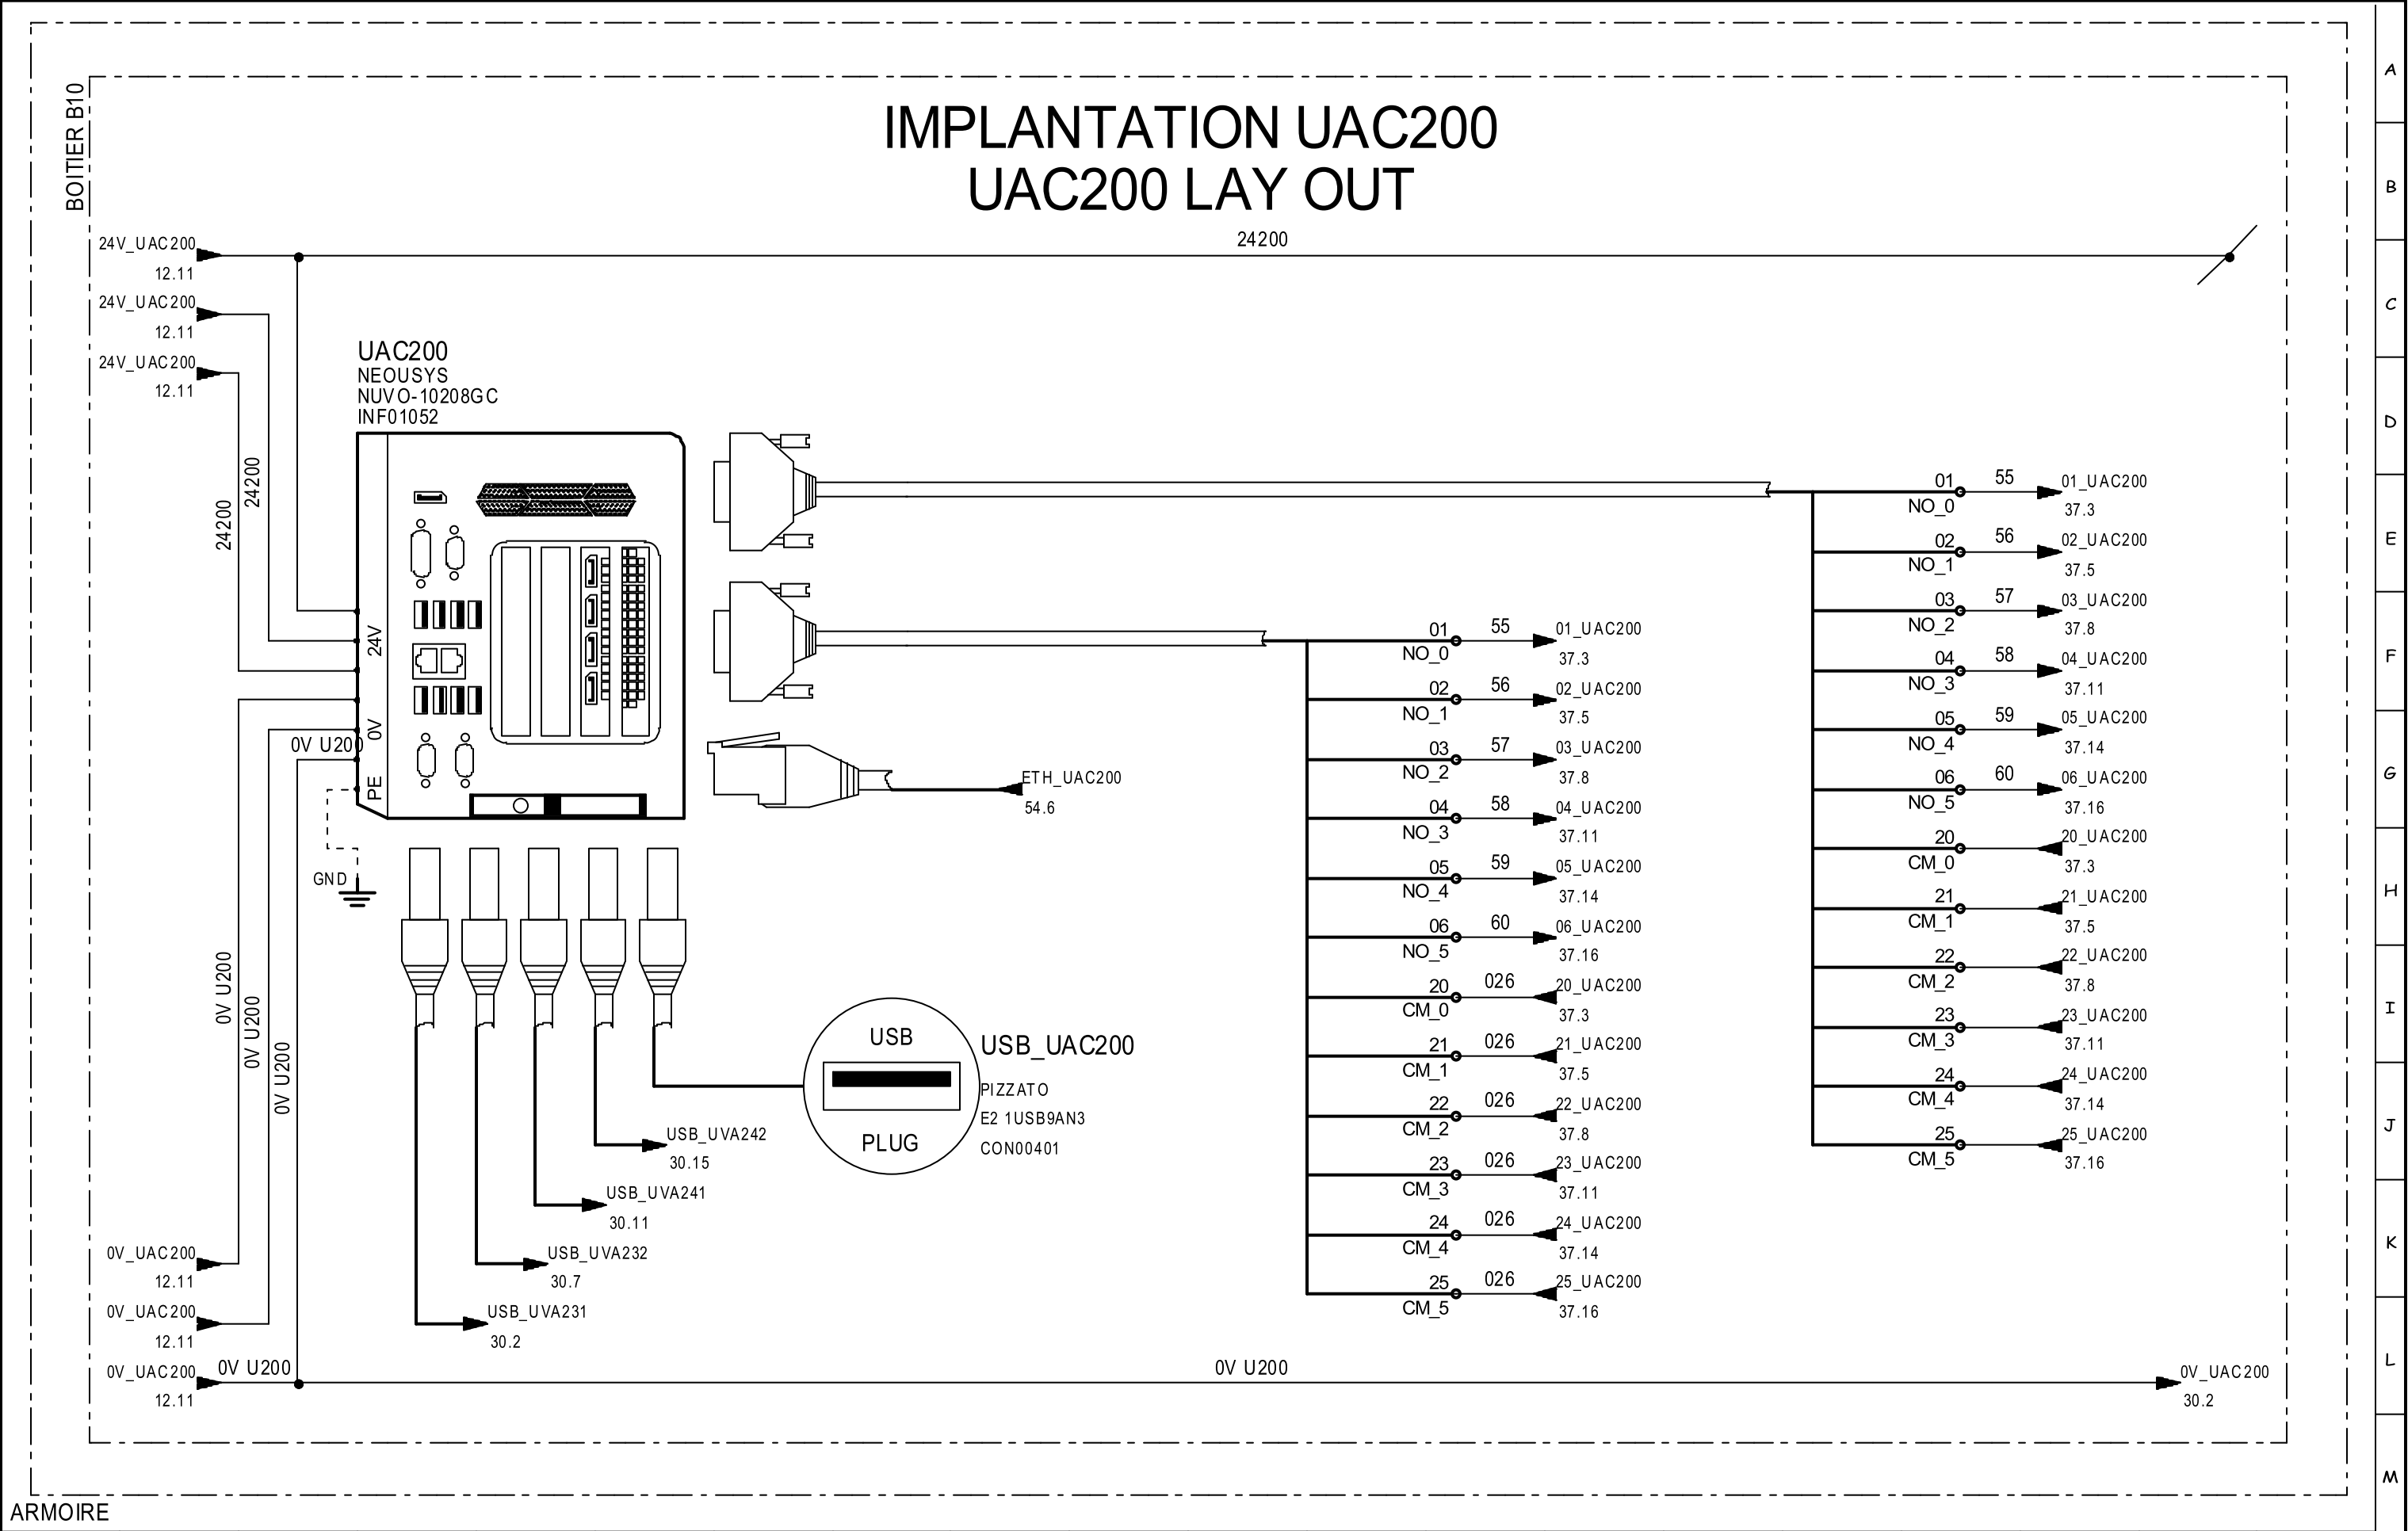


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION UAC200				 Ecat-iD Campus			CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		UAC200 LAY OUT							ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT :Version 4.49.F - 23/09/2020									FOLIO : 29/144			

VISION VOIE N°3 WAY 3 VISION


VISION VOIE N°4 WAY 4 VISION

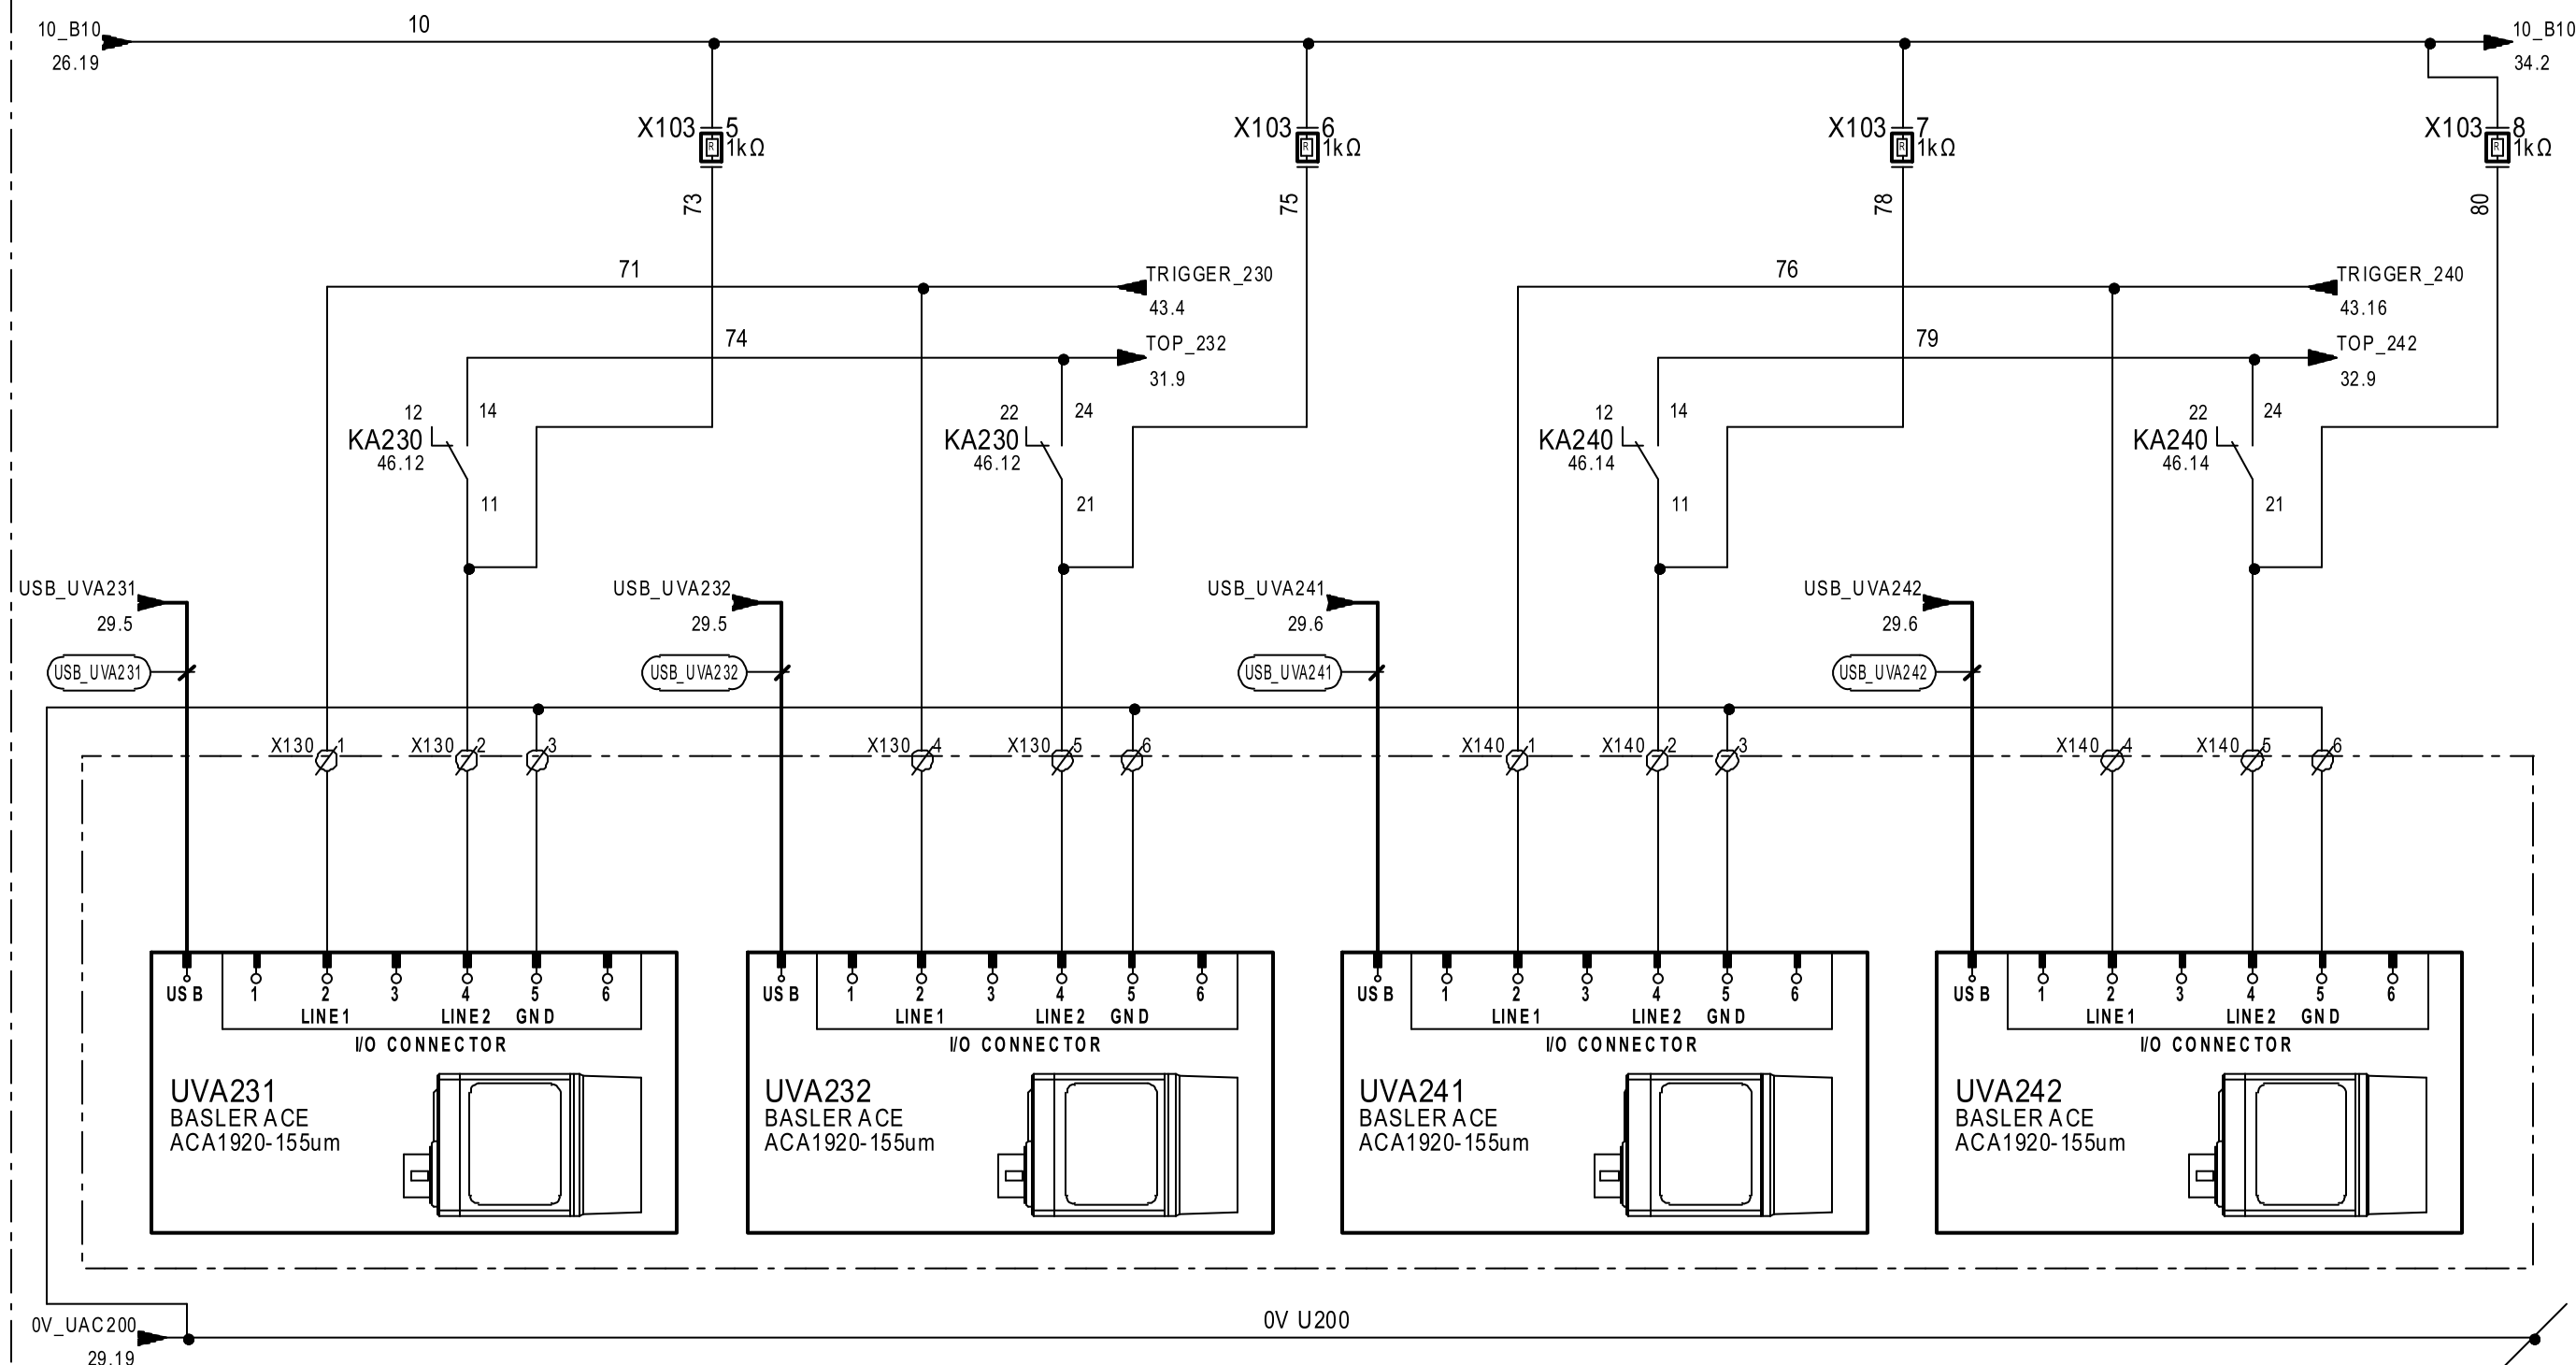

ARMOIRE


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION CAMERA VOIE 3 & 4				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 3 & 4 CAMERA LAY OUT								ARTICLE :		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT: Version 4.49.F - 23/09/2020				SMXA0002						FOLIO : 30/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

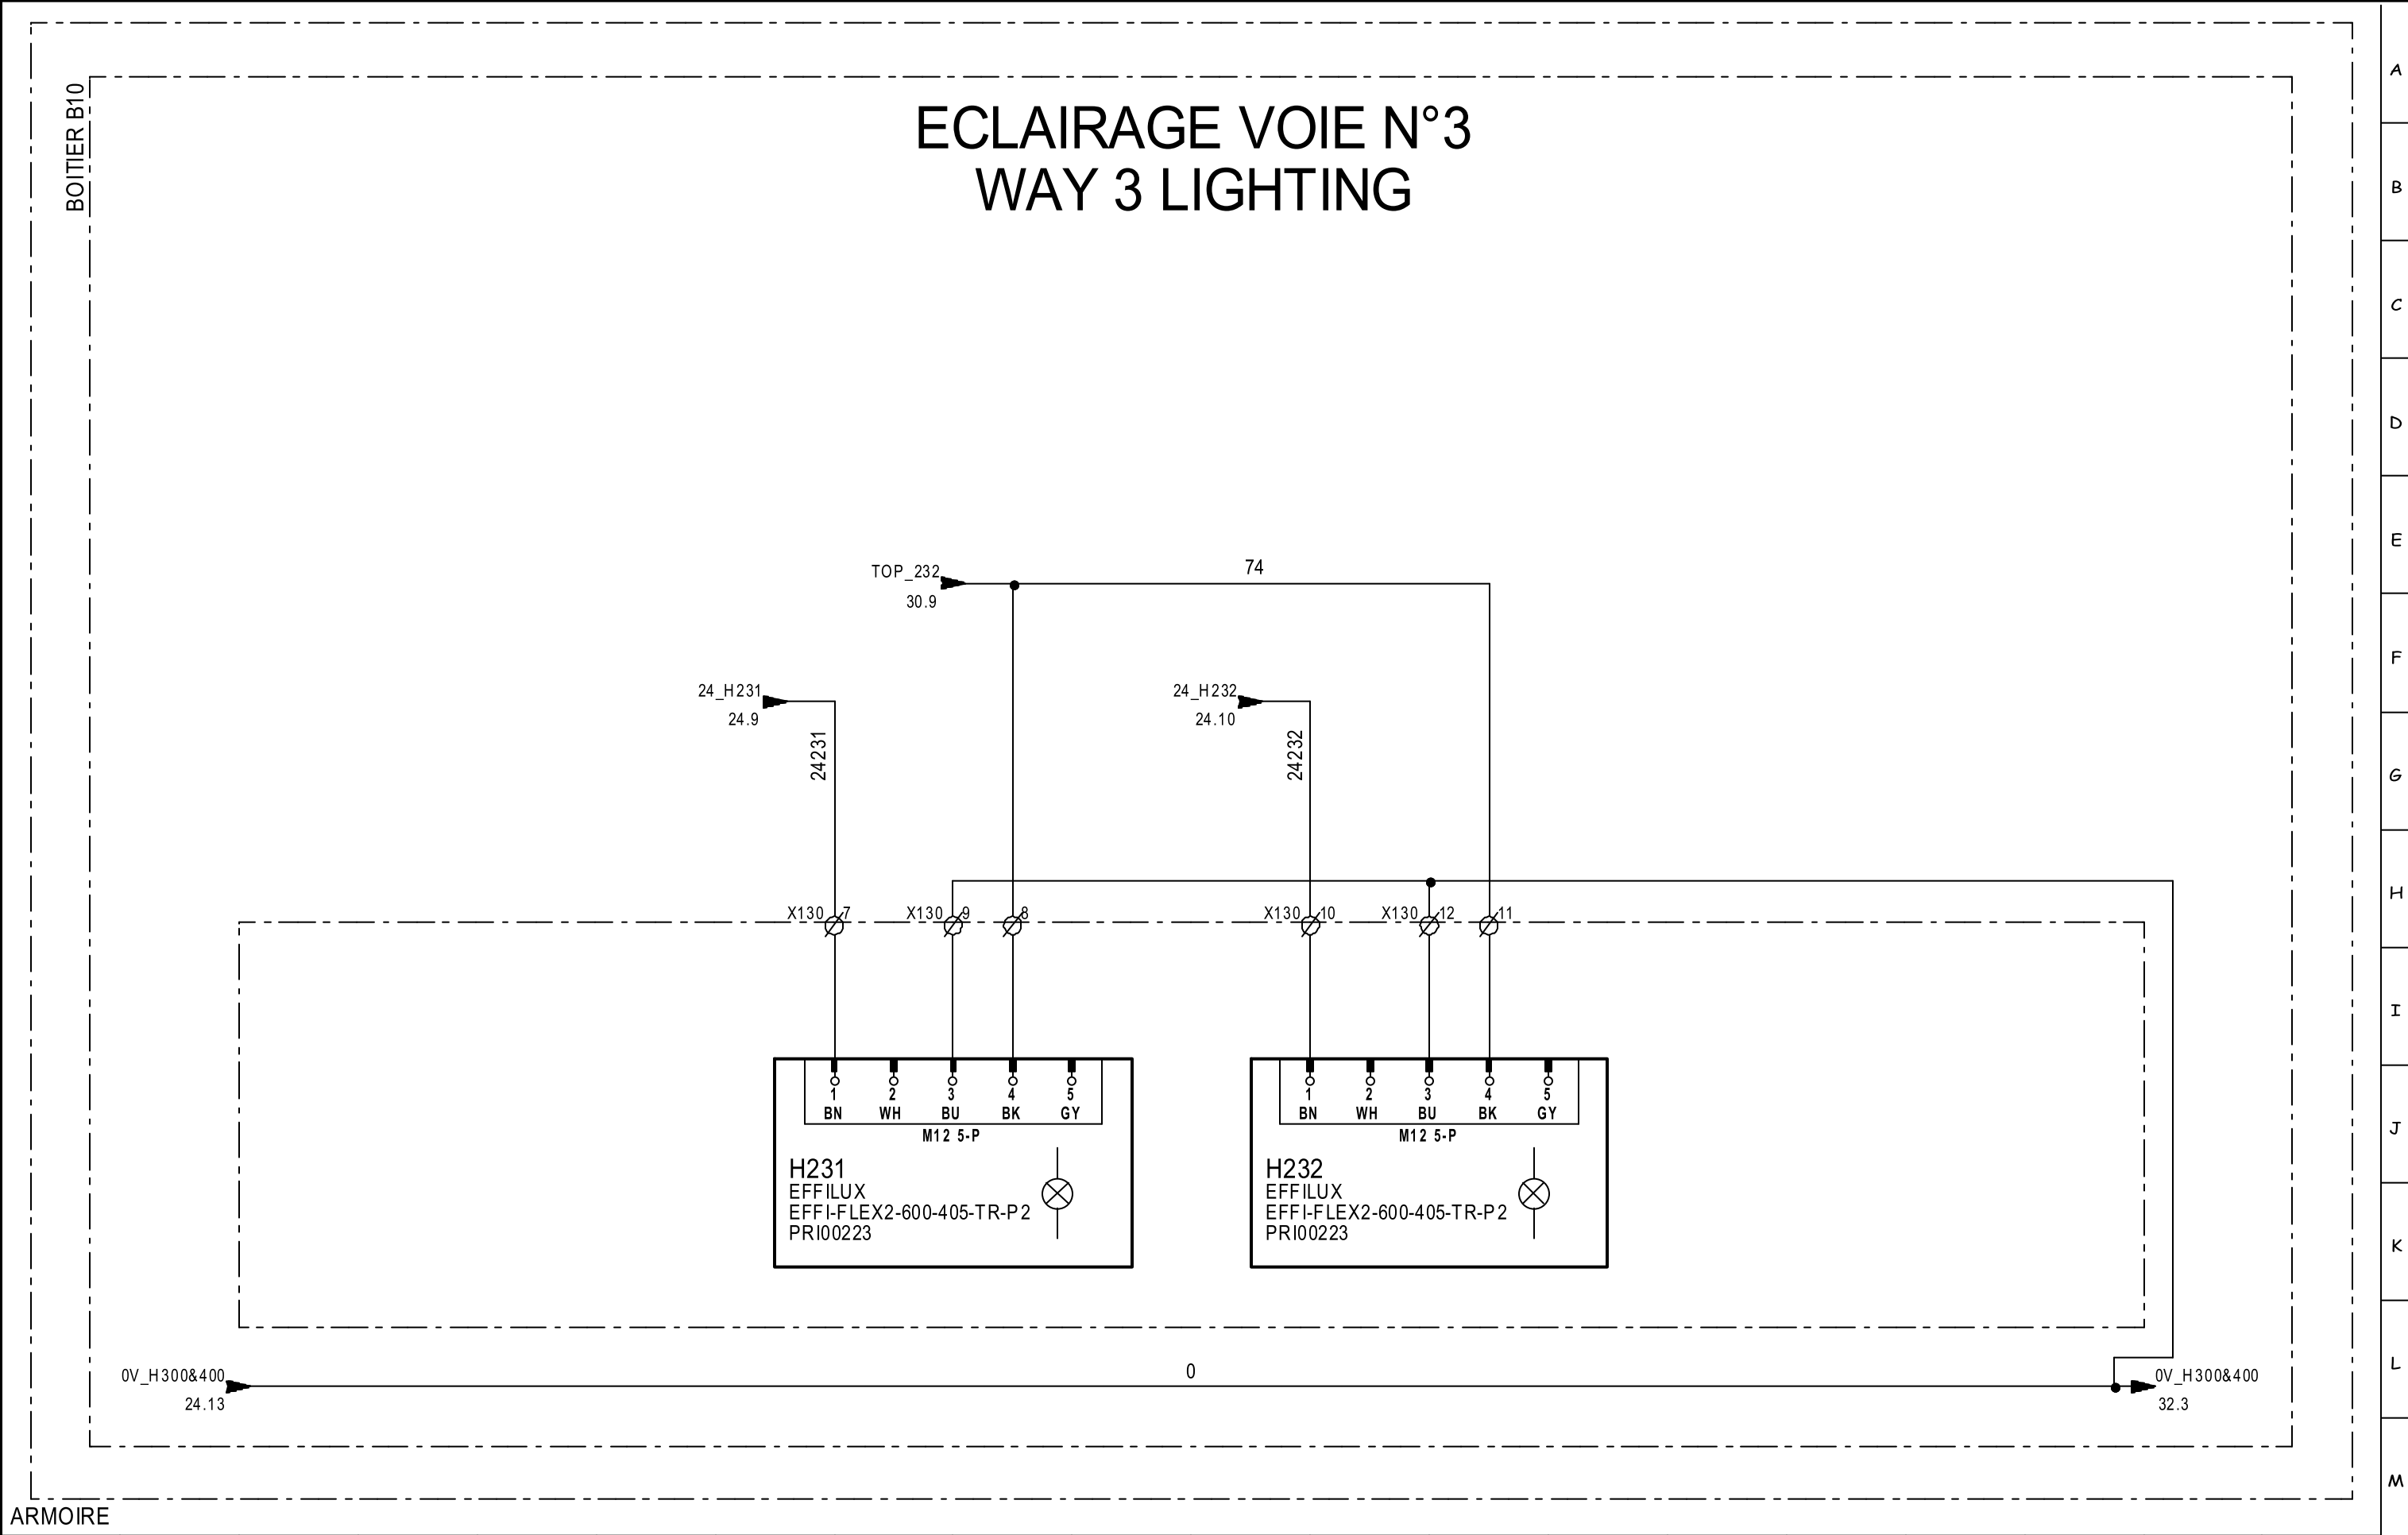


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		IMPLANTATION ECLAIRAGE VOIE 3				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		WAY 3 LIGHTING LAY OUT								ARTICLE :				INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 31/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

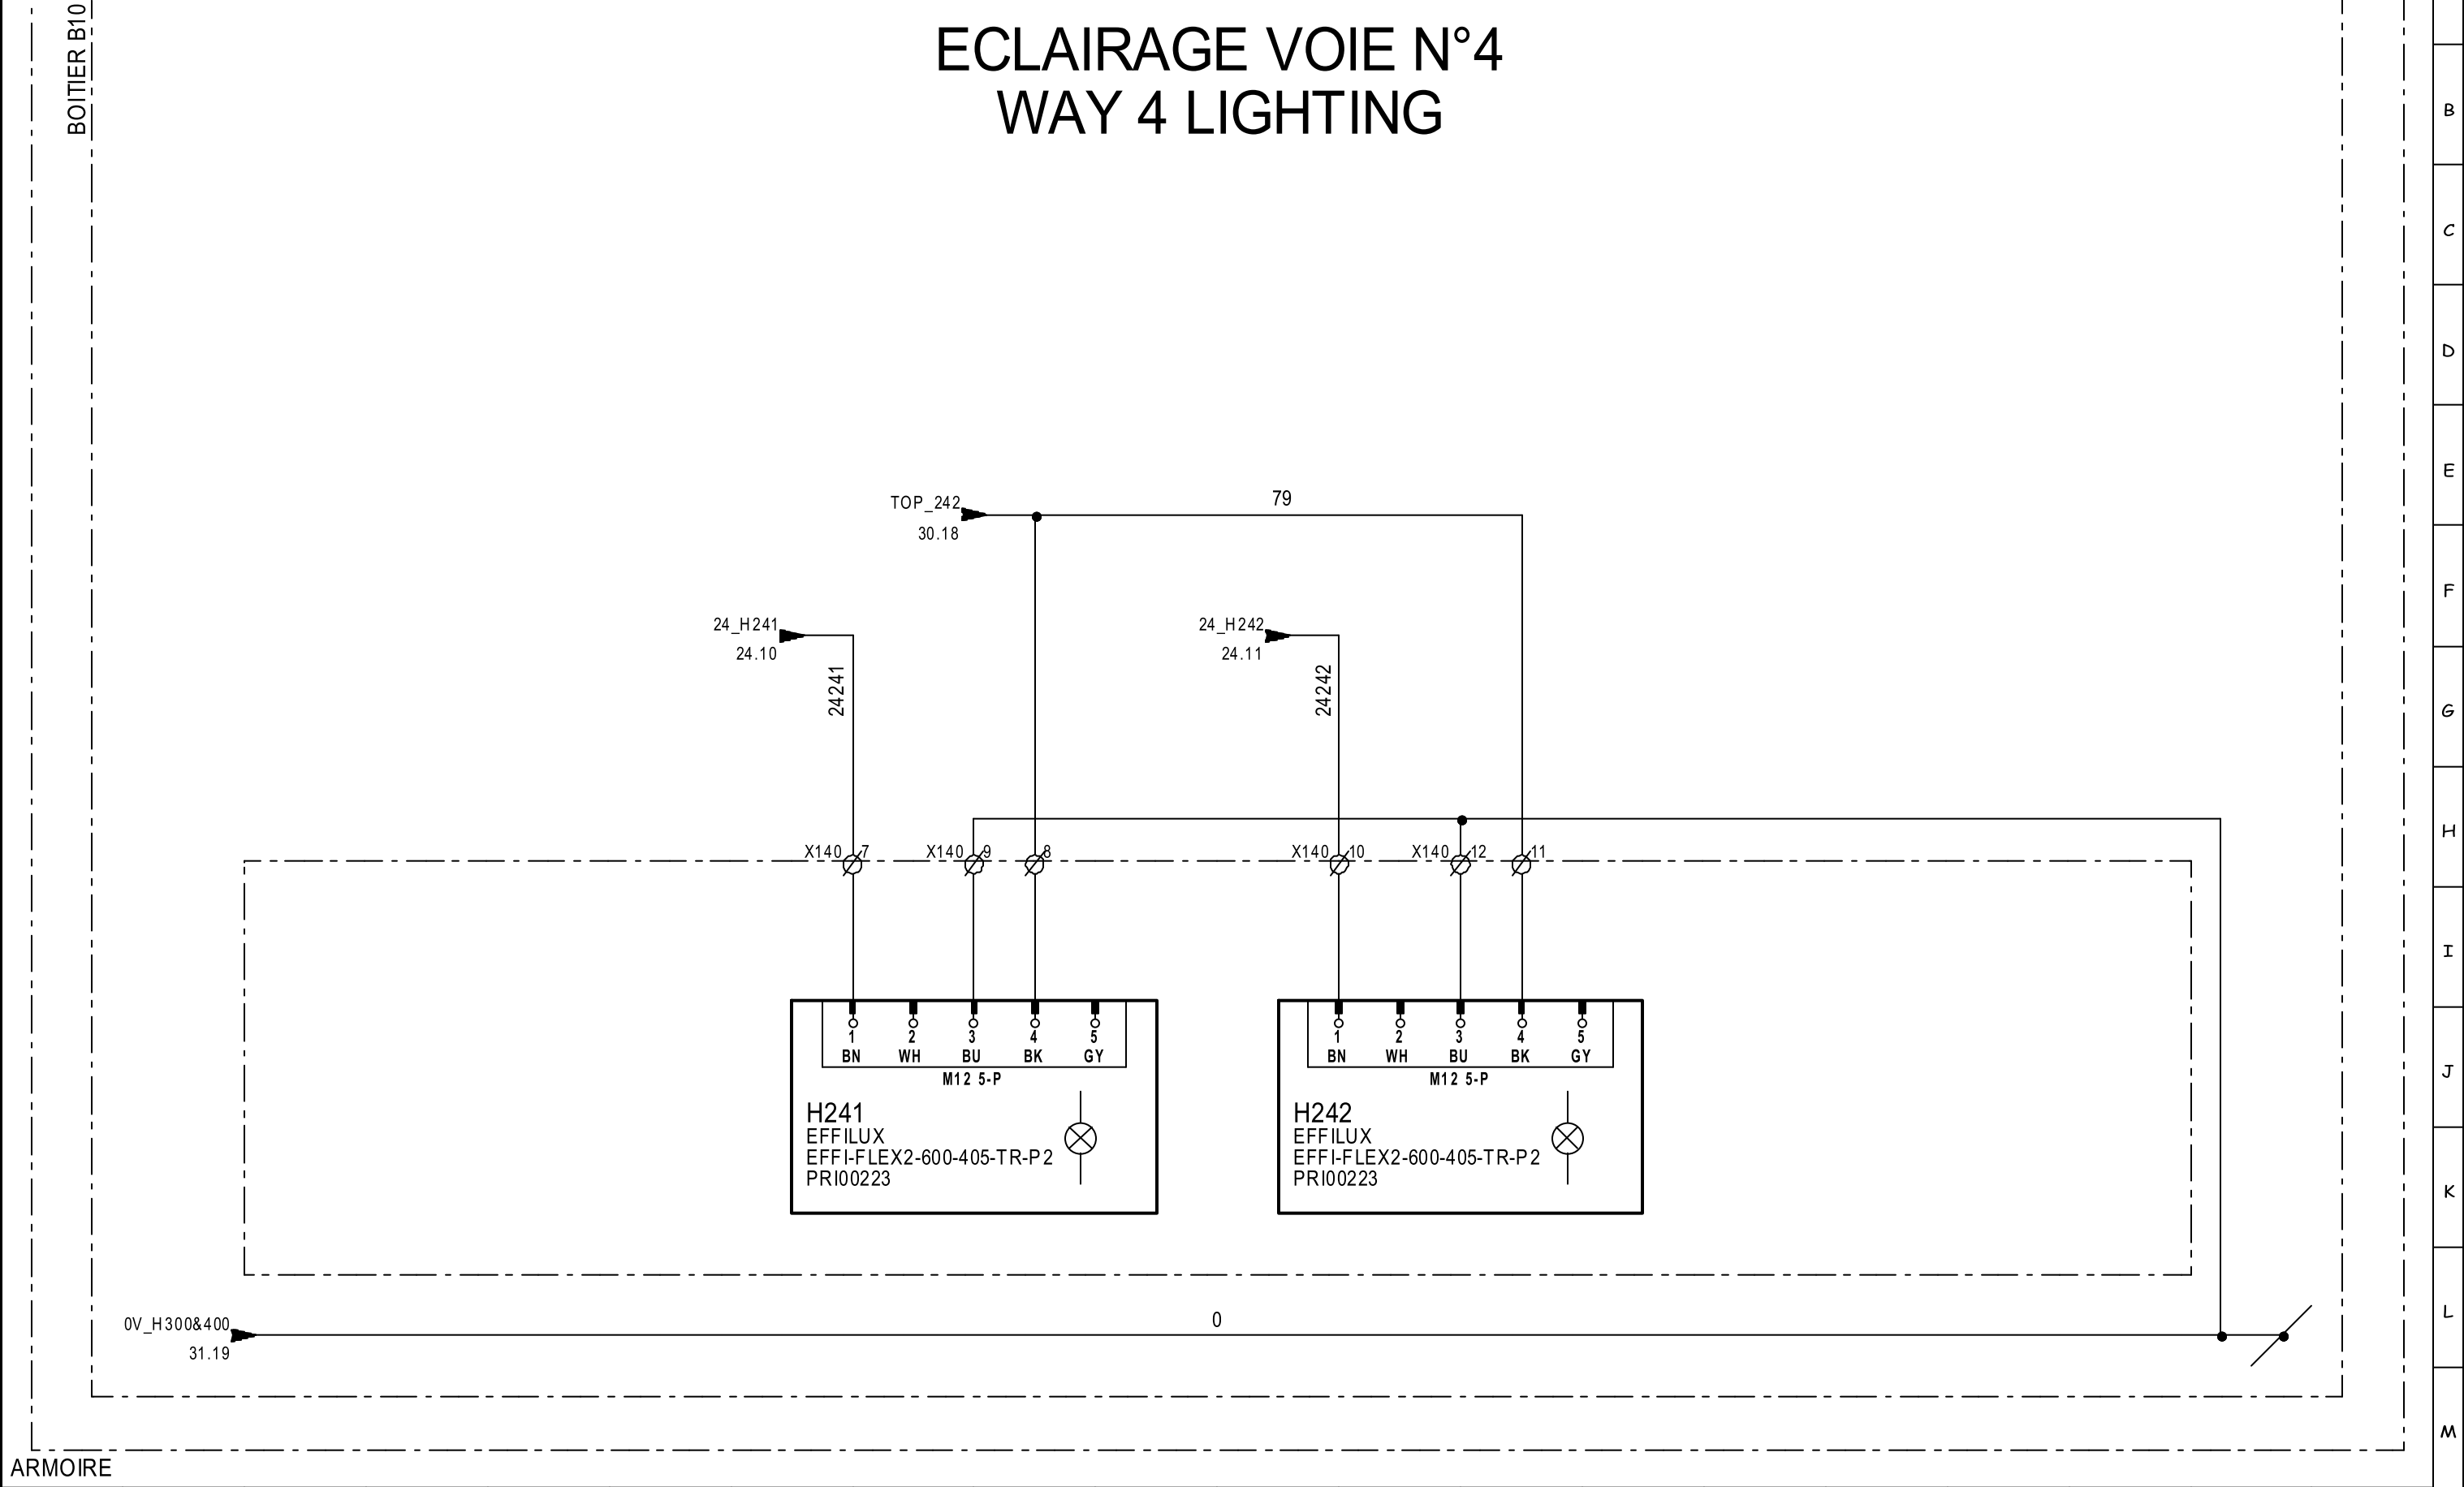

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION ECLAIRAGE VOIE 4				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 4 LIGHTING LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 32/144			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

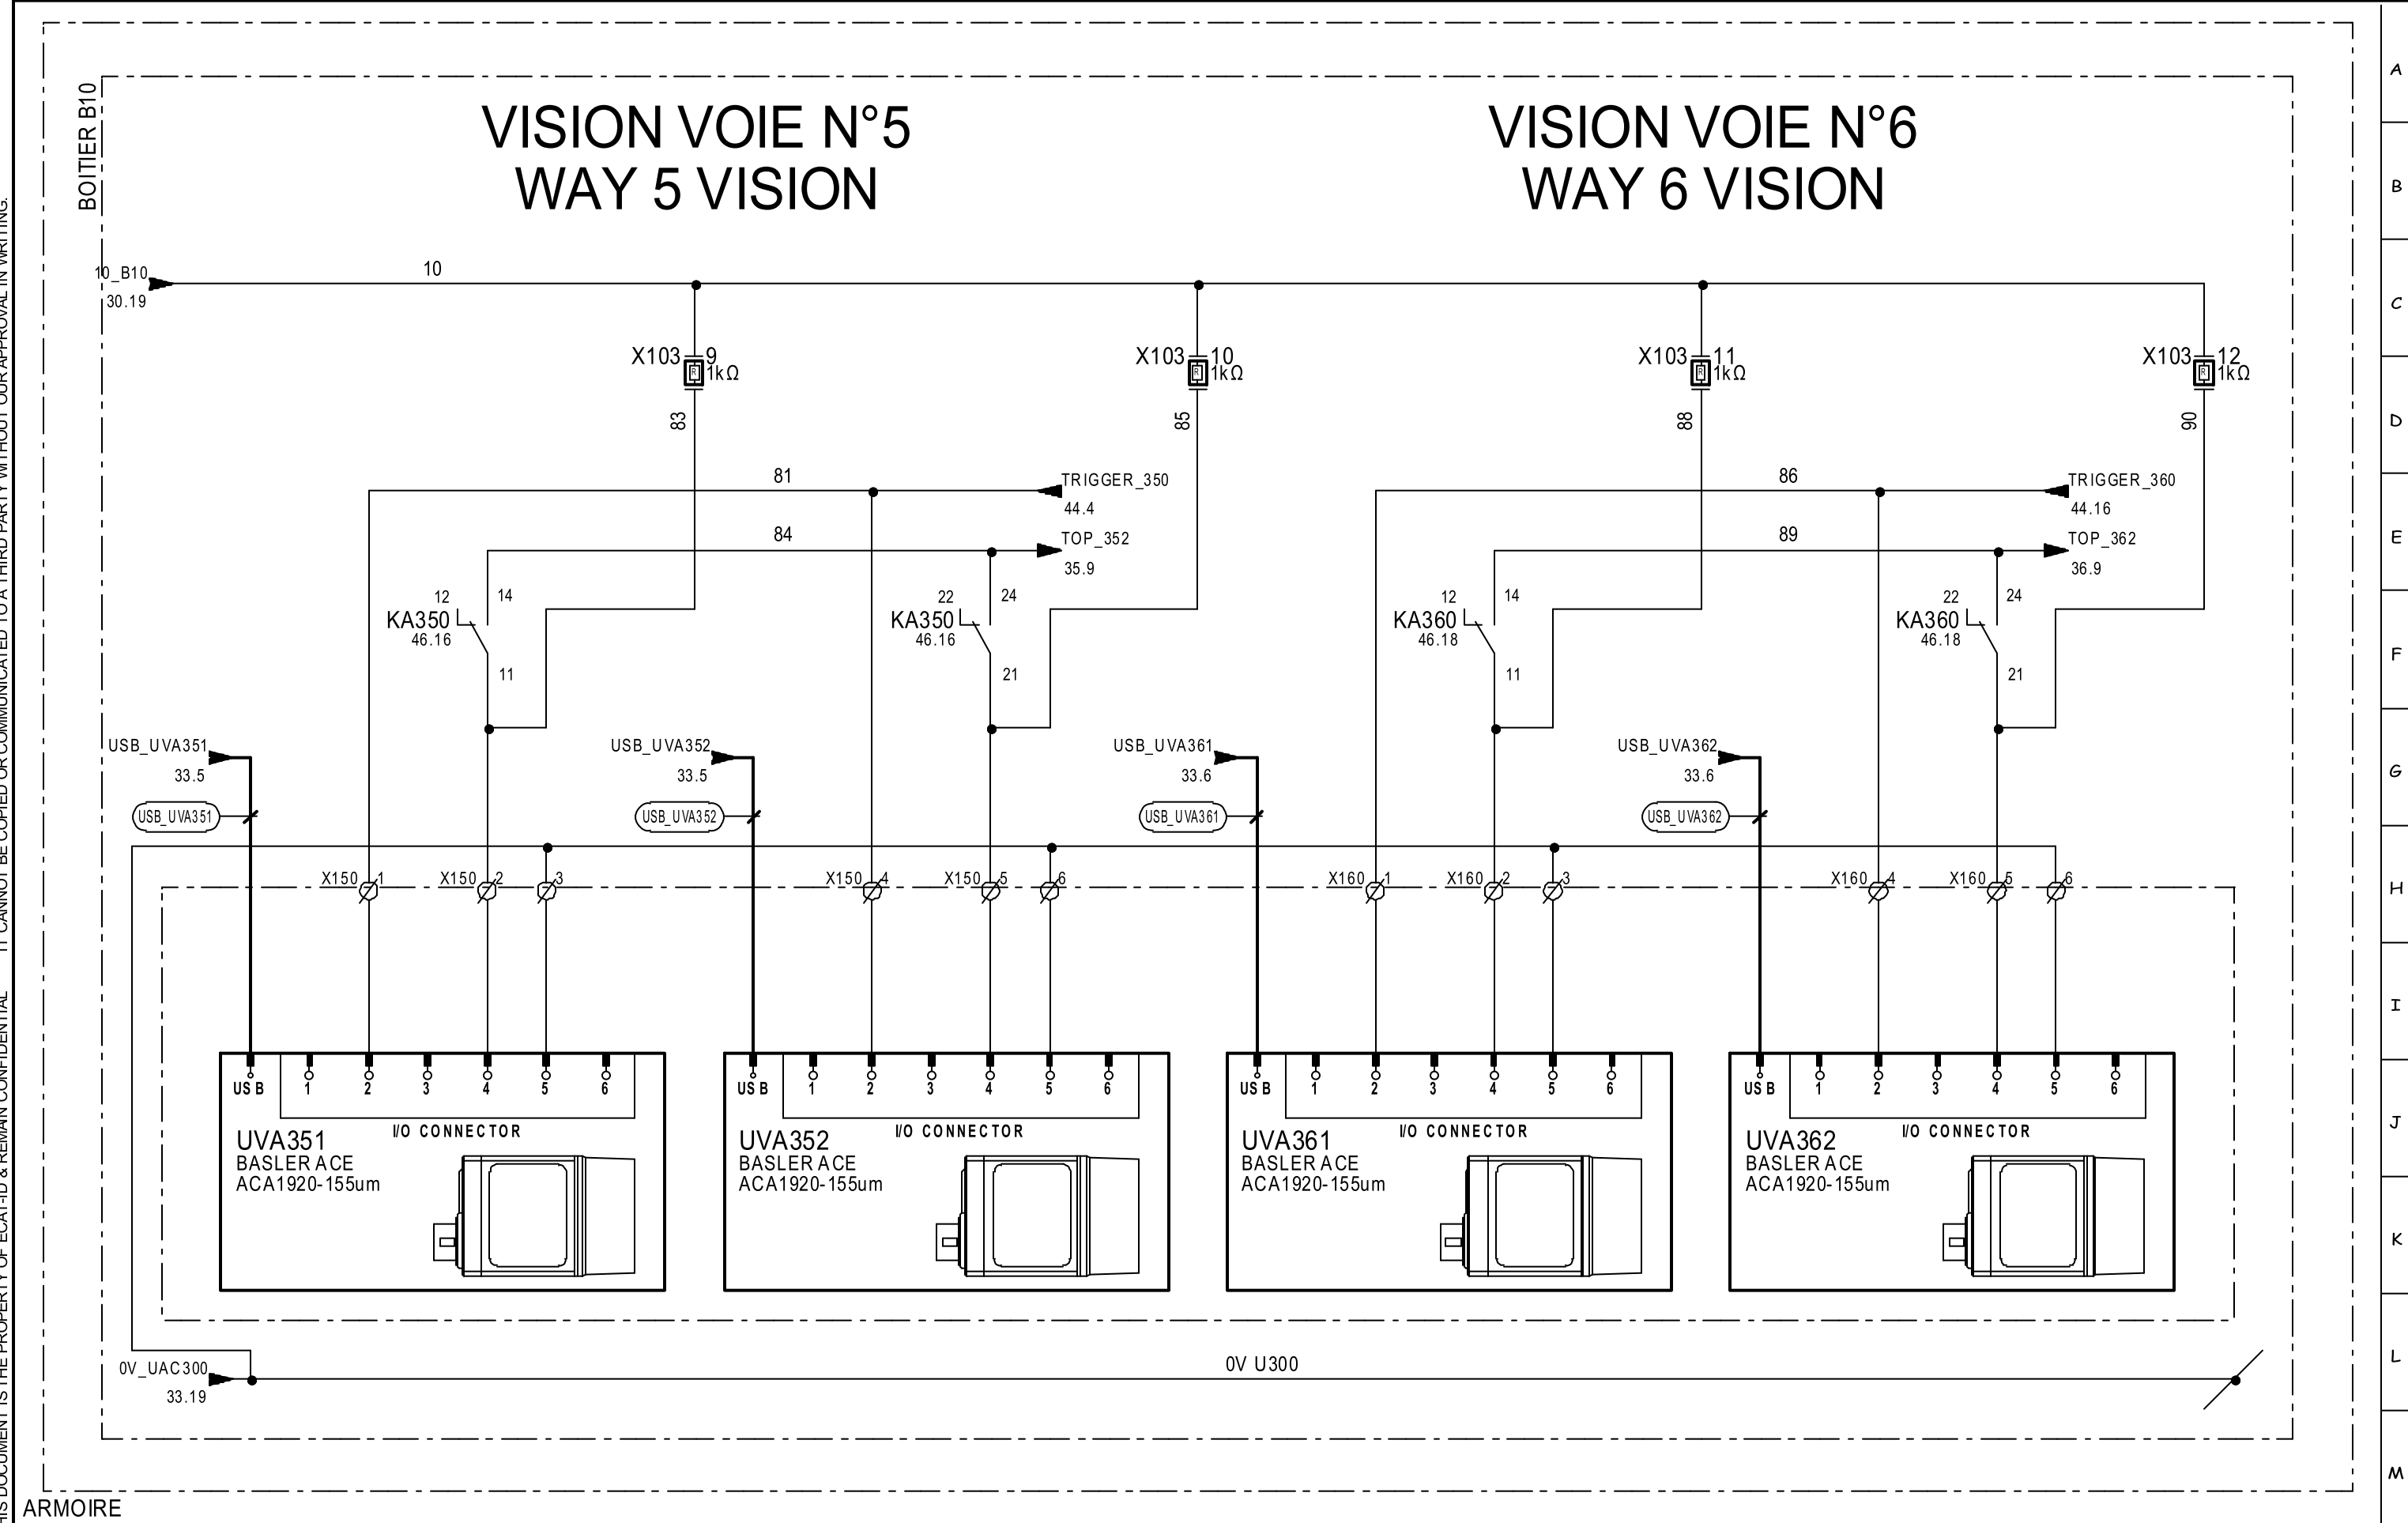

ARMOIRE


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION CAMERA VOIE 5 & 6				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 5 & 6 CAMERA LAY OUT								ARTICLE :		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 34/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

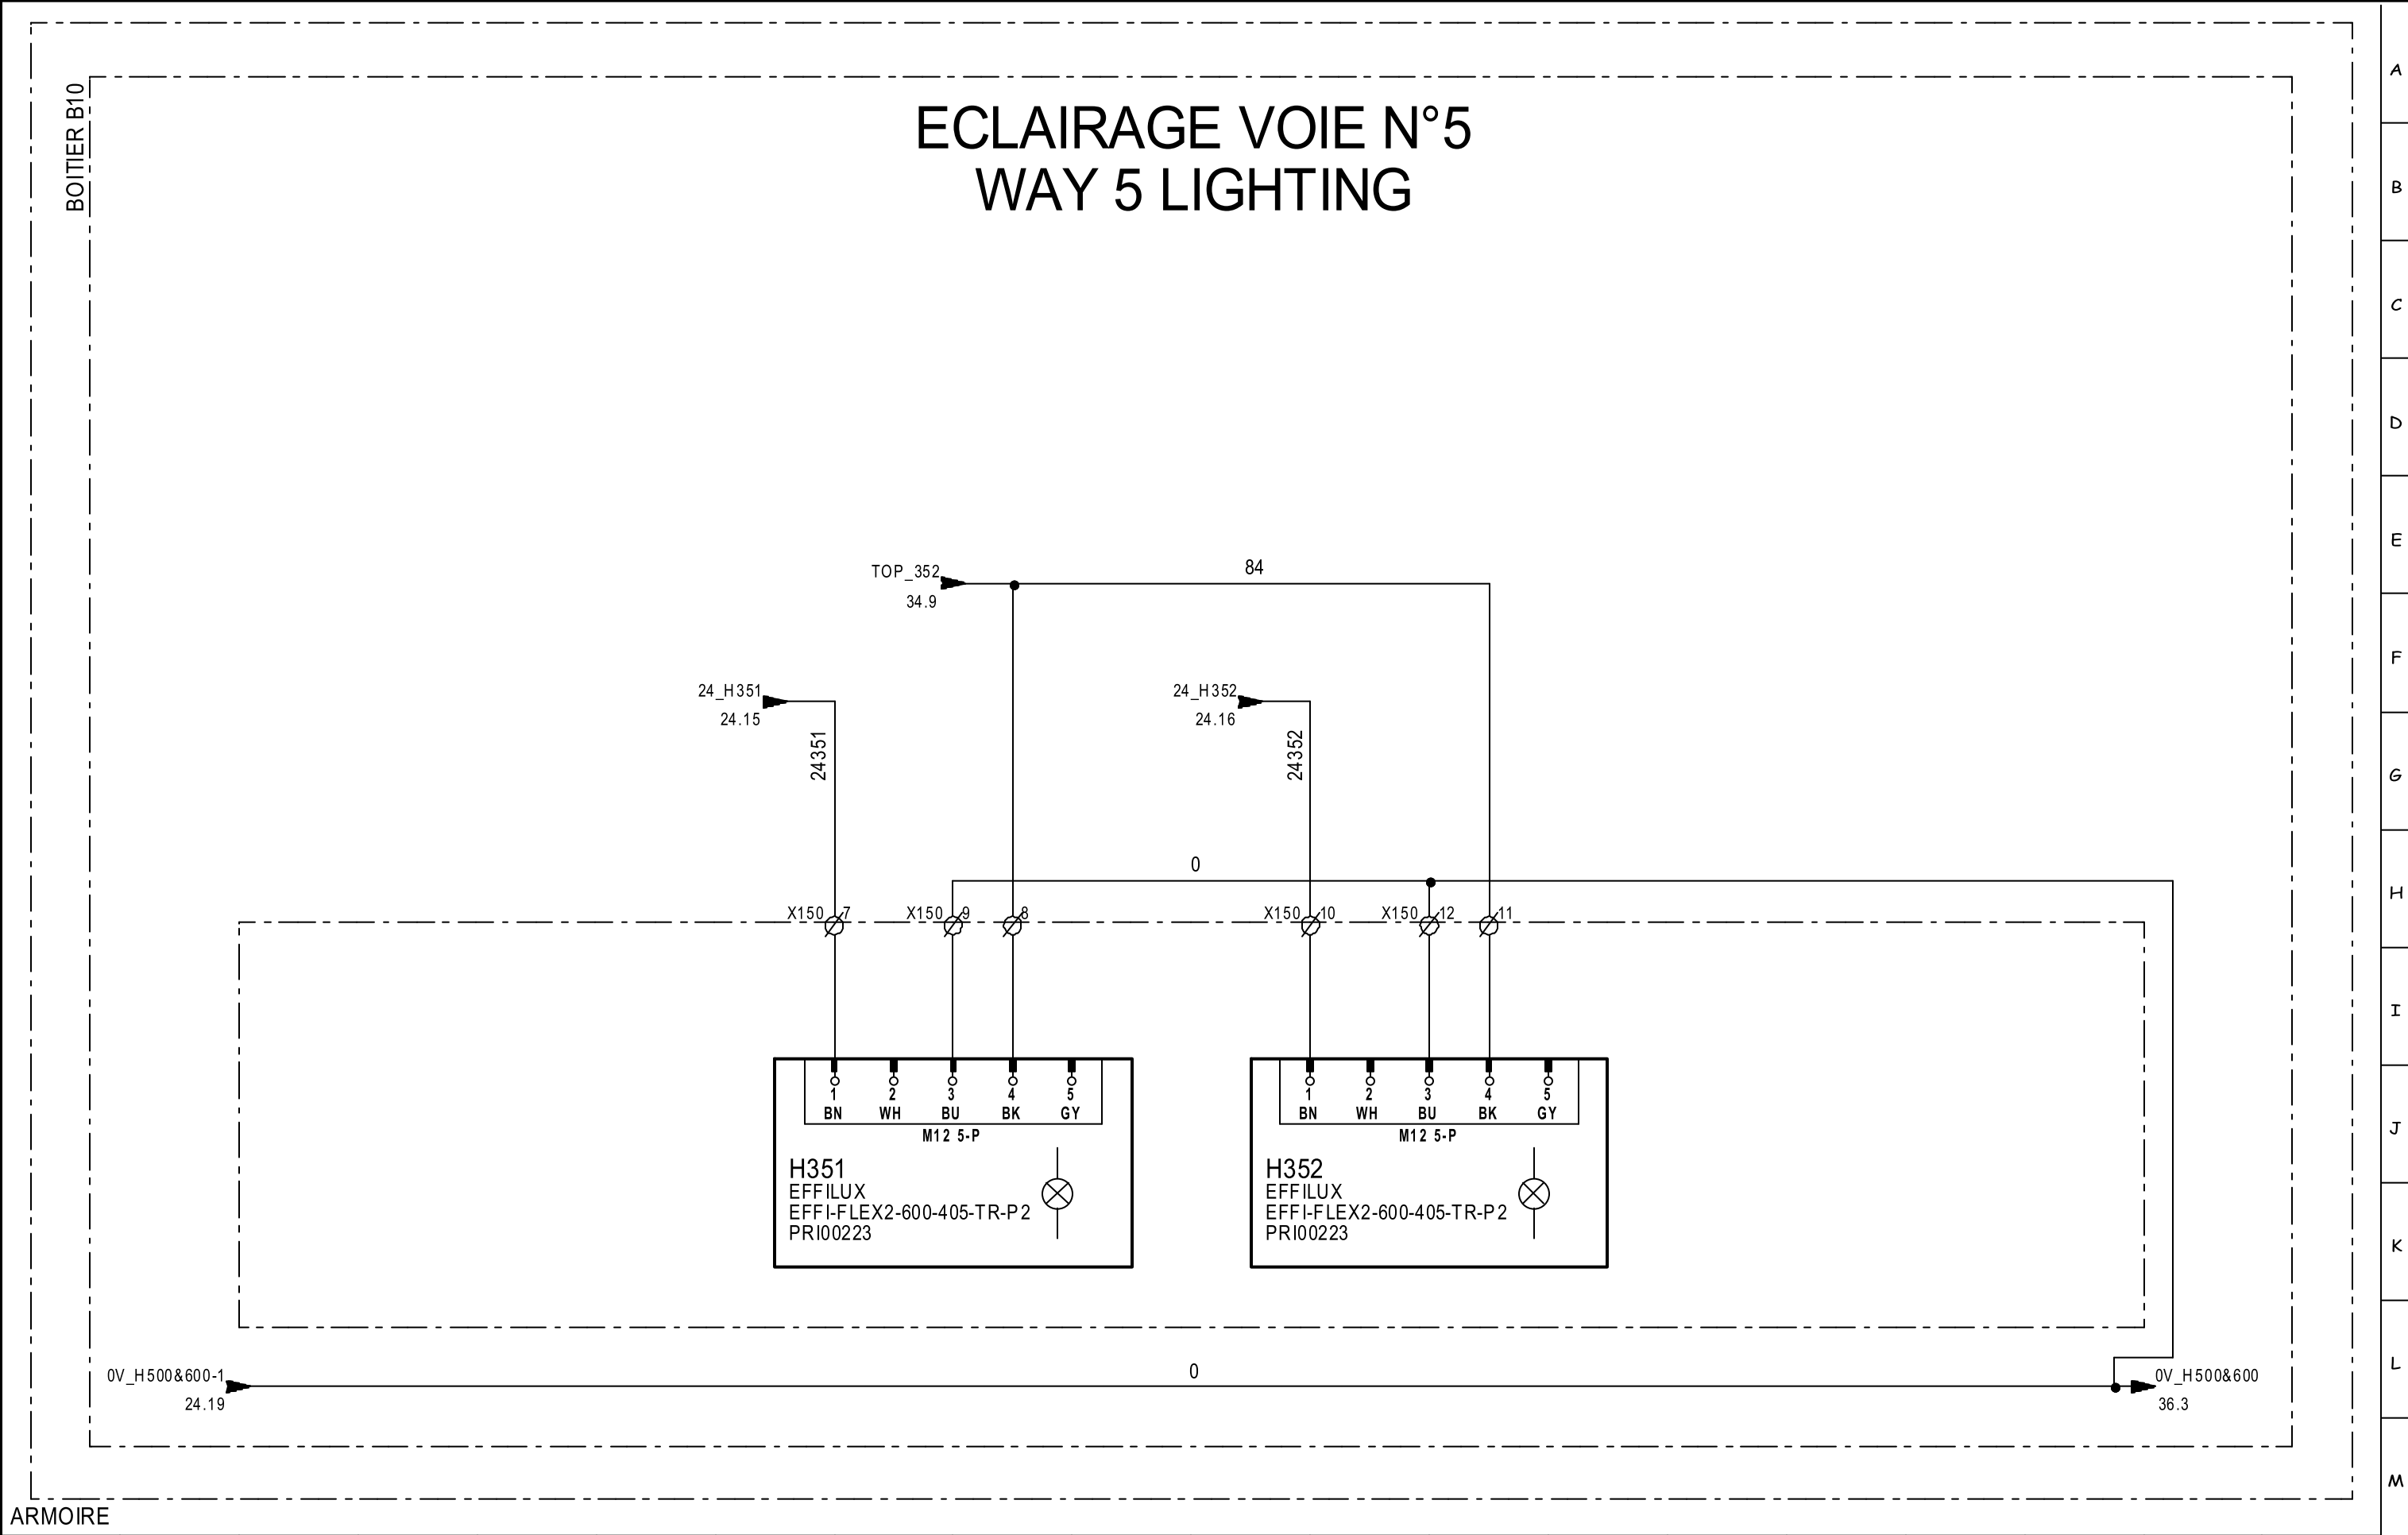


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		IMPLANTATION ECLAIRAGE VOIE 5				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		WAY 5 LIGHTING LAY OUT								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 35/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

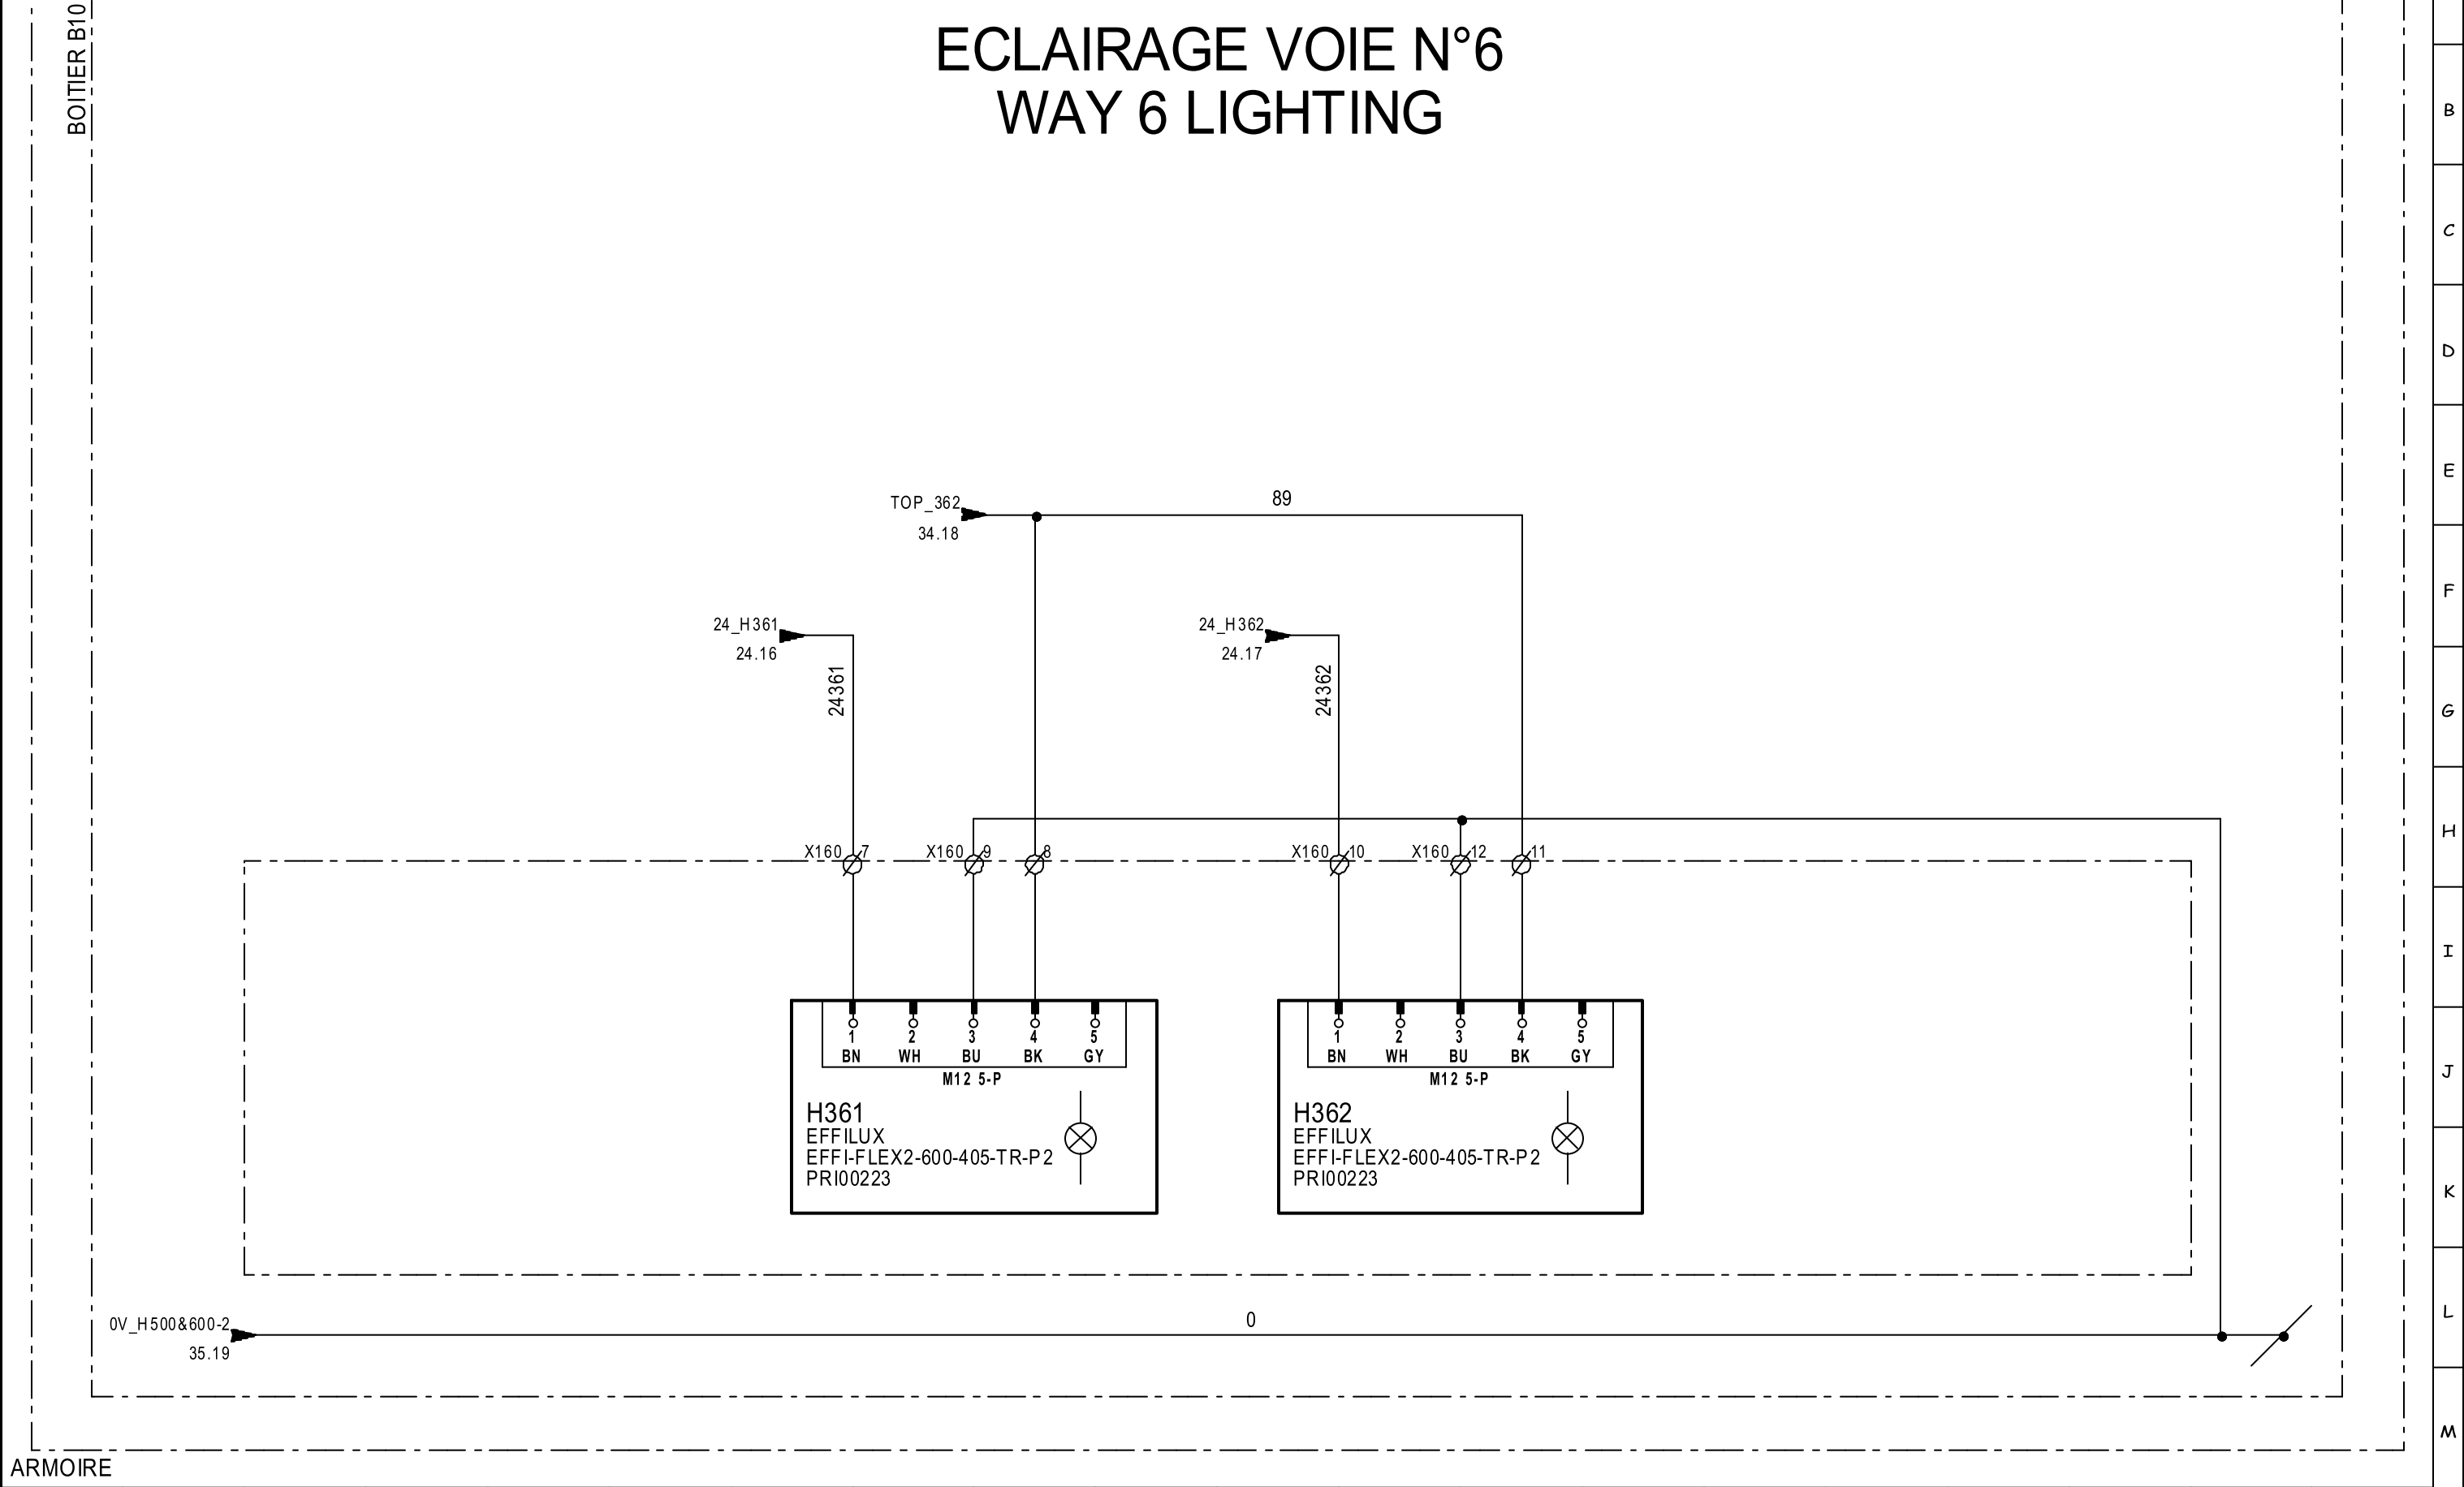


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION ECLAIRAGE VOIE 6				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		WAY 6 LIGHTING LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020													
																		FOLIO : 36/144		

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

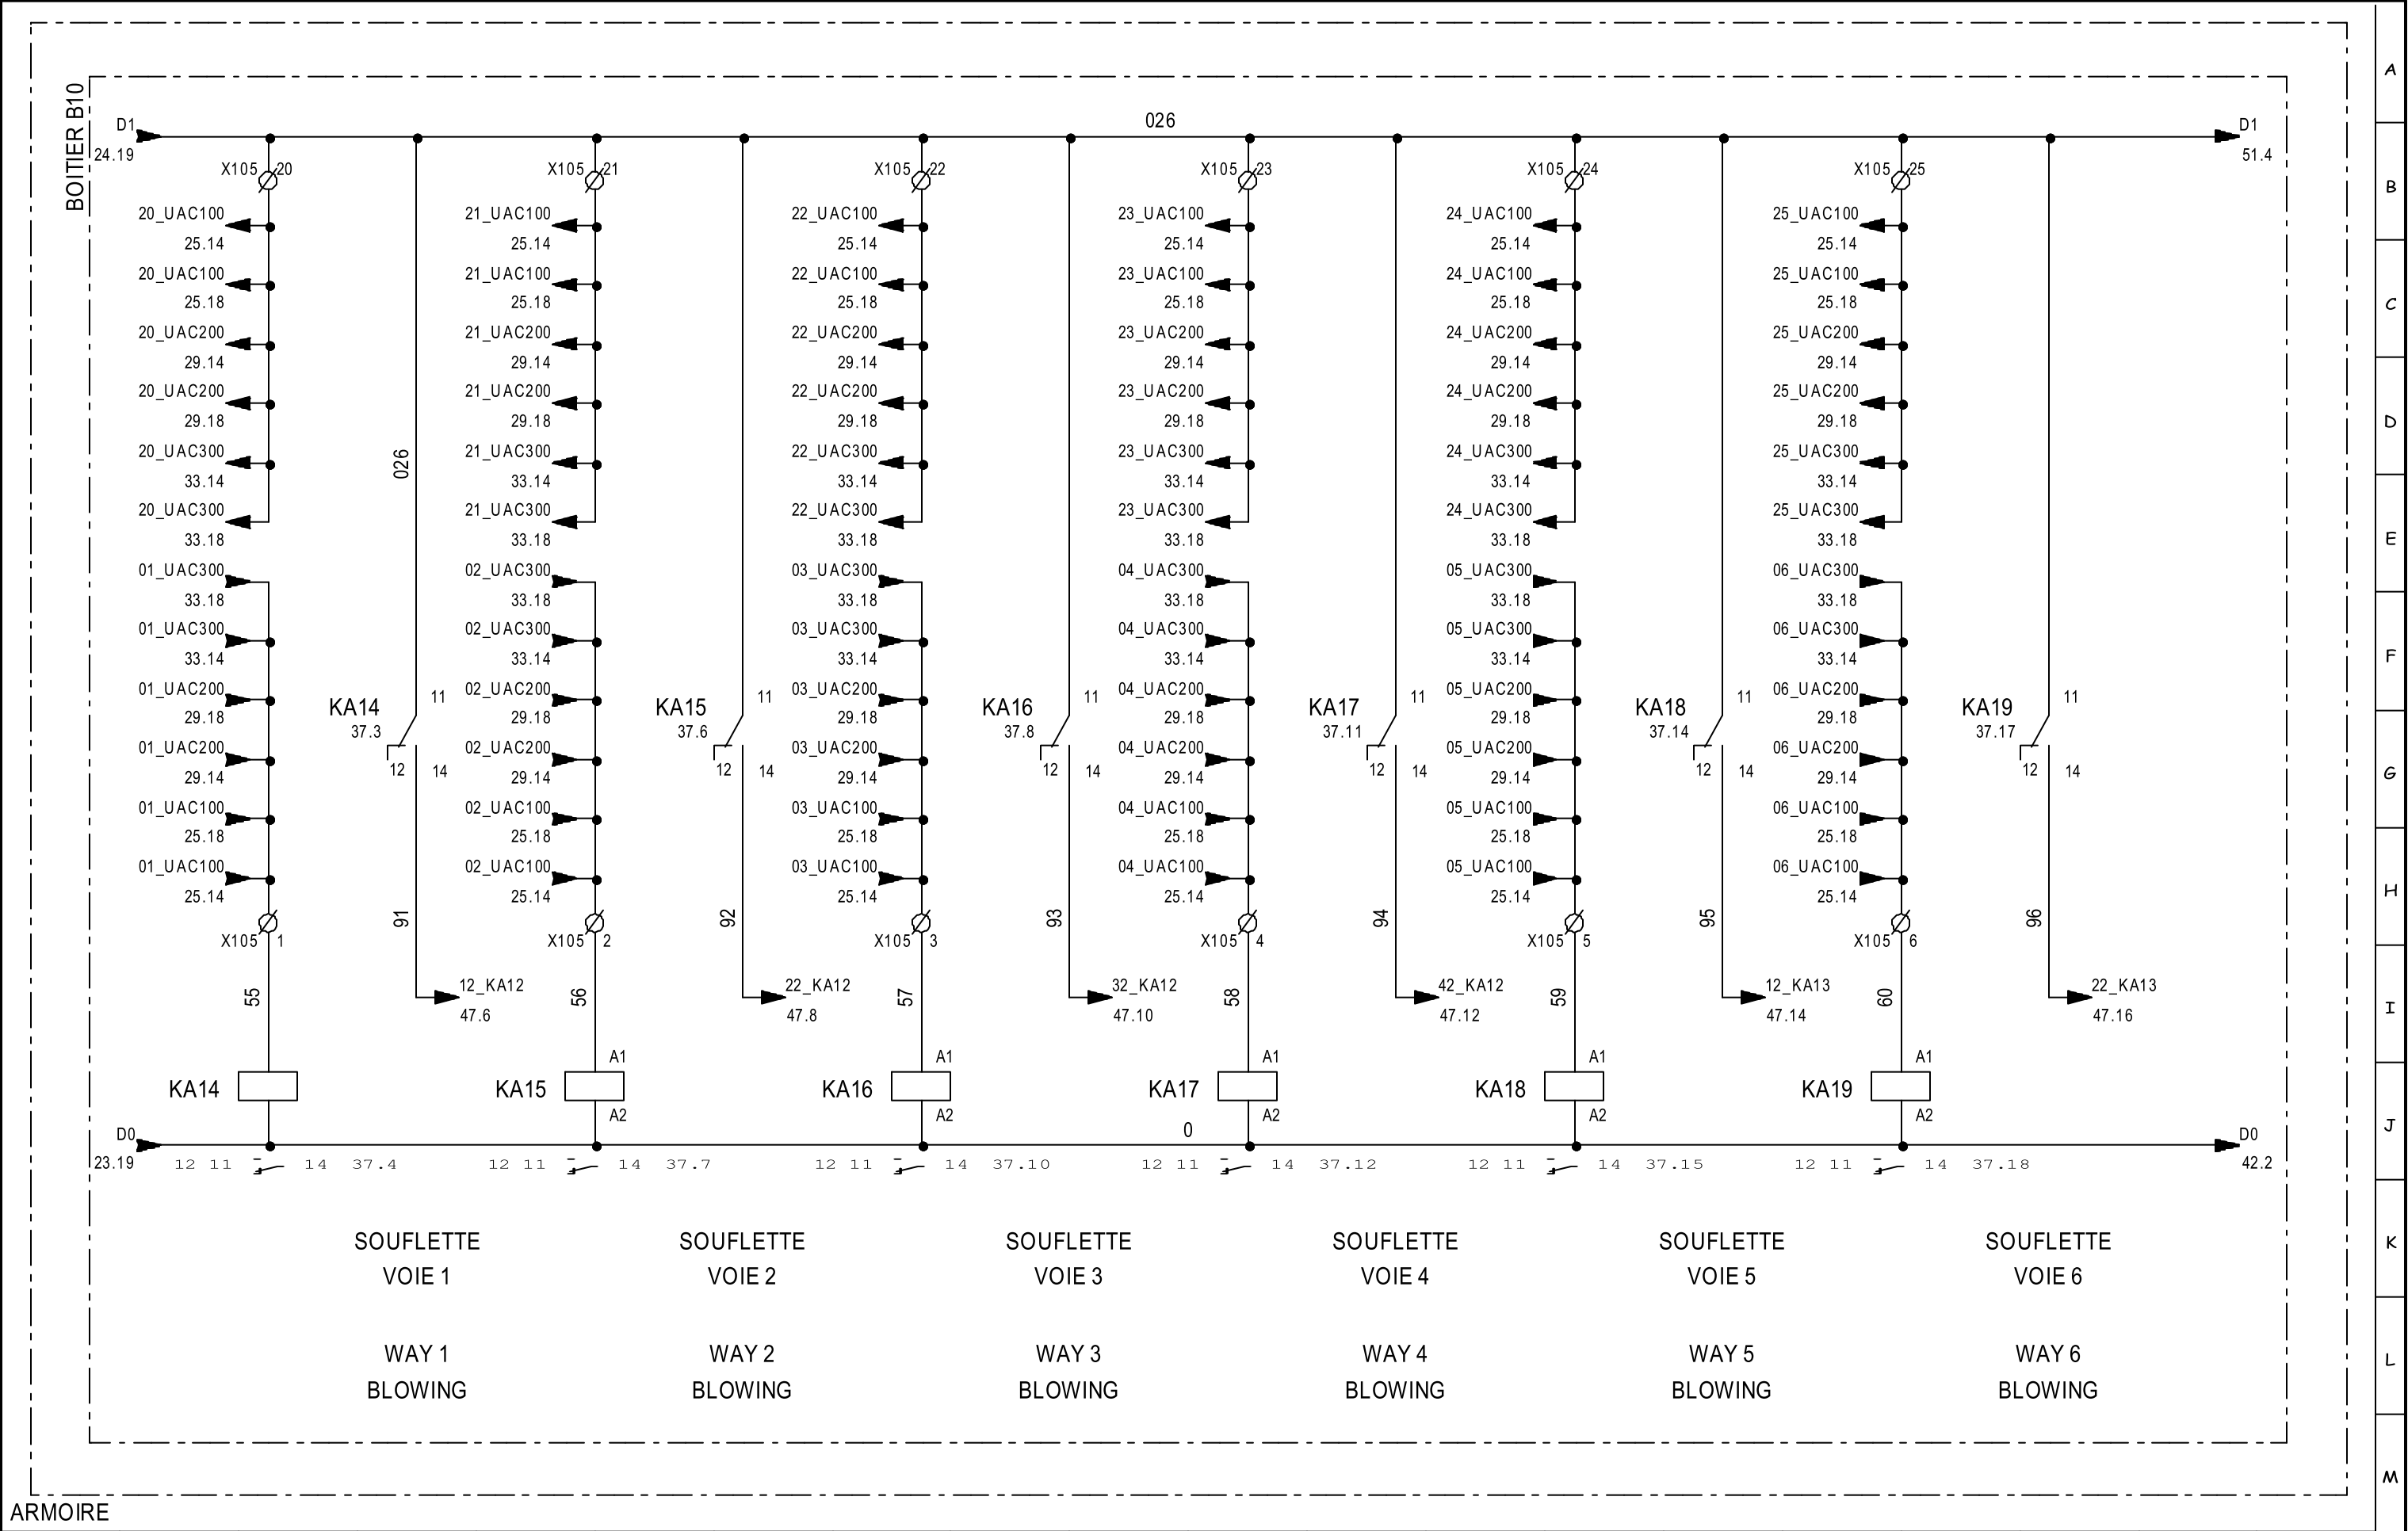

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 05/12/2023		SCHEMA COMMANDE UAC				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE			
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE :		INDEX : V6					
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002				FOLIO : 37/144			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

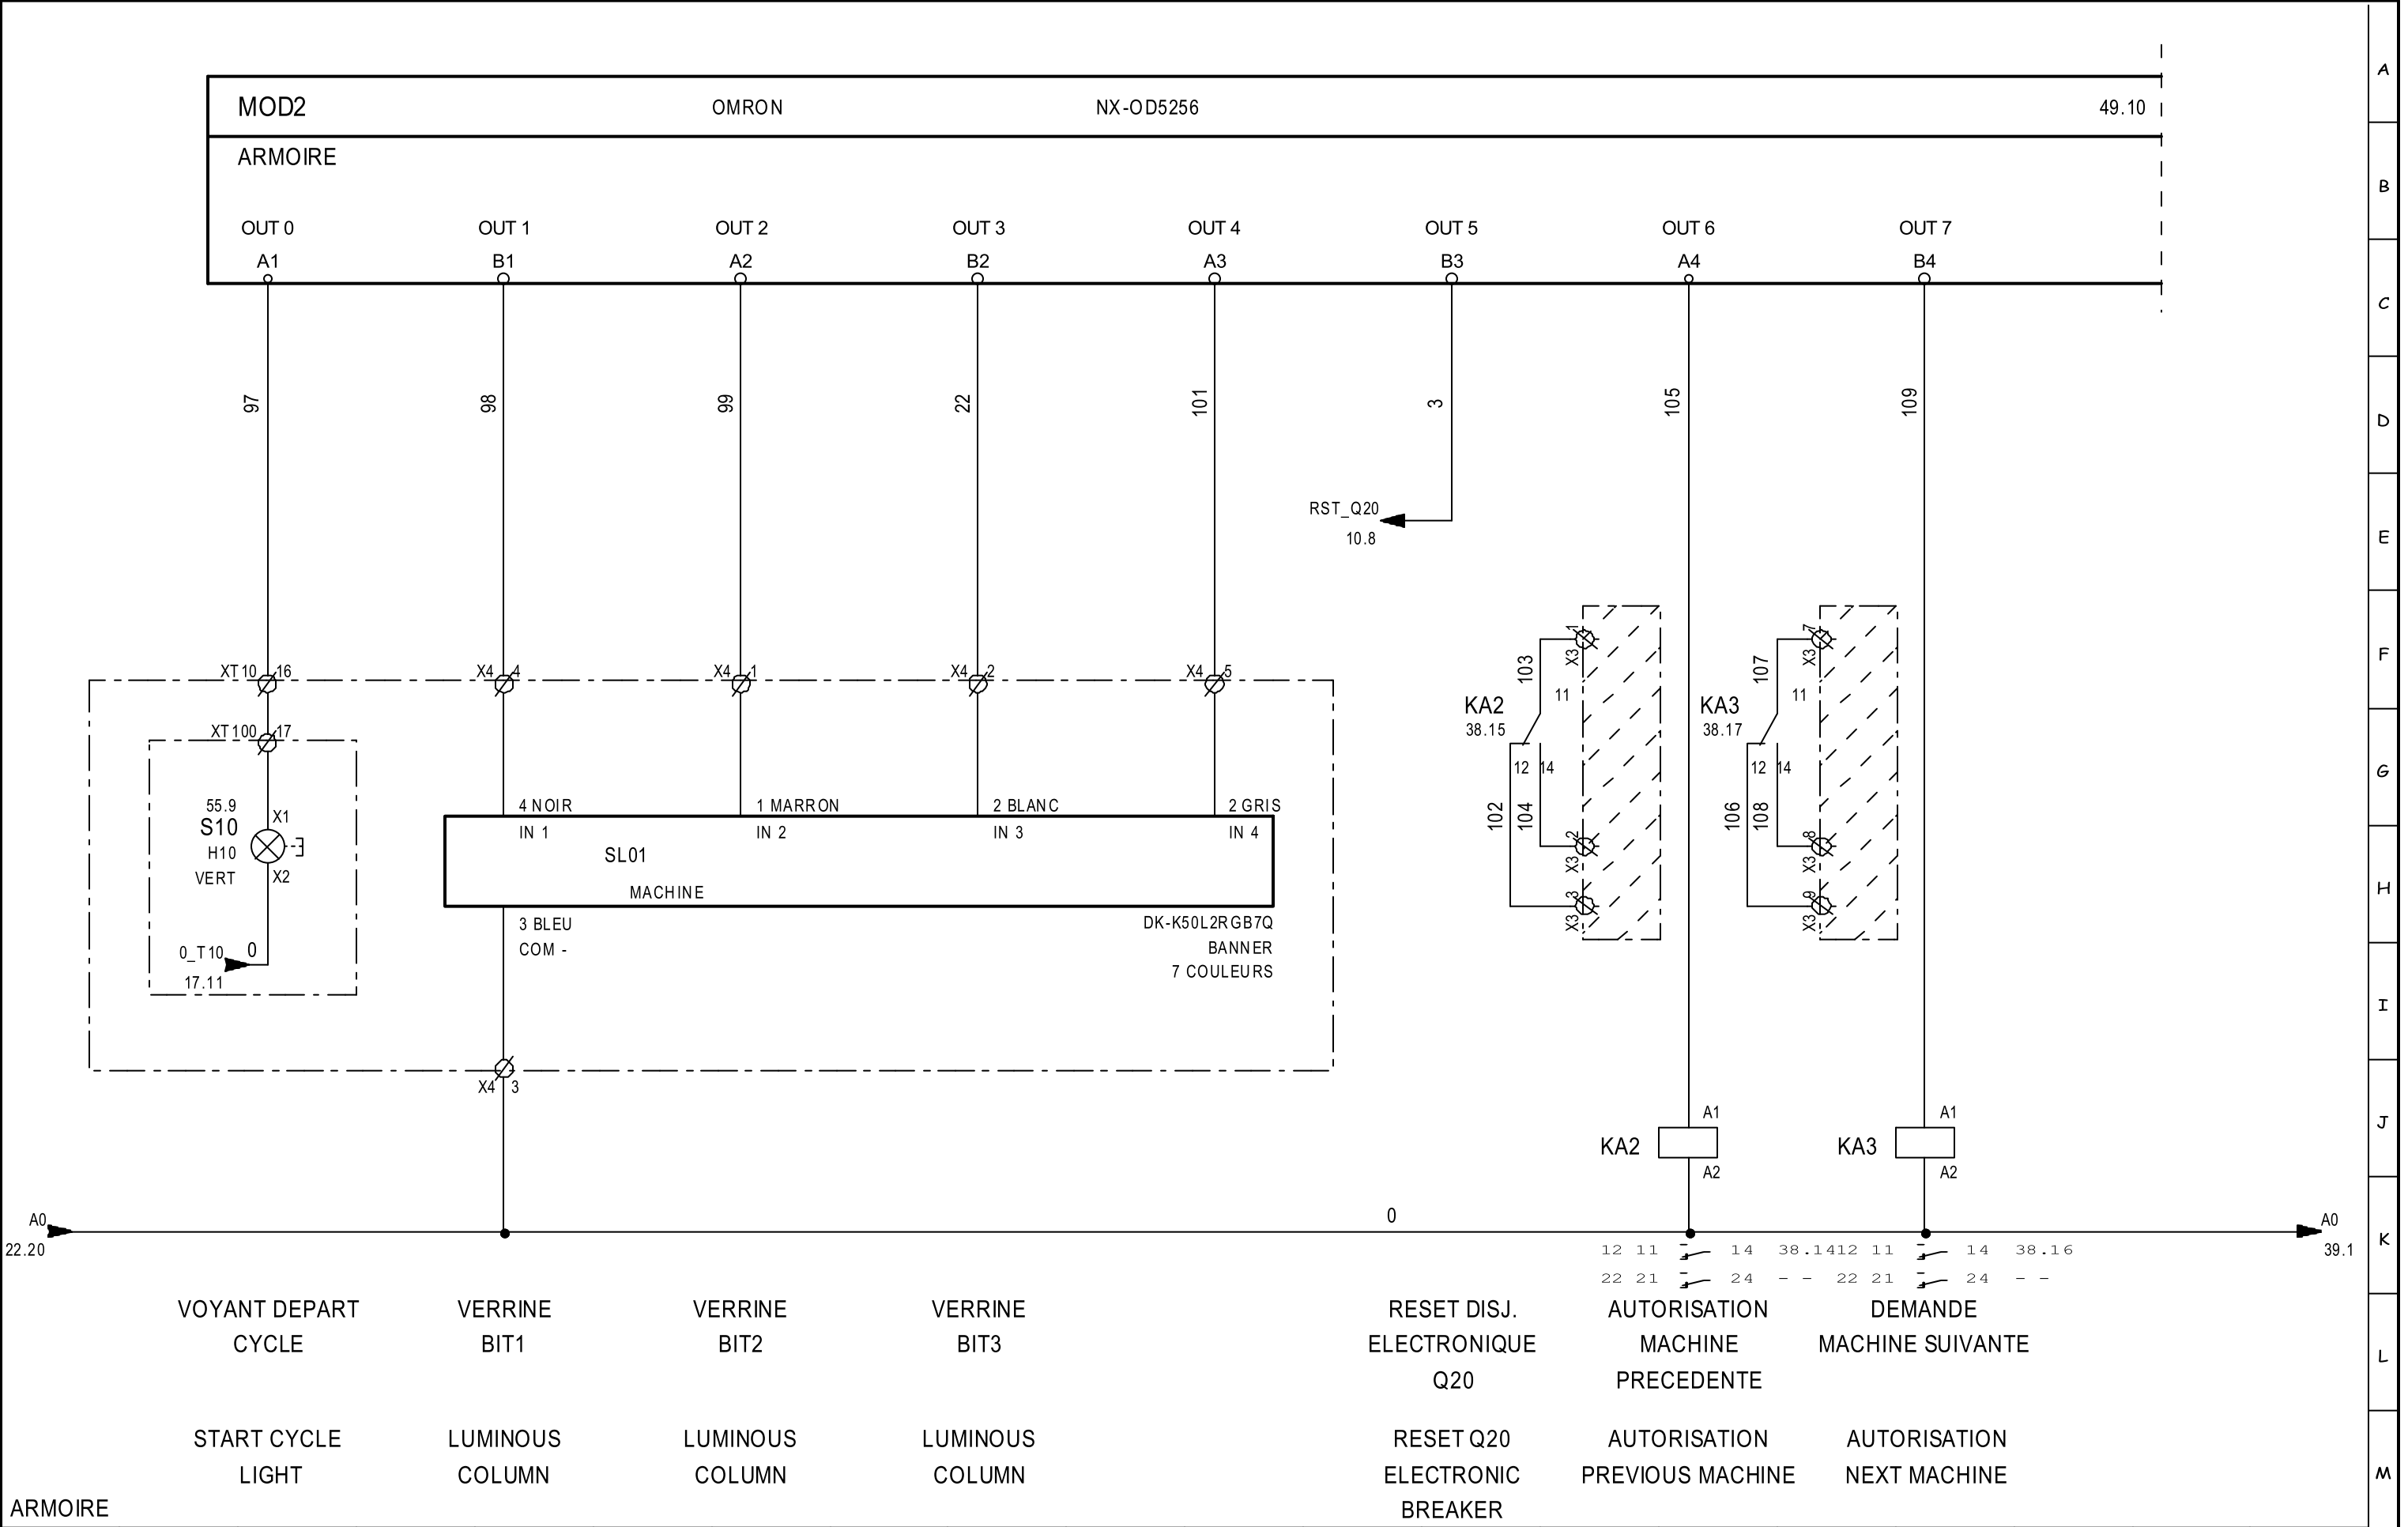

ARMOIRE


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD2				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD2								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		38/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

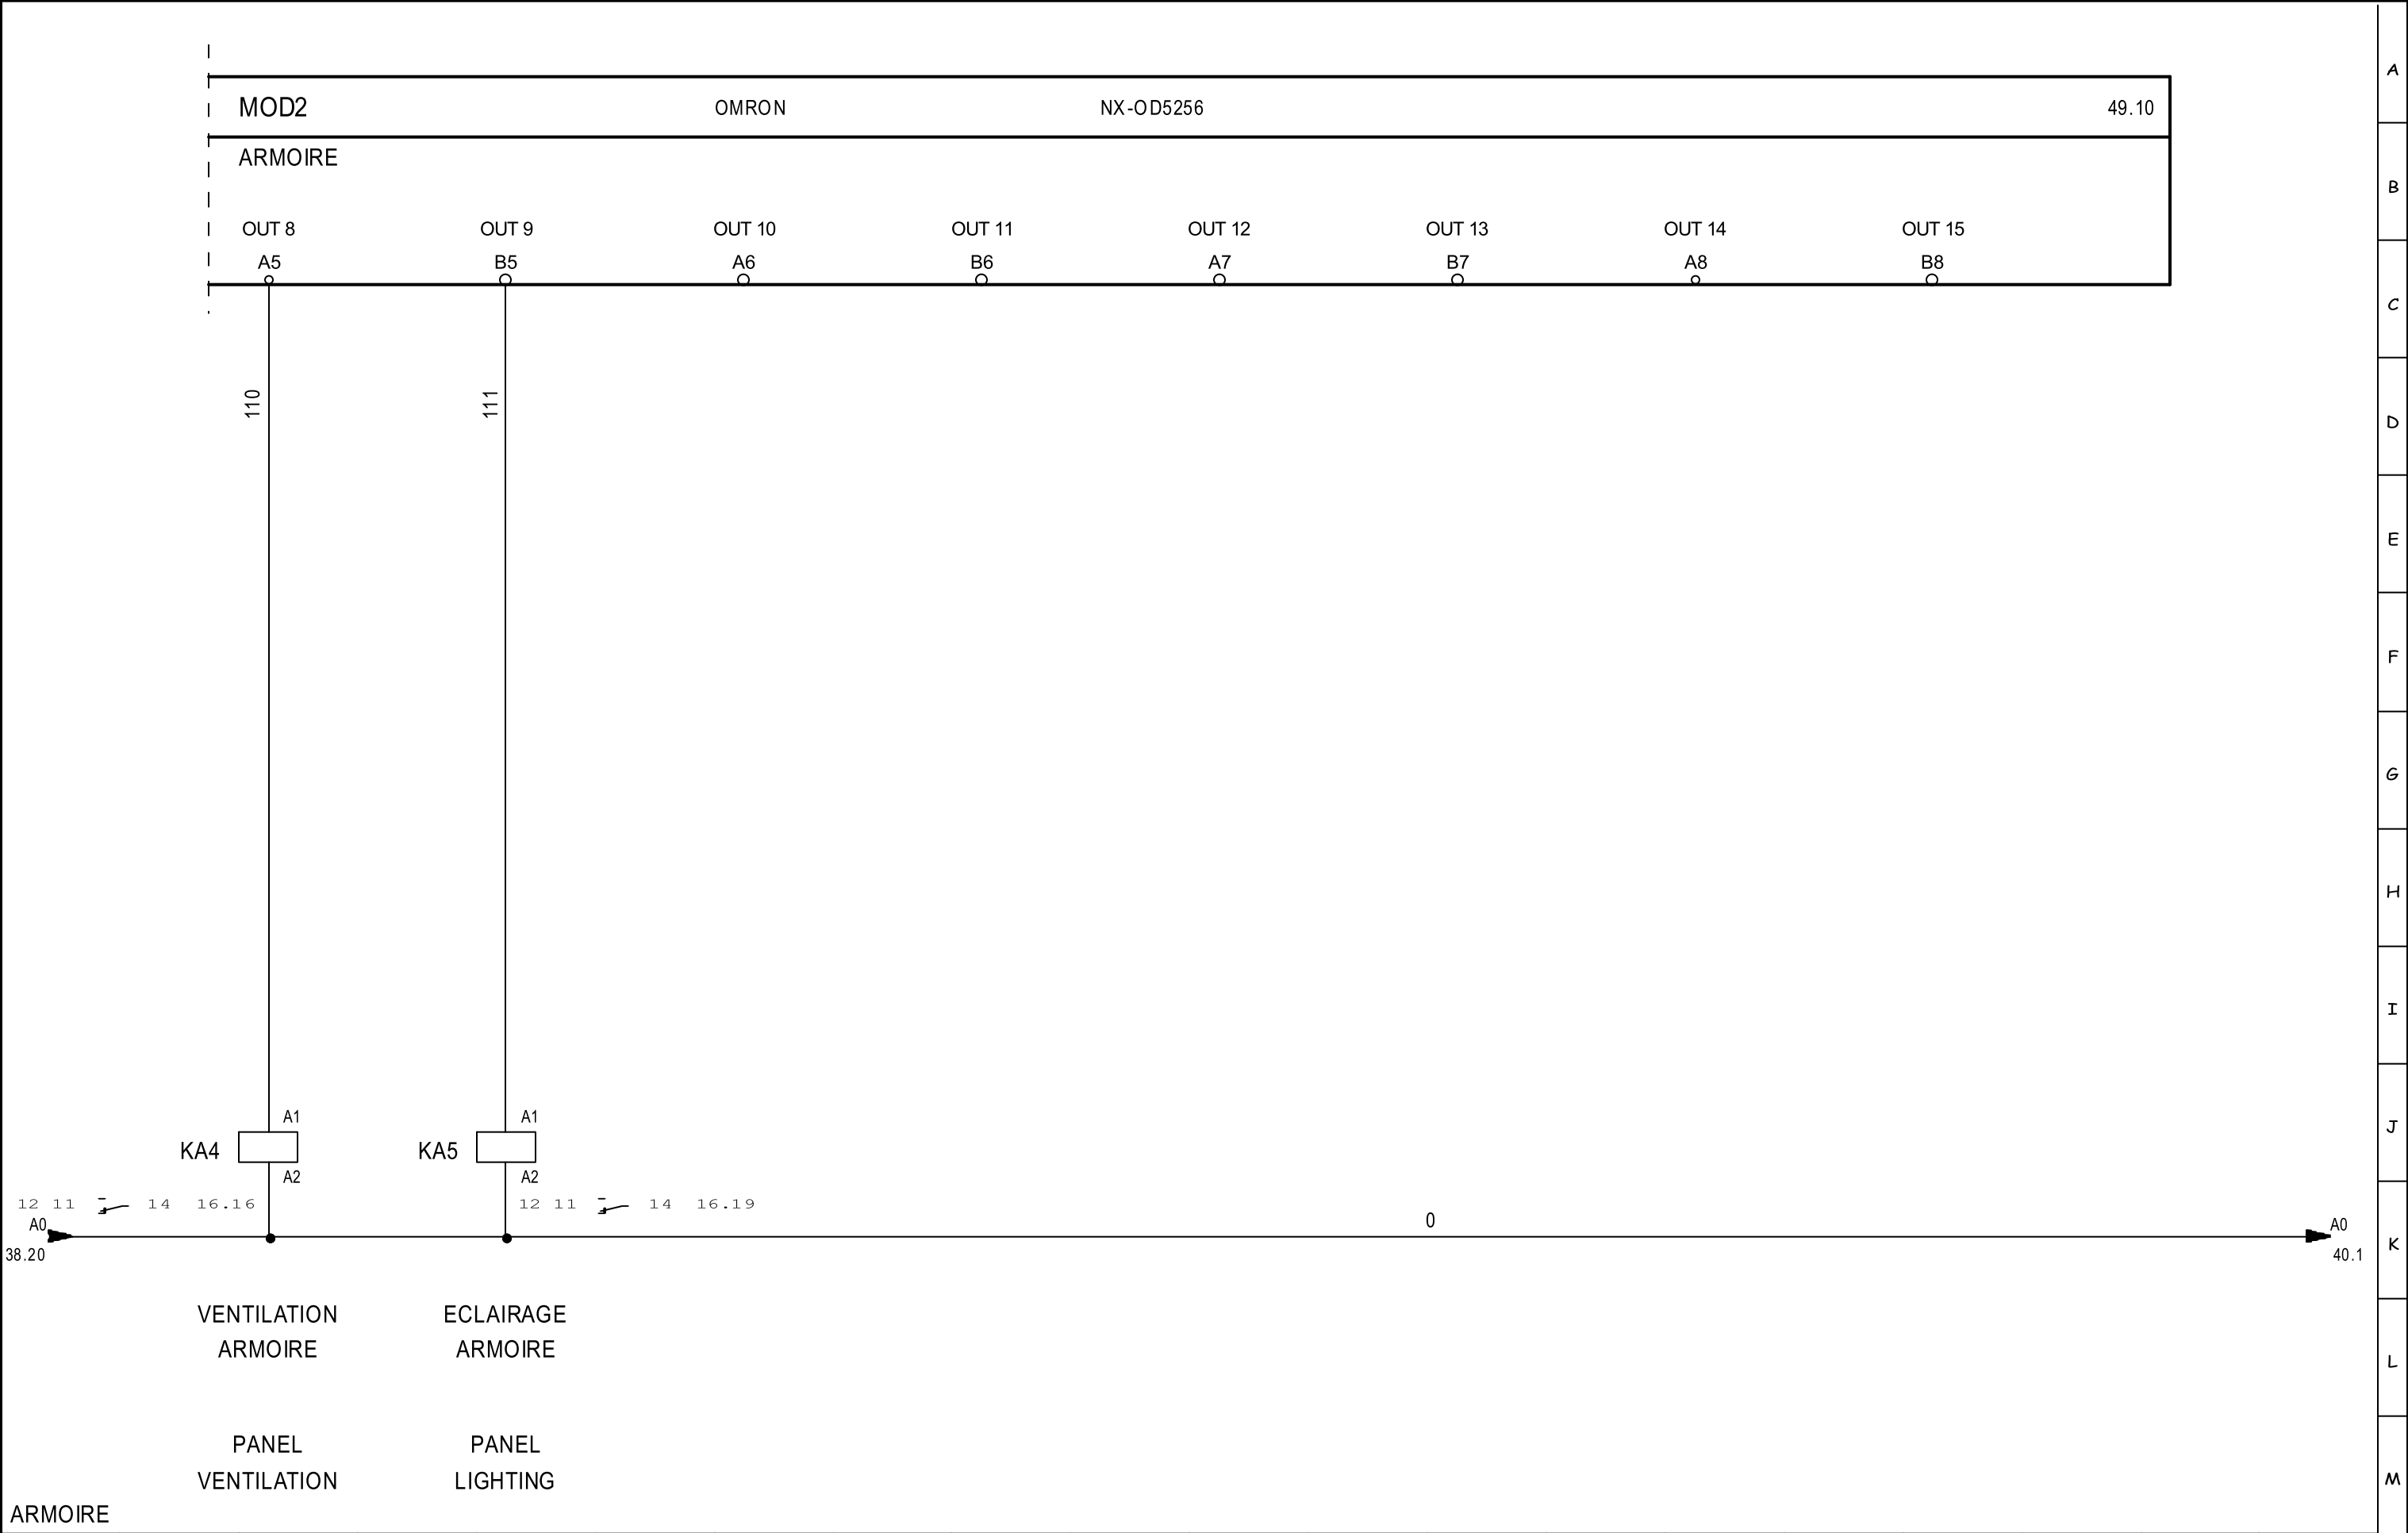

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD2				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD2								ARTICLE : SMXA0002				INDEX : V6	
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020				FOLIO : 39/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

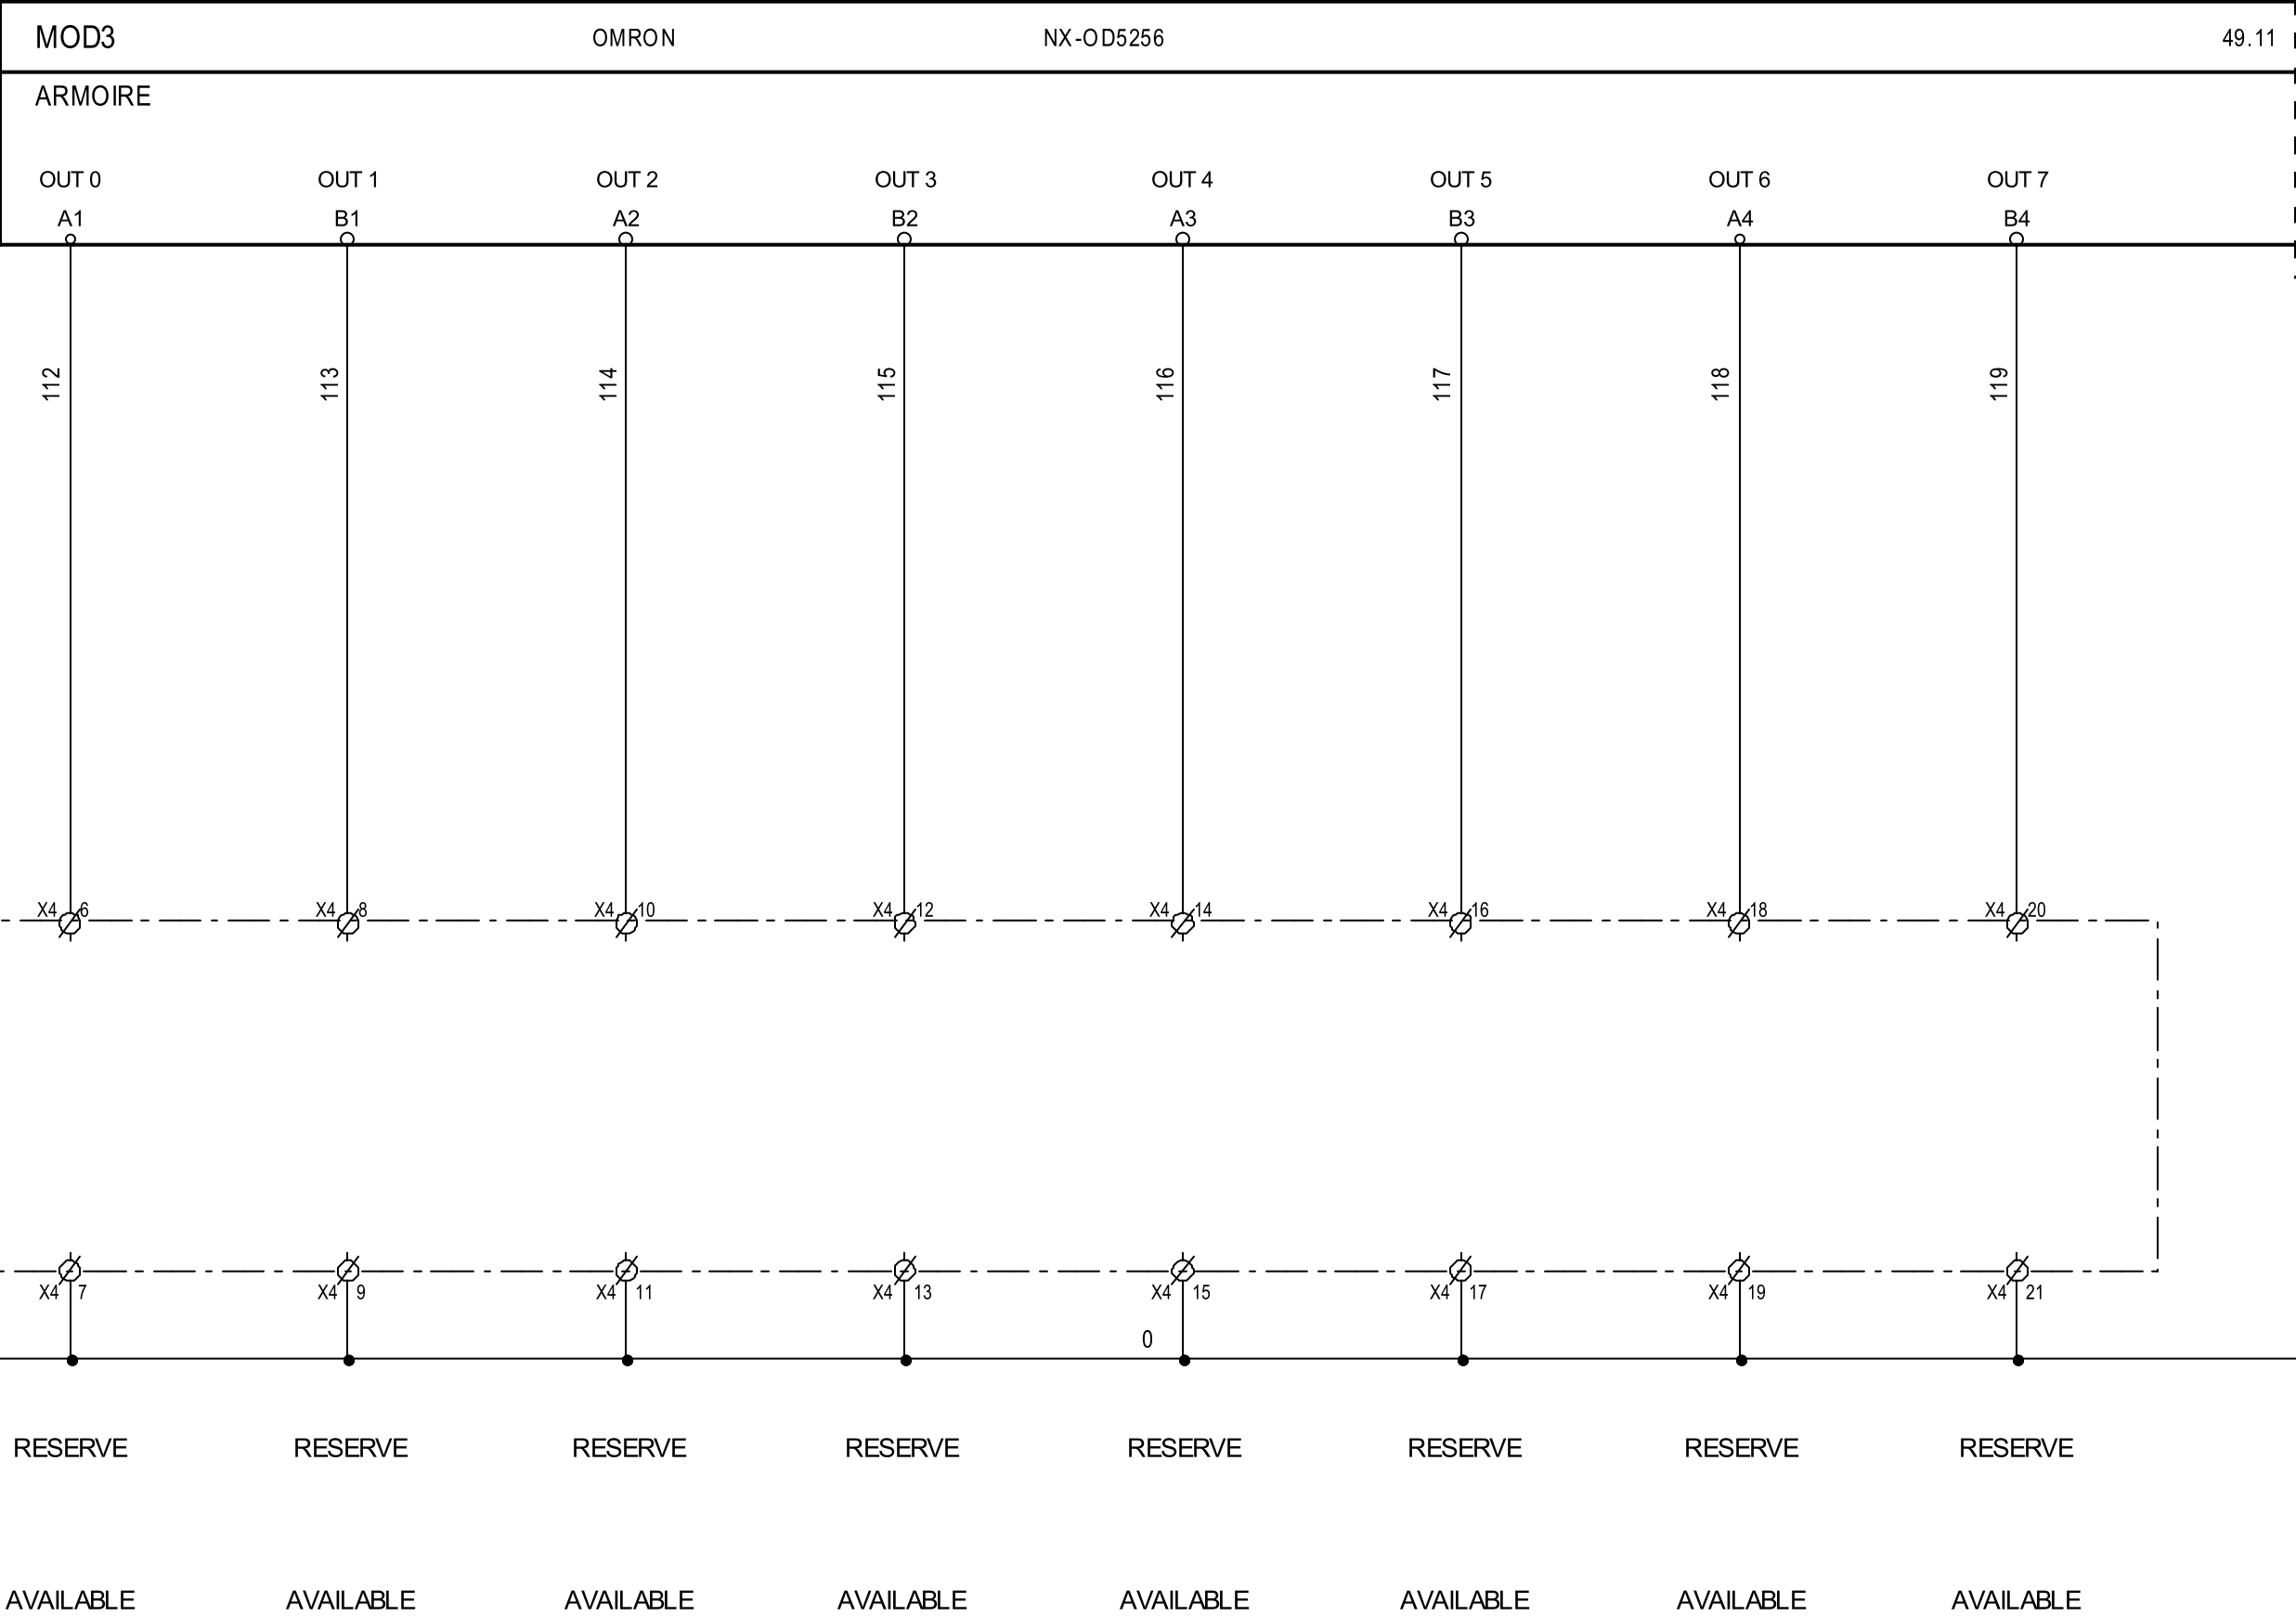

A0 39.20

A0 41.1

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD3				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD3								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								FOLIO : 40/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.


MOD3								OMRON		NX-OD5256								49.11	
ARMOIRE																			
OUT 8		OUT 9		OUT 10		OUT 11		OUT 12		OUT 13		OUT 14		OUT 15					
A5		B5		A6		B6		A7		B7		A8		B8					

A0	40.20																				0	
		RESERVE		RESERVE		RESERVE		RESERVE		RESERVE		RESERVE		RESERVE		RESERVE		RESERVE				
		AVAILABLE		AVAILABLE		AVAILABLE		AVAILABLE		AVAILABLE		AVAILABLE		AVAILABLE		AVAILABLE		AVAILABLE				

ARMOIRE


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD3				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD3								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020												FOLIO : 41/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

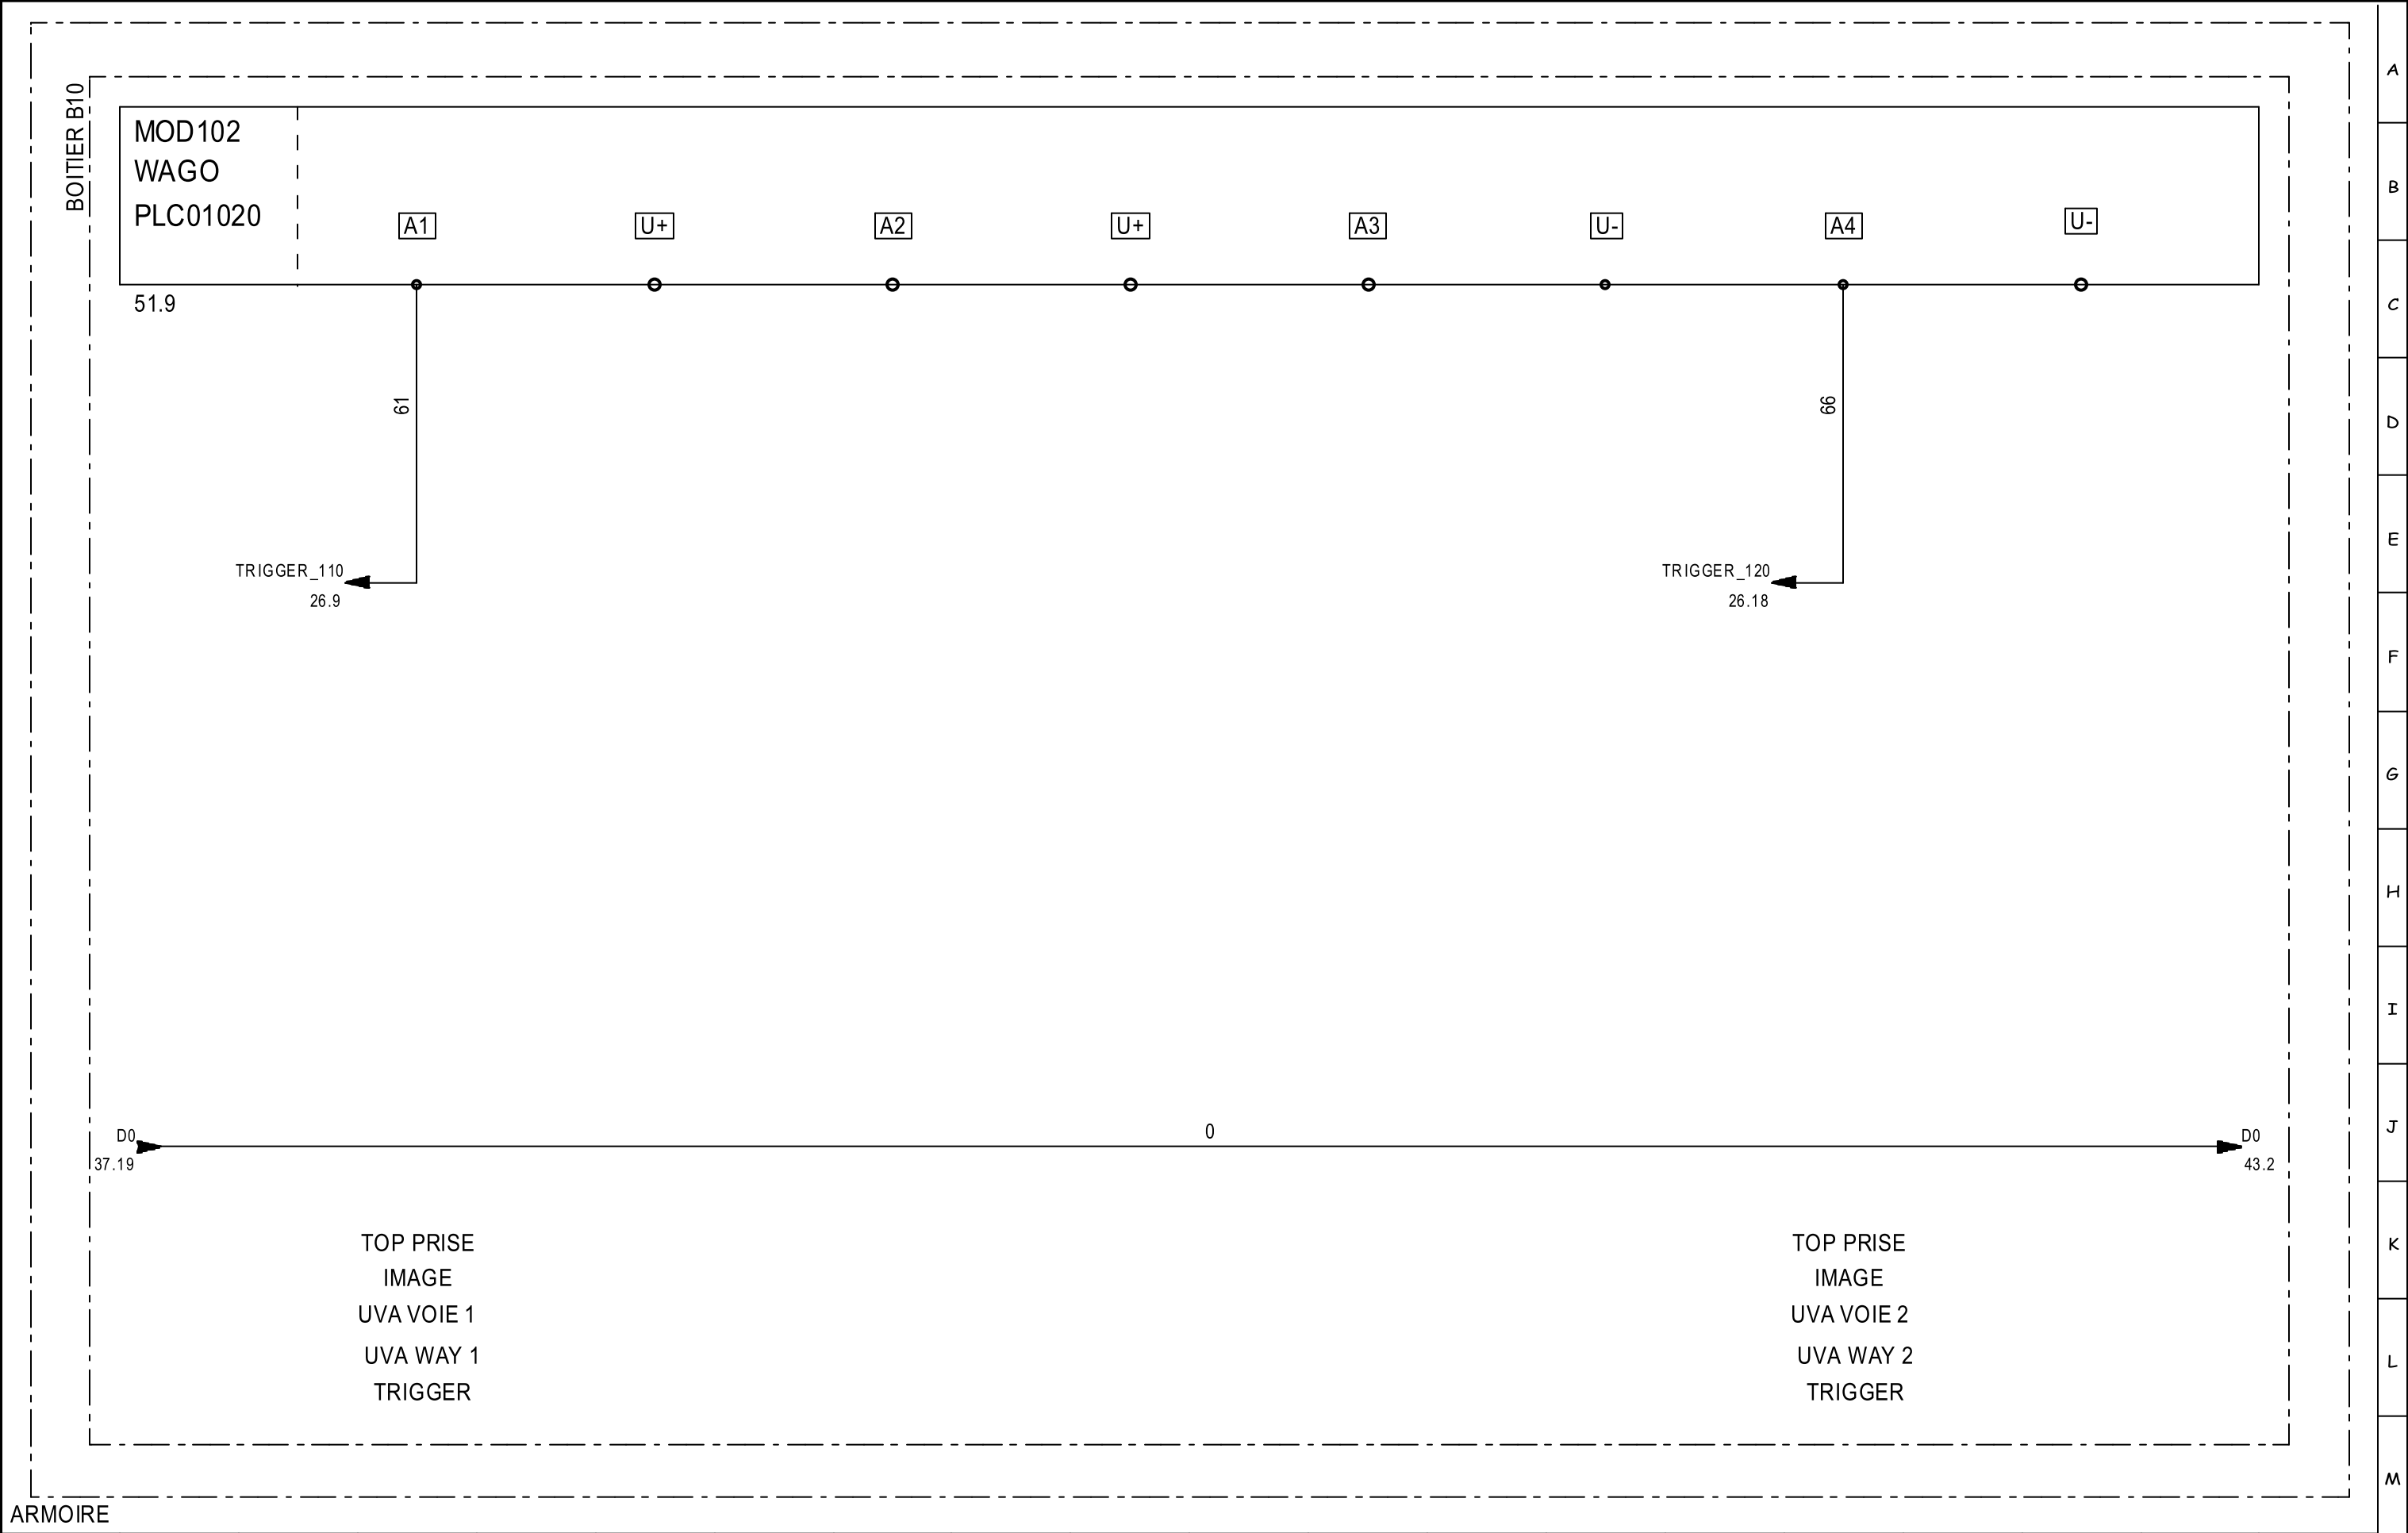


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD102				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD102								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 42/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

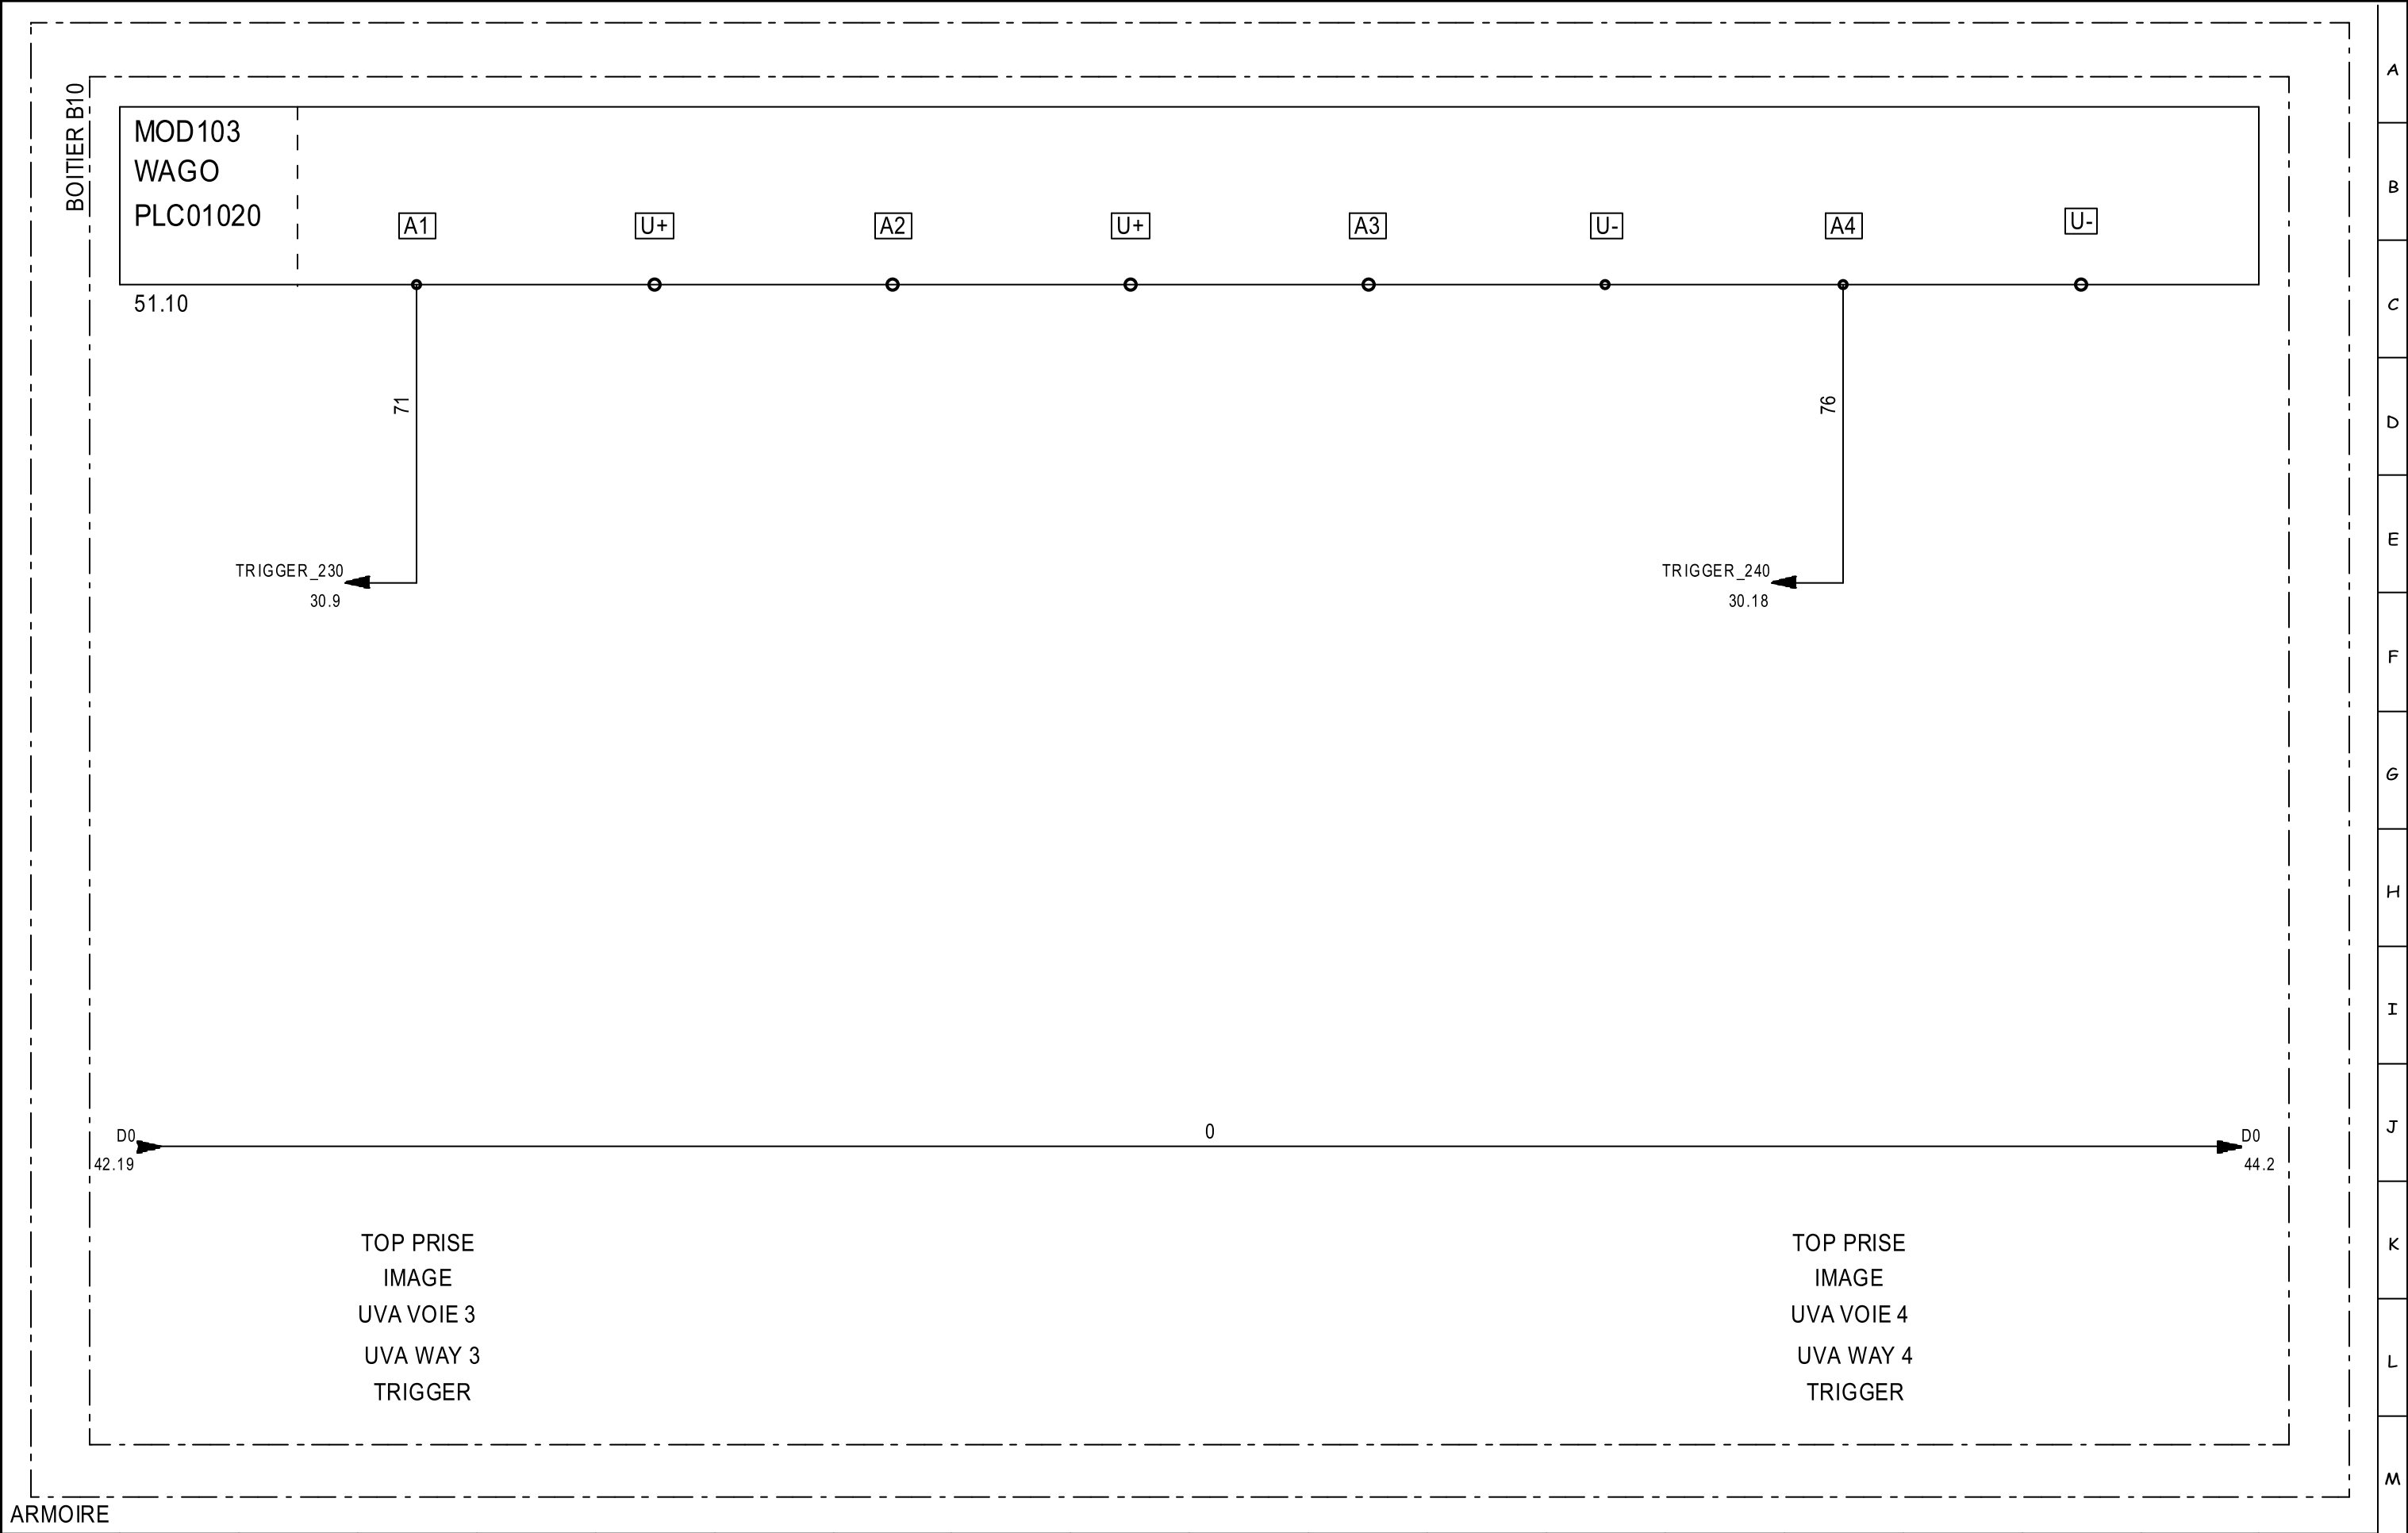


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD103				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD103								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 43/144			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

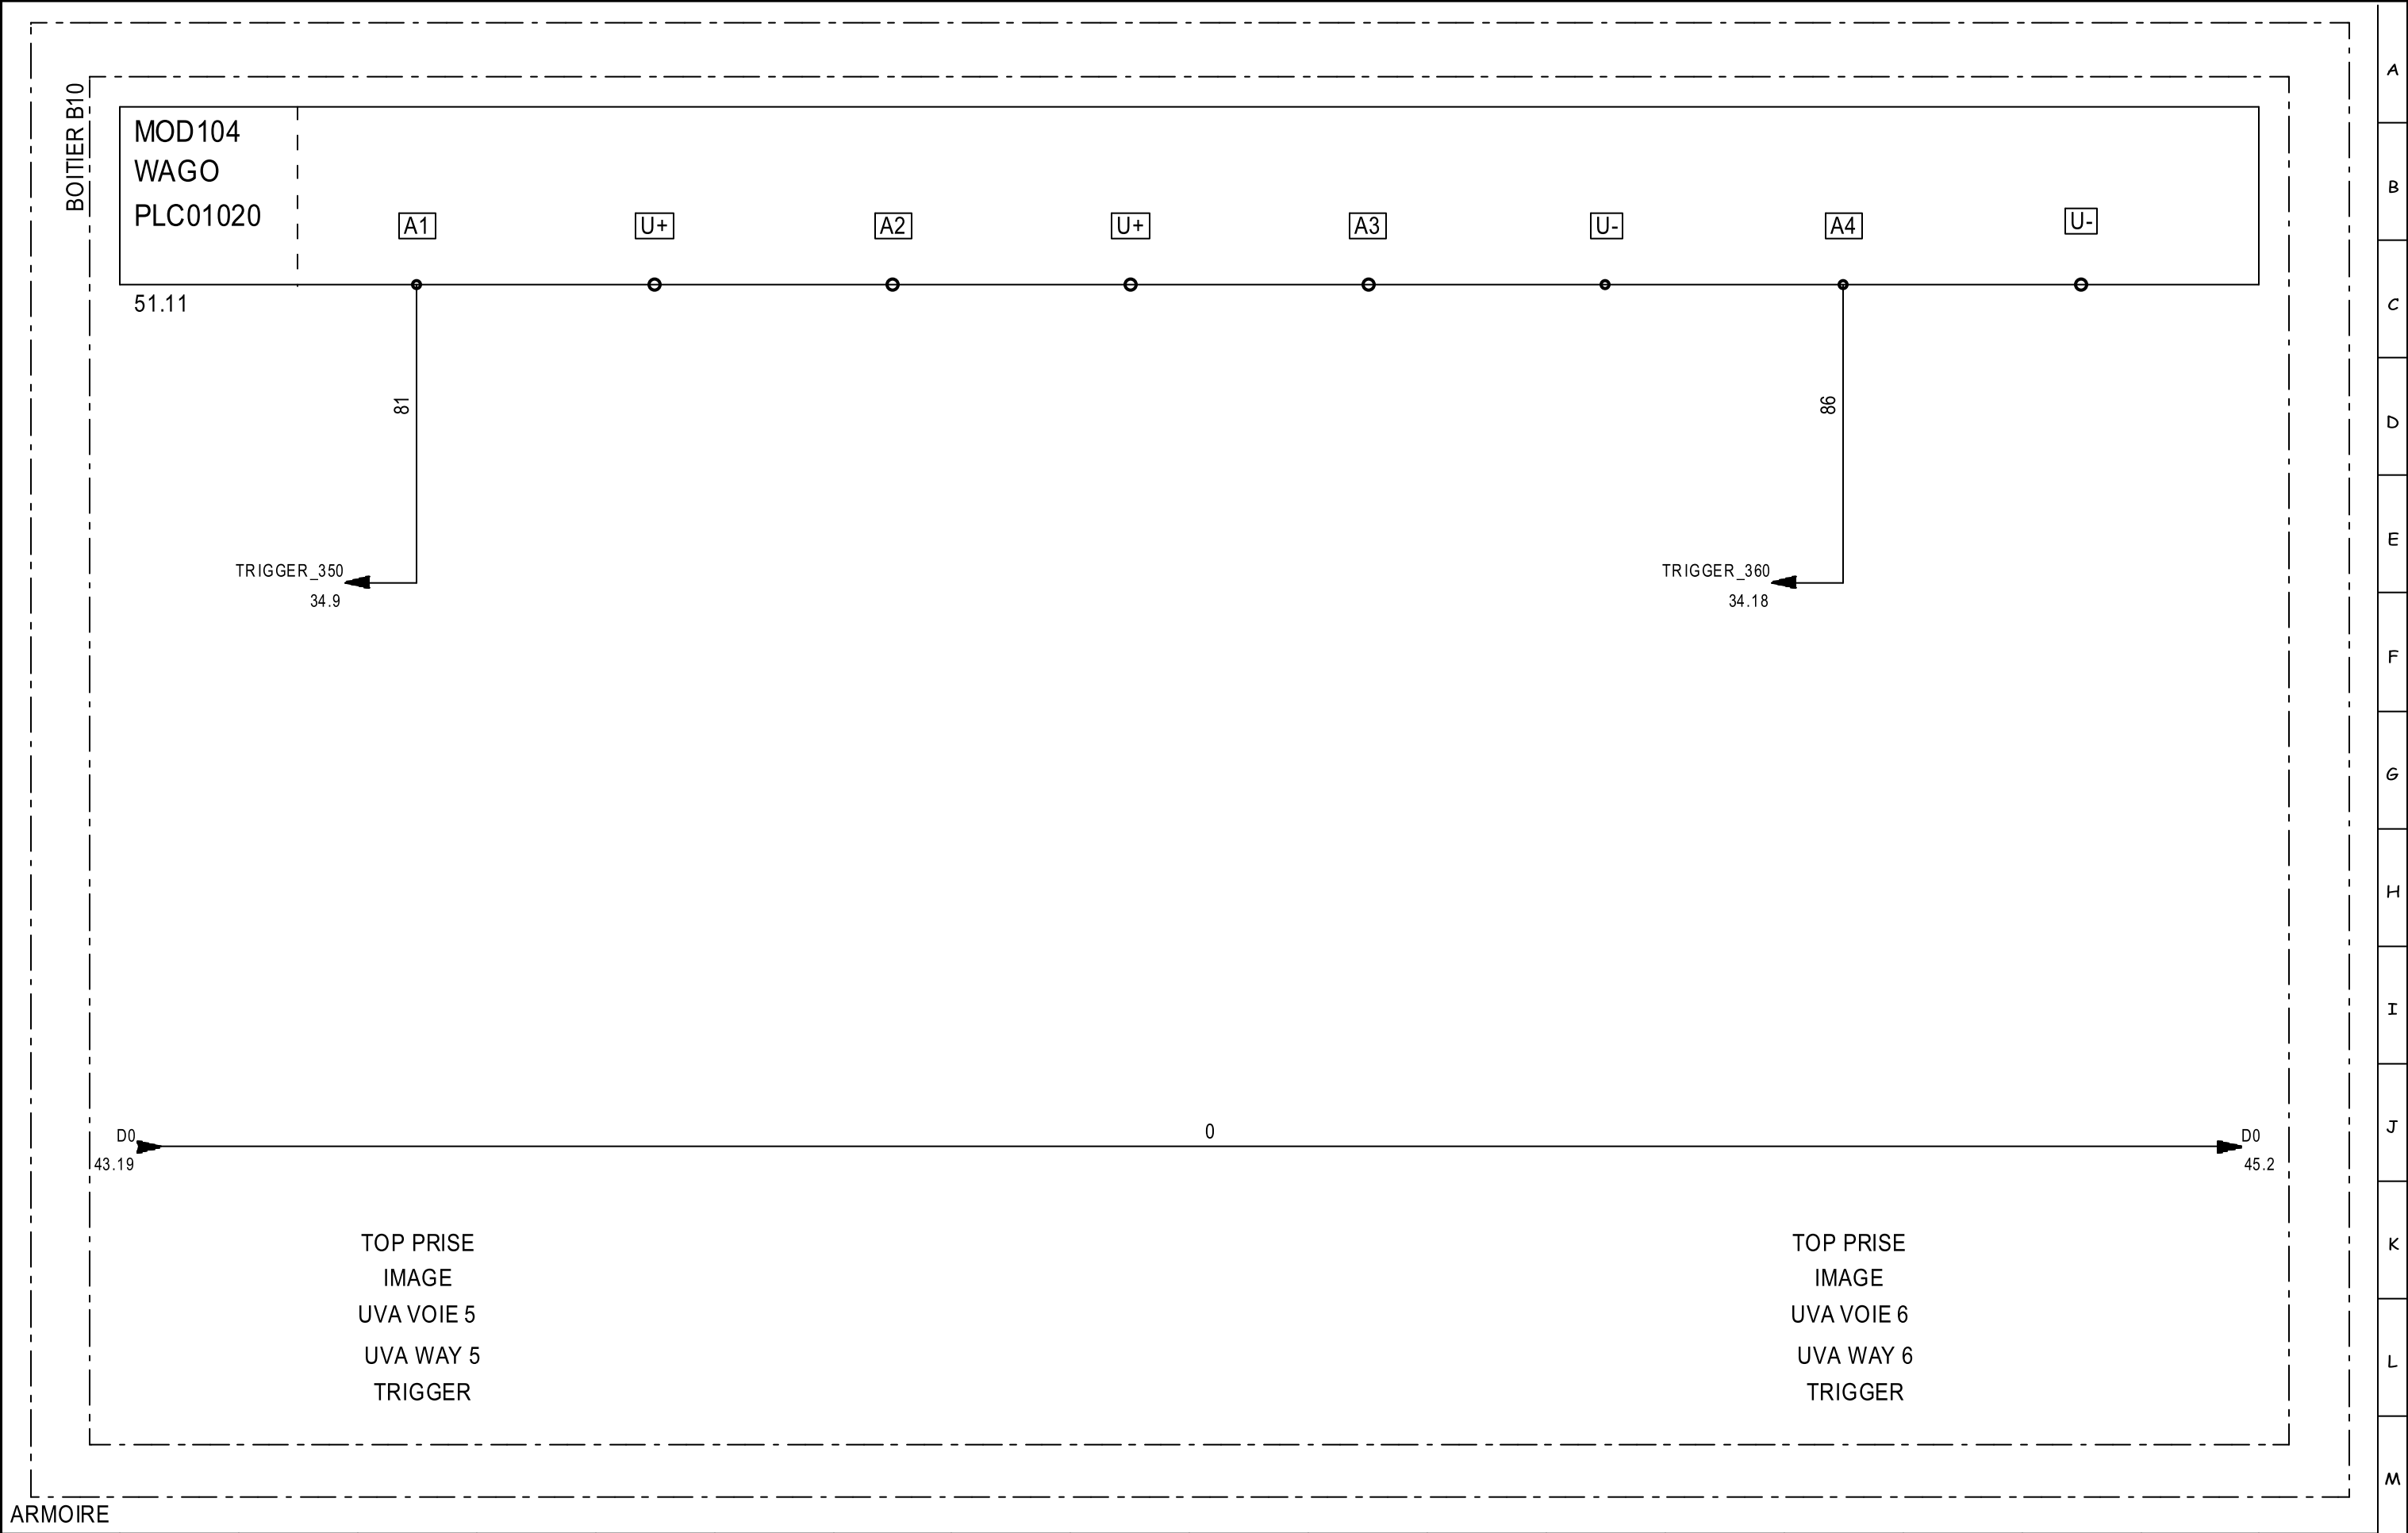

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD104				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD104								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								FOLIO : 44/144					

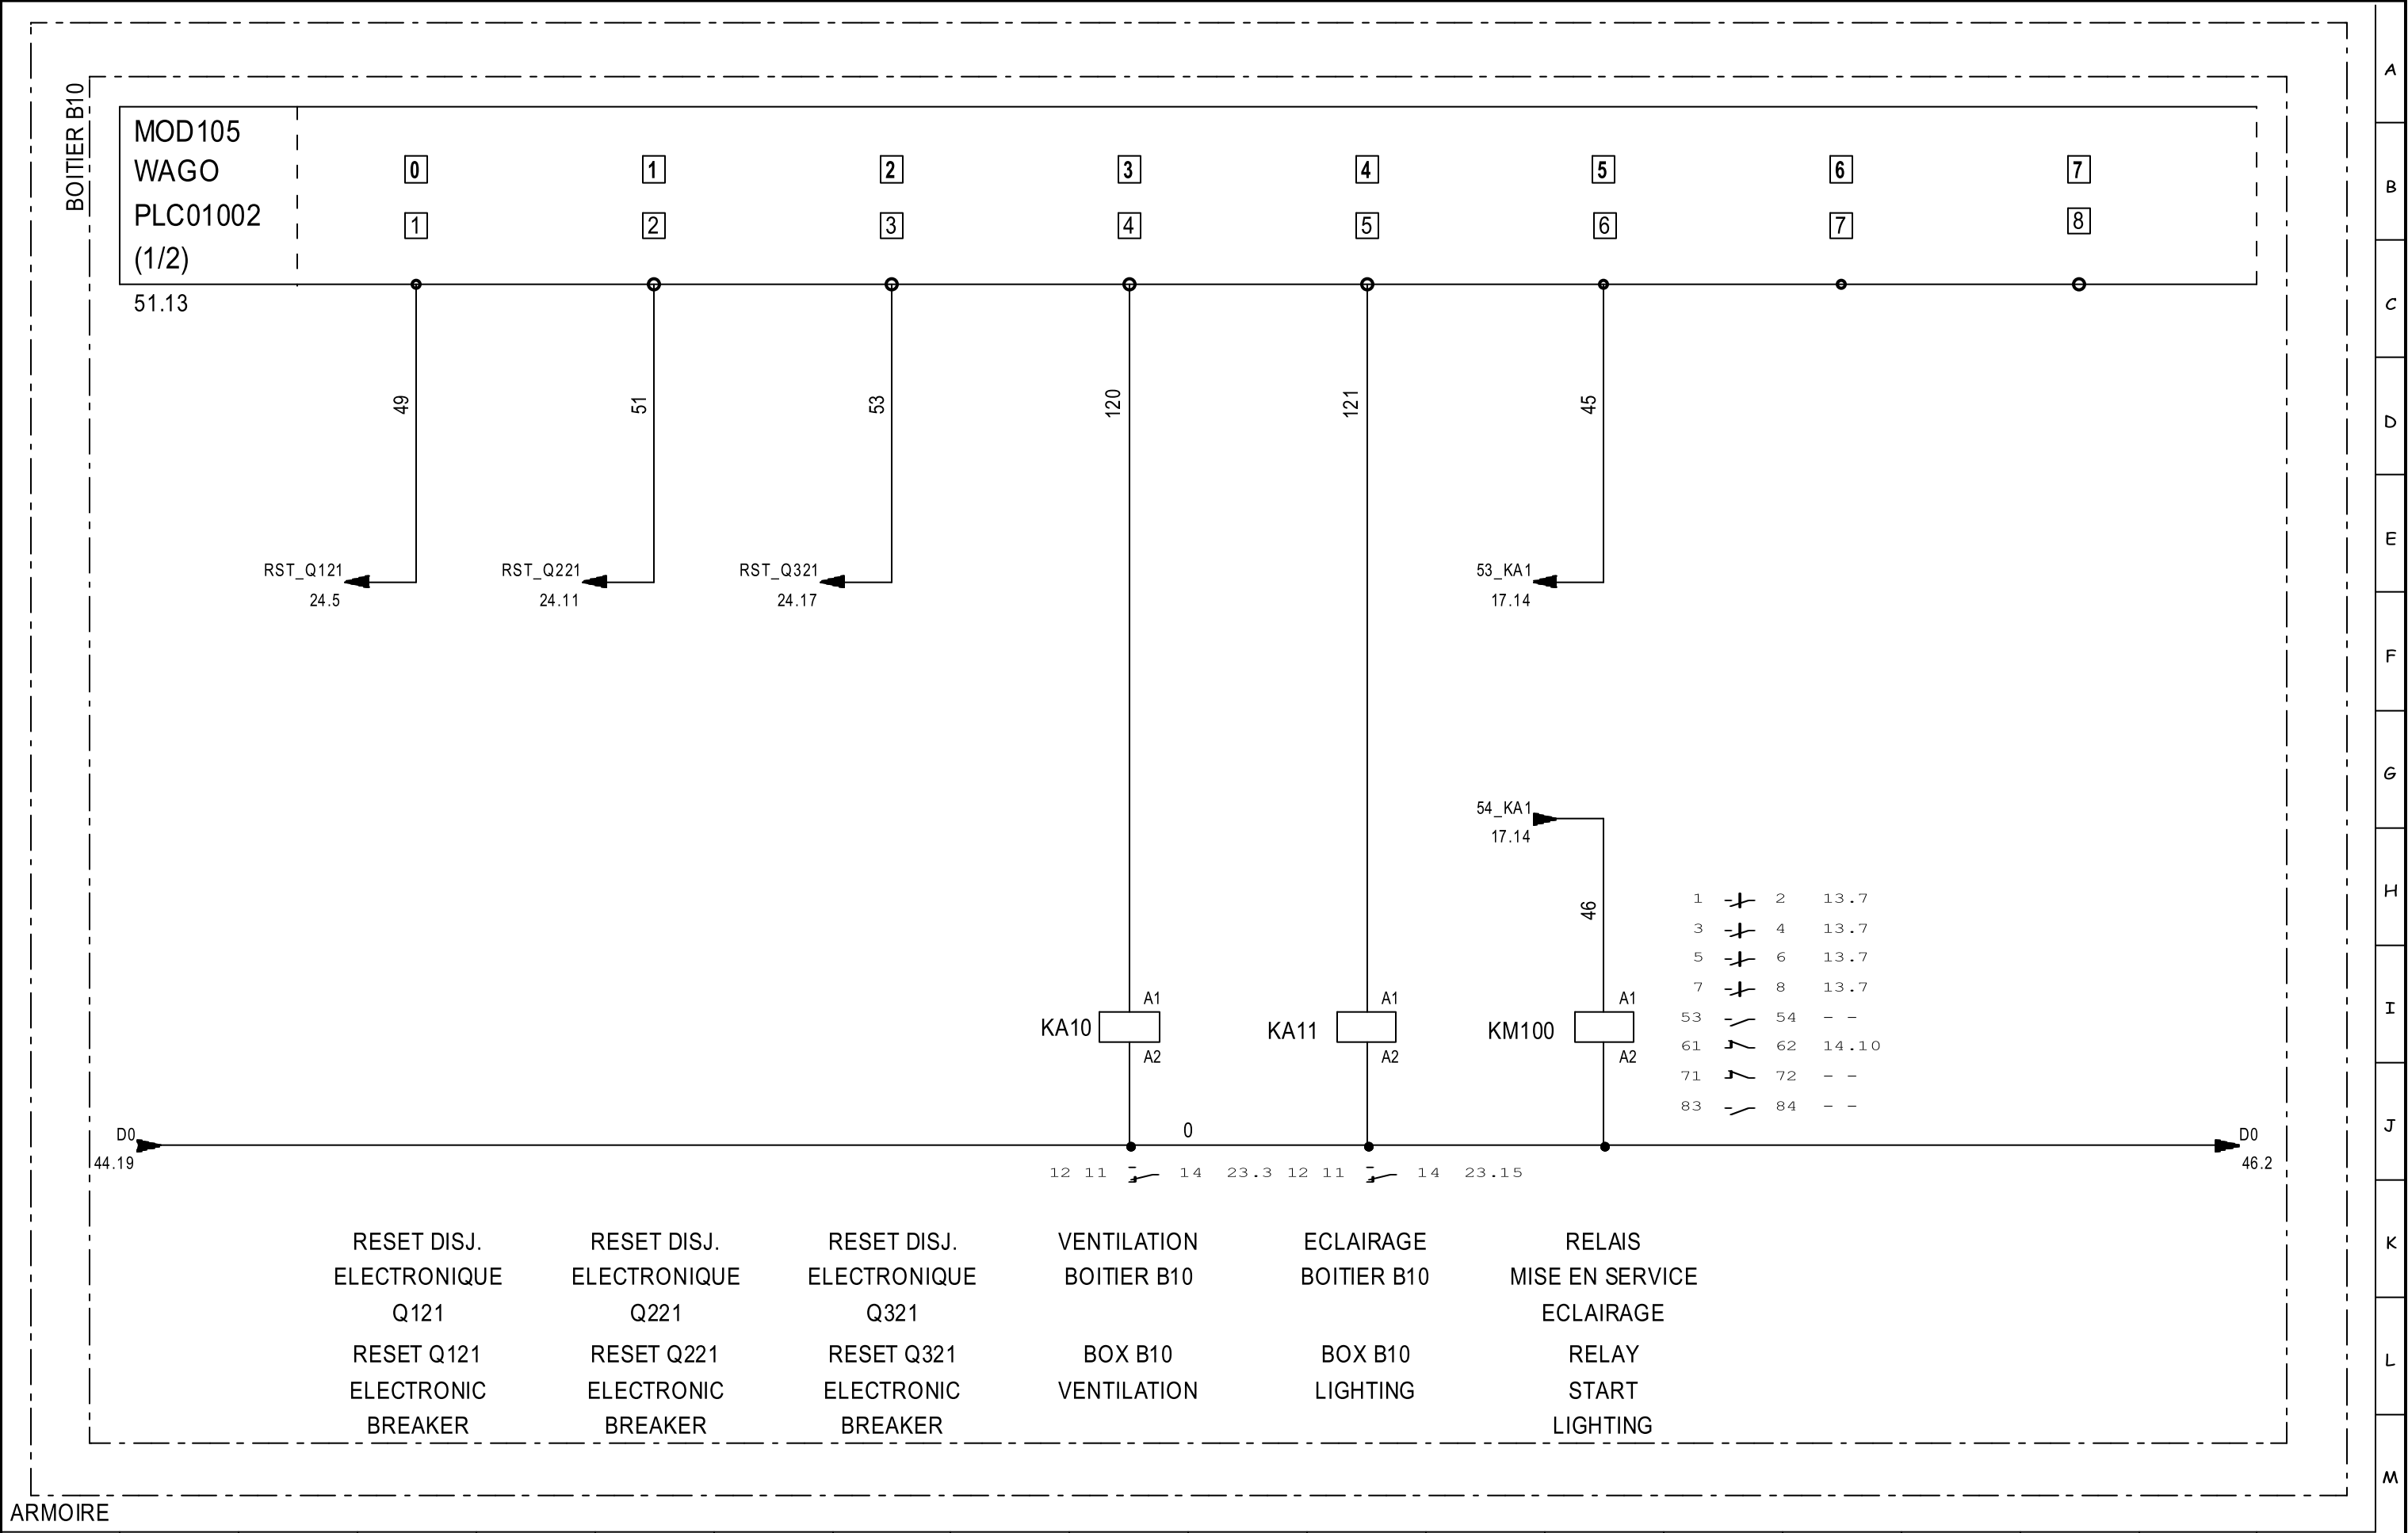


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

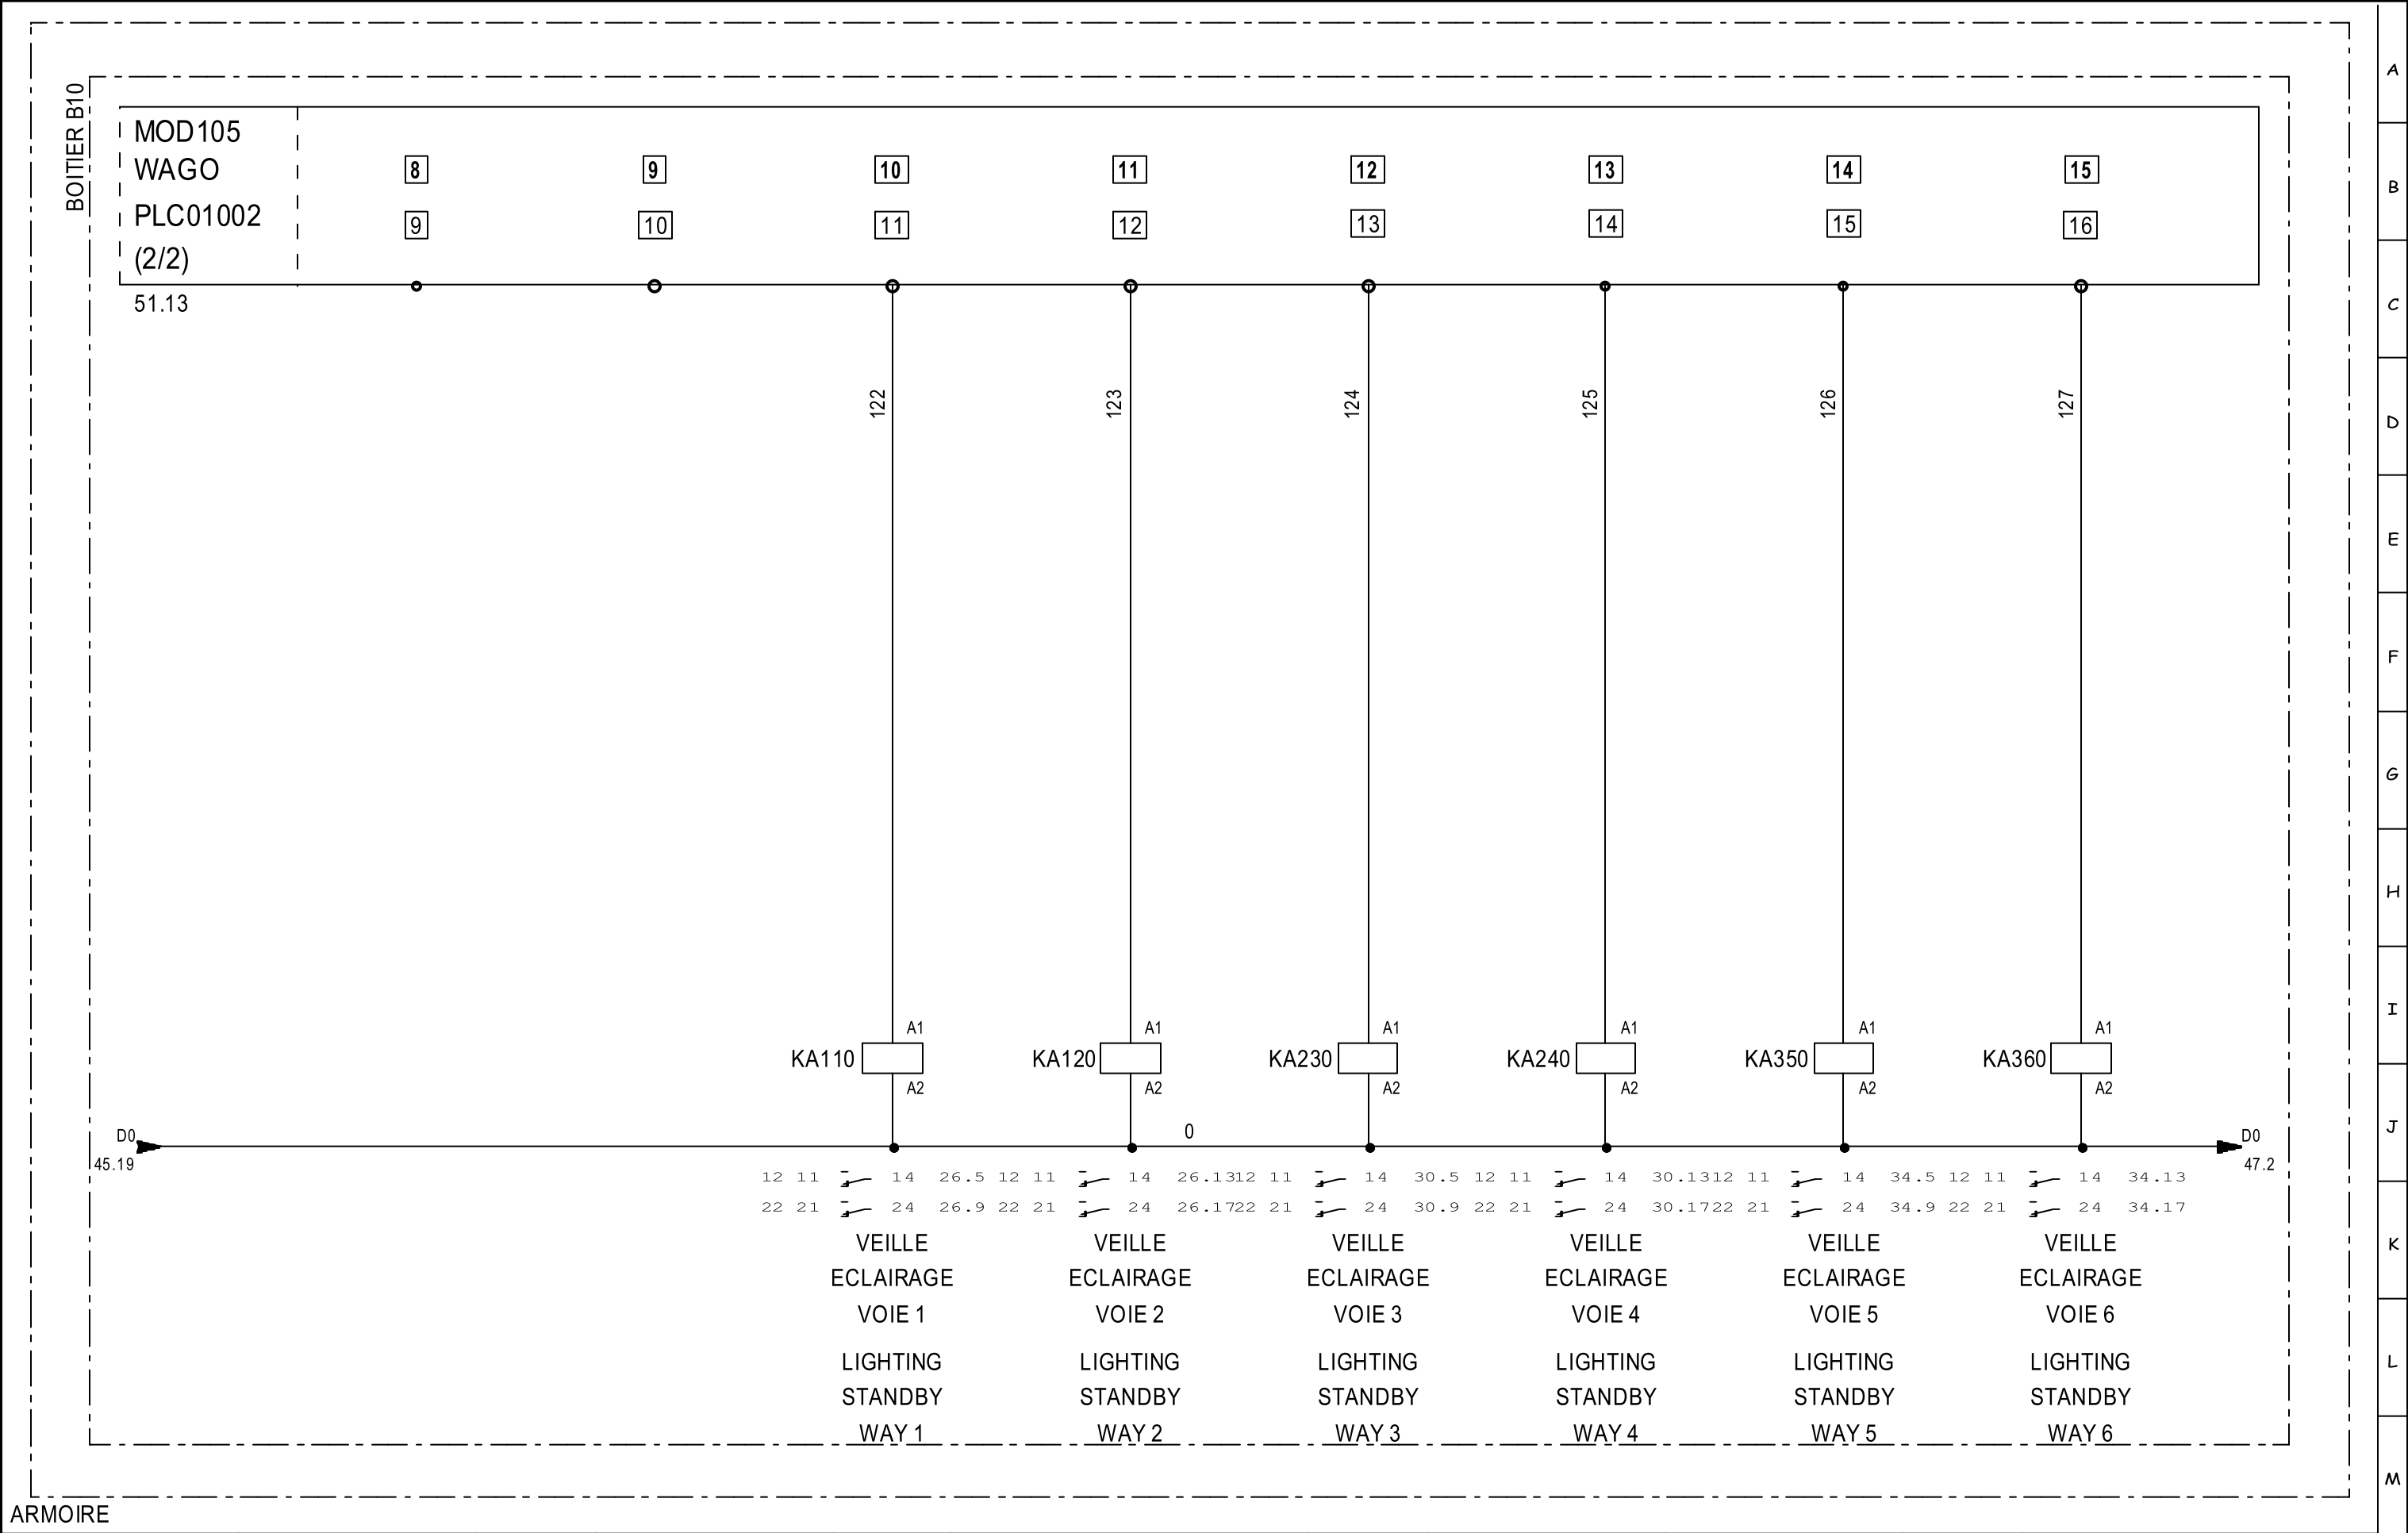


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD105				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD105								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 46/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

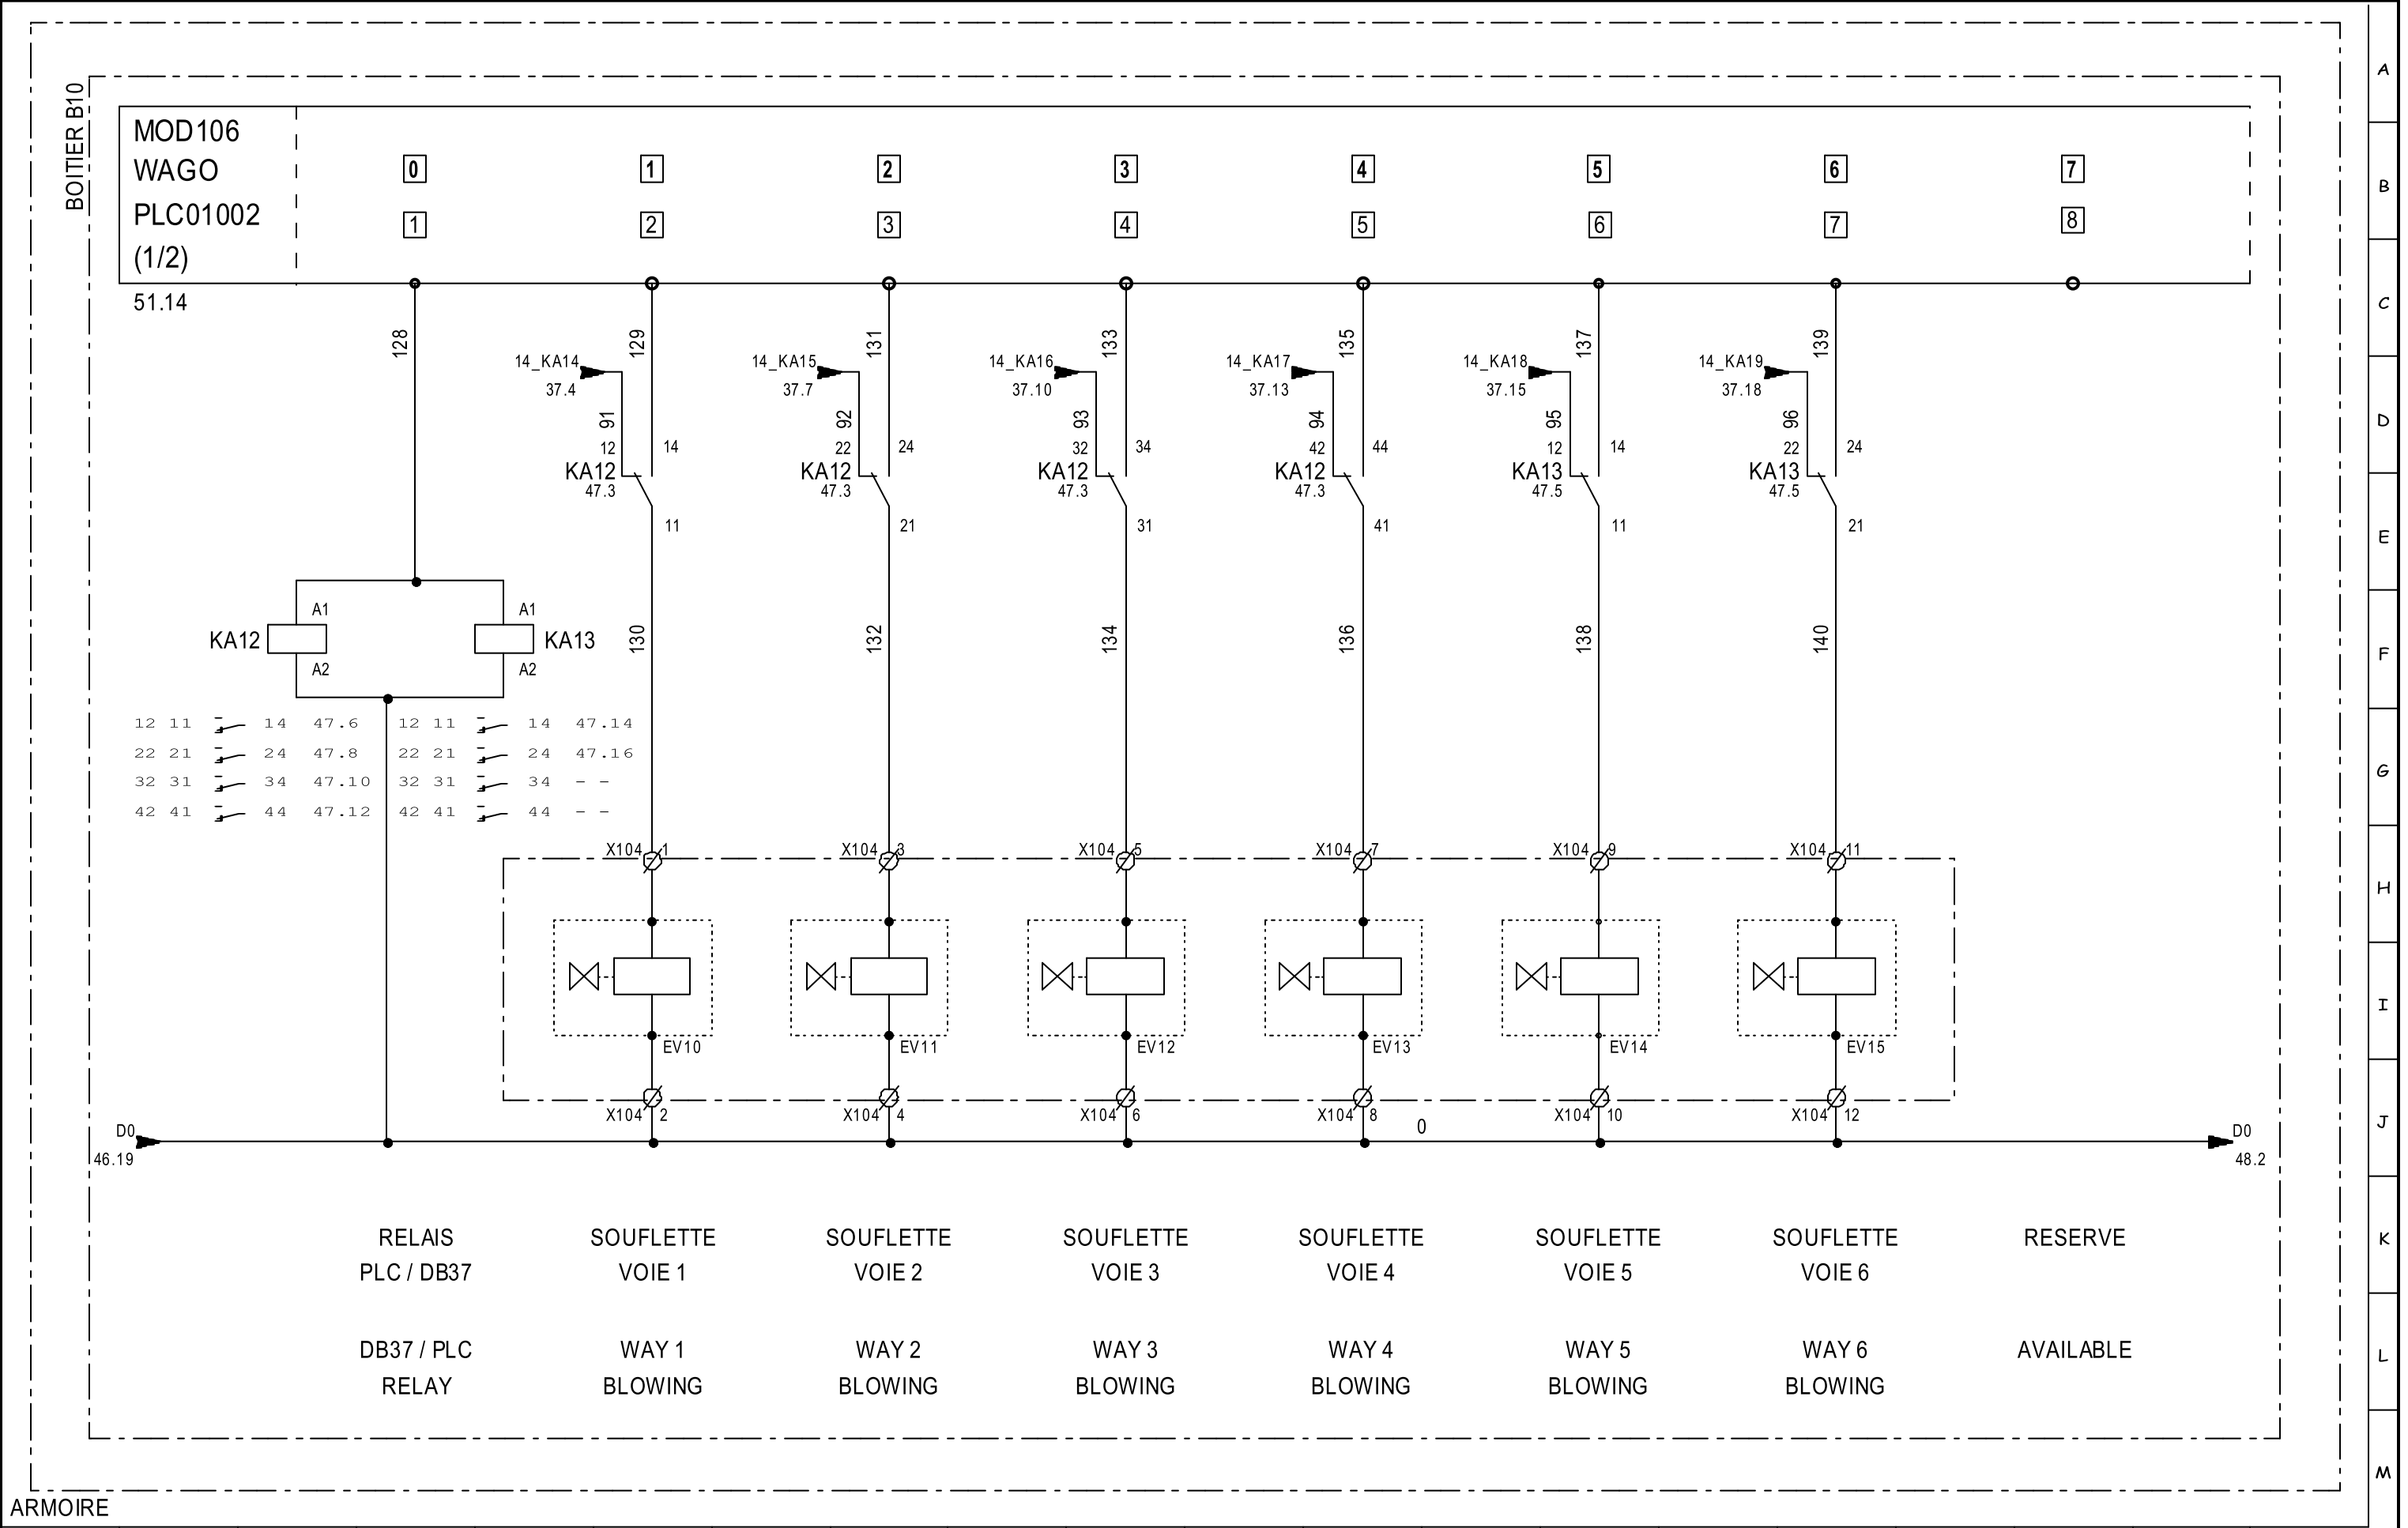


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		SORTIES MOD106				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD106								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 47/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

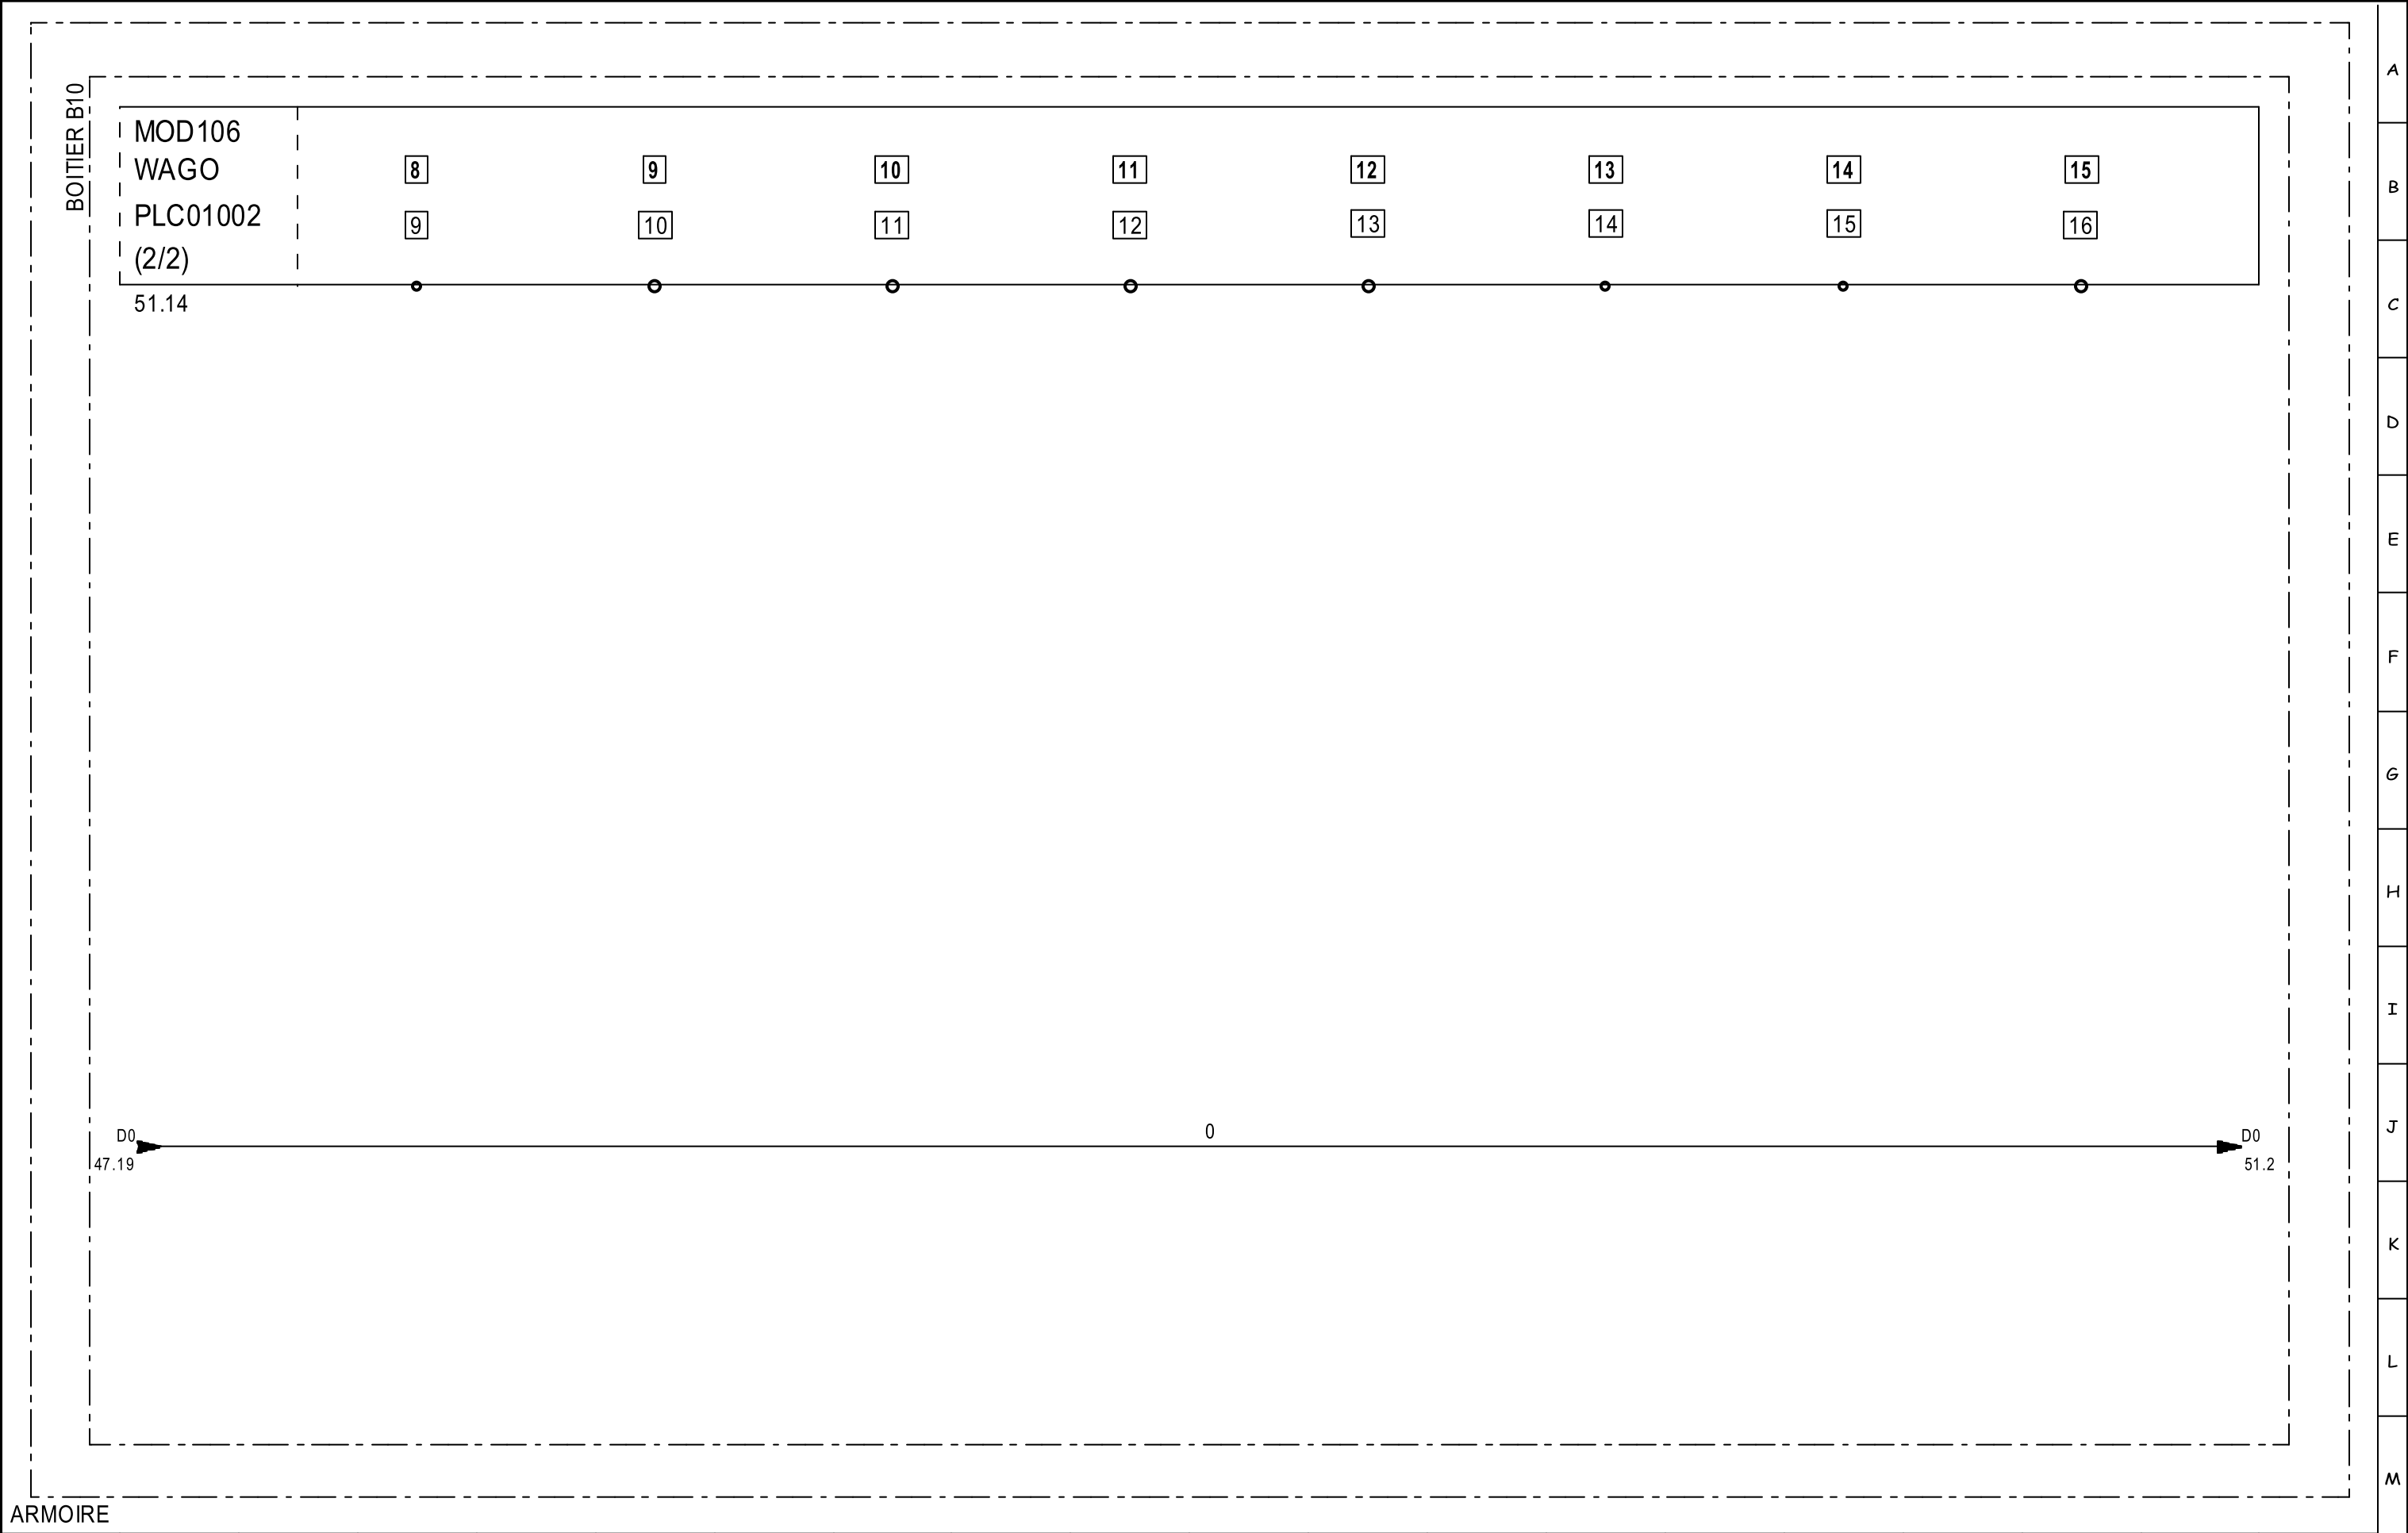

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		SORTIES MOD106				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		OUTPUTS MOD106								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 48/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

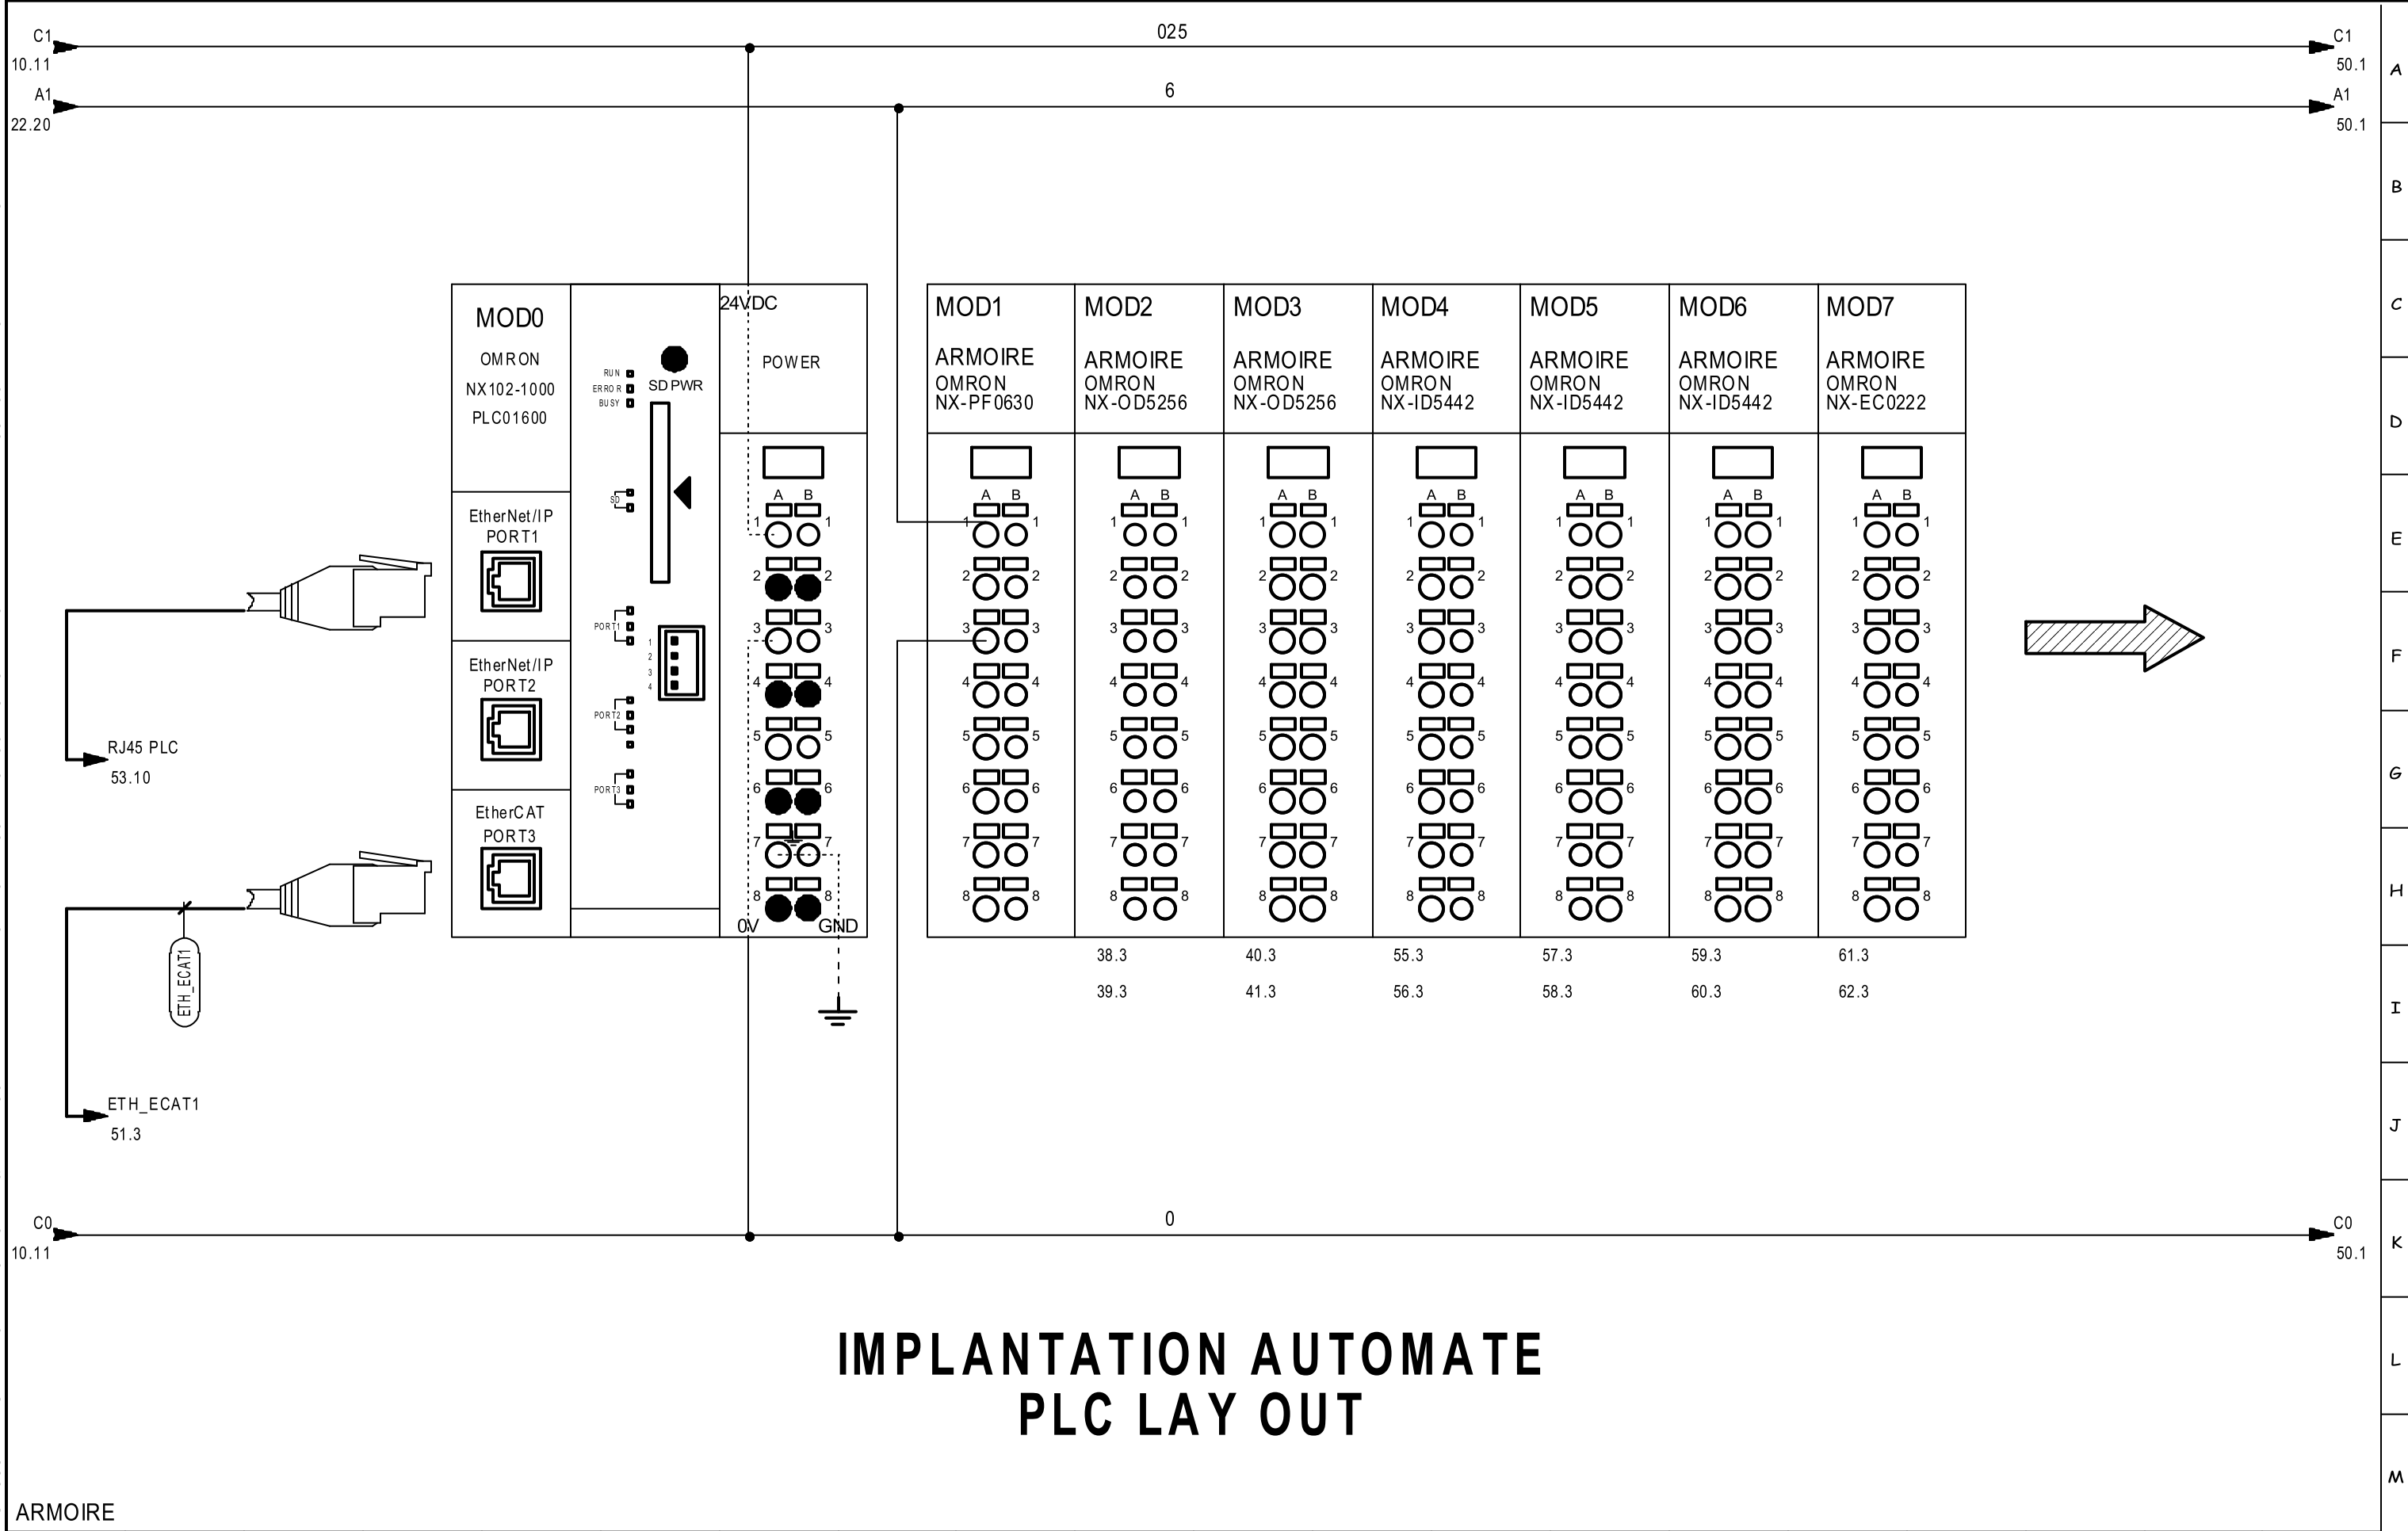


IMPLANTATION AUTOMATE PLC LAY OUT

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION AUTOMATE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		PLC LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020										FOLIO : 49/144					


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation : 05/04/2024		IMPLANTATION AUTOMATE				Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		PLC LAY OUT								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 50/144	

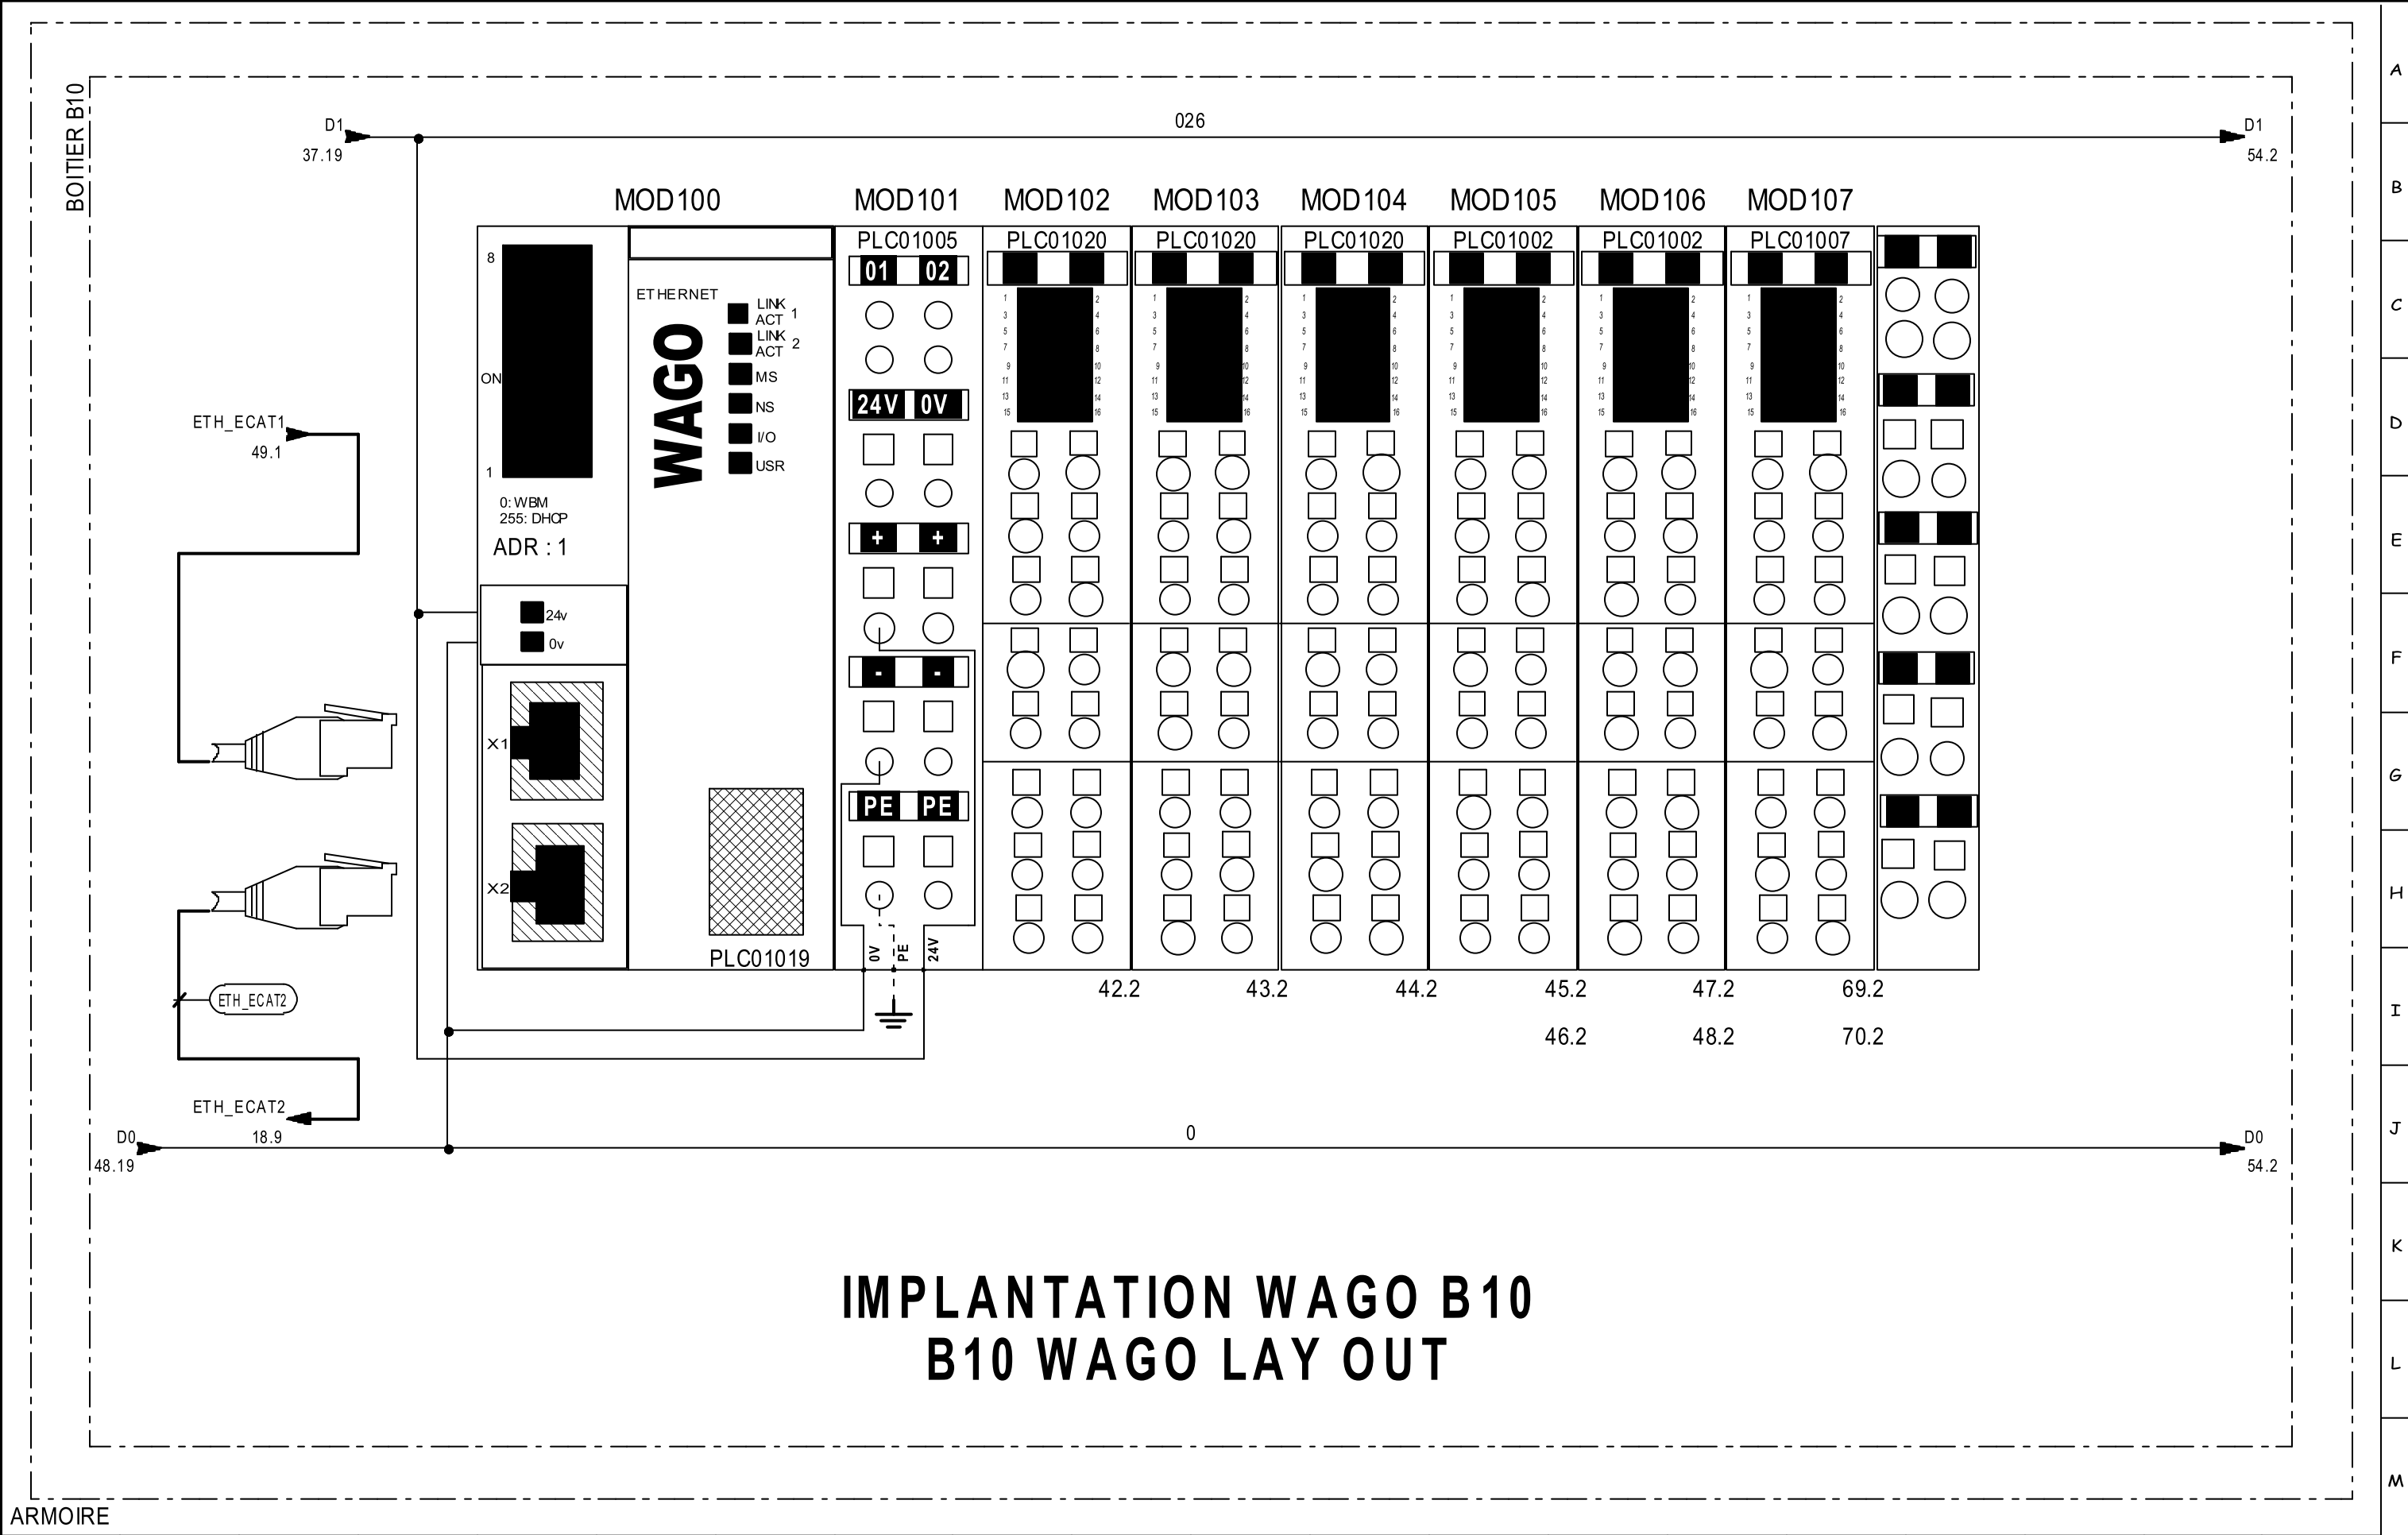

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecaticid.service@ceva.com		Date of creation : Designed by : DB		IMPLANTATION WAGO B10 WAGO B10 LAY OUT ENVIRONNEMENT : Version 4.49.F - 23/09/2020		ceva Ecat-iD Campus		CONTRACT : INTERNE		CUSTOMER : INTERNE		ARTICLE : SMXA0002		COUNTRY : FRANCE		INDEX : V6 FOLIO : 51/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

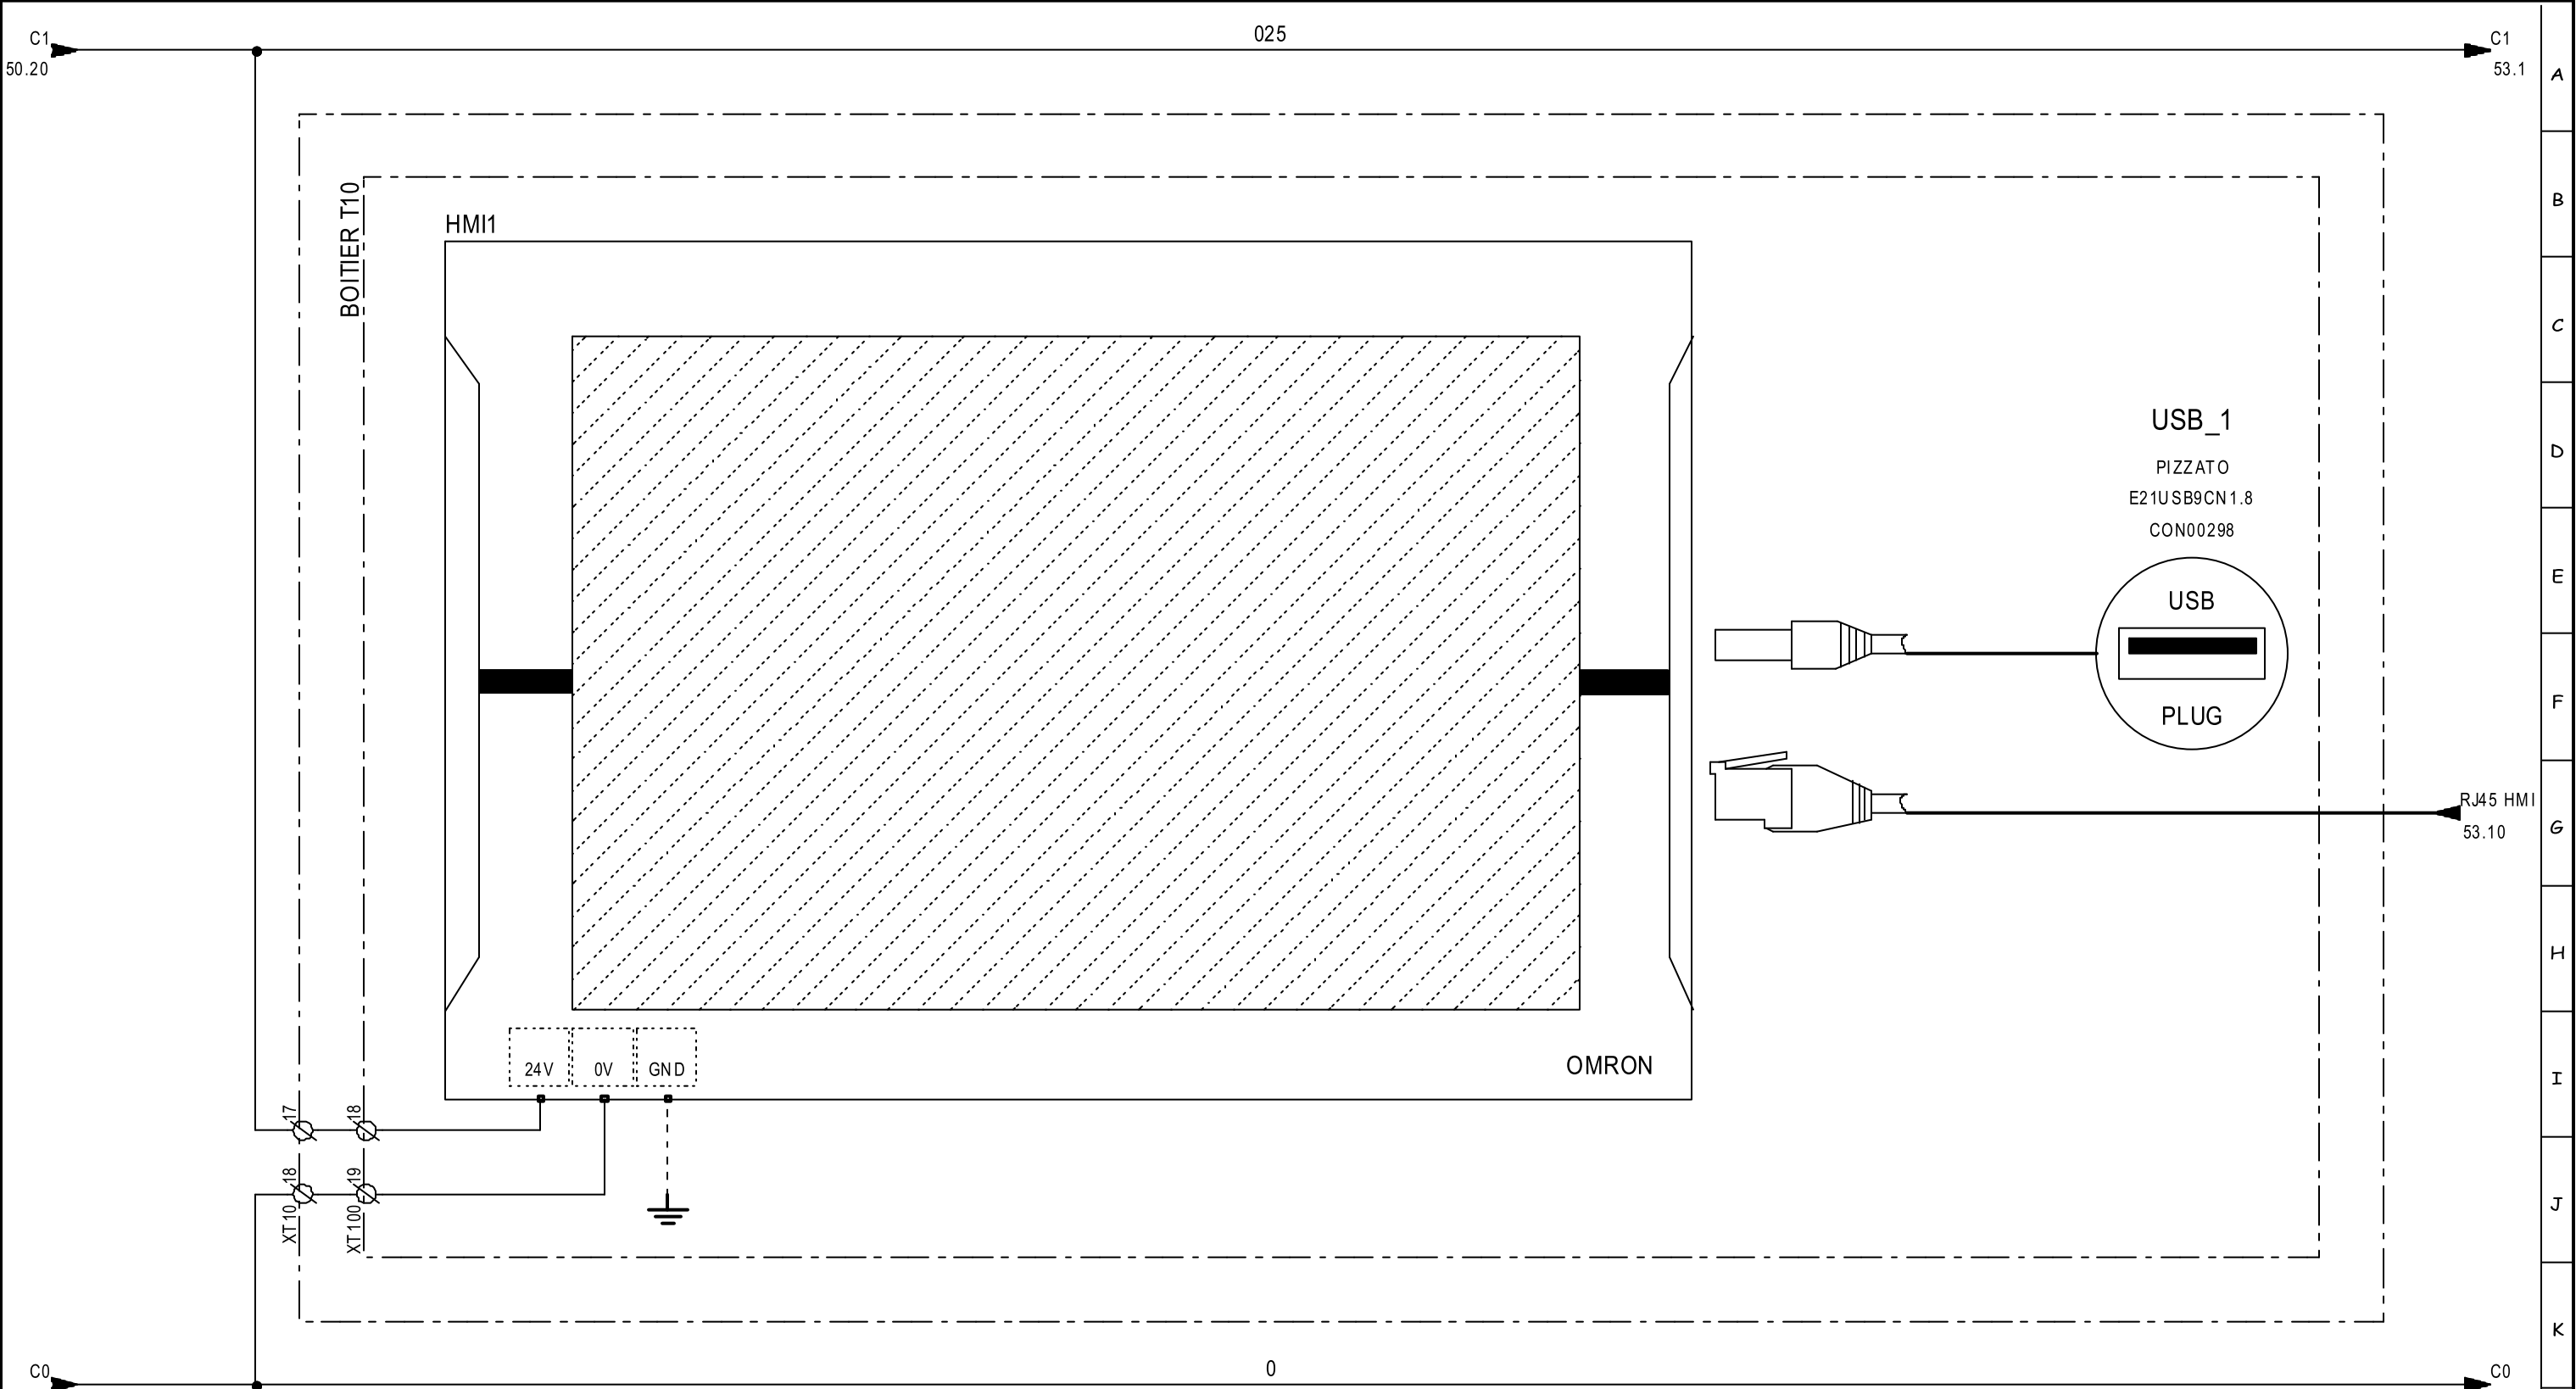


IMPLANTATION IHM

IHM LAY OUT

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION IHM				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		DISPLAY LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 52/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

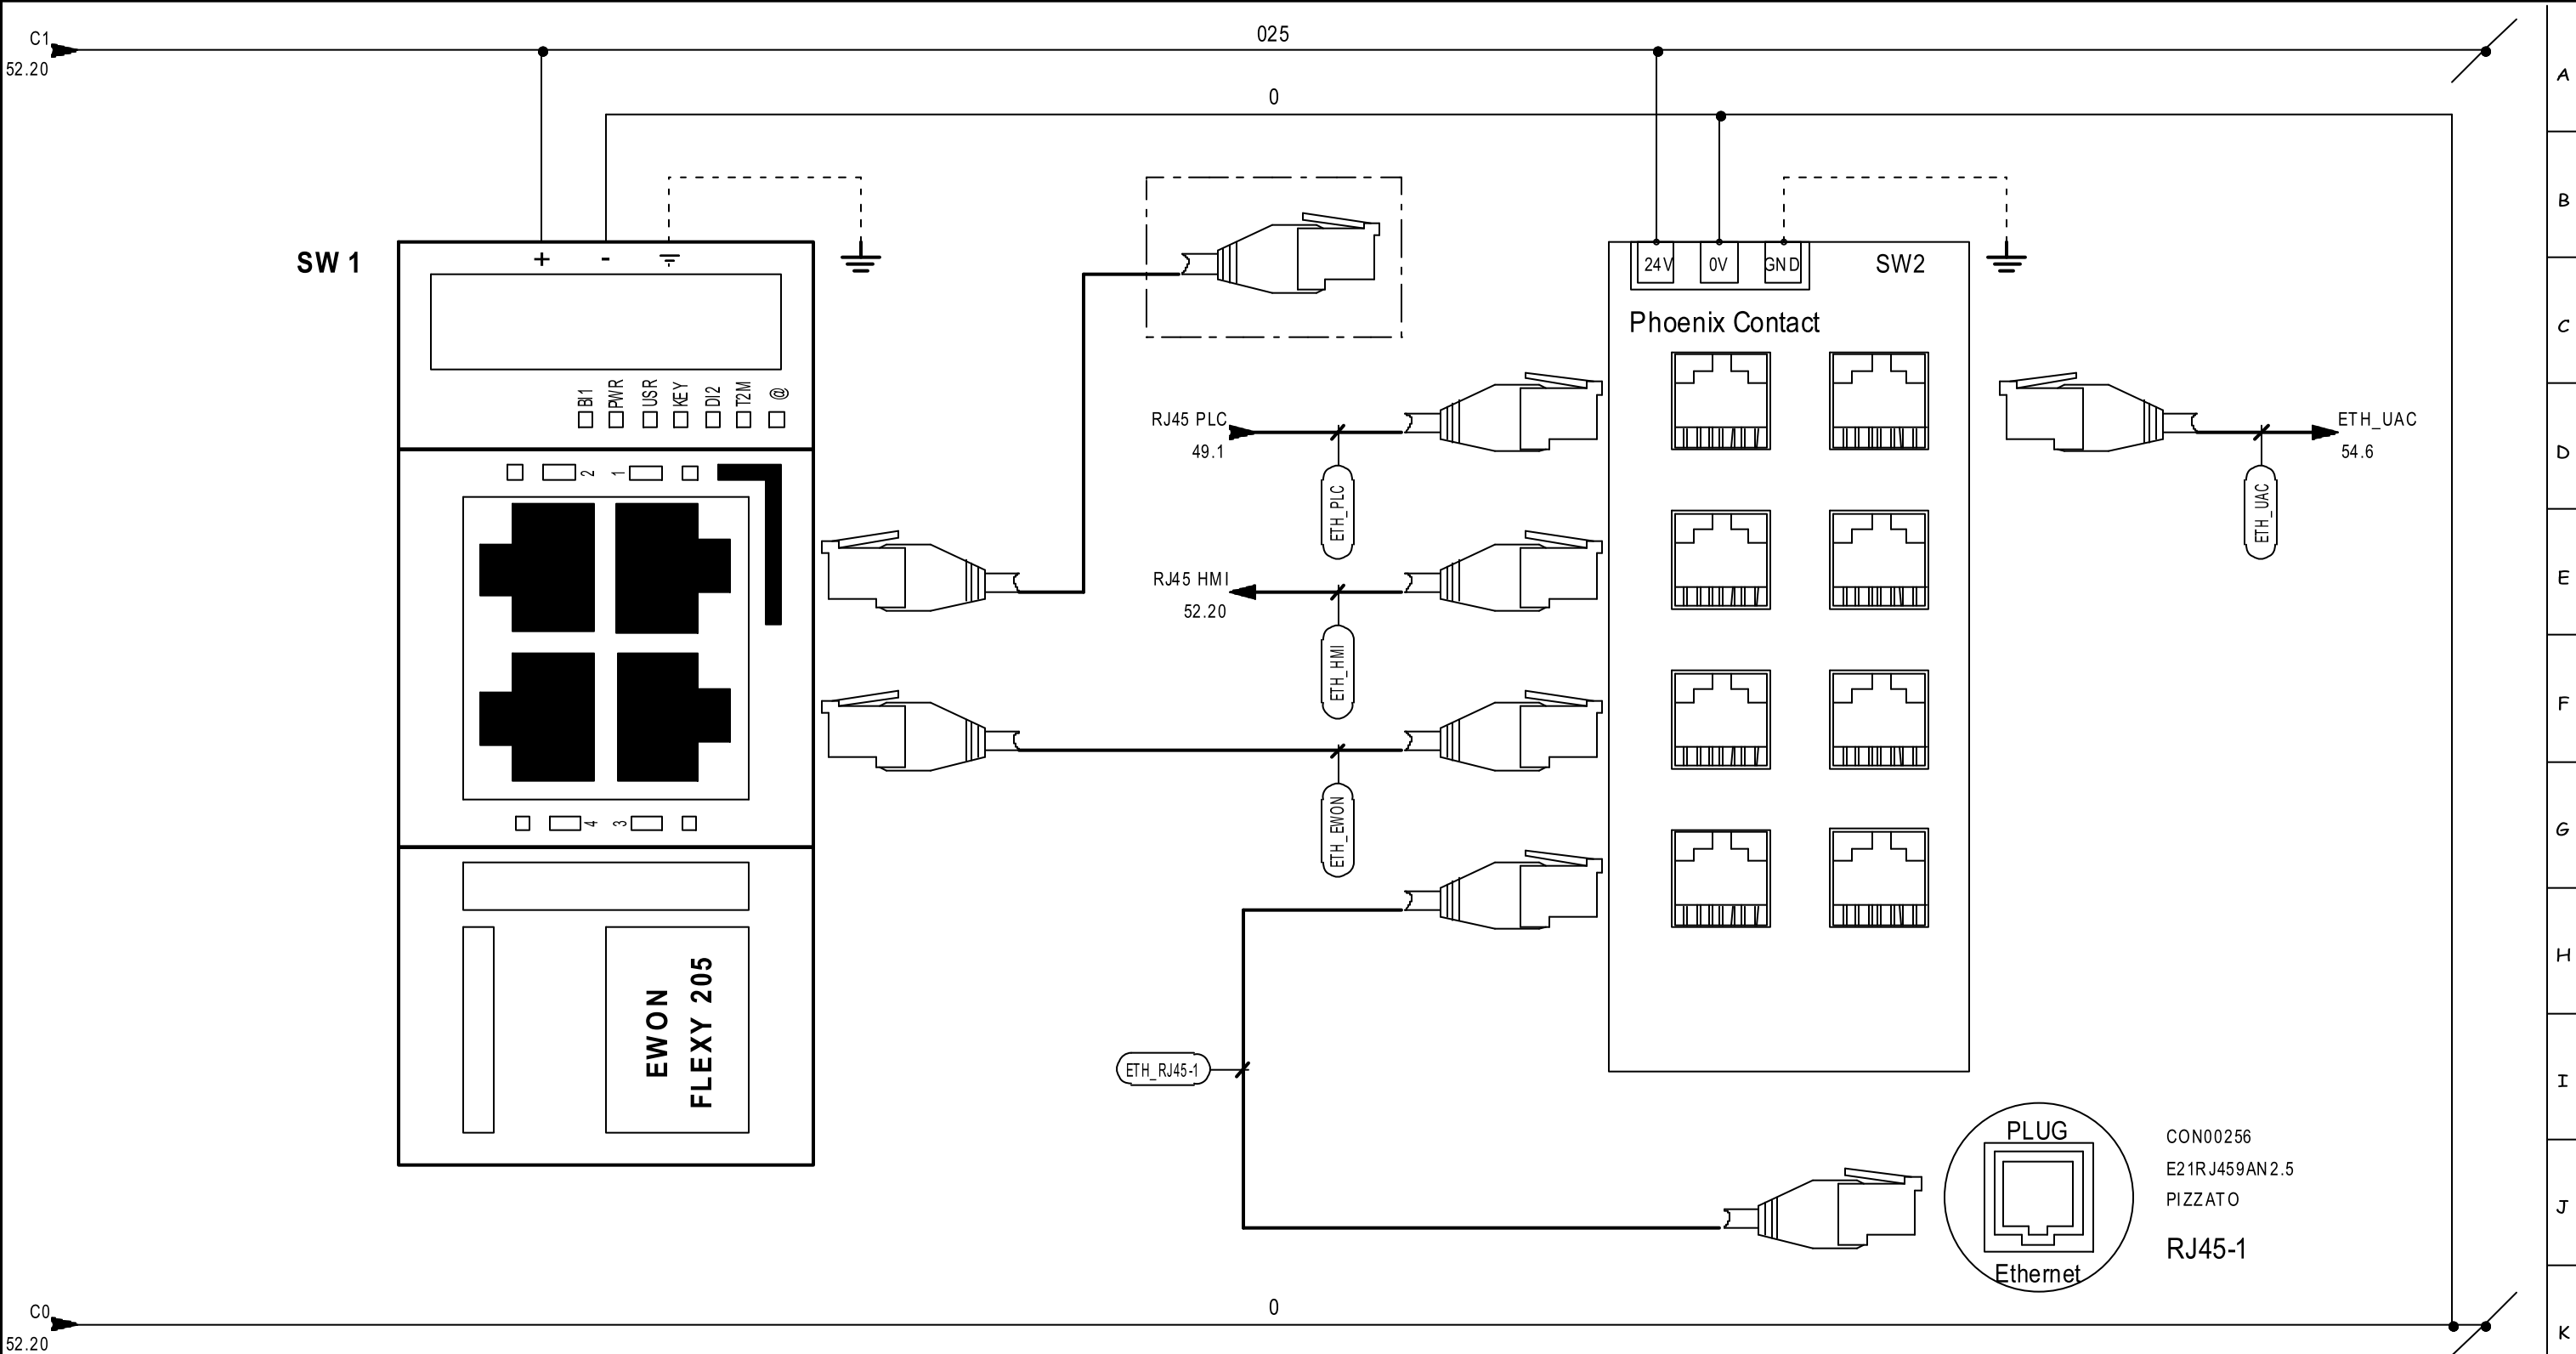


IMPLANTATION RESEAU

NETWORK LAY OUT


ARMOIRE																				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION RESEAU				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		NETWORK LAY OUT								ARTICLE :		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002				FOLIO : 53/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

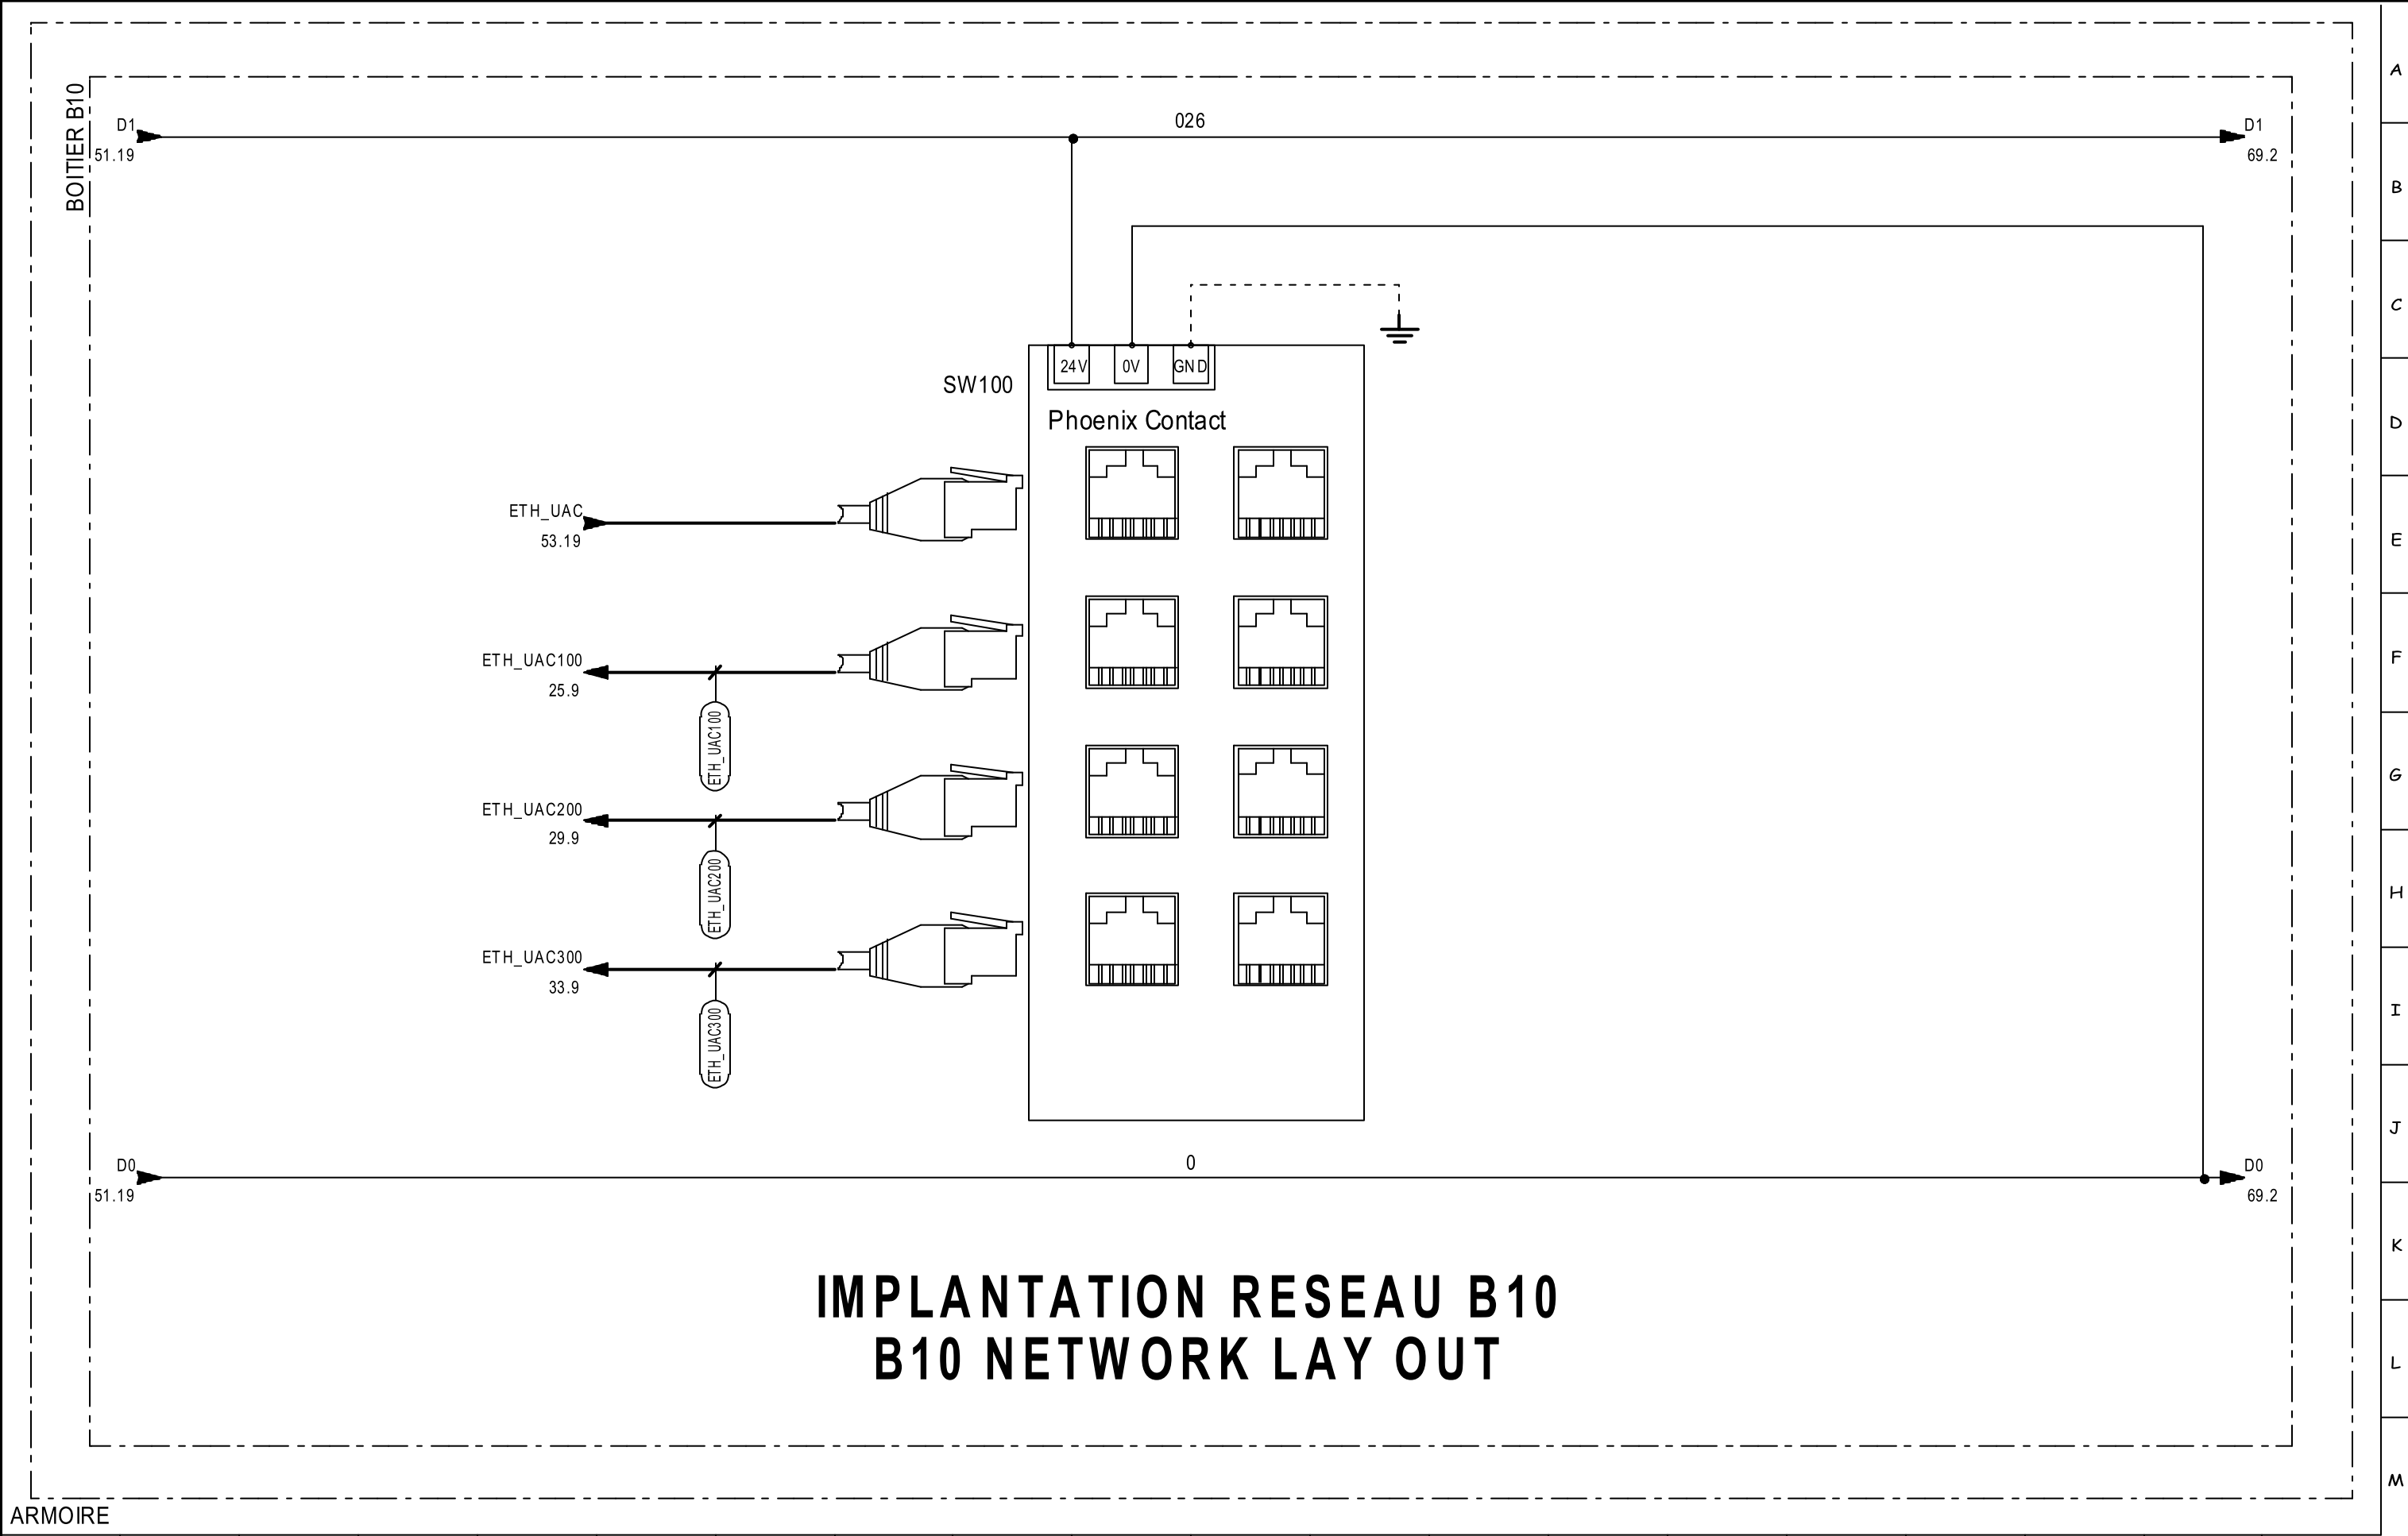


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		IMPLANTATION RESEAU B10				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		B10 NETWORK LAY OUT								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020															
														FOLIO : 54/144						

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

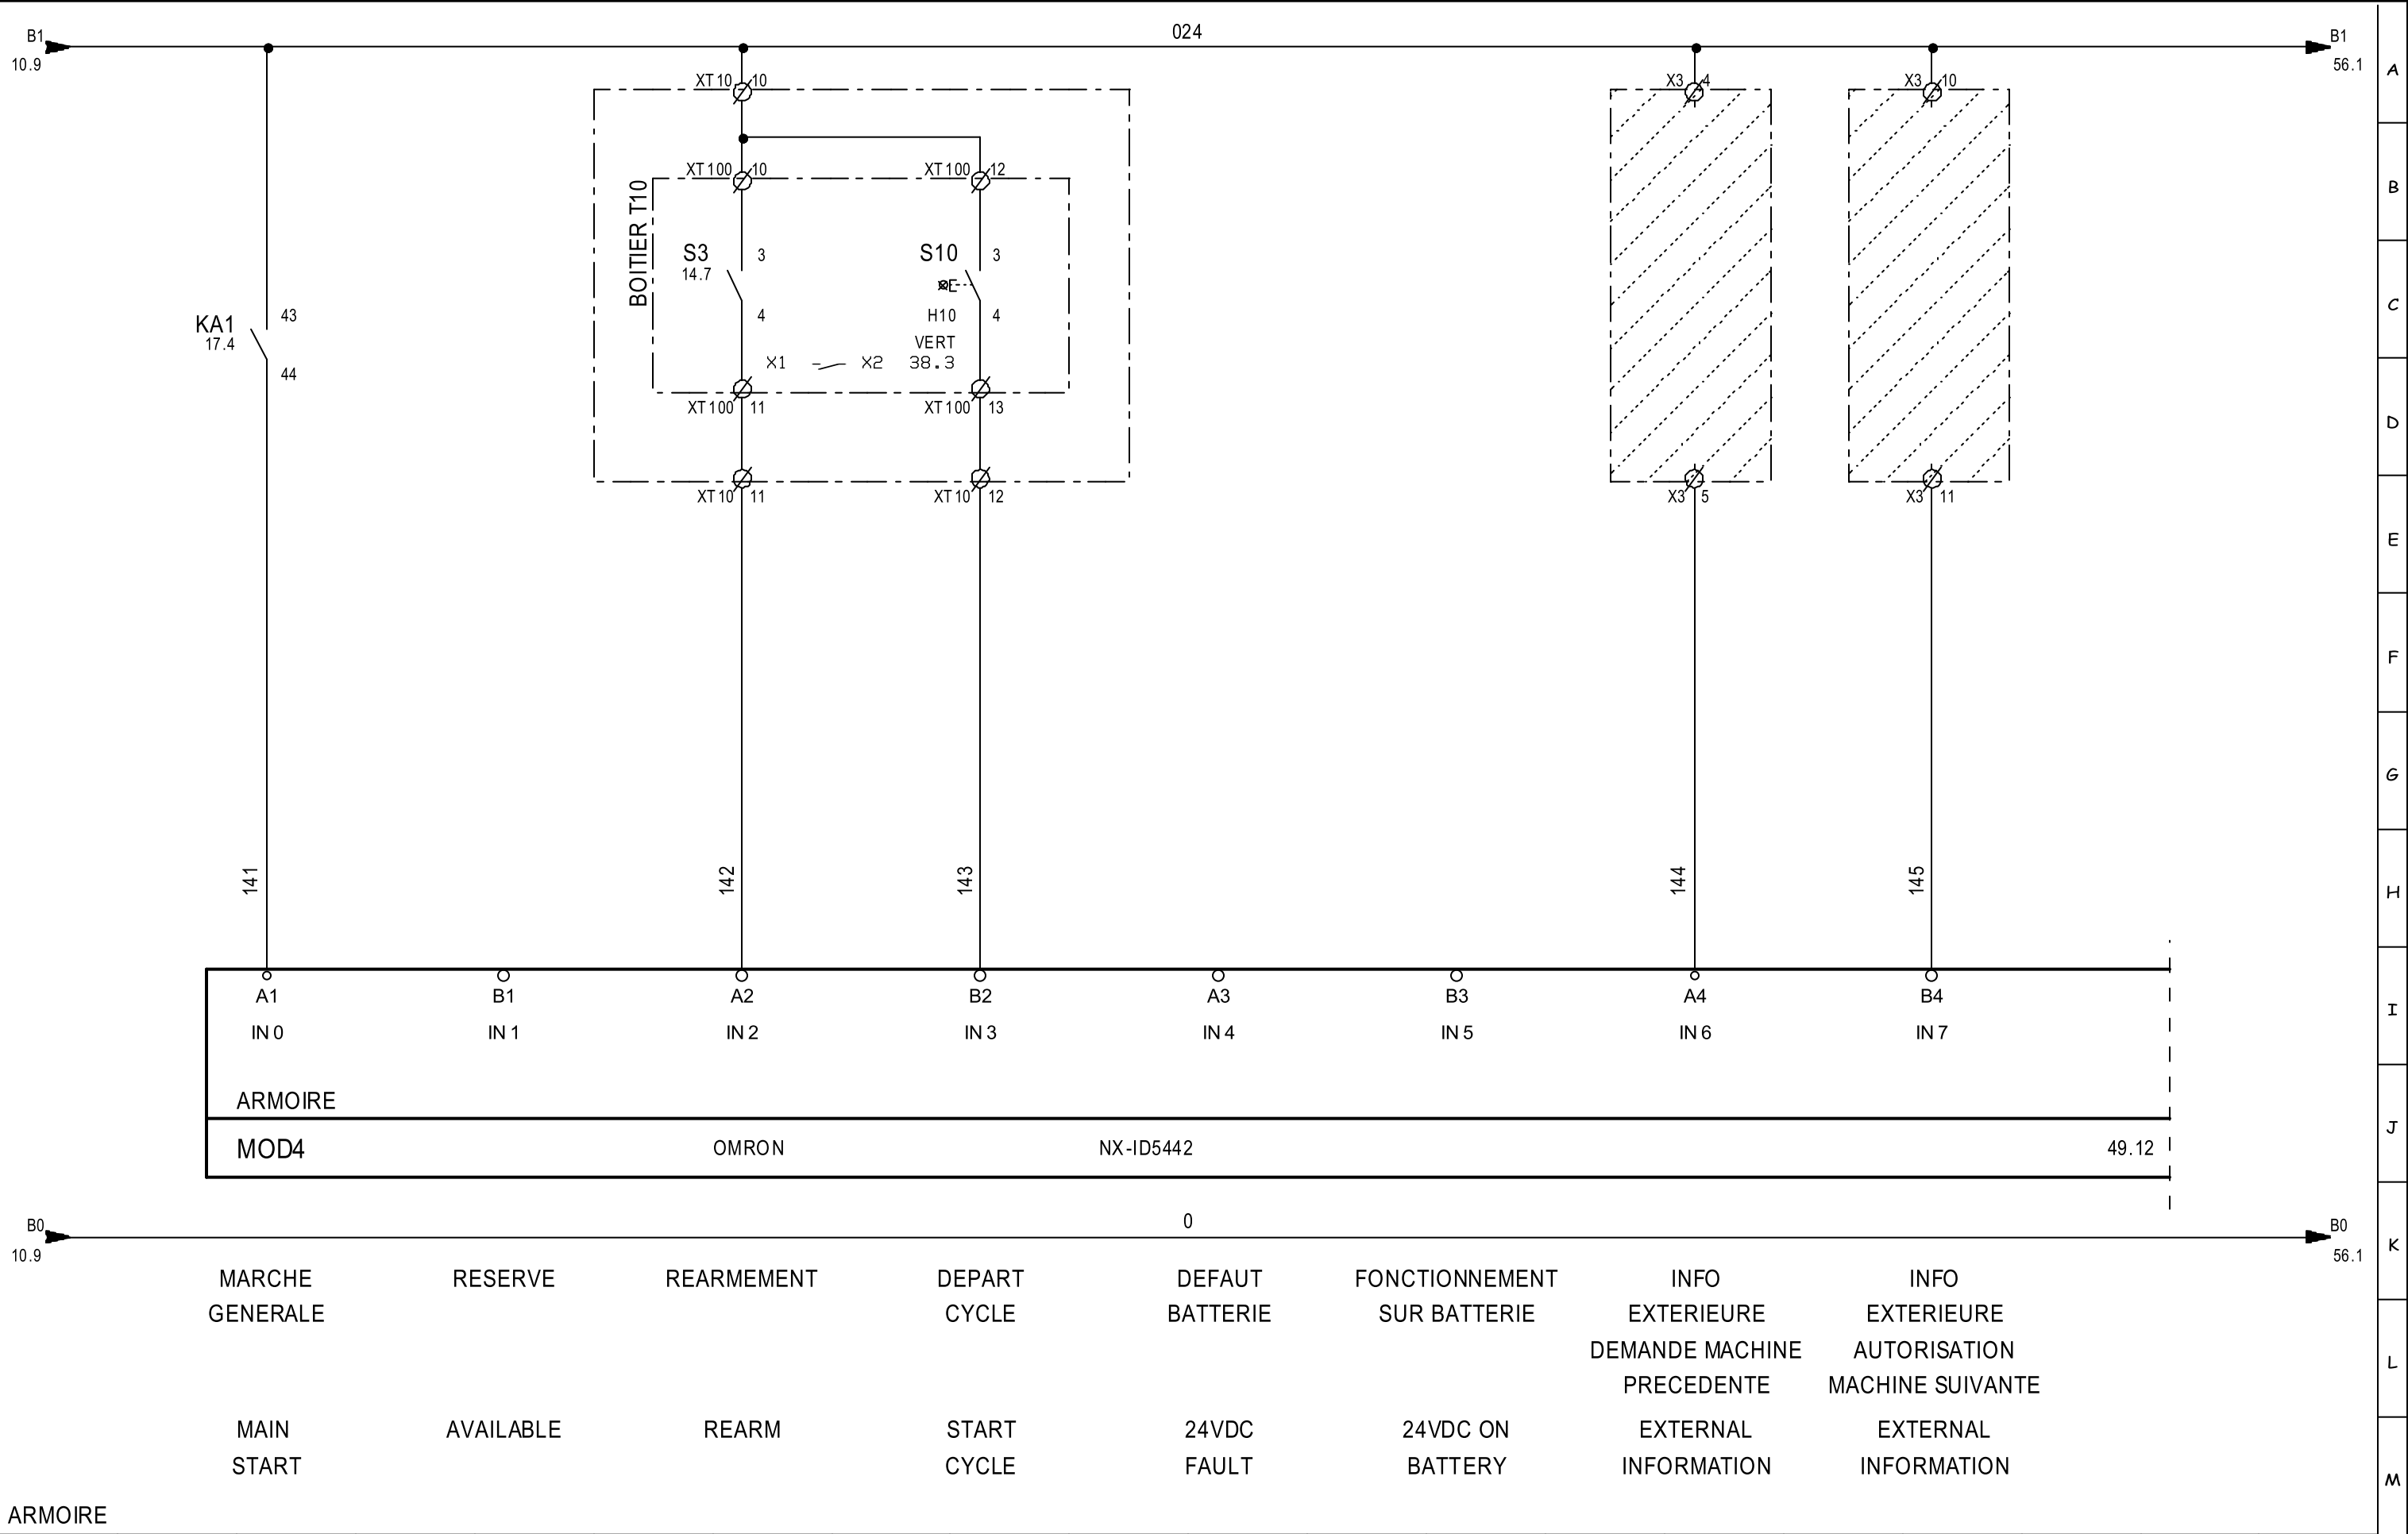


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD4				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD4								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020													


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

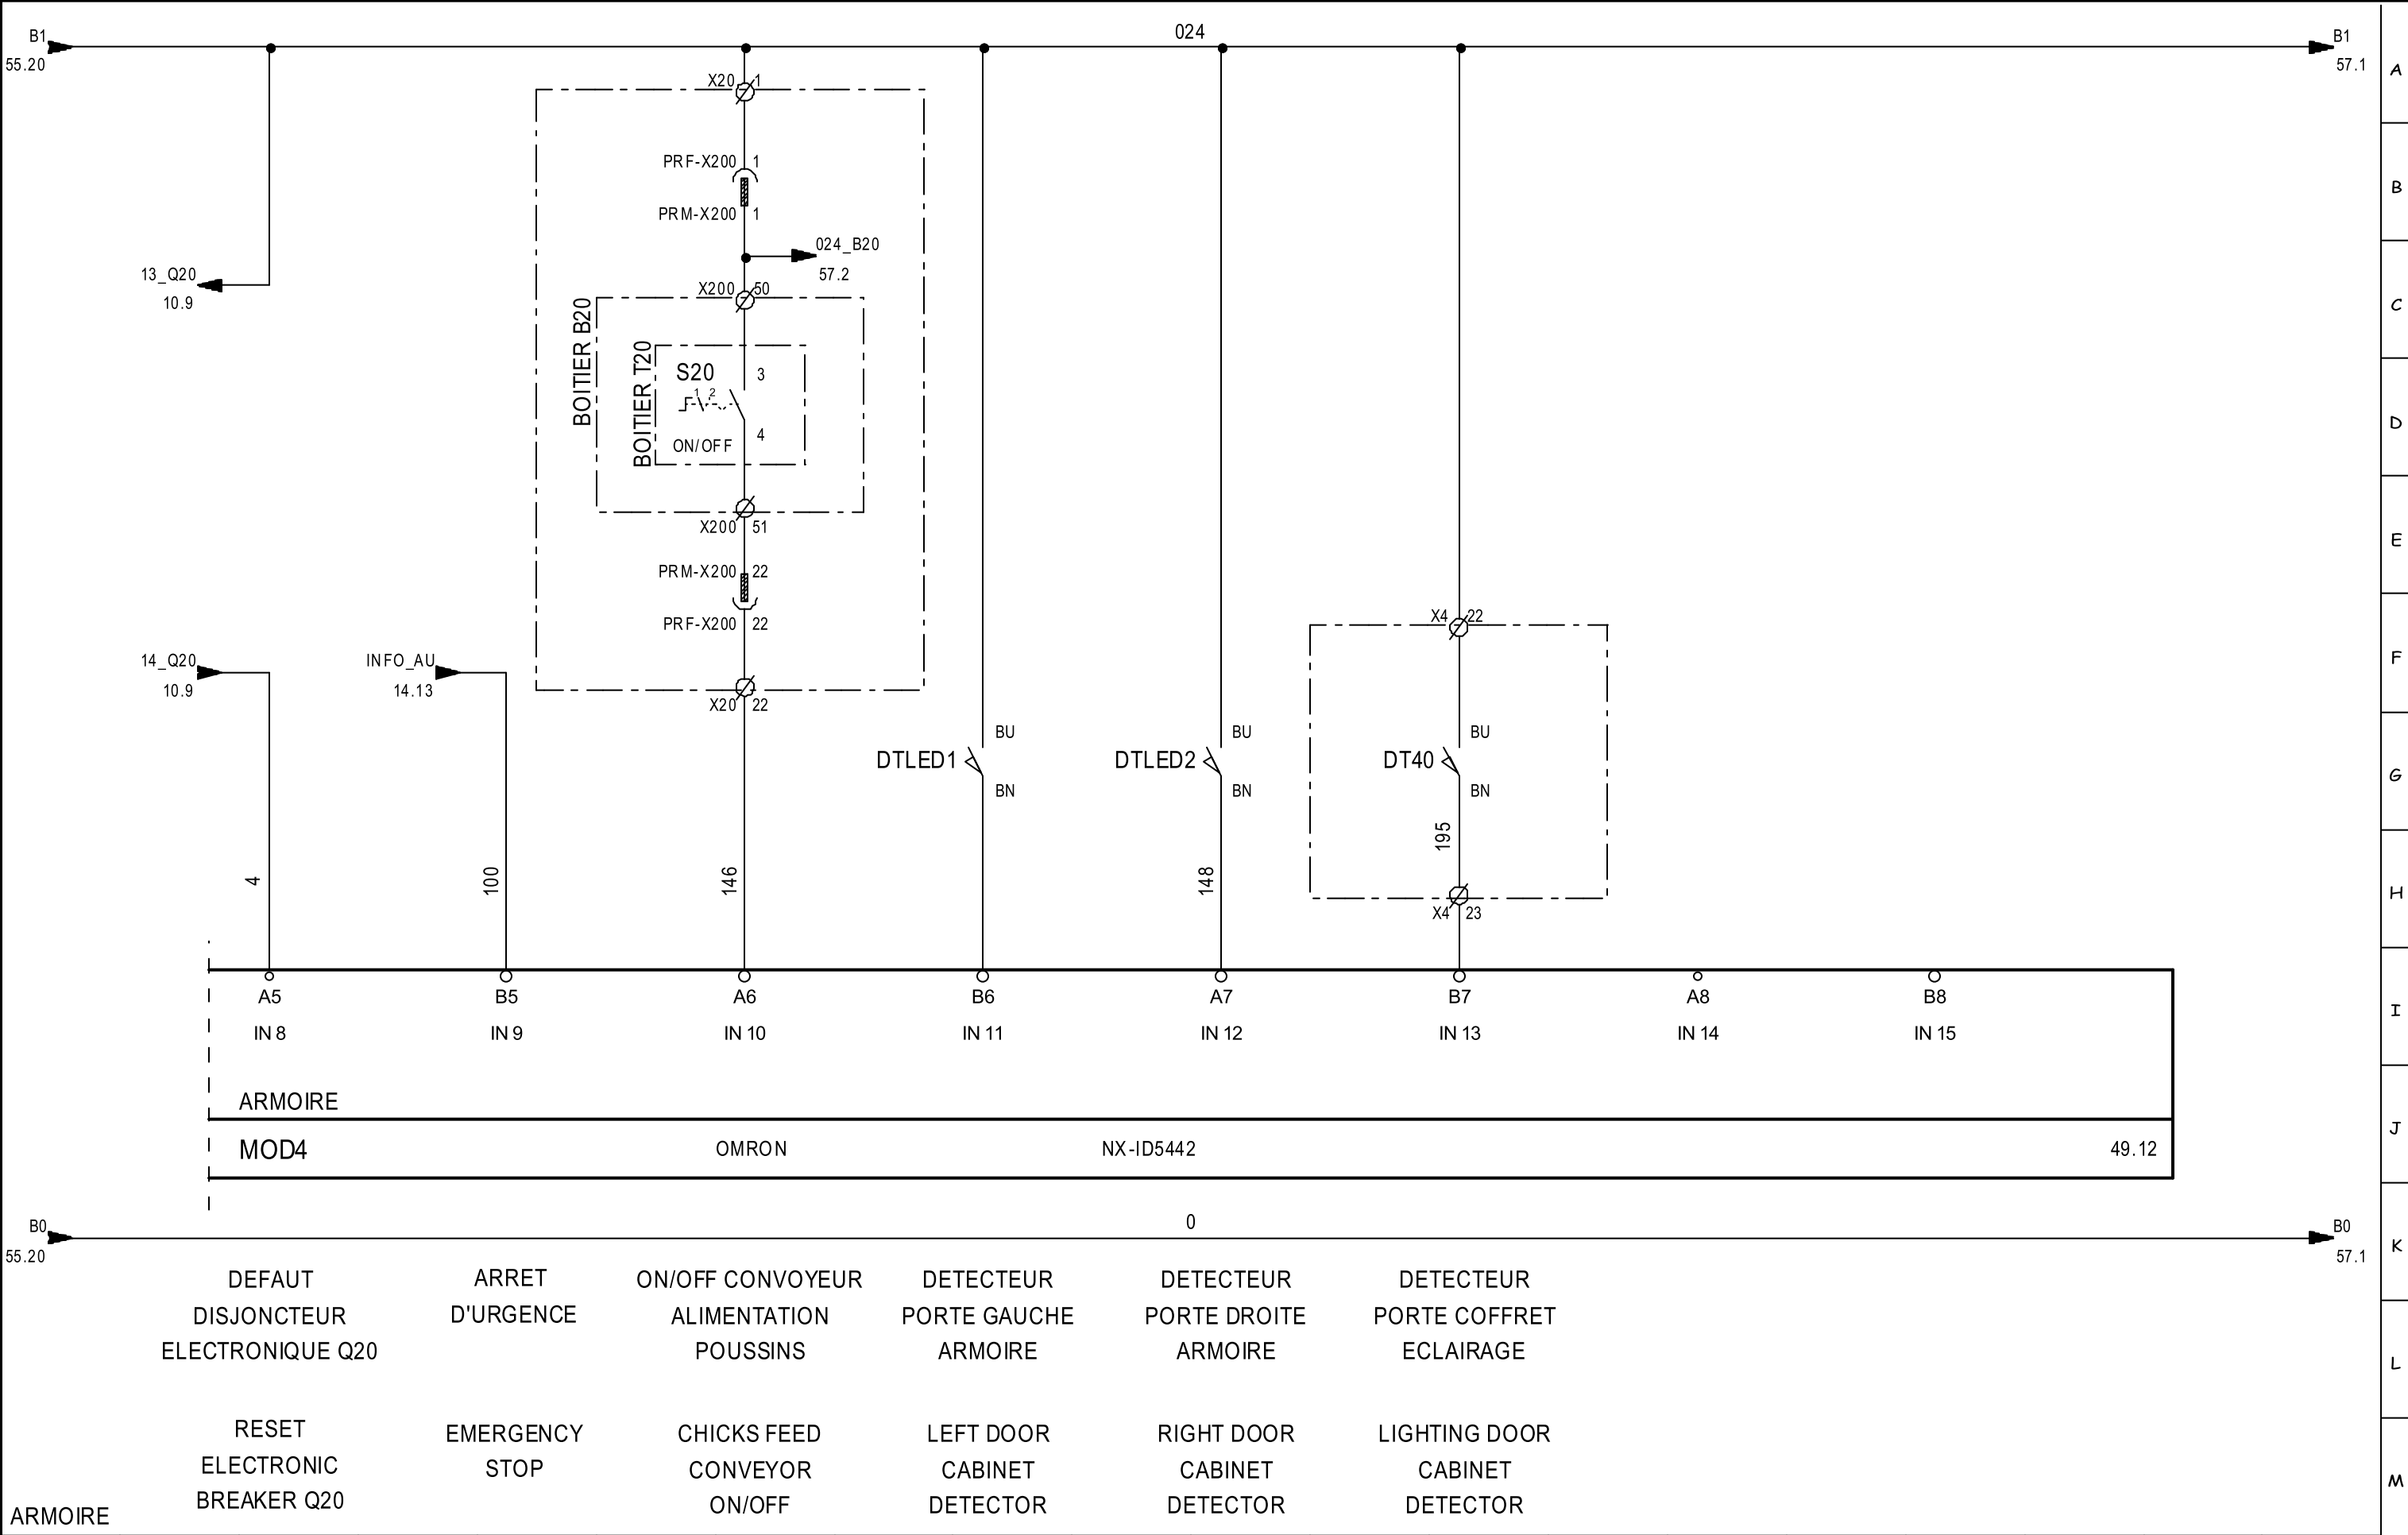


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD4				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD4								ARTICLE :		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 56/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

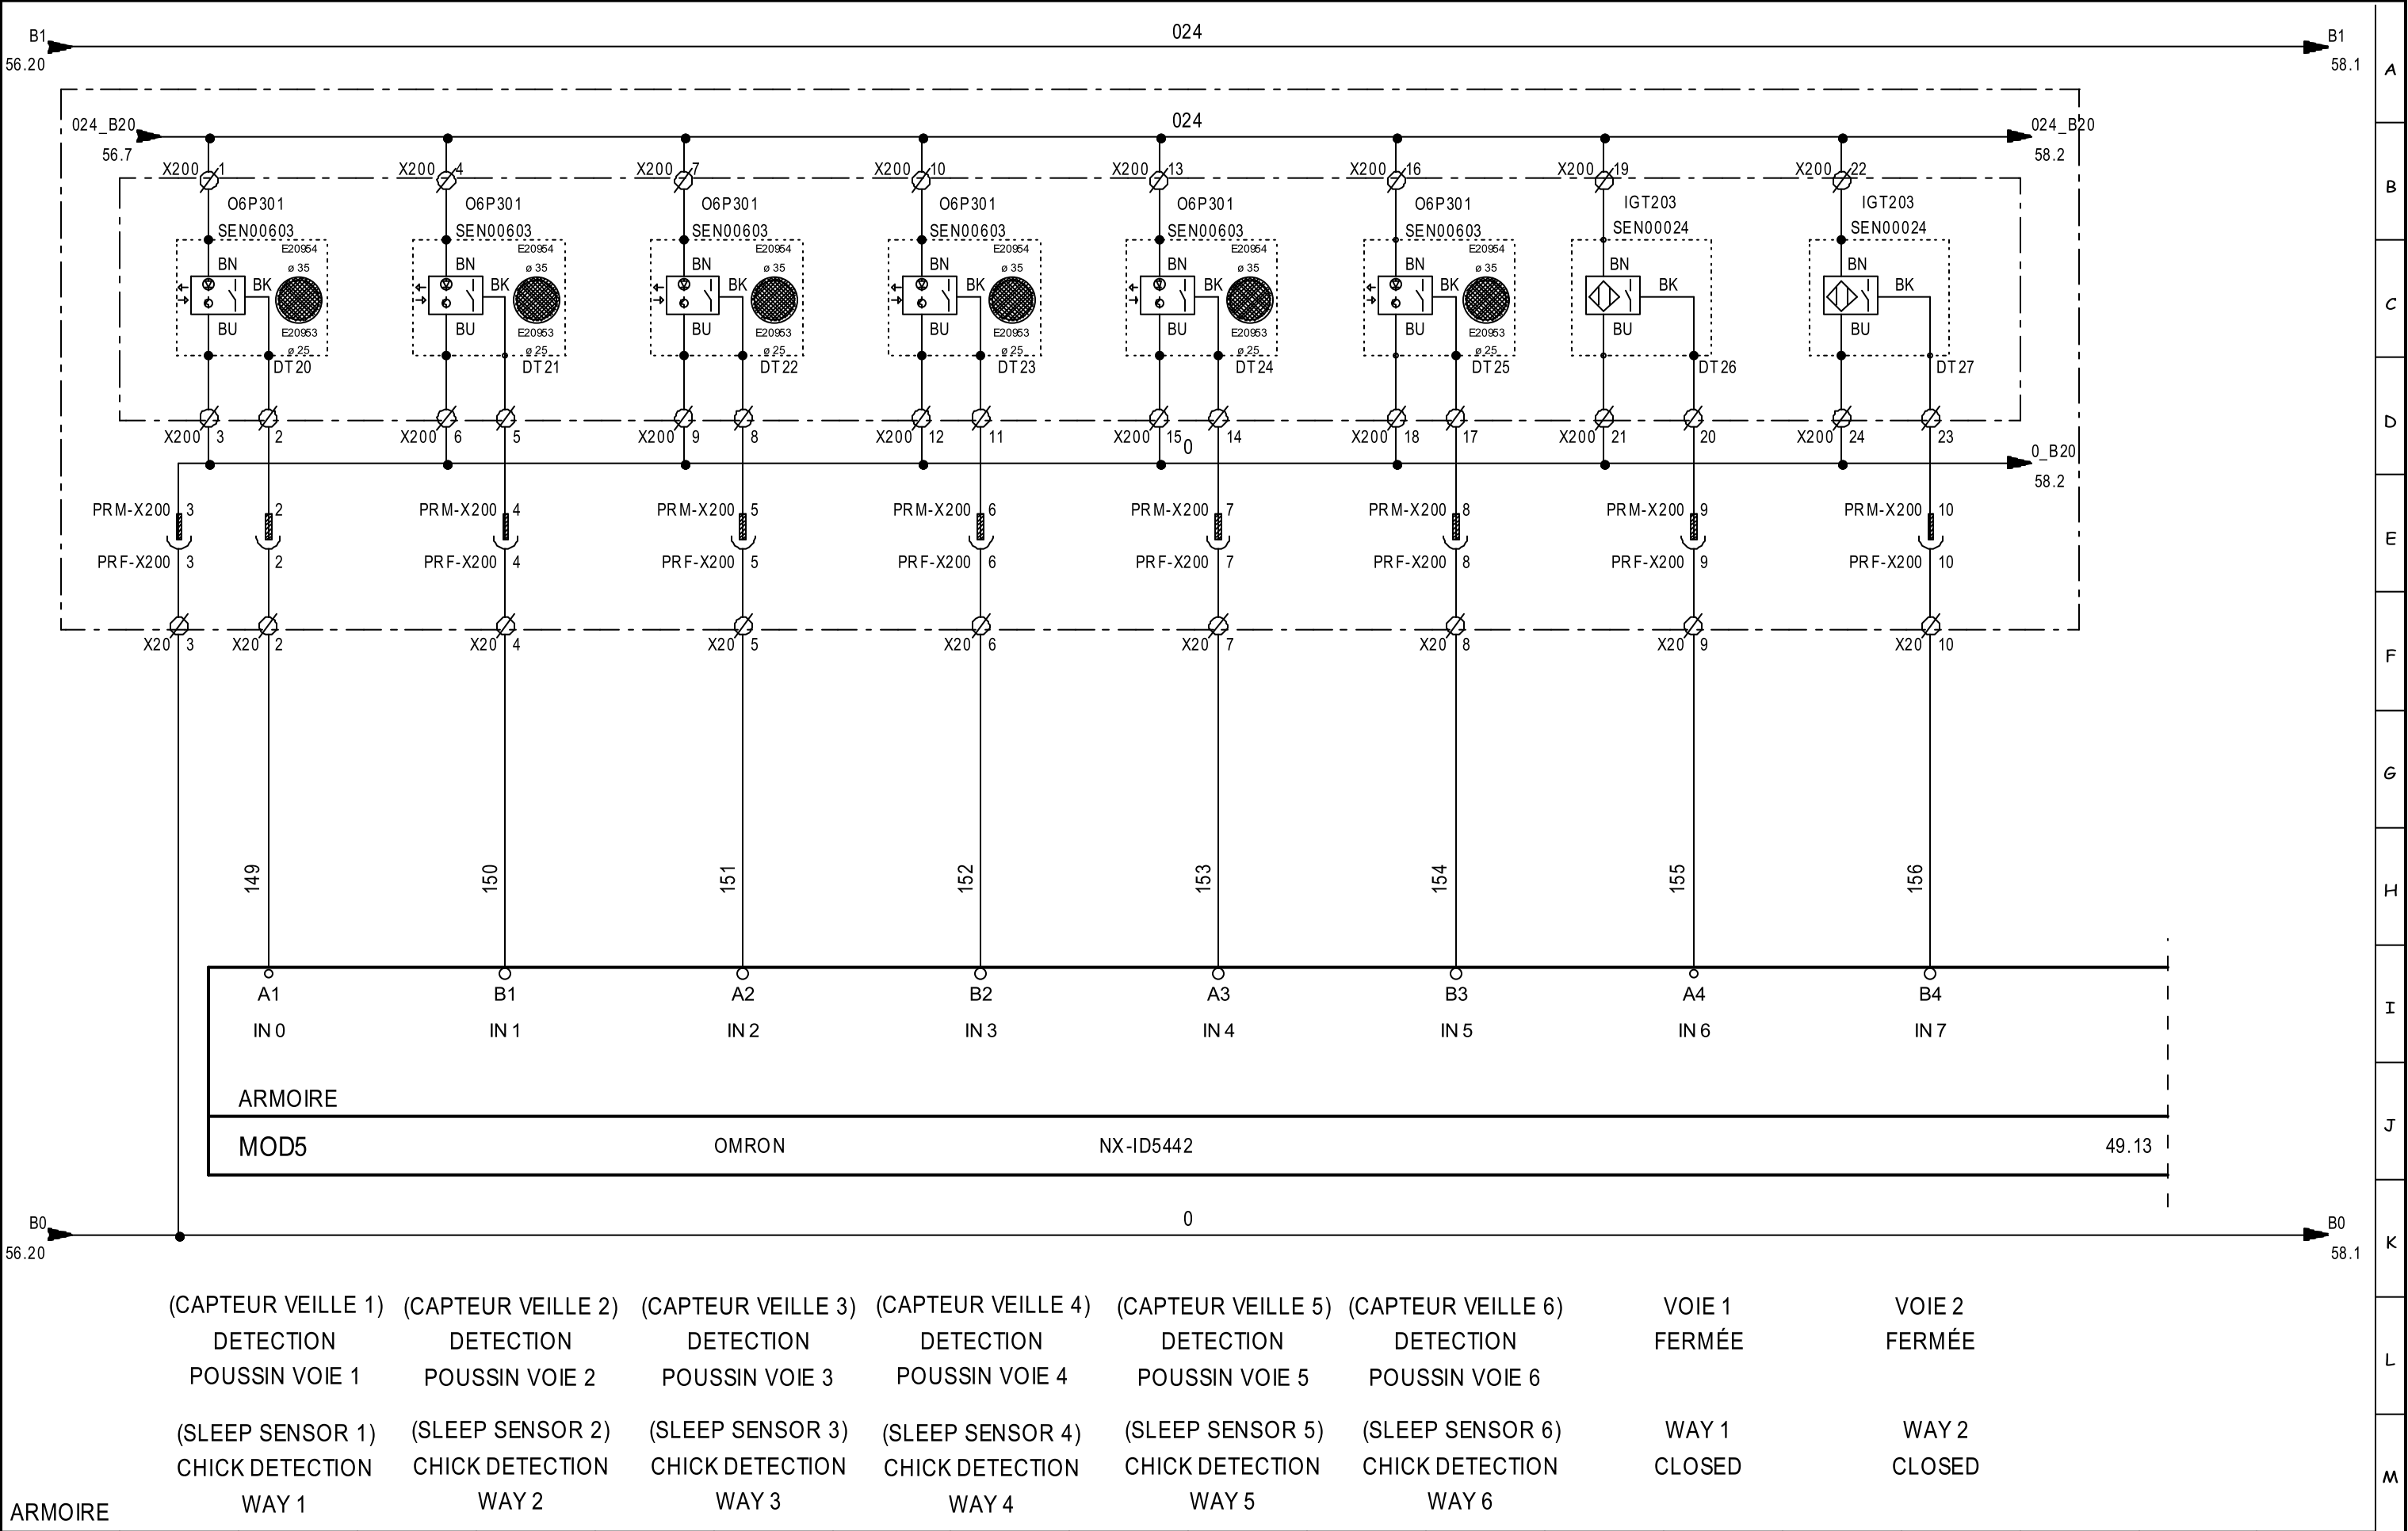

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD5				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD5								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 57/144			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

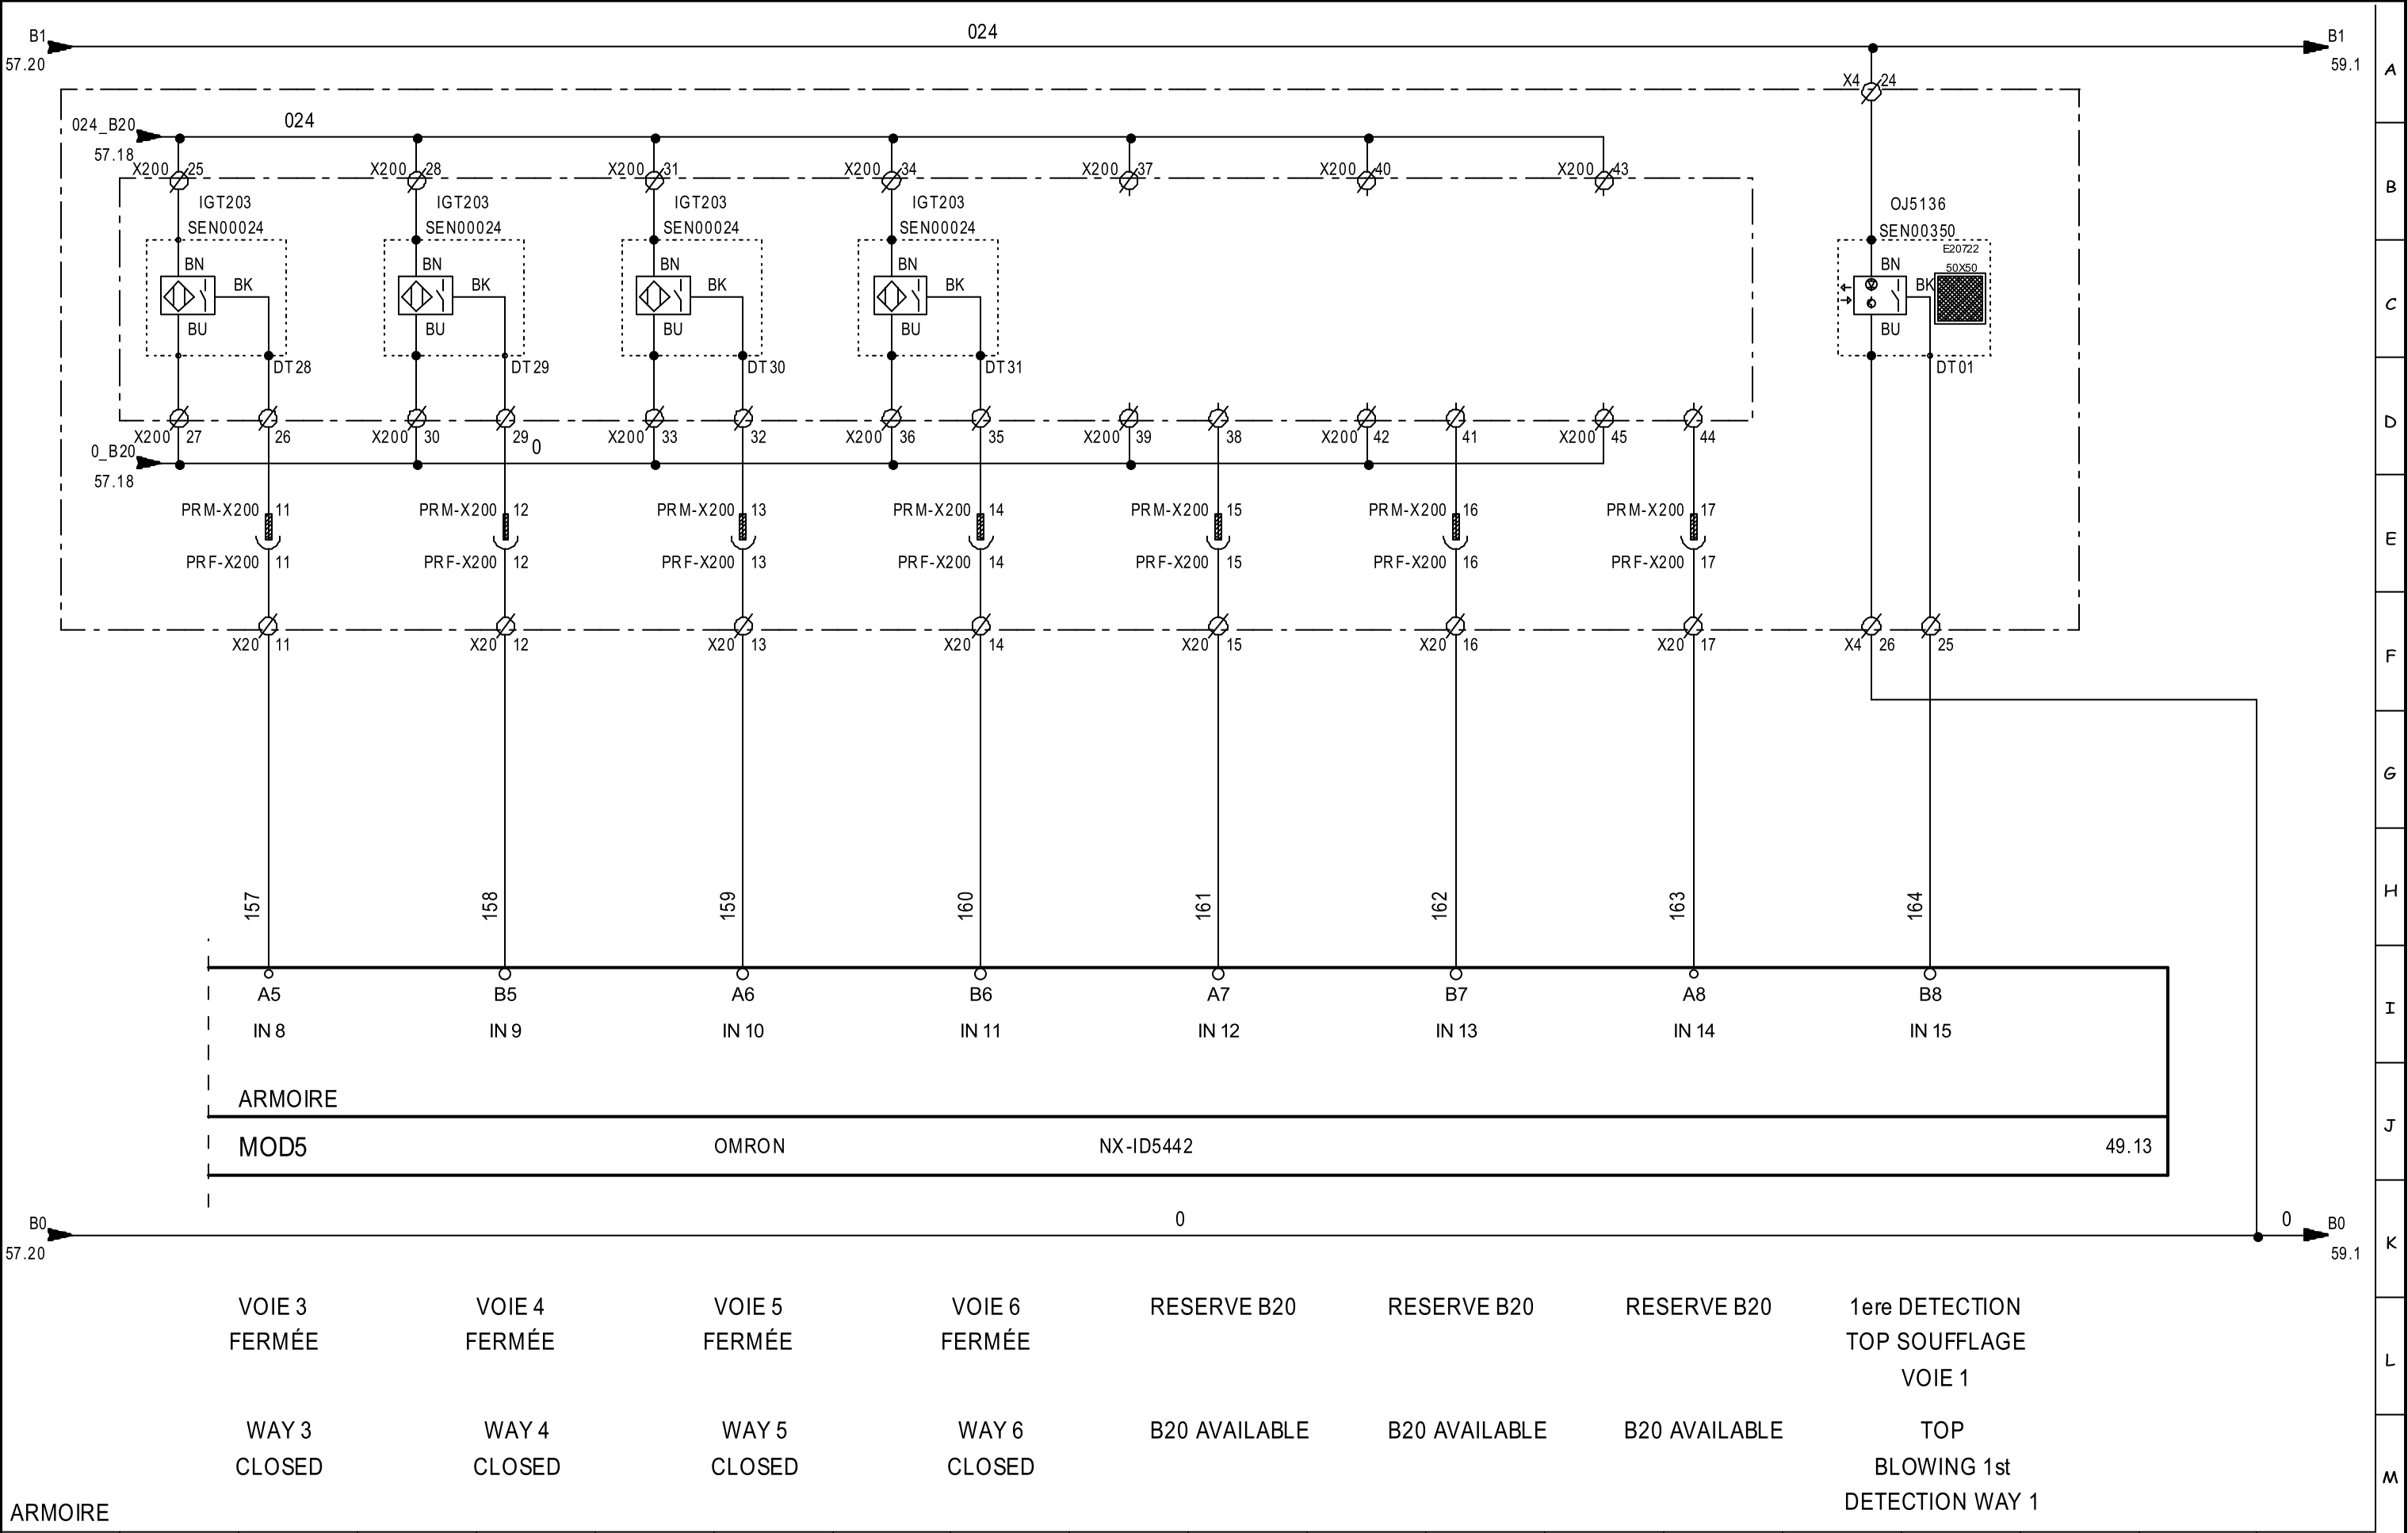

ARMOIRE


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		ENTREES MOD5				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		INPUTS MOD5								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								58/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

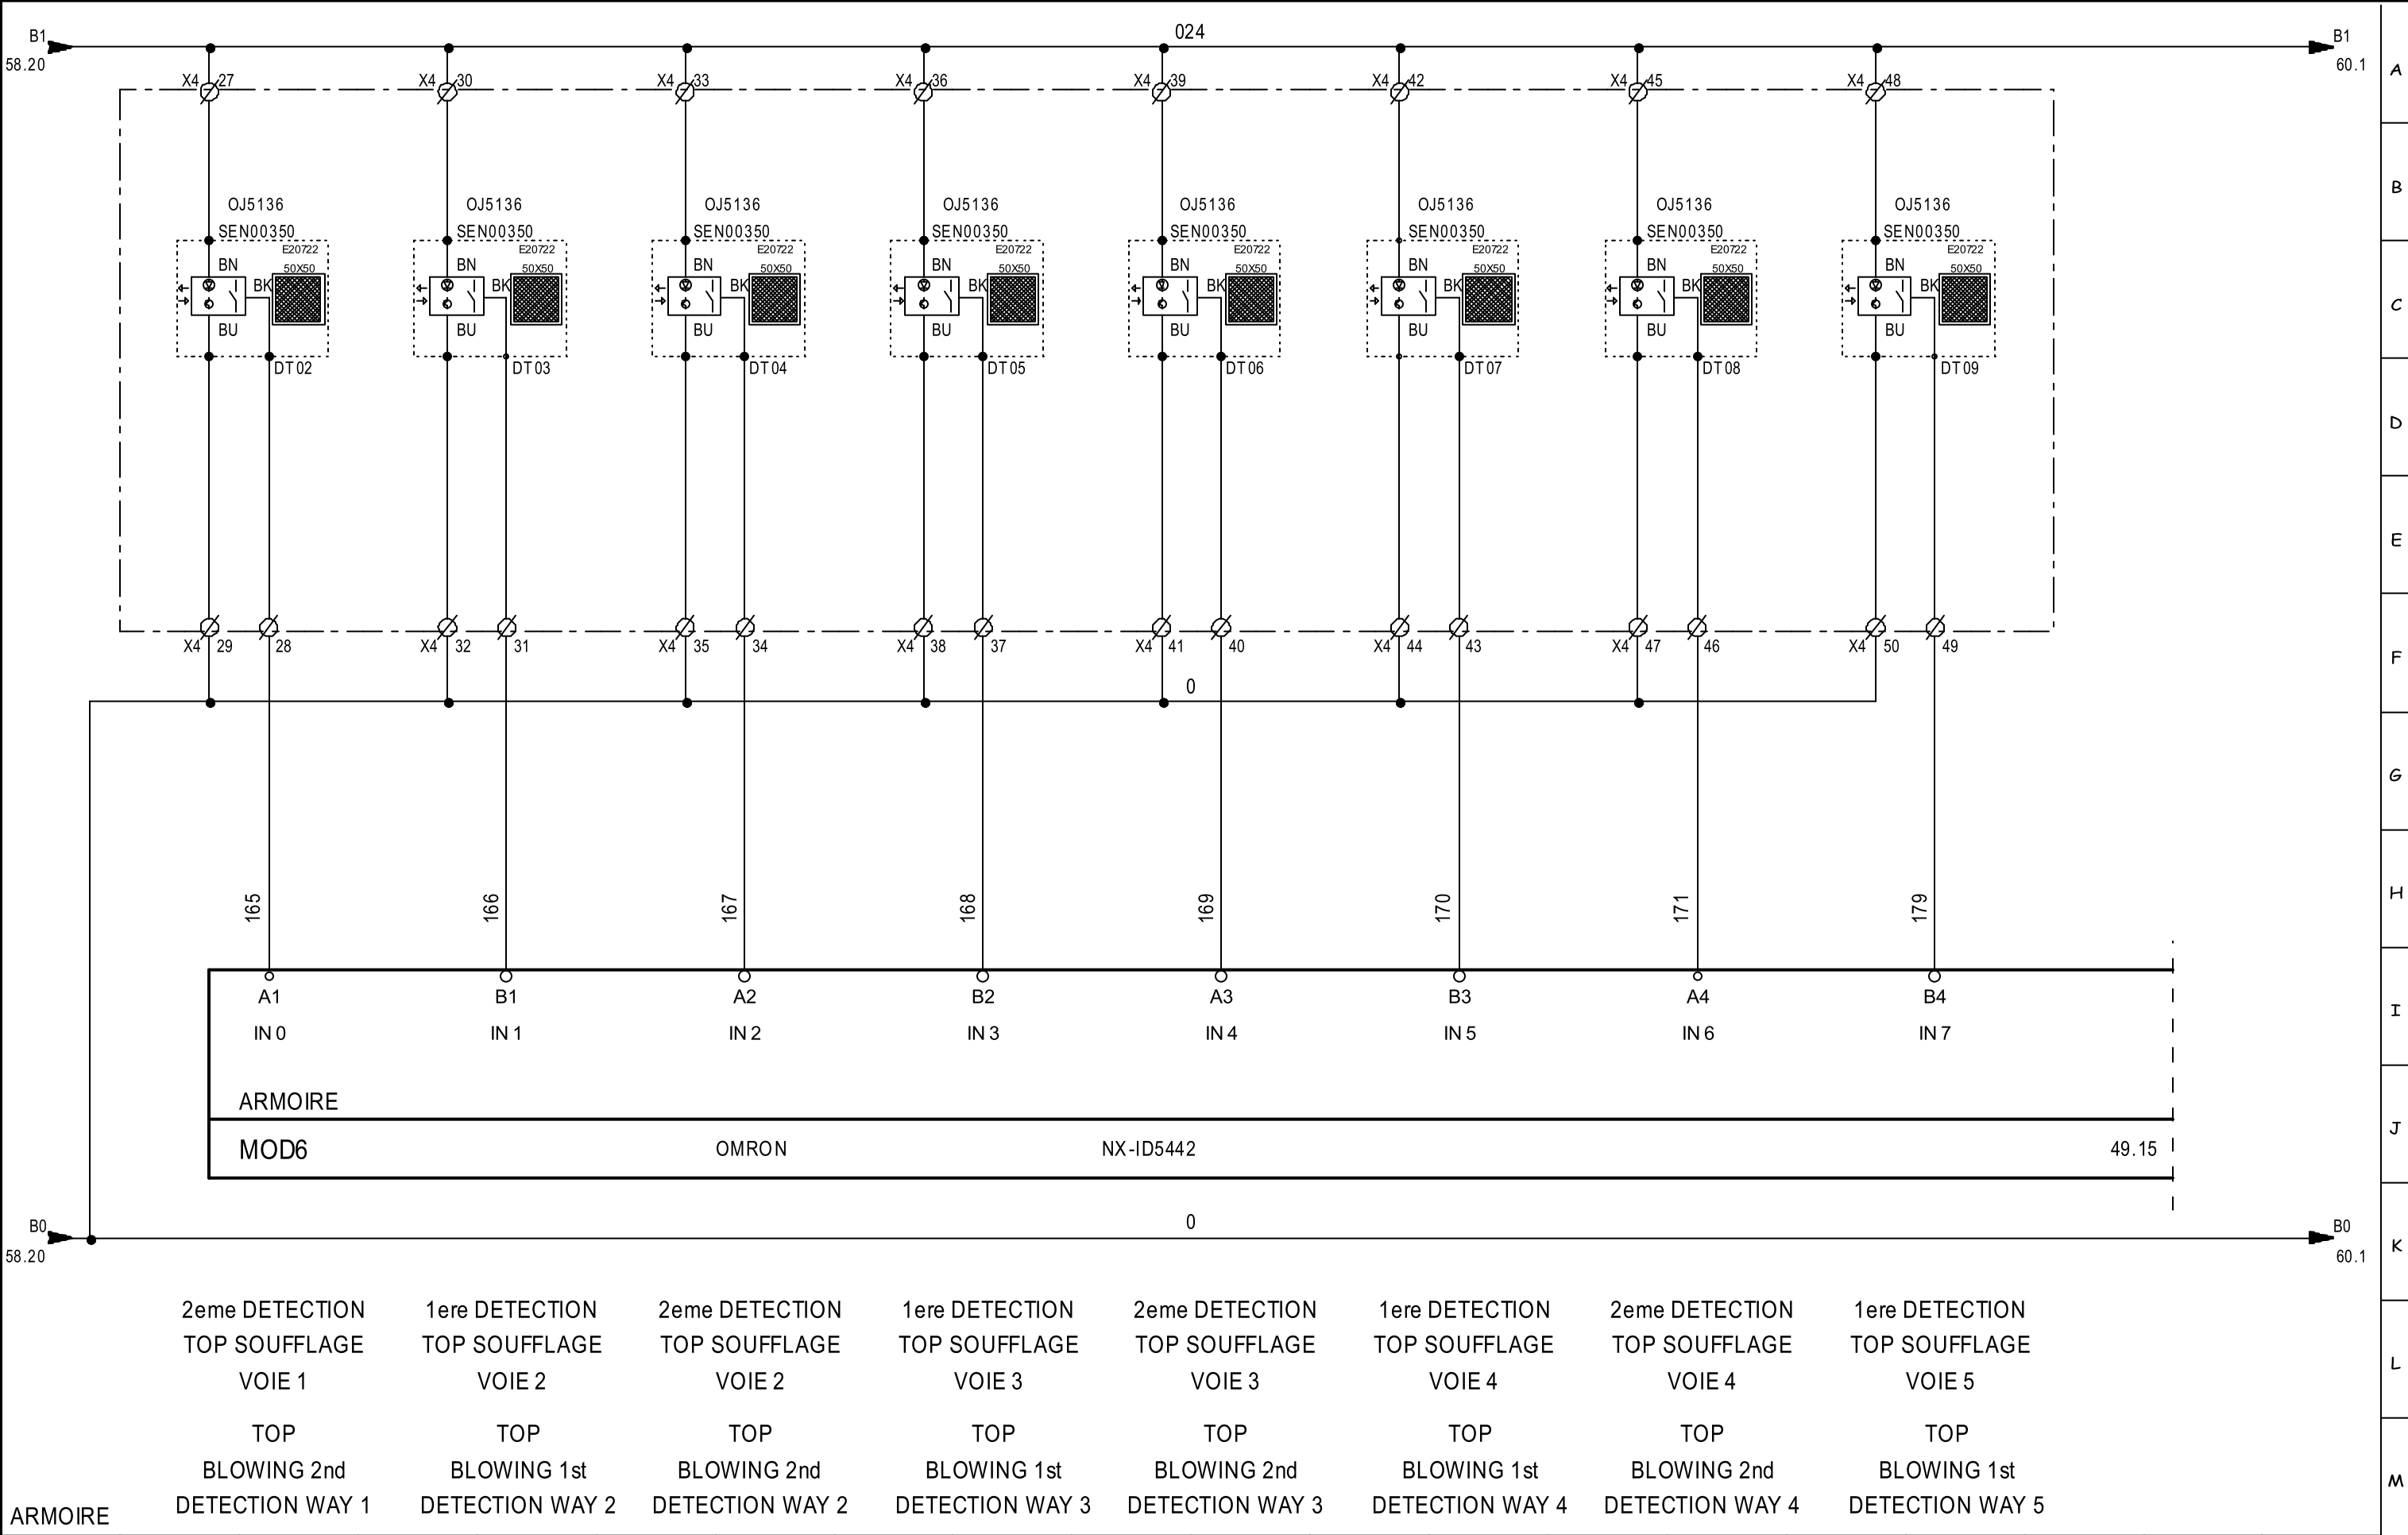

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD6				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD6								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 59/144	


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

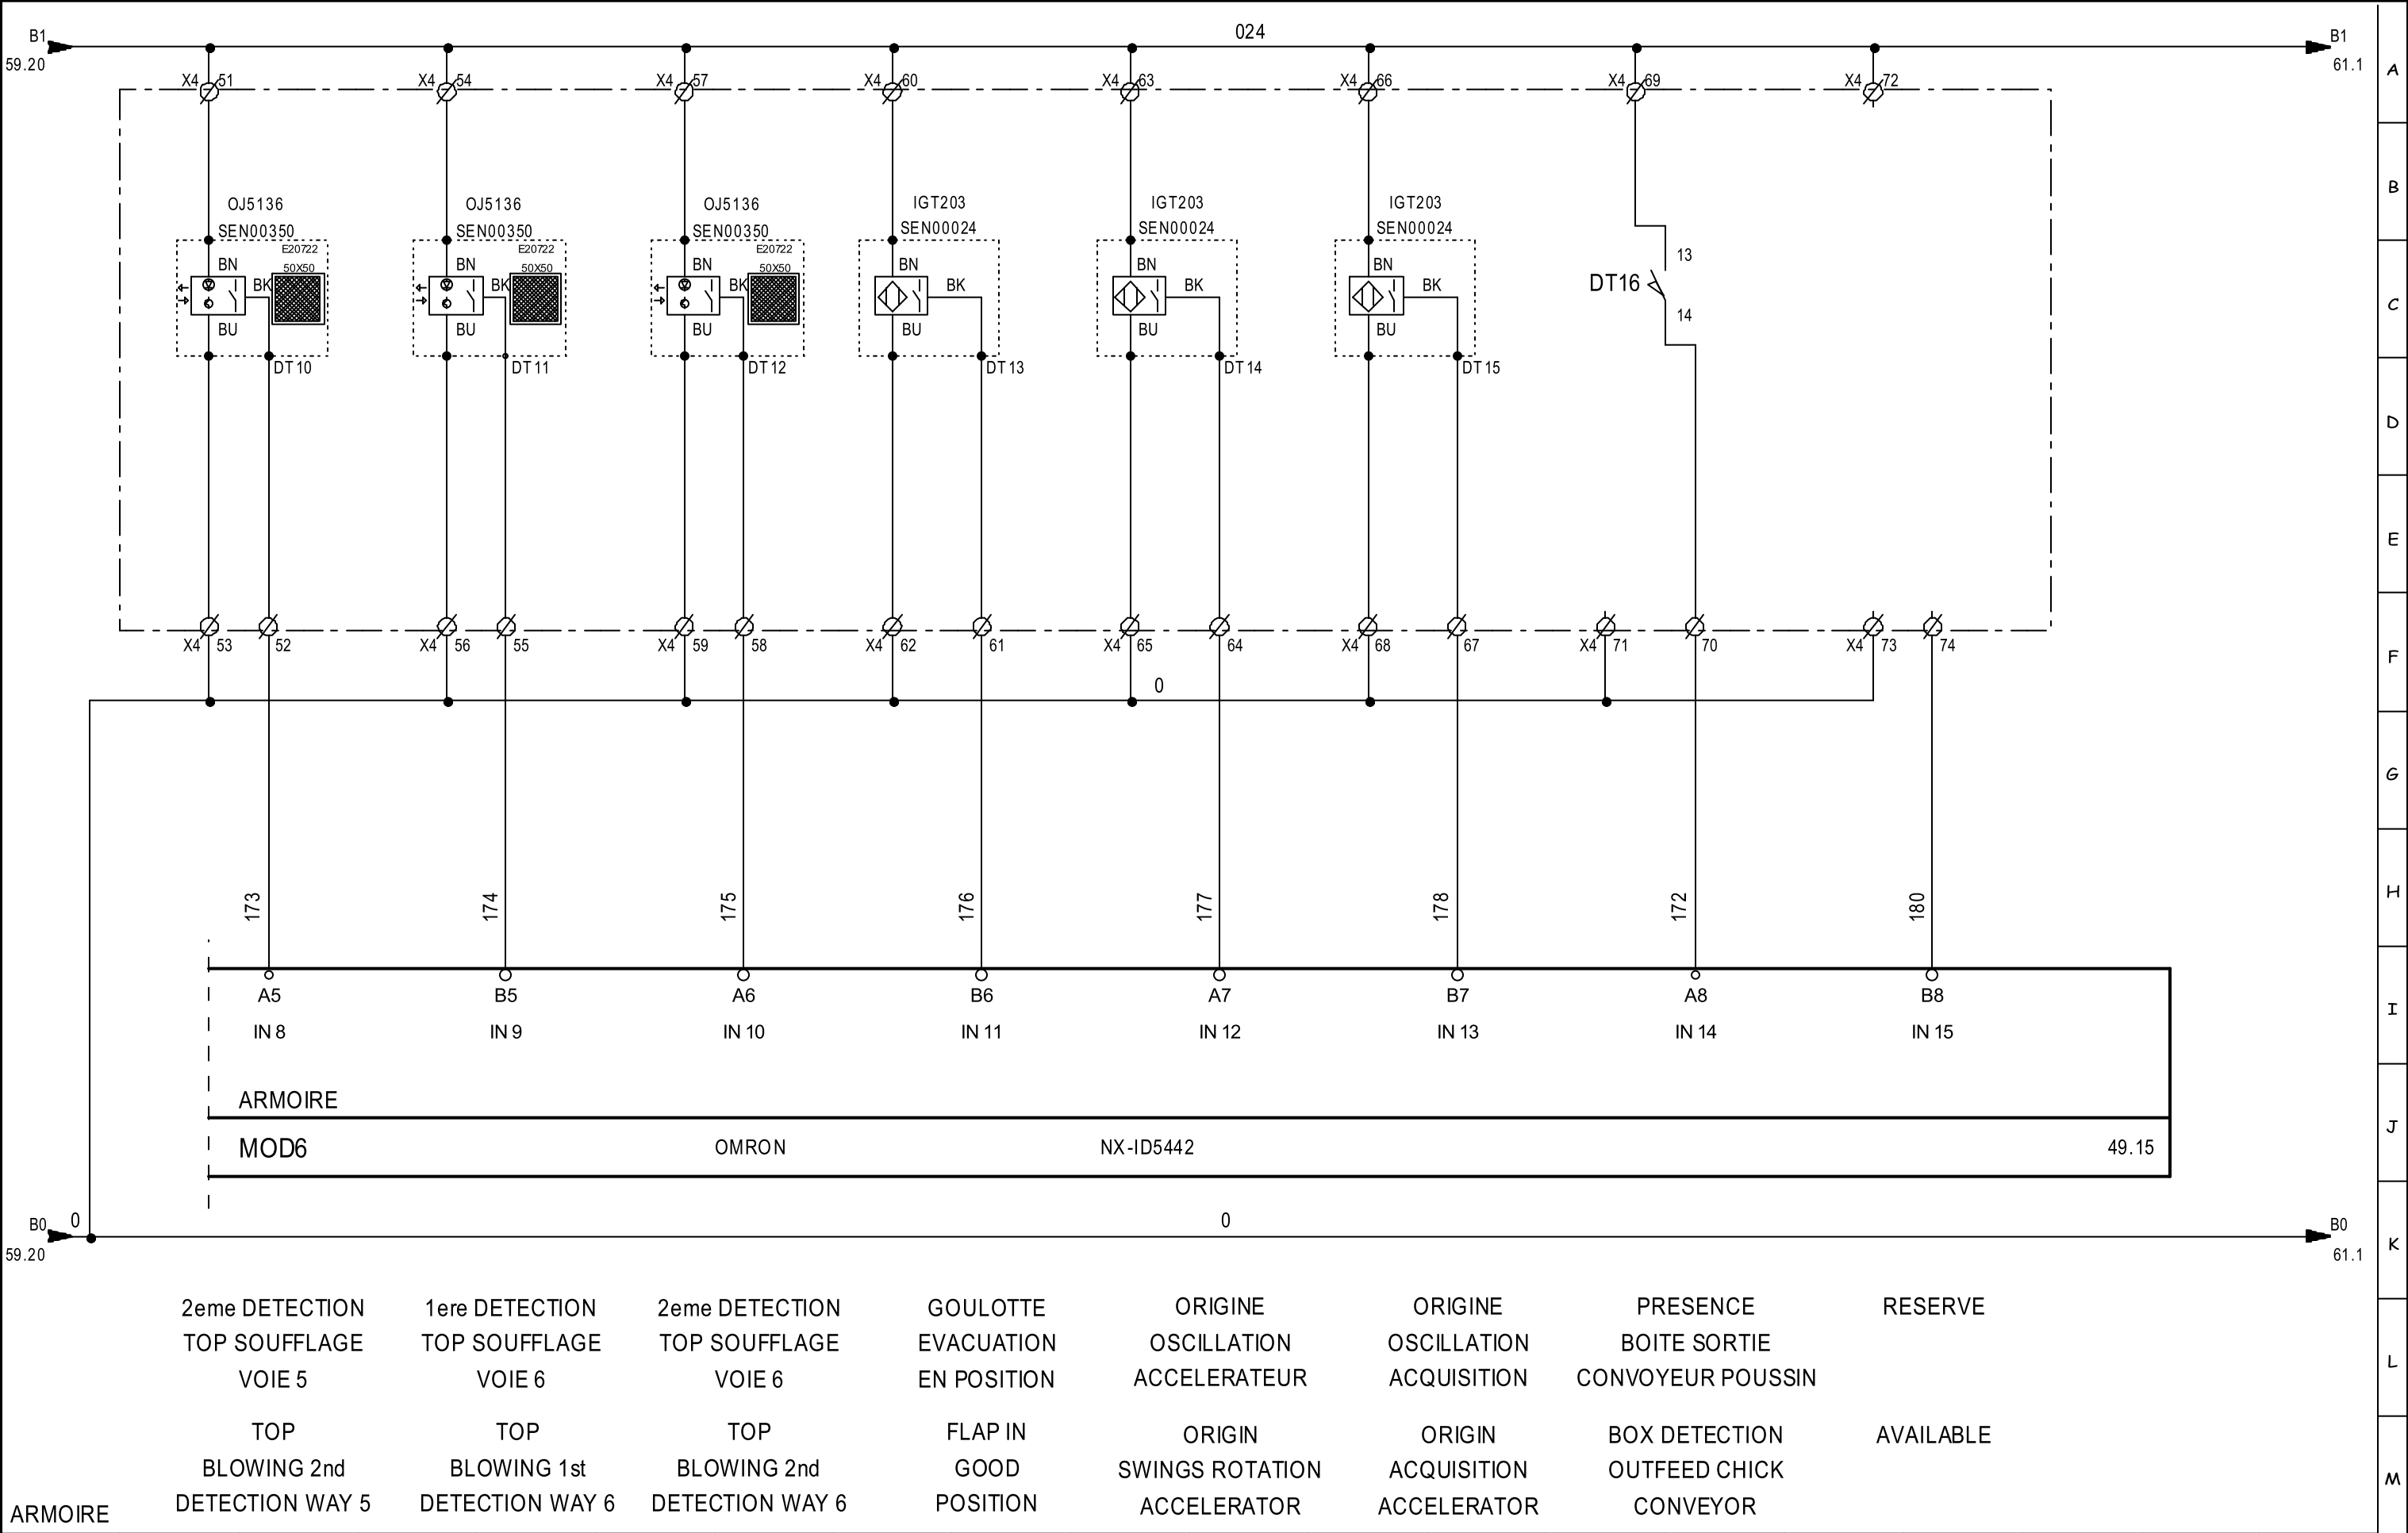

2eme DETECTION TOP SOUFFLAGE VOIE 5		1ere DETECTION TOP SOUFFLAGE VOIE 6		2eme DETECTION TOP SOUFFLAGE VOIE 6		GOULOTTE EVACUATION EN POSITION		ORIGINE OSCILLATION ACCELERATEUR		ORIGINE OSCILLATION ACQUISITION		PRESENCE BOITE SORTIE CONVOYEUR POUSSIN		RESERVE	
TOP BLOWING 2nd DETECTION WAY 5		TOP BLOWING 1st DETECTION WAY 6		TOP BLOWING 2nd DETECTION WAY 6		FLAP IN GOOD POSITION		ORIGIN SWINGS ROTATION ACCELERATOR		ORIGIN ACQUISITION ACCELERATOR		BOX DETECTION OUTFEED CHICK CONVEYOR		AVAILABLE	
ARMOIRE															


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD6				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD6								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT :Version 4.49.F - 23/09/2020		FOLIO : 60/144													

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

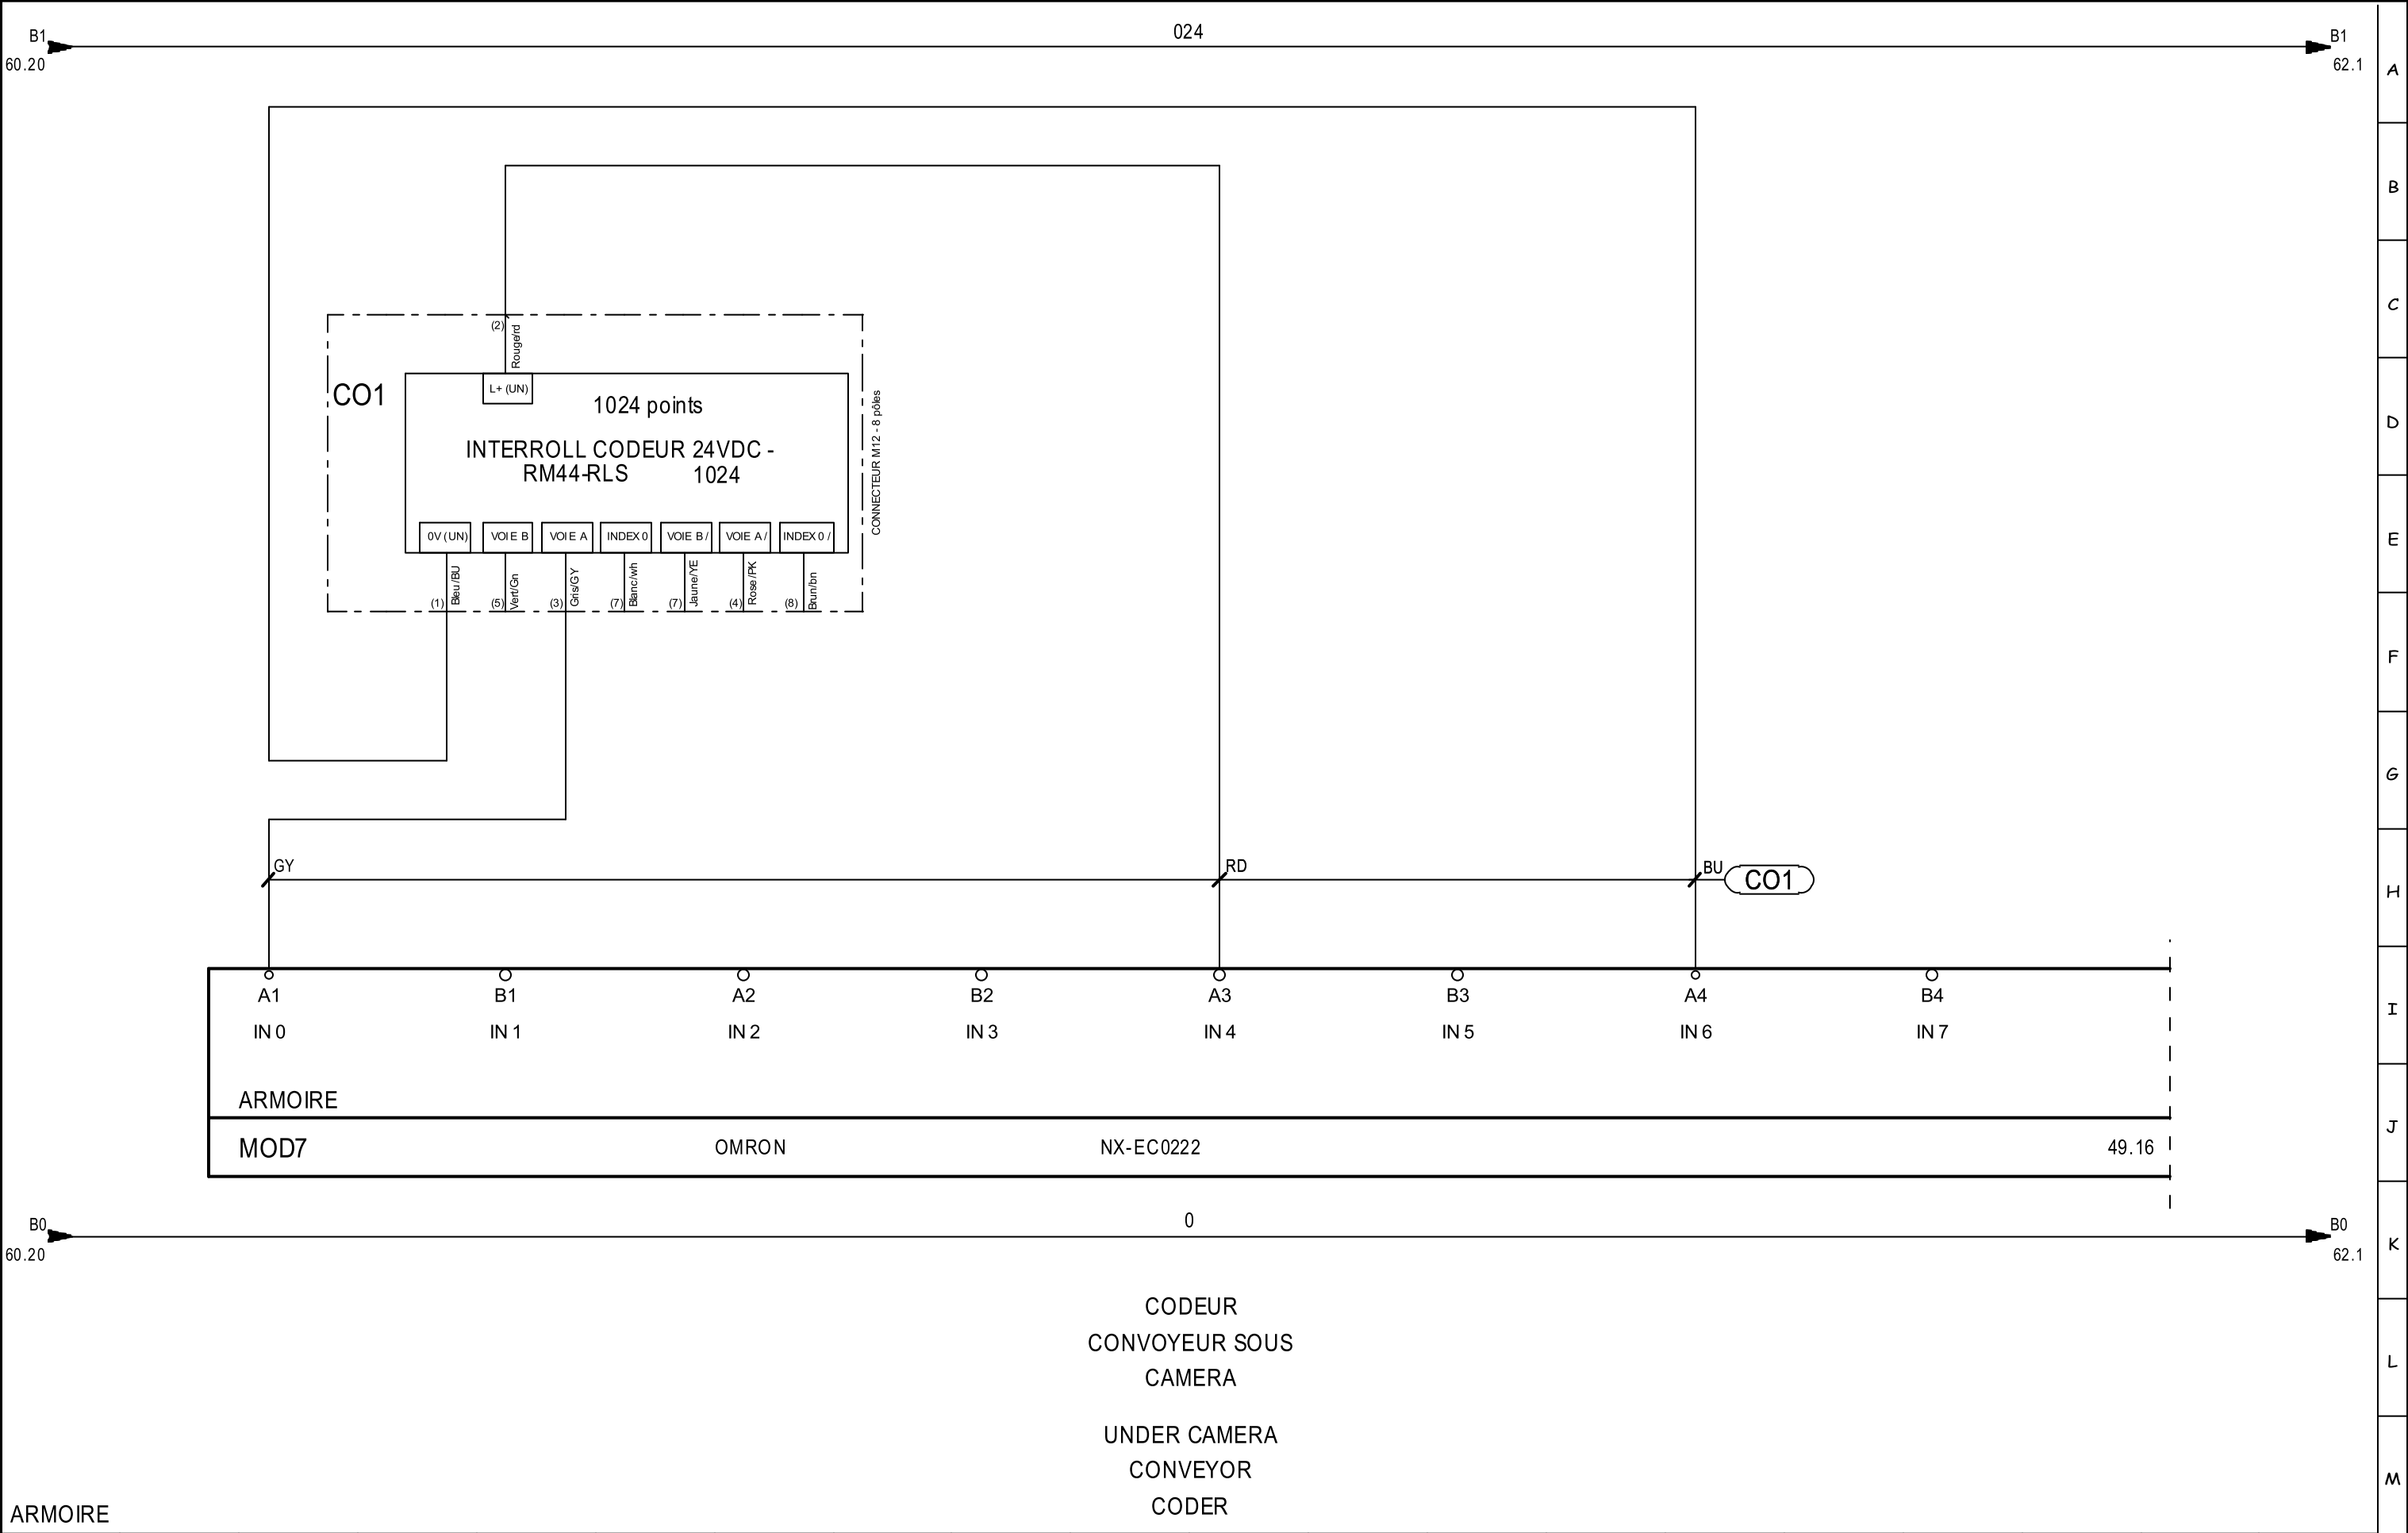


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD7				 Ecat-iD Campus			CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD7							INDEX : V6					
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020							SMXA0002		FOLIO : 61/144			

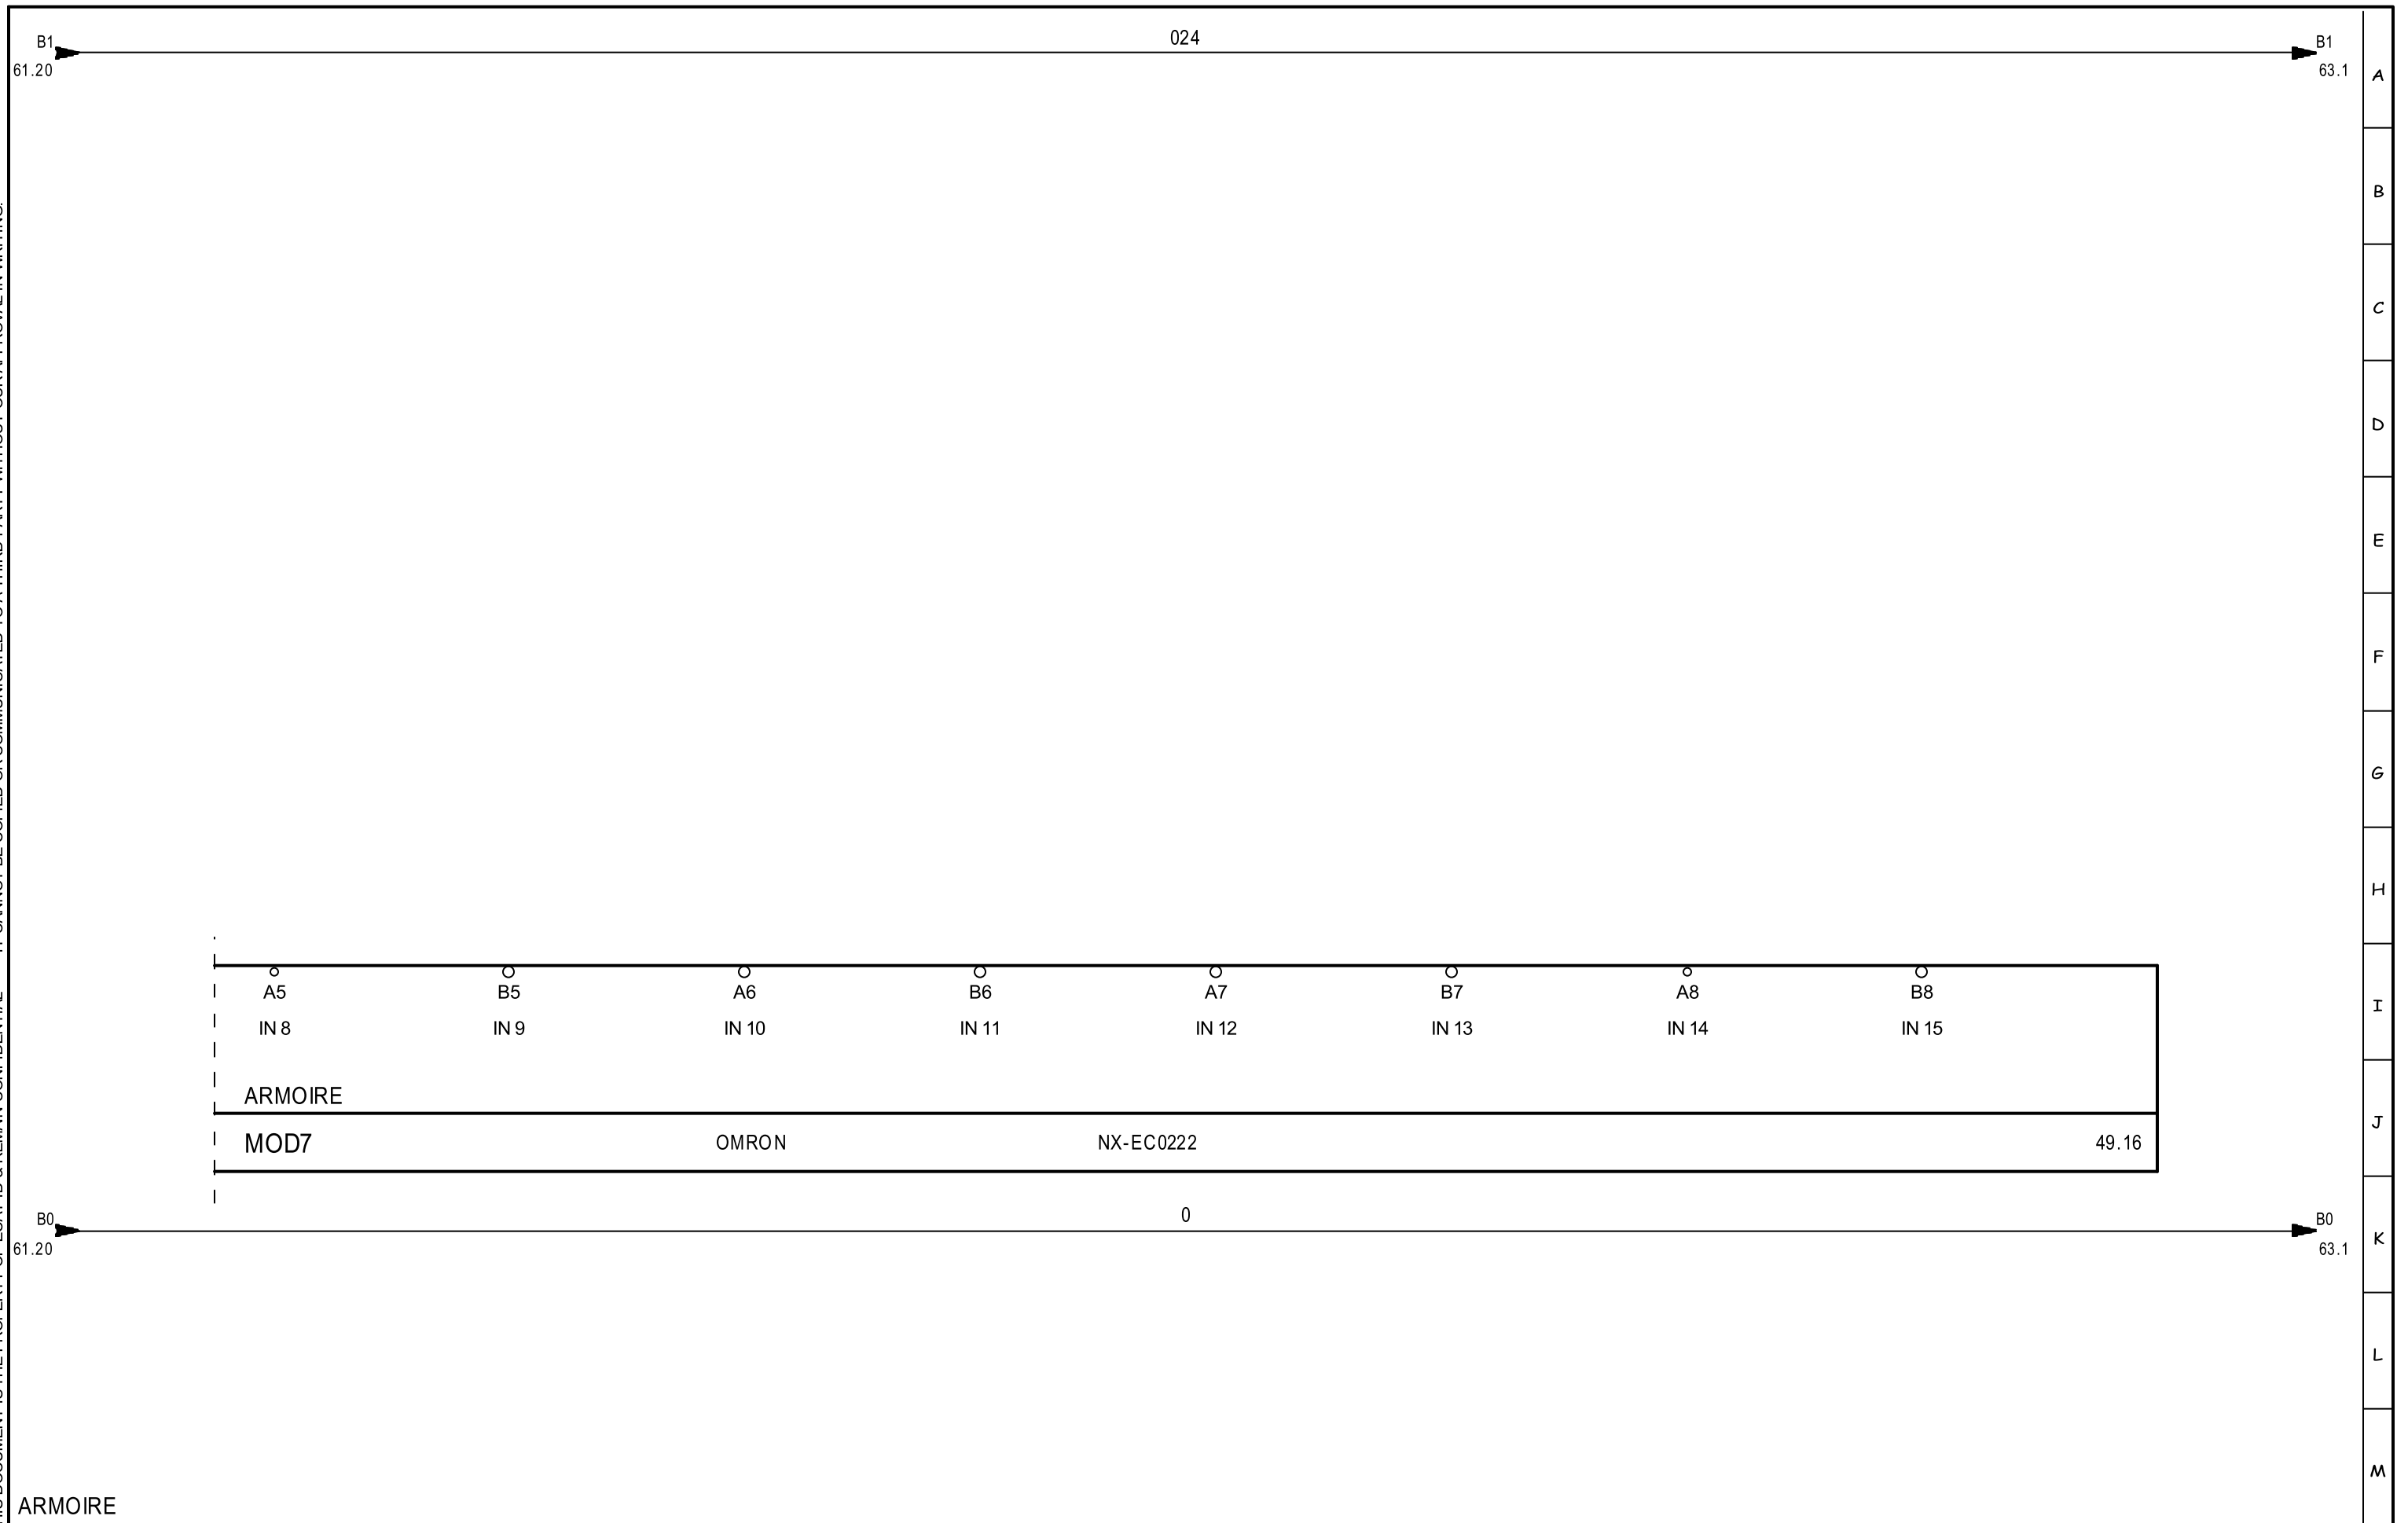


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD7				 Ecatt-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD7								ARTICLE :		INDEX : V6			
			E-mail : ecattid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				SMXA0002						FOLIO : 62/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

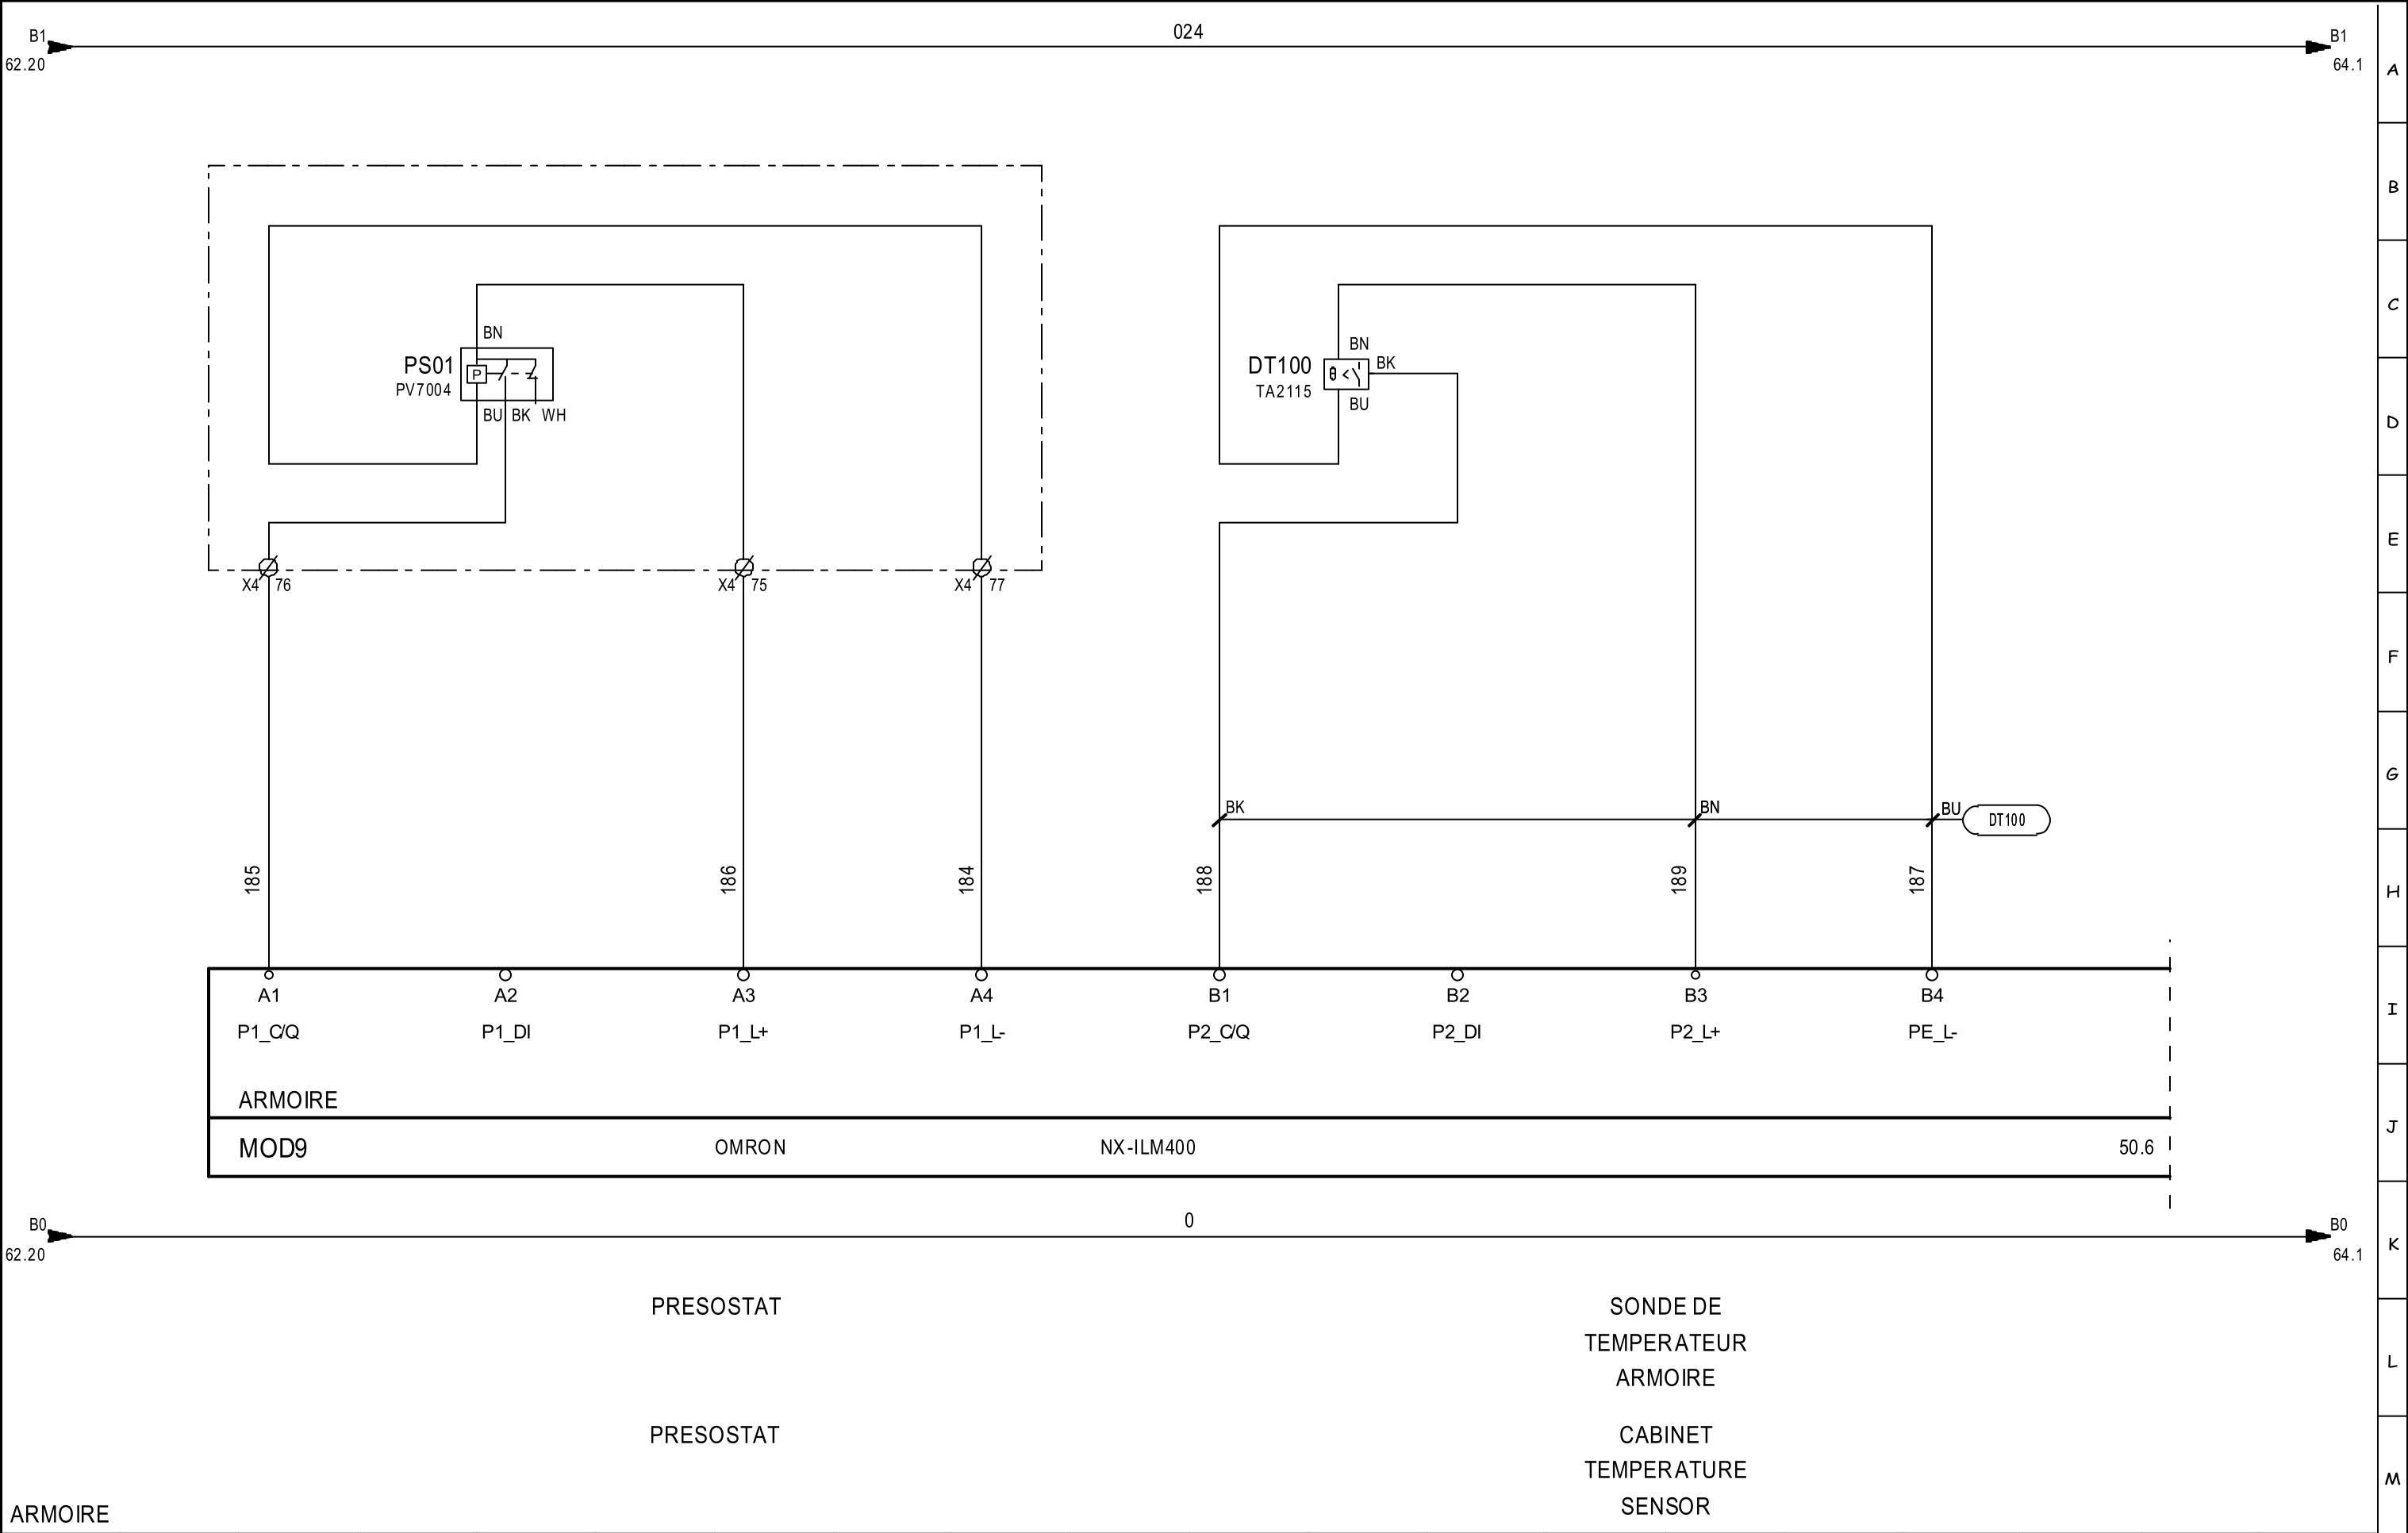


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél :(33).2.98.85.31.36		Date of creation :		I/O LINK MOD8				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		I/O LINK MOD8								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 63/144	


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

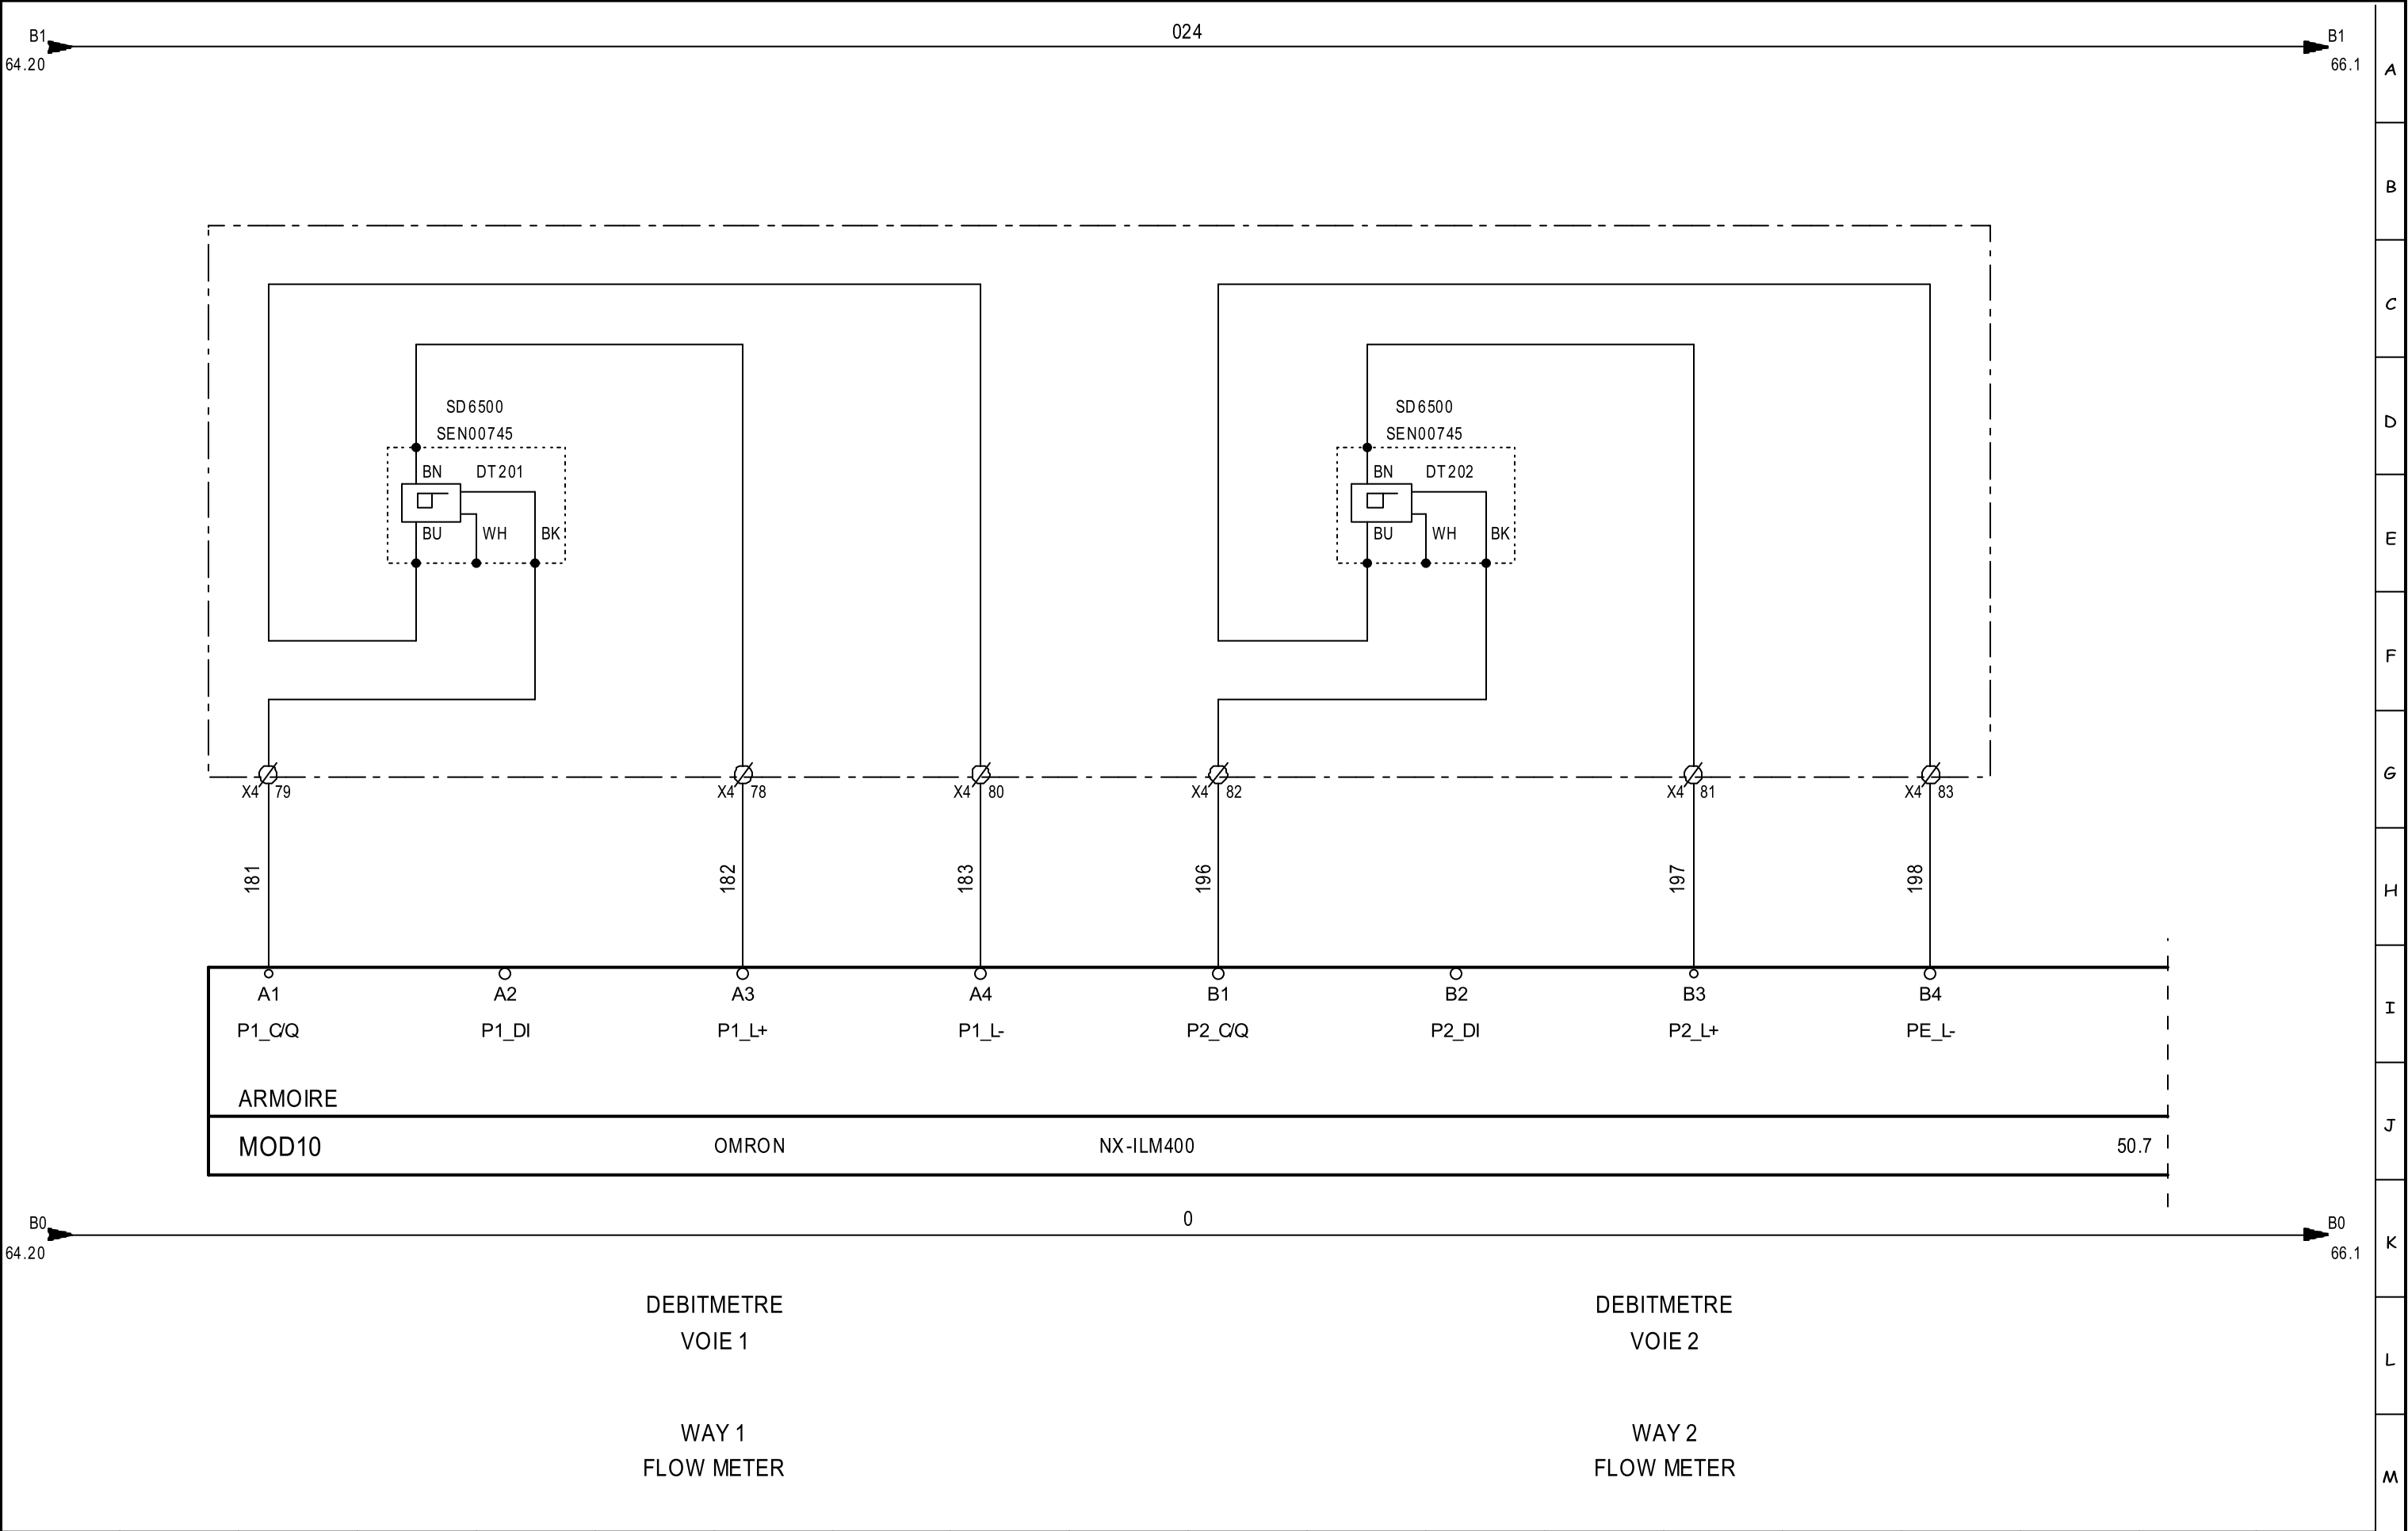


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		I/O LINK MOD9				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		I/O LINK MOD9								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		FOLIO : 65/144													

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

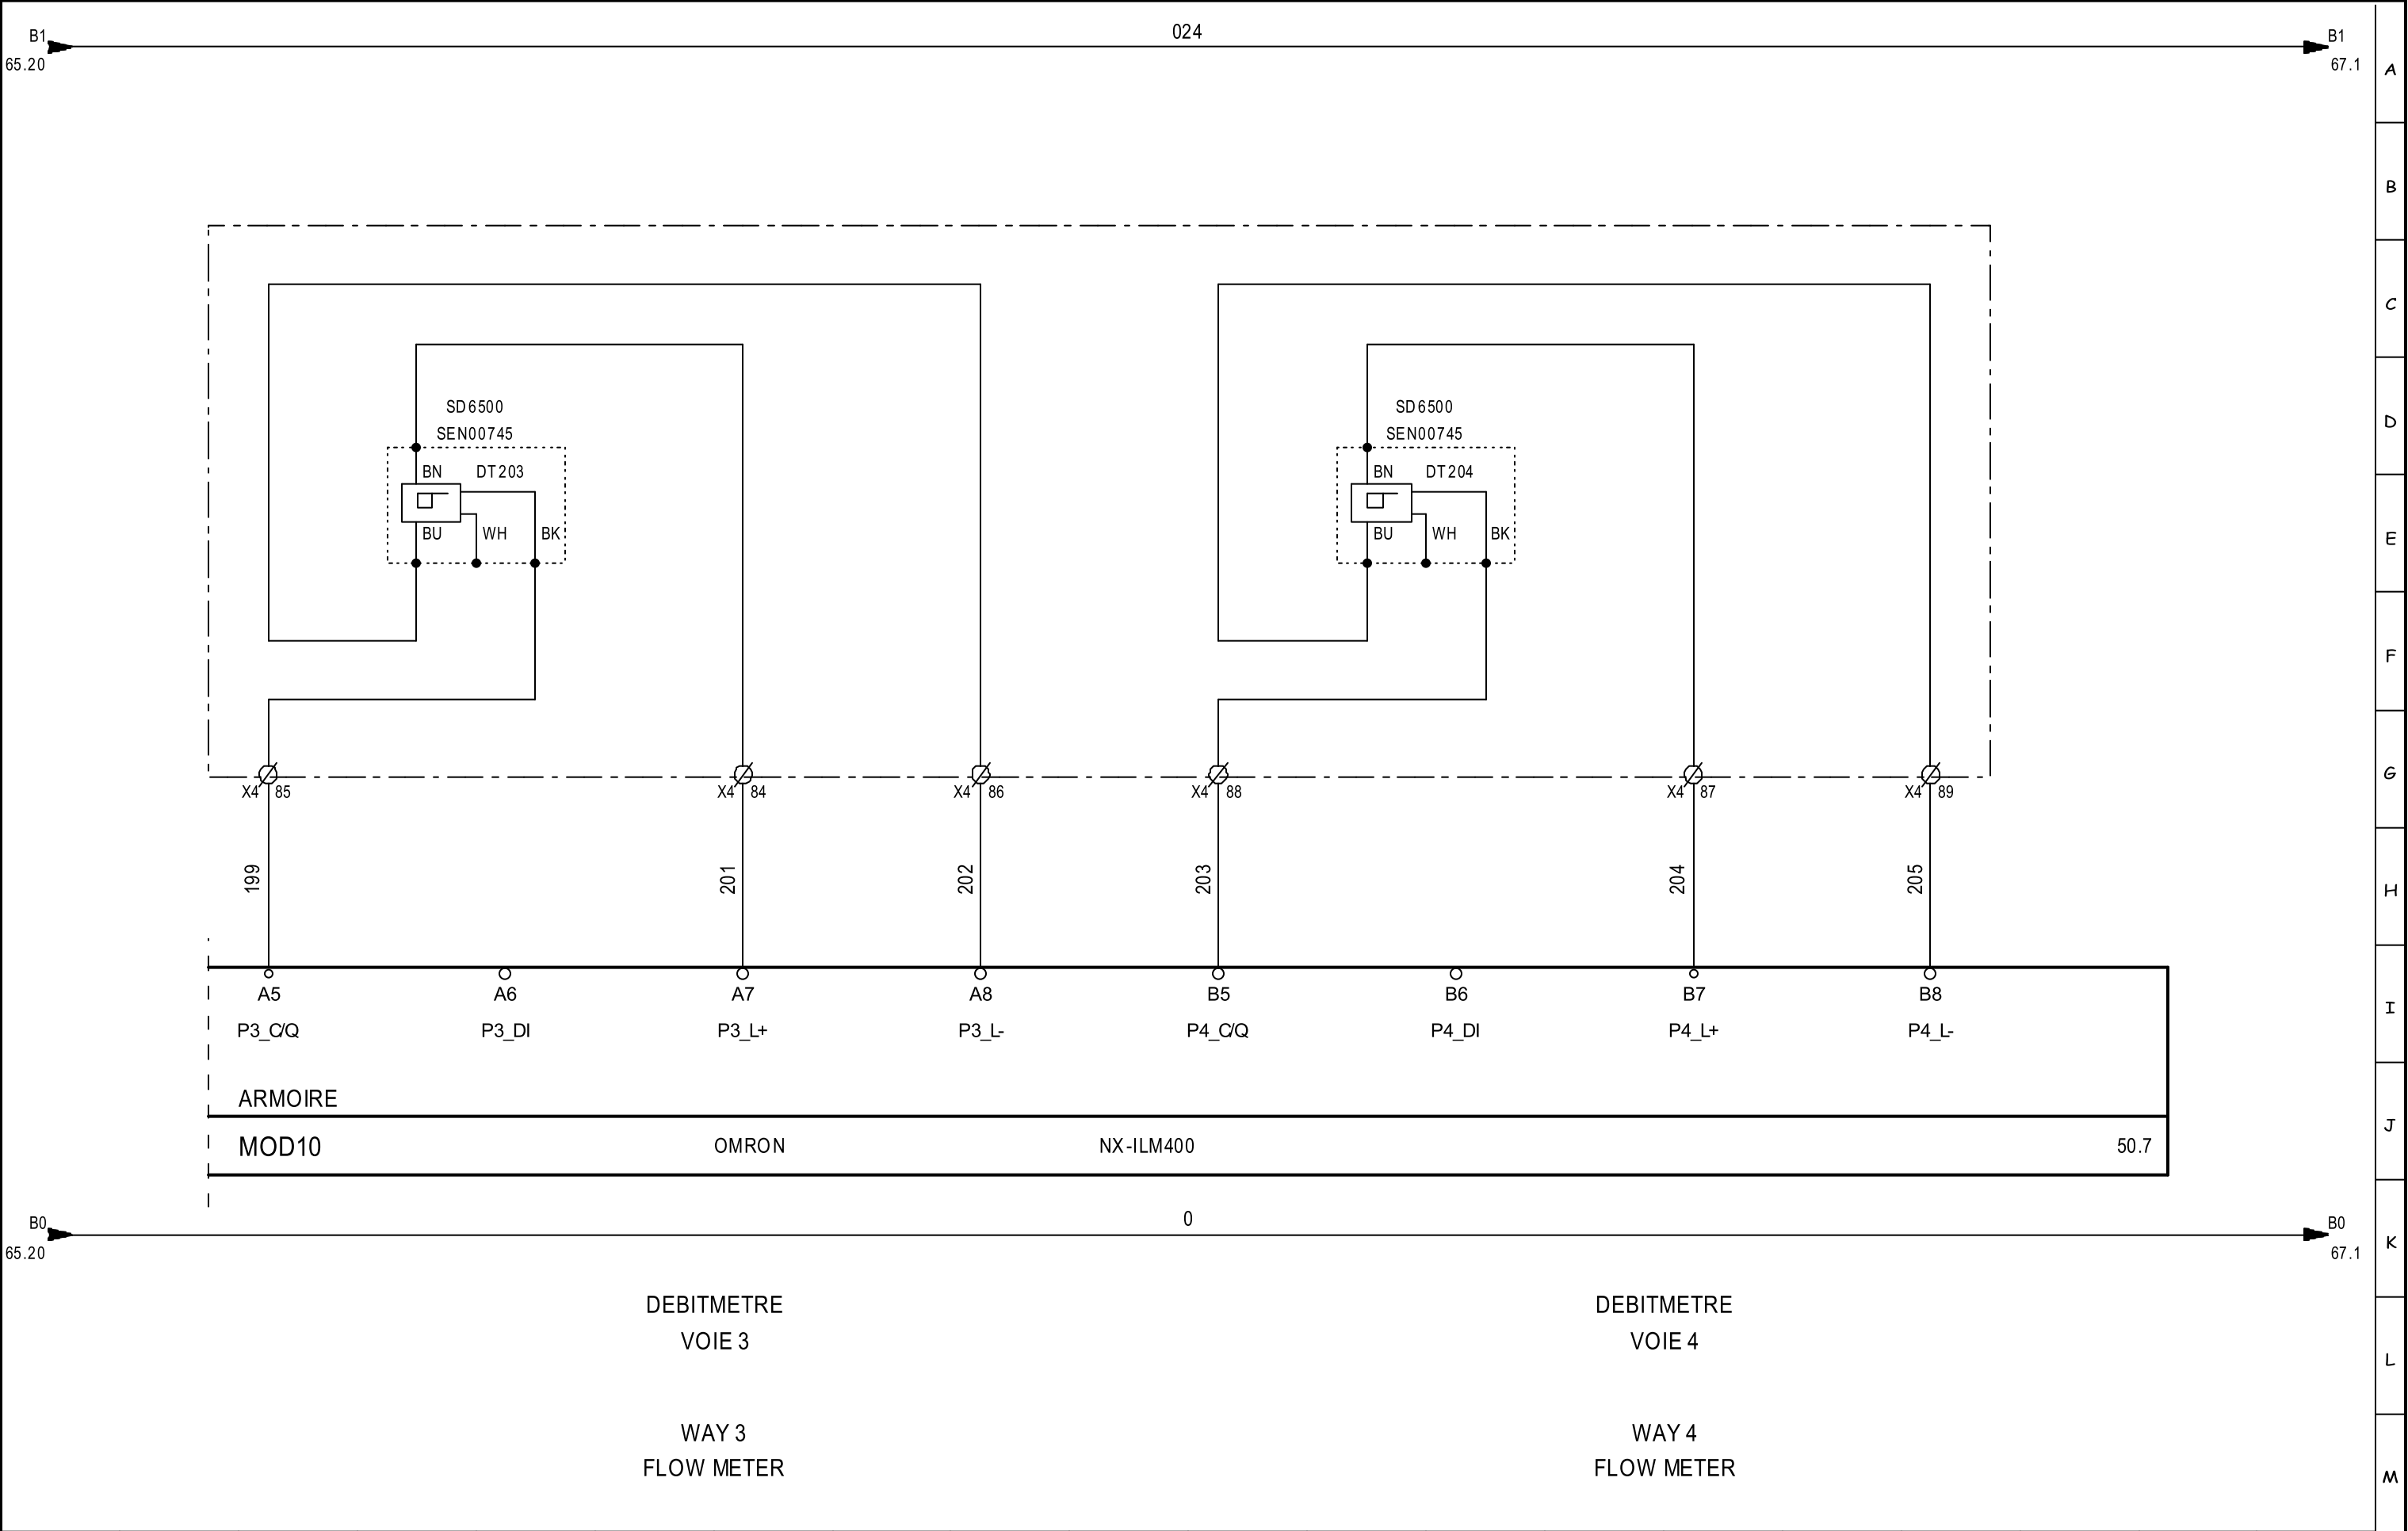


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		I/O LINK MOD9				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		I/O LINK MOD9								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT :Version 4.49.F - 23/09/2020										FOLIO : 66/144			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

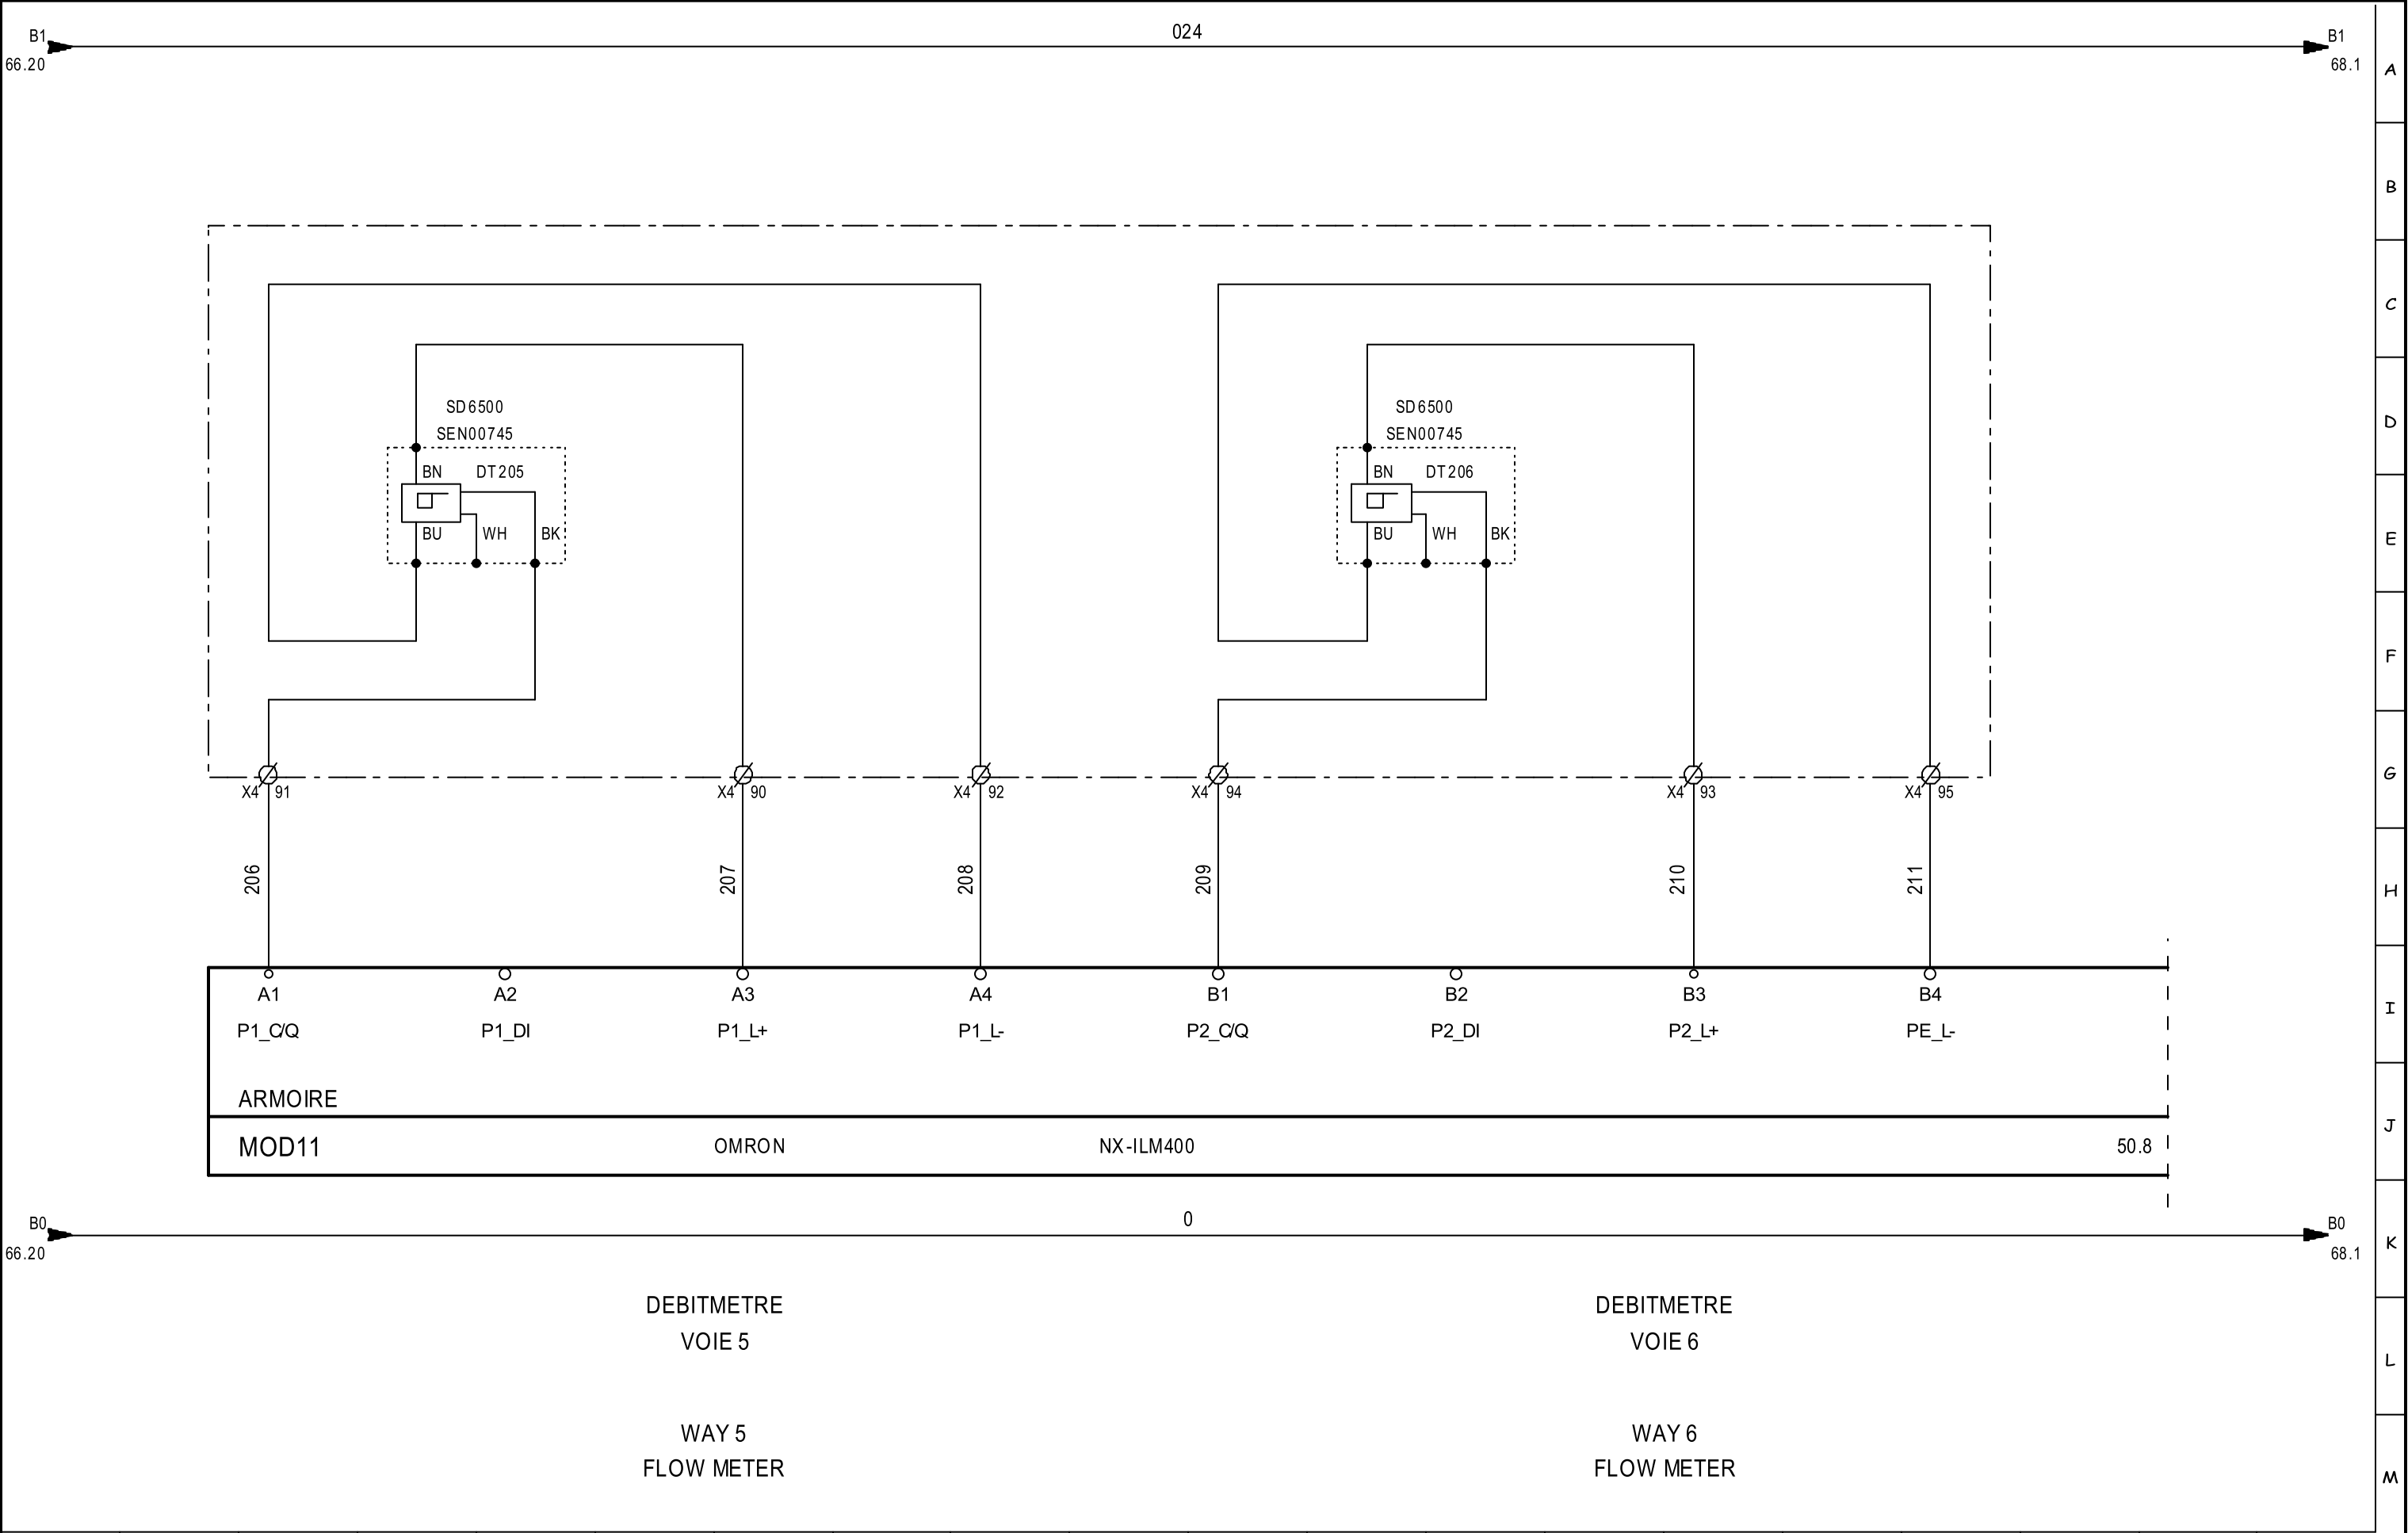


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 02/04/2024		I/O LINK MOD10				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		I/O LINK MOD10								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 67/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

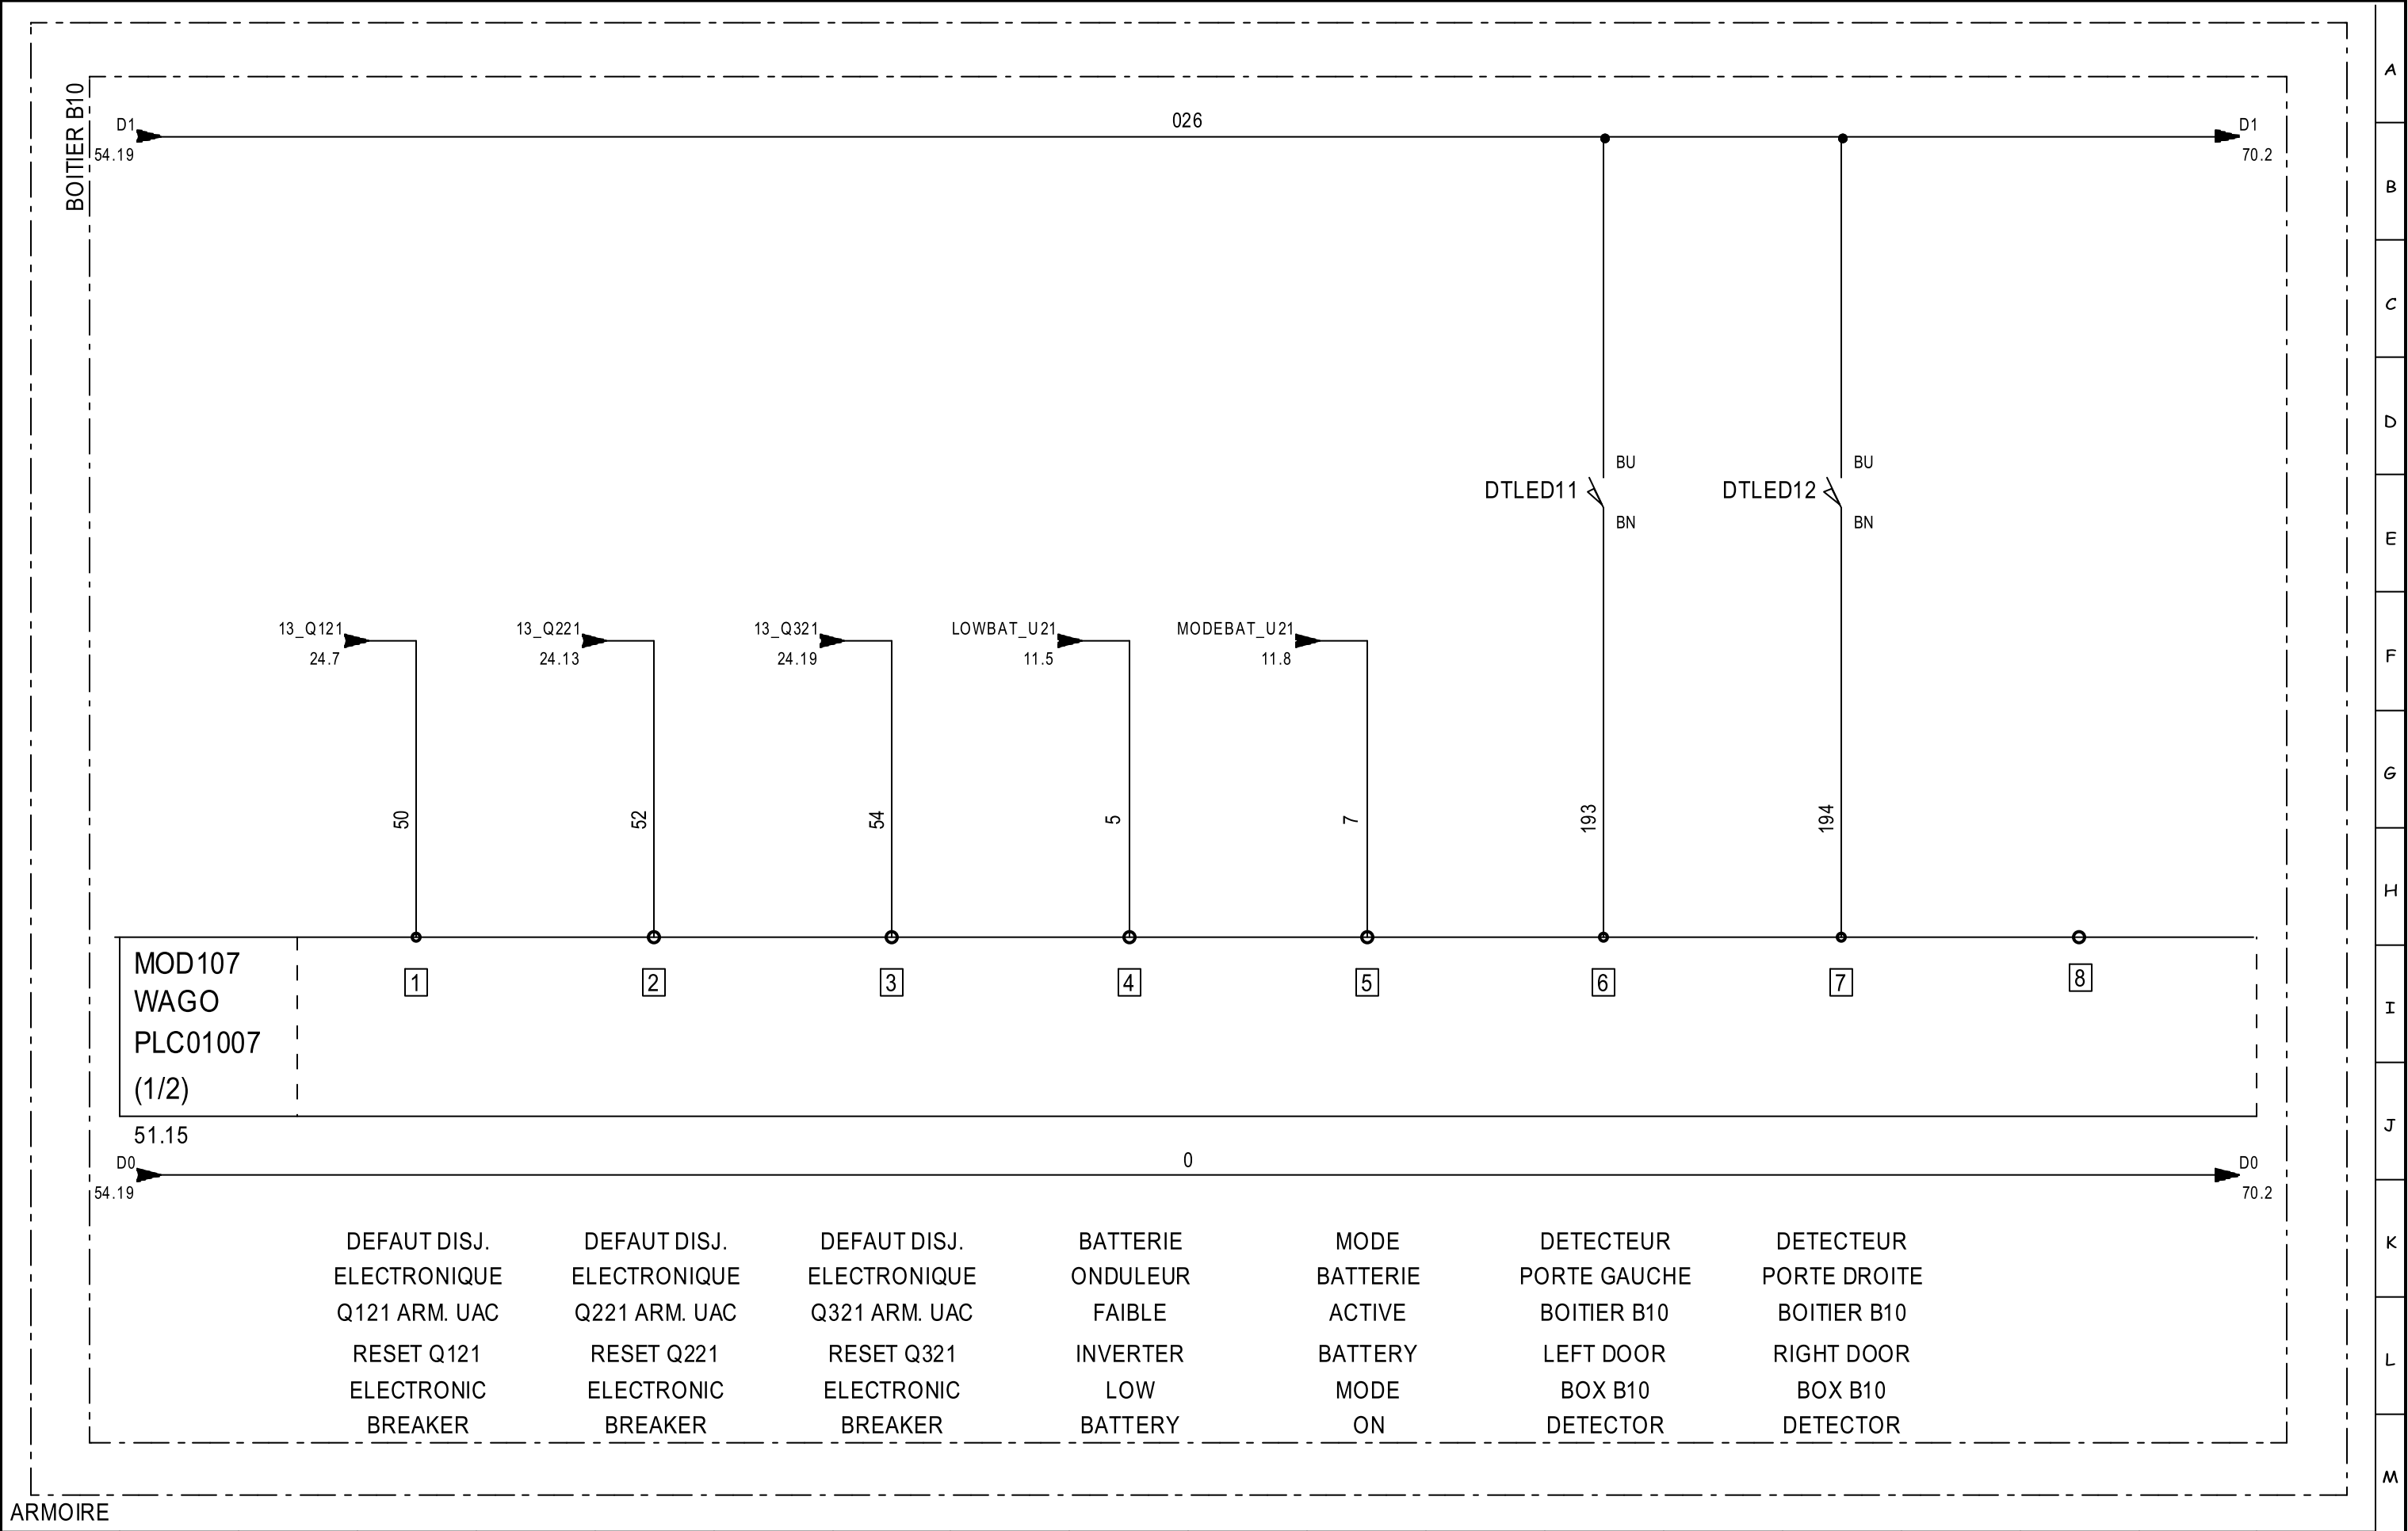

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD106				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD106								ARTICLE :		INDEX : V6			
			E-mail : ecaticd.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 69/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

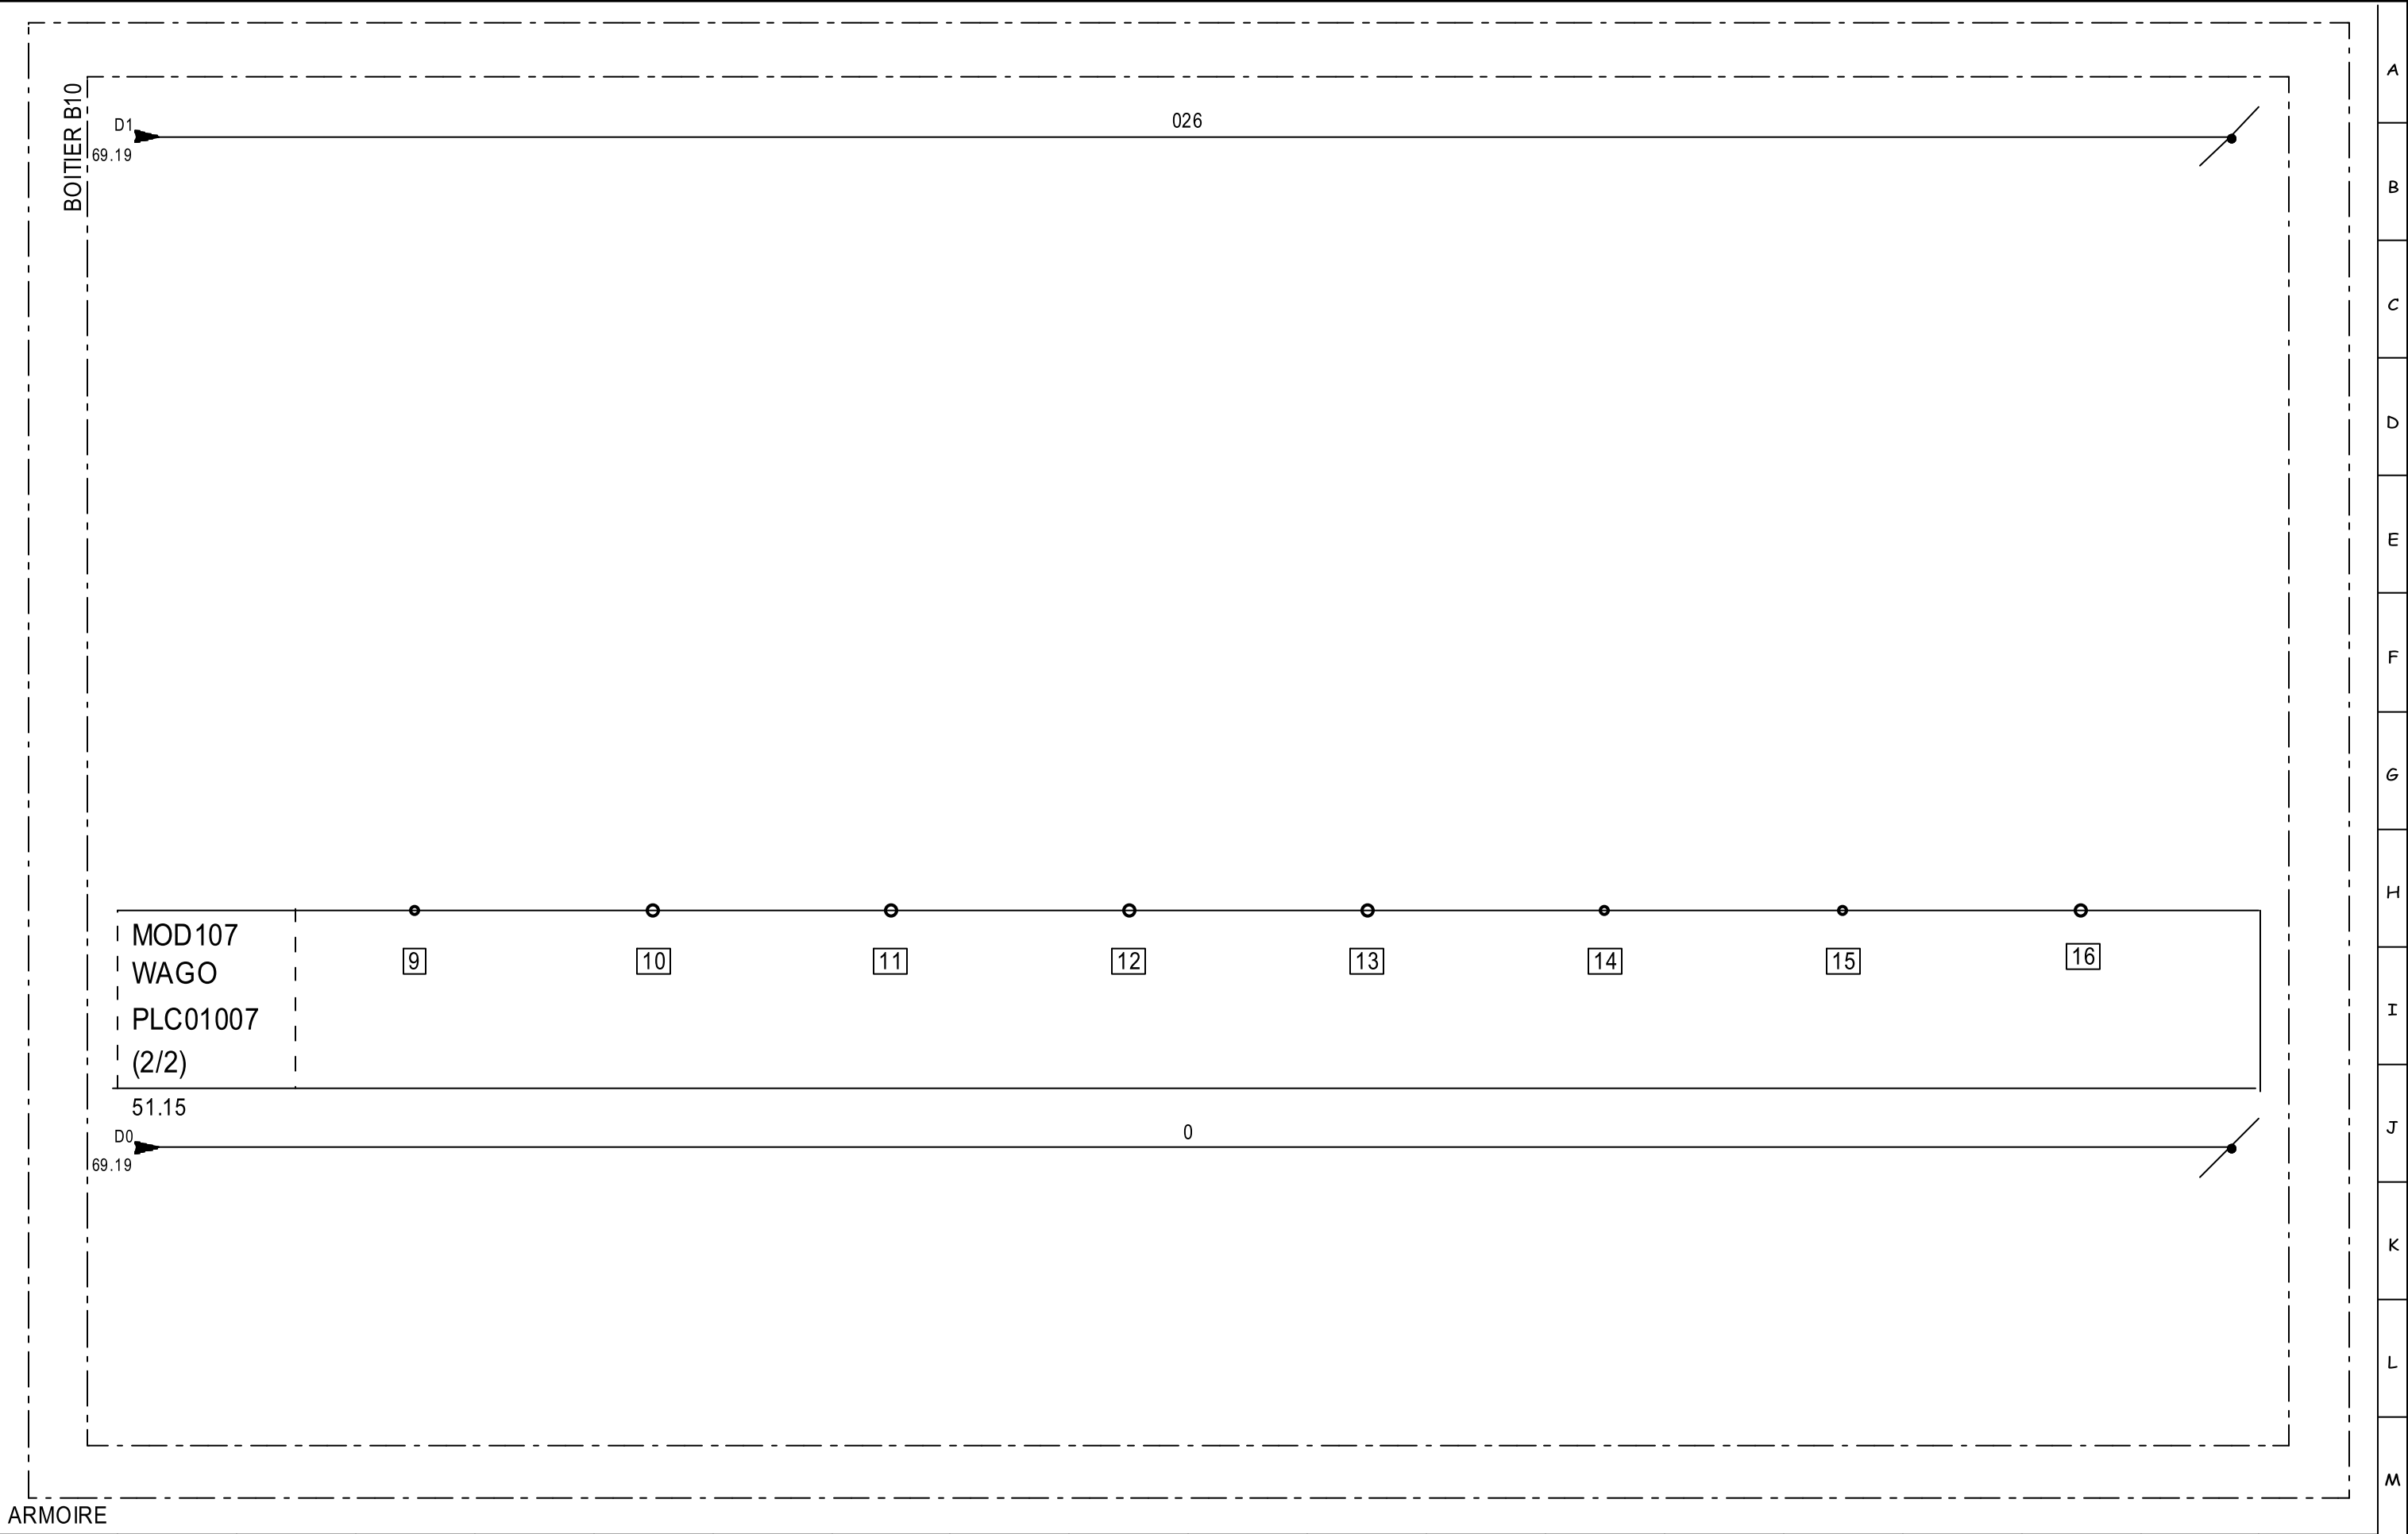


A
B
C
D
E
F
G
H
I
J
K
L
M

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		ENTREES MOD105				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INPUTS MOD105								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail : ecaticd.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020												FOLIO : 70/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.


BORNIER DE PUISSANCE : XP0
POWER TERMINALS : XP0

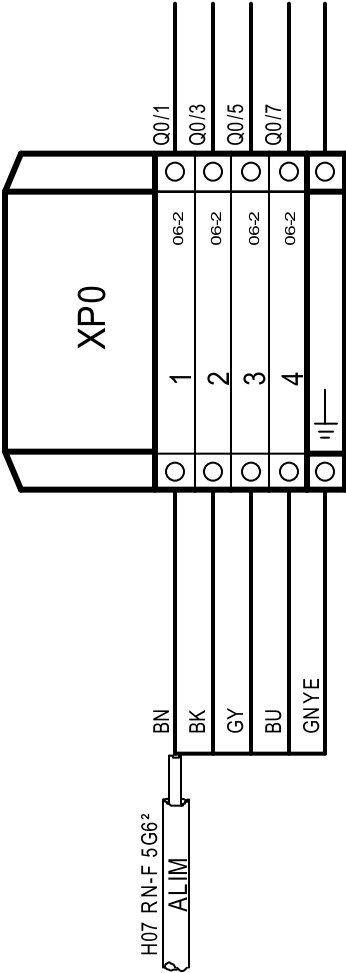

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : XP0			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : XP0							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020			FOLIO : 71/144											


BORNIER DE PUISSANCE : XP1
POWER TERMINALS : XP1

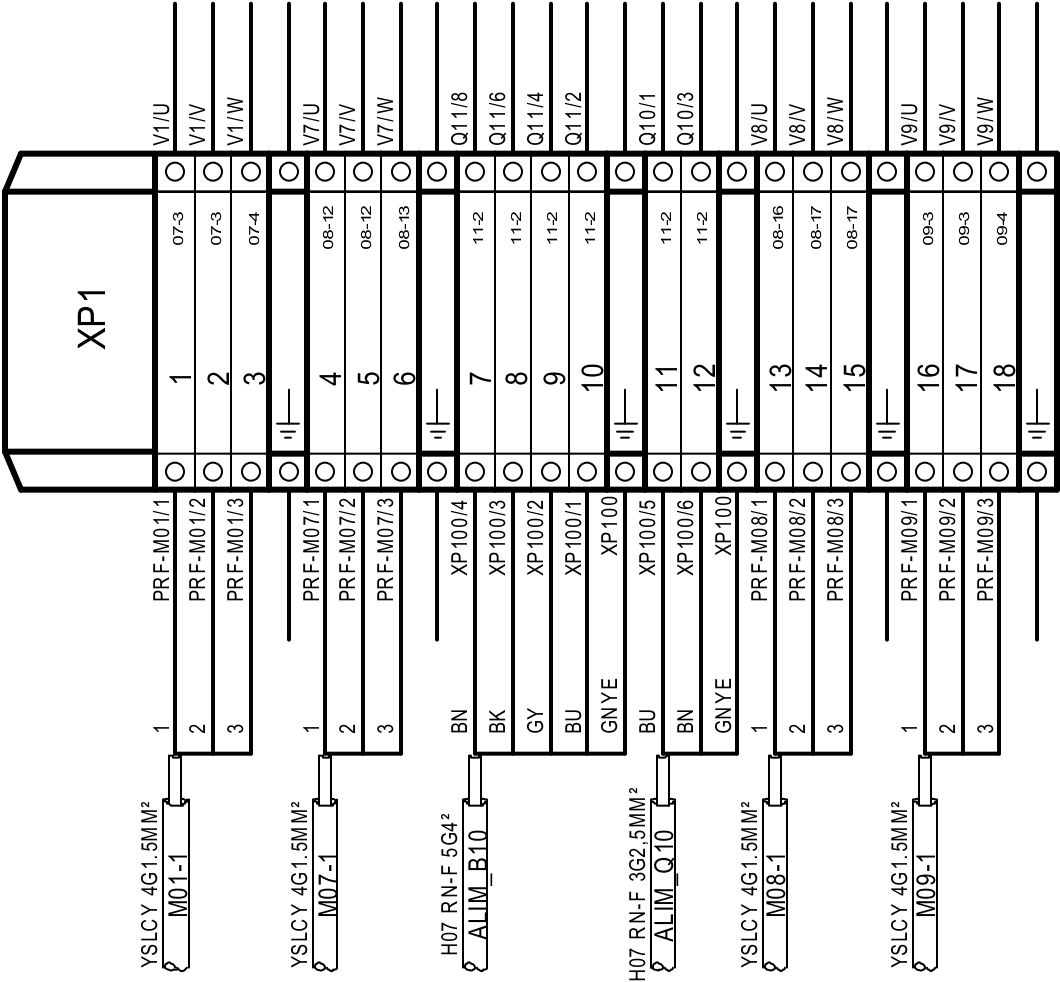

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : XP1				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : XP1								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								72/144					

BORNIER DE COMMANDE : X2
CONTROL TERMINALS : X2

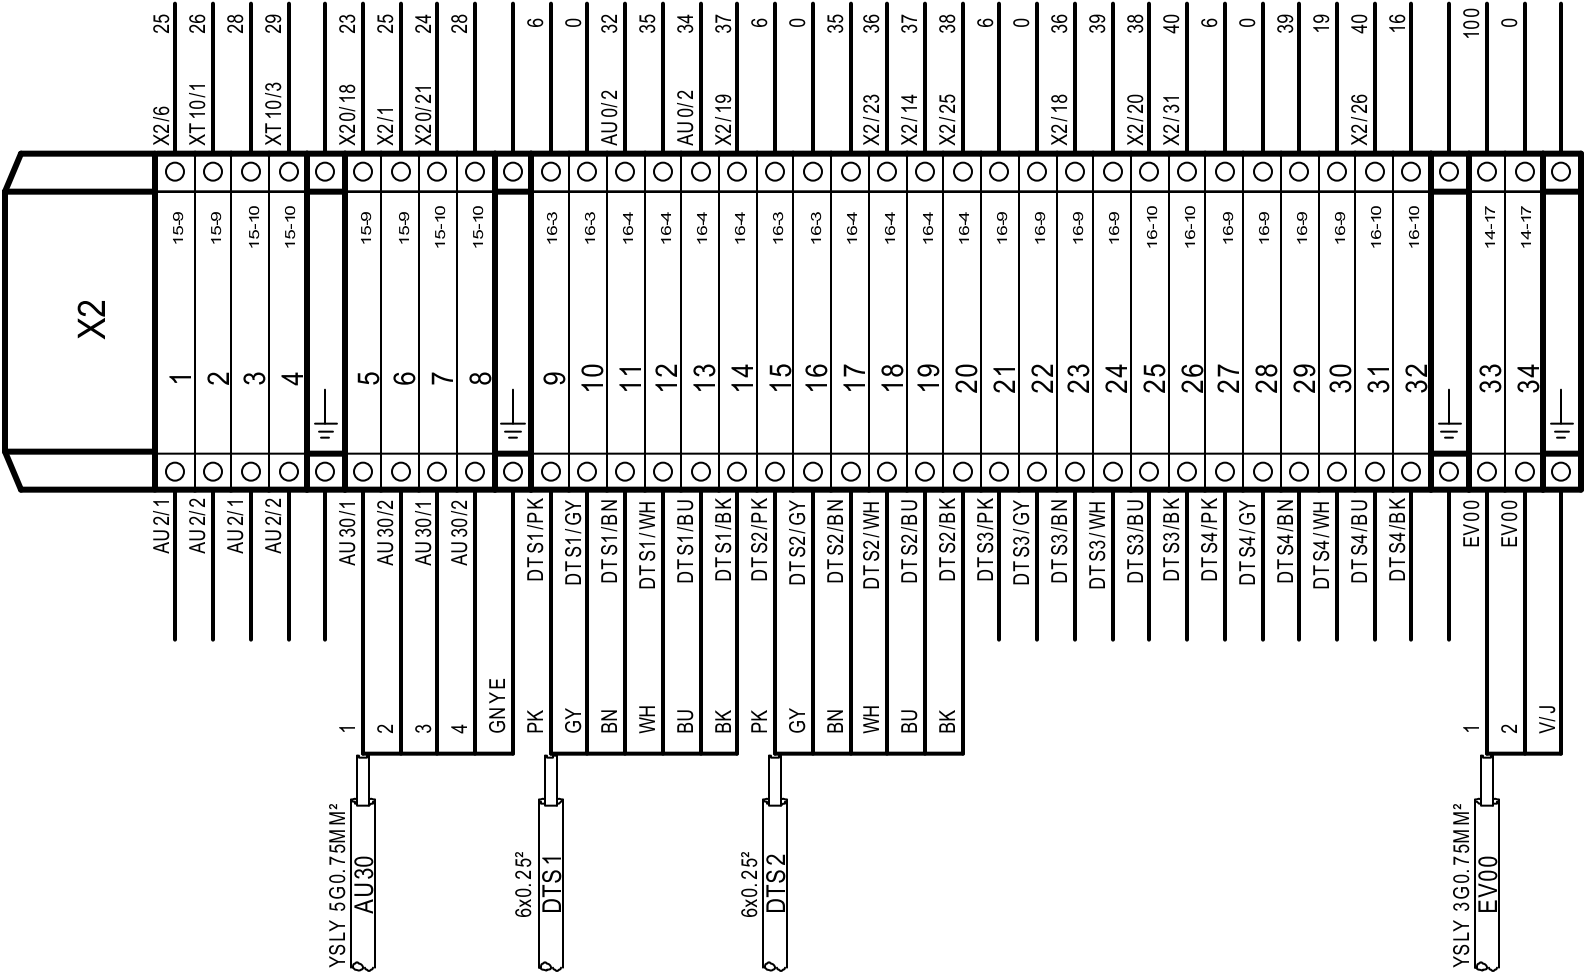


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X2			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X2							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020			FOLIO : 73/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.


BORNIER DE COMMANDE : X3
CONTROL TERMINALS : X3

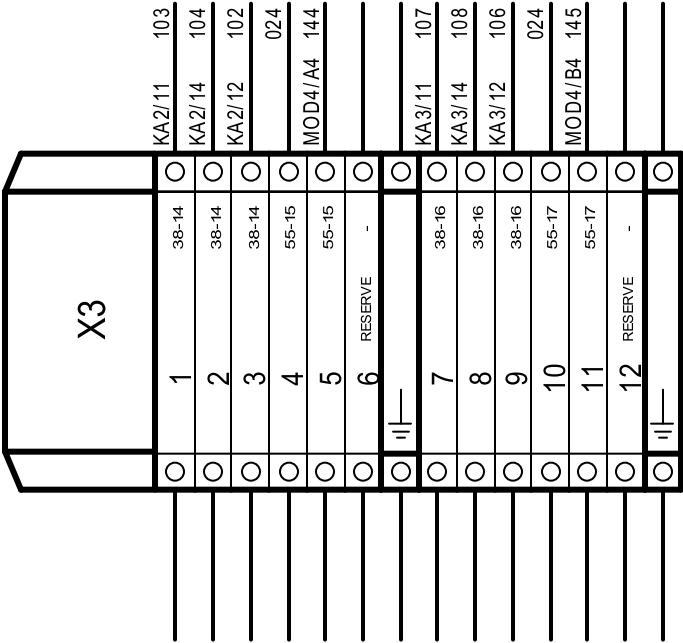

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36			Date of creation : 05/04/2024		Bornier : X3				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38			Designed by : DB		Bornier : X3								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Version 4.49.F - 23/09/2020										FOLIO : 74/144			

BORNIER DE COMMANDE : X4
CONTROL TERMINALS : X4

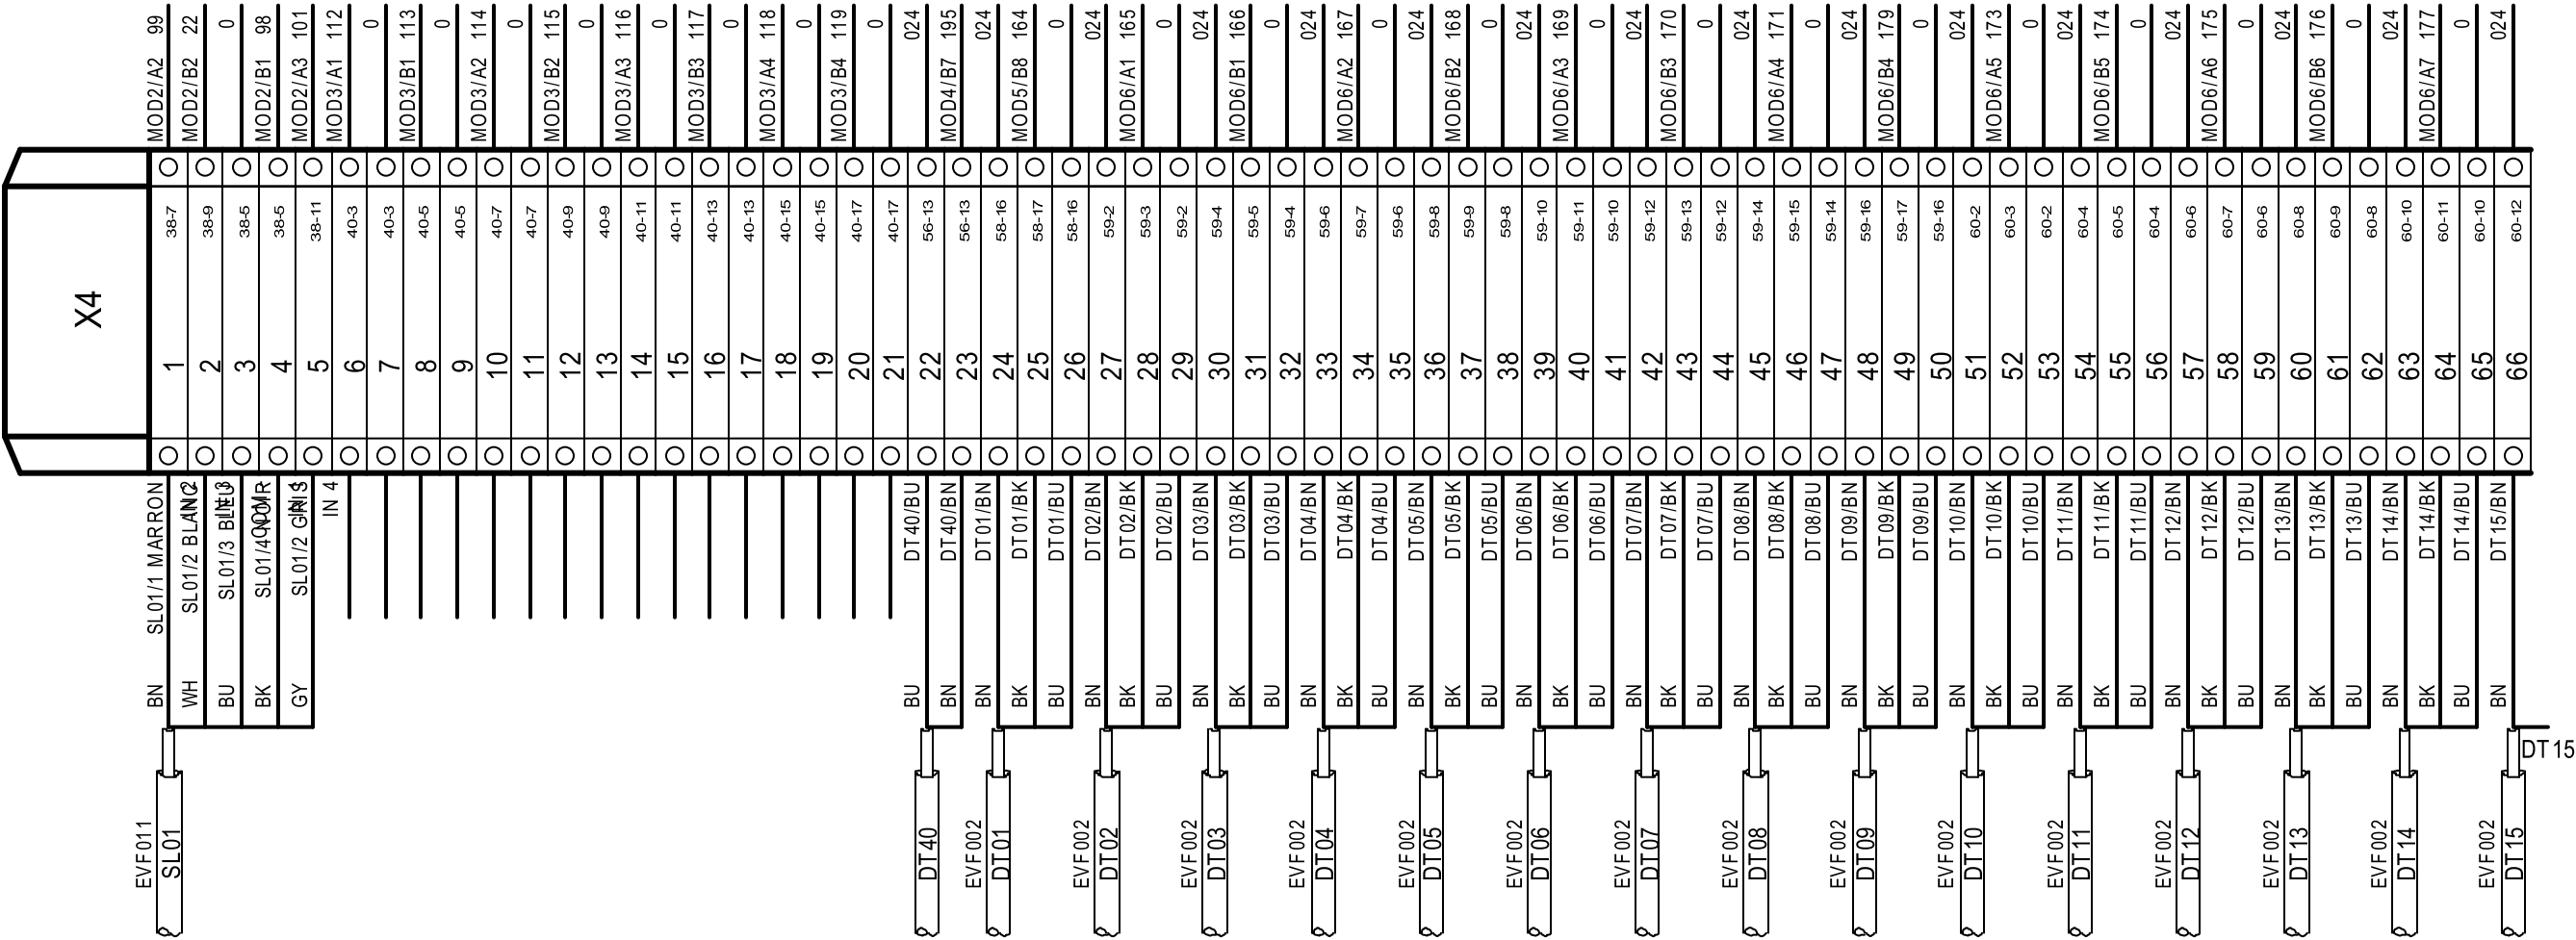


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20					
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatic.service@ceva.com			Date of creation : 05/04/2024 Designed by : DB		Bornier : X4 Bornier : X4 ENVIRONNEMENT : Version 4.49.F - 23/09/2020			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE INDEX : V6 FOLIO : 75/144					
															SMXA0002									

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X4
CONTROL TERMINALS : X4

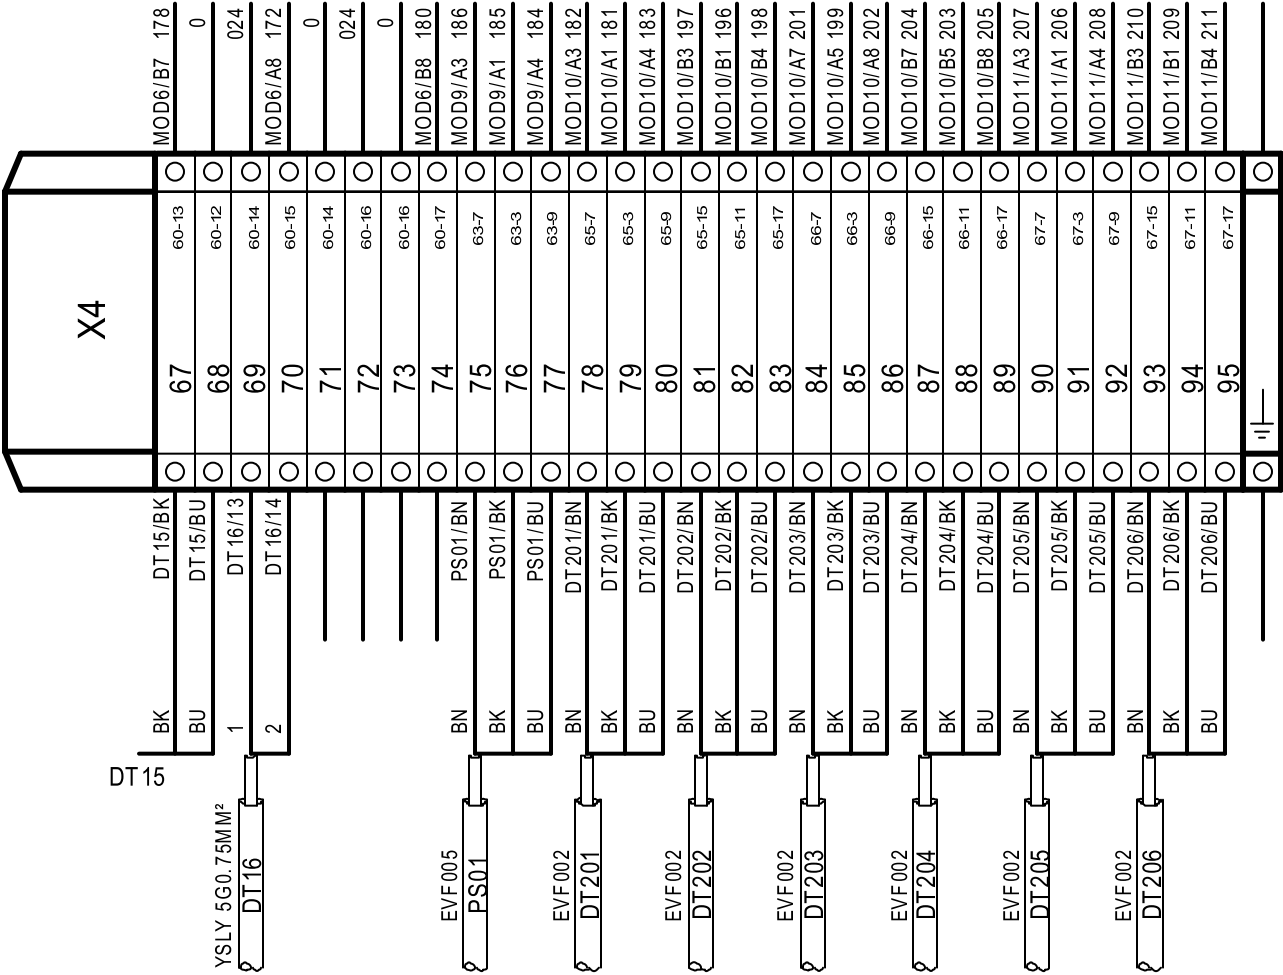


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 05/04/2024		Bornier : X4			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X4							ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020			76/144											



1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 05/04/2024		Bornier : X10				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X10								ARTICLE : SMXA0002				INDEX : V6	
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				FOLIO : 77/144											


BORNIER DE COMMANDE : XT10
CONTROL TERMINALS : XT10

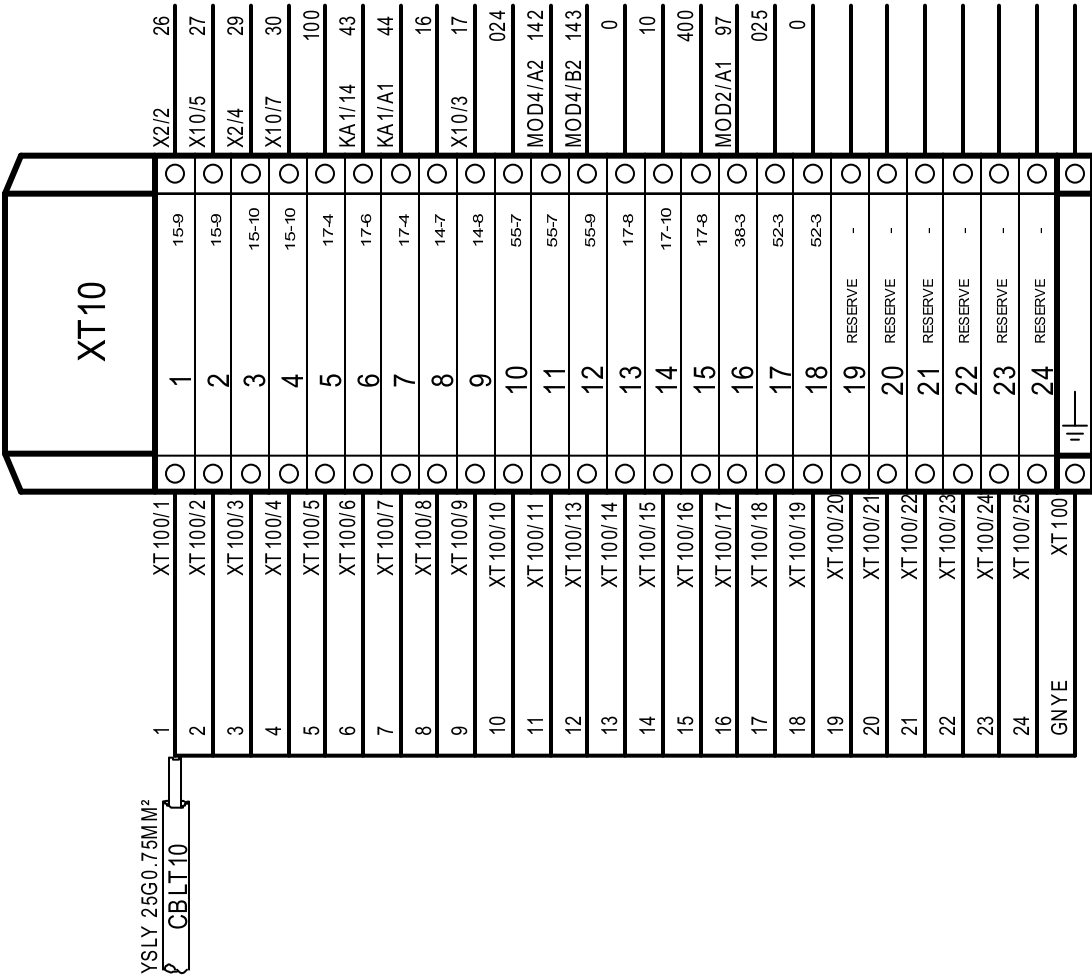

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36	Date of creation : 05/04/2024		Bornier : XT10					 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE			
			Fax : (33).2.98.85.31.38	Designed by : DB		Bornier : XT10									ARTICLE : SMXA0002						INDEX : V6	
			E-mail :ecatid.service@ceva.com					ENVIRONNEMENT:Version 4.49.F - 23/09/2020							79/144							

BORNIER DE PUISSANCE : XP100
POWER TERMINALS : XP100

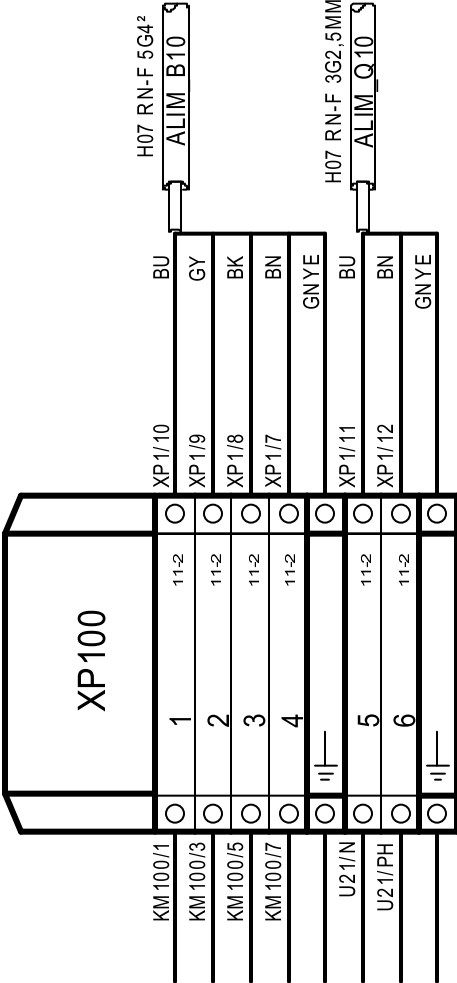


BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : XP100				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : XP100								ARTICLE :		SMXA0002		INDEX : V6	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 80/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE PUISSANCE : XP101
POWER TERMINALS : XP101

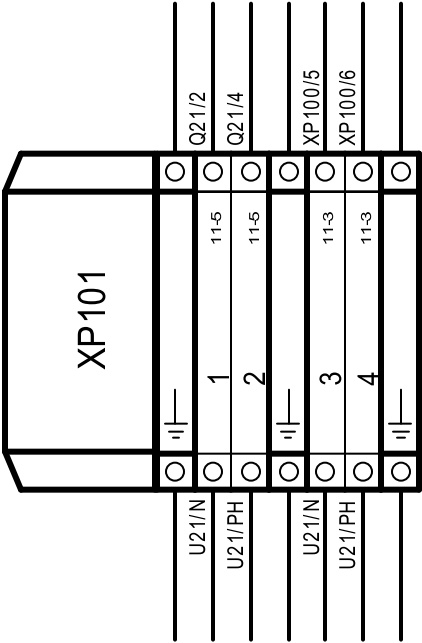


BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : XP101			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE		
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : XP101							ARTICLE : SMXA0002		INDEX : V6				
			E-mail : ecatid.service@ceva.com					ENVIRONNEMENT : Version 4.49.F - 23/09/2020						SMXA0002		FOLIO : 81/144				

BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36			Date of creation : 05/04/2024		Bornier : X100				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38			Designed by : DB		Bornier : X100								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com					ENVIRONNEMENT : Version 4.49.F - 23/09/2020										FOLIO : 82/144			

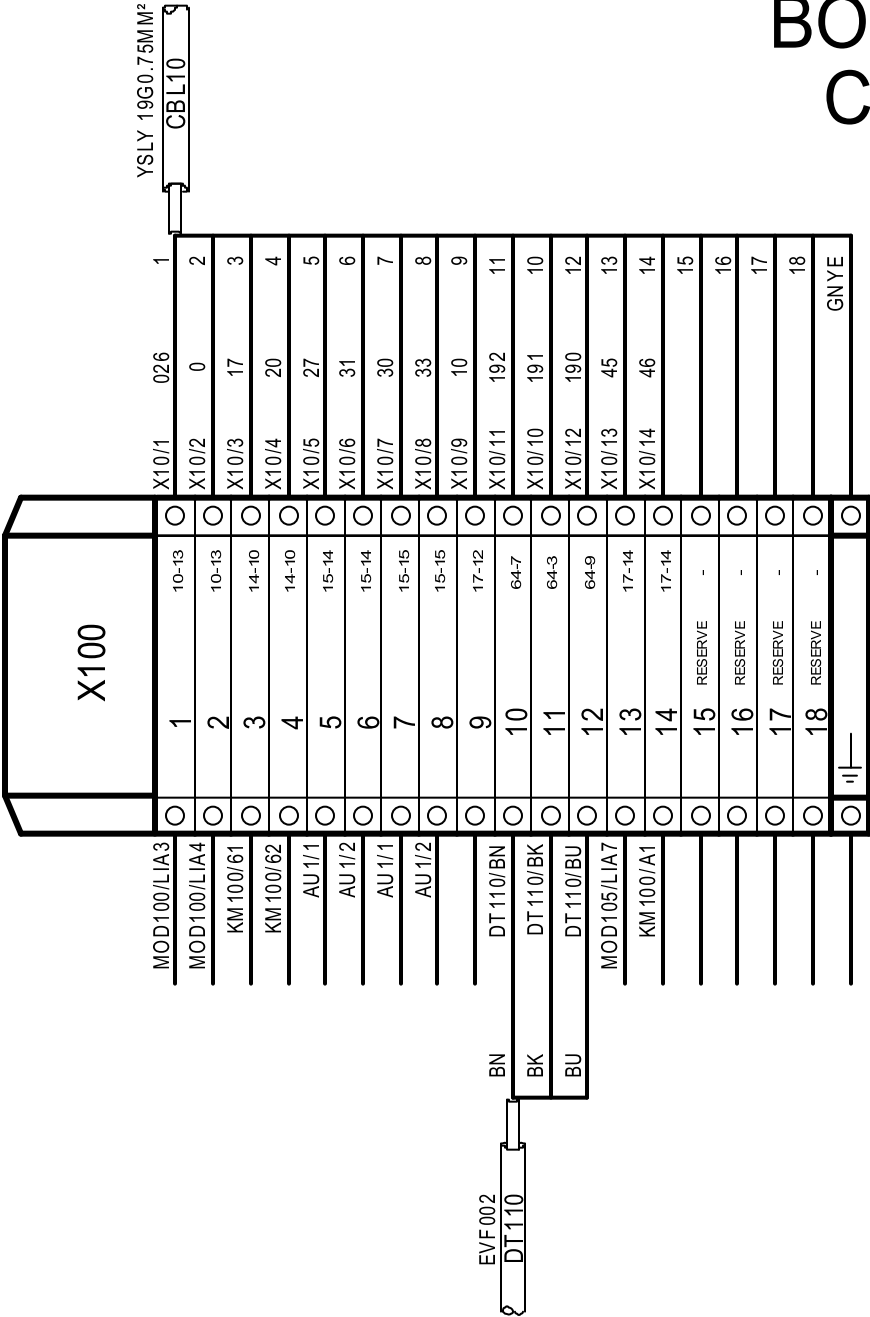

BORNIER DE COMMANDE : X100
CONTROL TERMINALS : X100


A
B
C
D
E
F
G
H
I
J
K
L
M



1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X103			 Ecat-iD Campus					CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE			
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X103								ARTICLE : SMXA0002						INDEX : V6	
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT: Version 4.49.F - 23/09/2020			FOLIO : 83/144														

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X104
CONTROL TERMINALS : X104

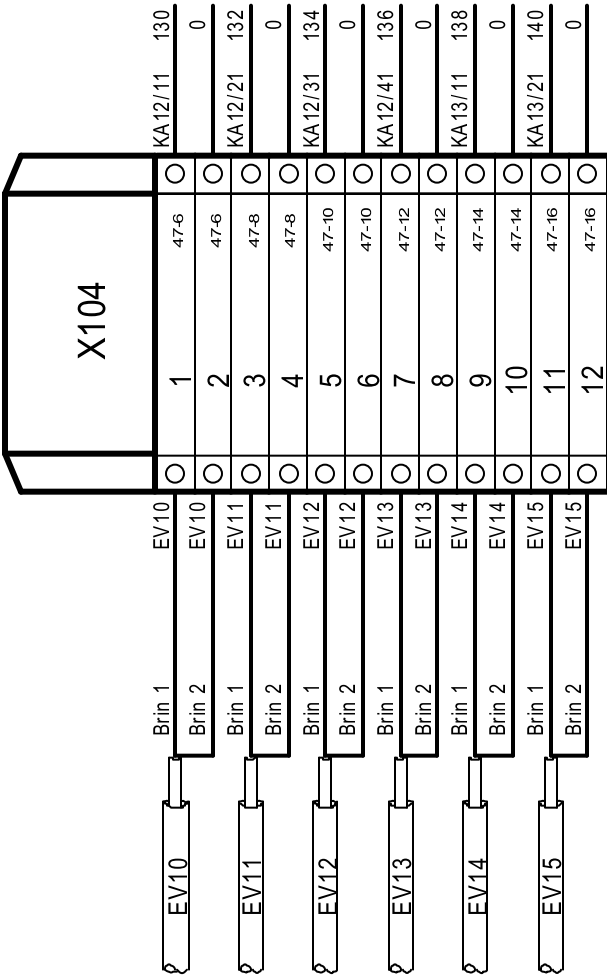


BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –		Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X104		 Ecat-iD Campus						CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X104								ARTICLE : SMXA0002		INDEX : V6			
		E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		FOLIO : 84/144													

A
B
C
D
E
F
G
H
I
J
K
L
M

BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36			Date of creation : 03/04/2024		Bornier : X105				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38			Designed by : DB		Bornier : X105								ARTICLE :		INDEX : V6			
			E-mail : ecaticid.service@ceva.com					ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002		85/144			

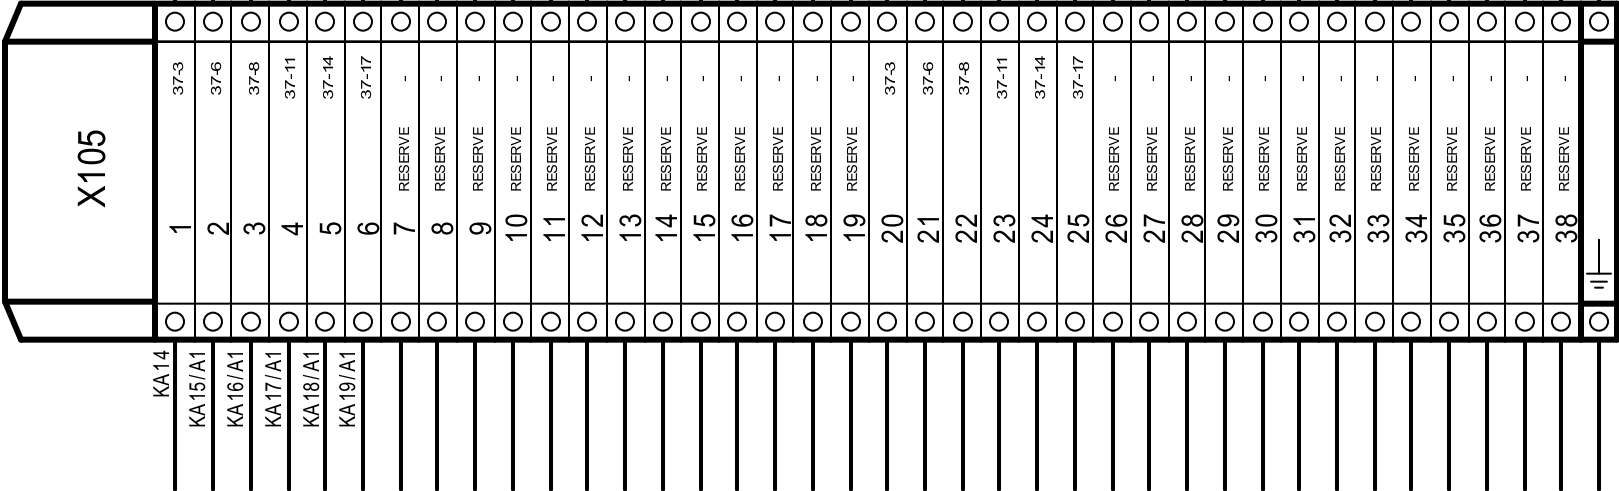

PREVOIR DES EMBOUTS
DE CÂBLAGE DOUBLE


UTILISER DES BORNES 3 ETAGES PT 1,5/S-3PV REF :3213742

BORNIER DE COMMANDE : X105
CONTROL TERMINALS : X105

A
B
C
D
E
F
G
H
I
J
K
L
M

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X106
CONTROL TERMINALS : X106

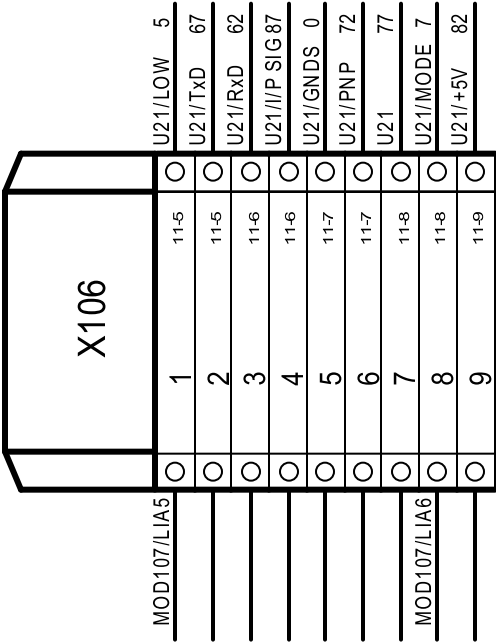

BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X106			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X106							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020			FOLIO : 86/144											


A
B
C
D
E
F
G
H
I
J
K
L
M



А	Б	В	Г	Д	Е	Ж	З	И	Й	К
---	---	---	---	---	---	---	---	---	---	---

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X120
CONTROL TERMINALS : X120

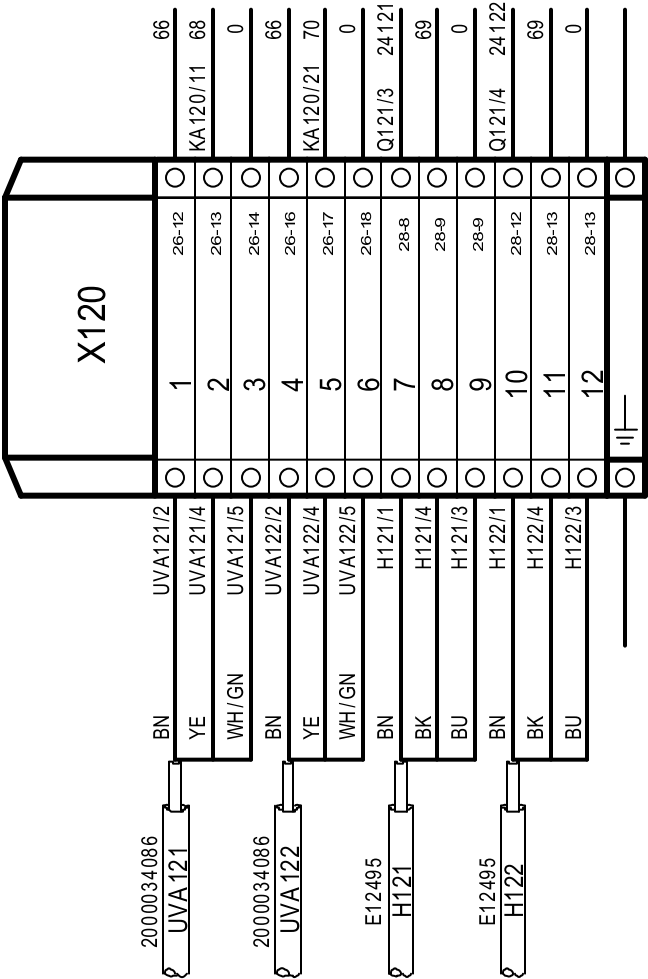


BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X120				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X120								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								88/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X130
CONTROL TERMINALS : X130

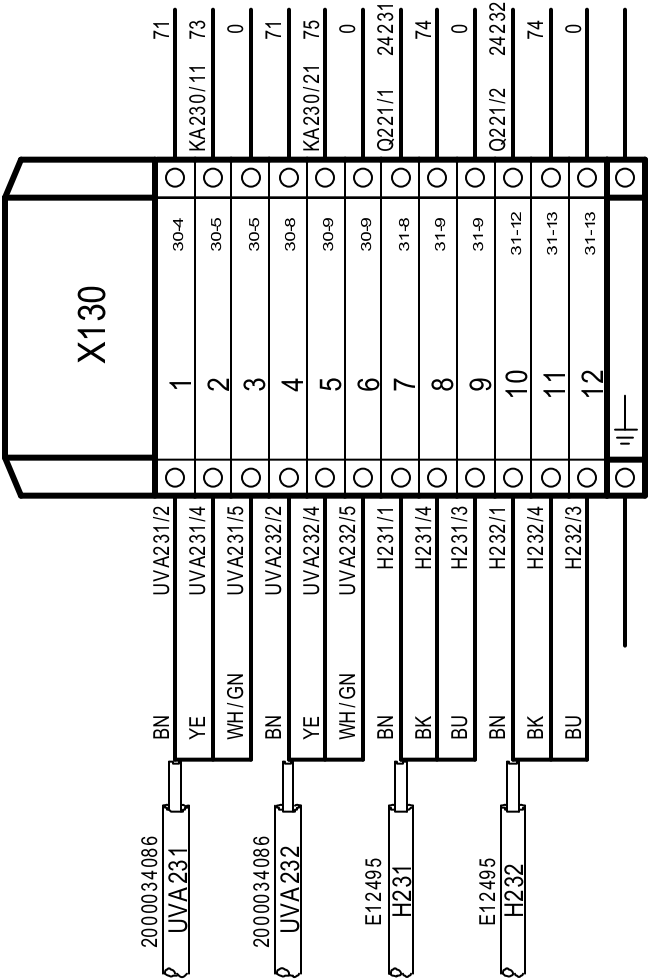


BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X130				 Ecat-iD Campus			CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X130							ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020							89/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X140
CONTROL TERMINALS : X140

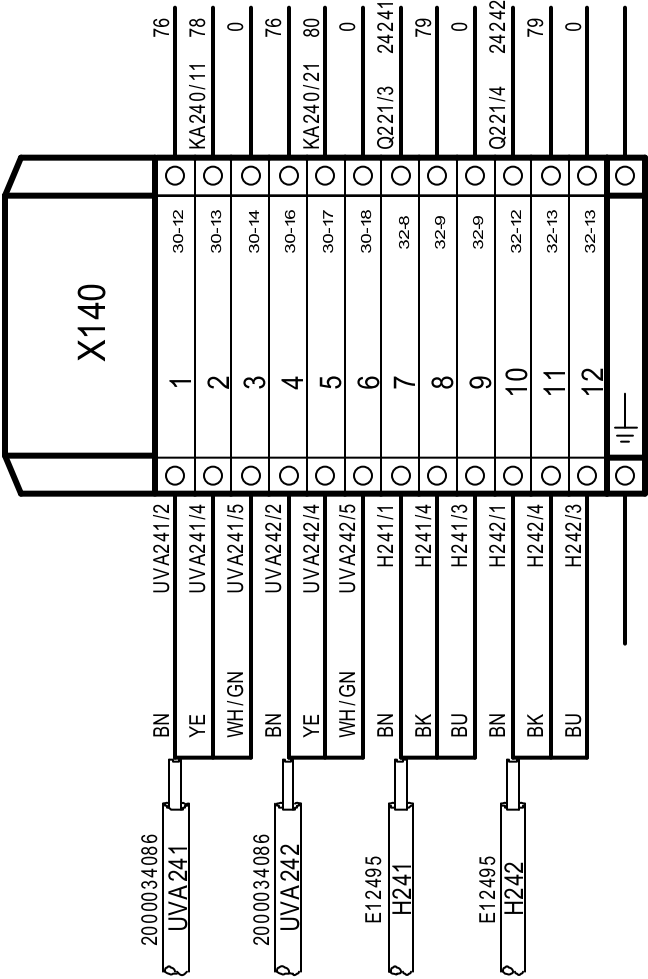


BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X140				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X140								INDEX : V6					
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								SMXA0002				FOLIO : 90/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X150
CONTROL TERMINALS : X150

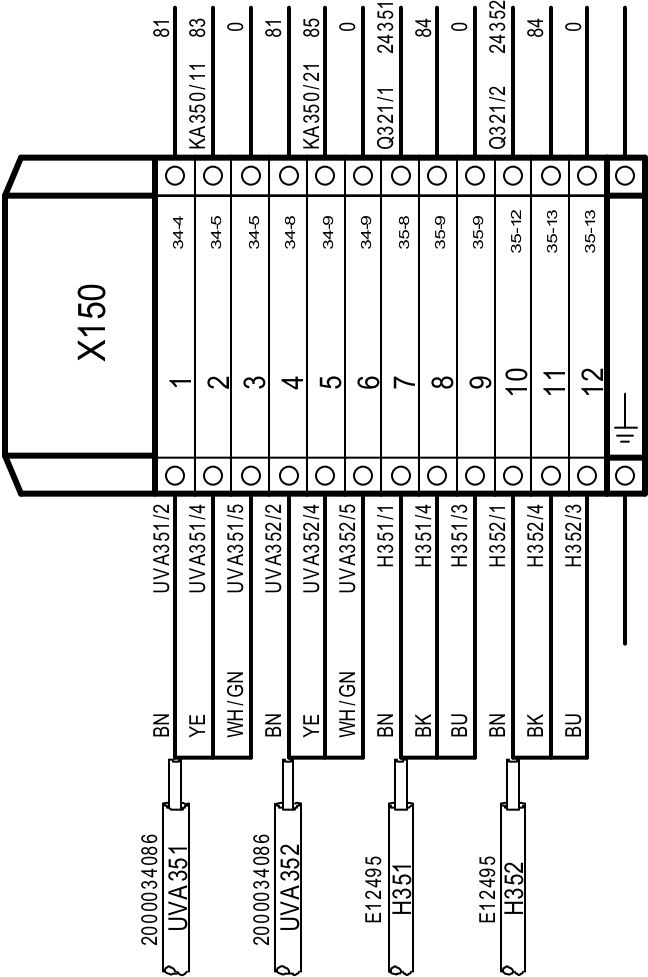

BOITIER B10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20					
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Bornier : X150				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE					
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : X150								ARTICLE :		SMXA0002		INDEX : V6					
			E-mail :ecatid.service@ceva.com						ENVIRONNEMENT:Version 4.49.F - 23/09/2020										FOLIO : 91/144					

A
B
C
D
E
F
G
H
I
J
K
L
M

A
B
C
D
E
F
G
H
I
J
K
L
M



ECAT-ID
ZI de KERIEL
29800 PLOUEDERN
- FRANCE -

E-mail : ecatid.service@ceva.com


ENVIRONNEMENT:Version 4.49.F - 23/09/2020



FOLIO : 92/144

SMXA0002

BORNIER DE COMMANDE : X200
CONTROL TERMINALS : X200

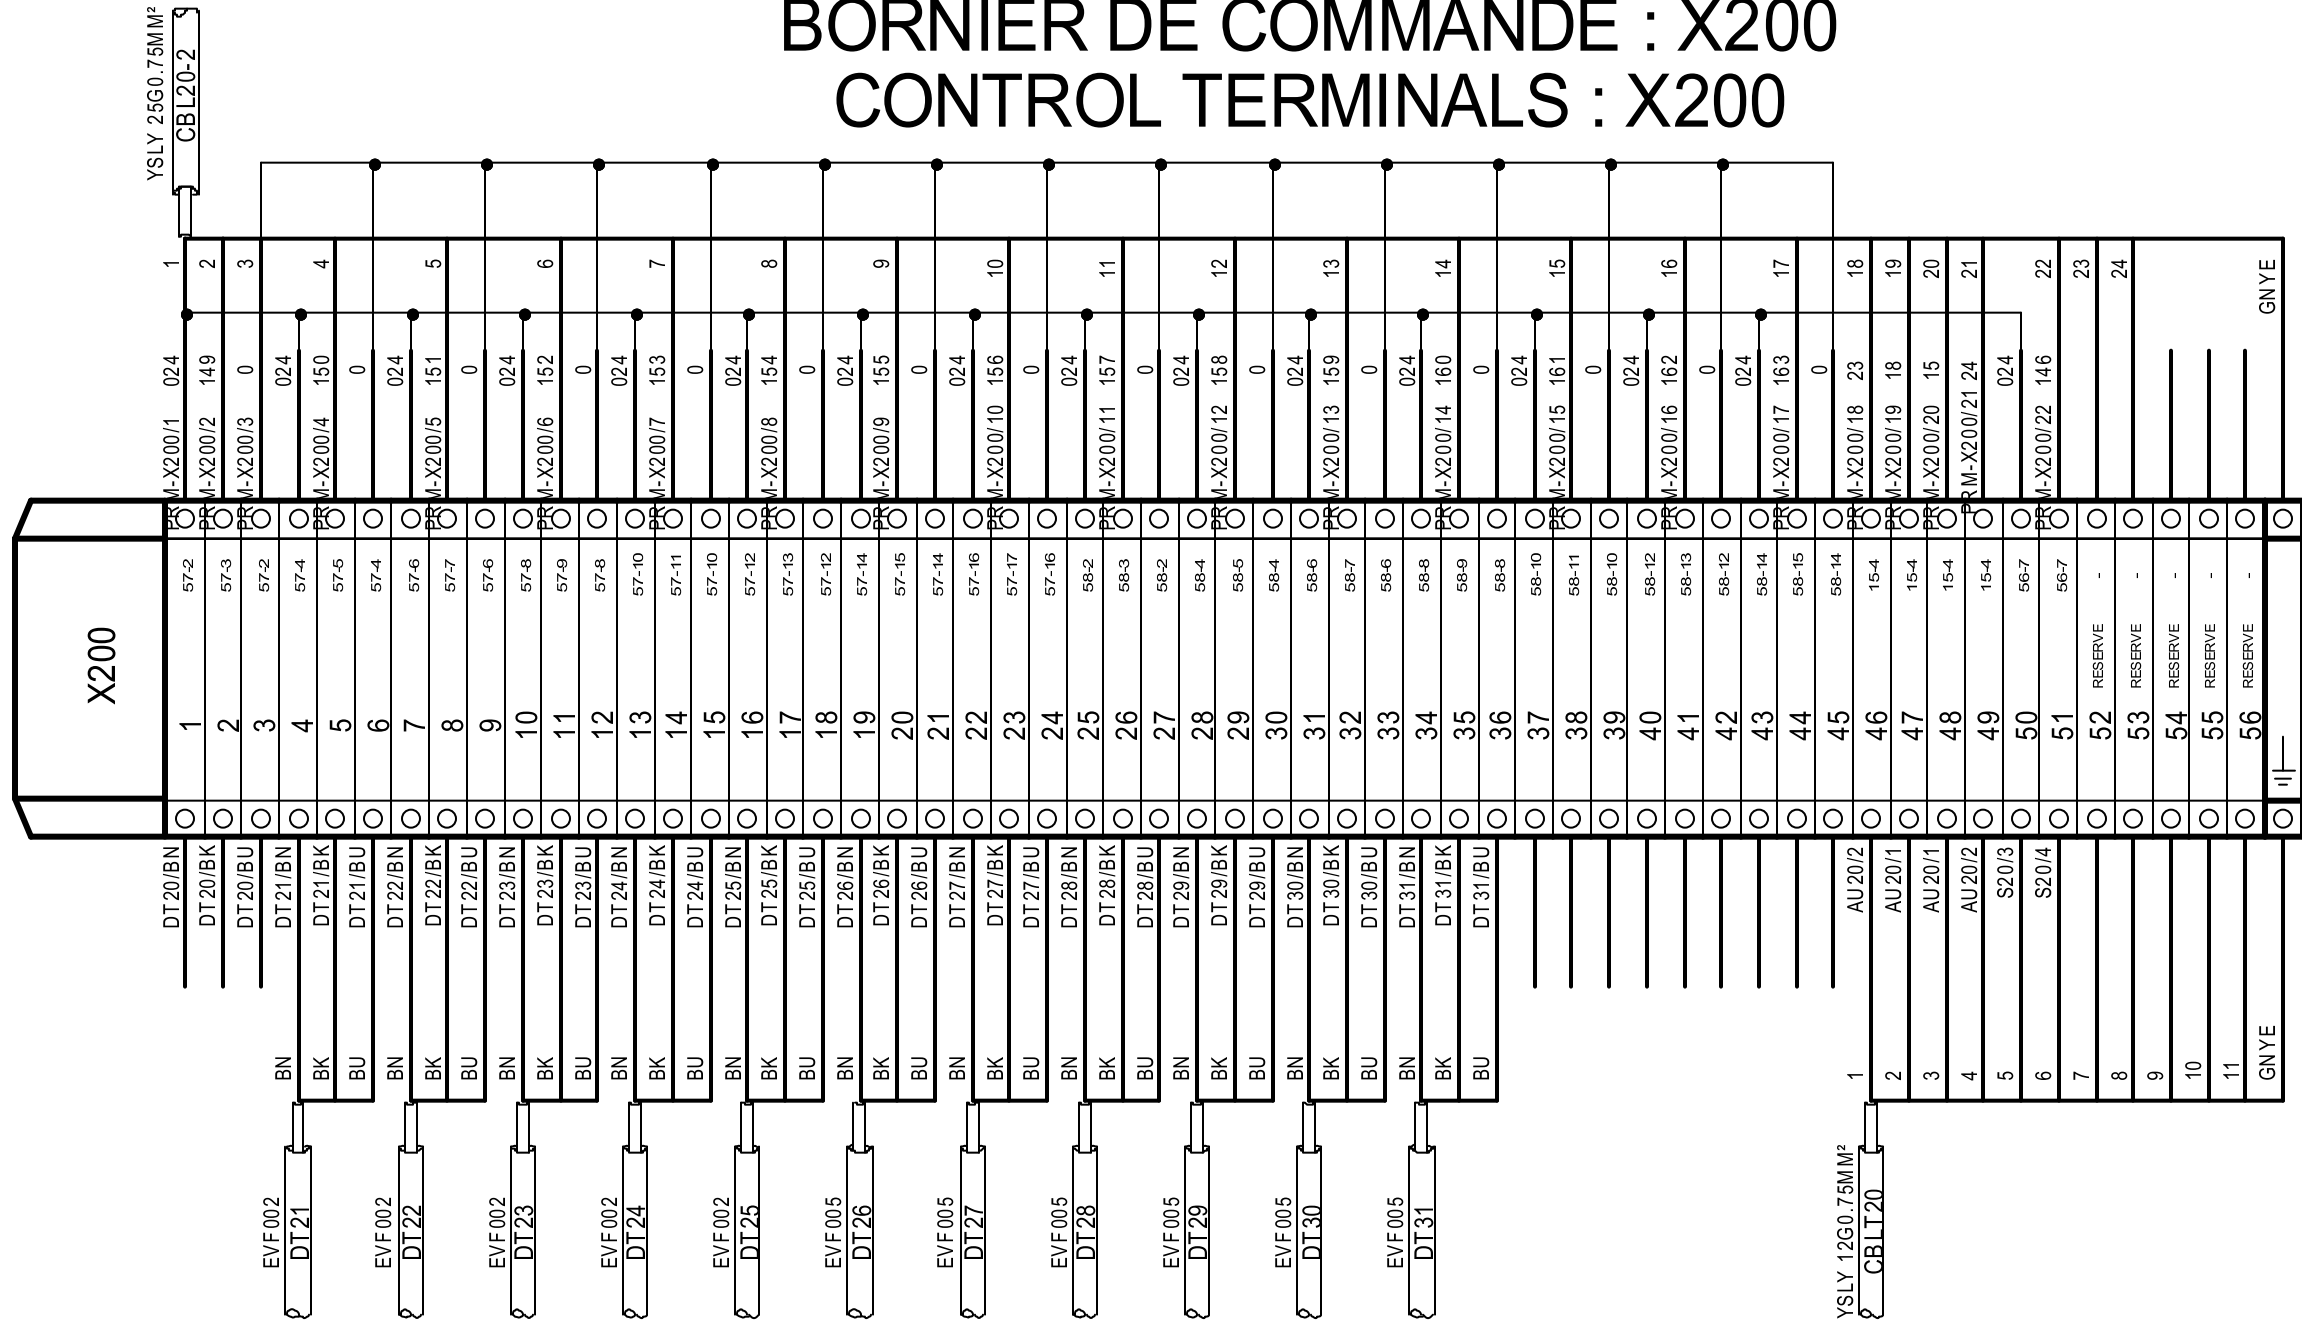


BOITIER B20

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél :(33).2.98.85.31.36		Date of creation : 05/04/2024		Bornier : X200				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax :(33).2.98.85.31.38		Designed by : DB		Bornier : X200								SMXA0002				INDEX : V5	
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 93/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : XT100
CONTROL TERMINALS : XT100


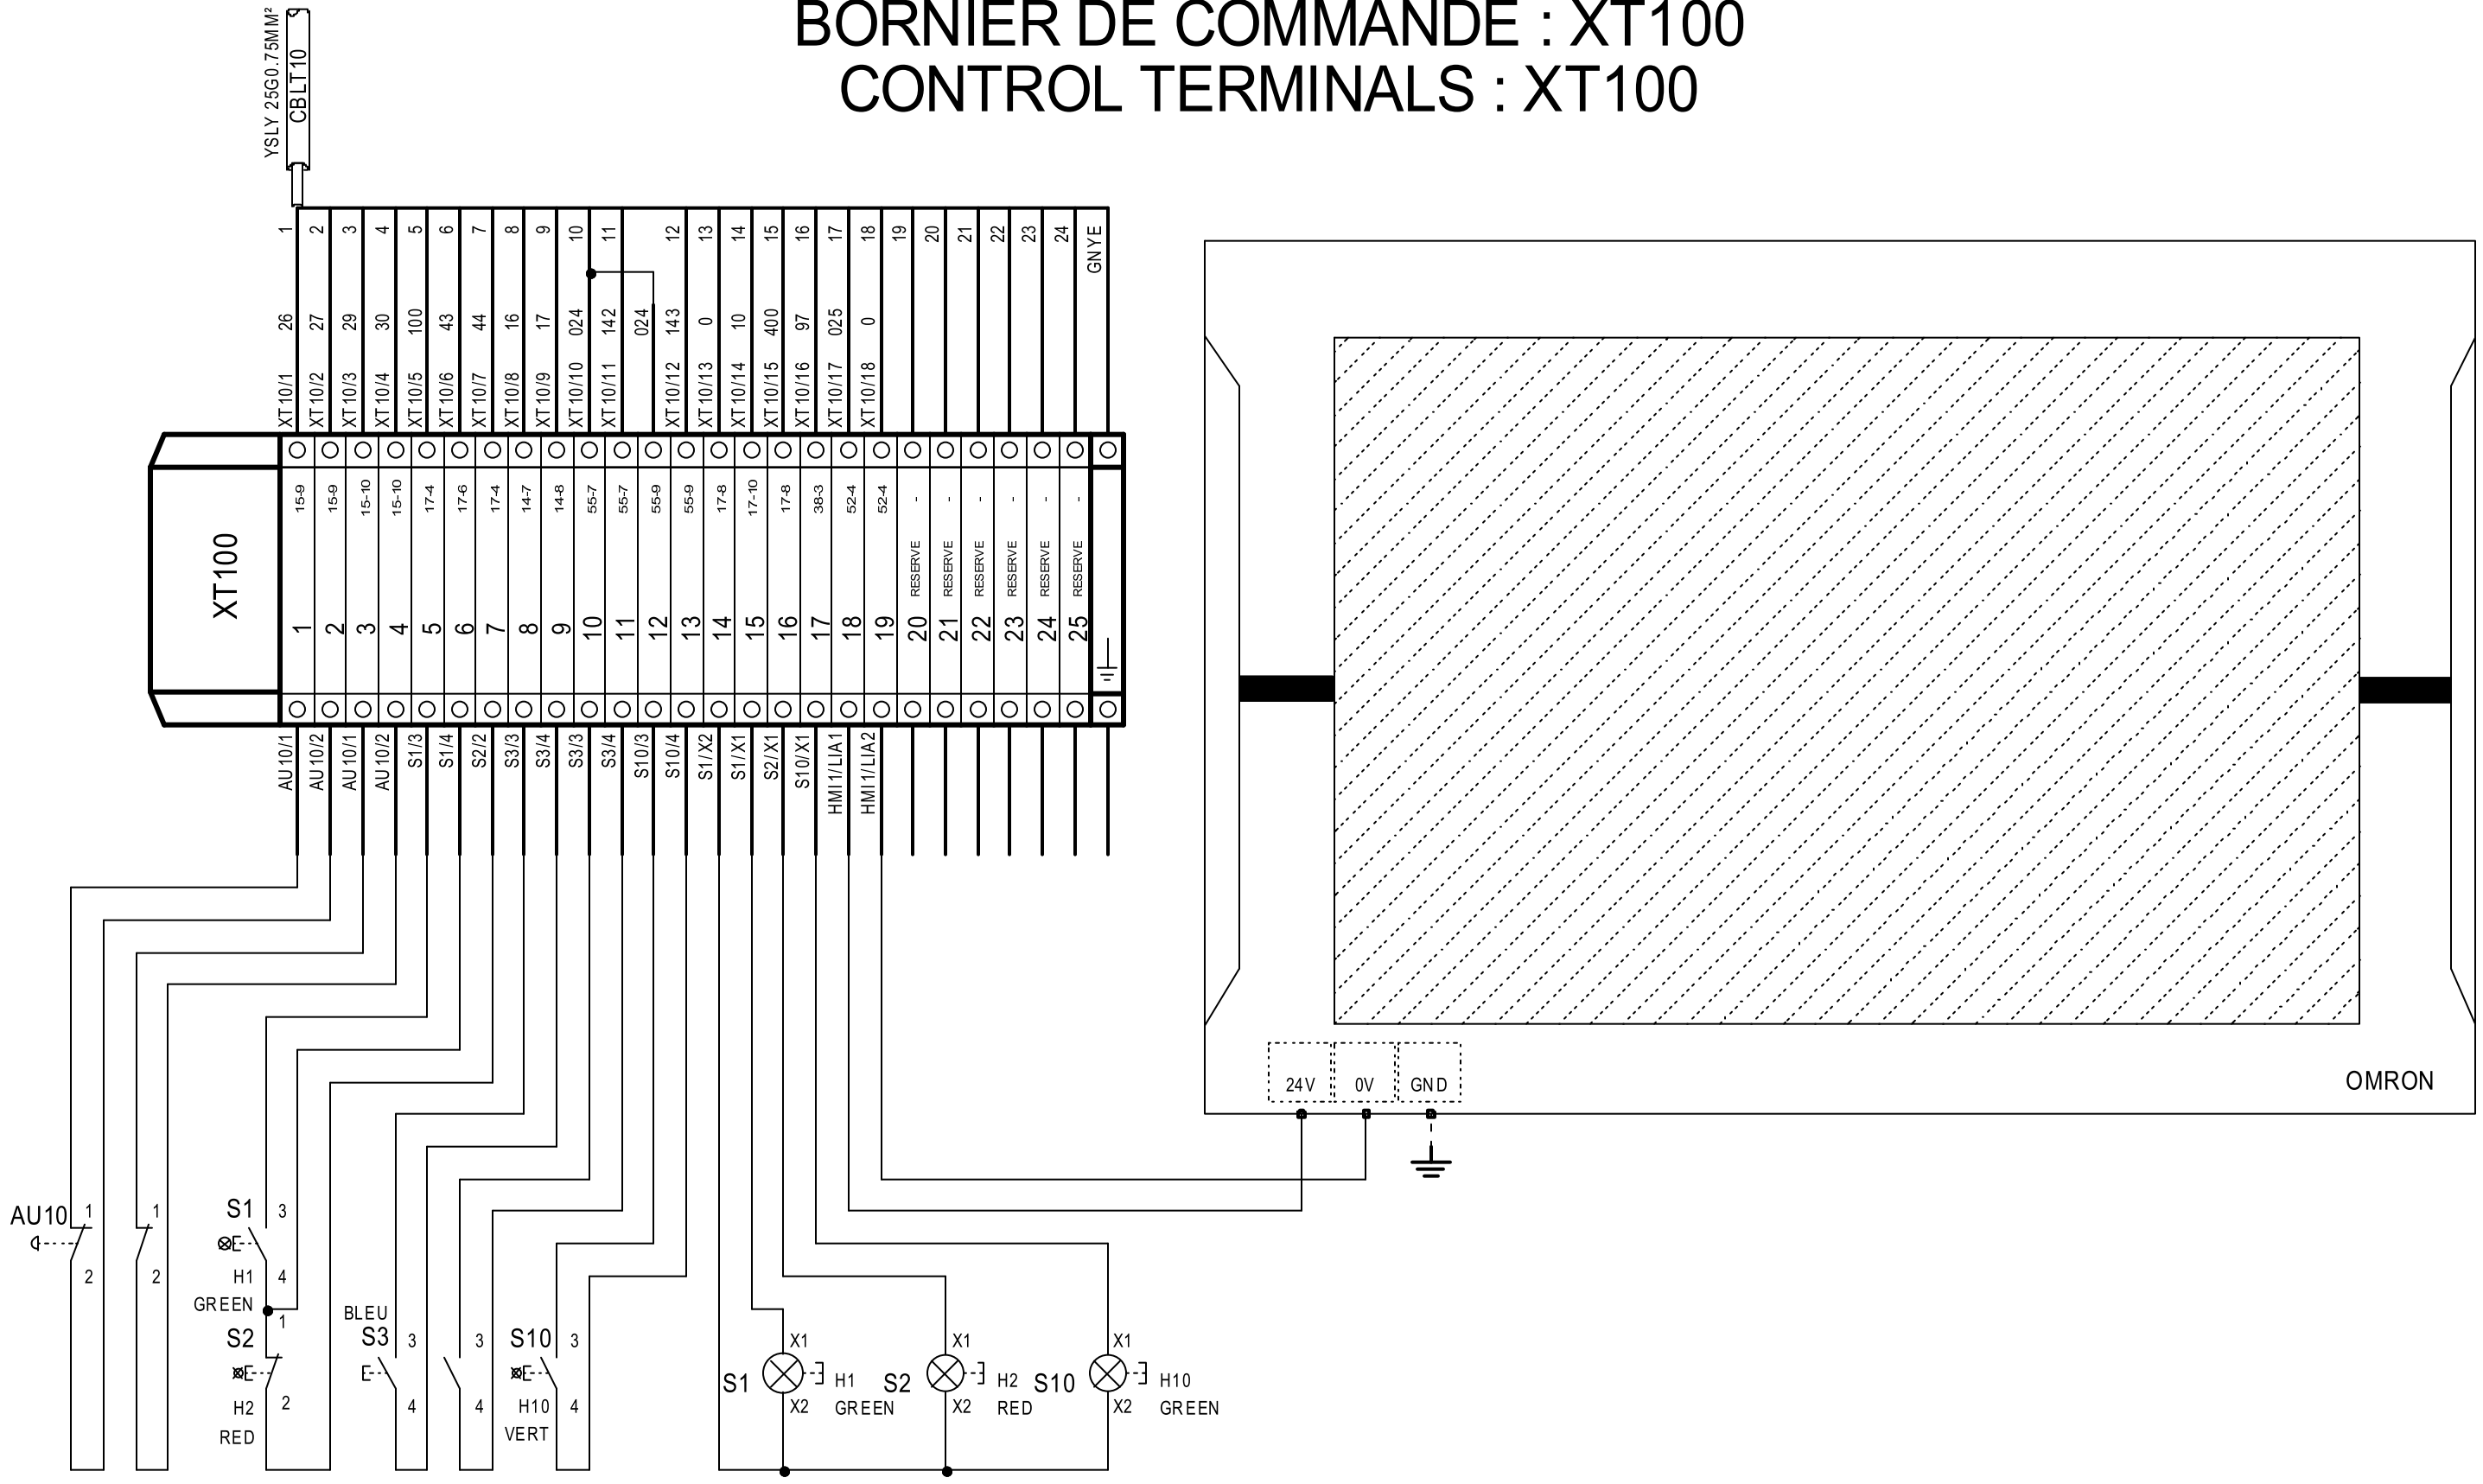


BOITIER T10

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 05/04/2024		Bornier : XT100				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		Bornier : XT100								ARTICLE : SMXA0002				INDEX : V6	
			E-mail : ecatid.service@ceva.com						ENVIRONNEMENT:Version 4.49.F - 23/09/2020						94/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

CONNECTEUR DE PUISSANCE : PRM-M01 & PRF-M01
POWER CONNECTOR : PRM-M01 & PRF-M01

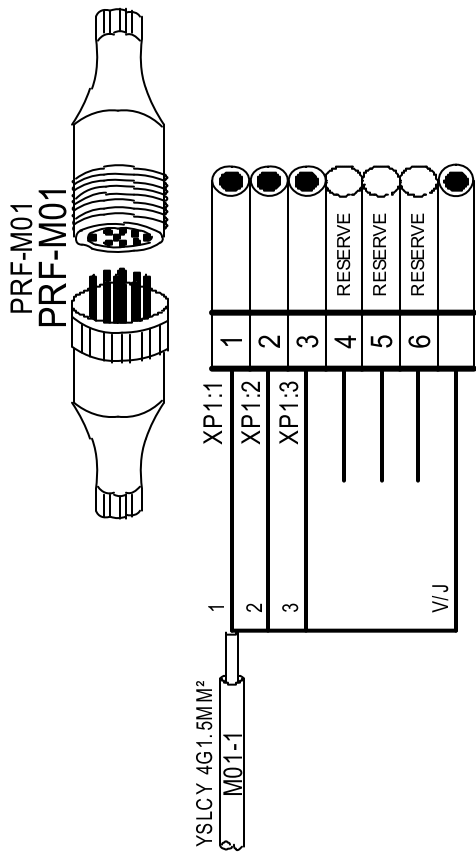
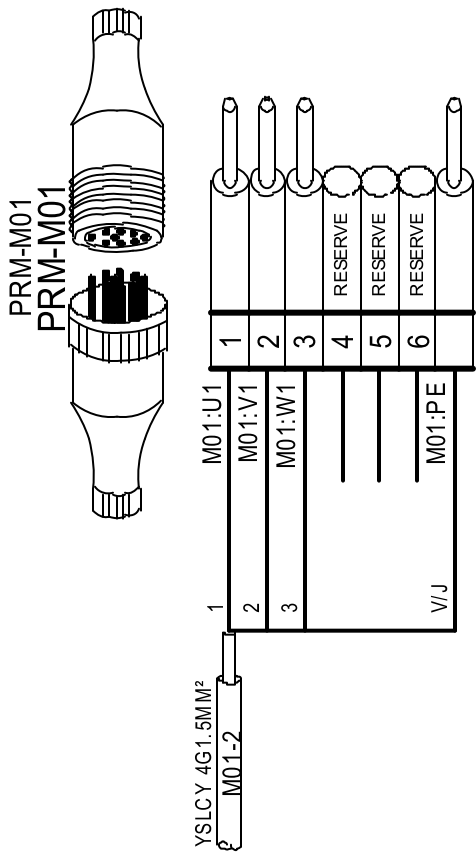


PRM-M01

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Connecteur: PRM-M01 & PRF-M01			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		PRM-M01 - 1/1							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com					ENVIRONNEMENT: Version 4.49.F - 23/09/2020						SMXA0002				FOLIO : 95/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

CONNECTEUR DE PUISSANCE : PRM-M07 & PRF-M07
POWER CONNECTOR : PRM-M07 & PRF-M07

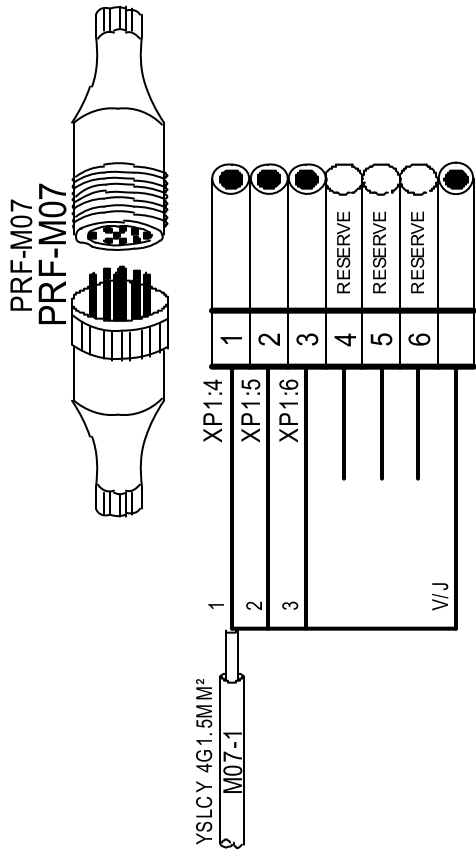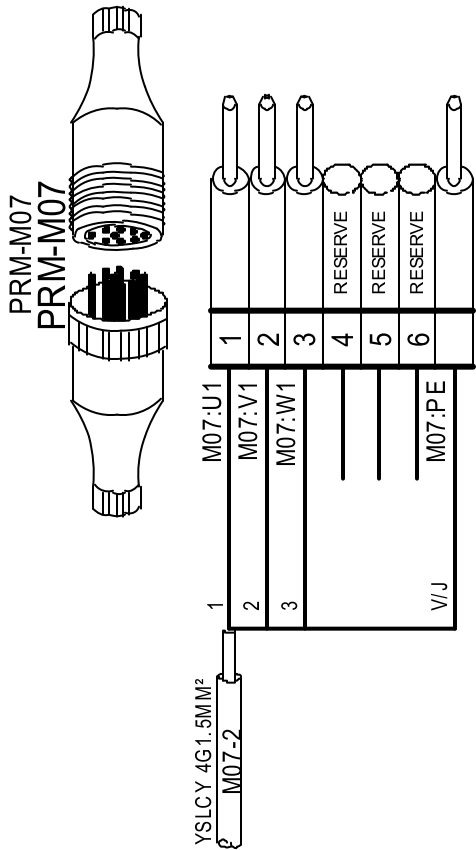



PRM-M07

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Connecteur: PRM-M07 & PRF-M07			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		PRM-M07 - 1/1							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT: Version 4.49.F - 23/09/2020			96/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

CONNECTEUR DE PUISSANCE : PRM-M08 & PRF-M08

POWER CONNECTOR : PRM-M08 & PRF-M08

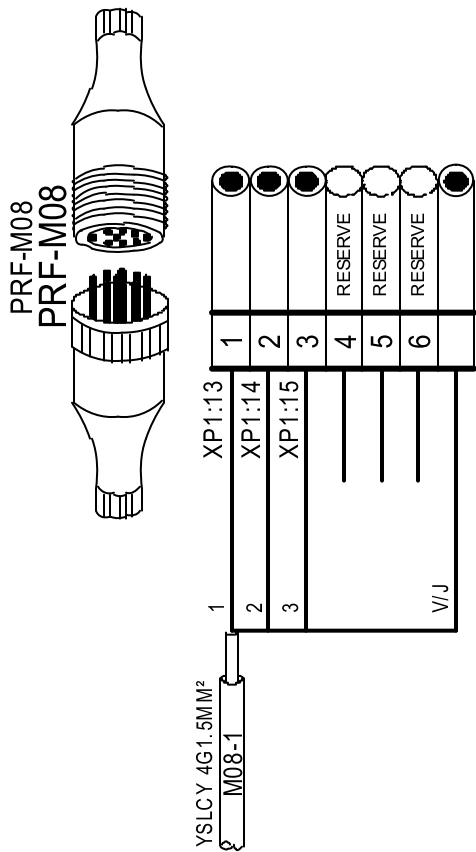
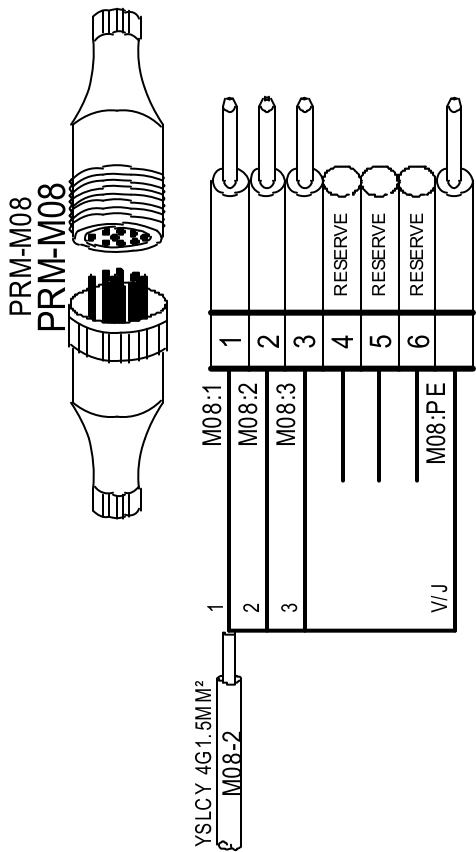


PRM-M08

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Connecteur: PRM-M08 & PRF-M08				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		PRM-M08 - 1/1								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020												FOLIO : 97/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

CONNECTEUR DE PUISSANCE : PRM-M09 & PRF-M09
POWER CONNECTOR : PRM-M09 & PRF-M09


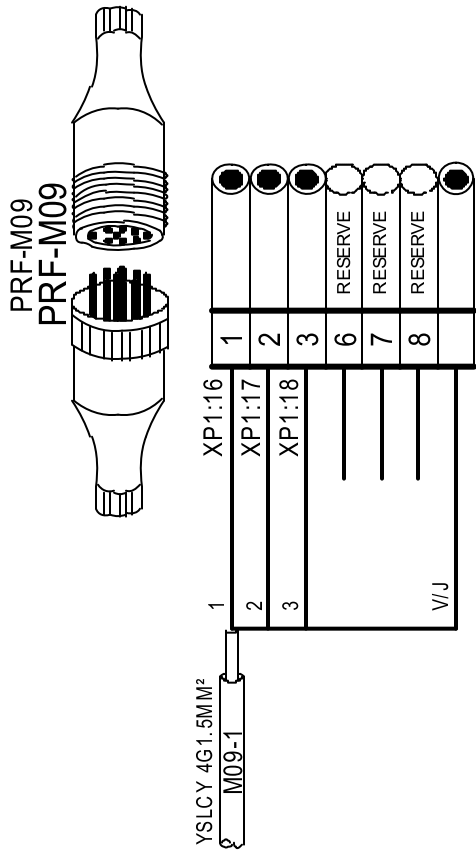
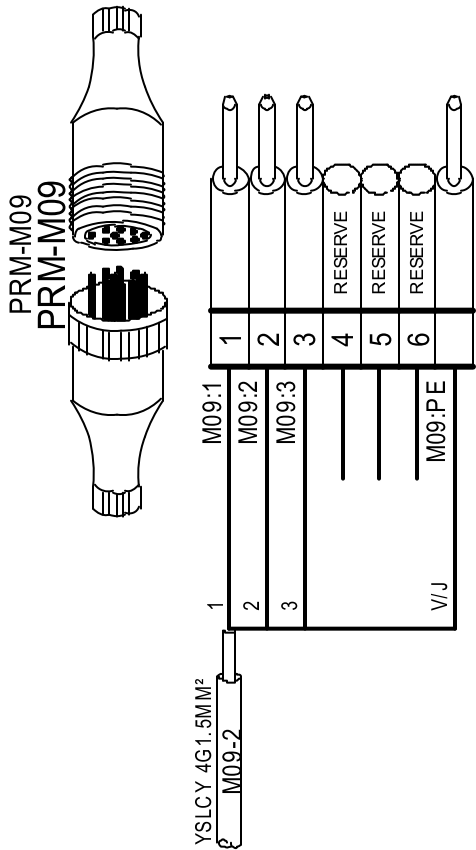


PRM-M09

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 03/04/2024		Connecteur: PRM-M09 & PRF-M09			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		PRM-M09 - 1/1							ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020			98/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

CONNECTEUR DE PUISSANCE : PRM-M09 & PRF-M09
POWER CONNECTOR : PRM-M09 & PRF-M09

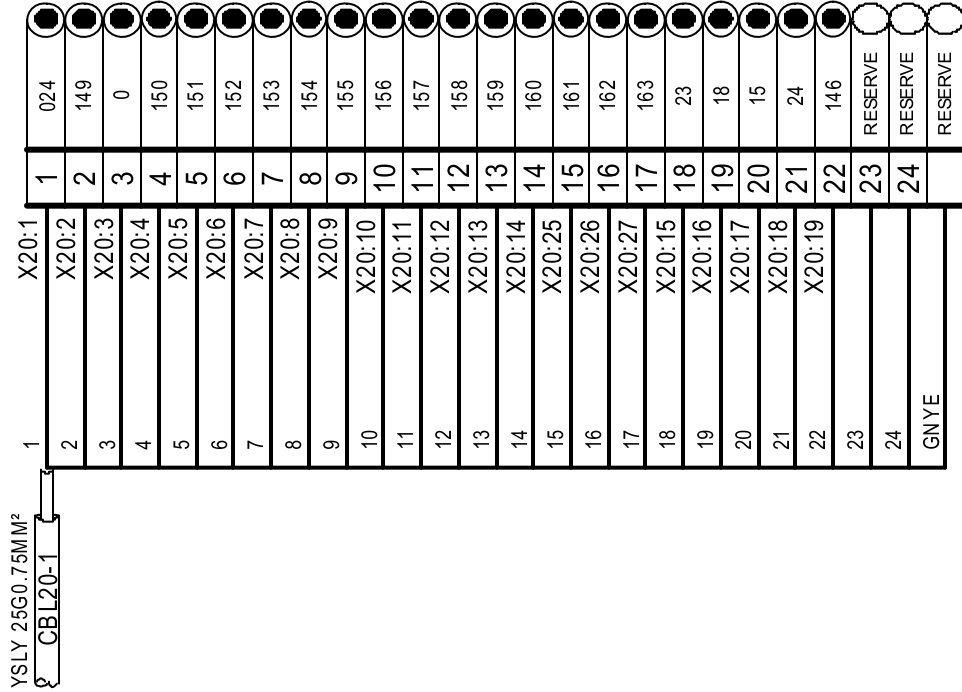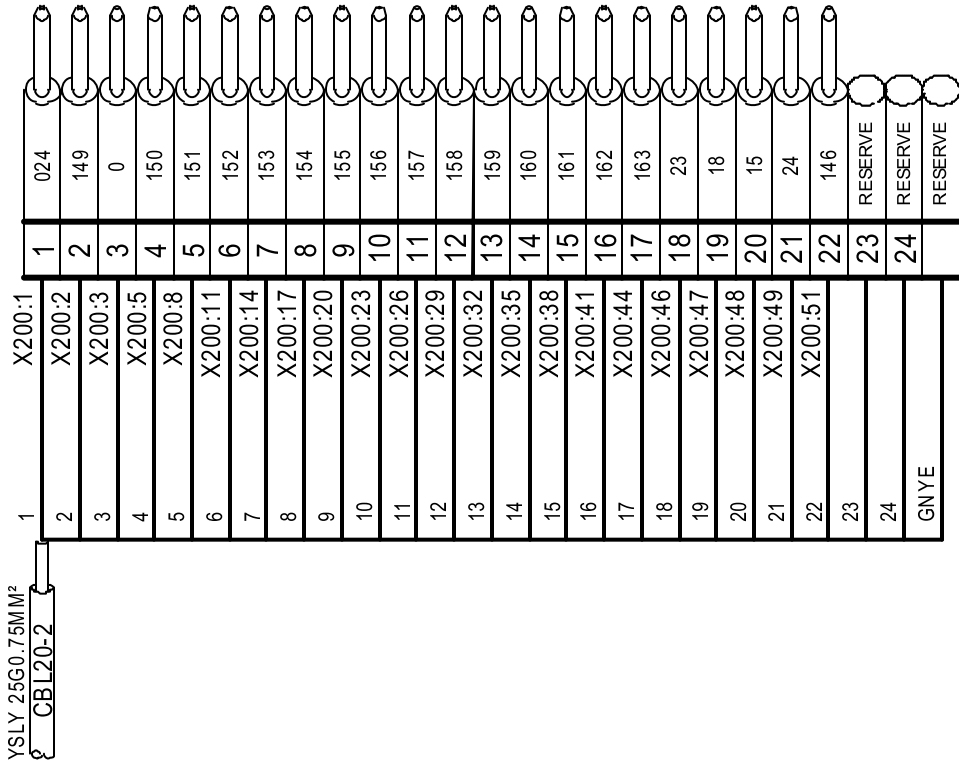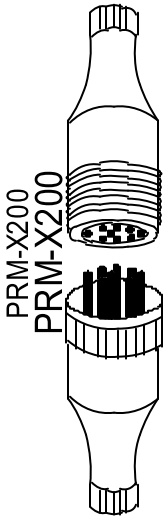


PRM-X200

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 05/04/2024		Connecteur: PRM-X200 & PRF-X200			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		PRM-X200 - 1/1							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT: Version 4.49.F - 23/09/2020			99/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACADE ARMOIRE

CABINET FRONT LAY OUT

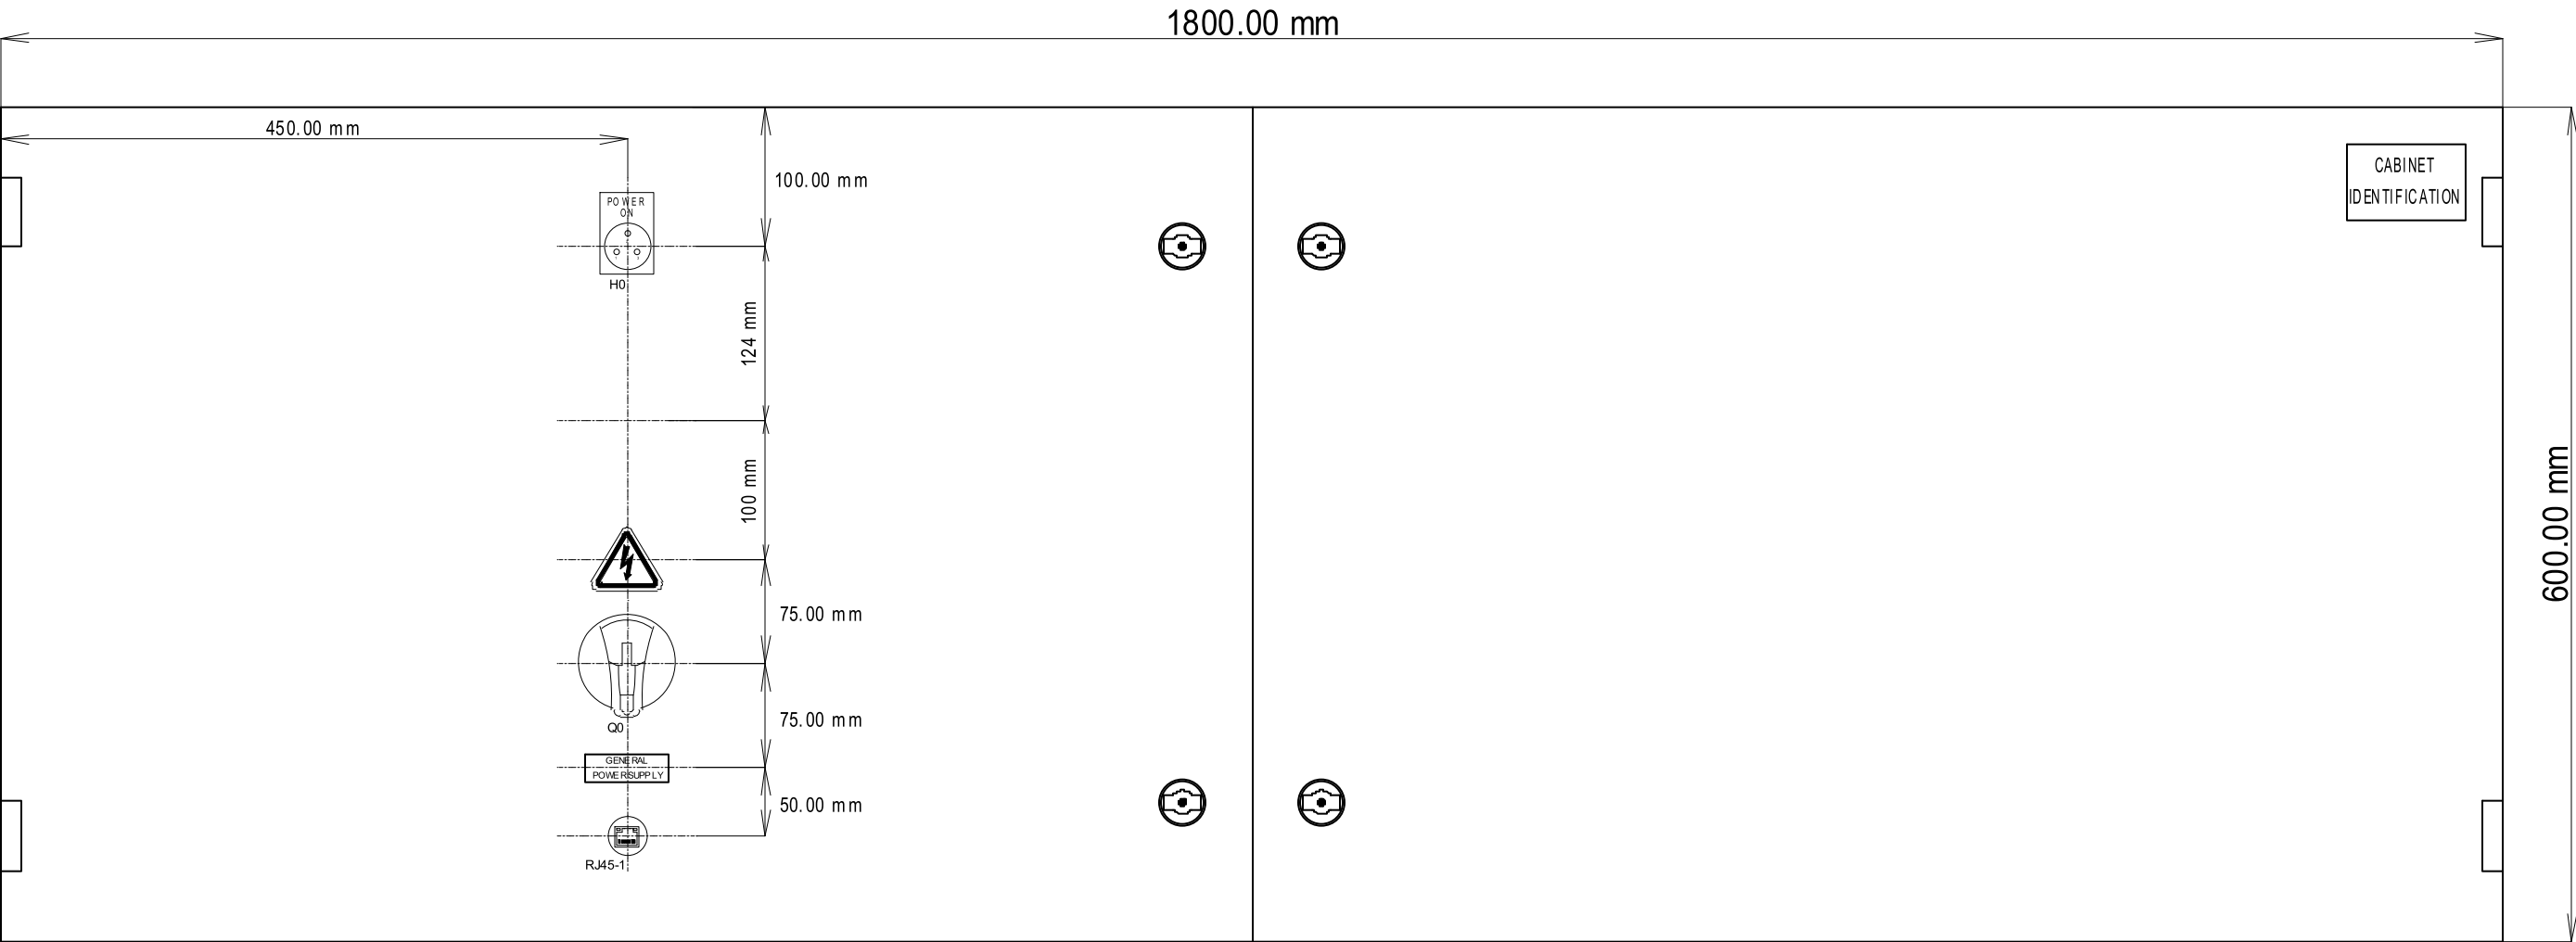


ARMOIRE

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatid.service@ceva.com	Date of creation :	IMPLANTATION FACADE ARMOIRE	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
		Designed by : DB	CABINET FRONT LAY OUT		ARTICLE :		INDEX : V6
			ENVIRONNEMENT : Version 4.49.F - 23/09/2020			SMXA0002	FOLIO : 100/144

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACE ARRIERE BOITIER B10

BOX B10 REAR PANEL LAY OUT

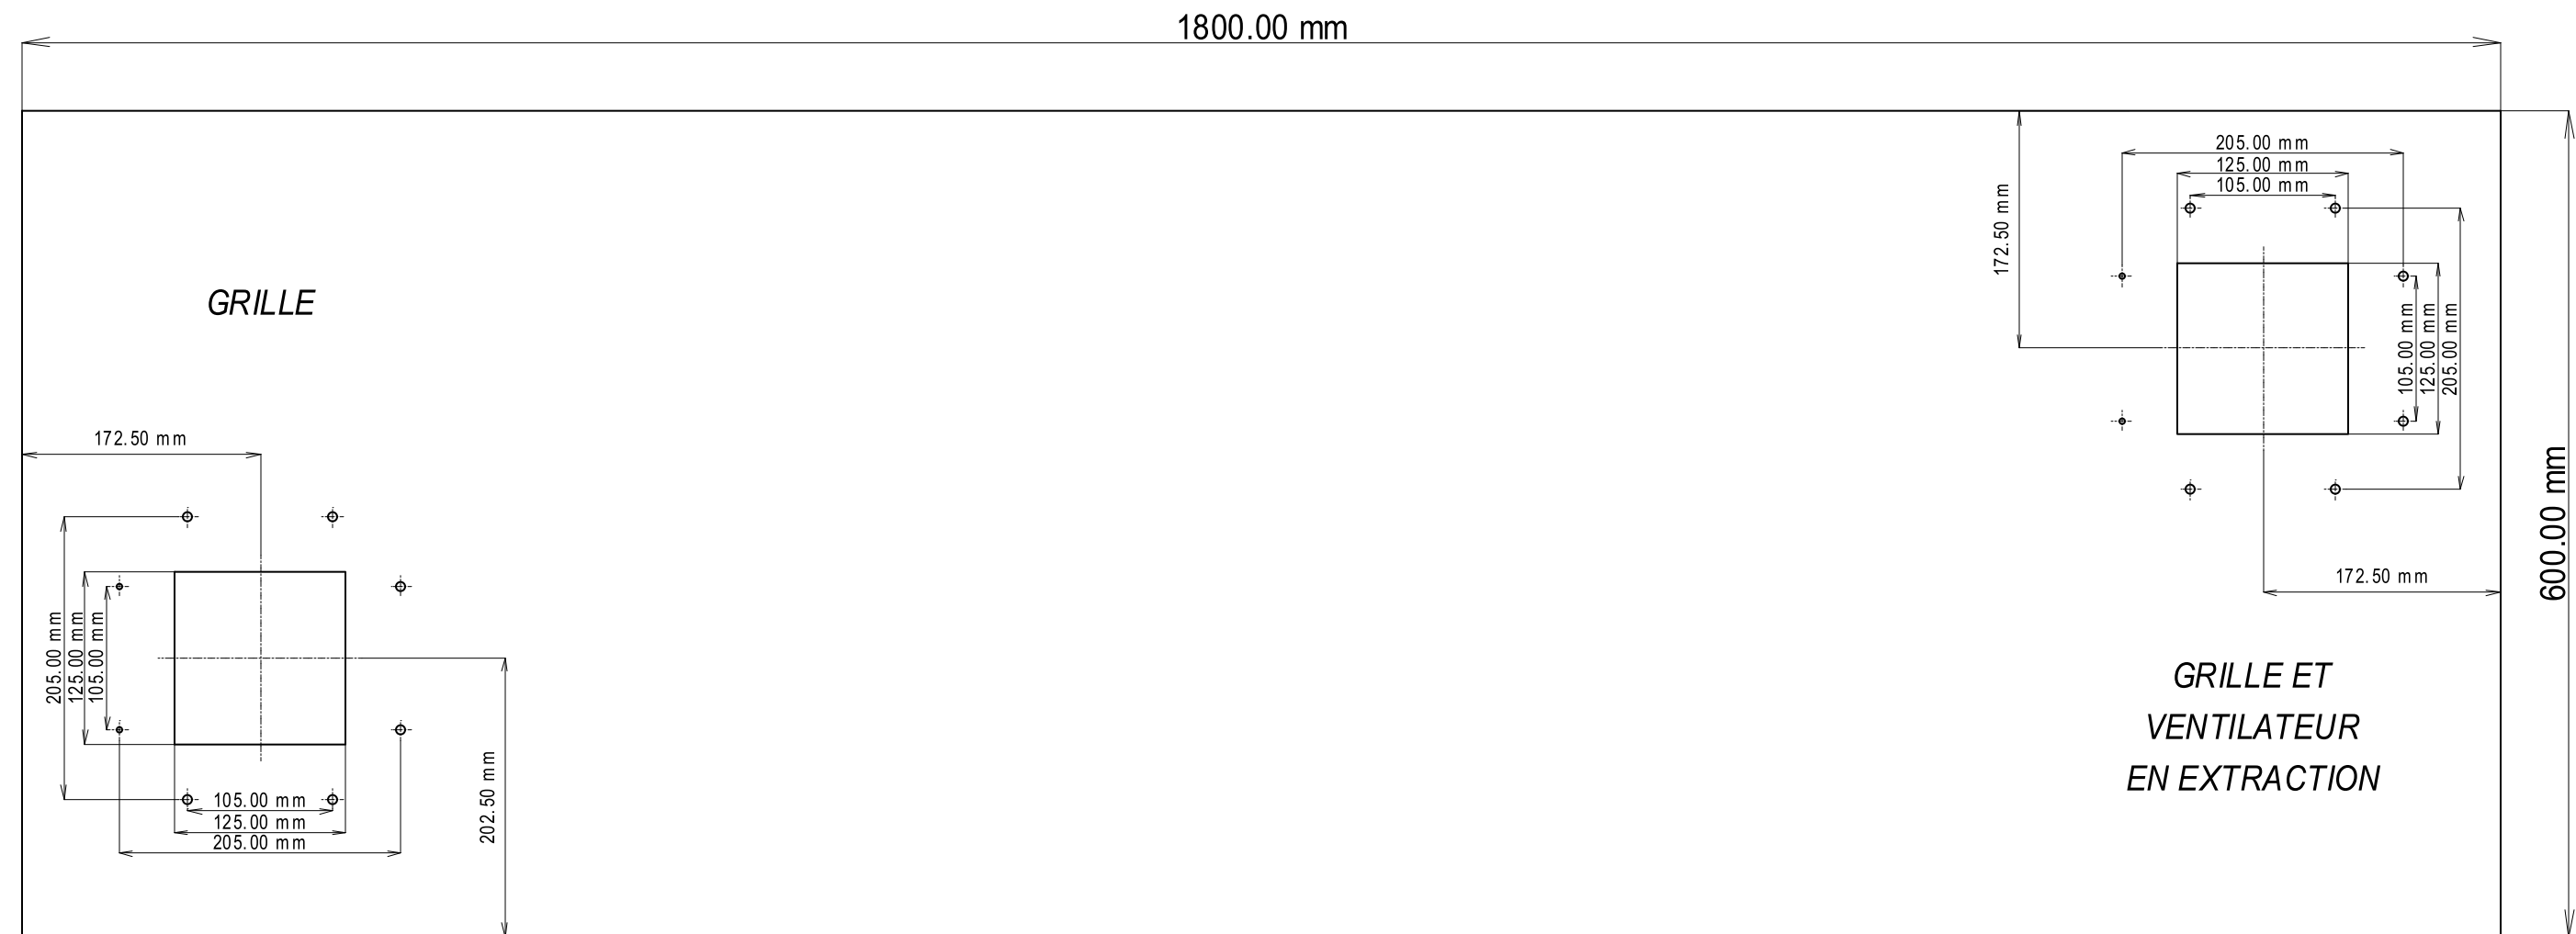

BOITIER B10

ECAT-ID
ZI de KERIEL
29800 PLOUEDERN
– FRANCE –

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :

Designed by :
DB

IMPLANTATION ARRIERE ARMOIRE

CABINET REAR LAY OUT

ENVIRONNEMENT : Version 4.49.F - 23/09/2020



Ecat-iD Campus

CONTRACT :

INTERNE

CUSTOMER :

INTERNE

ARTICLE :

SMXA0002

COUNTRY :

FRANCE

INDEX :


V6

FOLIO :

101/144

IMPLANTATION INTERIEUR ARMOIRE

CABINET INSIDE LAY OUT

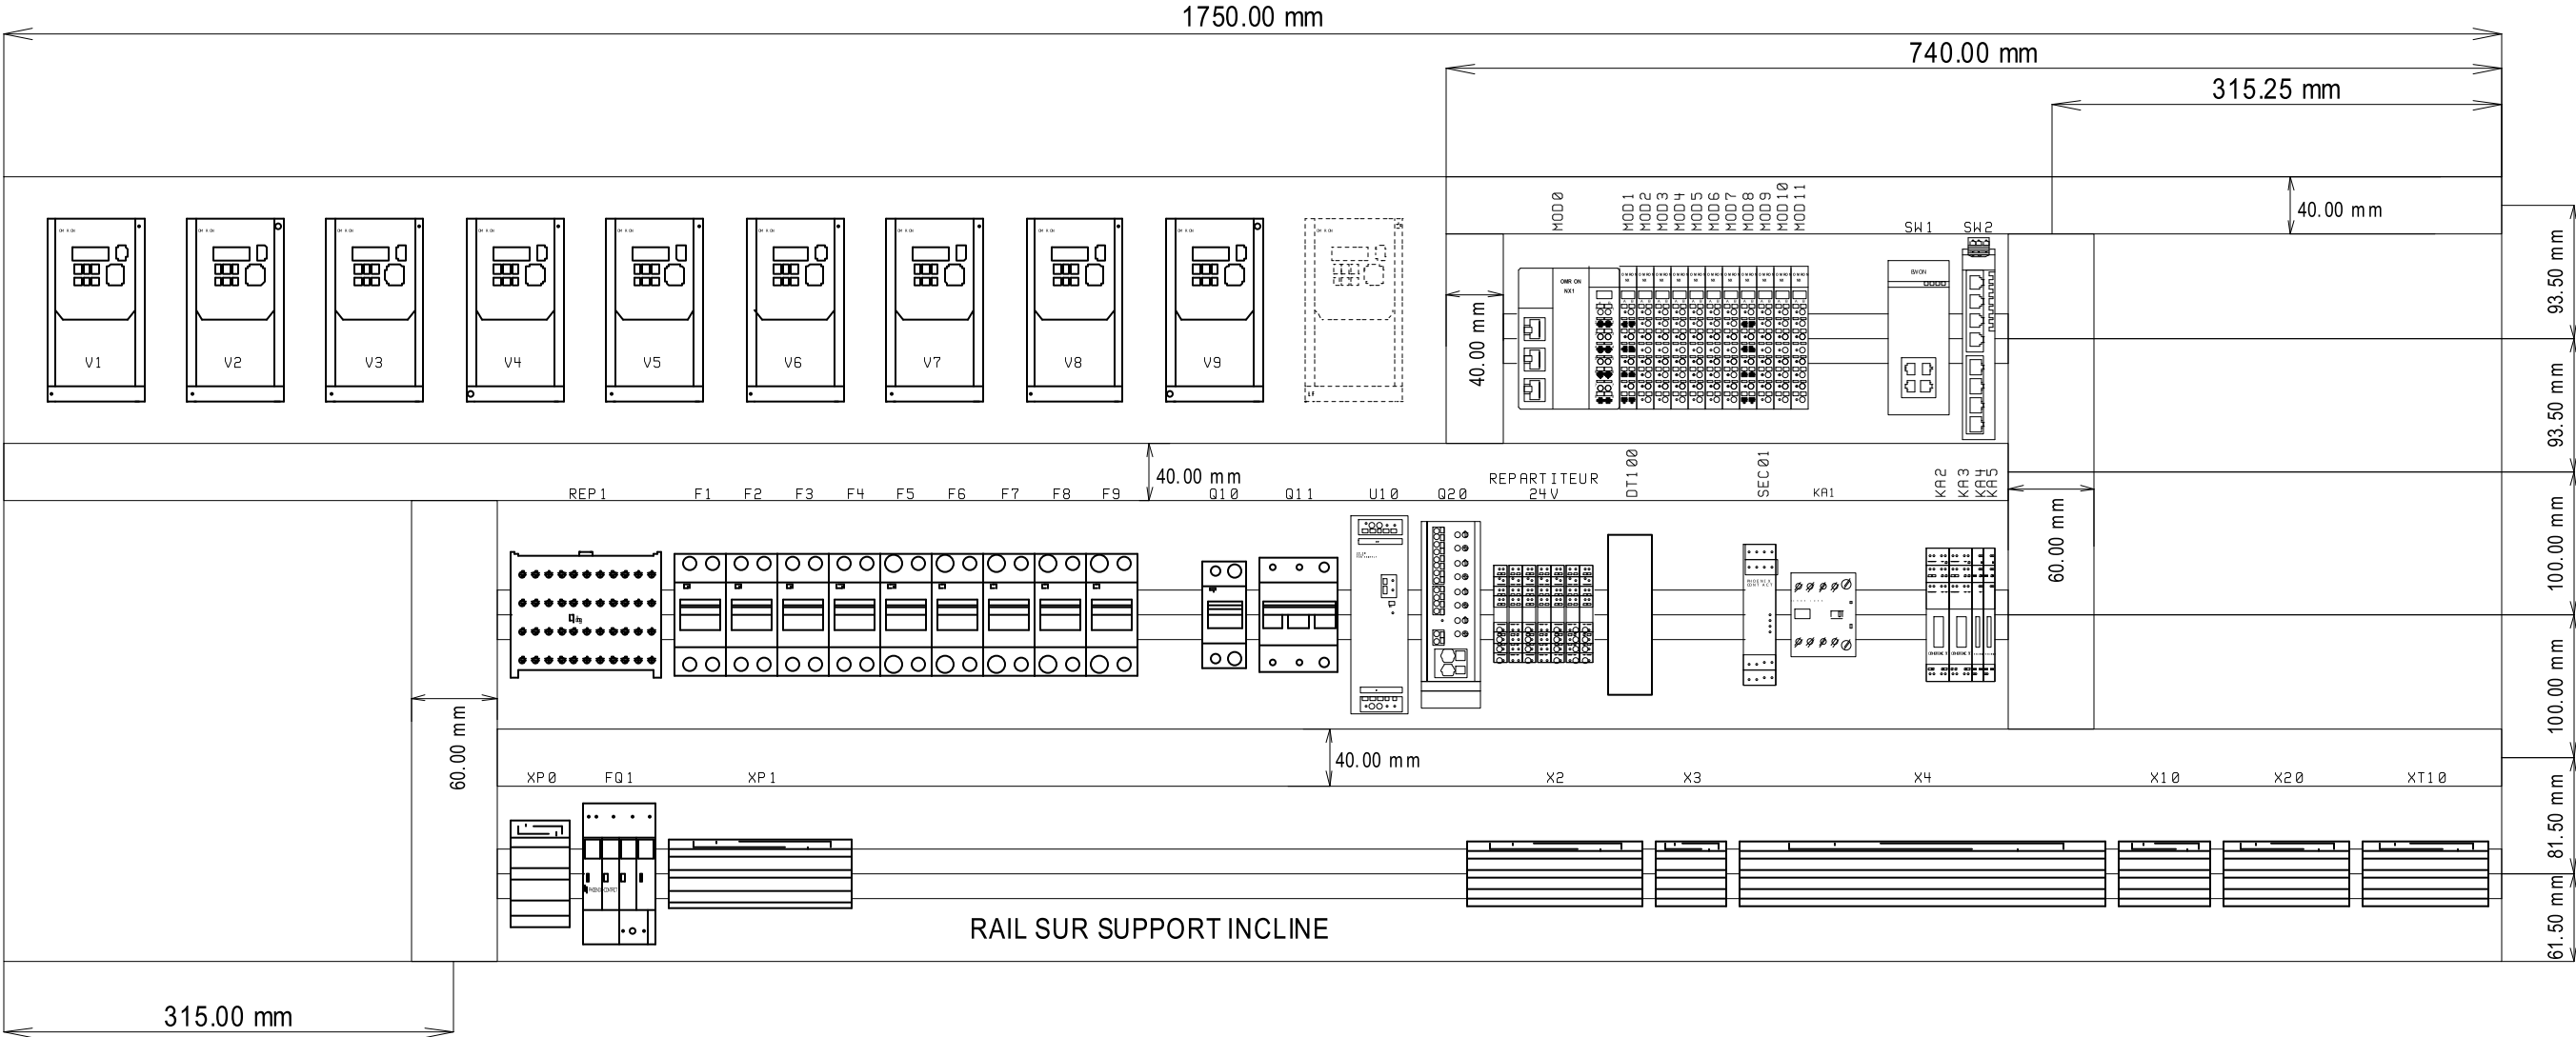


ARMOIRE

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36	Date of creation :	IMPLANTATION ARMOIRE	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
	Fax : (33).2.98.85.31.38	Designed by : DB	LAY OUT		ARTICLE : SMXA0002	INDEX : V6	
	E-mail :ecatid.service@ceva.com	ENVIRONNEMENT :Version 4.49.F - 23/09/2020				FOLIO : 102/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION COTE ARMOIRE CABINET SIDE LAY OUT

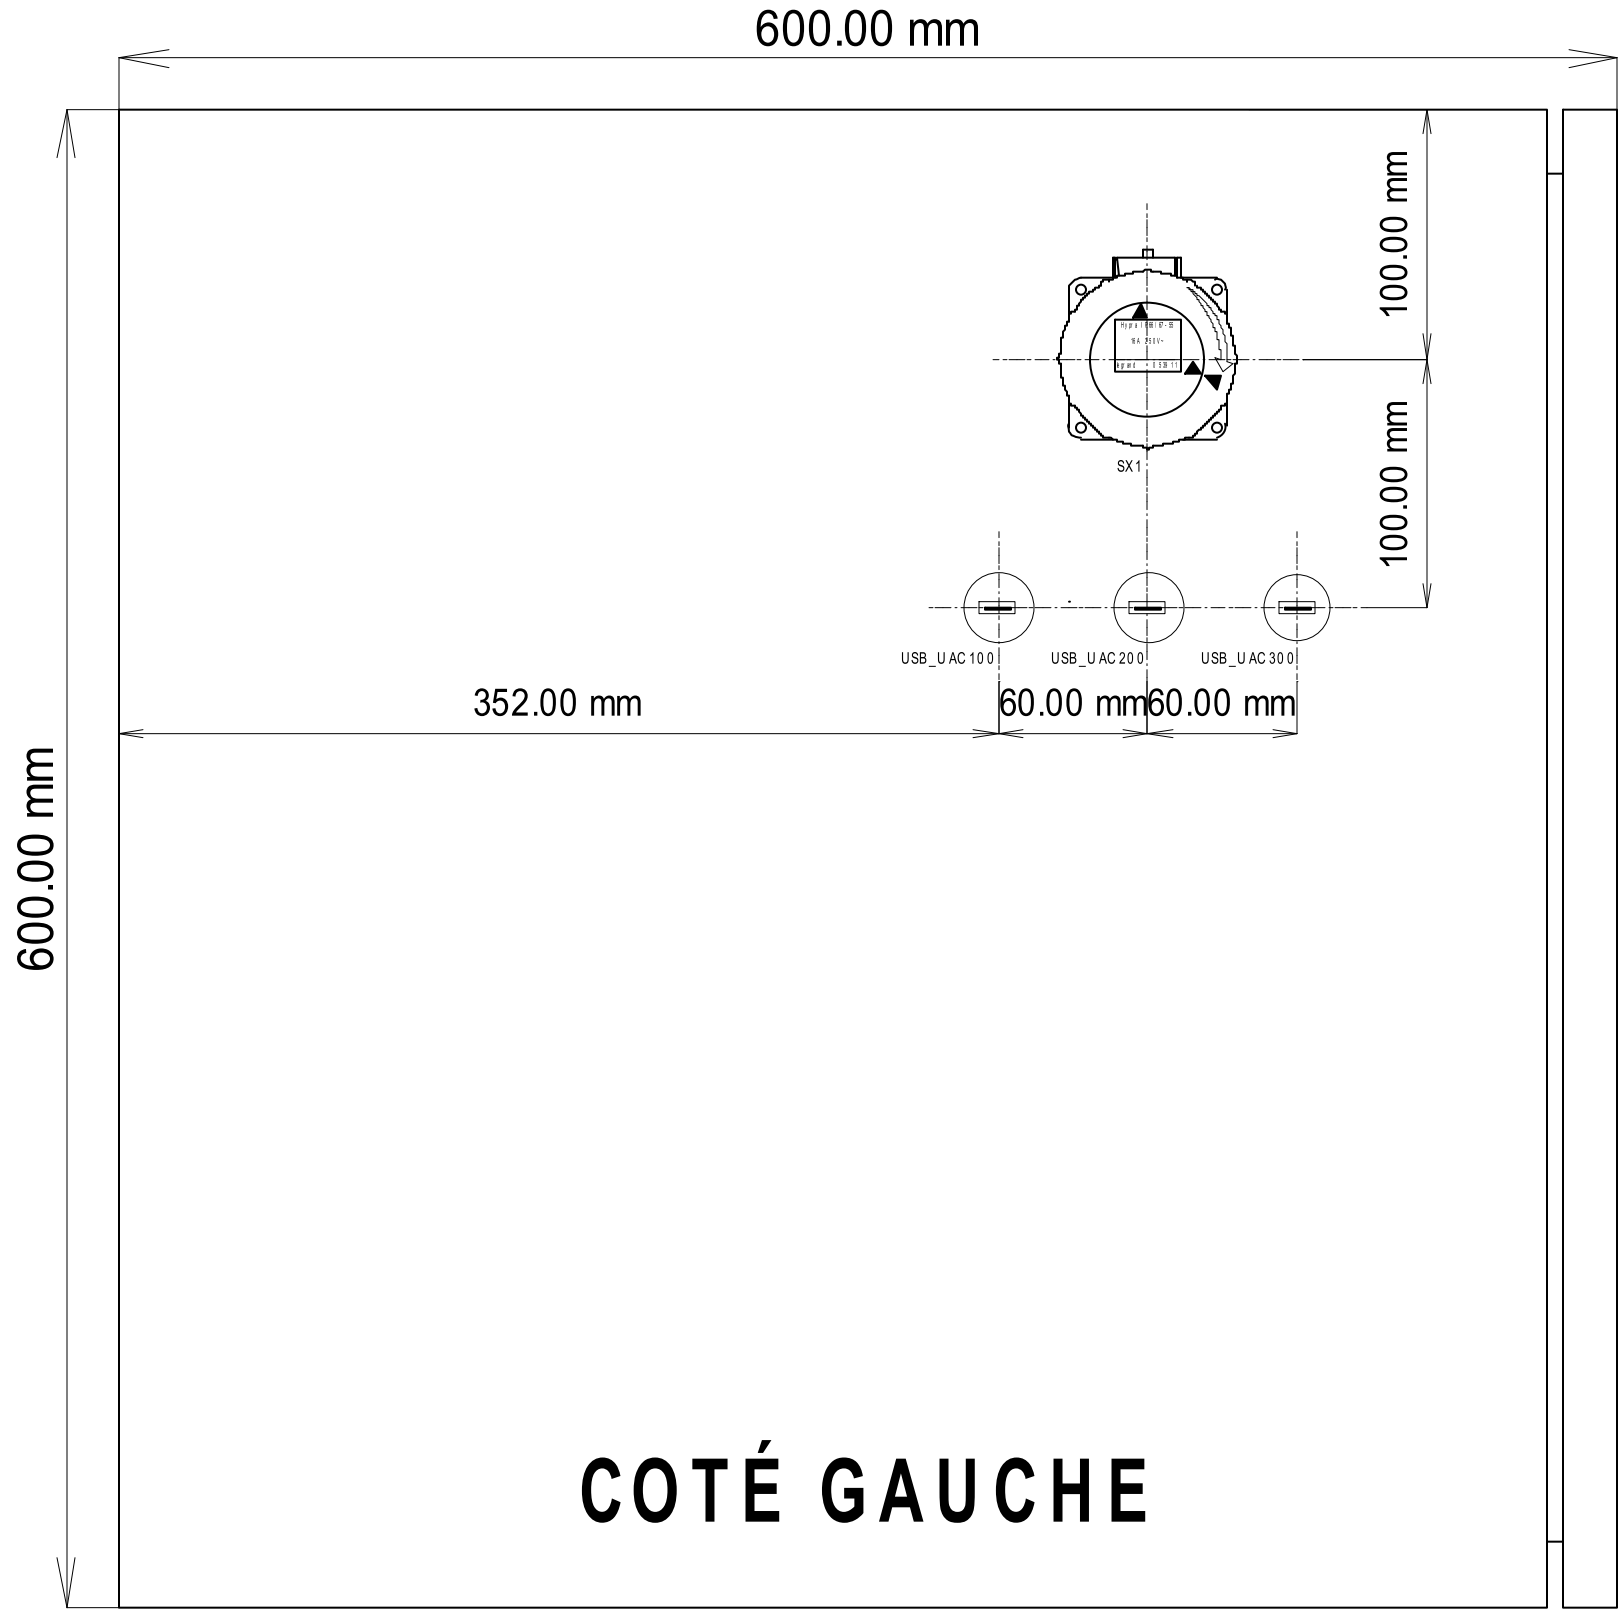


BOITIER B10

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36	Date of creation : 07/12/2023	IMPLANTATION COTE BOITIER B10	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
	Fax : (33).2.98.85.31.38	Designed by : DB			ARTICLE :		INDEX : V6
	E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002		FOLIO : 103/144

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACADE BOITIER B10

BOX B10 FRONT LAY OUT

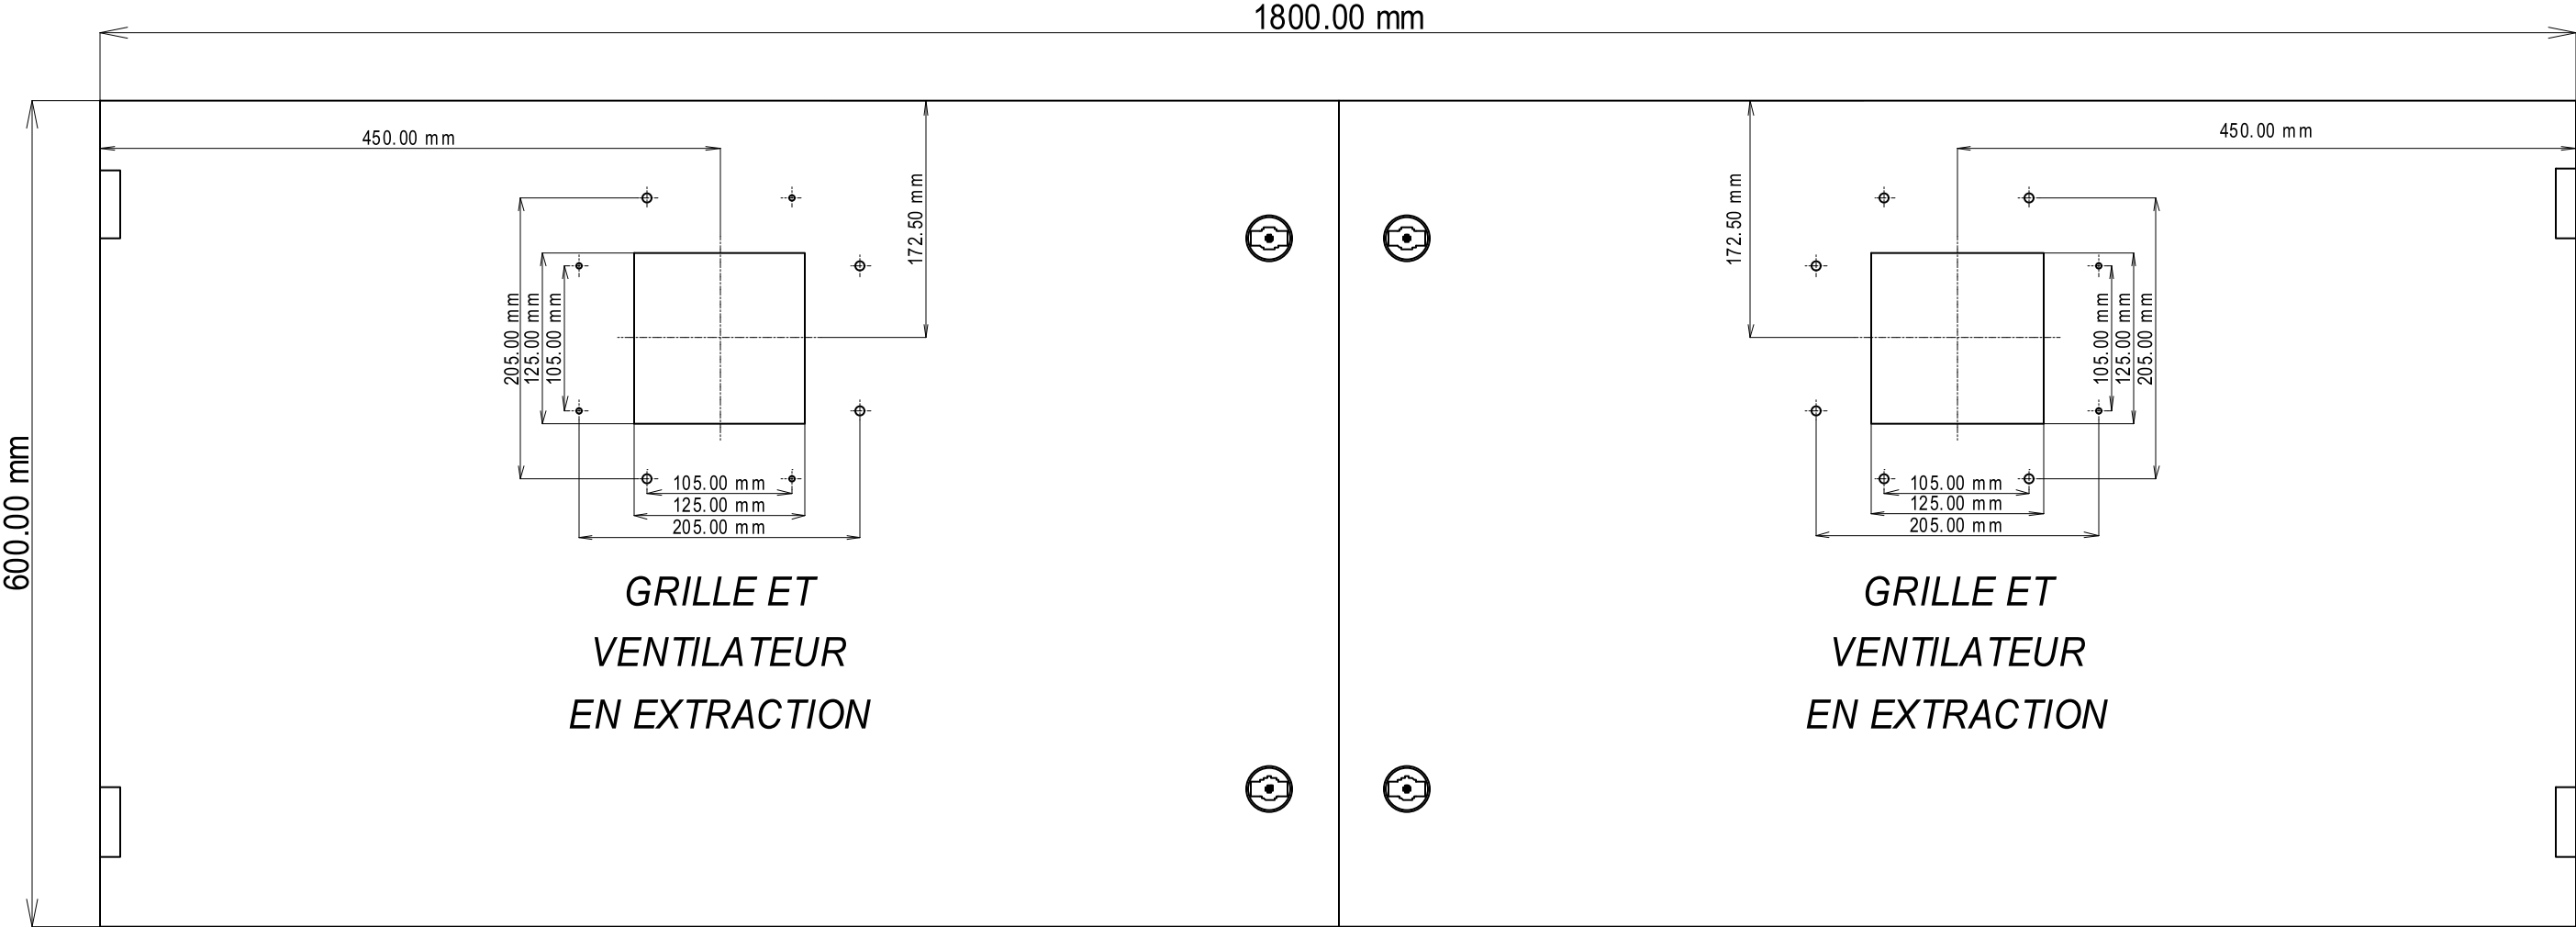


BOITIER B10

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatid.service@ceva.com	Date of creation :	IMPLANTATION FACADE BOITIER B10	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
		Designed by : DB			ARTICLE :		INDEX : V6
			ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002		FOLIO : 104/144

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACE ARRIERE BOITIER B10

BOX B10 REAR PANEL LAY OUT

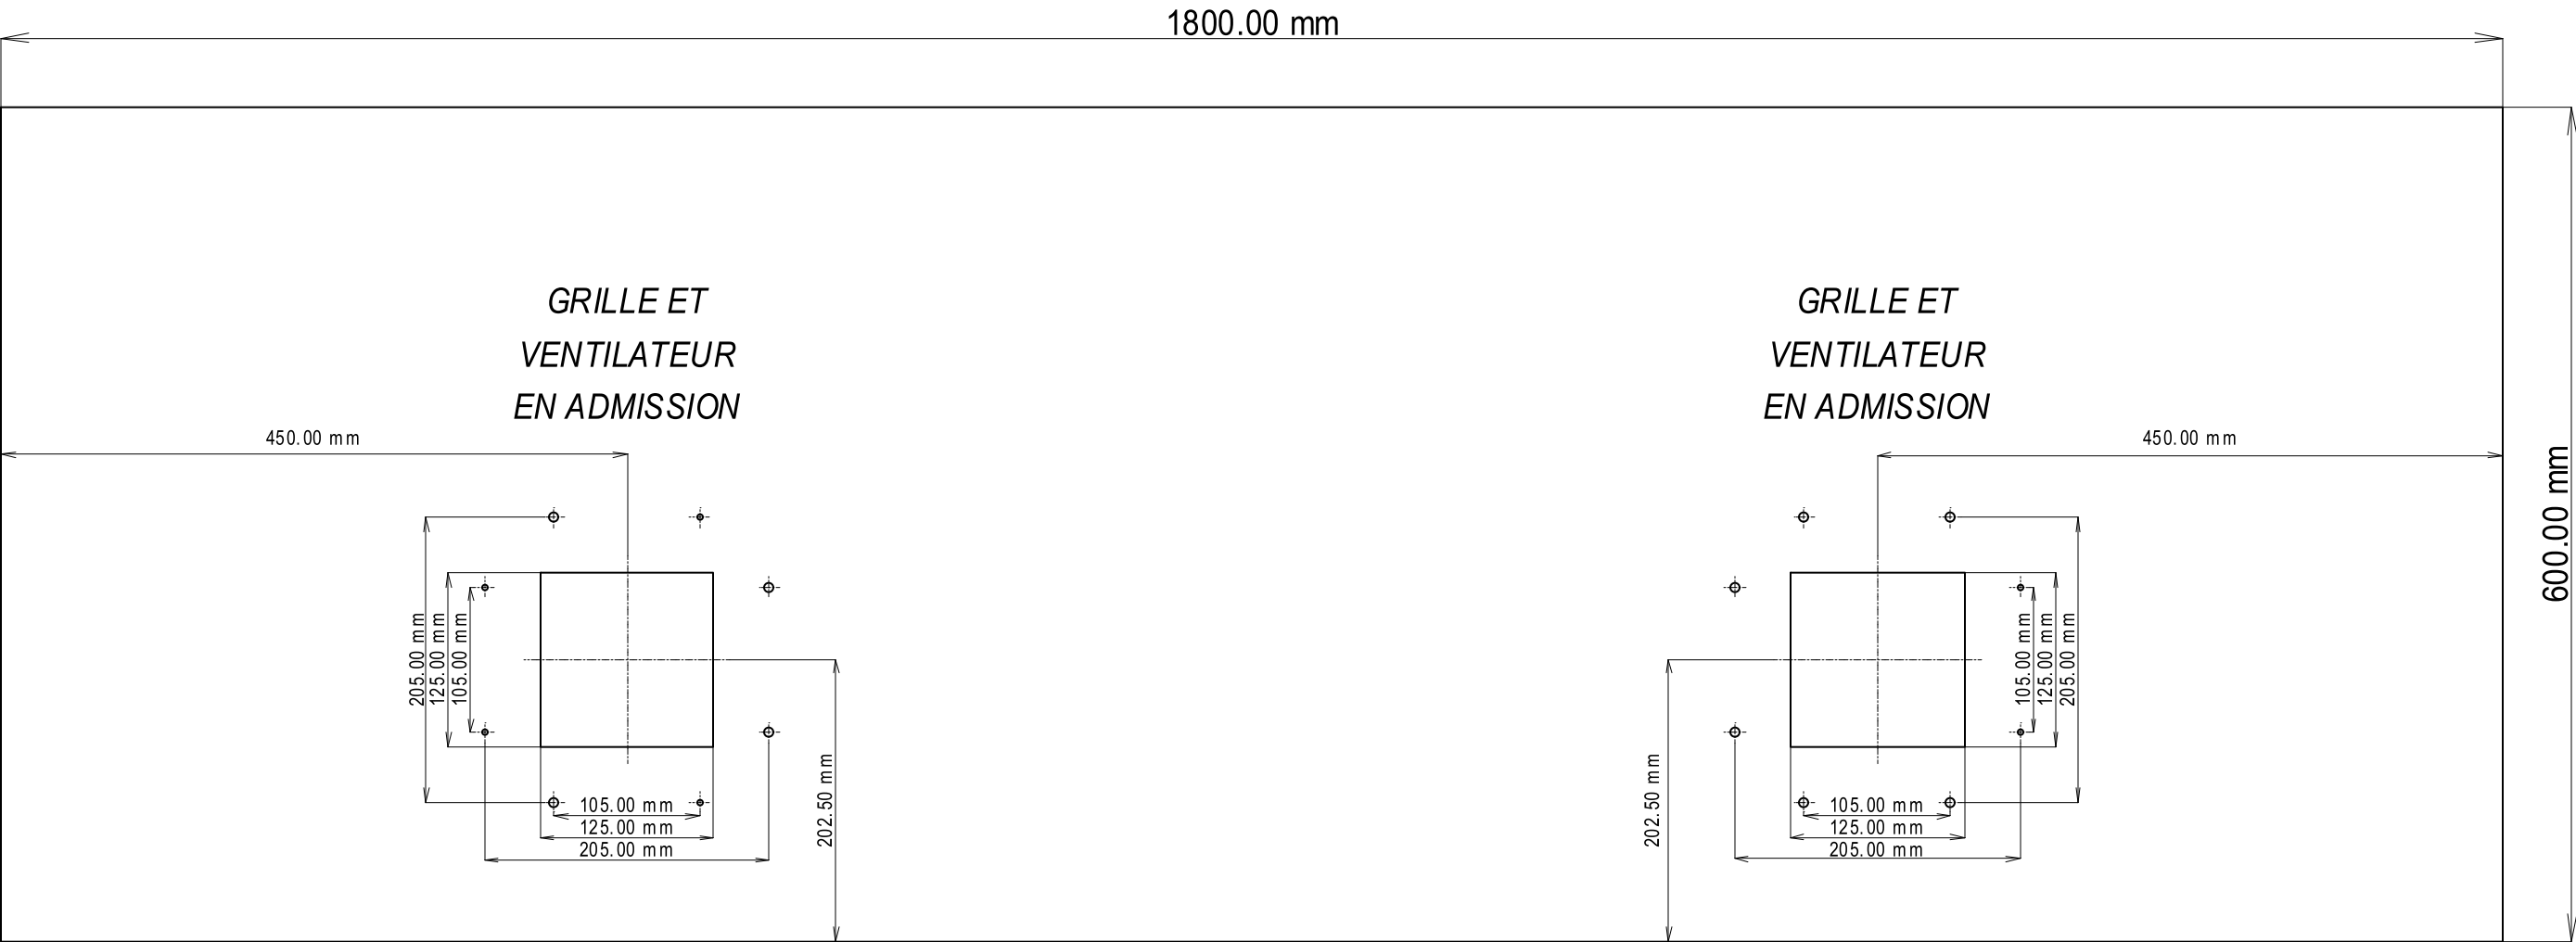

BOITIER B10

ECAT-ID
ZI de KERIEL
29800 PLOUEDERN
- FRANCE -

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :

Designed by :
DB

IMPLANTATION ARRIERE BOITIER B10

ENVIRONNEMENT : Version 4.49.F - 23/09/2020



Ecat-iD Campus

CONTRACT :

INTERNE

CUSTOMER :

INTERNE

ARTICLE :

SMXA0002


COUNTRY :

FRANCE

INDEX : V6

FOLIO : 105/144

PLAN DE PERCAGE PUPITRE
CONTROL PANEL DRILLING

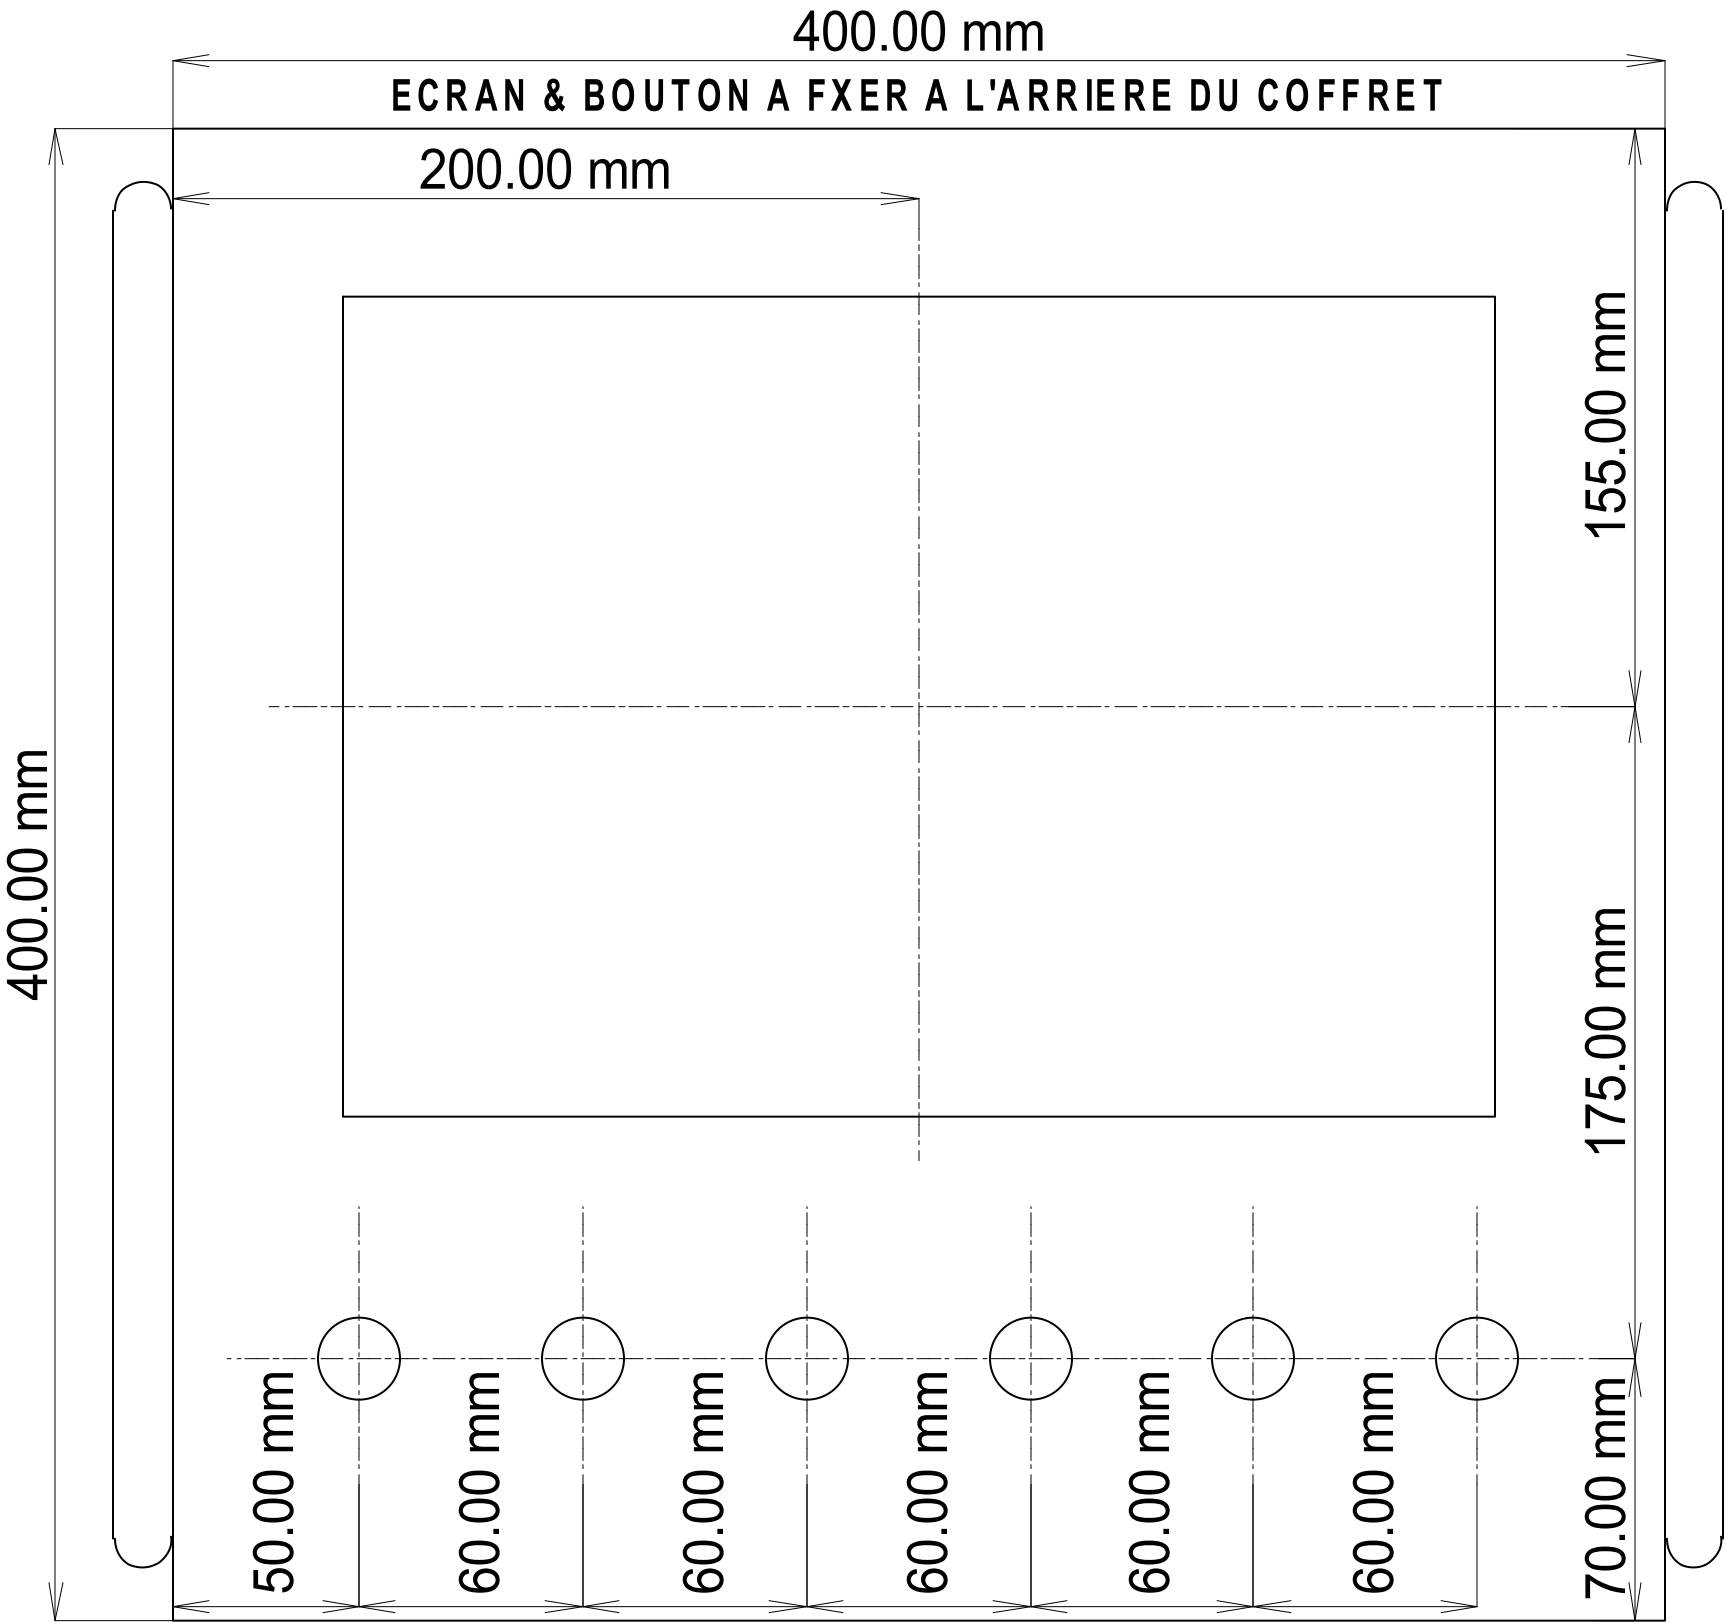


BOITIER T10

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36	Date of creation : 05/10/2023	PLAN DE PERCAGE BOITIER T10	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
	Fax : (33).2.98.85.31.38	Designed by : DB			ARTICLE :		INDEX : V6
	E-mail :ecatid.service@ceva.com	ENVIRONNEMENT :Version 4.49.F - 23/09/2020			SMXA0002		FOLIO : 107/144

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

PLAN DE PERCAGE PUPITRE
CONTROL PANEL DRILLING

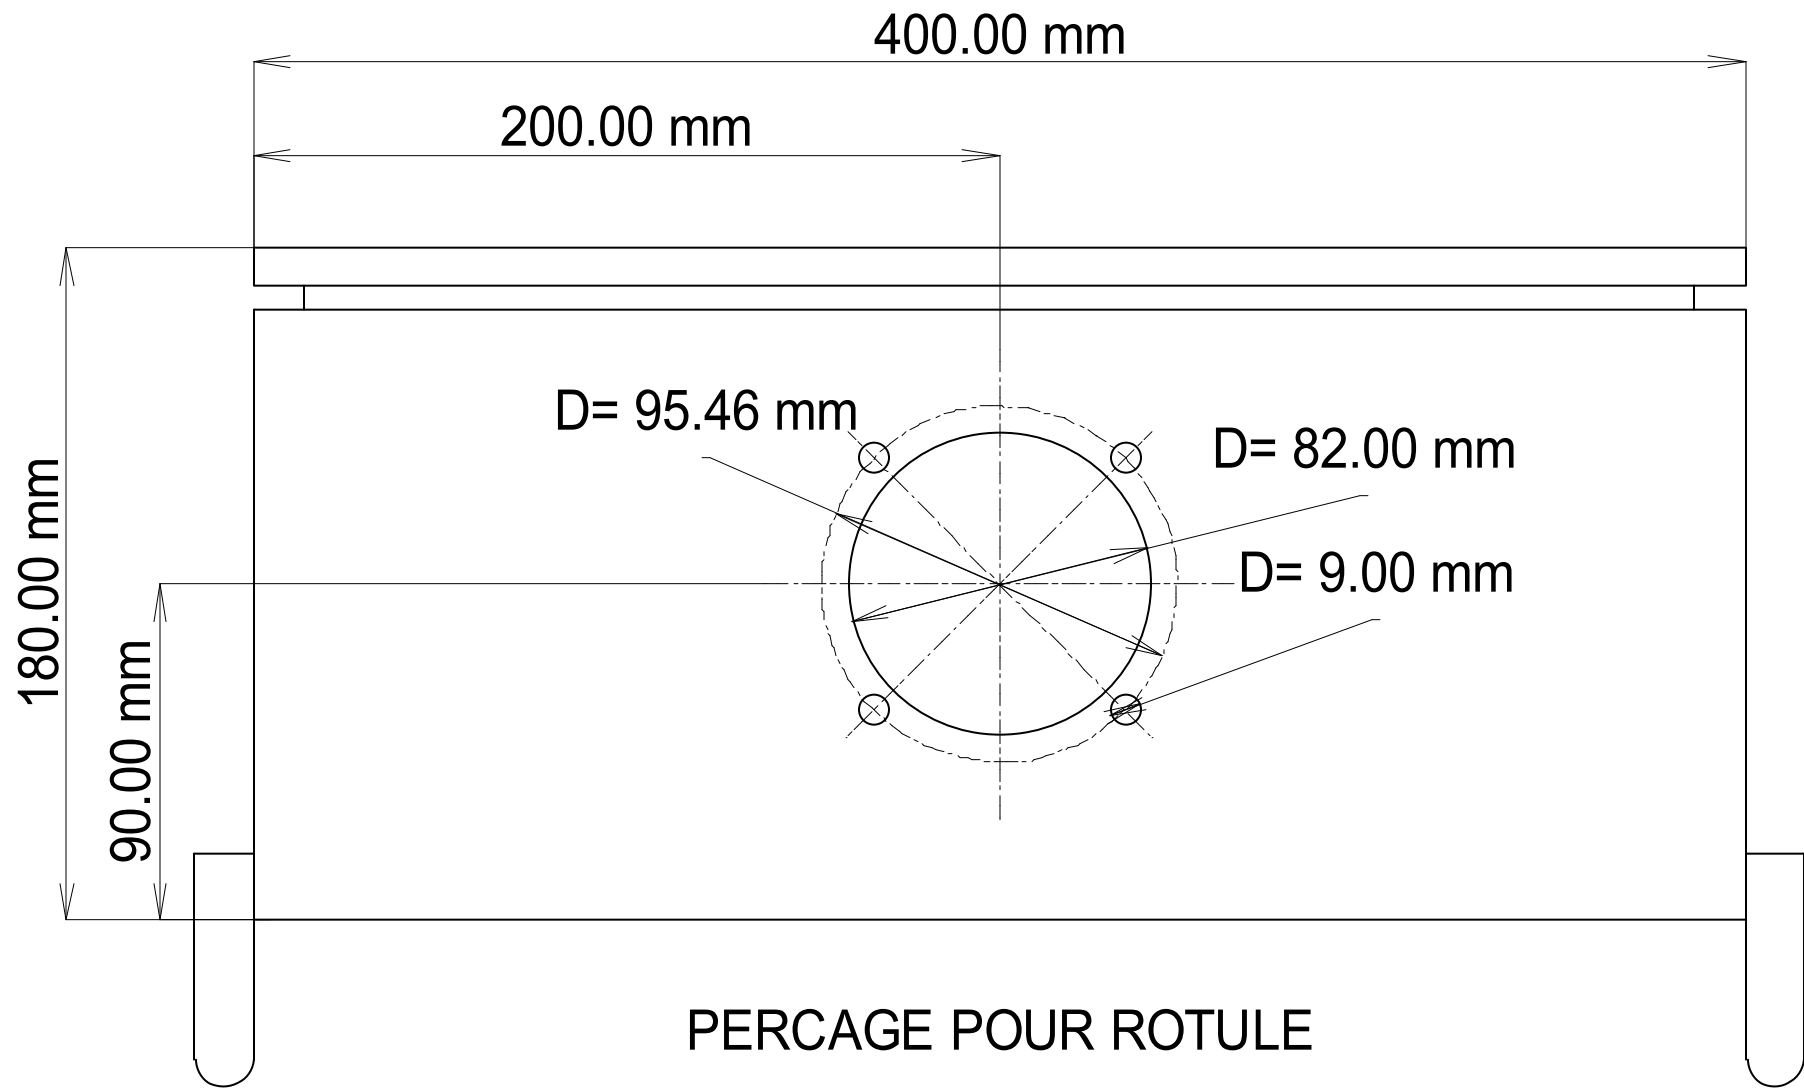


PUPITRE 400x400x180 INOX
REFERENCE COFFRET : SEB02903 IRINOX
ROTULE DEJA DECOUPE

BOITIER T10

ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -	Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecaticid.service@ceva.com	Date of creation : 05/10/2023	PLAN DE PERCAGE BOITIER T10	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
		Designed by : DB			ARTICLE :		INDEX : V6
			ENVIRONNEMENT: Version 4.49.F - 23/09/2020			SMXA0002	FOLIO : 108/144

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION BOITIER T10 BOX T10 LAYOUT

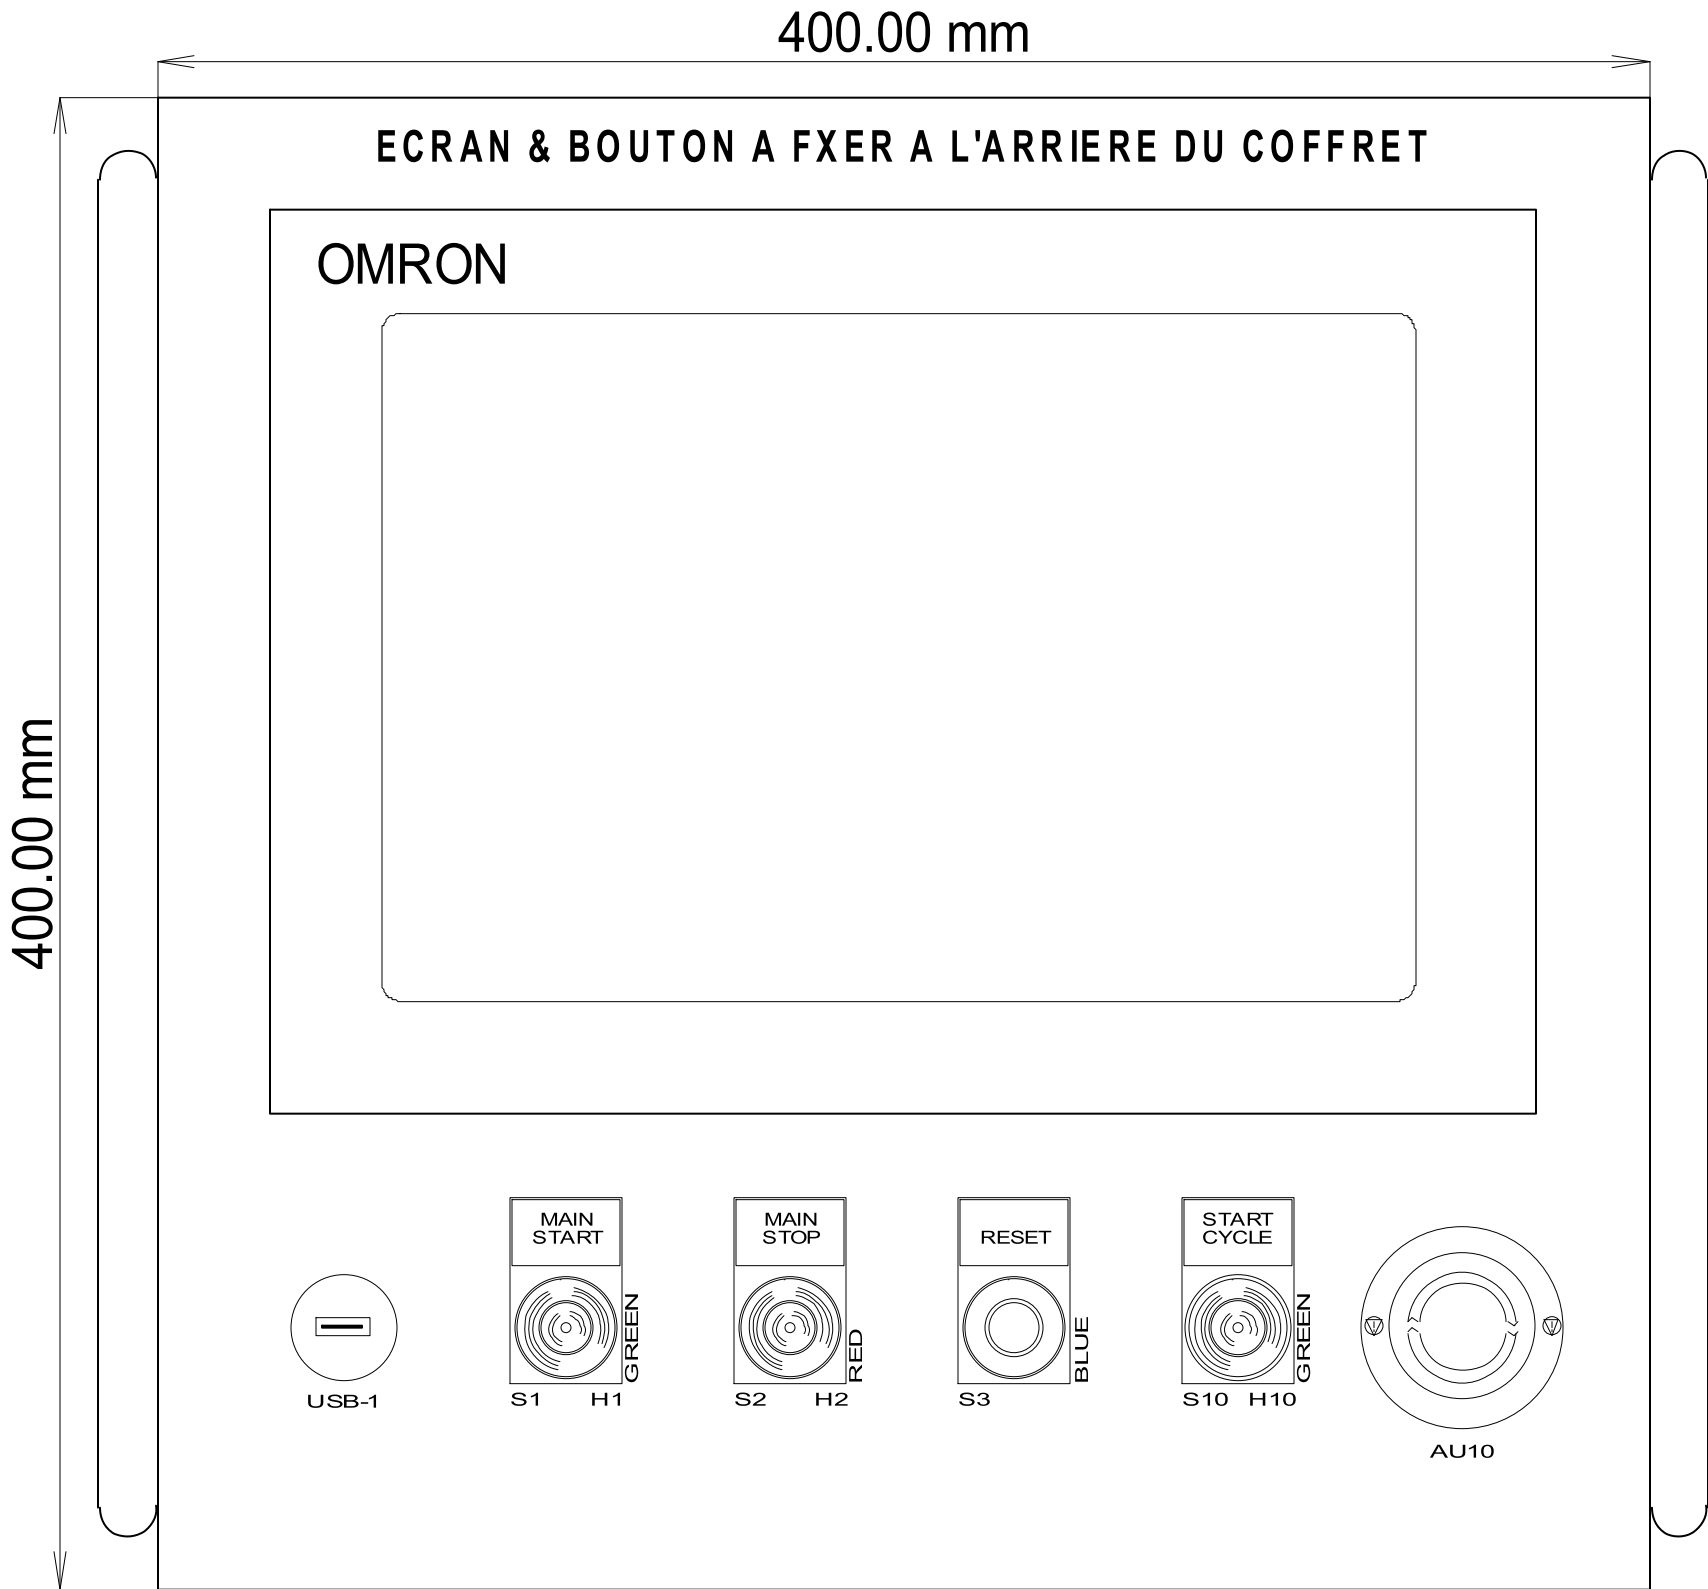

PUPITRE 400x400x180 INOX

REFERENCE COFFRET : SEB02903 IRINOX

BOUTON DU PUPITRE DEJA DECOUPE



BOITIER T10

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36	Date of creation : 05/10/2023	IMPLANTATION BOITIER T10	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
	Fax : (33).2.98.85.31.38	Designed by : DB			ARTICLE :		INDEX : V6
	E-mail : ecatid.service@ceva.com		ENVIRONNEMENT: Version 4.49.F - 23/09/2020		SMXA0002		FOLIO : 109/144

ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33) 2.98.85.31.36 Fax : (33) 2.98.85.31.38 E-mail : ecatid.service@ceva.com		Date of creation : Designed by : DB	IMPLANTATION BOITIER T20 BOX T20 LAY OUT	 Ecat-ID Campus	CONTRACT : INTERNE ARTICLE : SMXA0002	CUSTOMER : INTERNE	COUNTRY : FRANCE INDEX : V6 FOLIO : 110/144
---	--	--	--	--	---	--	---	---	-------------------------------	--

BOITIER T20

IMPLANTATION BOITIER T20

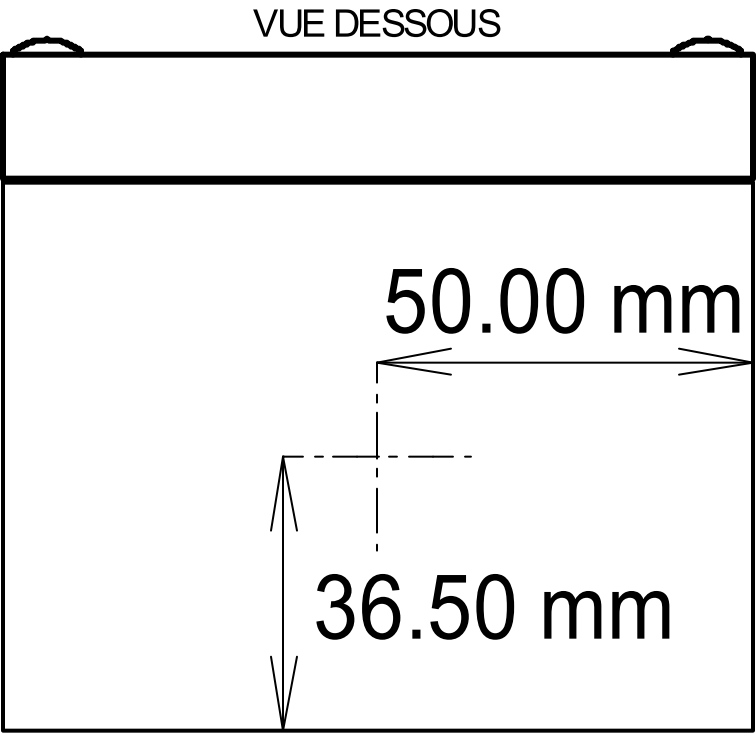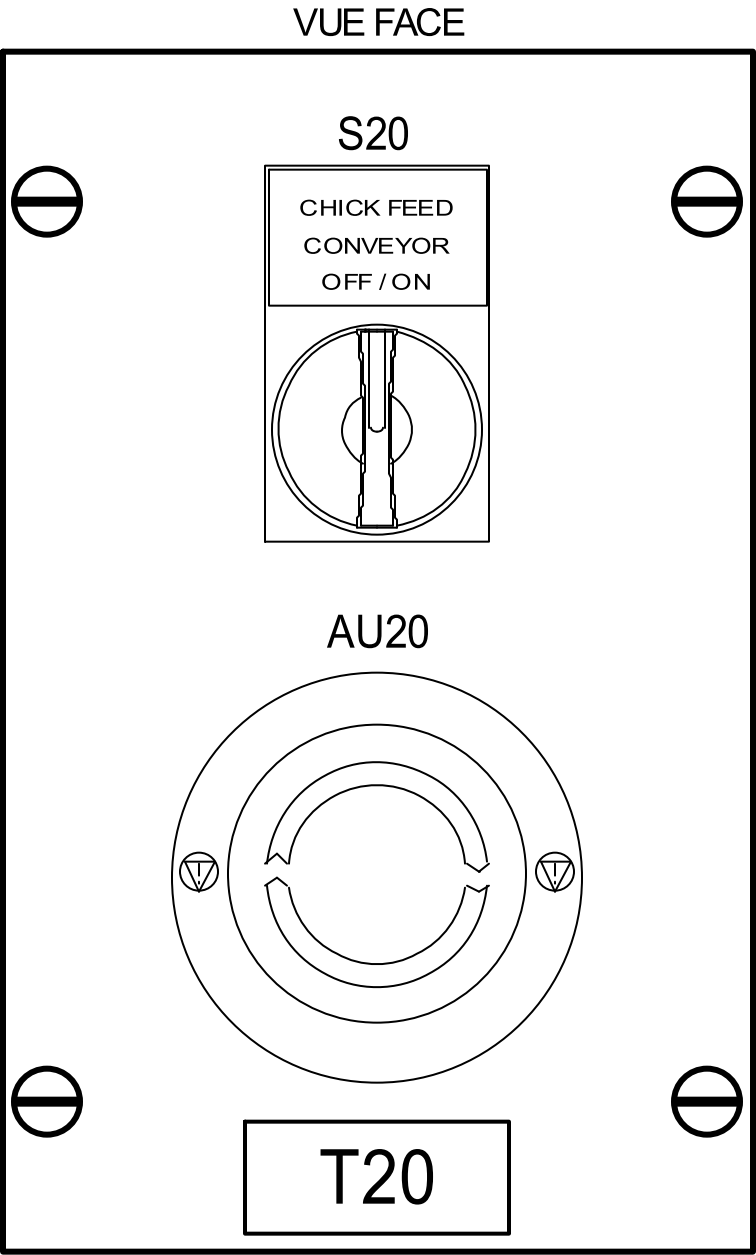


PERCAGE POUR PRESSE-ETOUPE

REFERENCE ECAT : BOX02014
REFERENCE : SPN10169
DIMENSION : 100x160x90

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION BOITIER T30

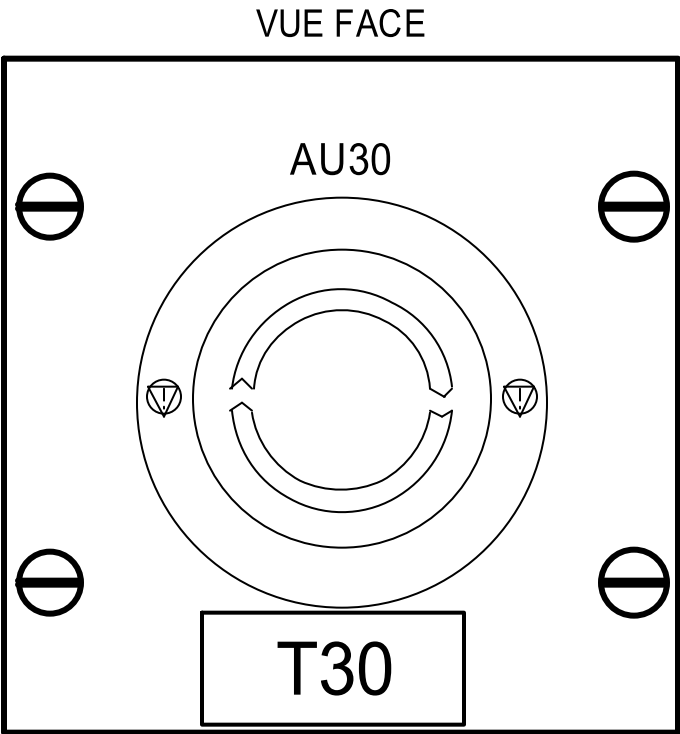

/!\ NE PAS PERCER POUR LE PE /!\

REFERENCE ECAT : BOX02013
REFERENCE : SPN997
DIMENSION : 90x90x70
BOITIER T30

ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –	Tél : (33).2.98.85.31.36	Date of creation :	IMPLANTATION BOITIER T30	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : INTERNE	COUNTRY : FRANCE
	Fax : (33).2.98.85.31.38	Designed by : DB	5		ARTICLE : SMXA0002	INDEX : V6	
	E-mail :ecatid.service@ceva.com	ENVIRONNEMENT:Version 4.49.F - 23/09/2020				FOLIO : 111/144	

Repère	V1	07.3
Caractéristiques	3G3MX2-AB004-EV2	
Référence fournisseur	3G3MX2-AB004-EV2	
Code interne	VAR00701	

OMRON - Paramètres variateur
Sans frein / Sans potentiomètre

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V1				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V1								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								112/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V2	07.7	OMRON - Paramètres variateur Sans frein / Sans potentiomètre
Caractéristiques	3G3MX2-AB004-EV2		
Référence fournisseur	3G3MX2-AB004-EV2		
Code interne	VAR00701		

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V2			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V2							ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020			113/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V3	07.12
Caractéristiques	3G3MX2-AB004-EV2	
Référence fournisseur	3G3MX2-AB004-EV2	
Code interne	VAR00701	

OMRON - Paramètres variateur
Sans frein / Sans potentiomètre

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V3				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V3								ARTICLE :		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT: Version 4.49.F - 23/09/2020								SMXA0002		114/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V4	07.16	OMRON - Paramètres variateur Sans frein / Sans potentiomètre
Caractéristiques	3G3MX2-AB004-EV2		
Référence fournisseur	3G3MX2-AB004-EV2		
Code interne	VAR00701		

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V4				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V4								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT: Version 4.49.F - 23/09/2020								SMXA0002		115/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V508.3	OMRON - Paramètres variateur Sans frein / Sans potentiomètre
Caractéristiques	3G3MX2-AB004-EV2	
Référence fournisseur	3G3MX2-AB004-EV2	
Code interne	VAR00701	

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V5				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V5								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								SMXA0002		FOLIO : 116/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V6	08.7	OMRON - Paramètres variateur Sans frein / Sans potentiomètre
Caractéristiques	3G3MX2-AB004-EV2		
Référence fournisseur	3G3MX2-AB004-EV2		
Code interne	VAR00701		

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V6				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V6								ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT: Version 4.49.F - 23/09/2020										FOLIO : 117/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V7	08.12
Caractéristiques	3G3MX2-AB004-EV2	
Référence fournisseur	3G3MX2-AB004-EV2	
Code interne	VAR00701	

OMRON - Paramètres variateur
Sans frein / Sans potentiomètre

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/12/2023		PARAMETRE VARIATEUR V7				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V7								ARTICLE : SMXA0002		INDEX : V6			
			E-mail :ecatid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020								118/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V8	08.16	OMRON - Paramètres variateur Sans frein / Sans potentiomètre
Caractéristiques	3G3MX2-AB004-EV2		
Référence fournisseur	3G3MX2-AB004-EV2		
Code interne	VAR00701		

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/03/2024		PARAMETRE VARIATEUR V8			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V8							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT:Version 4.49.F - 23/09/2020							SMXA0002		FOLIO : 119/144			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

Repère	V9	09.3	OMRON - Paramètres variateur Sans frein / Sans potentiomètre
Caractéristiques	3G3MX2-AB004-EV2		
Référence fournisseur	3G3MX2-AB004-EV2		
Code interne	VAR00701		

Paramètre	Valeur	Modif.	Paramètre	Valeur	Modif.
B031 - Code pour modification parametres	1		A023 - 4ème vitesse présélectionnée	65	
A001 - Source de Frequence	2		A024 - 5ème vitesse présélectionnée	80	
A002 - Source de commande Run	1		F002 - Accélération	0,2	
A004 - Fréquence maximale	80		F003 - Decélération	0,7	
A005 - Selection potentiometre	2		A092 2ème Accélération	0,8	
B012 - Courant Nominal	1,3		A093 2ème Déccélération	0,3	
C001 - Fonction Borne d'entrée n°1	0		A094 Autorisation 2ème Acc/Decc	1	
C002 - Fonction Borne d'entrée n°2	1		A095 Changement de rampe Accélération	20	
C003 - Fonction Borne d'entrée n°3	77		A096 Changement de rampe Déccélération	20	
C004 - Fonction Borne d'entrée n°4	78		A041 Sélection du boost de couple	1	
C005 - Fonction Borne d'entrée n°5	NC		A046 Gain de tension du boost auto	100	
C006 - Fonction Borne d'entrée n°6	2		A047 Gain de glissement du boost auto	100	
C007 - Fonction Borne d'entrée n°7	3				
C013 - Etat actif de la borne d'entrée n°3	1				
C014 - Etat actif de la borne d'entrée n°4	1				
A020 - Petite vitesse	20				
A021 - 2ème vitesse présélectionnée	60				
A022 - 3ème vitesse présélectionnée	50				

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation : 04/03/2024		PARAMETRE VARIATEUR V9			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INVERTER PARAMETER V9							ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT:Version 4.49.F - 23/09/2020			120/144											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	Qty	REFERENCE	CODE ECAT-ID	FABRICANT	Nomenclature
ARMOIRE	01	COFFRET INOX + PLAQUE 1800x600x600 2 PORTE + VENTIL	1	MXA03297	MXA03297	IRINOX	ARMOIRE
	01	COFFRET INOX + PLAQUE 1800x600x370 2 PORTE + VENTIL	1	MXA03300	MXA03300	IRINOX	ARMOIRE
	01	BOITE DE DERIVATION 220x150x120, INOX AISI 304, IP69K	1	SDN152212	BOX02019	MP GAMMA	ARMOIRE
	01	COFFRET 400x400x180, INOX AISI 304, IP66/IK10 ROTULE + BP	1	SEB02903	SEB02903	IRINOX	ARMOIRE
	01	BOITE DE DERIVATION 100x220x90, INOX AISI 304, IP69K 3 BP	1	SPN10229	BOX02031	MP GAMMA	ARMOIRE
FQ1	06	PARAFOUDRE ENFICHABLE TYPE 2 POUR RESEAUX MONOPHASES 5 FILS	1	2905340	DIS00135	PHOENIX CONTACT	ARMOIRE
Q0	06	POIGNEE ROUGE/JAUNE IP65 POUR CDE EXTERIEURE FRONTALE	1	14741111	SEC00042	SOCOMEK	ARMOIRE
	06	POLE ADDITIONNEL PRINCIPAL SIRCO M 32A	1	22001003	SEC00032	SOCOMEK	ARMOIRE
	06	INTERRUPTEUR-SECTIONNEUR SIRCO M 3x32A NU	1	22003003	SEC00030	SOCOMEK	ARMOIRE
	06	CACHE-BORNES POUR SIRCO M 1P 16...40A	1	22941005	SEC00070	SOCOMEK	ARMOIRE
	06	CACHE-BORNES POUR SIRCO M 3P 16...40A	1	22943005	SEC00071	SOCOMEK	ARMOIRE
	06	ACCOUPLEMENT PORTE	1	22993409		SOCOMEK	ARMOIRE
F1	07	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F2	07	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F3	07	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F4	07	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
V1	07	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	FILTRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V2	07	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	FILTRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V3	07	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	FILTRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V4	07	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	FILTRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
F5	08	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F6	08	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F7	08	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F8	08	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
V5	08	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36		Date of creation :		Nomenclature Armoire				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INDEX : V6													
			E-mail : ecaticid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002								FOLIO : 121/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	Qty	REFERENCE	CODE ECAT-ID	FABRICANT	Nomenclature
	08	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	FIL TRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V6	08	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	08	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	FIL TRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V7	08	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	08	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	FIL TRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V8	08	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	08	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	FIL TRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
F9	09	ACTI9, IC60N DISJONCTEUR 2P 6A COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q11	09	PRODIS DT40 - DISJONCTEUR 3P+N 20 A COURBE D - 6KA	1	A9N21076	DIS00271	SCHNEIDER ELECTRIC	ARMOIRE
V9	09	CARTE COMMETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	09	VARIATEUR DE VITESSE POUR MOTEUR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	09	FIL TRE CEM	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Q10	10	DISJONCTEUR POUR CIRCUIT DE CONTROLE - GB2-DB - 3 A - 2P - 2D	1	GB2DB08	DIS00116	SCHNEIDER ELECTRIC	ARMOIRE
Q20	10	DISJONCTEUR ELECTRONIQUE 4x24VDC/0.5-10A	1	2905743	DIS00252	PHOENIX CONTACT	ARMOIRE
U10	10	ALIMENTATION A DECOUPAGE 100-240VAC, SORTIE 24V, 10A	1	S8VK-S24024	ALM00217	OMRON	ARMOIRE
Q21	11	ACTI9, IC60N DISJONCTEUR 2P 16A COURBE C	1	A9F77216	DIS00147	SCHNEIDER ELECTRIC	ARMOIRE
	11	ACTI9 VIGI IC60 - BLOC DIFFERENTIEL 2P 6KA 25A 30MA	1	A9Q11225	DIS00342	SCHNEIDER ELECTRIC	ARMOIRE
U21	11	ONDULEUR ONLINE 3000VA 230V	1	EON9SX3000I	ALM00247	EATON	ARMOIRE
Q100	12	DISJONCTEUR POUR CIRCUIT DE CONTROLE - GB2-DB - 10A - 2P - 2D	1	GB2DB16	DIS00159	SCHNEIDER ELECTRIC	ARMOIRE
Q120	12	DISJONCTEUR-SECTIONNEUR COURANT CONTINU 40A 1P, 250VDC, C	1	A9N61517	DIS00346	SCHNEIDER ELECTRIC	ARMOIRE
Q200	12	DISJONCTEUR POUR CIRCUIT DE CONTROLE - GB2-DB - 10A - 2P - 2D	1	GB2DB16	DIS00159	SCHNEIDER ELECTRIC	ARMOIRE
Q220	12	DISJONCTEUR-SECTIONNEUR COURANT CONTINU 40A 1P, 250VDC, C	1	A9N61517	DIS00346	SCHNEIDER ELECTRIC	ARMOIRE
Q300	12	DISJONCTEUR POUR CIRCUIT DE CONTROLE - GB2-DB - 10A - 2P - 2D	1	GB2DB16	DIS00159	SCHNEIDER ELECTRIC	ARMOIRE
Q320	12	DISJONCTEUR-SECTIONNEUR COURANT CONTINU 40A 1P, 250VDC, C	1	A9N61517	DIS00346	SCHNEIDER ELECTRIC	ARMOIRE
U100	12	ALIMENTATION 230VAC/24VDC 40A 1000W	1	HRPG-1000-24	ALM00246	MEAN WELL	ARMOIRE
U200	12	ALIMENTATION 230VAC/24VDC 40A 1000W	1	HRPG-1000-24	ALM00246	MEAN WELL	ARMOIRE
U300	12	ALIMENTATION 230VAC/24VDC 40A 1000W	1	HRPG-1000-24	ALM00246	MEAN WELL	ARMOIRE
Q101	13	DISJONCTEUR POUR CIRCUIT DE CONTROLE - GB2-DB - 6A - 2P - 2D	1	GB2DB12	DIS00144	SCHNEIDER ELECTRIC	ARMOIRE
Q201	13	DISJONCTEUR POUR CIRCUIT DE CONTROLE - GB2-DB - 6A - 2P - 2D	1	GB2DB12	DIS00144	SCHNEIDER ELECTRIC	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36		Date of creation :		Nomenclature Armoire			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		INDEX : V6												
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002							FOLIO : 122/144					

A
B
C
D
E
F
G
H
I
J
K
L
M



THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	Qty	REFERENCE	CODE ECAT-ID	FABRICANT	Nomenclature
KA16	37	MODULE RELAIS A SEMIE-CONDUCTEURS	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA17	37	MODULE RELAIS A SEMIE-CONDUCTEURS	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA18	37	MODULE RELAIS A SEMIE-CONDUCTEURS	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA19	37	MODULE RELAIS A SEMIE-CONDUCTEURS	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA2	38	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA3	38	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA4	39	RELAIS PUSH-IN, 1 Contact	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KA5	39	RELAIS PUSH-IN, 1 Contact	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KA10	45	RELAIS PUSH-IN, 1 Contact	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KA11	45	RELAIS PUSH-IN, 1 Contact	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KM100	45	BLOC DE CONTACTS AUXILIAIRES 2NO 2NF POUR CA3KN	1	LA1KN22	REL00057	SCHNEIDER ELECTRIC	ARMOIRE
	45	CONTACTEUR TESYS LP1-K - 4P - AC-1 440V 20 A - BOBINE 24 V CC	1	LP1K09004BD		SCHNEIDER ELECTRIC	ARMOIRE
KA110	46	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA120	46	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA230	46	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA240	46	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA350	46	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA360	46	RELAIS PUSH-IN, 2 Contacts	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA12	47	RELAIS PUSH-IN, 4 Contats	1	2903308	REL00084	PHOENIX CONTACT	ARMOIRE
KA13	47	RELAIS PUSH-IN, 4 Contats	1	2903308	REL00084	PHOENIX CONTACT	ARMOIRE
MOD0	49	API, 24VDC OMRON	1	NX102-1000	PLC01600	OMRON	ARMOIRE
MOD1	49	CARTE ALIMENTATION 24VDC	1	NX-PF0630	PLC01601	OMRON	ARMOIRE
MOD2	49	MODULE DE SORTIES TOR, 16S TRANSISTOR, 24VDC	1	NX-OD5256	PLC01631	OMRON	ARMOIRE
MOD3	49	MODULE DE SORTIES TOR, 16S TRANSISTOR, 24VDC	1	NX-OD5256	PLC01631	OMRON	ARMOIRE
MOD4	49	MODULE D'ENTREES TOR, 16E 24VDC	1	NX-ID5442	PLC01611	OMRON	ARMOIRE
MOD5	49	MODULE D'ENTREES TOR, 16E 24VDC	1	NX-ID5442	PLC01611	OMRON	ARMOIRE
MOD6	49	MODULE D'ENTREES TOR, 16E 24VDC	1	NX-ID5442	PLC01611	OMRON	ARMOIRE
MOD7	49	MODULE D'ENTREES POUR ENCODEUR INCREMENTAL, 2 VOIES	1	NX-EC0222	PLC01651	OMRON	ARMOIRE
MOD10	50	MODULE D'ENTREES/SORTIES I/O LINK , 4 VOIES	1	NX-ILM400	PLC01659	OMRON	ARMOIRE
MOD11	50	MODULE D'ENTREES/SORTIES I/O LINK , 4 VOIES	1	NX-ILM400	PLC01659	OMRON	ARMOIRE
MOD8	50	CARTE ALIMENTATION 24VDC	1	NX-PD1000	PLC01608	OMRON	ARMOIRE
MOD9	50	MODULE D'ENTREES/SORTIES I/O LINK , 4 VOIES	1	NX-ILM400	PLC01659	OMRON	ARMOIRE
FIN	51	MODULE DE FINALE DE BUS	1	750-600	PLC01003	WAGO	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Nomenclature Armoire				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB				ARTICLE : SMXA0002						INDEX : V6					
		E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020								FOLIO : 124/144					

A
B
C
D
E
F
G
H
I
J
K
L
M



THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
ARMOIRE	01	STAINLESS STEEL ENCLOSURE 1800x600X600 WITH MOUNTING PLATE	1	MXA03297	MXA03297	IRINOX	ARMOIRE
	01	STAINLESS STEEL ENCLOSURE 1800x600X370 WITH MOUNTING PLATE	1	MXA03300	MXA03300	IRINOX	ARMOIRE
	01	STAINLESS STEEL JUNCTION BOX 220x150x120 IP69K	1	SDN152212	BOX02019	MP GAMMA	ARMOIRE
	01	STAINLESS STEEL ENCLOSURE 400x400X180 IP66	1	SEB02903	SEB02903	IRINOX	ARMOIRE
	01	STAINLESS STEEL JUNCTION BOX 100x220x90 IP69K	1	SPN10229	BOX02031	MP GAMMA	ARMOIRE
FQ1	06	SURGE SUPPRESSORS VAL-SEC-T2-3S-350-FM	1	2905340	DIS00135	PHOENIX CONTACT	ARMOIRE
Q0	06	YELLOW AND RED EXTERNAL HANDLE OPERATION FOR SIRCO M	1	14741111	SEC00042	SOCOMEK	ARMOIRE
	06	ADDITIONAL POLE FOR SIRCO M 32A	1	22001003	SEC00032	SOCOMEK	ARMOIRE
	06	LOAD BREAK SWITCH SIRCO M 3x32A	1	22003003	SEC00030	SOCOMEK	ARMOIRE
	06	TERMINAL SHROUD FOR SIRCO M 1P 16...40A	1	22941005	SEC00070	SOCOMEK	ARMOIRE
	06	TERMINAL SHROUD FOR SIRCO M 3P 16...40A	1	22943005	SEC00071	SOCOMEK	ARMOIRE
	06	DOOR MONTING SIRCO M	1	22993409		SOCOMEK	ARMOIRE
F1	07	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F2	07	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F3	07	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F4	07	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
V1	07	COMM CARDETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	OMRON EMI FILTER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V2	07	COMM CARDETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	OMRON EMI FILTER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V3	07	COMM CARDETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	OMRON EMI FILTER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V4	07	COMM CARDETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	07	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	07	OMRON EMI FILTER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
F5	08	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F6	08	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F7	08	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
F8	08	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
V5	08	COMM CARDETHERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE :		SMXA0002		INDEX : V6	
		E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020													
																		126/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
	08	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	OMRON EMI FIL TER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V6	08	COMM CARDE THERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	08	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	OMRON EMI FIL TER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V7	08	COMM CARDE THERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	08	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	OMRON EMI FIL TER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
V8	08	COMM CARDE THERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	08	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	08	OMRON EMI FIL TER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
F9	09	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 6A - D CURVE	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q11	09	DT40 - CIRCUIT BREAKER 3P + N 20 A D CURVE - 6KA	1	A9N21076	DIS00271	SCHNEIDER ELECTRIC	ARMOIRE
V9	09	COMM CARDE THERCAT	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
	09	VARIABLE SPEED DRIVE FOR MOTOR 0.40kW, 200-240VAC MONO	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
	09	OMRON EMI FIL TER	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Q10	10	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 3 A - 2P - 2D	1	GB2DB08	DIS00116	SCHNEIDER ELECTRIC	ARMOIRE
Q20	10	CIRCUIT BREAKER CBM E4 4x24VDC/0.5-10A	1	2905743	DIS00252	PHOENIX CONTACT	ARMOIRE
U10	10	POWER SUPPLY 100-240VAC, OUTPUT 24VDC, 10A	1	S8VK-S24024	ALM00217	OMRON	ARMOIRE
Q21	11	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 16A - C CURVE	1	A9F77216	DIS00147	SCHNEIDER ELECTRIC	ARMOIRE
	11	ACTI9 VIGI IC60 - DIFFERENTIAL CIRCUIT BREAKER 2P 6KA 25A 30MA	1	A9Q11225	DIS00342	SCHNEIDER ELECTRIC	ARMOIRE
U21	11	UPS 3000VA 230VAC	1	EON9SX3000I	ALM00247	EATON	ARMOIRE
Q100	12	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 10 A - 2P - 2D	1	GB2DB16	DIS00159	SCHNEIDER ELECTRIC	ARMOIRE
Q120	12	MINITURE CIRCUIT BREAKER - C60H - 1 POLE - 40 A - C CURVE	1	A9N61517	DIS00346	SCHNEIDER ELECTRIC	ARMOIRE
Q200	12	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 10 A - 2P - 2D	1	GB2DB16	DIS00159	SCHNEIDER ELECTRIC	ARMOIRE
Q220	12	MINITURE CIRCUIT BREAKER - C60H - 1 POLE - 40 A - C CURVE	1	A9N61517	DIS00346	SCHNEIDER ELECTRIC	ARMOIRE
Q300	12	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 10 A - 2P - 2D	1	GB2DB16	DIS00159	SCHNEIDER ELECTRIC	ARMOIRE
Q320	12	MINITURE CIRCUIT BREAKER - C60H - 1 POLE - 40 A - C CURVE	1	A9N61517	DIS00346	SCHNEIDER ELECTRIC	ARMOIRE
U100	12	POWER SUPPLY 230VAC/24VDC 40A 1000W	1	HRPG-1000-24	ALM00246	MEAN WELL	ARMOIRE
U200	12	POWER SUPPLY 230VAC/24VDC 40A 1000W	1	HRPG-1000-24	ALM00246	MEAN WELL	ARMOIRE
U300	12	POWER SUPPLY 230VAC/24VDC 40A 1000W	1	HRPG-1000-24	ALM00246	MEAN WELL	ARMOIRE
Q101	13	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 6 A - 2P - 2D	1	GB2DB12	DIS00144	SCHNEIDER ELECTRIC	ARMOIRE
Q201	13	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 6 A - 2P - 2D	1	GB2DB12	DIS00144	SCHNEIDER ELECTRIC	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB				ARTICLE : SMXA0002						INDEX : V6					
		E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020				FOLIO : 127/144									

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
Q22	13	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 10A - C CURVE	1	A9F77210	DIS00142	SCHNEIDER ELECTRIC	ARMOIRE
	13	ACTI9 VIGI IC60 - DIFFERENTIAL CIRCUIT BREAKER 2P 6KA 25A 30MA	1	A9Q11225	DIS00342	SCHNEIDER ELECTRIC	ARMOIRE
Q23	13	ACTI 9 iC60N - MINITURE CIRCUIT BREAKER - 2P - 10A - C CURVE	1	A9F77210	DIS00142	SCHNEIDER ELECTRIC	ARMOIRE
Q301	13	CIRCUIT BREAKER FOR CONTROL CIRCUIT - GB2-DB - 6 A - 2P - 2D	1	GB2DB12	DIS00144	SCHNEIDER ELECTRIC	ARMOIRE
SX1	13		1	053911	PRI00002	LEGRAND	ARMOIRE
U101	13	POWER SUPPLY 100-240VAC, OUTPUT 24VDC, 20A	1	S8VK-S48024	ALM00218	OMRON	ARMOIRE
U201	13	POWER SUPPLY 100-240VAC, OUTPUT 24VDC, 20A	1	S8VK-S48024	ALM00218	OMRON	ARMOIRE
U301	13	POWER SUPPLY 100-240VAC, OUTPUT 24VDC, 20A	1	S8VK-S48024	ALM00218	OMRON	ARMOIRE
SEC01	14	SAFETY RELAY	1	2900509	REL00033	PHOENIX	ARMOIRE
FAN1	16	24VDC FAN 178m3/h + OUTLET GRILLE AND FILTER	1	COSD12B05HWPBZ0	ELC00961	COSTECH	ARMOIRE
H50	16	LED STRIP WHITE HOT 24VDC	1	VEL75167	ELC02012	MIIDEX	ARMOIRE
KA1	17	TESYS K CONTROL RELAY 3NO+1NF 24VDC	1	CA3KN31BD	REL00051	SCHNEIDER ELECTRIC	ARMOIRE
	17	TESYS D AUXILIARY CONTACT BLOCK 4NO	1	LA1KN40	REL00086	SCHNEIDER ELECTRIC	ARMOIRE
FAN11	23	24VDC FAN 355m3/h	1	4114N/2H4	ELC02073	EBM-PAPST	ARMOIRE
	23	120x120 GRILLE FOR FAN	1	COS120	ELC00722	COSTECH	ARMOIRE
FAN12	23	24VDC FAN 355m3/h	1	4114N/2H4	ELC02073	EBM-PAPST	ARMOIRE
	23	120x120 GRILLE FOR FAN	1	COS120	ELC00722	COSTECH	ARMOIRE
FAN13	23	24VDC FAN 355m3/h	1	4114N/2H4	ELC02073	EBM-PAPST	ARMOIRE
	23	120x120 GRILLE FOR FAN	1	COS120	ELC00722	COSTECH	ARMOIRE
FAN14	23	24VDC FAN 355m3/h	1	4114N/2H4	ELC02073	EBM-PAPST	ARMOIRE
	23	120x120 GRILLE FOR FAN	1	COS120	ELC00722	COSTECH	ARMOIRE
H51	23	LED STRIP WHITE HOT 24VDC	1	VEL75167	ELC02012	MIIDEX	ARMOIRE
Q121	24	CIRCUIT BREAKER CBM E8 8x24VDC/0.5-10A	1	2905744	DIS00250	PHOENIX CONTACT	ARMOIRE
Q221	24	CIRCUIT BREAKER CBM E8 8x24VDC/0.5-10A	1	2905744	DIS00250	PHOENIX CONTACT	ARMOIRE
Q321	24	CIRCUIT BREAKER CBM E8 8x24VDC/0.5-10A	1	2905744	DIS00250	PHOENIX CONTACT	ARMOIRE
UAC100	25	INDUSTRIEL COMPUTER NEOUSYS NUVO	1	NUVO-10208GC	INF01052	NEOUSYS	ARMOIRE
USB_UAC100	25	USB 3.0 PORT REMOTE CABLE	1	E2 1USB9AN3	CON00401	PIZZATO	ARMOIRE
UAC200	29	INDUSTRIEL COMPUTER NEOUSYS NUVO	1	NUVO-10208GC	INF01052	NEOUSYS	ARMOIRE
USB_UAC200	29	USB 3.0 PORT REMOTE CABLE	1	E2 1USB9AN3	CON00401	PIZZATO	ARMOIRE
UAC300	33	INDUSTRIEL COMPUTER NEOUSYS NUVO	1	NUVO-10208GC	INF01052	NEOUSYS	ARMOIRE
USB_UAC300	33	USB 3.0 PORT REMOTE CABLE	1	E2 1USB9AN3	CON00401	PIZZATO	ARMOIRE
KA14	37	SEMICONDUCTOR RELAI MODULE	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA15	37	SEMICONDUCTOR RELAI MODULE	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List		 Ecat-iD Campus						CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB		INDEX : V6													
		E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002								FOLIO : 128/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
KA16	37	SEMICONDUCTOR RELAI MODULE	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA17	37	SEMICONDUCTOR RELAI MODULE	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA18	37	SEMICONDUCTOR RELAI MODULE	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA19	37	SEMICONDUCTOR RELAI MODULE	1	2900378	REL00088	PHOENIX CONTACT	ARMOIRE
KA2	38	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA3	38	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA4	39	RELAY MODULE RIF-0-RPT-24DC/21	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KA5	39	RELAY MODULE RIF-0-RPT-24DC/21	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KA10	45	RELAY MODULE RIF-0-RPT-24DC/21	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KA11	45	RELAY MODULE RIF-0-RPT-24DC/21	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
KM100	45	TESYS K AUXILIARY CONTACT BLOCK 2NO+2NC	1	LA1KN22	REL00057	SCHNEIDER ELECTRIC	ARMOIRE
	45	TESYS K CONTACTOR - 4P - AC-1 <= 440 V 20 A - 24 V DC COIL	1	LP1K09004BD		SCHNEIDER ELECTRIC	ARMOIRE
KA110	46	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA120	46	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA230	46	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA240	46	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA350	46	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA360	46	RELAY MODULE RIF-1-RPT-LDP-24DC/2X21	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA12	47	RELAY MODULE RIF-2-RPT-LDP-24DC/4X21	1	2903308	REL00084	PHOENIX CONTACT	ARMOIRE
KA13	47	RELAY MODULE RIF-2-RPT-LDP-24DC/4X21	1	2903308	REL00084	PHOENIX CONTACT	ARMOIRE
MOD0	49	OMRON CPU 24VCC	1	NX102-1000	PLC01600	OMRON	ARMOIRE
MOD1	49	POWER SUPPLY MODULE 24VCC	1	NX-PF0630	PLC01601	OMRON	ARMOIRE
MOD2	49	16 CHANNEL DIGITAL OUTPUT, 24VDC, 0.5A	1	NX-OD5256	PLC01631	OMRON	ARMOIRE
MOD3	49	16 CHANNEL DIGITAL OUTPUT, 24VDC, 0.5A	1	NX-OD5256	PLC01631	OMRON	ARMOIRE
MOD4	49	16 CHANNEL DIGITAL INPUT, 24VDC	1	NX-ID5442	PLC01611	OMRON	ARMOIRE
MOD5	49	16 CHANNEL DIGITAL INPUT, 24VDC	1	NX-ID5442	PLC01611	OMRON	ARMOIRE
MOD6	49	16 CHANNEL DIGITAL INPUT, 24VDC	1	NX-ID5442	PLC01611	OMRON	ARMOIRE
MOD7	49	2 INCREMENTAL ENCODERS INPUT UNIT, 24VDC	1	NX-EC0222	PLC01651	OMRON	ARMOIRE
MOD10	50	4 CHANNEL I/O LINK	1	NX-ILM400	PLC01659	OMRON	ARMOIRE
MOD11	50	4 CHANNEL I/O LINK	1	NX-ILM400	PLC01659	OMRON	ARMOIRE
MOD8	50	ADDITIONAL UNIT POWER SUPPLY MODULE 24VCC	1	NX-PD1000	PLC01608	OMRON	ARMOIRE
MOD9	50	4 CHANNEL I/O LINK	1	NX-ILM400	PLC01659	OMRON	ARMOIRE
FIN	51	END MODULE	1	750-600	PLC01003	WAGO	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List		 Ecat-iD Campus						CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0002		INDEX : V6			
		E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020										FOLIO : 129/144			

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		Components List				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0002				INDEX : V6	
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020										FOLIO : 130/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	Qte	REFERENCE	CODE ECAT-ID	FABRICANT	Nomenclature
ETH_HMI		CONNECTEUR RJ45 METAL A MONTER IP20 DROIT CAT.6A	2	J00026A5001	CON00035	TELEGARTNER	FI
ETH_UAC		CONNECTEUR RJ45 METAL A MONTER IP20 DROIT CAT.6A	2	J00026A5001	CON00035	TELEGARTNER	FI
EV00	14	FR + VANNE + MSP	1	AC30A-QAS111	FPF00057	SMC	FI
DTS1	16	CAPTEUR SECURITE PORTE	1	1059511	SEN00569	SICK	FI
	16	ENTRETOISE POUR CAPTEUR SECURITE PORTE	2	1060291	SEN00570	SICK	FI
DTS2	16	CAPTEUR SECURITE PORTE	1	1059511	SEN00569	SICK	FI
	16	ENTRETOISE POUR CAPTEUR SECURITE PORTE	2	1060291	SEN00570	SICK	FI
DTS3	16	CAPTEUR SECURITE PORTE	1	1059511	SEN00569	SICK	FI
	16	ENTRETOISE POUR CAPTEUR SECURITE PORTE	2	1060291	SEN00570	SICK	FI
DTS4	16	CAPTEUR SECURITE PORTE	1	1059511	SEN00569	SICK	FI
	16	ENTRETOISE POUR CAPTEUR SECURITE PORTE	2	1060291	SEN00570	SICK	FI
SL01	38	VERRINE 7 COULEURS BANNER LED 24VDC 4P	1	DK-K50L2RGB7Q	PRI00166	BANNER	FI
	38	PIED POUR VERRINE BANNER BLANC	1	SA-E12M30C	PRI00169	BANNER	FI
	38	ADAPTATEUR VERRINE BANNER	1	SA-M30TE12C	PRI00167	BANNER	FI
	38	TUBE 300mm SS VERRINE BANNER	1	SOP-E12-300SS	PRI00168	BANNER	FI
DT40	56	CAPTEUR MECANIQUE MINIATURE	1	XCMN2121L1	SEN00118	SCHNEIDER ELECTRIC	FI
DTLED1	56	CAPTEUR MECANIQUE MINIATURE	1	XCMN2121L1	SEN00118	SCHNEIDER ELECTRIC	FI
DTLED2	56	CAPTEUR MECANIQUE MINIATURE	1	XCMN2121L1	SEN00118	SCHNEIDER ELECTRIC	FI
DT20	57	REFLECTEUR ROND Diam 35mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	57	CAPTEUR REFLEX RECTANGULAIRE	1	O6P301	SEN00603	IFM	FI
DT21	57	REFLECTEUR ROND Diam 35mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	57	CAPTEUR REFLEX RECTANGULAIRE	1	O6P301	SEN00603	IFM	FI
DT22	57	REFLECTEUR ROND Diam 35mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	57	CAPTEUR REFLEX RECTANGULAIRE	1	O6P301	SEN00603	IFM	FI
DT23	57	REFLECTEUR ROND Diam 35mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	57	CAPTEUR REFLEX RECTANGULAIRE	1	O6P301	SEN00603	IFM	FI
DT24	57	REFLECTEUR ROND Diam 35mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	57	CAPTEUR REFLEX RECTANGULAIRE	1	O6P301	SEN00603	IFM	FI

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Nomenclature FI		 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE			
		Fax : (33).2.98.85.31.38		Designed by : DB		INDEX : V6													
		E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002						FOLIO : 131/144							

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	Qty	REFERENCE	CODE ECAT-ID	FABRICANT	Nomenclature
DT25	57	REFLECTEUR ROND Diam 35mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles DROIT L=10m PP	1	EVF002	CBL00464	IFM	FI
	57	CAPTEUR REFLEX RECTANGULAIRE	1	O6P301	SEN00603	IFM	FI
DT26	57	CABLE M12 4poles COUDE L=10m PP	1	EVF005	CBL00440	IFM	FI
	57	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT27	57	CABLE M12 4poles COUDE L=10m PP	1	EVF005	CBL00440	IFM	FI
	57	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT01	58	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	58	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	58	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT28	58	CABLE M12 4poles COUDE L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT29	58	CABLE M12 4poles COUDE L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT30	58	CABLE M12 4poles COUDE L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT31	58	CABLE M12 4poles COUDE L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT02	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT03	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT04	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT05	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT06	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Nomenclature FI		 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE			
		Fax : (33).2.98.85.31.38		Designed by : DB		INDEX : V6													
		E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002						FOLIO : 132/144							

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	Qte	REFERENCE	CODE ECAT-ID	FABRICANT	Nomenclature
DT07	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT08	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT09	59	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	59	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT10	60	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	60	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	60	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT11	60	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	60	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	60	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT12	60	REFLECTEUR 50X50mm	1	E20722	SEN00352	IFM	FI
	60	CABLE M8 4poles COUDE L=10m	1	EVF140	CBL00561	IFM	FI
	60	CAPTEUR LASER	1	OJ5136	SEN00350	IFM	FI
DT13	60	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	60	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT14	60	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	60	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT15	60	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	60	CAPTEUR INDUCTIF Diamètre 18 NO	1	IGT203	SEN00024	IFM	FI
DT16	60	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	60	CAPTEUR MECANIQUE A TIGE RONDE Ø6 AVEC CONNECTEUR M12	1	XCKJ10559D	SEN00690	SCHNEIDER ELECTRIC	FI
DT100	63	SUPPORT SONDE TEMPERATURE IFM	1	E10076	SEN00677	IFM	FI
	63	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI
	63	CAPTEURS: Sonde de température INOX I/O LINK Pt1000	1	TA2115	SEN00554	IFM	FI
PS01	63	CABLE M12 4poles COUDE L=10mPP	1	EVF005	CBL00440	IFM	FI
	63	CAPTEUR DE PRESSION IOLINK -1-10b	1	PV7004	SEN00674	IFM	FI
DT110	64	SUPPORT SONDE TEMPERATURE IFM	1	E10076	SEN00677	IFM	FI
	64	CABLE M12 4poles DROIT L=10mPP	1	EVF002	CBL00464	IFM	FI

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatid.service@ceva.com		Date of creation : Designed by : DB		Nomenclature FI ENVIRONNEMENT : Version 4.49.F - 23/09/2020		 Ecat-iD Campus					CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
														ARTICLE : SMXA0002			INDEX : V6 FOLIO : 133/144		

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		Nomenclature FI			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB									ARTICLE : SMXA0002				INDEX : V6	
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT: Version 4.49.F - 23/09/2020									FOLIO : 134/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
ETH_HMI		METALIC RJ45 CONNECTOR	2	J00026A5001	CON00035	TELEGARTNER	FI
ETH_UAC		METALIC RJ45 CONNECTOR	2	J00026A5001	CON00035	TELEGARTNER	FI
EV00	14	PRESSURE ELECTROVALVE + FILTER	1	AC30A-QAS111	FPF00057	SMC	FI
DTS1	16	RE2 / MAGNETIC SAFETY SWITCH	1	1059511	SEN00569	SICK	FI
	16	RE2 / MAGNETIC SAFETY SWITCH MOUNTING	2	1060291	SEN00570	SICK	FI
DTS2	16	RE2 / MAGNETIC SAFETY SWITCH	1	1059511	SEN00569	SICK	FI
	16	RE2 / MAGNETIC SAFETY SWITCH MOUNTING	2	1060291	SEN00570	SICK	FI
DTS3	16	RE2 / MAGNETIC SAFETY SWITCH	1	1059511	SEN00569	SICK	FI
	16	RE2 / MAGNETIC SAFETY SWITCH MOUNTING	2	1060291	SEN00570	SICK	FI
DTS4	16	RE2 / MAGNETIC SAFETY SWITCH	1	1059511	SEN00569	SICK	FI
	16	RE2 / MAGNETIC SAFETY SWITCH MOUNTING	2	1060291	SEN00570	SICK	FI
SL01	38	7-COLORS RGB General Purpose Indicator	1	DK-K50L2RGB7Q	PRI00166	BANNER	FI
	38	MOUNTING BASE FOR 7-COLORS INDICATOR	1	SA-E12M30C	PRI00169	BANNER	FI
	38	ADAPTER FOR 7-COLORS INDICATOR	1	SA-M30TE12C	PRI00167	BANNER	FI
	38	SS PIPE 300mm FOR 7-COLORS INDICATOR	1	SOP-E12-300SS	PRI00168	BANNER	FI
DT40	56	LIMIT SWITCH XCMN - TH.PLASTIC ROLLER LEVER PLUNG. HOR - 1NC+1NO - SNAP - 1 M	1	XCMN2121L1	SEN00118	SCHNEIDER ELECTRIC	FI
DTLED1	56	LIMIT SWITCH XCMN - TH.PLASTIC ROLLER LEVER PLUNG. HOR - 1NC+1NO - SNAP - 1 M	1	XCMN2121L1	SEN00118	SCHNEIDER ELECTRIC	FI
DTLED2	56	LIMIT SWITCH XCMN - TH.PLASTIC ROLLER LEVER PLUNG. HOR - 1NC+1NO - SNAP - 1 M	1	XCMN2121L1	SEN00118	SCHNEIDER ELECTRIC	FI
DT20	57	PRISMATIC REFLECTOR; Ø 35 mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	57	RETRO-REFLECTIVE SENSOR; PNP; CABLE WITH CONNECTOR	1	O6P301	SEN00603	IFM	FI
DT21	57	PRISMATIC REFLECTOR; Ø 35 mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	57	RETRO-REFLECTIVE SENSOR; PNP; CABLE WITH CONNECTOR	1	O6P301	SEN00603	IFM	FI
DT22	57	PRISMATIC REFLECTOR; Ø 35 mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	57	RETRO-REFLECTIVE SENSOR; PNP; CABLE WITH CONNECTOR	1	O6P301	SEN00603	IFM	FI
DT23	57	PRISMATIC REFLECTOR; Ø 35 mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	57	RETRO-REFLECTIVE SENSOR; PNP; CABLE WITH CONNECTOR	1	O6P301	SEN00603	IFM	FI
DT24	57	PRISMATIC REFLECTOR; Ø 35 mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	57	RETRO-REFLECTIVE SENSOR; PNP; CABLE WITH CONNECTOR	1	O6P301	SEN00603	IFM	FI

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List		 Ecat-iD Campus						CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB		INDEX : V6													
		E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020		SMXA0002								FOLIO : 135/144					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
DT25	57	PRISMATIC REFLECTOR; Ø 35 mm	1	E20954	SEN00591	IFM	FI
	57	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	57	RETRO-REFLECTIVE SENSOR; PNP; CABLE WITH CONNECTOR	1	O6P301	SEN00603	IFM	FI
DT26	57	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	57	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT27	57	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	57	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT01	58	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	58	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	58	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT28	58	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT29	58	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT30	58	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT31	58	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	58	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT02	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT03	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT04	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT05	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT06	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE :		SMXA0002		INDEX : V6	
		E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020												FOLIO : 136/144	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

MARK	FOLIO	DESCRIPTION	Qty	REFERENCE	CODE ECAT-ID	MANUFACTURER	LISTING
DT07	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT08	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT09	59	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	59	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	59	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT10	60	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	60	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	60	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT11	60	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	60	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	60	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT12	60	PRISMATIC REFLECTOR; 50X50mm	1	E20722	SEN00352	IFM	FI
	60	CABLE M8 4poles ELBOW L=10m	1	EVF140	CBL00561	IFM	FI
	60	RETRO-REFLECTIVE LASER SENSOR	1	OJ5136	SEN00350	IFM	FI
DT13	60	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	60	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT14	60	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	60	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT15	60	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	60	INDUCTIVE SENSOR Ø18 NO	1	IGT203	SEN00024	IFM	FI
DT16	60	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	60	LIMIT SWITCH XCKJ - THERMOPLASTIC ROUND ROD LEVER 6 MM - 1NC+1NO - SNAP - M12	1	XCKJ10559D	SEN00690	SCHNEIDER ELECTRIC	FI
DT100	63	TEMPERATURE SENSOR SUPPORT	1	E10076	SEN00677	IFM	FI
	63	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI
	63	TEMPERATURE SENSOR I/O LINK Pt1000	1	TA2115	SEN00554	IFM	FI
PS01	63	CABLE M12 4poles ELBOW L=10m PP	1	EVF005	CBL00440	IFM	FI
	63	ELECTRONIC PRESSURE MONITOR IOLINK -1-10BAR	1	PV7004	SEN00674	IFM	FI
DT110	64	TEMPERATURE SENSOR SUPPORT	1	E10076	SEN00677	IFM	FI
	64	CABLE M12 4poles STRAIGHT L=10m	1	EVF002	CBL00464	IFM	FI

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID ZI de KERIEL 29800 PLOUEDERN - FRANCE -		Tél : (33).2.98.85.31.36		Date of creation :		Components List				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE :		SMXA0002		INDEX : V6	
		E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Version 4.49.F - 23/09/2020													
																		137/144	

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID ZI de KERIEL 29800 PLOUEDERN – FRANCE –			Tél : (33).2.98.85.31.36		Date of creation :		Components List				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0002		INDEX : V6			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Version 4.49.F - 23/09/2020				138/144											

REPERE	TYPE/SECTION	TENANT	ABOUTISSANT	NOMENCLATURE
DT206	EVF002	ARMOIRE		CABLE
DT21	EVF002	BOITIER B20	MACHINE	CABLE
DT22	EVF002	BOITIER B20	MACHINE	CABLE
DT23	EVF002	BOITIER B20	MACHINE	CABLE
DT24	EVF002	BOITIER B20	MACHINE	CABLE
DT25	EVF002	BOITIER B20	MACHINE	CABLE
DT26	EVF005	BOITIER B20		CABLE
DT27	EVF005	BOITIER B20		CABLE
DT28	EVF005	BOITIER B20		CABLE
DT29	EVF005	BOITIER B20		CABLE
DT30	EVF005	BOITIER B20		CABLE
DT31	EVF005	BOITIER B20		CABLE
DTS1	6x0.25²	ARMOIRE	MACHINE	CABLE
DTS2	6x0.25²	ARMOIRE	MACHINE	CABLE
ETH_ECAT1	XS6W6LSZH8SS500CMY	ARMOIRE	BOITIER B10	CABLE
ETH_ECAT2	XS6W6LSZH8SS500CMY	ARMOIRE	BOITIER B10	CABLE
ETH_ECAT3	XS6W6LSZH8SS30CMY	ARMOIRE	ARMOIRE	CABLE
ETH_ECAT4	XS6W6LSZH8SS30CMY	ARMOIRE	ARMOIRE	CABLE
ETH_ECAT5	XS6W6LSZH8SS30CMY	ARMOIRE	ARMOIRE	CABLE
ETH_ECAT6	XS6W6LSZH8SS30CMY	ARMOIRE	ARMOIRE	CABLE
ETH_ECAT7	XS6W6LSZH8SS30CMY	ARMOIRE	ARMOIRE	CABLE
ETH_ECAT8	XS6W6LSZH8SS30CMY	ARMOIRE	ARMOIRE	CABLE
ETH_EWON	411-384	ARMOIRE	ARMOIRE	CABLE
ETH_PLC	411-227	ARMOIRE	ARMOIRE	CABLE
ETH_RJ45-1	1517509	ARMOIRE	ARMOIRE	CABLE
ETH_UAC100	ECORD6ASF03MSH	BOITIER B10	BOITIER B10	CABLE
ETH_UAC200	ECORD6ASF03MSH	BOITIER B10	BOITIER B10	CABLE
ETH_UAC300	ECORD6ASF03MSH	BOITIER B10	BOITIER B10	CABLE
H111	E12495	BOITIER B10	MACHINE	CABLE
H112	E12495	BOITIER B10	MACHINE	CABLE
H121	E12495	BOITIER B10	MACHINE	CABLE
H122	E12495	BOITIER B10	MACHINE	CABLE
H231	E12495	BOITIER B10	MACHINE	CABLE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20																																																																																																																																																																										
<table><tr><th>REPERE</th><th>TYPE/SECTION</th><th>TENANT</th><th>ABOUTISSANT</th><th>NOMENCLATURE</th></tr><tr><td>H232</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>H241</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>H242</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>H351</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>H352</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>H361</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>H362</td><td>E12495</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M01-1</td><td>YSLCY 4G1.5MM²</td><td>PRF-M01</td><td>ARMOIRE</td><td>CABLE</td></tr><tr><td>M01-2</td><td>YSLCY 4G1.5MM²</td><td>PRM-M01</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M02</td><td>YSLCY 4G1.5MM²</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M03</td><td>YSLCY 4G1.5MM²</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M04</td><td>YSLCY 4G1.5MM²</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M05</td><td>YSLCY 4G1.5MM²</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M06</td><td>YSLCY 4G1.5MM²</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M07-1</td><td>YSLCY 4G1.5MM²</td><td>PRF-M07</td><td>ARMOIRE</td><td>CABLE</td></tr><tr><td>M07-2</td><td>YSLCY 4G1.5MM²</td><td>PRM-M07</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M08-1</td><td>YSLCY 4G1.5MM²</td><td>ARMOIRE</td><td>PRF-M08</td><td>CABLE</td></tr><tr><td>M08-2</td><td>YSLCY 4G1.5MM²</td><td>PRM-M08</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>M09-1</td><td>YSLCY 4G1.5MM²</td><td>PRF-M09</td><td>ARMOIRE</td><td>CABLE</td></tr><tr><td>M09-2</td><td>YSLCY 4G1.5MM²</td><td>PRM-M09</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>PS01</td><td>EVF005</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>SL01</td><td>EVF011</td><td>ARMOIRE</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>SUB-D_UAC100-1</td><td>2926616</td><td>BOITIER B10</td><td></td><td>CABLE</td></tr><tr><td>SUB-D_UAC100-2</td><td>2926616</td><td></td><td></td><td>CABLE</td></tr><tr><td>SUB-D_UAC200-1</td><td>2926616</td><td></td><td></td><td>CABLE</td></tr><tr><td>SUB-D_UAC200-2</td><td>2926616</td><td></td><td></td><td>CABLE</td></tr><tr><td>SUB-D_UAC300-1</td><td>2926616</td><td></td><td></td><td>CABLE</td></tr><tr><td>SUB-D_UAC300-2</td><td>2926616</td><td></td><td></td><td>CABLE</td></tr><tr><td>USB_UVA111</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA112</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA121</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA122</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA231</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr></table>																				REPERE	TYPE/SECTION	TENANT	ABOUTISSANT	NOMENCLATURE	H232	E12495	BOITIER B10	MACHINE	CABLE	H241	E12495	BOITIER B10	MACHINE	CABLE	H242	E12495	BOITIER B10	MACHINE	CABLE	H351	E12495	BOITIER B10	MACHINE	CABLE	H352	E12495	BOITIER B10	MACHINE	CABLE	H361	E12495	BOITIER B10	MACHINE	CABLE	H362	E12495	BOITIER B10	MACHINE	CABLE	M01-1	YSLCY 4G1.5MM²	PRF-M01	ARMOIRE	CABLE	M01-2	YSLCY 4G1.5MM²	PRM-M01	MACHINE	CABLE	M02	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE	M03	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE	M04	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE	M05	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE	M06	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE	M07-1	YSLCY 4G1.5MM²	PRF-M07	ARMOIRE	CABLE	M07-2	YSLCY 4G1.5MM²	PRM-M07	MACHINE	CABLE	M08-1	YSLCY 4G1.5MM²	ARMOIRE	PRF-M08	CABLE	M08-2	YSLCY 4G1.5MM²	PRM-M08	MACHINE	CABLE	M09-1	YSLCY 4G1.5MM²	PRF-M09	ARMOIRE	CABLE	M09-2	YSLCY 4G1.5MM²	PRM-M09	MACHINE	CABLE	PS01	EVF005	ARMOIRE	MACHINE	CABLE	SL01	EVF011	ARMOIRE	MACHINE	CABLE	SUB-D_UAC100-1	2926616	BOITIER B10		CABLE	SUB-D_UAC100-2	2926616			CABLE	SUB-D_UAC200-1	2926616			CABLE	SUB-D_UAC200-2	2926616			CABLE	SUB-D_UAC300-1	2926616			CABLE	SUB-D_UAC300-2	2926616			CABLE	USB_UVA111	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA112	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA121	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA122	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA231	2000033241	BOITIER B10	MACHINE	CABLE
REPERE	TYPE/SECTION	TENANT	ABOUTISSANT	NOMENCLATURE																																																																																																																																																																																									
H232	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
H241	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
H242	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
H351	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
H352	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
H361	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
H362	E12495	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
M01-1	YSLCY 4G1.5MM²	PRF-M01	ARMOIRE	CABLE																																																																																																																																																																																									
M01-2	YSLCY 4G1.5MM²	PRM-M01	MACHINE	CABLE																																																																																																																																																																																									
M02	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
M03	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
M04	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
M05	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
M06	YSLCY 4G1.5MM²	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
M07-1	YSLCY 4G1.5MM²	PRF-M07	ARMOIRE	CABLE																																																																																																																																																																																									
M07-2	YSLCY 4G1.5MM²	PRM-M07	MACHINE	CABLE																																																																																																																																																																																									
M08-1	YSLCY 4G1.5MM²	ARMOIRE	PRF-M08	CABLE																																																																																																																																																																																									
M08-2	YSLCY 4G1.5MM²	PRM-M08	MACHINE	CABLE																																																																																																																																																																																									
M09-1	YSLCY 4G1.5MM²	PRF-M09	ARMOIRE	CABLE																																																																																																																																																																																									
M09-2	YSLCY 4G1.5MM²	PRM-M09	MACHINE	CABLE																																																																																																																																																																																									
PS01	EVF005	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
SL01	EVF011	ARMOIRE	MACHINE	CABLE																																																																																																																																																																																									
SUB-D_UAC100-1	2926616	BOITIER B10		CABLE																																																																																																																																																																																									
SUB-D_UAC100-2	2926616			CABLE																																																																																																																																																																																									
SUB-D_UAC200-1	2926616			CABLE																																																																																																																																																																																									
SUB-D_UAC200-2	2926616			CABLE																																																																																																																																																																																									
SUB-D_UAC300-1	2926616			CABLE																																																																																																																																																																																									
SUB-D_UAC300-2	2926616			CABLE																																																																																																																																																																																									
USB_UVA111	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
USB_UVA112	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
USB_UVA121	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
USB_UVA122	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
USB_UVA231	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																									
(33).2.98.85.31.36 (33).2.98.85.31.38 ecatid.service@ceva.com				DESSINE : DB VERIFIE : JT DATE D'E CREATION : 13/12/2023		V603/04/2024AJOUT CAPTEUR D'ENTREE ET CAPTEUR I/O DBNK V528/03/2024MODIF FOLIO 01/02/03/10/23/27/31/53/76/100/104DB V427/03/2024MODIF FOLIO 09/23/27/31/35/74/78/79/104DB V104/03/2024CREATIONDB INDICE DATE MODIFICATION DES.	Dossier n° : INTERNE		SMXA0002 Carnet des cables Cable book				FOLIO 143/144 see3000 version 4.8																																																																																																																																																																																

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20																																																																																																																																																																																									
<table><tr><th>REPERE</th><th>TYPE/SECTION</th><th>TENANT</th><th>ABOUTISSANT</th><th>NOMENCLATURE</th></tr><tr><td>USB_UVA232</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA241</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA242</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA351</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA352</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA361</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>USB_UVA362</td><td>2000033241</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA111</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA112</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA121</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA122</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA231</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA232</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA241</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA242</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA351</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA352</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA361</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td>UVA362</td><td>2000034086</td><td>BOITIER B10</td><td>MACHINE</td><td>CABLE</td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr></table>																				REPERE	TYPE/SECTION	TENANT	ABOUTISSANT	NOMENCLATURE	USB_UVA232	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA241	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA242	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA351	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA352	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA361	2000033241	BOITIER B10	MACHINE	CABLE	USB_UVA362	2000033241	BOITIER B10	MACHINE	CABLE	UVA111	2000034086	BOITIER B10	MACHINE	CABLE	UVA112	2000034086	BOITIER B10	MACHINE	CABLE	UVA121	2000034086	BOITIER B10	MACHINE	CABLE	UVA122	2000034086	BOITIER B10	MACHINE	CABLE	UVA231	2000034086	BOITIER B10	MACHINE	CABLE	UVA232	2000034086	BOITIER B10	MACHINE	CABLE	UVA241	2000034086	BOITIER B10	MACHINE	CABLE	UVA242	2000034086	BOITIER B10	MACHINE	CABLE	UVA351	2000034086	BOITIER B10	MACHINE	CABLE	UVA352	2000034086	BOITIER B10	MACHINE	CABLE	UVA361	2000034086	BOITIER B10	MACHINE	CABLE	UVA362	2000034086	BOITIER B10	MACHINE	CABLE																																																																																					
REPERE	TYPE/SECTION	TENANT	ABOUTISSANT	NOMENCLATURE																																																																																																																																																																																																								
USB_UVA232	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
USB_UVA241	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
USB_UVA242	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
USB_UVA351	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
USB_UVA352	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
USB_UVA361	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
USB_UVA362	2000033241	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA111	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA112	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA121	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA122	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA231	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA232	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA241	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA242	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA351	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA352	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA361	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
UVA362	2000034086	BOITIER B10	MACHINE	CABLE																																																																																																																																																																																																								
(33).2.98.85.31.36 (33).2.98.85.31.38 ecatid.service@ceva.com		DESSINE : DB VERIFIE : JT DATE D'E CREATION : 13/12/2023	V603/04/2024 V528/03/2024 V427/03/2024 V104/03/2024 INDICE DATE	AJOUT CAPTEUR D'ENTREE ET CAPTEUR I/O DB MODIF FOLIO 01/02/03/10/23/27/31/53/76/100/101 DB MODIF FOLIO 09/23/27/31/35/74/78/79/104 CREATION MODIFICATION	DB DB DB DB DES.	Dossier n° : INTERNE	SMXA0002 Carnet des cables Cable book	FOLIO 144/144 see3000 version 4.00																																																																																																																																																																																																				