

-ARMOIRE

N° Armoire :

Matière du coffret :INOX

Taille du coffret :600x600x300

Marque du coffret :IRINOX

Matière des boîtiers :/

Equipements utilisés :

Marque boutonnerie :SCHNEIDER ELECTRIC

Langue boutonnerie :FRANCAIS

Marque automate :/

Marque IHM :/

Câblage

Pouvoir de coupure lcc : 10kA

Câbles blindés sur les variateurs

Couleurs des fils :

Phase 230V : Noir24VDC : Violet

Neutre 230V : Bleu12VDC ou 15VDC : Rouge

Phase 115V : Marron5VDC : Gris

Neutre 115V : Marron bagué bleu48VDC : Jaune

Terre : Vert/Jaune0VDC : Blanc

Potentiel extérieur : Orange

Neutre extérieur : Orange bagué bleu

Caractéristiques électriques estimées

Puissance nominale totale (kW):

Courant nominal total (Amps):

Disjoncteur principal conseillé (Client)

Calibre du disjoncteur (Amps):16A

Courbe du disjoncteur (type):D

Section minimale du câble d'alimentation (Client) :

380V+3PH+N+GND

Section du fil (mm²):2,5mm²

Type de câble (Nombre de fils):5G2,5mm²H07 RNF / U1000 R2V

Le disjoncteur principal et le câble d'alimentation peuvent être différents en fonction de l'installation électrique (Matériau du câble, longueur, méthode d'installation, ...)

CE DOCUMENT EST LA PROPRIETE DE ECAT-ID. IL EST REMIS A TITRE CONFIDENTIEL. IL NE DOIT PAS ETRE REPRODUIT OU COMMUNIQUE A DES TIERS SANS NOTRE AUTORISATION ECRITE.

INDEX	MODIFICATION	DATE	DESSINÉ PAR	VÉRIFIÉ PAR	APPROUVÉ PAR

COFFRET CONVOYEUR D'ENTREE GENDER SORTING

DESSINÉ PAR : DB

VÉRIFIÉ PAR : JT

DATE DE CRÉATION : 09/10/2024

CLIENT : INTERNE

N° CONTRAT : C0

N° PROCESS : PMXA_C0

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tel : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatic.service@ceva.com

ENVIRONNEMENT IGE-XAO : Elec_IEC V5R2_ECATIC Environnement Electricité et Automatismes - CEI

FOLIO : 01/23

Ecat-iD Campus

PAYS :FRANCE

NUMÉRO DE SCHÉMA :SMXA0004-OPT1

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1				INDEX :	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID												FOLIO : 02/23	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A	
																				B	
																				C	
																				D	
																				E	
																				F	
																				G	
																				H	
																				I	
																				J	
																				K	
																				L	
																				M	
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36			Date of creation : 09/10/2024		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38			Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
						E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 03/23		

[illegible][illegible]


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1				INDEX :	
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID										FOLIO : 04/23					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1				INDEX :	
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 05/23					


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

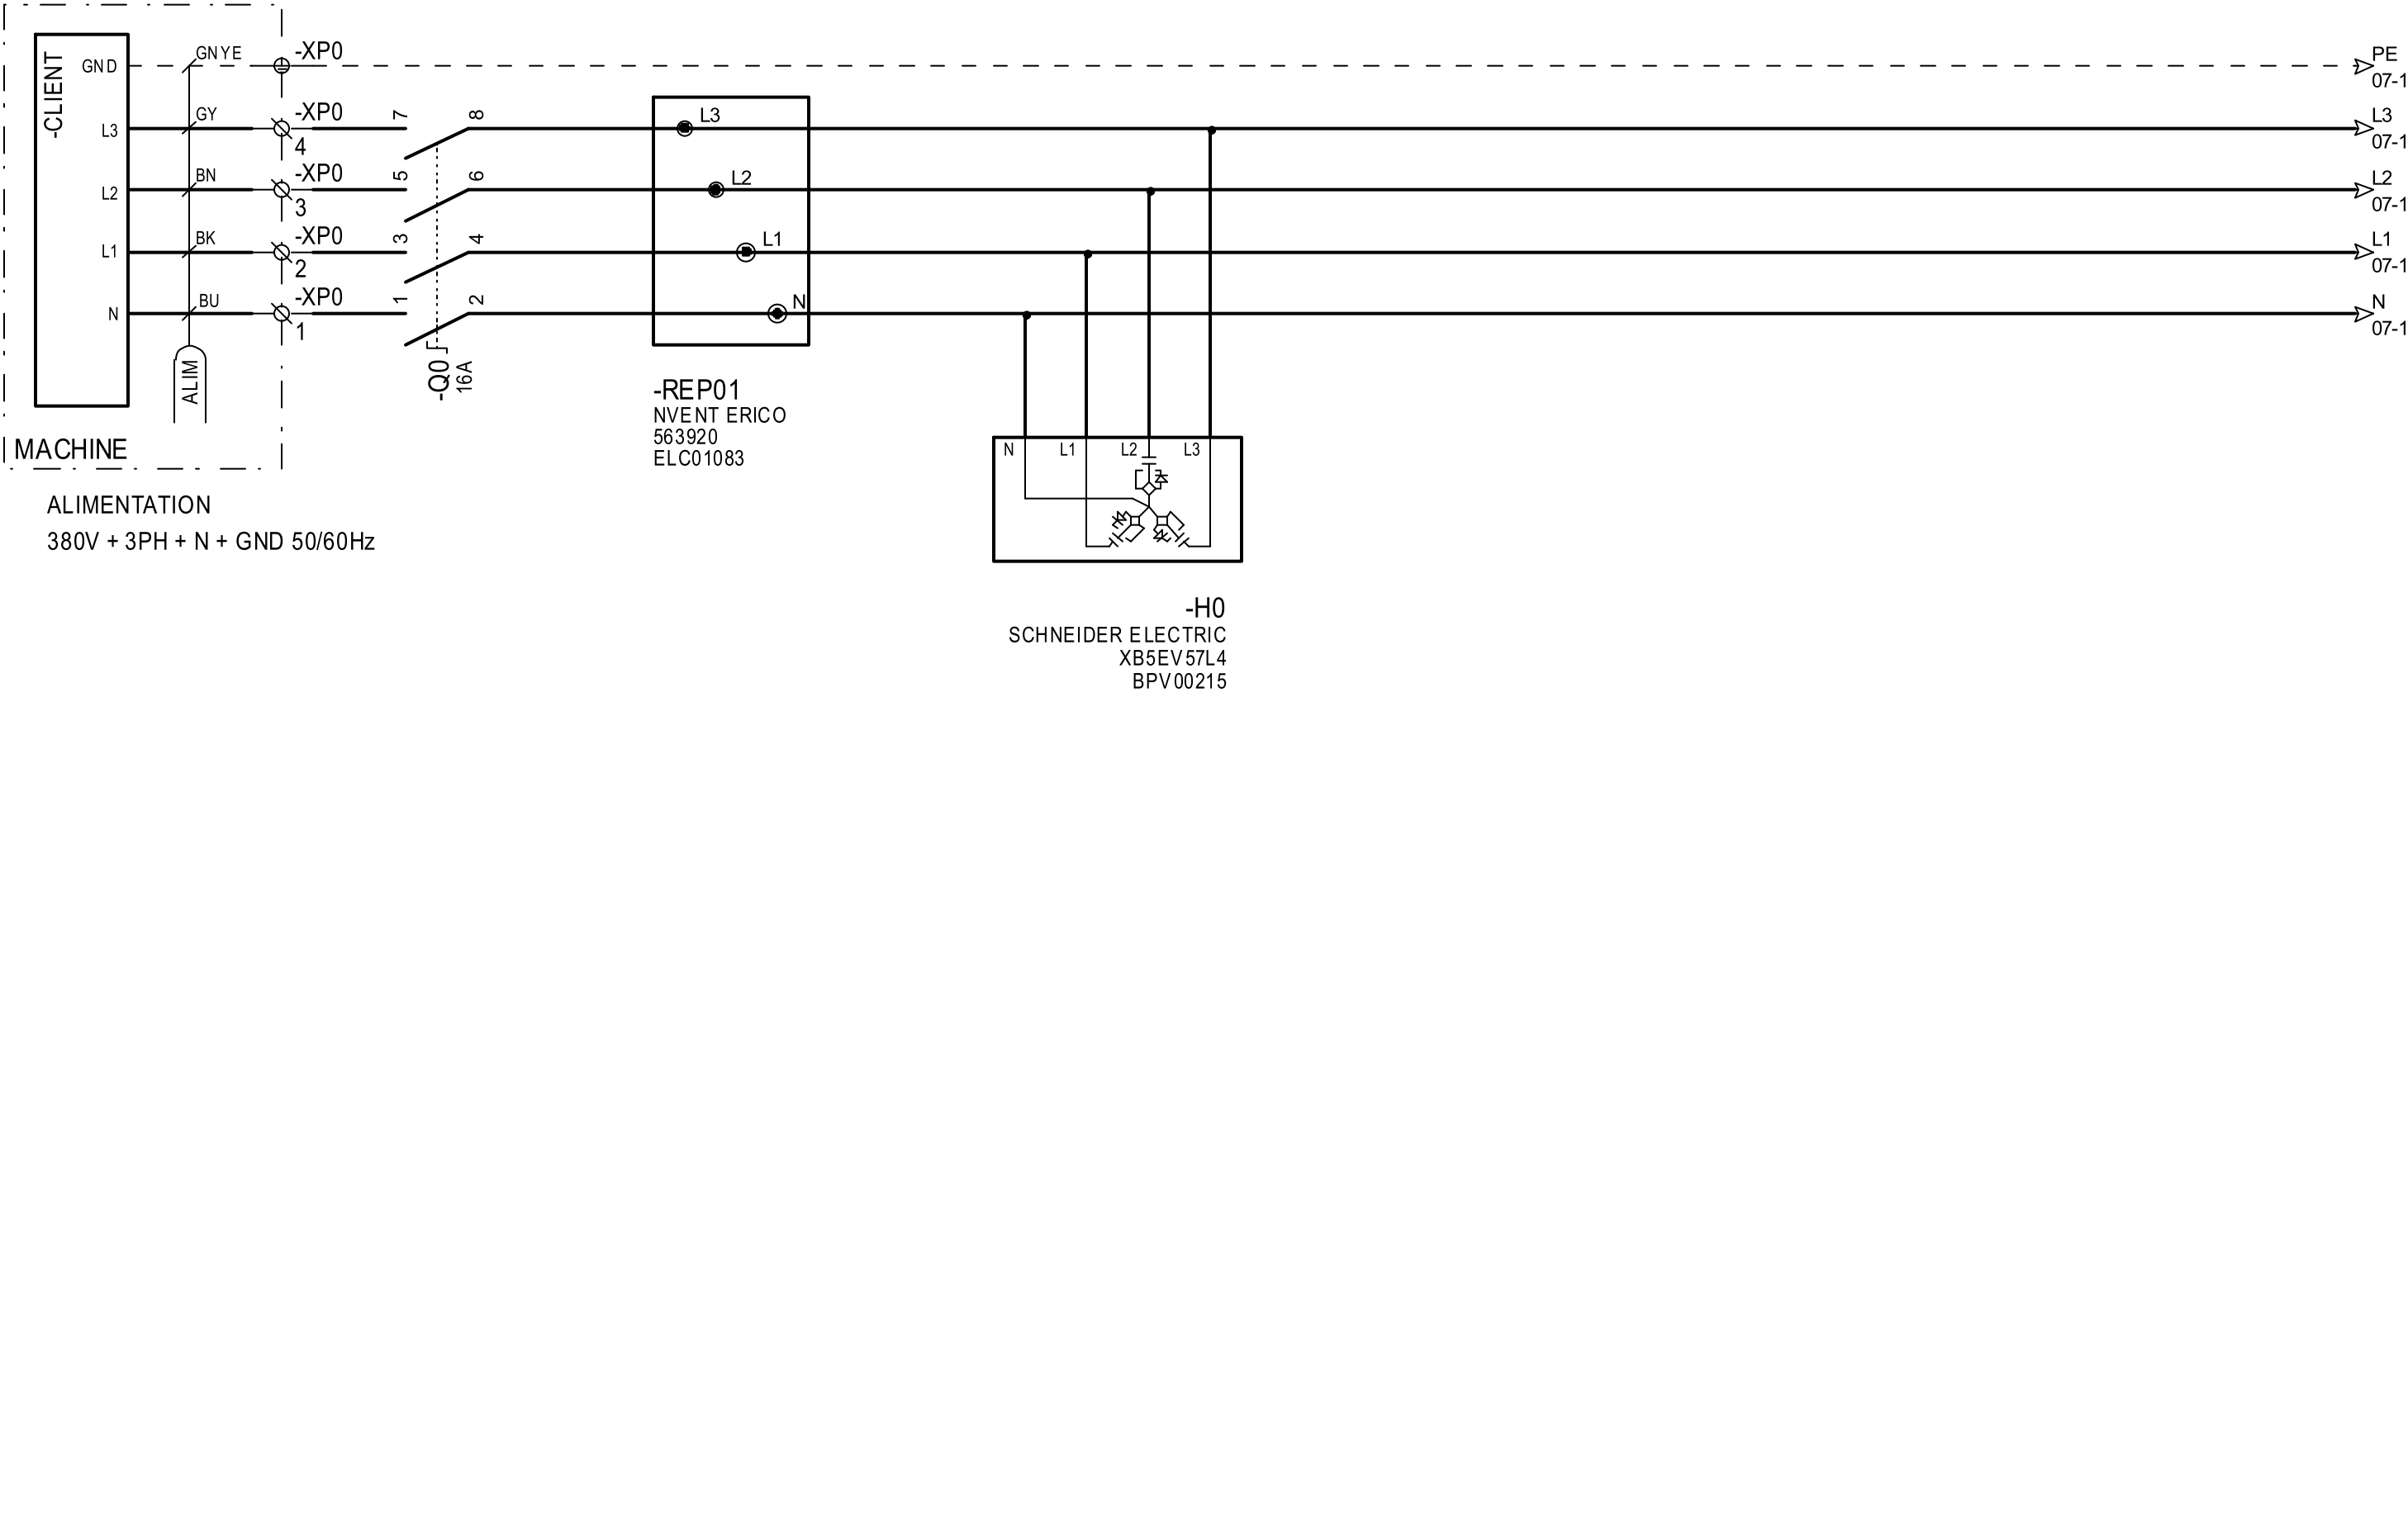


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		SCHEMA DE PUISSANCE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX : FOLIO : 06/23			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID													

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

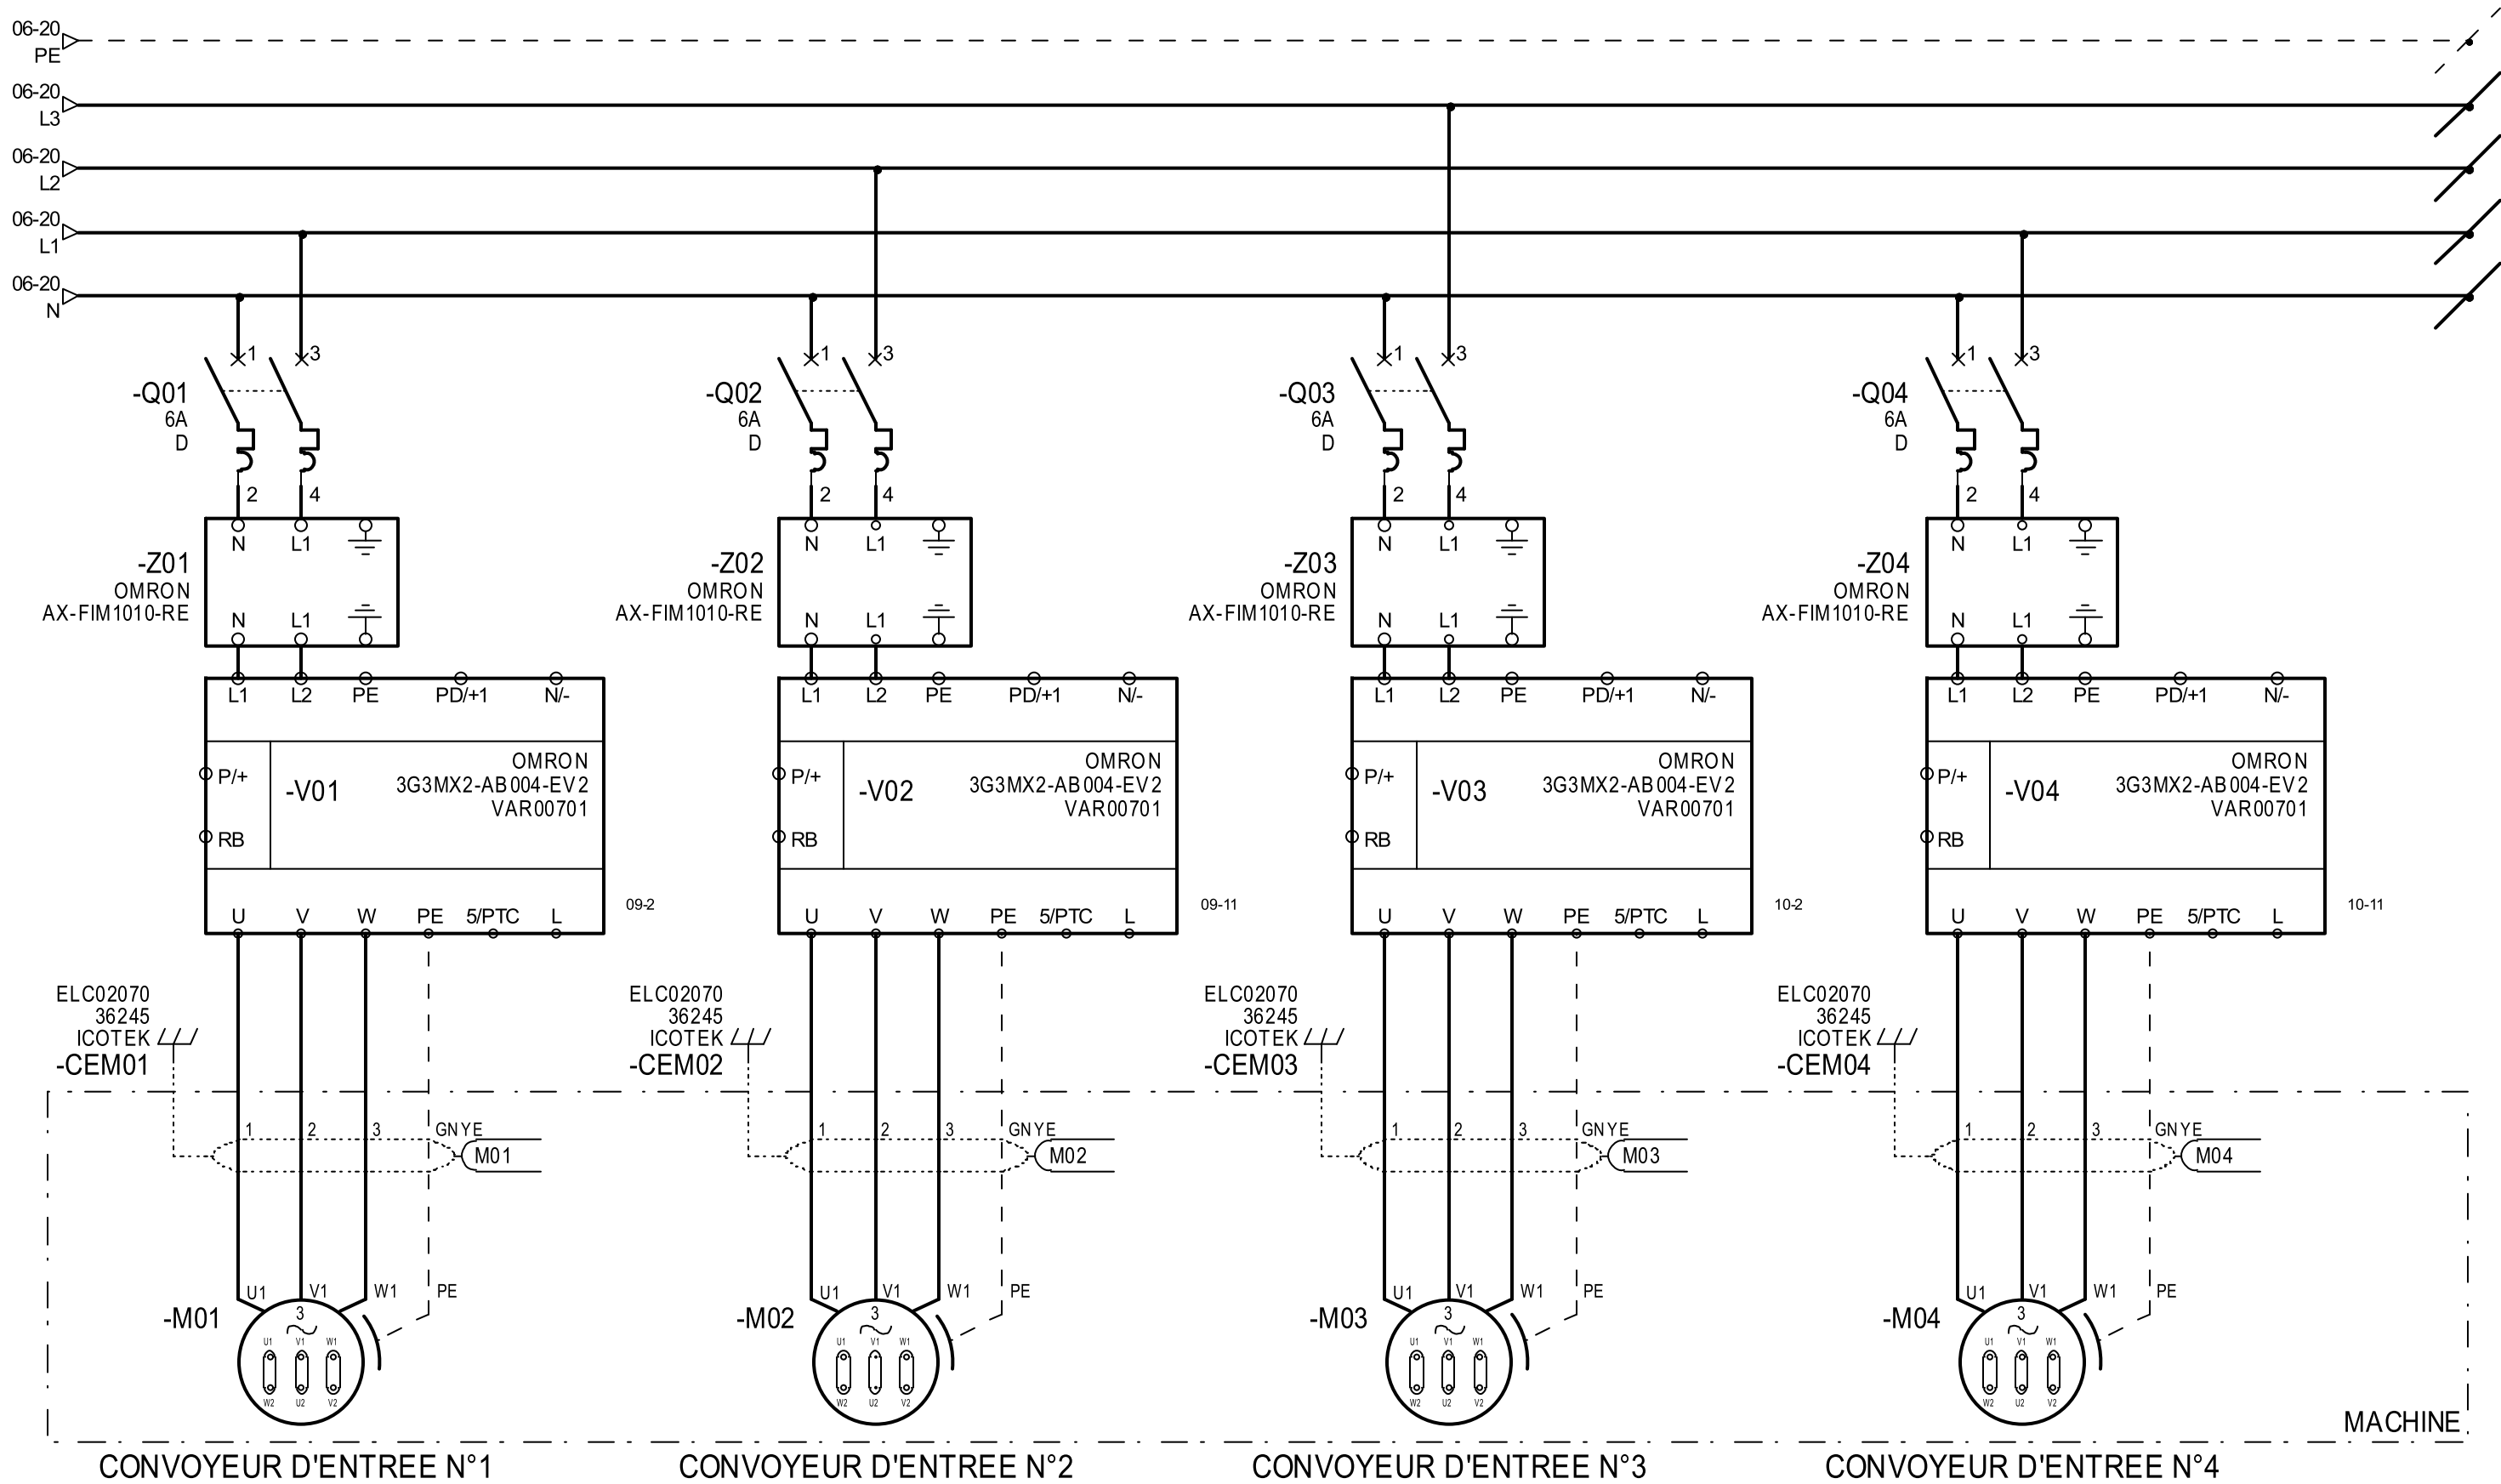


ARMOIRE				230/400V 50/60 Hz				230/400V 50/60 Hz				230/400V 50/60 Hz									
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE				Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		SCHEMA DE PUISSANCE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
				Fax : (33).2.98.85.31.38		Designed by : DB														INDEX :	
				E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								ARTICLE : SMXA0004-OPT1				FOLIO : 07/23	

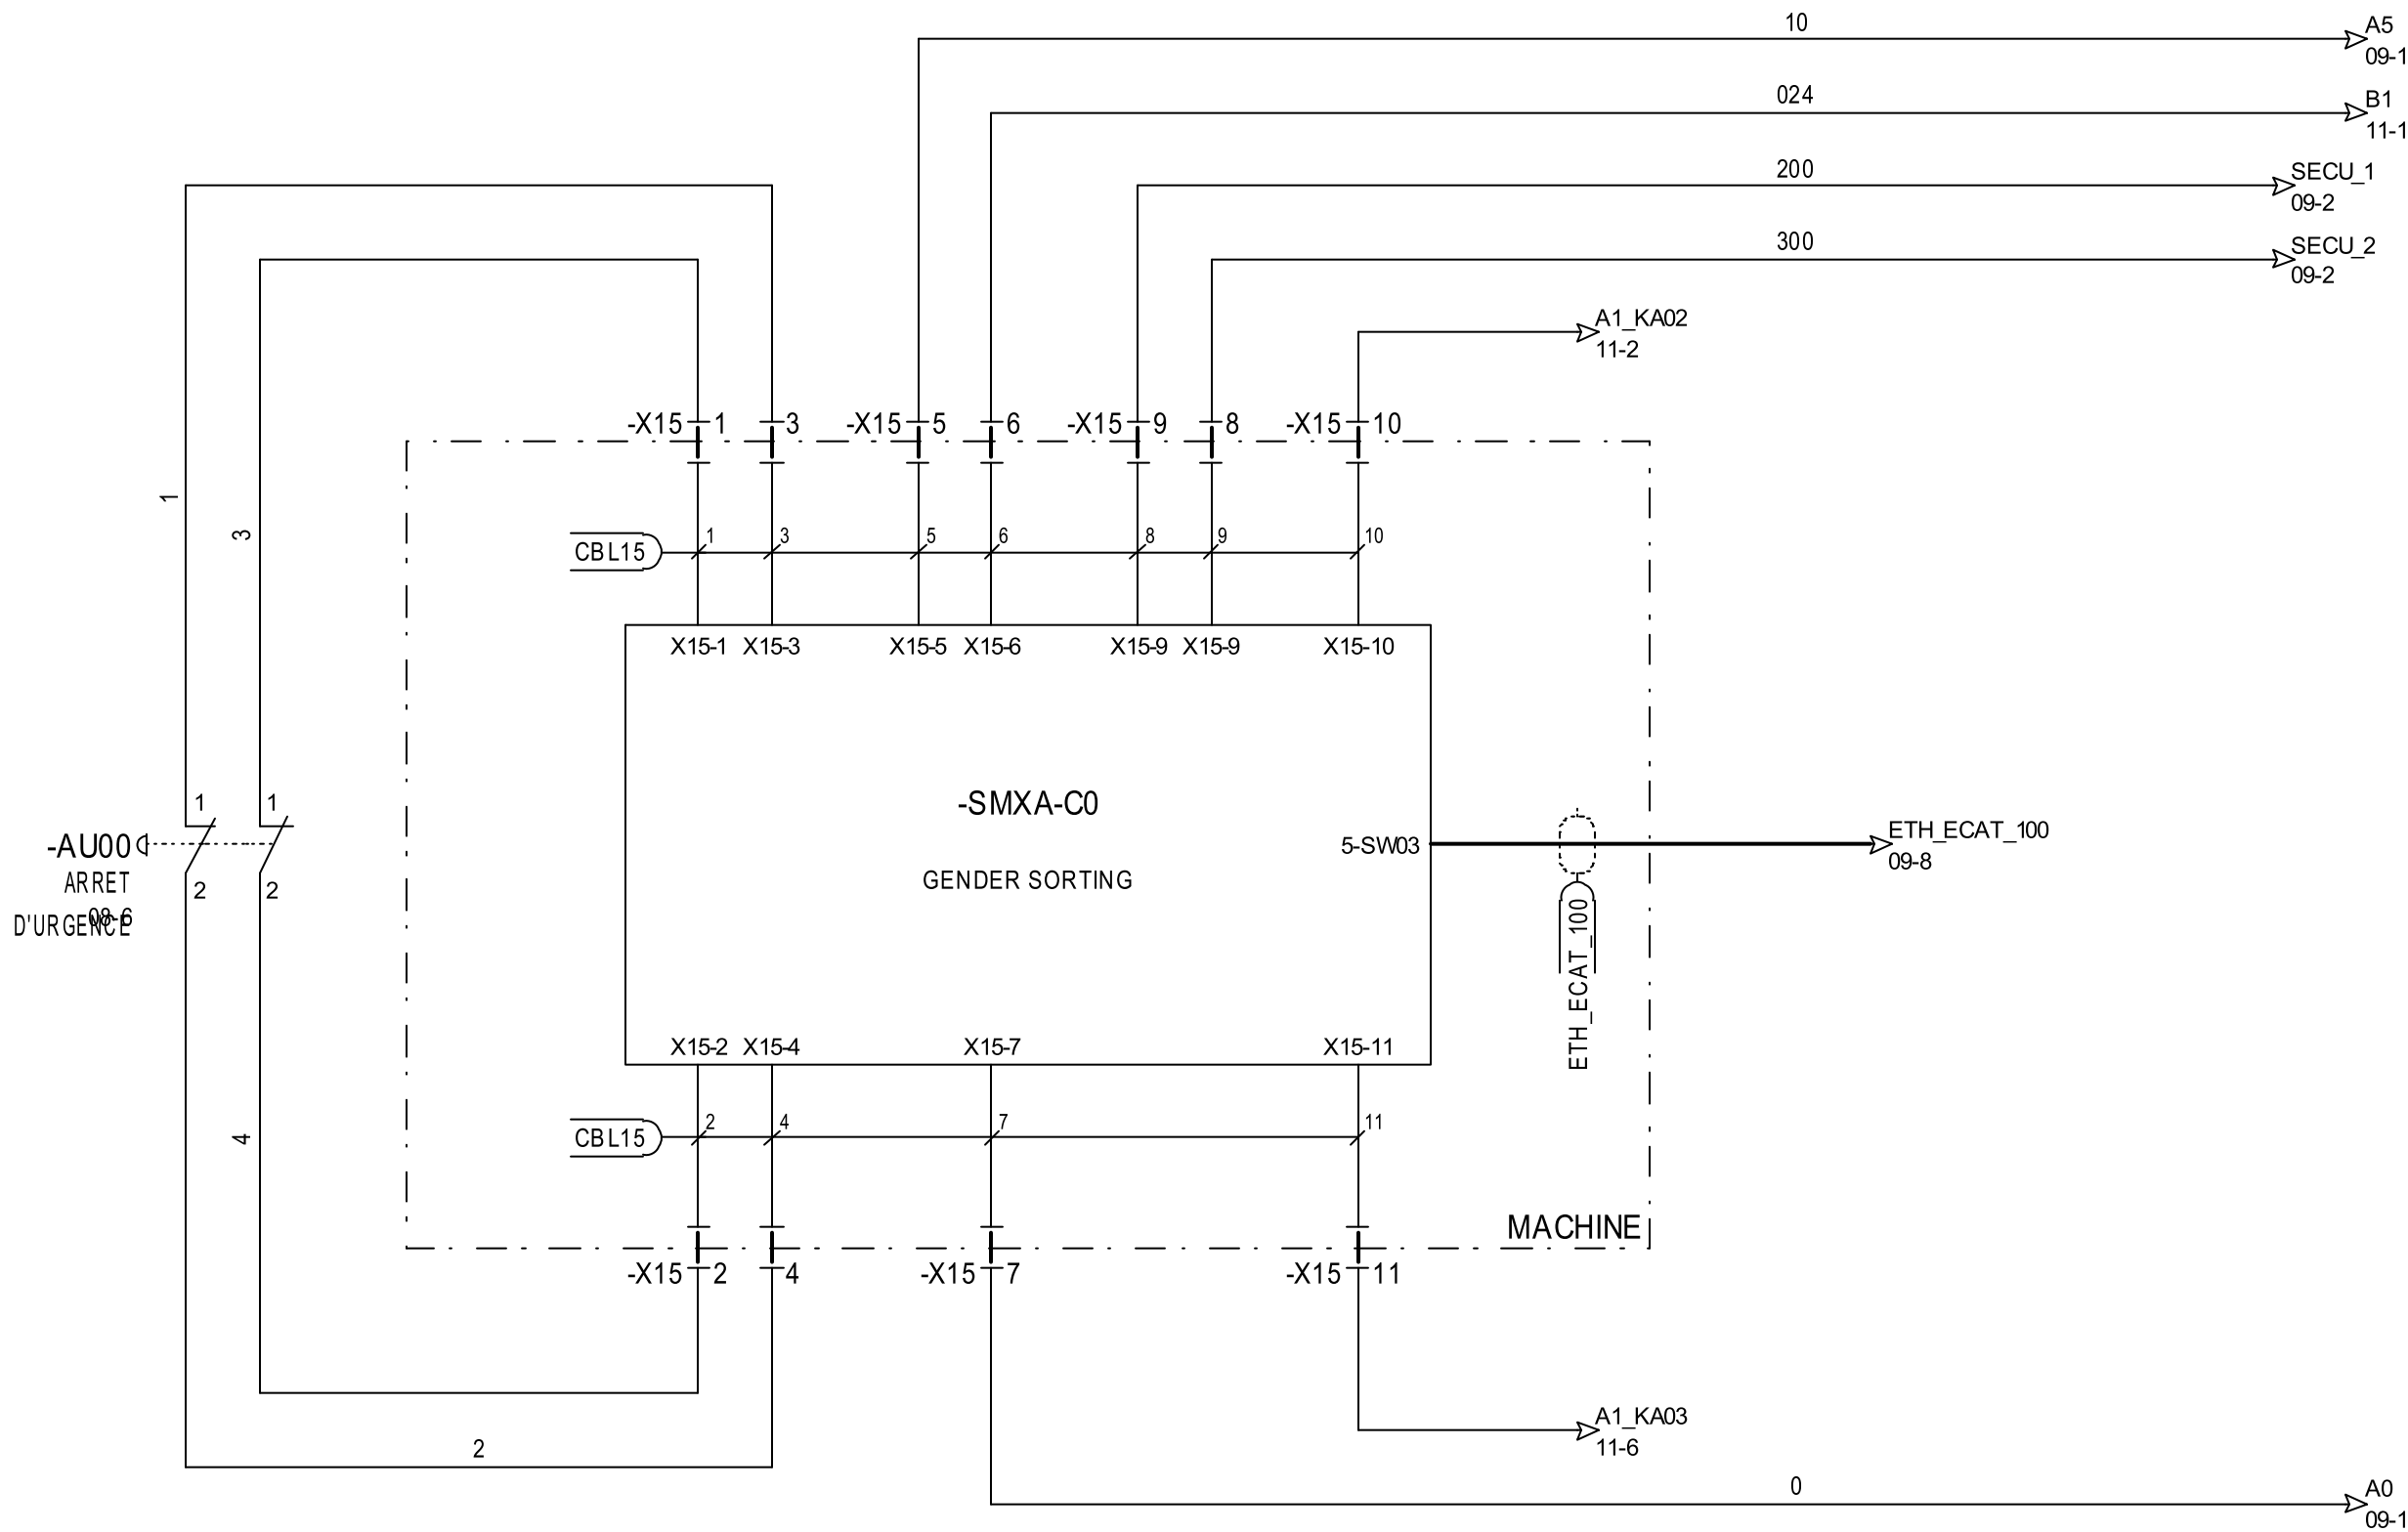

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID										FOLIO : 08/23			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

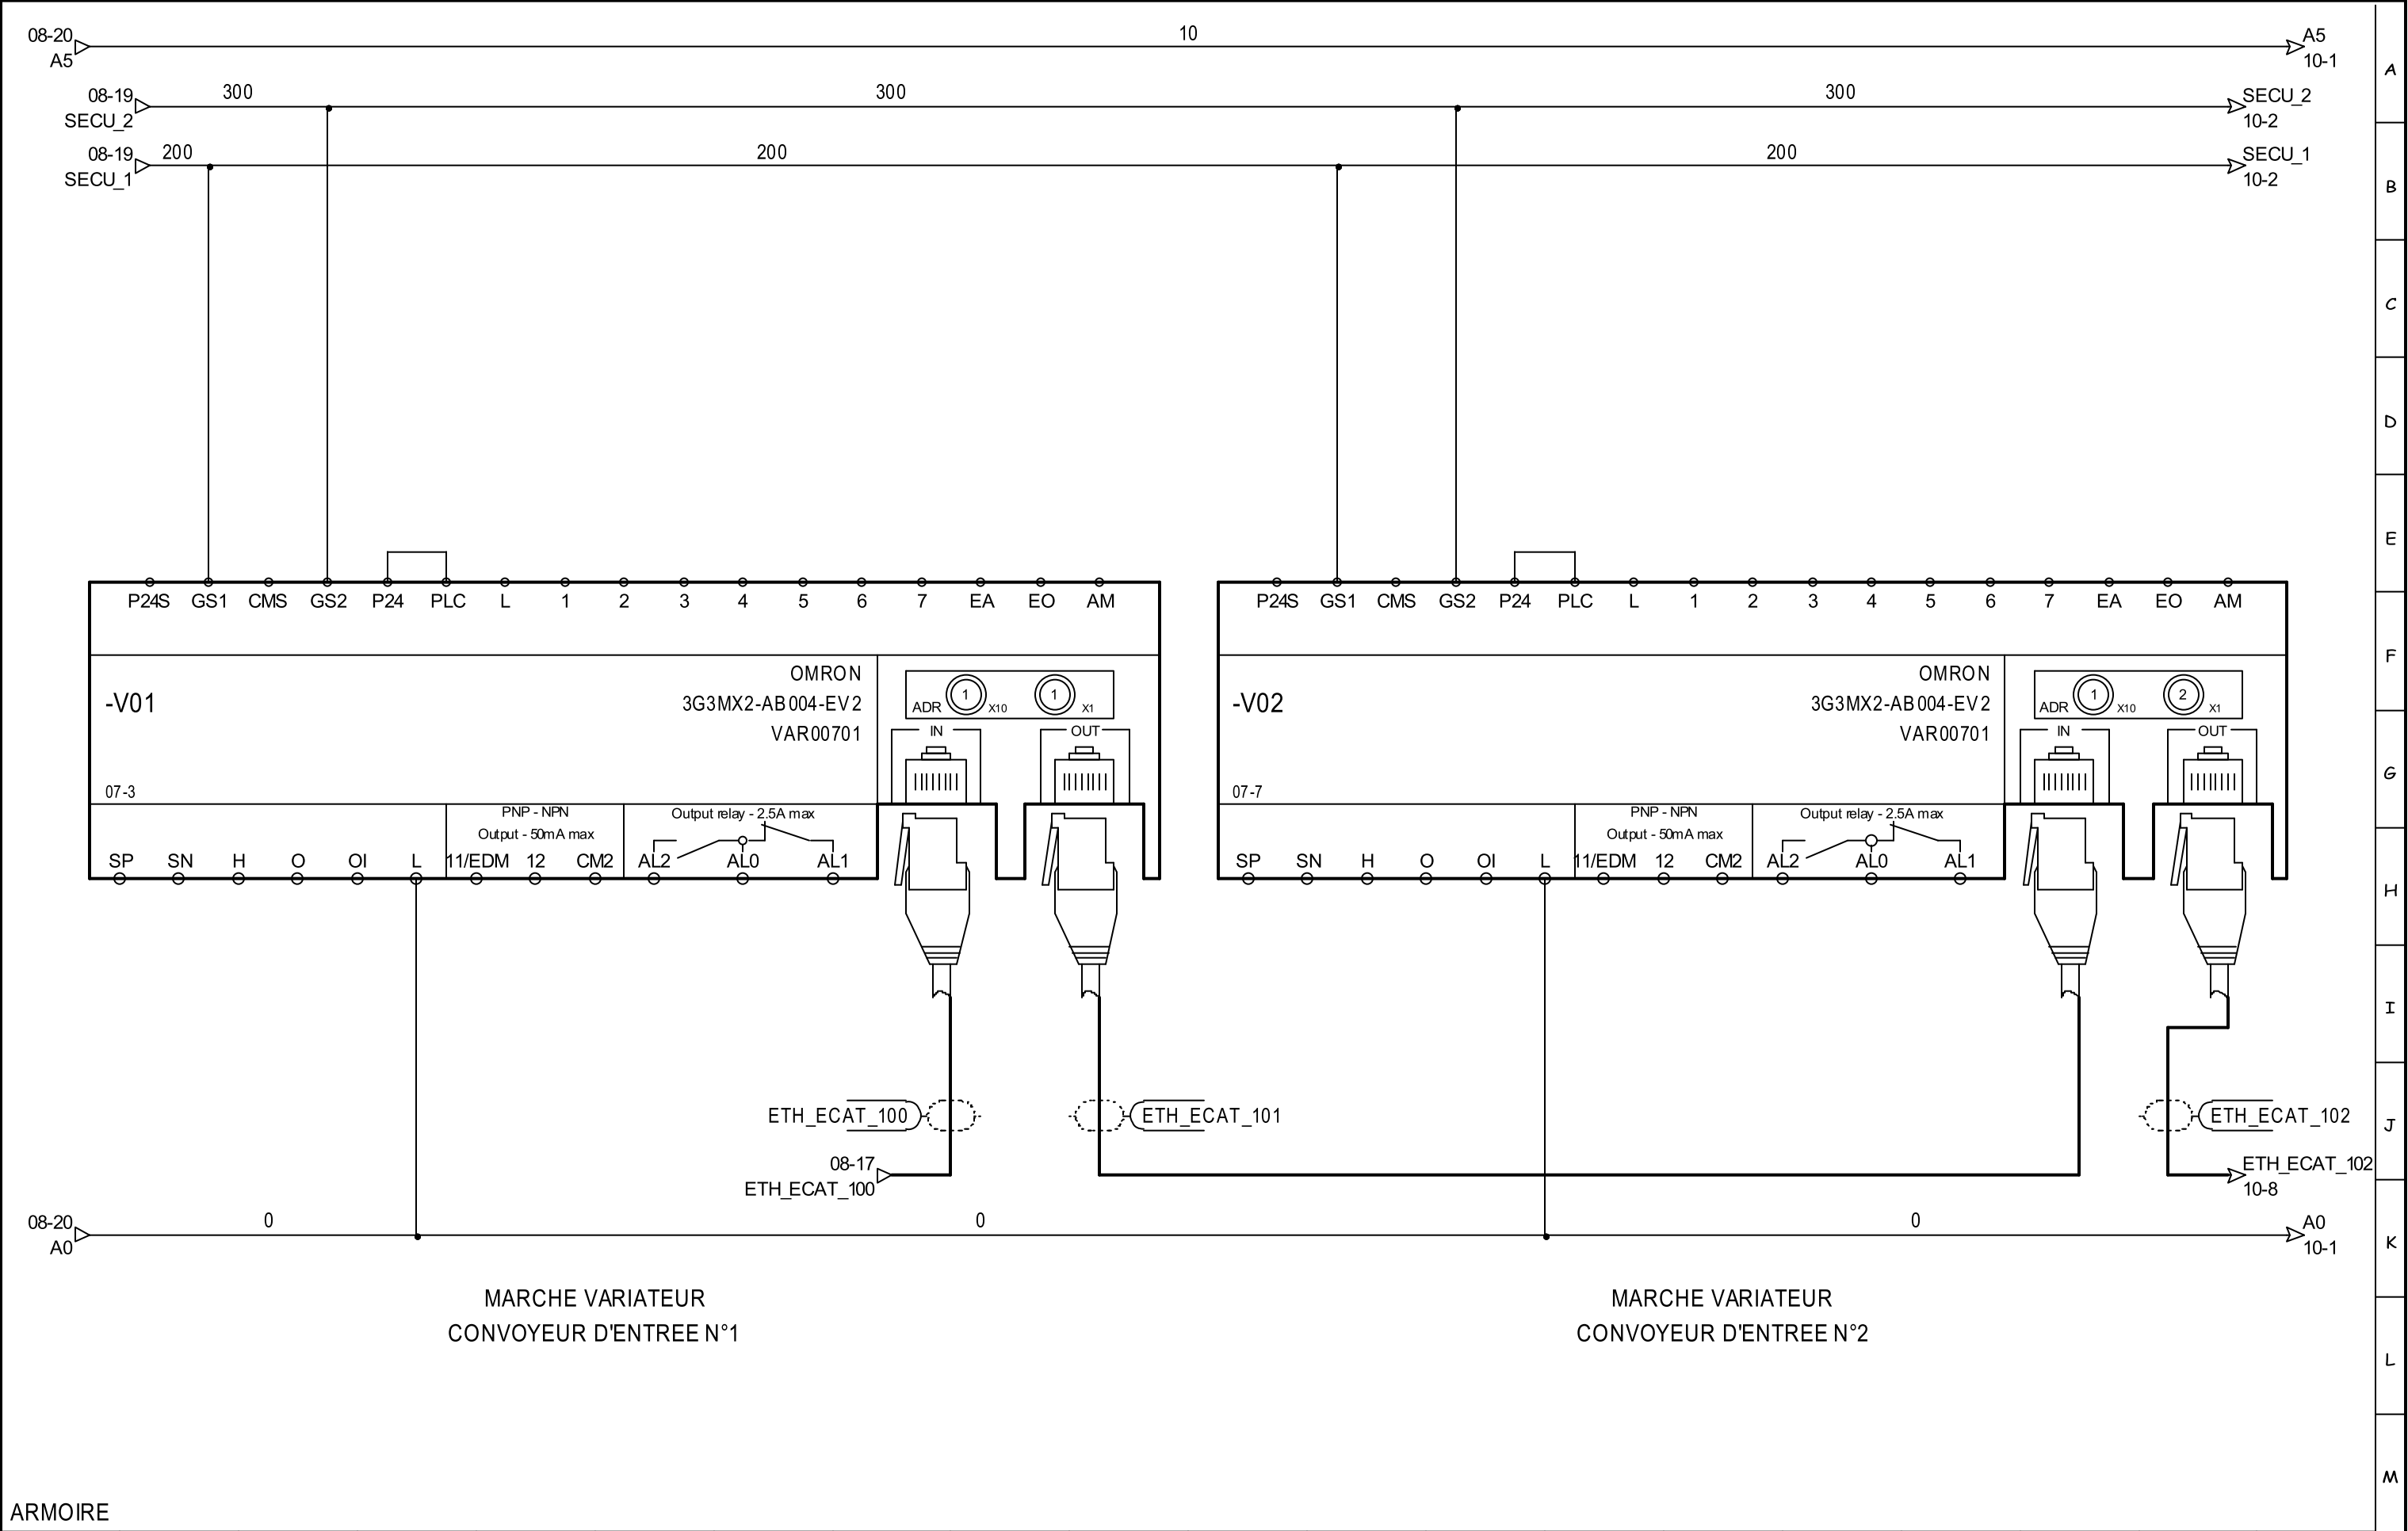

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID										FOLIO : 09/23			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

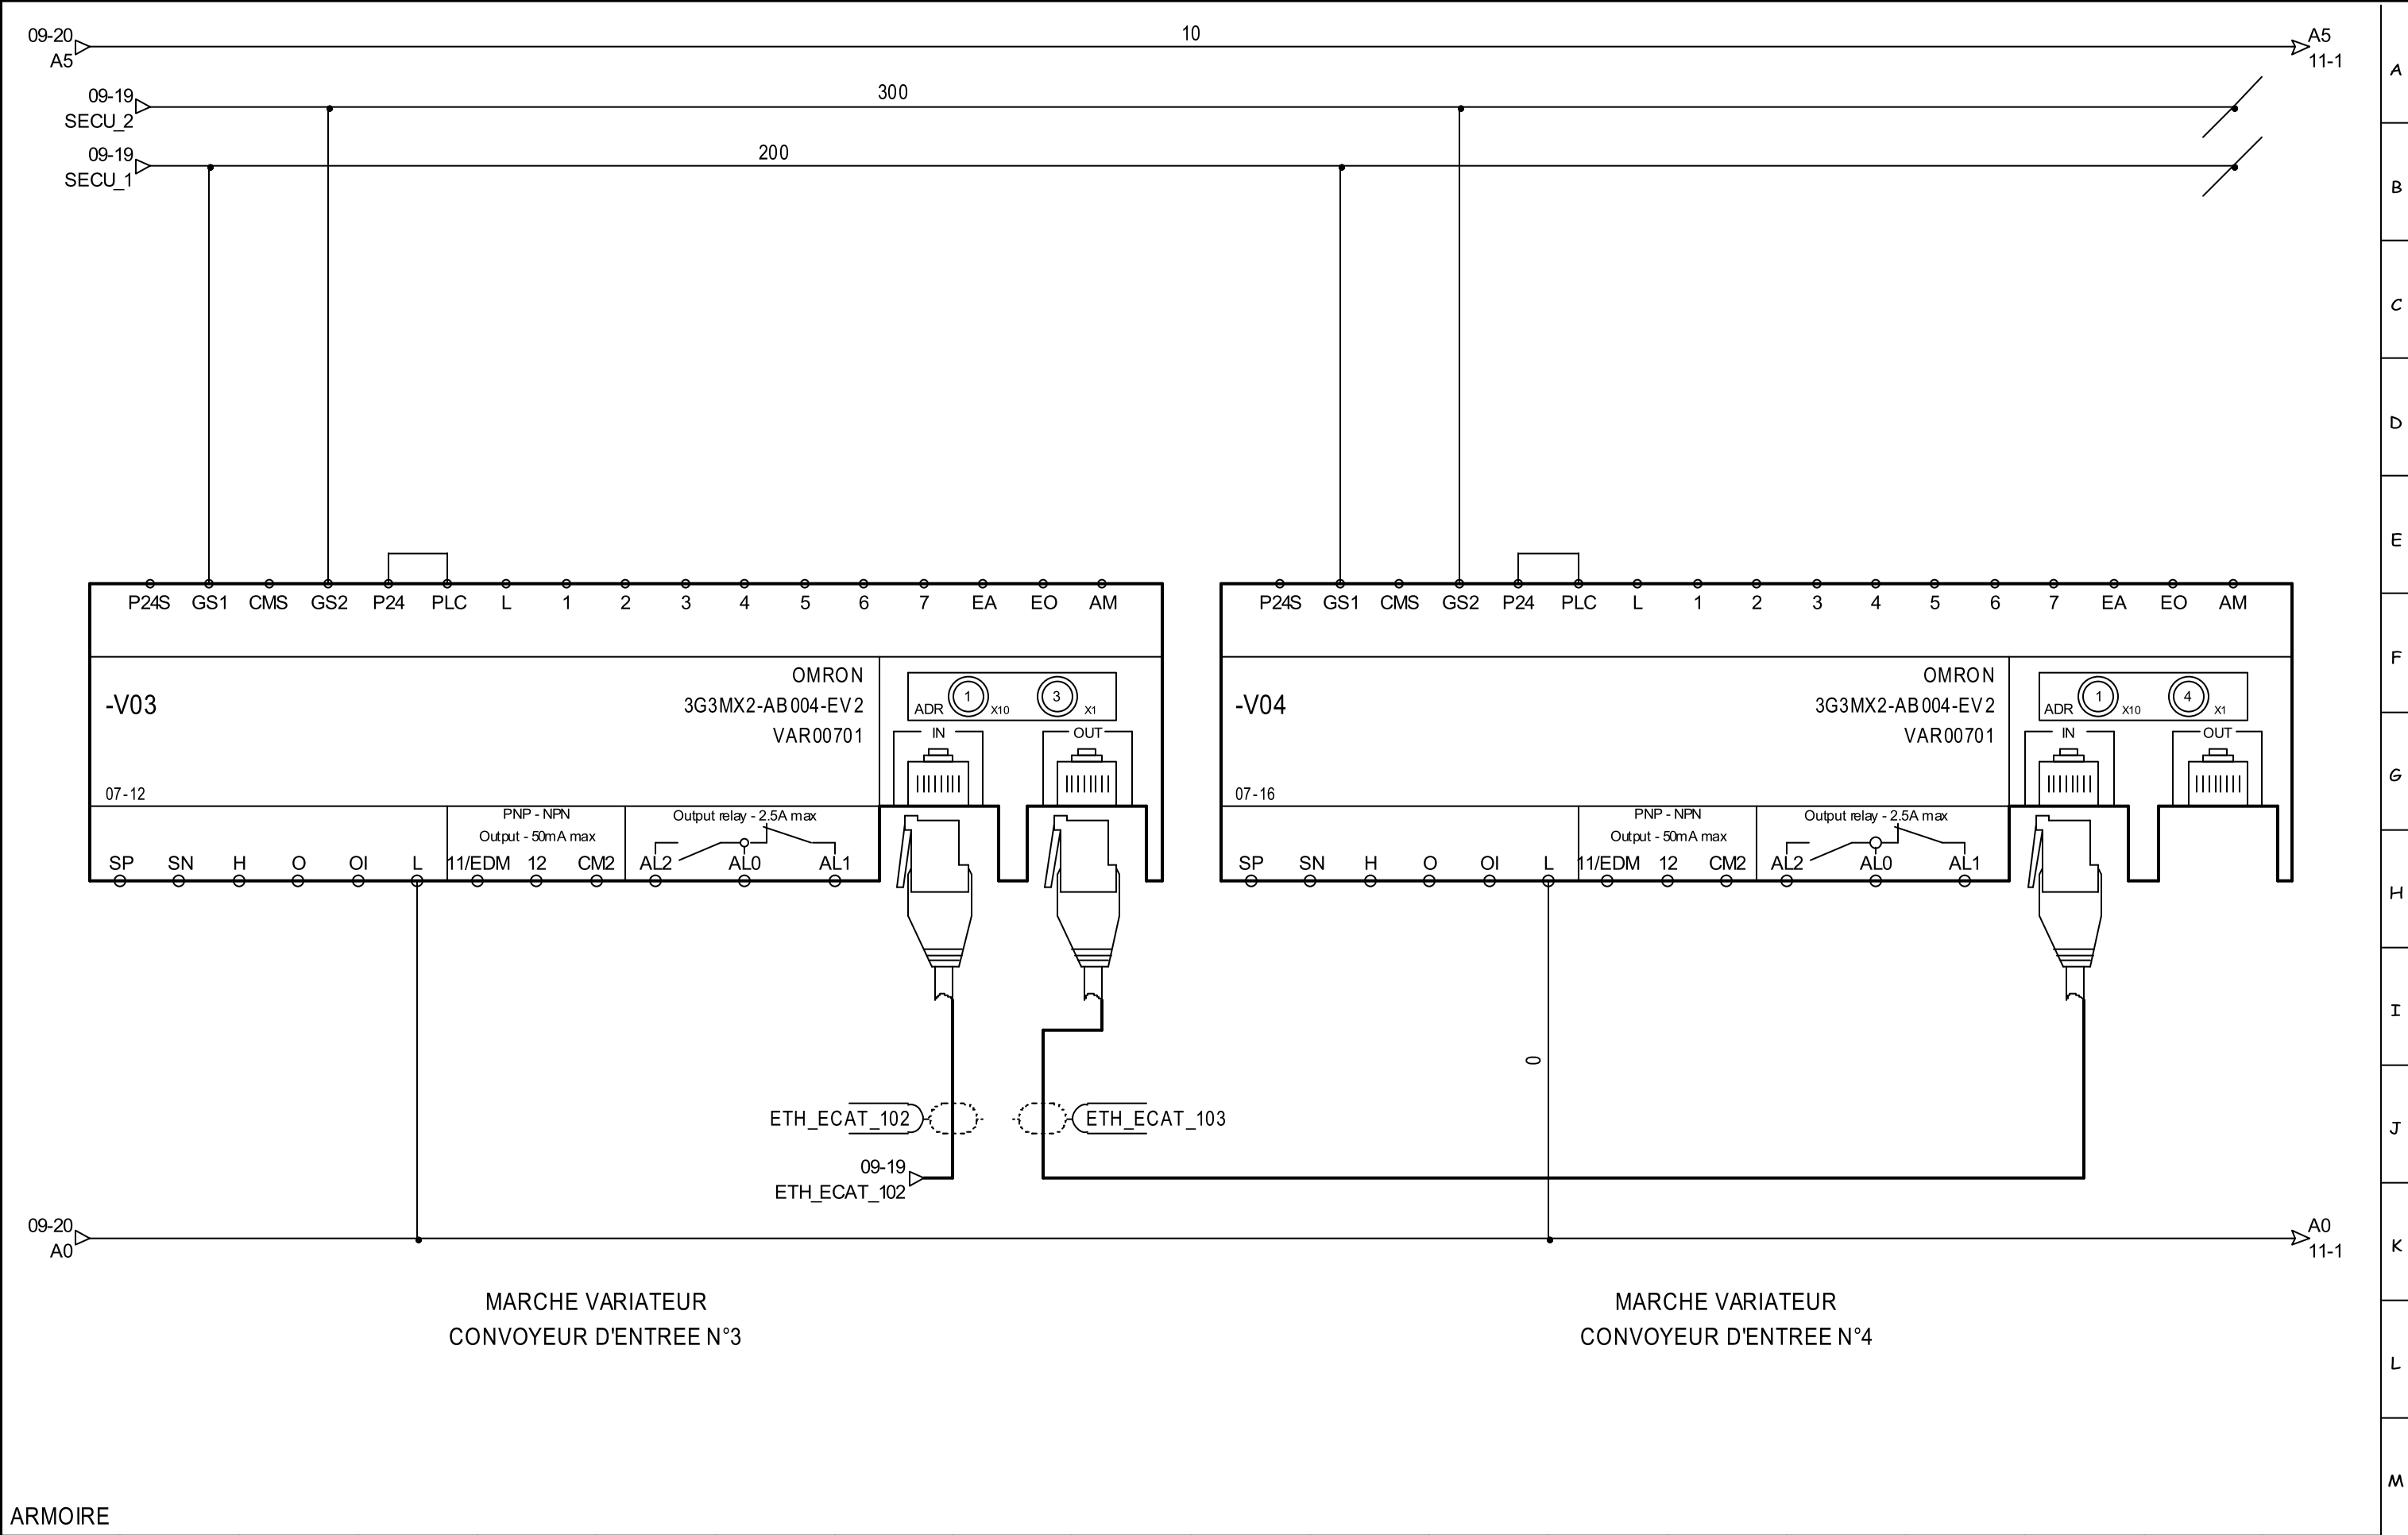


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 10/23					



Ecat-iD Campus


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

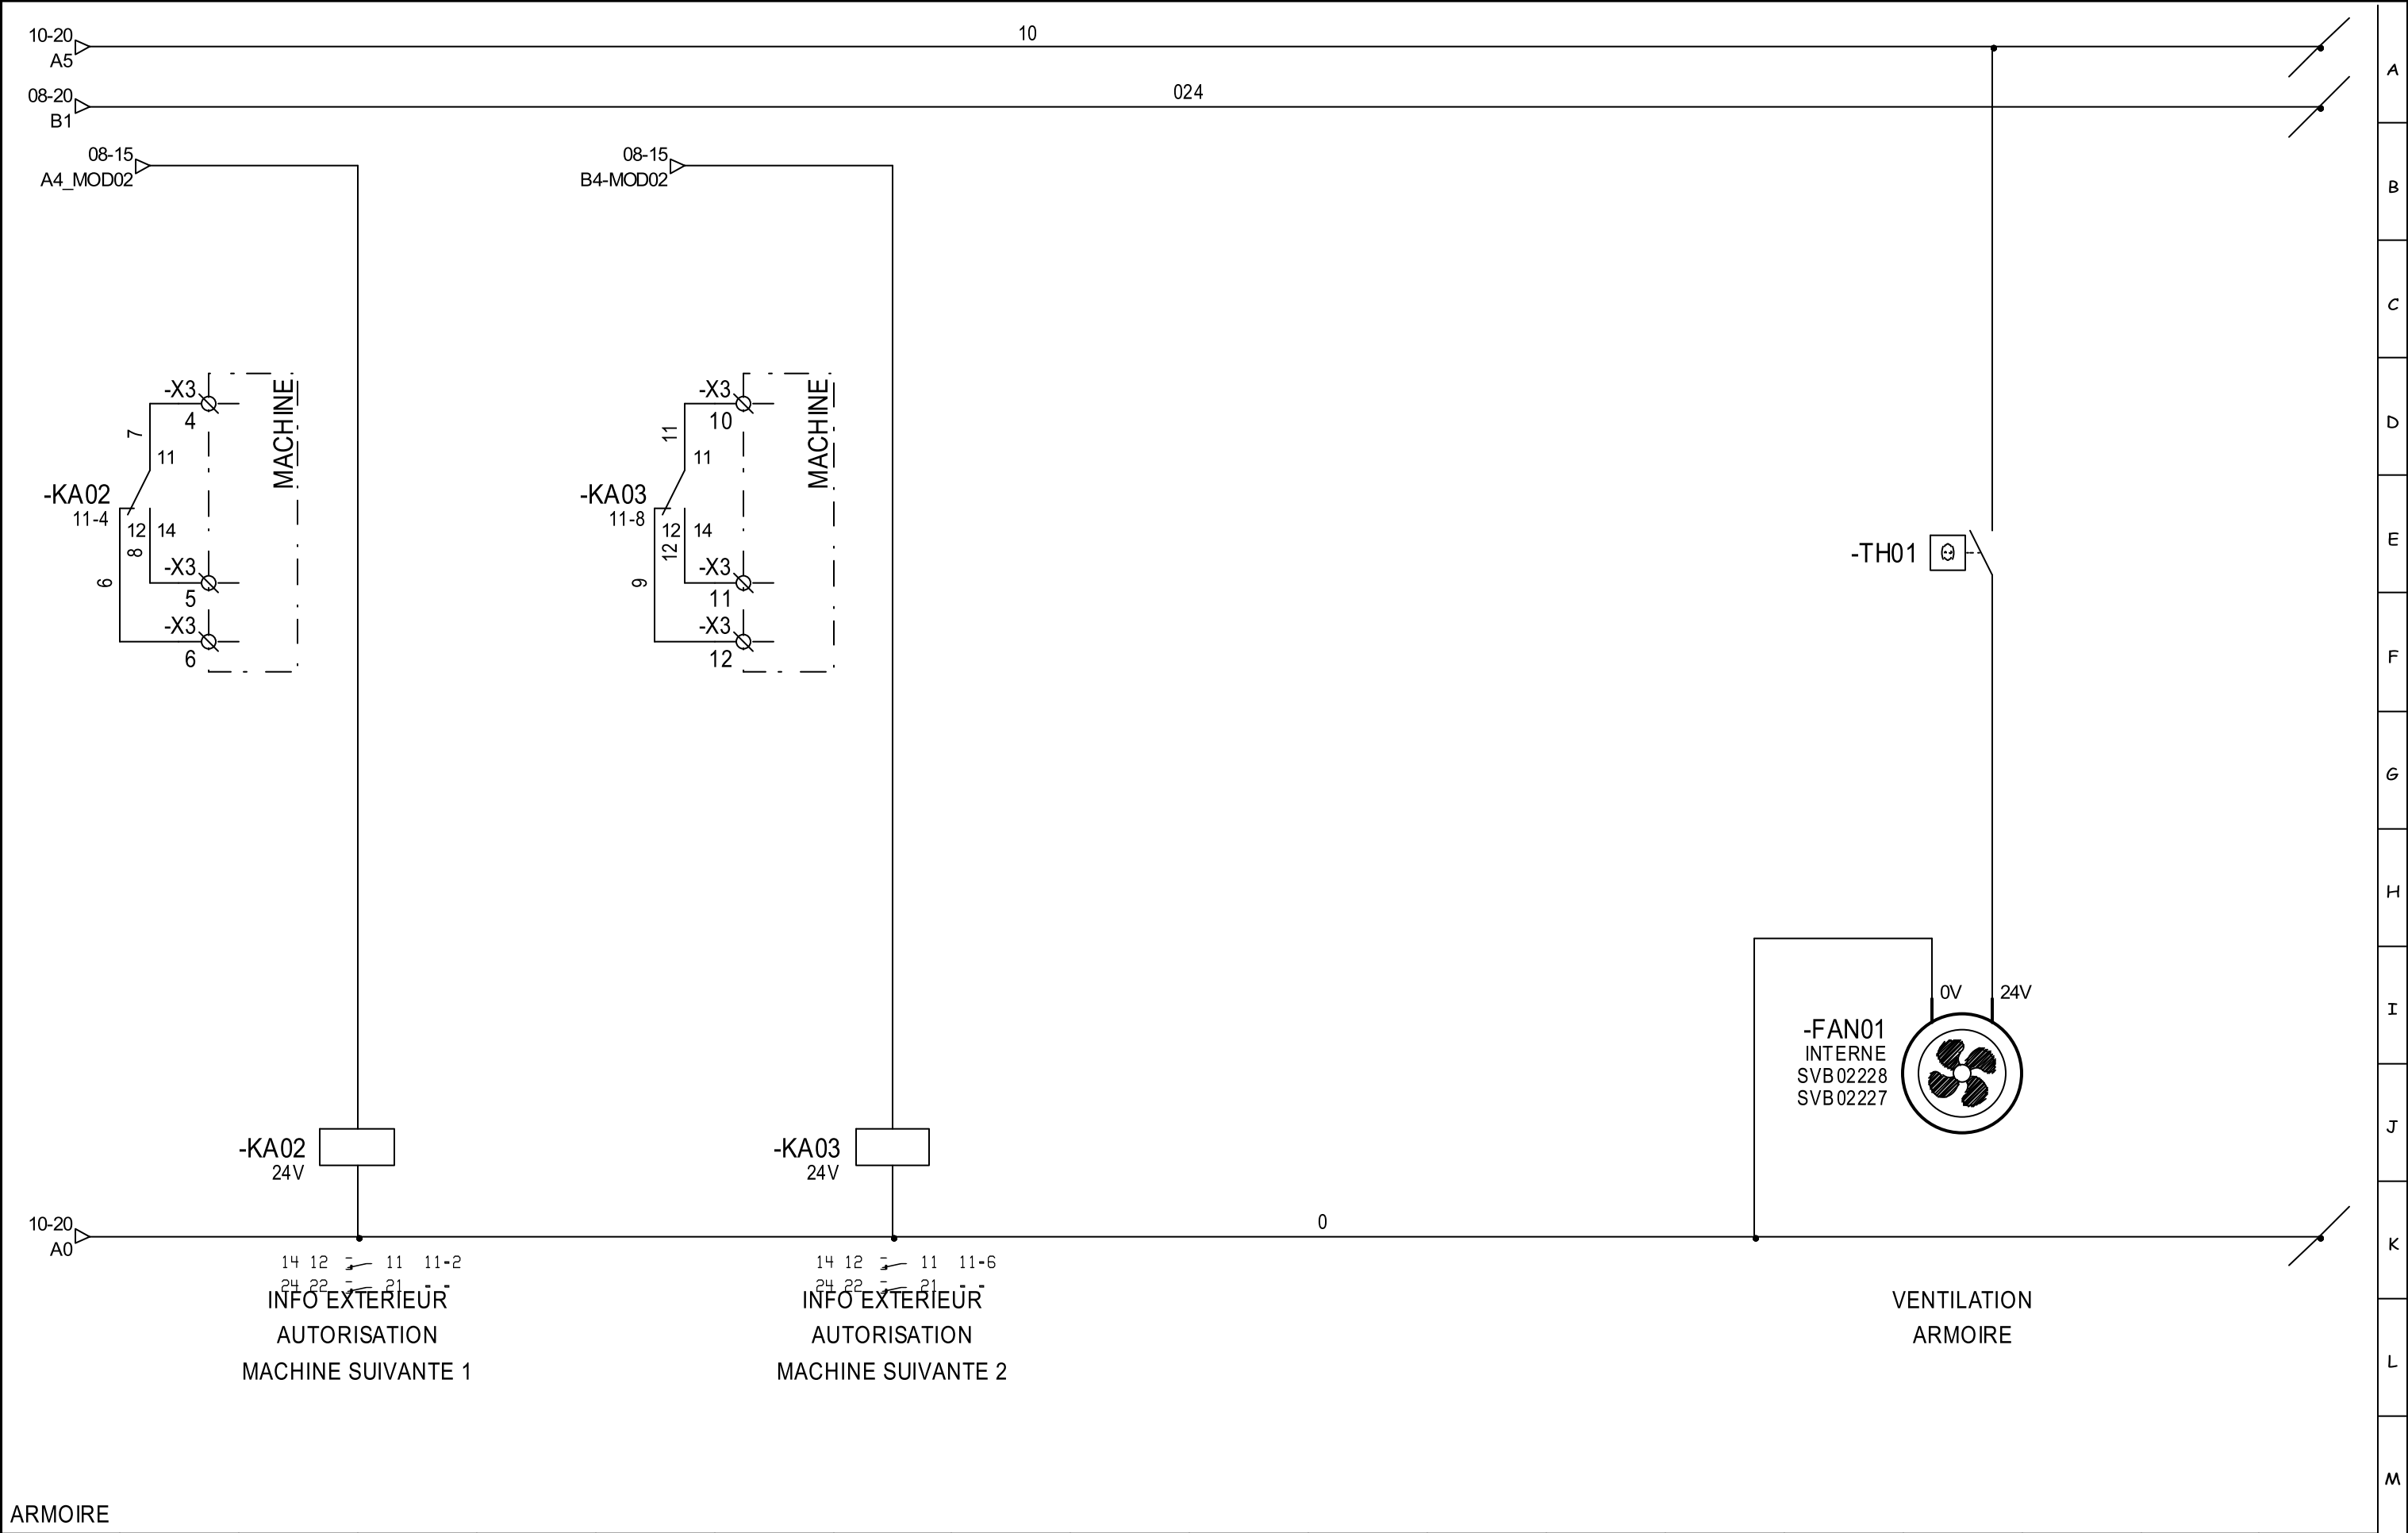

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 11/23					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE PUISSANCE : XP0

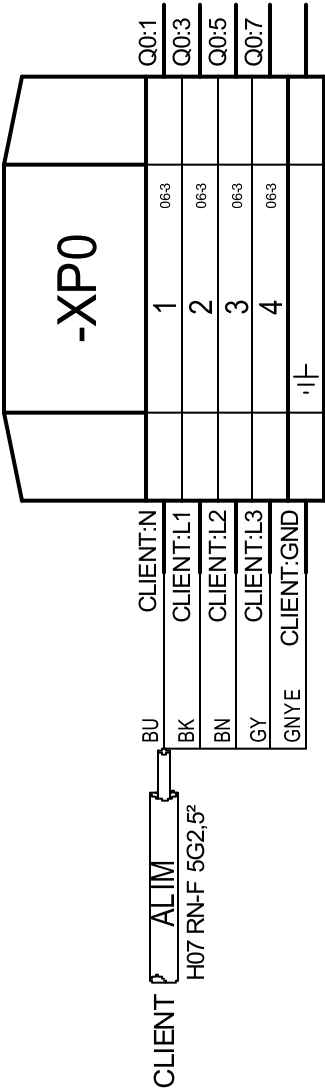


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		BORNIER : XP0			 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB		XP0							ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Elec_IEC V5R2_ECATID						FOLIO : 12/23					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X3

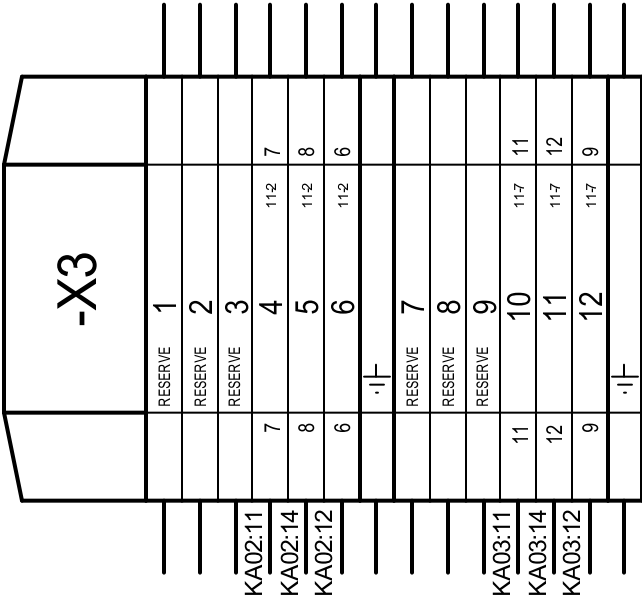


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE		Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		BORNIER : X3				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
		Fax : (33).2.98.85.31.38		Designed by : DB		X3								ARTICLE : SMXA0004-OPT1				INDEX :	
		E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 13/23					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : X15

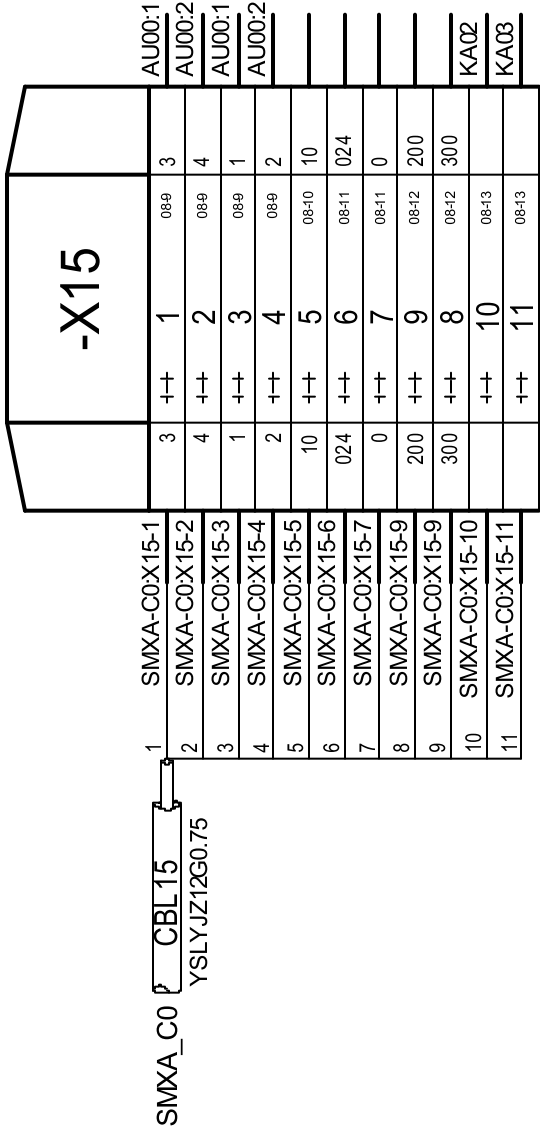


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		BORNIER : X15			 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB									X15			ARTICLE : SMXA0004-OPT1		INDEX : FOLIO : 14/23
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID												

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACADE ARMOIRE

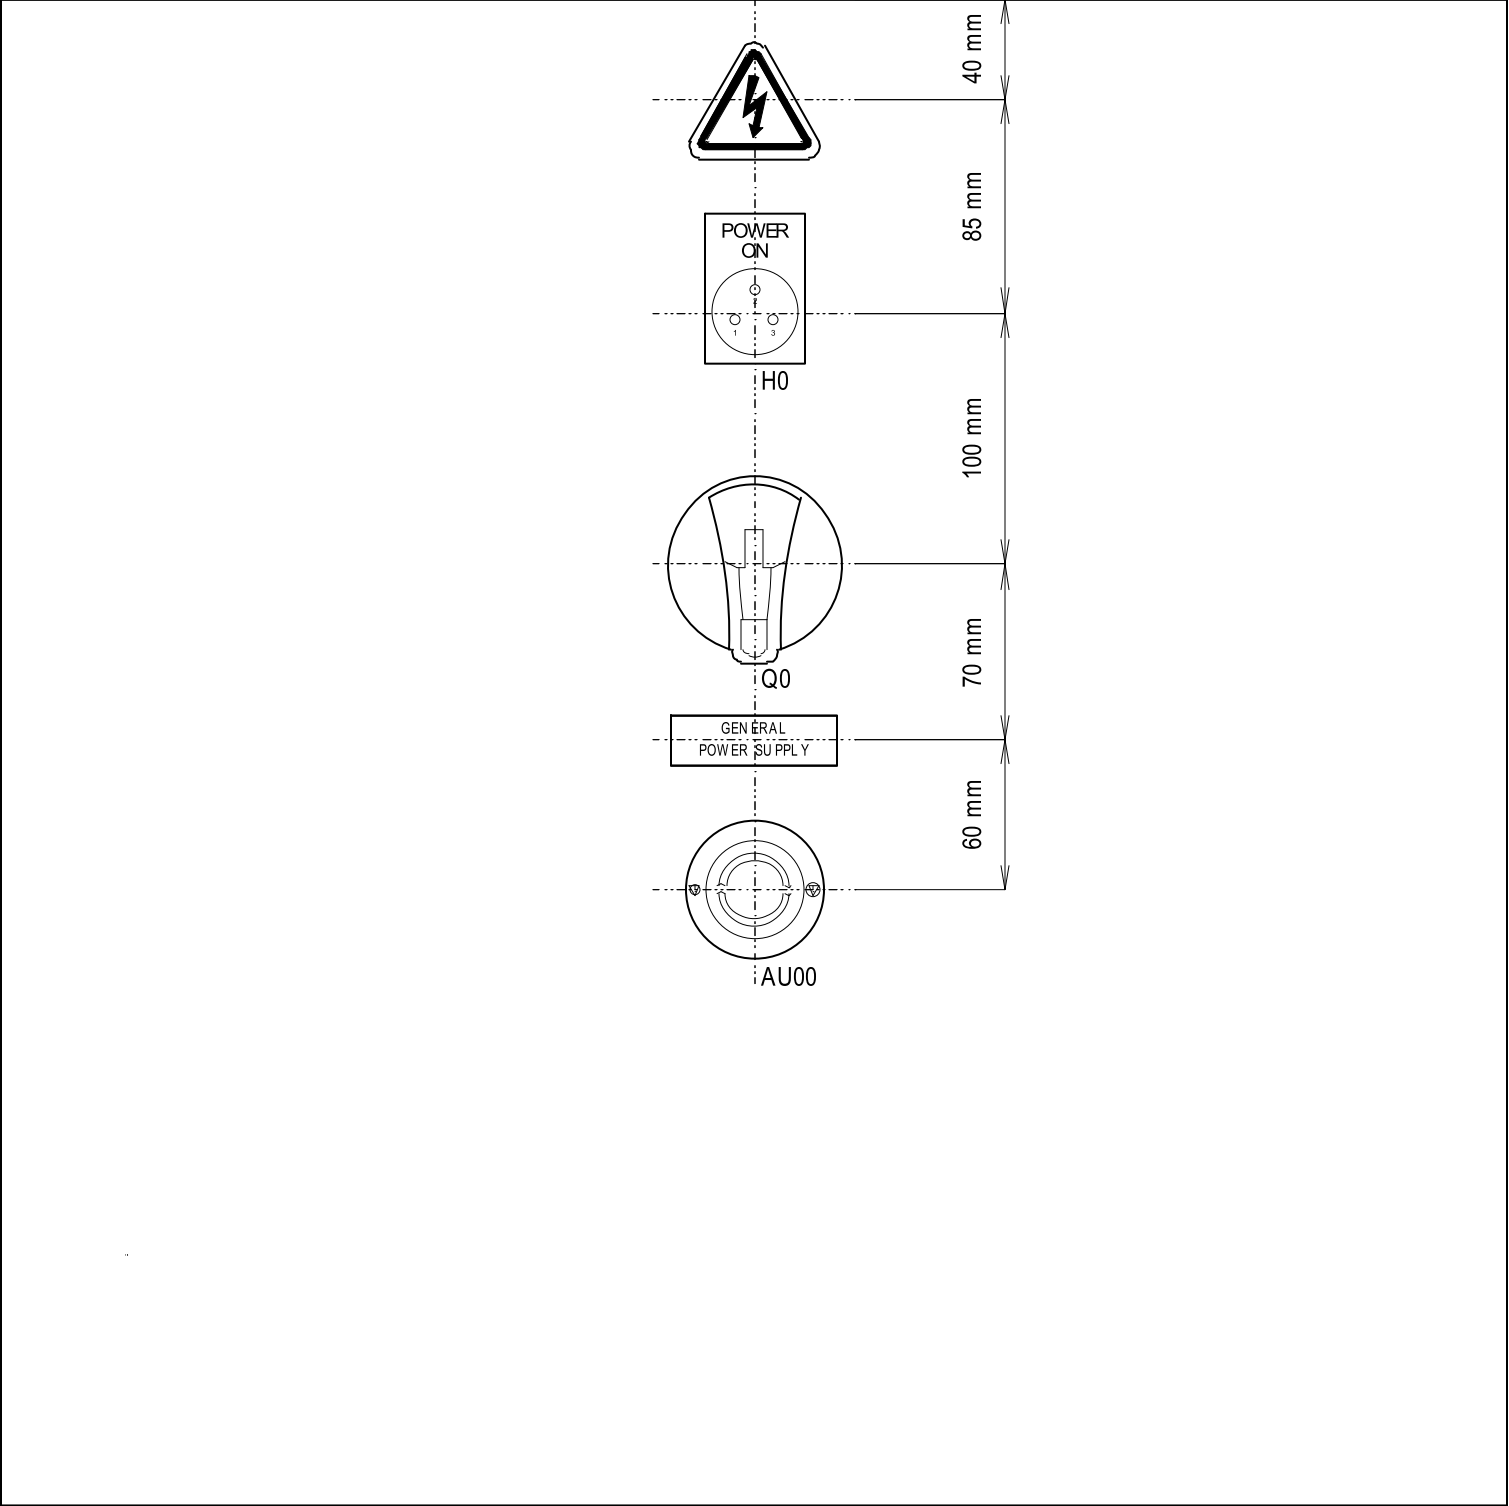

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

Date of creation :
09/10/2024
Designed by :
DB

IMPLANTATION FACADE ARMOIRE
ENVIRONNEMENT : Elec_IEC V5R2_ECATID



CONTRACT :
C0

CUSTOMER :
INTERNE



ARTICLE :
SMXA0004-OPT1

COUNTRY :
FRANCE

INDEX :
FOLIO : 15/23

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION COTE ARMOIRE

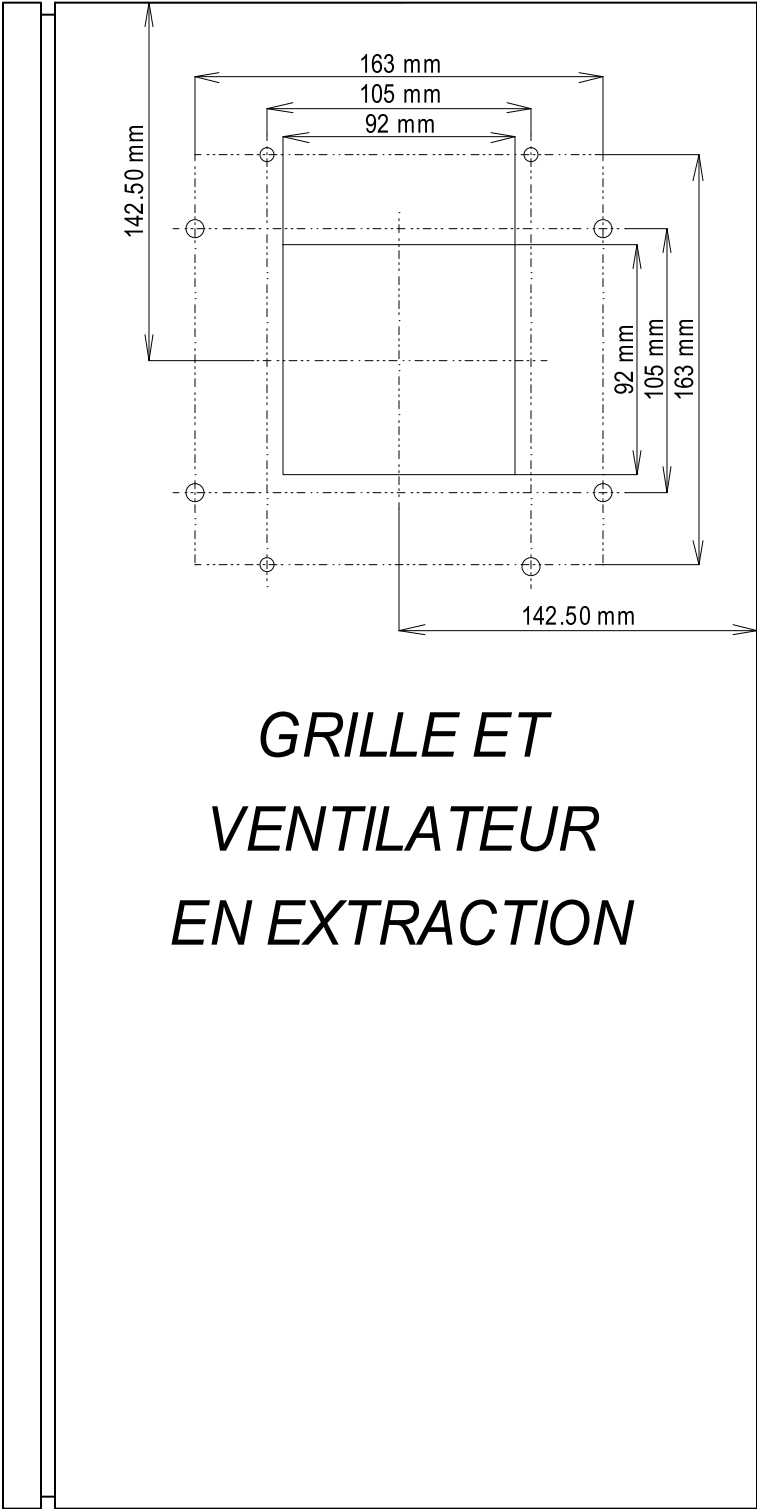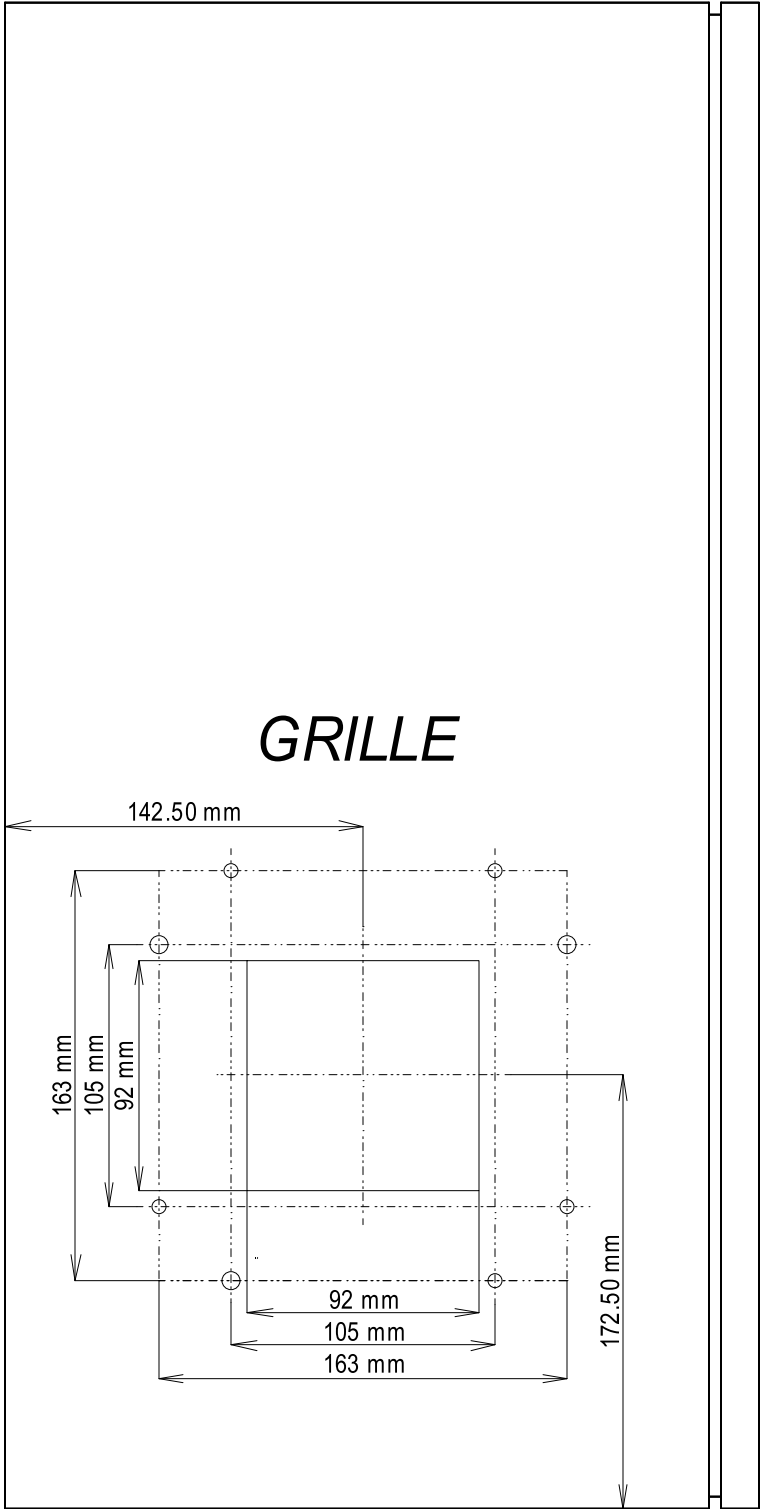

ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

Date of creation :
09/10/2024
Designed by :
DB

IMPLANTATION COTE ARMOIRE
ENVIRONNEMENT : Elec_IEC V5R2_ECATID



CONTRACT :
C0

CUSTOMER :
INTERNE

COUNTRY :
FRANCE

ARTICLE :
SMXA0004-OPT1

INDEX :
FOLIO :
16/23

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation : 09/10/2024

Designed by : DB

IMPLANTATION PLATINE ARMOIRE



Ecatt-ID Campus

CONTRACT : C0

CUSTOMER : INTERNE

COUNTRY : FRANCE

ARTICLE : SMXA0004-OPT1

INDEX : 17/23

ARMOIRE

IMPLANTATION PLATINE ARMOIRE

ESPACEMENT DE 30mm ENTRE CHAQUE VARIATEUR

The diagram illustrates the layout of a control panel (ARMOIRE) for four inverters. The inverters, labeled -V01, -V02, -V03, and -V04, are arranged in a row with a 30 mm spacing between them. Below the inverters is a common terminal block labeled -CEM04. To the right of the inverters are various electrical components: a terminal block -REP01, four circuit breakers -Q01, -Q02, -Q03, and -Q04, a thermal relay -TH01, and two terminal blocks -KA02 and -KA03. The dimensions of the components are indicated on the right side of the diagram: 47.5 mm for the inverters, 25 mm for the terminal block -REP01, 77.5 mm for the circuit breakers -Q01 to -Q04, 85 mm for the thermal relay -TH01, 80 mm for the terminal blocks -KA02 and -KA03, and 60 mm for the terminal block -CEM04. The diagram also shows the wiring connections between the components.

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

REPERE	FOLIO	DESIGNATION	QTE	REFERENCE	CODE ECAT-ID	FABRICANT	FILTRE
ARMOIRE	01	COFFRET INOX 600x600x300	1	CPN606030	BOX00367	MP GAMMA	ARMOIRE
CEM01	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM02	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM03	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM04	07	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ETH_ECAT_100		CONNECTEUR RJ45 A MONTER IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
FAN01	11	KIT ENS CAPOT VENTILATEUR ELC00708 SANS VENTILATEUR PETIT MODELE	1	SVB02227	SVB02227	INTERNE	ARMOIRE
FAN01	11	KIT ENS CAPOT VENTILATEUR ELC00708 AVEC VENTILATEUR PETIT MODELE	1	SVB02228	SVB02228	INTERNE	ARMOIRE
KA02	11	RELAIS RIFLINE 2 CONTACT	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA03	11	RELAIS RIFLINE 2 CONTACT	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
Q01	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q02	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q03	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q04	07	DISJONCTEUR IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, COURBE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
REP01	06	REPARTITEUR TETRAPOLAIRE TD 80/100 A, 6 CONNEXIONS	1	563920	ELC01083	NVENT ERICO	ARMOIRE
TH01	11	THERMOSTAT MECANIQUE 0 60°C "F"	1	NSYCCOTH0	SEN00671	SCHNEIDER ELECTRIC	ARMOIRE
V01	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V01	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V02	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V02	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V03	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V03	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V04	07	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V04	07	VARIATEUR DE FREQUENCE, 200-240VAC 1-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
Z01	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z02	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z03	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z04	07	FILTRE DE LIGNE CEM POUR VARIATEUR MX2, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatid.service@ceva.com		Date of creation : 09/10/2024 Designed by : DB		NOMENCLATURE ARMOIRE		 Ecat-iD Campus					CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
							ENVIRONNEMENT : Elec_IEC V5R2_ECATID							ARTICLE : SMXA0004-OPT1				INDEX : FOLIO : 18/23	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

TAG	SHEET	DESCRIPTION	QTY	CATALOG No	CODE ECAT-ID	MANUFACTURER	FILTER
ARMOIRE	01	STAINLESS STEEL BOX 600X600X300	1	CPN606030	BOX00367	MP GAMMA	ARMOIRE
CEM01	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM02	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM03	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CEM04	07	EMC EARTH CLAMPS SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ETH_ECAT_100		RJ45 CONNECTOR TO MOUNT IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
FAN01	11	KIT SET FAN COVER WITHOUT FAN ELC00708 SMALL MODEL	1	SVB02227	SVB02227	INTERNE	ARMOIRE
FAN01	11	KIT SET FAN COVER WITH FAN ELC00708 SMALL MODEL	1	SVB02228	SVB02228	INTERNE	ARMOIRE
KA02	11	RIFLINE 2 CONTACT RELAY	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
KA03	11	RIFLINE 2 CONTACT RELAY	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
Q01	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q02	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q03	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
Q04	07	CIRCUIT BREAKER IC60N 2P 6A, 440VAC/6KA 133VDC/6KA, CURVE D	1	A9F75206	DIS00163	SCHNEIDER ELECTRIC	ARMOIRE
REP01	06	TD 80/100 A TETRAPOLAR SPLITTER, 6 CONNECTIONS	1	563920	ELC01083	NVENT ERICO	ARMOIRE
TH01	11	MECHANICAL THERMAL SENSOR 0 60°C "NC"	1	NSYCCOTH0	SEN00671	SCHNEIDER ELECTRIC	ARMOIRE
V01	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V01	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V02	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V02	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V03	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V03	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
V04	07	ETHERCAT COMMUNICATION CARD FOR MX2 INVERTER	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
V04	07	COMPACT VECTOR INVERTER, 200-240VAC SINGLE-PHASE, 0.4/0.55 KW, 3.0/3.5A	1	3G3MX2-AB004-EV2	VAR00701	OMRON	ARMOIRE
Z01	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z02	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z03	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE
Z04	07	EMC LINE FILTER FOR MX2 DRIVE, 200-240VAC MONO, 10A	1	AX-FIM1010-RE	VAR00277	OMRON	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		NOMENCLATURE ARMOIRE ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID										FOLIO : 19/23			



Ecat-iD Campus

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		NOMENCLATURE BOUTONNERIE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE			COUNTRY : FRANCE		
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1						INDEX :	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID														FOLIO : 20/23	

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		NOMENCLATURE BOUTONNERIE ANGLA				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1		INDEX :			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 21/23					

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20			
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		CARNET DE CABLE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE			
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1						INDEX :	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID														FOLIO : 22/23	

[illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 09/10/2024		CARNET DE CABLE ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER : INTERNE		COUNTRY : FRANCE	
			Fax : (33).2.98.85.31.38		Designed by : DB										ARTICLE : SMXA0004-OPT1				INDEX :	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID												FOLIO : 23/23	