

-ARMOIRE

Cabinet no. : XB

Cabinet material :INOX

Cabinet size :1000x750x300

Brand of enclosure :MP GAMMA

Enclosure material :INOX

Equipment used :

Button brand :SCHNEIDER

Button language :ENGLISH

PLC brand :/

HMI brand :/

Wiring

Breaking capacity Icc :1.2kA

Shielded cables on drives

Wire colours :

Phase 230V: Black24VDC: Violet

Neutral 230V: Blue12VDC or 15VDC : Red

115V phase: Brown5VDC: Grey

Neutral 115V: Brown with blue stripes48VDC : Yellow

Earth: Green/Yellow0VDC : White

External potential : Orange

External neutral: Orange with blue stripes

Estimated electrical characteristics

Total rated power (kW) :1.48

Total rated current (Amps) :4.2

Recommended main circuit breaker (Customer)

Circuit breaker rating (Amps) :10

Circuit breaker curve (type) :D

Minimum cross-section of supply cable (Customer) :

400V 3P+N+T

Wire cross-section (mm²) :14AWG

Cable type (Number of wires) :ÖFLEX TRAY II 5G14AWGH07 RNF / U1000 R2V

The main circuit breaker and the supply cable may be different depending on the electrical installation
(Cable material, length, installation method, ...)

V1	CREATION	19/06/2025	BM	AV	JT
INDEX	MODIFICATION	DATE	DESIGNED BY	VERIFIED BY	APPROVED BY

COFFRET CONVOYEUR DE SORTIE GENESYS

GENESYS OUTFEED CONVEYOR CABINET

DESIGNED BY : AV

VERIFIED BY : JT

DATE CREATED : 19/06/2025

CUSTOMER :

CONTRACT NO. : C0

PROCESS N° : PMXA_C0

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tel : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatic.service@ceva.com

ENVIRONNEMENT IGE-XAO : Elec_IEC V5R2_ECATICID Environment for electrical controls and automation systems (according to IEC standard)

FOLIO : 01/25

Ecat-iD Campus

COUNTRY :
USA

DRAWING NUMBER :
SMXA0008-OPT2

[illegible][illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36	Date of creation : 19/06/2025		LISTE DE FOLIOS FRANCAIS			 Ecat-iD Campus						CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
			Fax : (33).2.98.85.31.38	Designed by : BM		FRENCH FOLIOS LIST									ARTICLE : SMXA0008-OPT2		INDEX : V1			
			E-mail : ecatid.service@ceva.com			ENVIRONNEMENT : Elec_IEC V5R2_ECATID											FOLIO : 02/25			

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH FOLIOS LIST								ARTICLE : SMXA0008-OPT2				INDEX : V1	
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 03/25					


[illegible][illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		ENGLISH FOLIOS LIST								ARTICLE : SMXA0008-OPT2			INDEX : V1			
			E-mail : ecatid.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID				FOLIO : 04/25												

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

																				A
																				B
																				C
																				D
																				E
																				F
																				G
																				H
																				I
																				J
																				K
																				L
																				M
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecaticid.service@ceva.com		Date of creation : 19/06/2025		LISTE DE FOLIOS ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
					Designed by : BM		ENGLISH FOLIOS LIST								ARTICLE : SMXA0008-OPT2				INDEX : V1	
					ENVIRONNEMENT : Elec_IEC V5R2_ECATICID										FOLIO : 05/25					


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

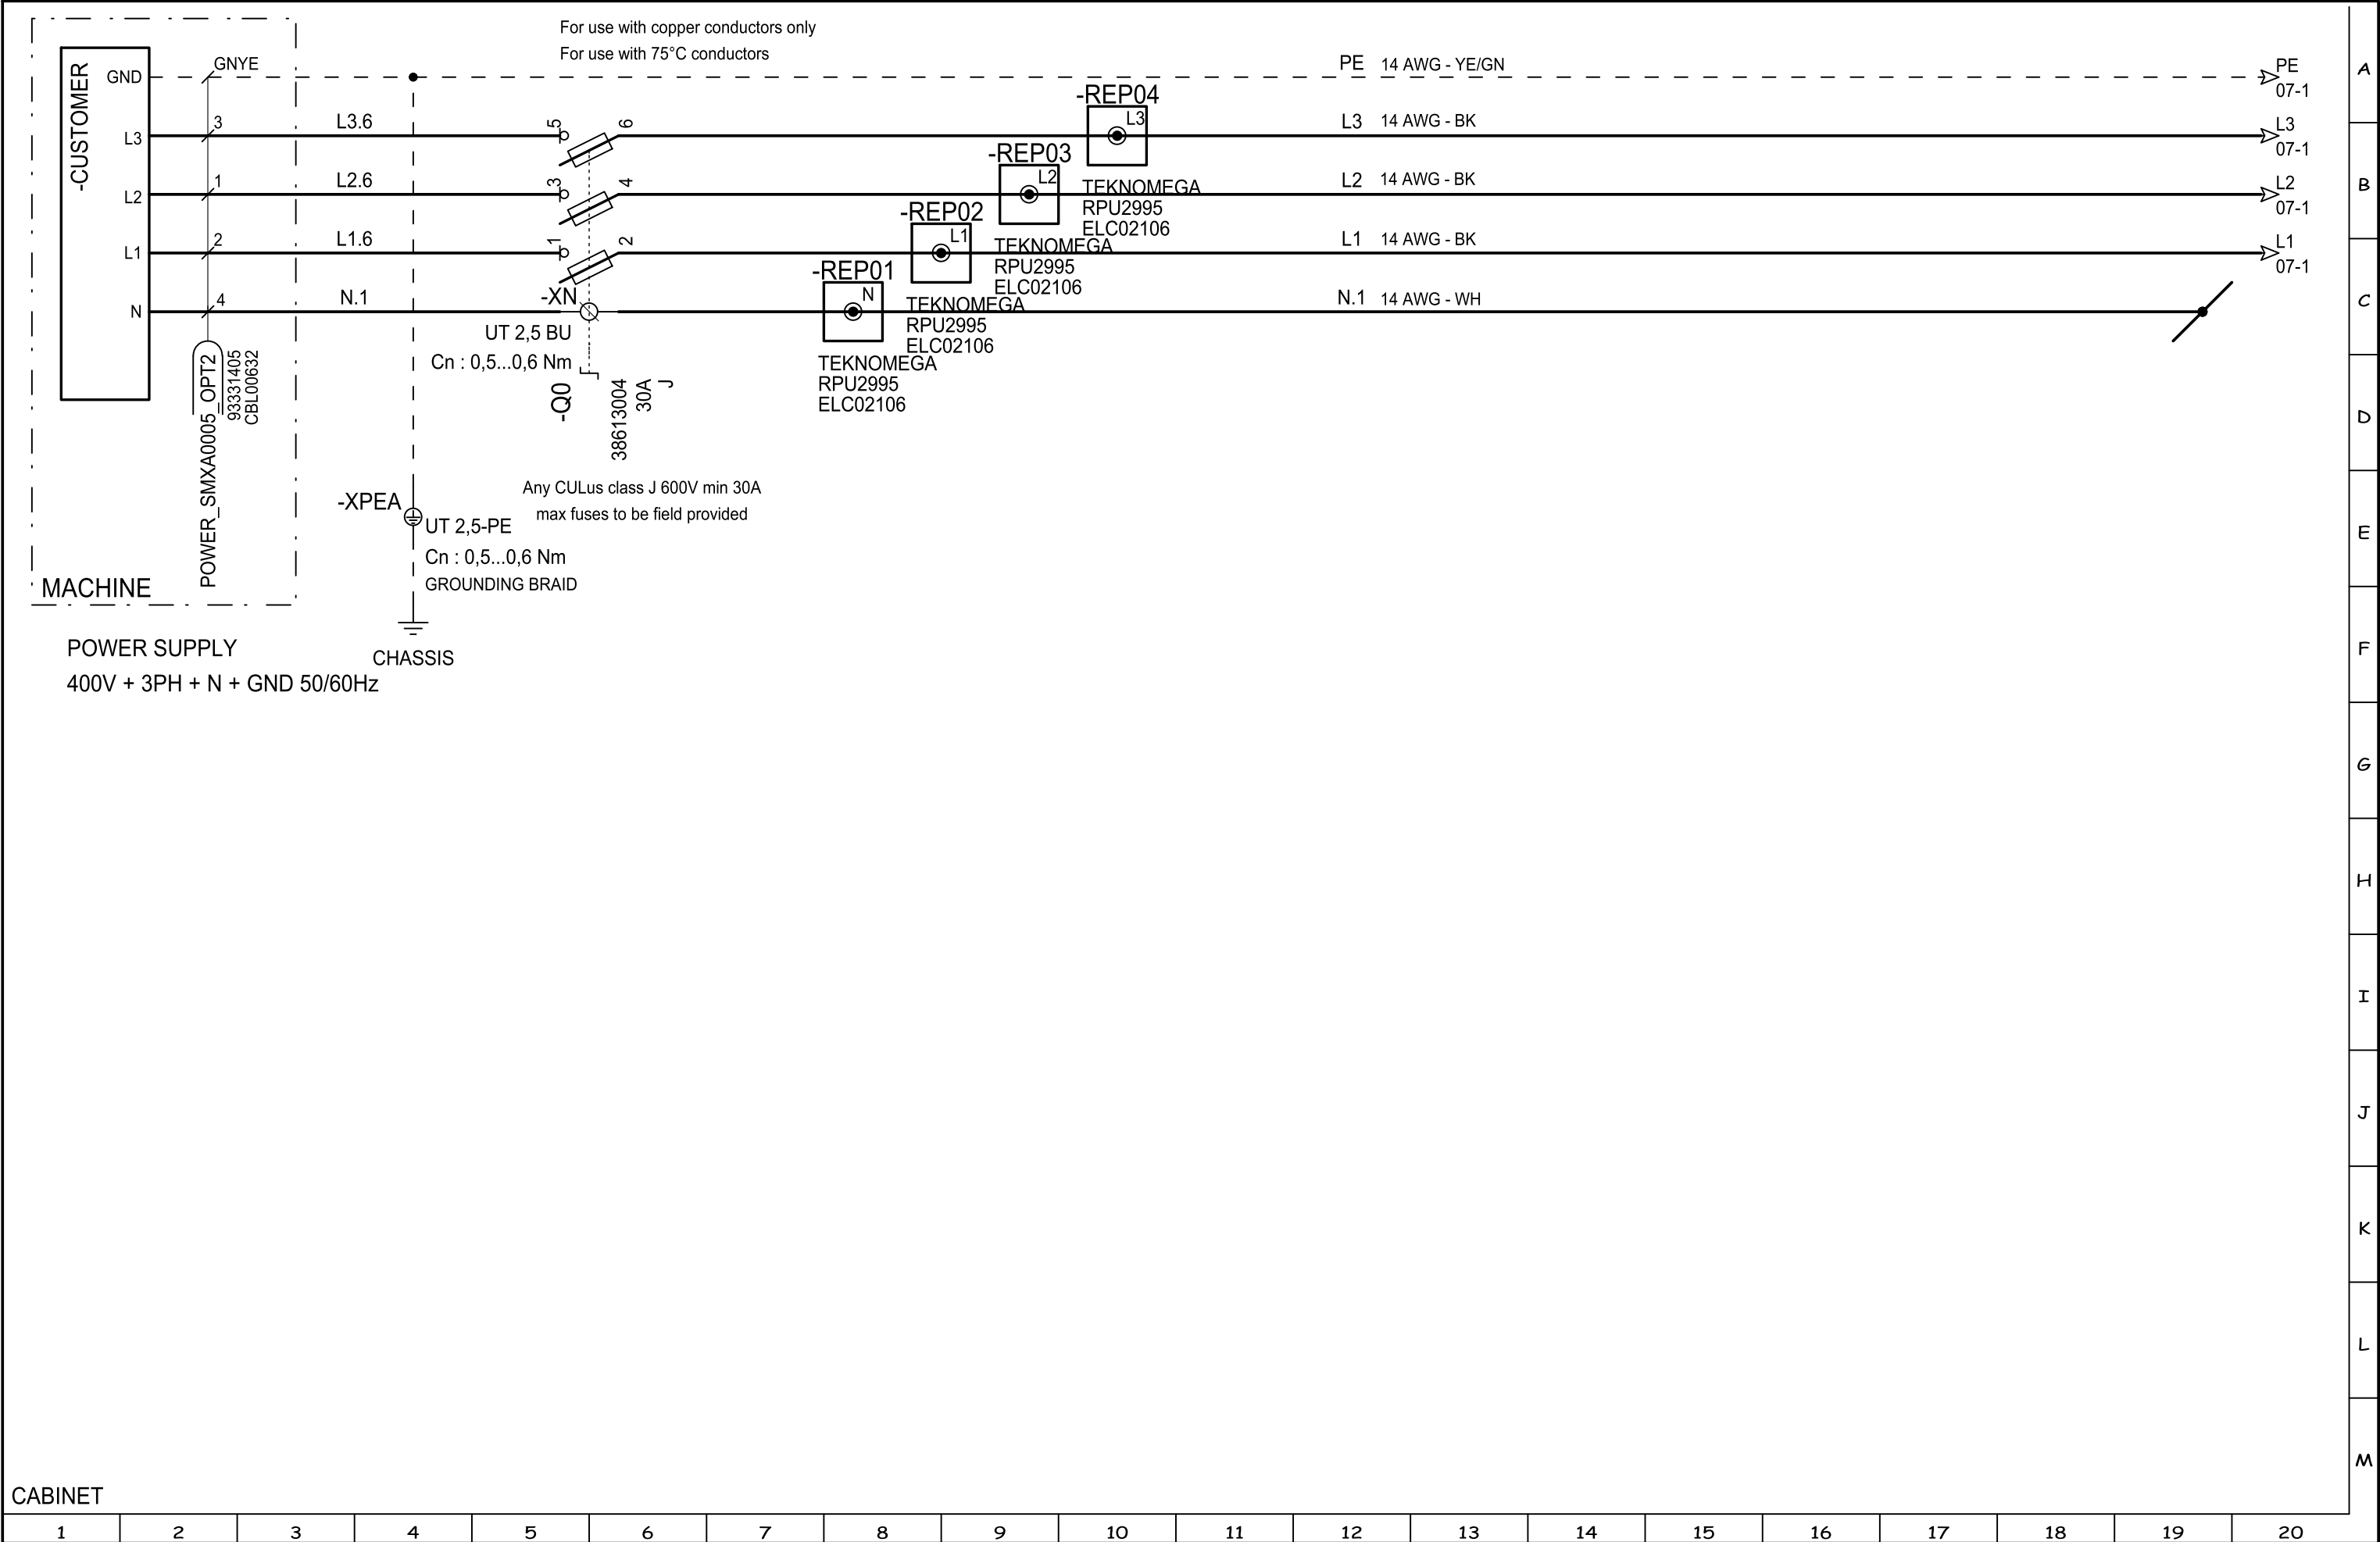

CABINET

ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE	Tél : (33).2.98.85.31.36	Date of creation : 19/06/2025	SCHEMA DE PUISSANCE	 Ecat-iD Campus	CONTRACT : C0	CUSTOMER :	COUNTRY : USA
	Fax : (33).2.98.85.31.38	Designed by : BM	POWER DIAGRAM		ARTICLE :		INDEX : V1
	E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID		SMXA0008-OPT2		FOLIO : 06/25

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

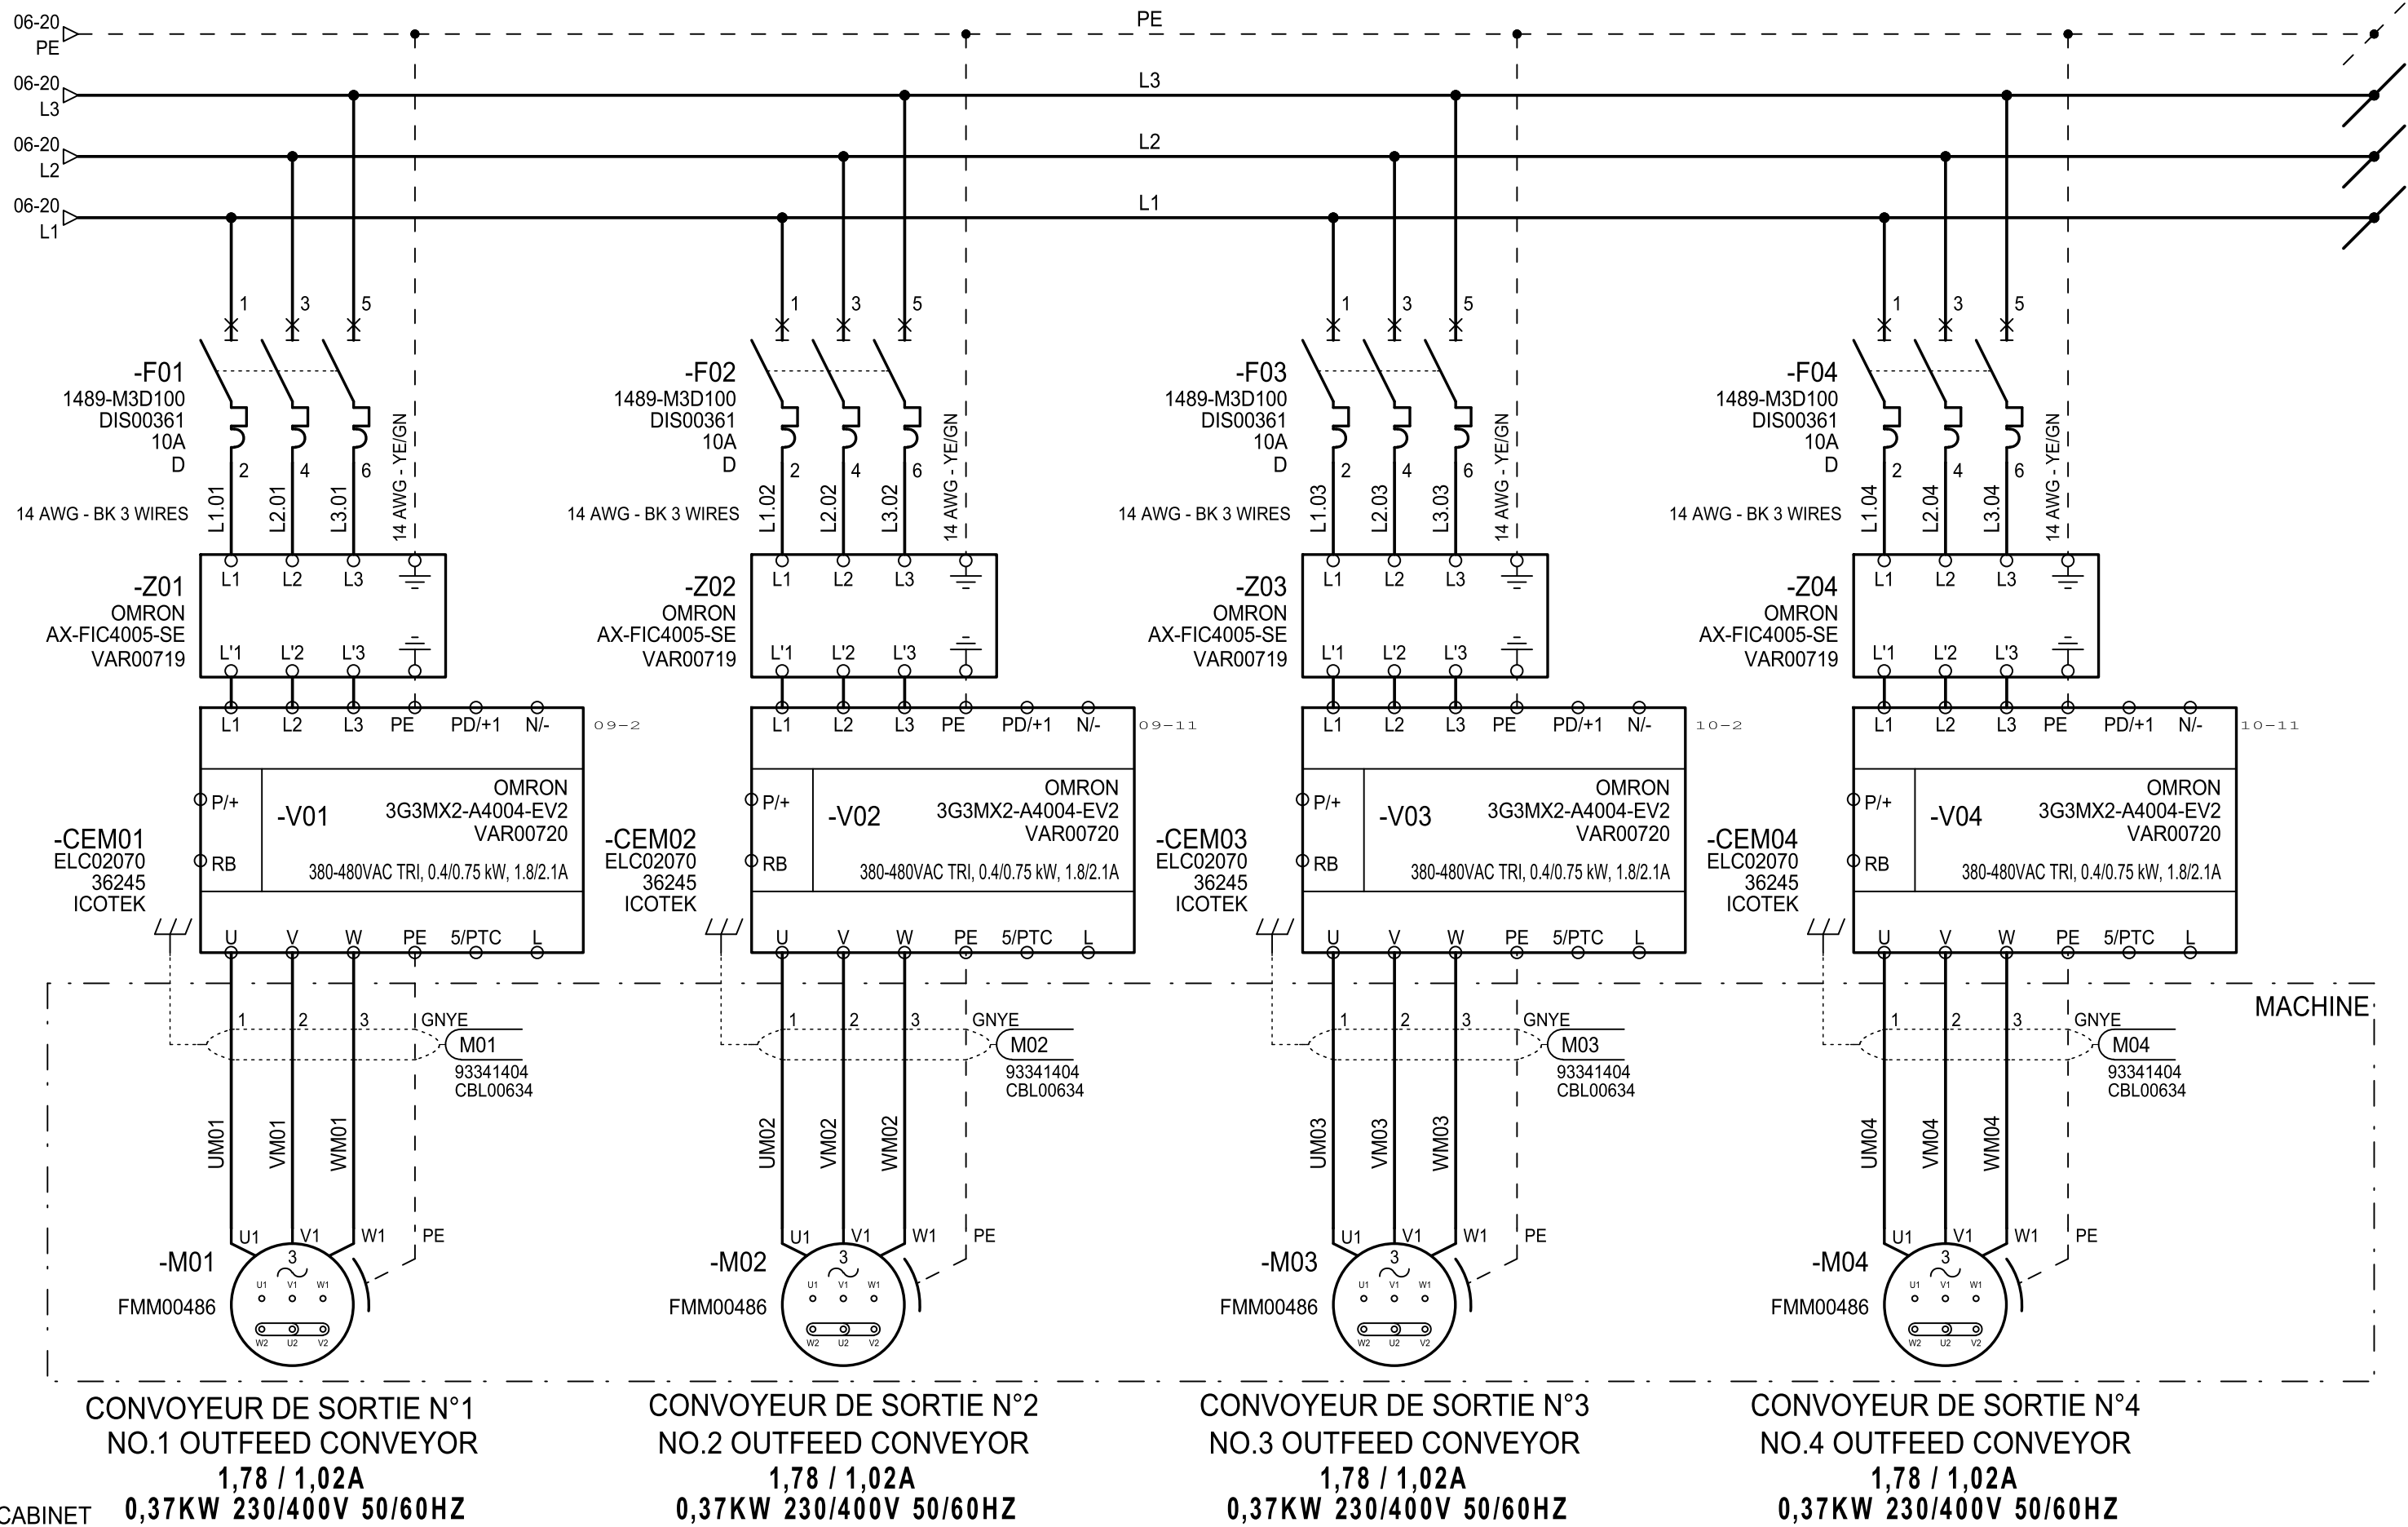

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36
Fax : (33).2.98.85.31.38
E-mail : ecatid.service@ceva.com

Date of creation :
19/06/2025

Designed by :
BM

SCHEMA DE PUISSANCE

POWER DIAGRAM

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
C0

CUSTOMER :


COUNTRY :
USA

ARTICLE :

SMXA0008-OPT2

INDEX : V1

FOLIO : 07/25

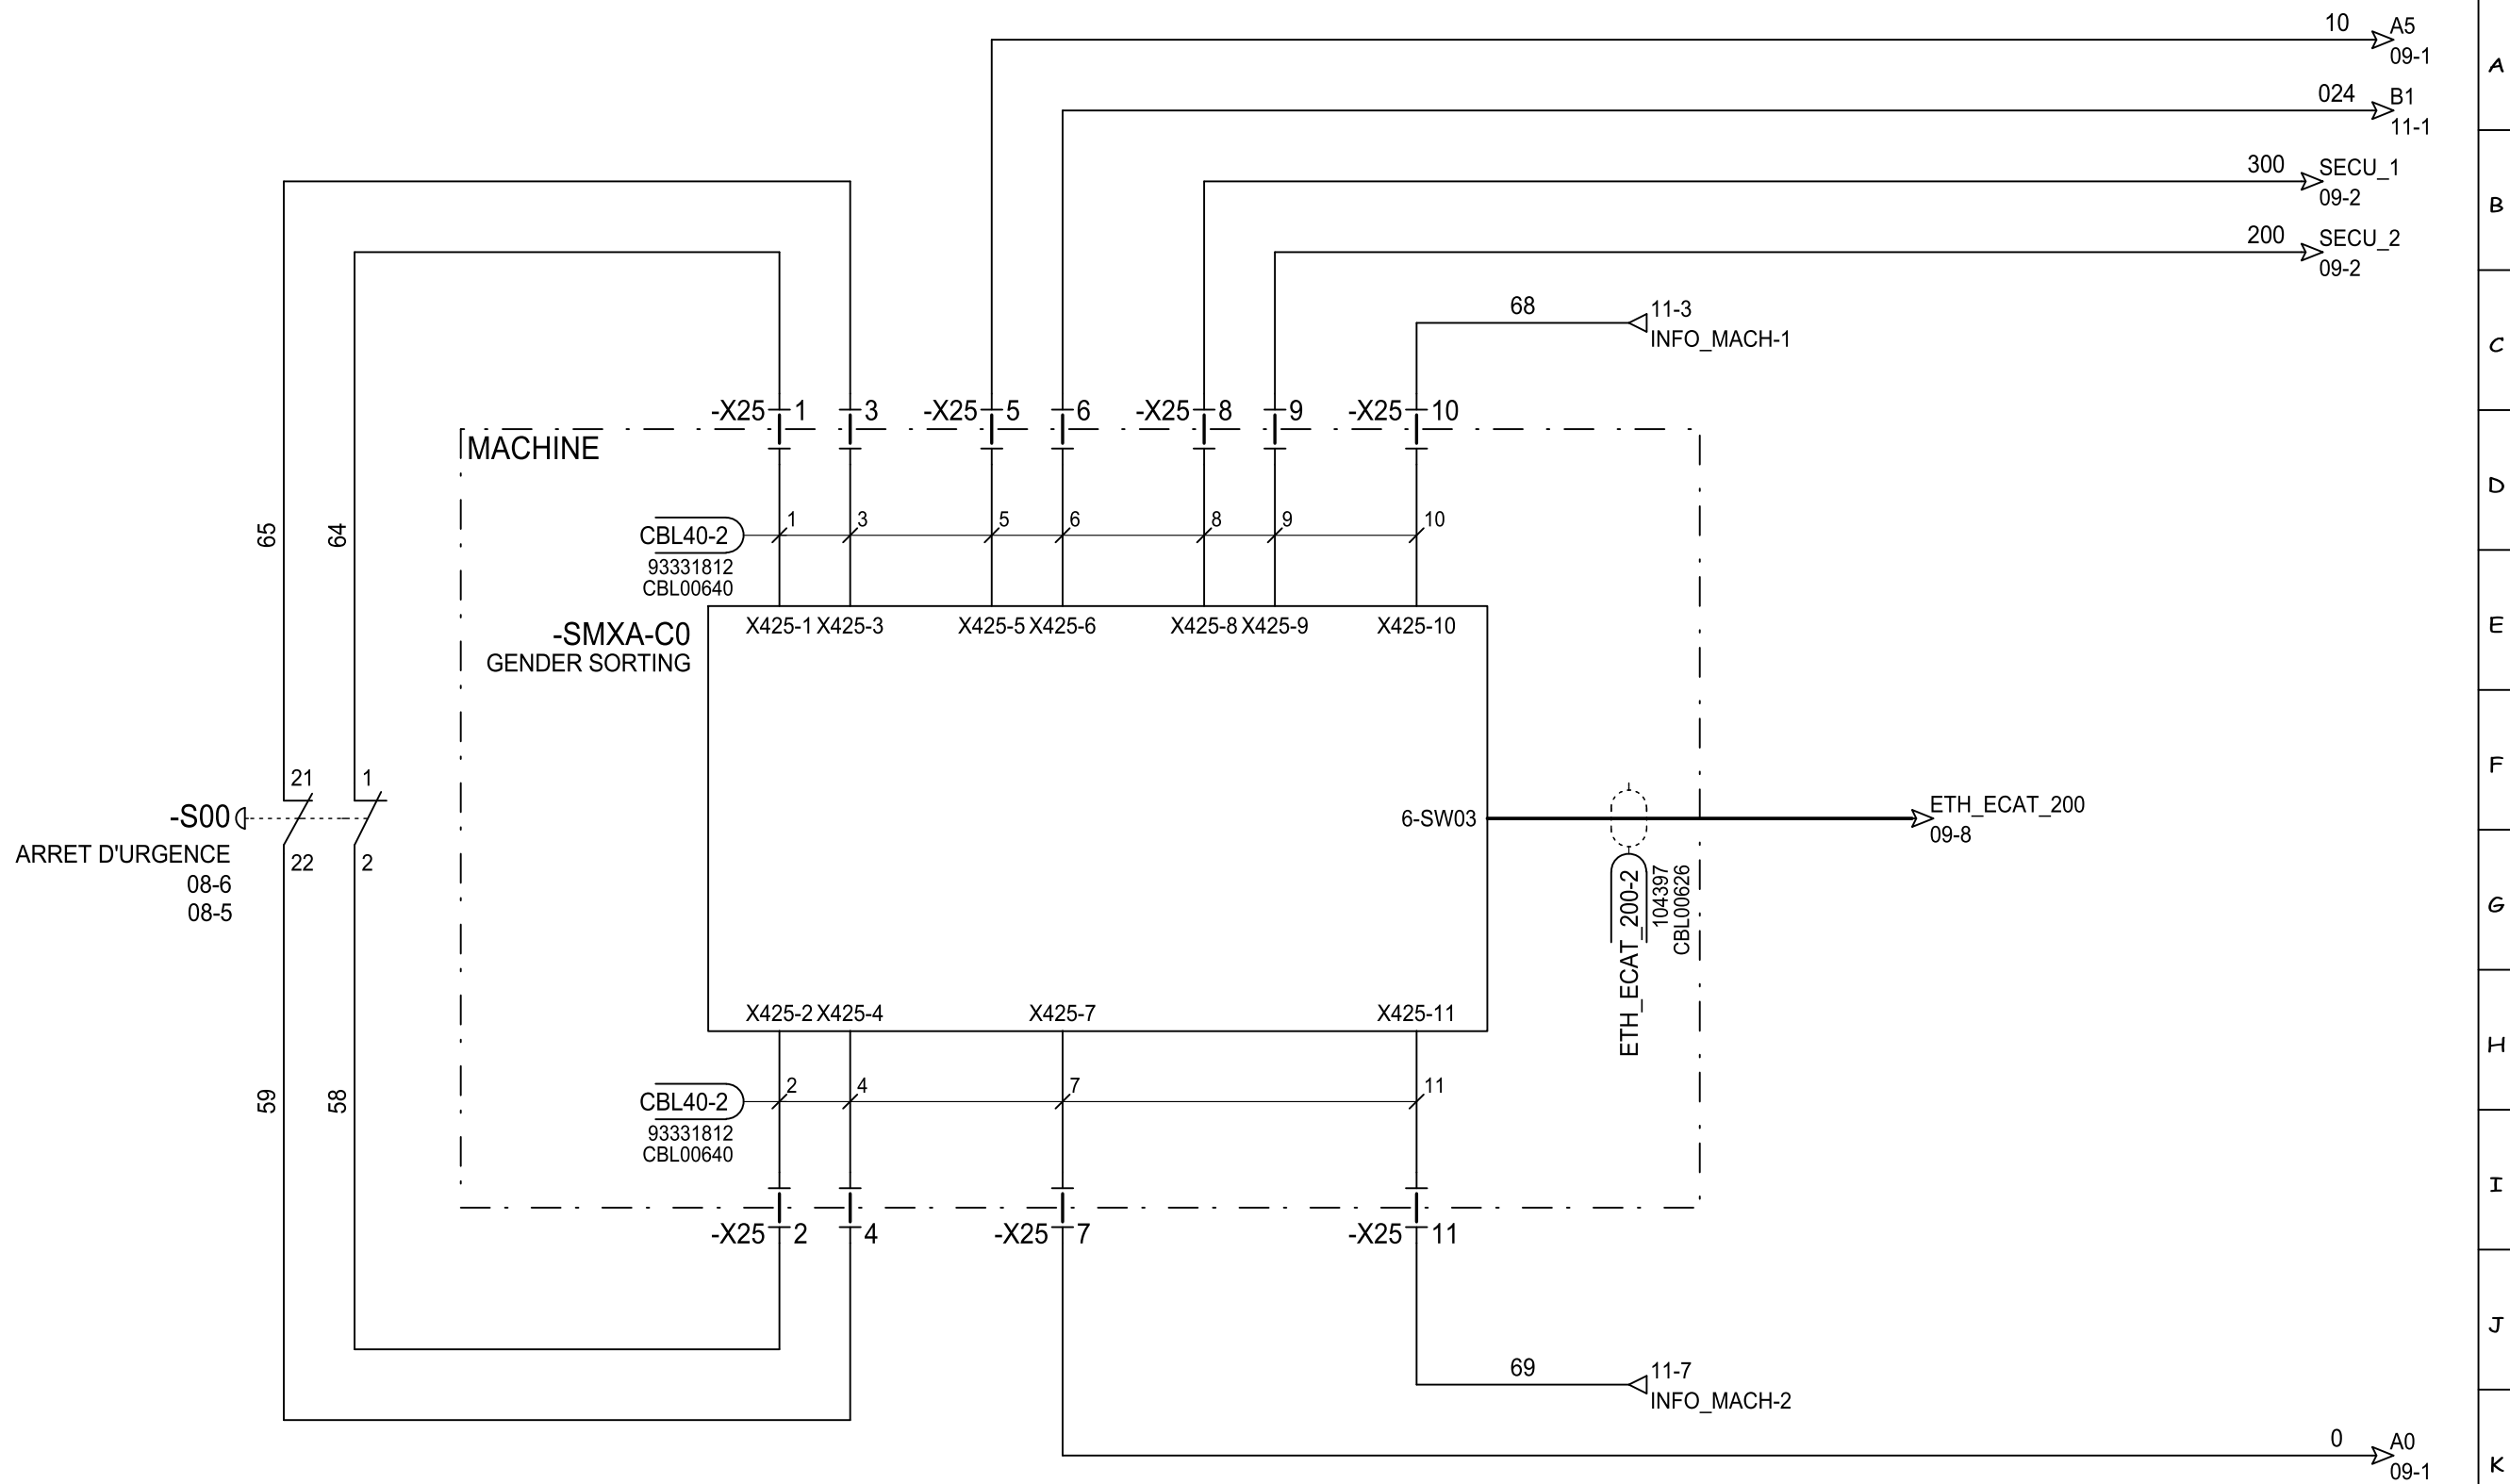


ECHANGE : SMXA => SMXA-OPT2
EXCHANGE : SMXA => SMXA-OPT2

CABINET

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		CONTROL DIAGRAM								ARTICLE :		SMXA0008-OPT2			INDEX : V1	
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID													FOLIO : 08/25	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

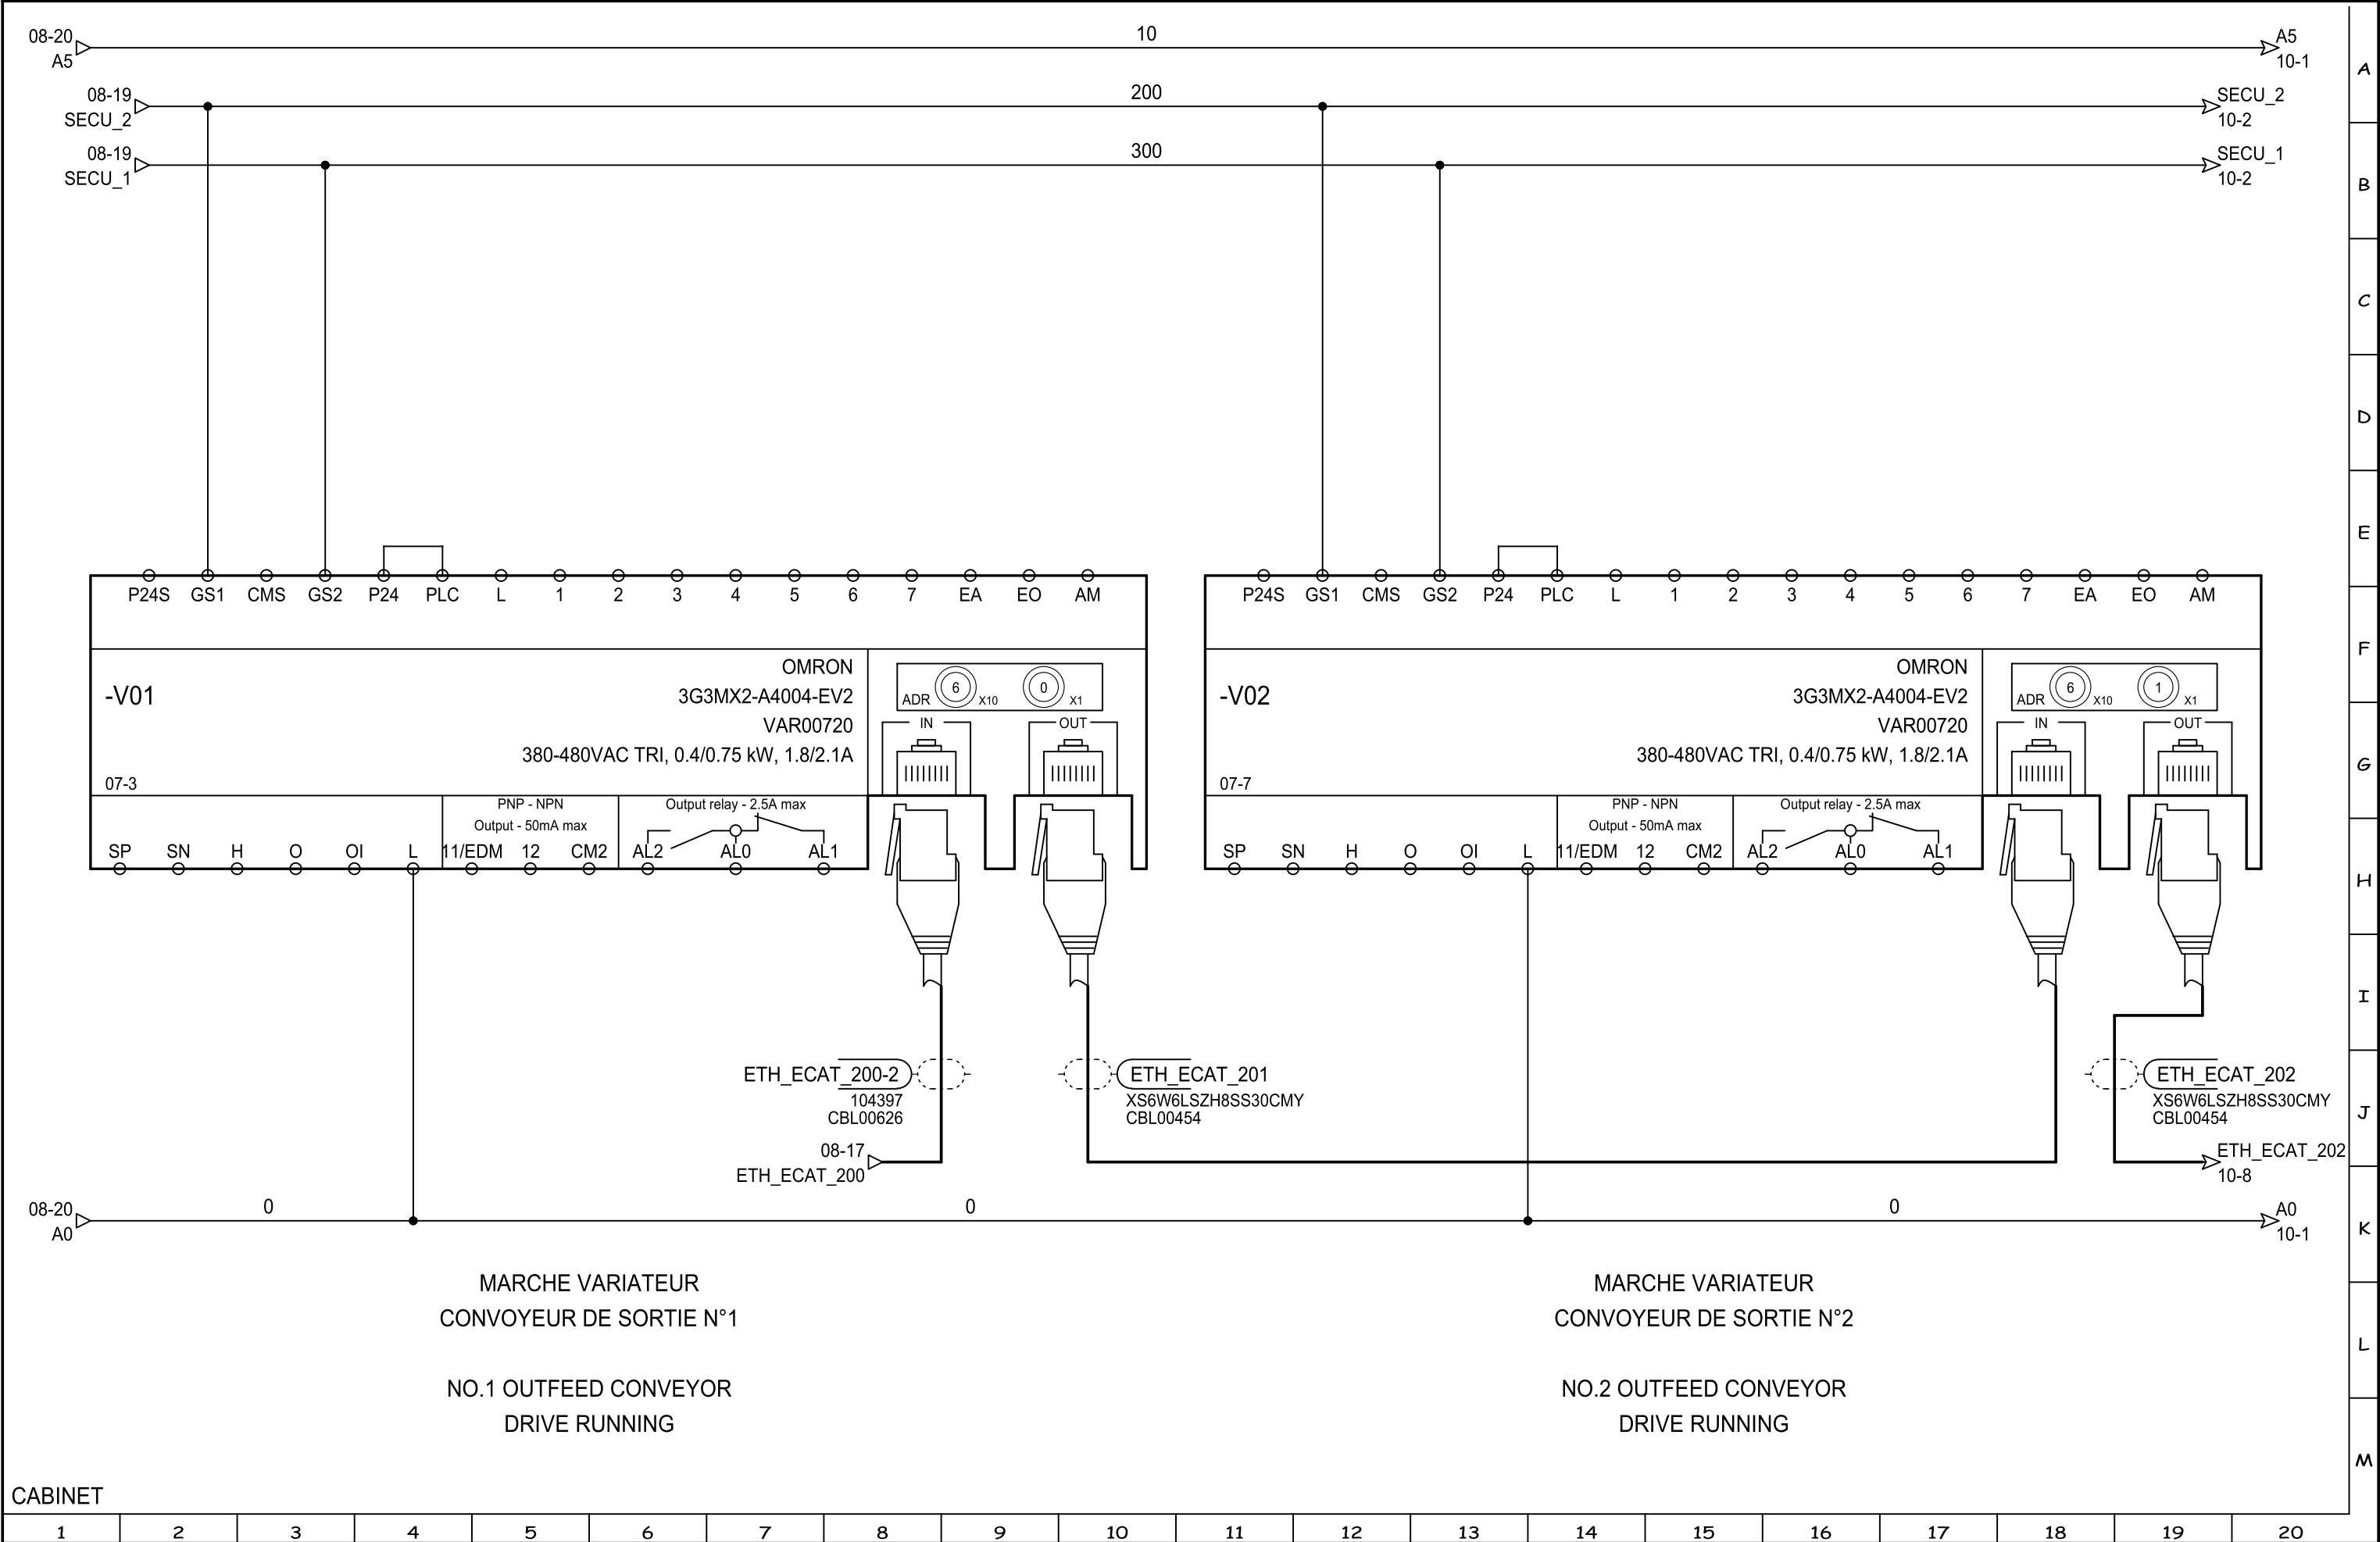

CABINET


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE		Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatic.service@ceva.com		Date of creation : 19/06/2025 Designed by : BM		SCHEMA DE COMMANDE CONTROL DIAGRAM ENVIRONNEMENT : Elec_IEC V5R2_ECATICD		 Ecat-iD Campus		CONTRACT : C0		CUSTOMER :		COUNTRY : USA		ARTICLE : SMXA0008-OPT2		INDEX : V1 FOLIO : 09/25	

Designed by :
BM

SCHEMA DE COMMANDE

CONTROL DIAGRAM

ENVIRONNEMENT : Elec IEC V5R2 ECATID



Ecat-iD Campus

CONTRACT :

C0

CUSTOMER:

ARTICLE :


SMXA0008-OPT2

COUNTRY :

JSA


INDEX :	V1
---------	----

FOLIO : 10/25

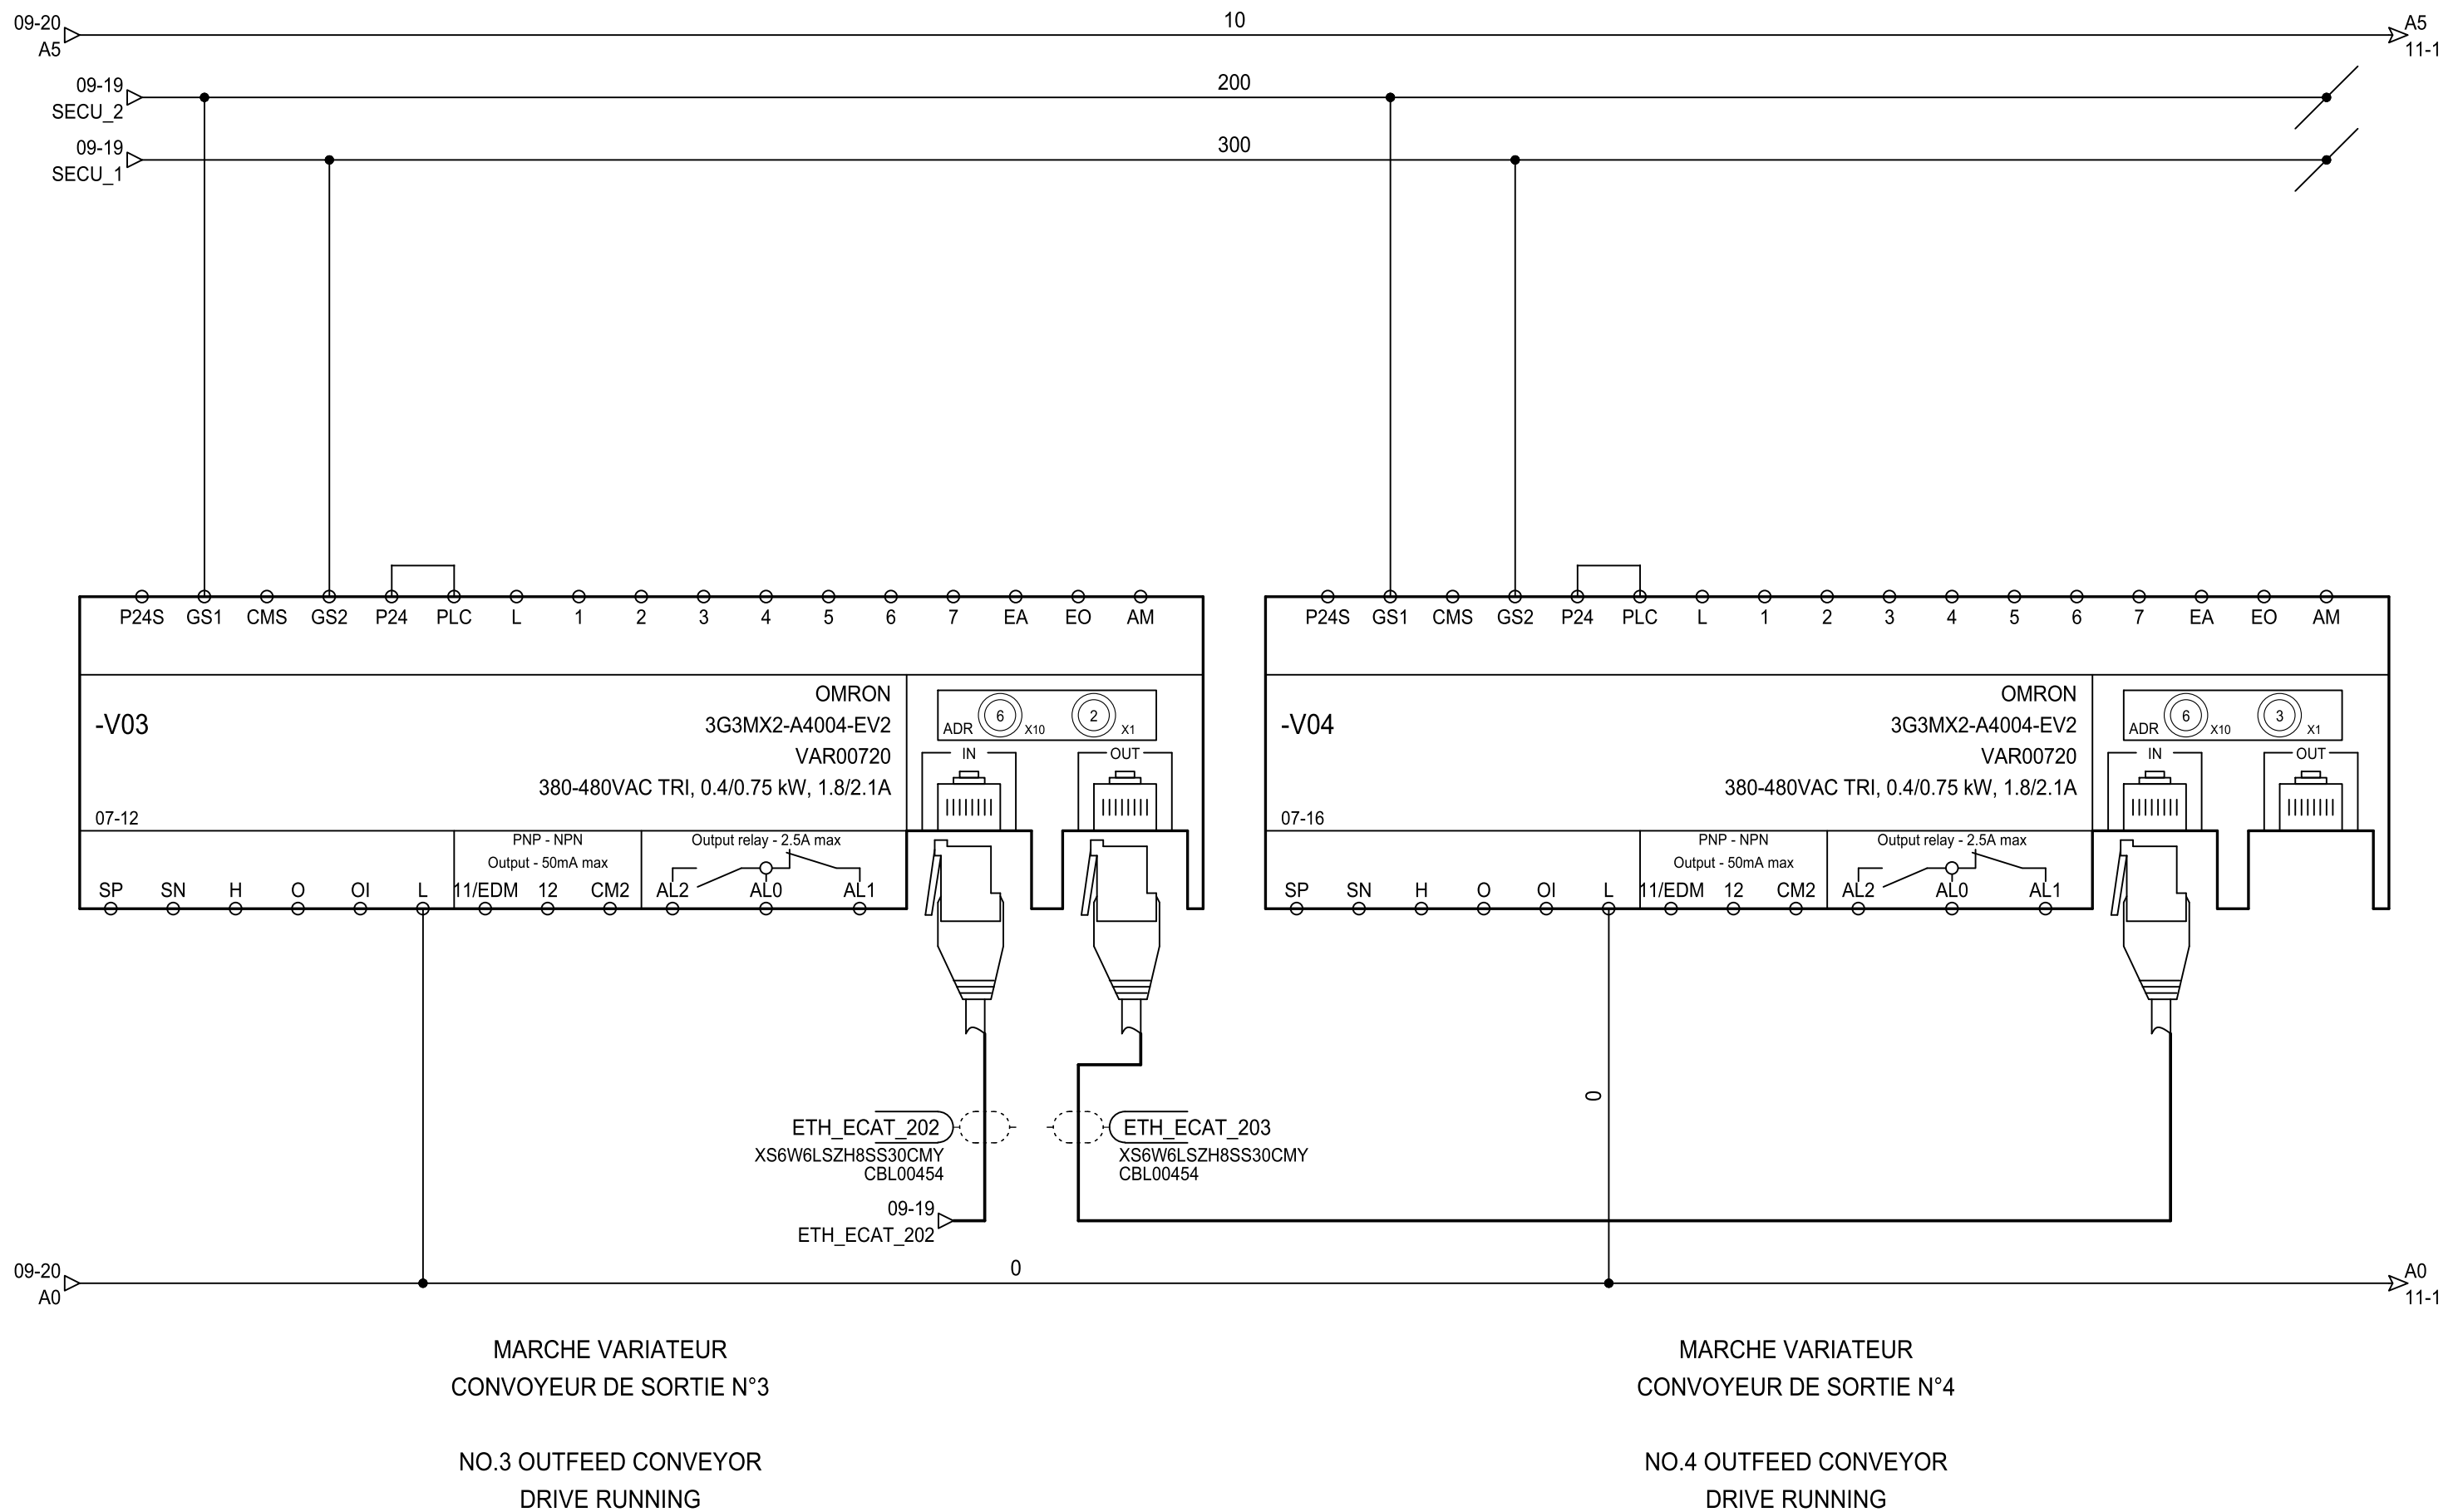

CABINET


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

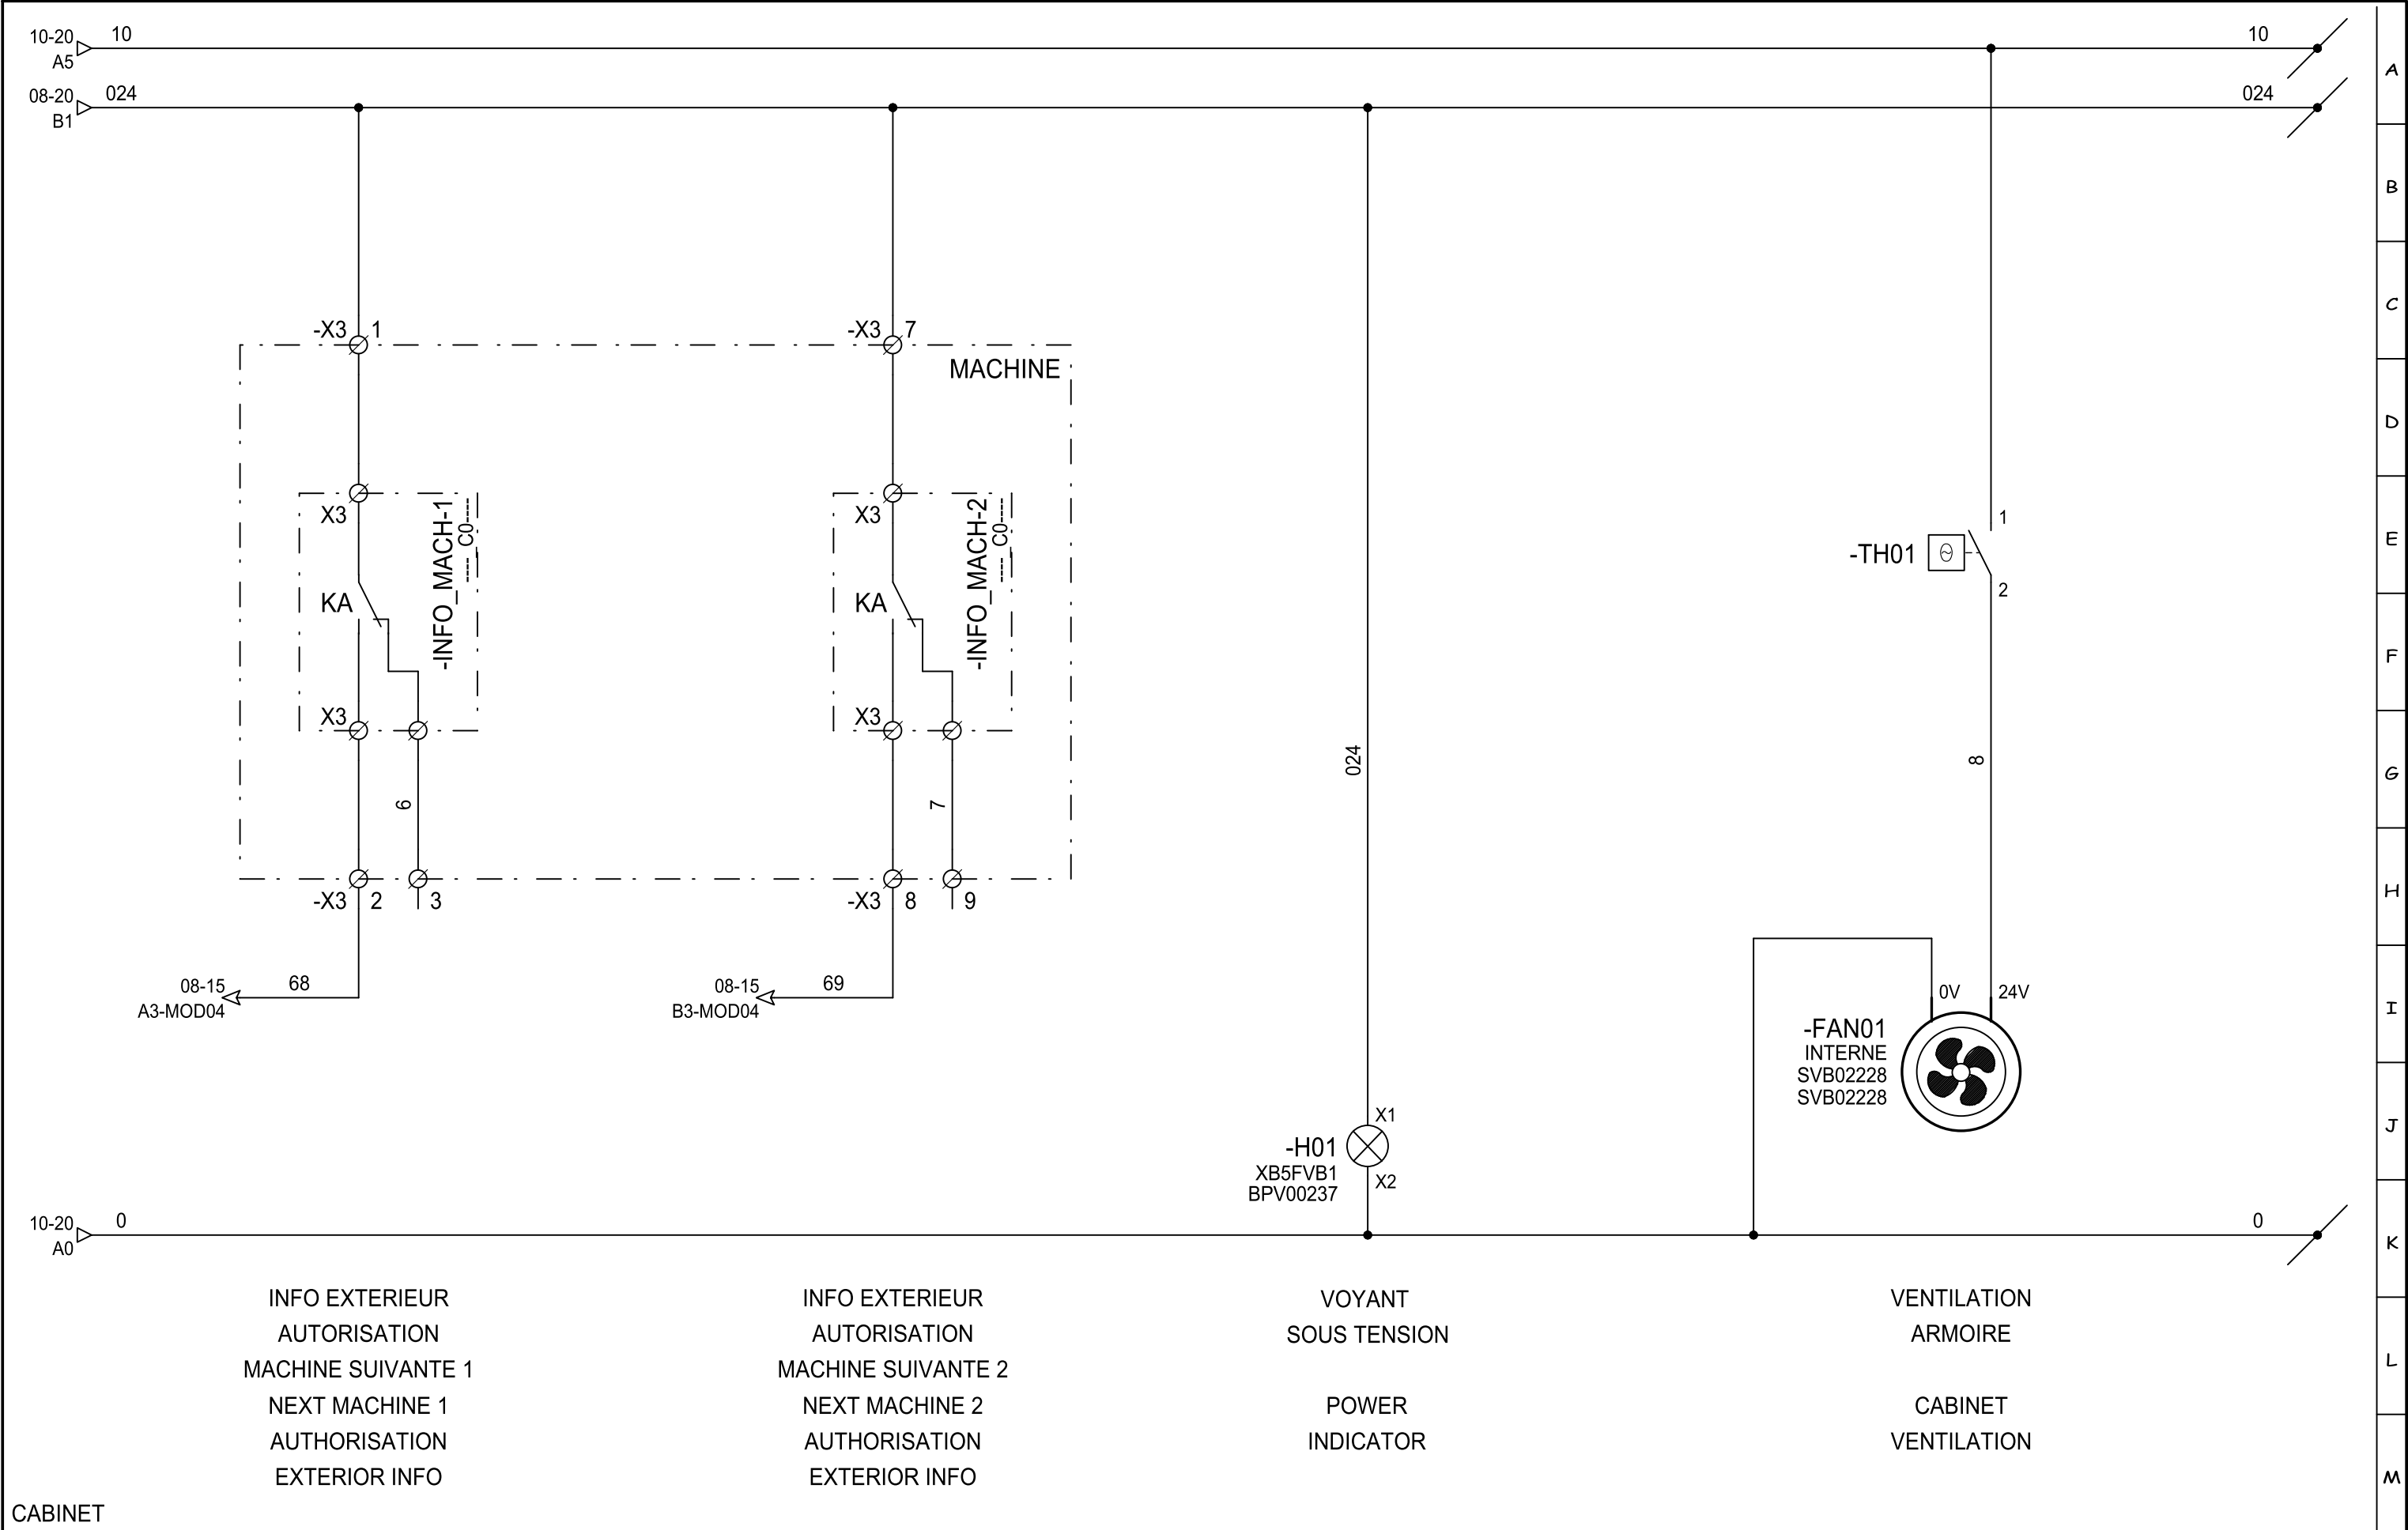

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		CONTROL DIAGRAM								ARTICLE :		SMXA0008-OPT2		INDEX : V1	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID												FOLIO : 11/25	

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.


BORNIER DE COMMANDE : X3
CONTROL TERMINAL BLOCK : X3

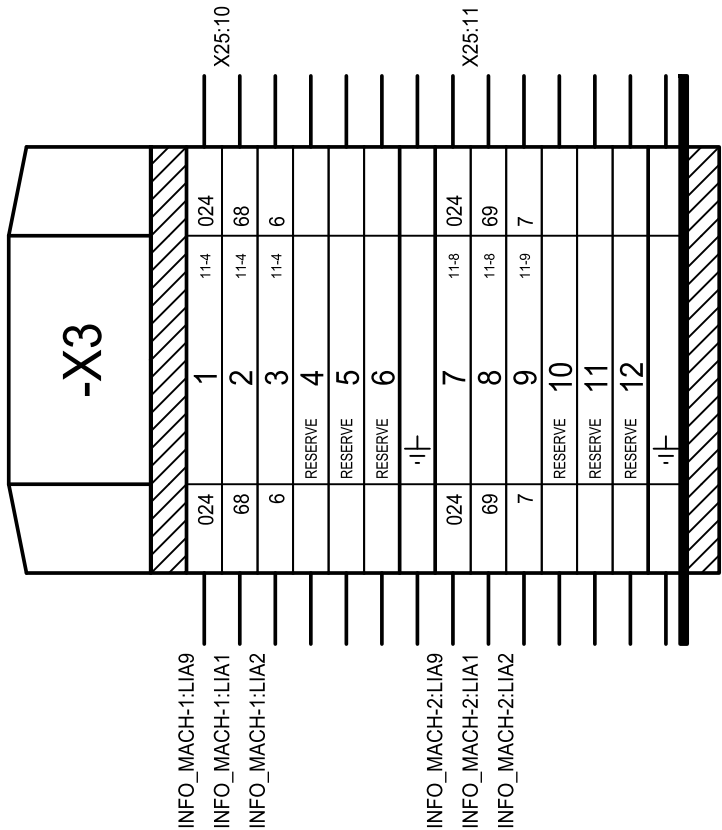

CABINET

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE				Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		BORNIER : X3				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
				Fax : (33).2.98.85.31.38		Designed by : BM		TERMINAL BLOCK : X3								ARTICLE : SMXA0008-OPT2				INDEX : V1	
				E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 12/25					

BORNIER DE COMMANDE : X25
CONTROL TERMINAL BLOCK : X25

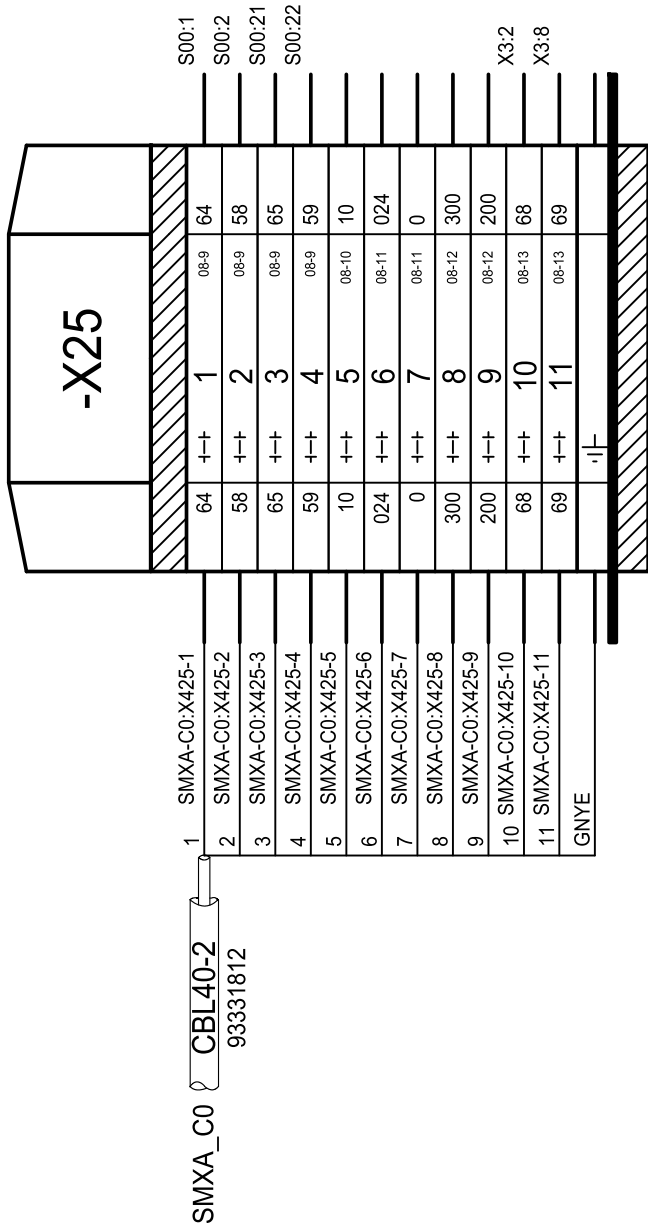

CABINET

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		BORNIER : X25				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		TERMINAL BLOCK : X25								ARTICLE :		SMXA0008-OPT2			INDEX : V1	
			E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 13/25						

ECAT-ID

Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33) 2.98.85.31.36

Fax : (33) 2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
19/06/2025

Designed by :
BM

IMPLANTATION FACADE ARMOIRE

CABINET FRONT LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-ID Campus

CONTRACT :
C0

CUSTOMER :

ARTICLE :
SMXA0008-OPT2

INDEX :
V1

COUNTRY :
USA

FOLIO :
14/25

CABINET


IMPLANTATION FACADE ARMOIRE

CABINET FRONT LAYOUT

The diagram illustrates the front layout of a cabinet with a width of 750 mm and a height of 1000 mm. A vertical dashed line serves as a centerline. Key components and their dimensions are as follows:

- Q0**: A circular component at the top center.
- GENERAL POWER SUPPLY**: A rectangular component below Q0.
- STICKER Y SRS02938**: An orange and grey sticker located 160 mm from the top edge and 70 mm from the centerline.
- 60 mm**: The distance from the centerline to the center of the next circular component.
- 115 mm**: The distance from the centerline to the center of the third circular component.
- Warning Stickers**: Three warning stickers (STICKER L SRS02925, STICKER H SRS02921, and STICKER K SRS02924) are positioned to the right of the centerline. STICKER L is 60 mm from the centerline, STICKER H is 115 mm, and STICKER K is 81 mm.
- 81 mm**: The distance from the centerline to the center of the bottom circular component.
- H01 WHITE**: The bottom circular component, labeled H01 and WHITE.

IMPLANTATION COTE ARMOIRE
CABINET SIDE LAYOUT

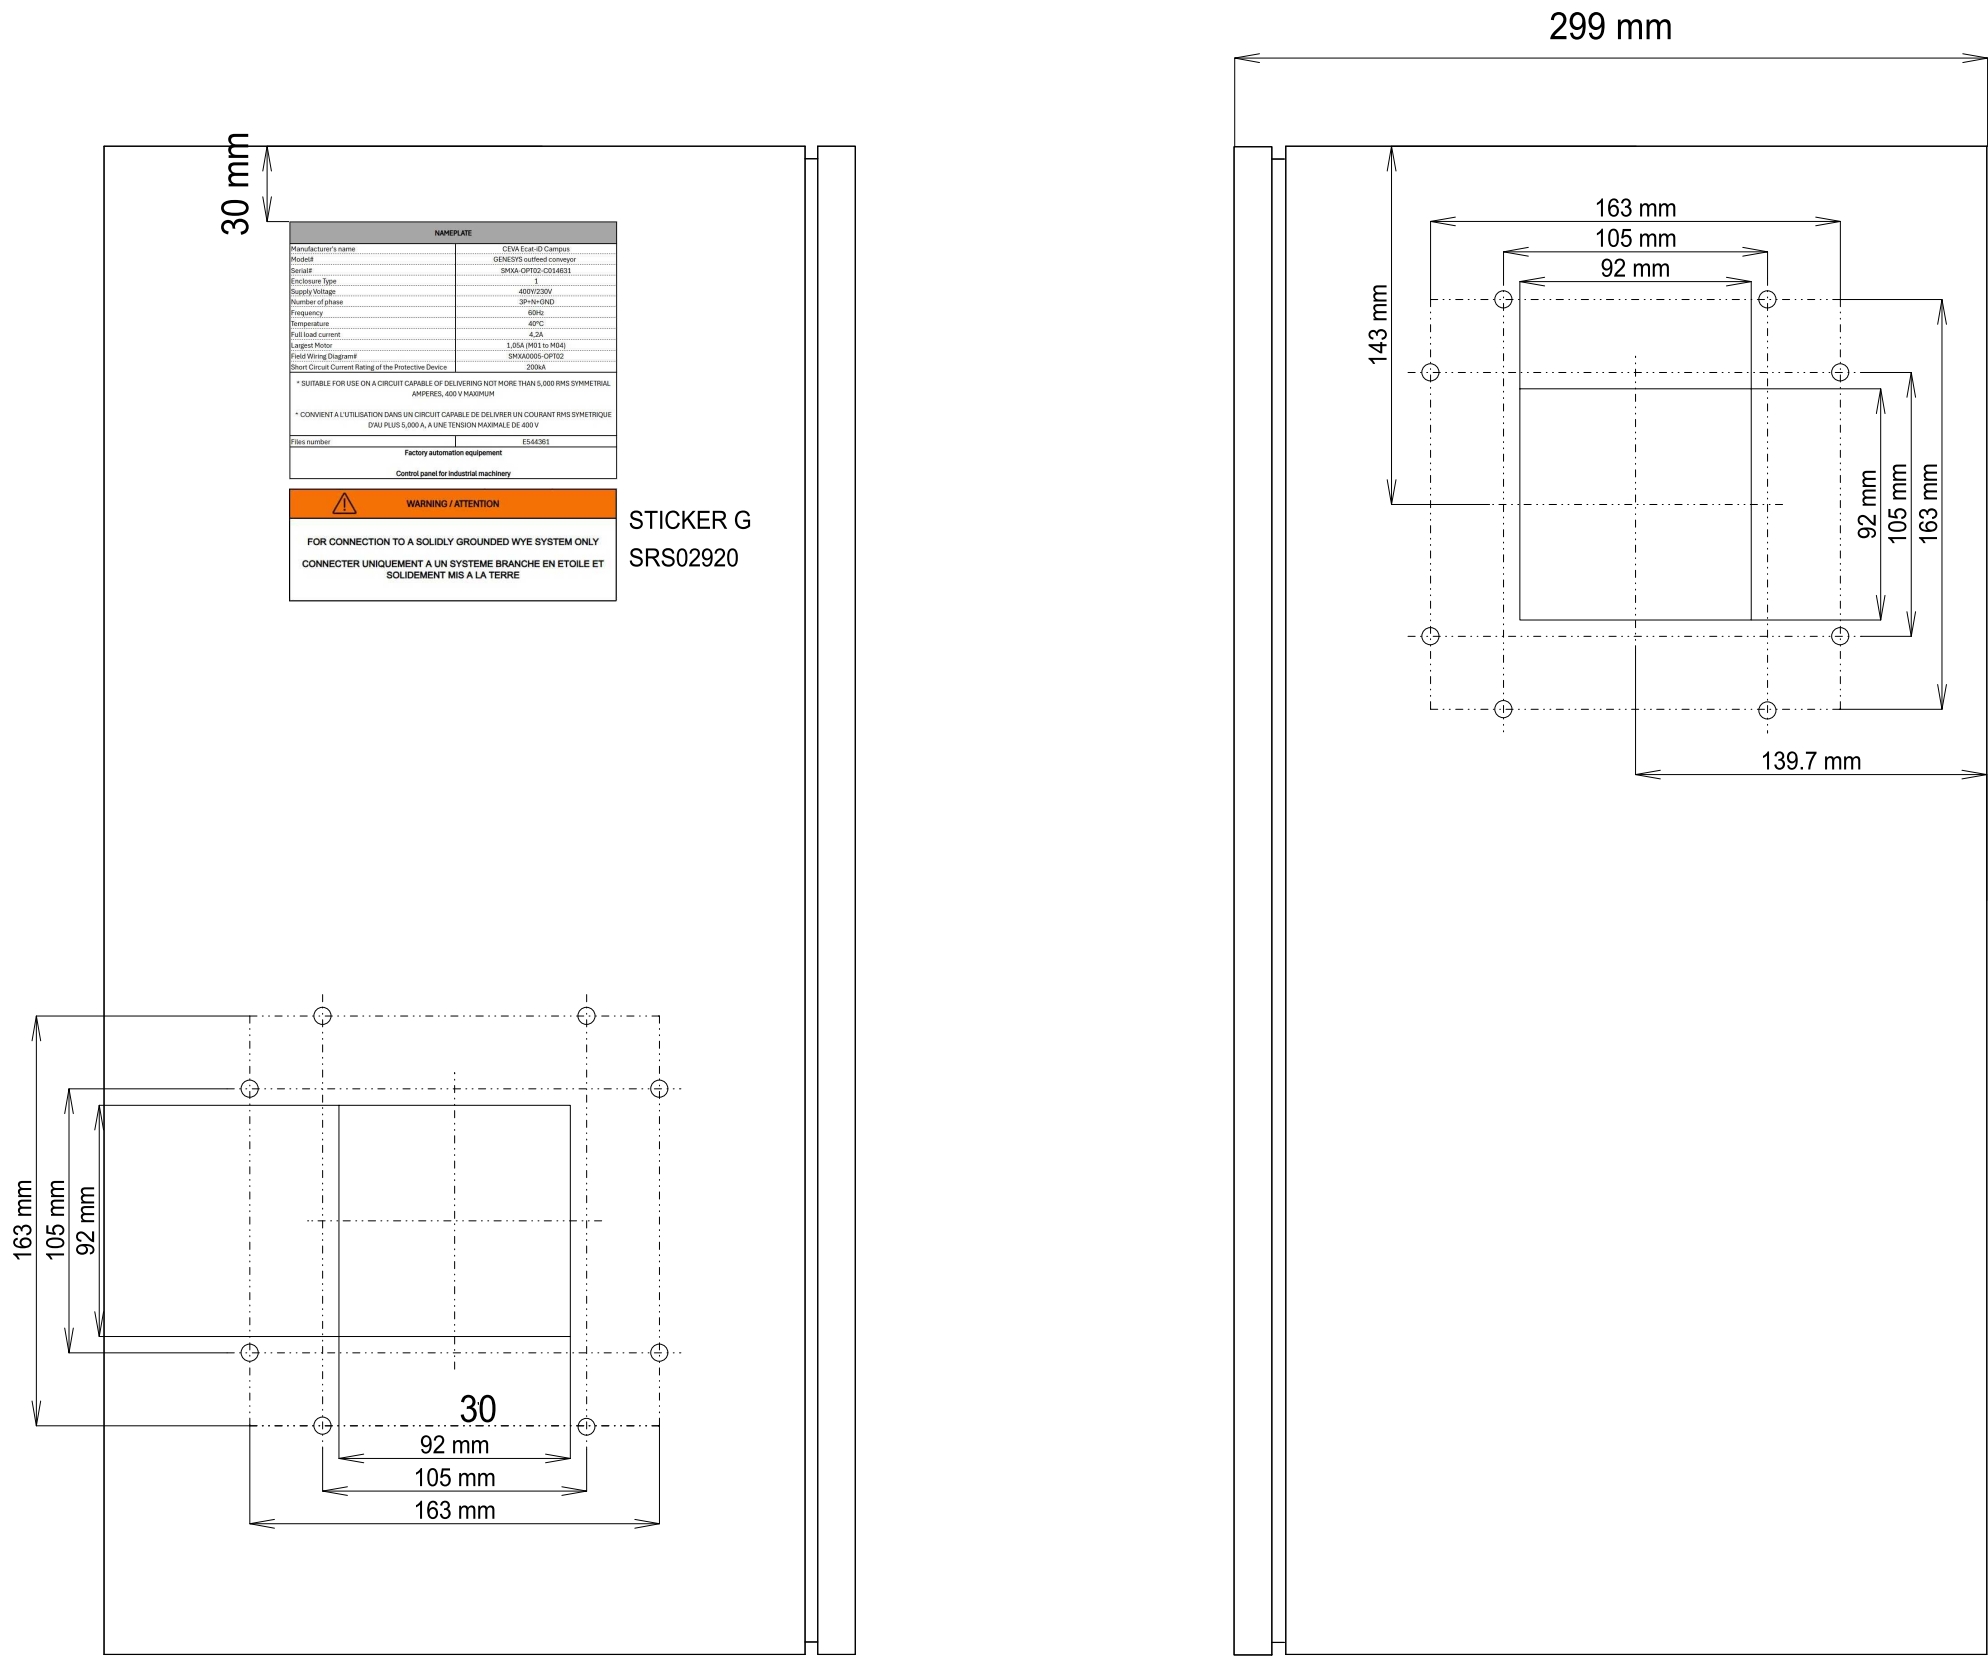

CABINET

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
19/06/2025

Designed by :
BM

IMPLANTATION COTE ARMOIRE

CABINET SIDE LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
C0

CUSTOMER :

ARTICLE :

SMXA0008-OPT2

COUNTRY :
USA

INDEX :
V1

FOLIO :
15/25

ECAT-ID

Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33) 2.98.85.31.36

Fax : (33) 2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
19/06/2025

Designed by :
BM

IMPLANTATION PLATINE ARMOIRE

CABINET BOARD LAYOUT

ENVIRONNEMENT : Elec_IEC V6R2_ECATID



Ecat-id Campus

CONTRACT :
C0

CUSTOMER :

ARTICLE :
SMXA0008-OPT2

INDEX :
V1


FOLIO :
16/25

COUNTRY :
USA

CABINET

IMPLANTATION PLATINE ARMOIRE


CABINET BOARD LAYOUT

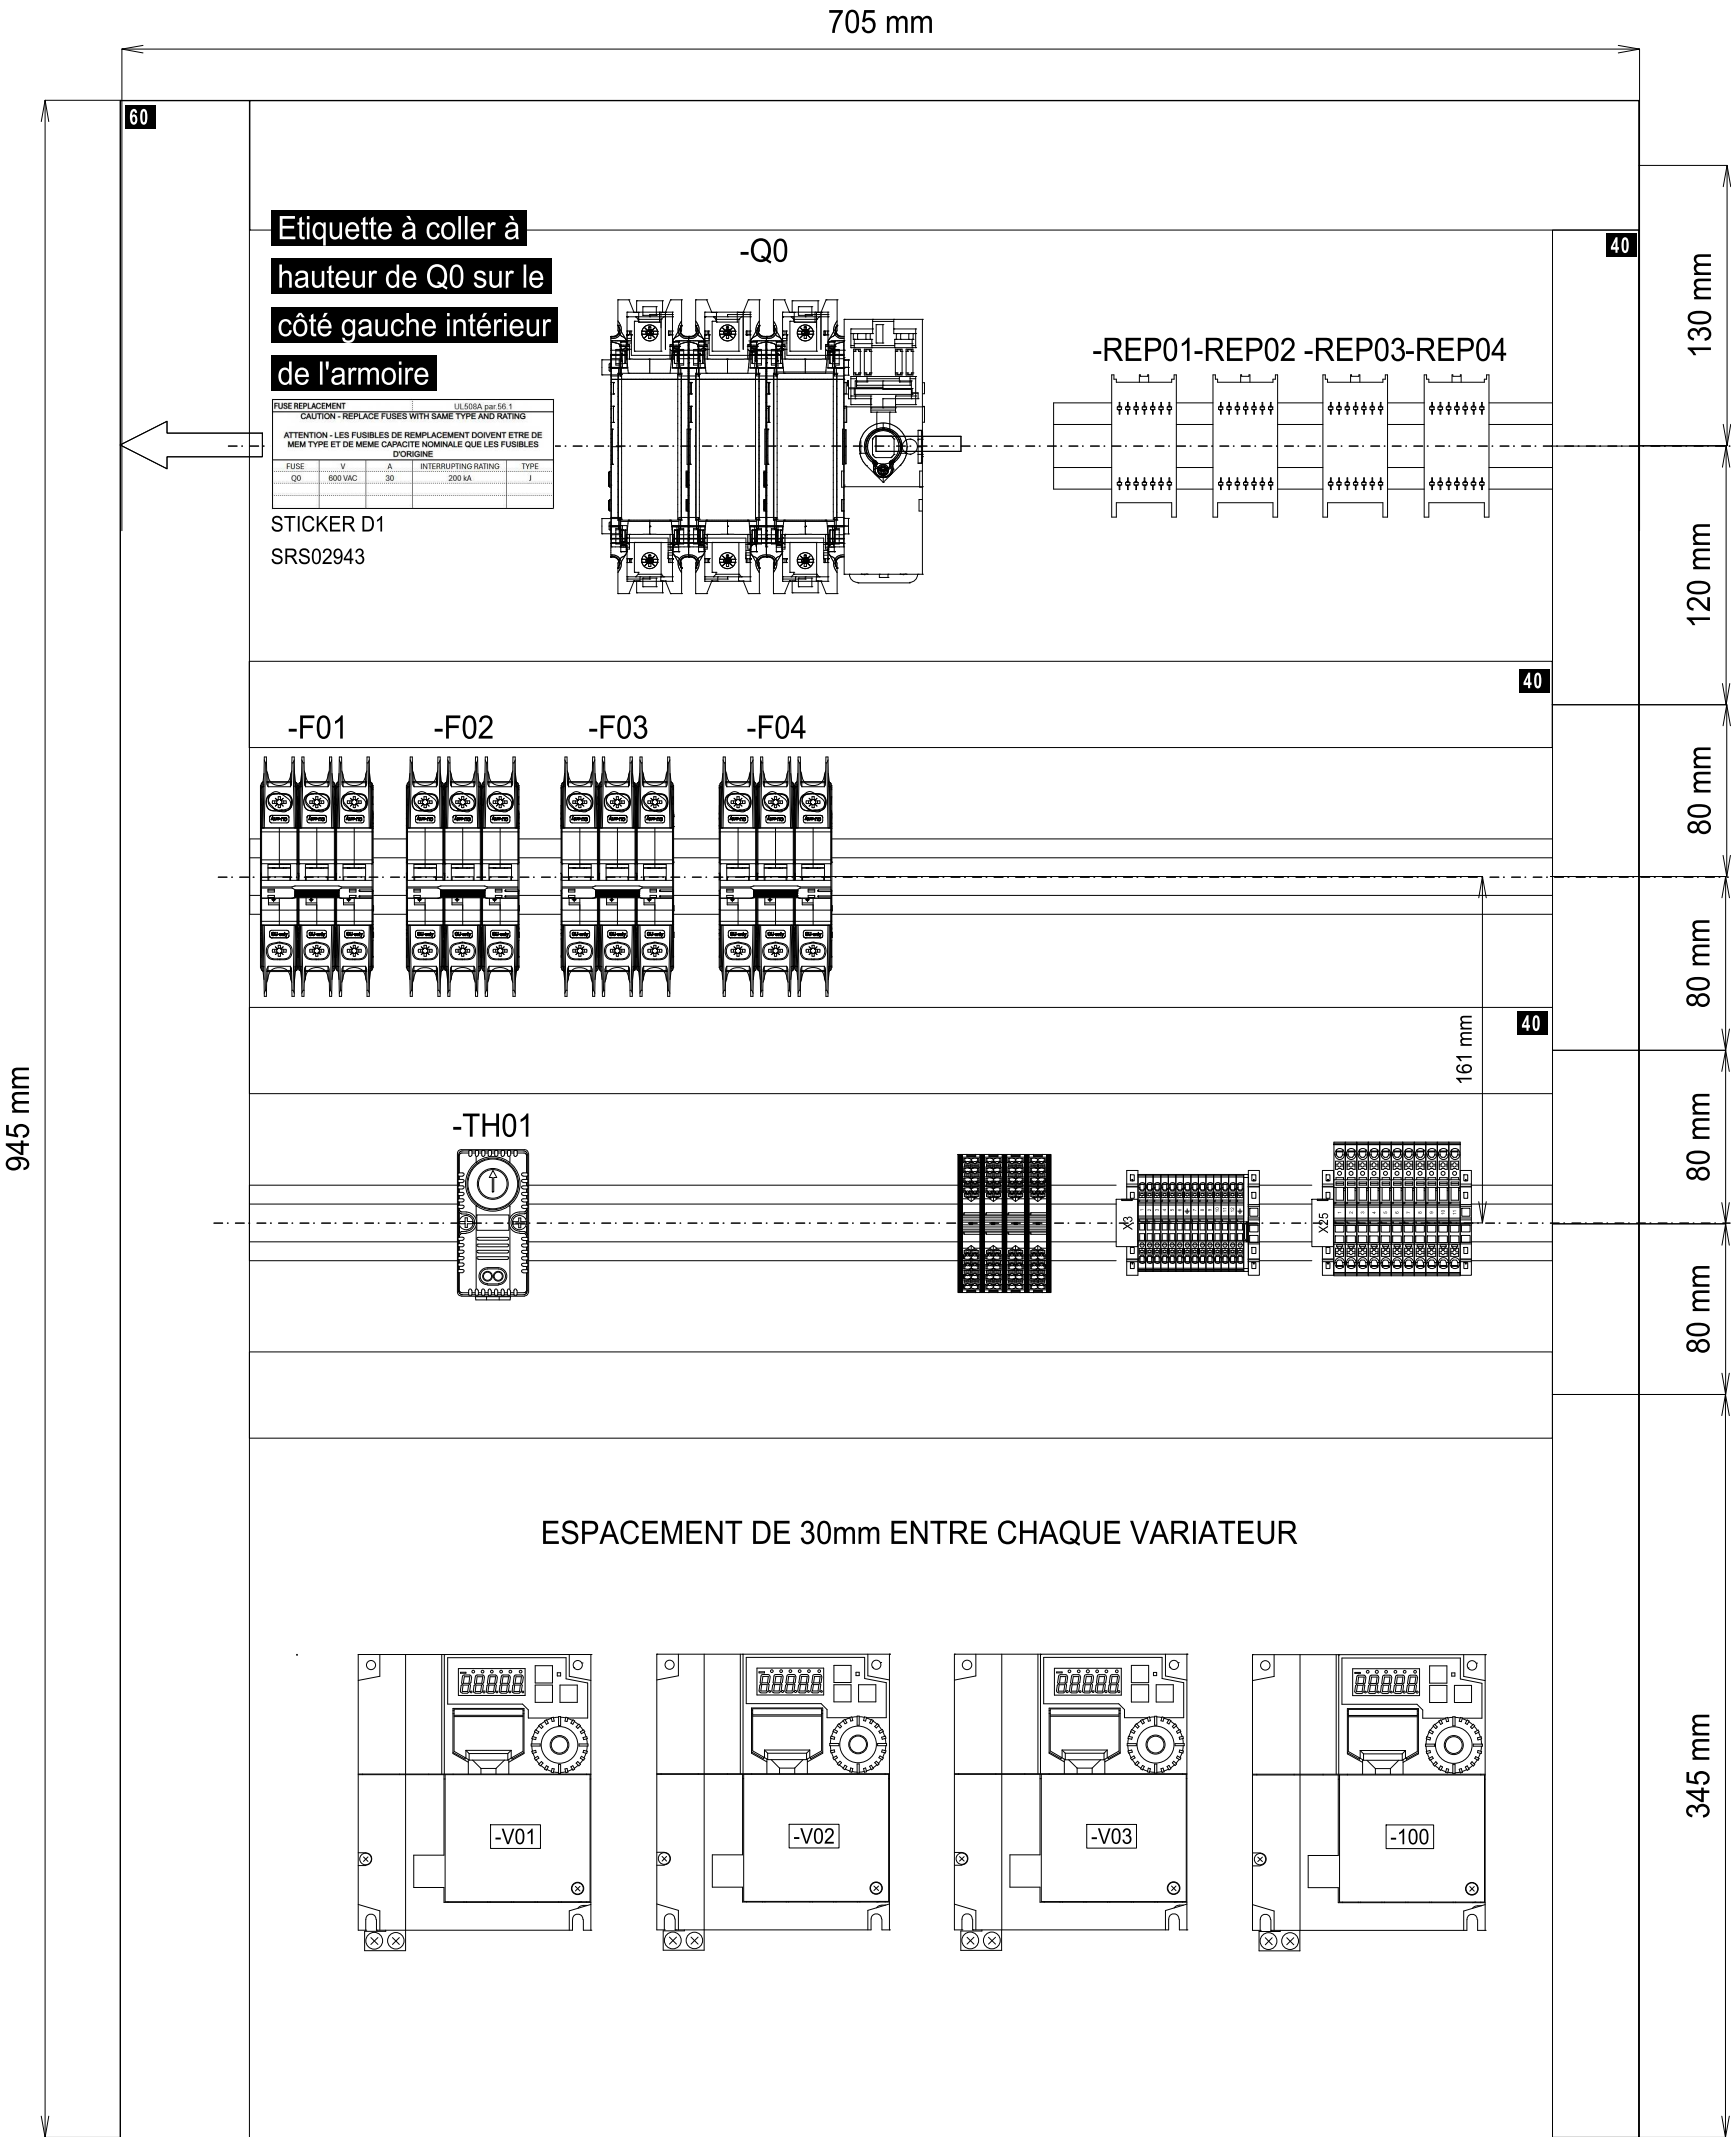

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.


LOCALISATION	FOLIO	REPERE	DESIGNATION	QTE	REFERENCE	CODE ECAT-ID	FABRICANT	FILTRE
		ETH_ECAT_200-2	CONNECTEUR RJ45 A MONTER IP20	2	100023085	CON00035	TELEGARTNER	ARMOIRE
	01	ARMOIRE	CELLULE INOX 1000X750X300	1	CPN7510030	BOX02058	MP GAMMA	ARMOIRE
	01	ARMOIRE	AUTOCOLLANT G	1	SRS02920	SRS02920	INTERNE	ARMOIRE
	01	ARMOIRE	AUTOCOLLANT H	1	SRS02921	SRS02921	INTERNE	ARMOIRE
	01	ARMOIRE	AUTOCOLLANT K	1	SRS02924	SRS02924	INTERNE	ARMOIRE
	01	ARMOIRE	AUTOCOLLANT L	1	SRS02925	SRS02925	INTERNE	ARMOIRE
	01	ARMOIRE	AUTOCOLLANT Y	1	SRS02938	SRS02938	INTERNE	ARMOIRE
	01	ARMOIRE	AUTOCOLLANT D1	1	SRS02943	SRS02943	INTERNE	ARMOIRE
CABINET	06	Q0	POIGNEE SECTIONNEUR SOCOMEC 60A FUSERBLOC UL	1	141G2111	SEC00085	SOCOMEK	ARMOIRE
CABINET	06	Q0	KIT INTERVERROUILLAGE NFPA79	1	37297540	SEC00061	SOCOMEK	ARMOIRE
CABINET	06	Q0	INTERRUPTEUR-SECTIONNEUR-FUSIBLE TS J 3x30A F/L 200kA	1	38613004	SEC00096	SOCOMEK	ARMOIRE
CABINET	06	Q0	FUSIBLE TEMPORISE UL, TYPE J 30A	3	6J000030	DIS00301	SOCOMEK	ARMOIRE
CABINET	06	REP01	DISTRIBUTEUR DE BLOCS, 1P, 80A, 1000V, 6 SORTIES	1	RPU2995	ELC02106	TEKNOMEGA	ARMOIRE
CABINET	06	REP02	DISTRIBUTEUR DE BLOCS, 1P, 80A, 1000V, 6 SORTIES	1	RPU2995	ELC02106	TEKNOMEGA	ARMOIRE
CABINET	06	REP03	DISTRIBUTEUR DE BLOCS, 1P, 80A, 1000V, 6 SORTIES	1	RPU2995	ELC02106	TEKNOMEGA	ARMOIRE
CABINET	06	REP04	DISTRIBUTEUR DE BLOCS, 1P, 80A, 1000V, 6 SORTIES	1	RPU2995	ELC02106	TEKNOMEGA	ARMOIRE
CABINET	07	CEM01	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CABINET	07	CEM02	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CABINET	07	CEM03	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CABINET	07	CEM04	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
CABINET	07	F01	DISJONCTEUR MINIATURE, 3P, 10A, COURBE D	1	1489-M3D100	DIS00361	ALLEN-BRADLEY	ARMOIRE
CABINET	07	F02	DISJONCTEUR MINIATURE, 3P, 10A, COURBE D	1	1489-M3D100	DIS00361	ALLEN-BRADLEY	ARMOIRE
CABINET	07	F03	DISJONCTEUR MINIATURE, 3P, 10A, COURBE D	1	1489-M3D100	DIS00361	ALLEN-BRADLEY	ARMOIRE
CABINET	07	F04	DISJONCTEUR MINIATURE, 3P, 10A, COURBE D	1	1489-M3D100	DIS00361	ALLEN-BRADLEY	ARMOIRE
CABINET	07	V01	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
CABINET	07	V01	VECTOR VARIATEUR DE FREQUENCE, 380-480VAC TRI, 0.4/0.75 kW,	1	3G3MX2-A4004-EV2	VAR00720	OMRON	ARMOIRE
CABINET	07	V02	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
CABINET	07	V02	VECTOR VARIATEUR DE FREQUENCE, 380-480VAC TRI, 0.4/0.75 kW,	1	3G3MX2-A4004-EV2	VAR00720	OMRON	ARMOIRE
CABINET	07	V03	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
CABINET	07	V03	VECTOR VARIATEUR DE FREQUENCE, 380-480VAC TRI, 0.4/0.75 kW,	1	3G3MX2-A4004-EV2	VAR00720	OMRON	ARMOIRE
CABINET	07	V04	CARTE DE COMMUNICATION ETHERCAT POUR ONDULEUR MX2	1	3G3AX-MX2-ECT	VAR00351	OMRON	ARMOIRE
CABINET	07	V04	VECTOR VARIATEUR DE FREQUENCE, 380-480VAC TRI, 0.4/0.75 kW,	1	3G3MX2-A4004-EV2	VAR00720	OMRON	ARMOIRE
CABINET	07	Z01	FILTRE RFI 5A 400VAC, TRI POUR VARIATEUR 0,37 A 0,55KW	1	AX-FIC4005-SE	VAR00719	OMRON	ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		NOMENCLATURE ARMOIRE FRANCAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH ENCLOSURE PART LIST								ARTICLE :		INDEX : V1			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								SMXA0008-OPT2				FOLIO : 17/25	

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		NOMENCLATURE BOUTONNERIE FRANCAISE				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH BUTTON PARTS LIST								ARTICLE : SMXA0008-OPT2			INDEX : V1			
			E-mail : ecatid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								FOLIO : 19/25						

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		CARNET DE CABLE FRANCAIS			 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :		COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH CABLE BOOKLET							ARTICLE : SMXA0008-OPT2		INDEX : V1			
			E-mail : ecatic.service@ceva.com			ENVIRONNEMENT : Elec_IEC V5R2_ECATID			FOLIO : 21/25										

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		CARNET DE CABLE ANGLAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		ENGLISH CABLE BOOKLET								ARTICLE :			INDEX : V1			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATID								SMXA0008-OPT2			FOLIO : 22/25			

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		NOMENCLATURE MOTEUR FRANCAIS				 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA	
			Fax : (33).2.98.85.31.38		Designed by : BM		FRENCH MOTOR PART LIST								ARTICLE :			INDEX : V1			
			E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Elec_IEC V5R2_ECATID							SMXA0008-OPT2			FOLIO : 23/25			

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 19/06/2025		NOMENCLATURE MOTEUR ANGLAIS			 Ecat-iD Campus				CONTRACT : C0		CUSTOMER :			COUNTRY : USA		
			Fax : (33).2.98.85.31.38		Designed by : BM		MOTOR PARTS LIST							ARTICLE : SMXA0008-OPT2						INDEX : V1	
			E-mail : ecatic.service@ceva.com					ENVIRONNEMENT : Elec_IEC V5R2_ECATID						FOLIO : 24/25							

