

Cabinet no. :

Cabinet material :

INOX

Cabinet size :

H450xL600xP250

Brand of enclosure :

IRINOX

Enclosure material :

N/A

Equipment used :

Button brand :

SCHNEIDER ELECTRIC

Button language :

FRANÇAIS

PLC brand :

N/A

HMI brand :

N/A

Wiring

Breaking capacity Icc :

10kA

Shielded cables on drives

Wire colours :

Phase 230V: Black

24VDC: Violet

Neutral 230V: Blue

12VDC or 15VDC : Red

115V phase: Brown

5VDC: Grey

Neutral 115V: Brown with blue stripes

48VDC : Yellow

Earth: Green/Yellow

0VDC : White

External potential : Orange

External neutral: Orange with blue stripes

Estimated electrical characteristics

Total rated power (kW) :

N/A

Total rated current (Amps) :

16

Recommended main circuit breaker (Customer)

Circuit breaker rating (Amps) :

16A / 30mA

Circuit breaker curve (type) :

C

Minimum cross-section of supply cable (Customer) :

230VAC 1PH+N+GND

Wire cross-section (mm²) :

2.5mm²

Cable type (Number of wires) :

3G2.5mm²

H07 RNF / U1000 R2V

The main circuit breaker and the supply cable may be different depending on the electrical installation
(Cable material, length, installation method, ...)

V2	MAJ - Séparation commande éclairage et trigger	07/10/2025	MB		
V1	CREATION	18/03/2025	MB	AV	JT
INDEX	MODIFICATION	DATE	DESIGNED BY	VERIFIED BY	APPROVED BY

BANC DE CALIBRATION CAMERAS GENESYS

LASER LIFE

DESIGNED BY : MB

VERIFIED BY : AV

DATE CREATED : 18/03/2025

CUSTOMER : ECAT-ID

CONTRACT NO. : INTERNE

PROCESS N° : PMXA

ECAT-ID

Z.I DE KERIEL

29800 PLOUEDERN

FRANCE

Tel : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecaticid.service@ceva.com

ENVIRONNEMENT IGE-XAO : Elec_IEC V5R2_ECATID Environment for electrical controls and automation systems (according to IEC standard)

FOLIO : 01/22



Ecat-iD Campus

COUNTRY :

INTERNE


DRAWING NUMBER :

SMXA04264

[illegible][illegible]

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 18/03/2025		LISTE DE FOLIOS FRANCAIS				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID			COUNTRY : INTERNE	
			Fax : (33).2.98.85.31.38		Designed by : MB		FRENCH FOLIOS LIST								ARTICLE :		SMXA04264			INDEX : v2	
			E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID				02/22												

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

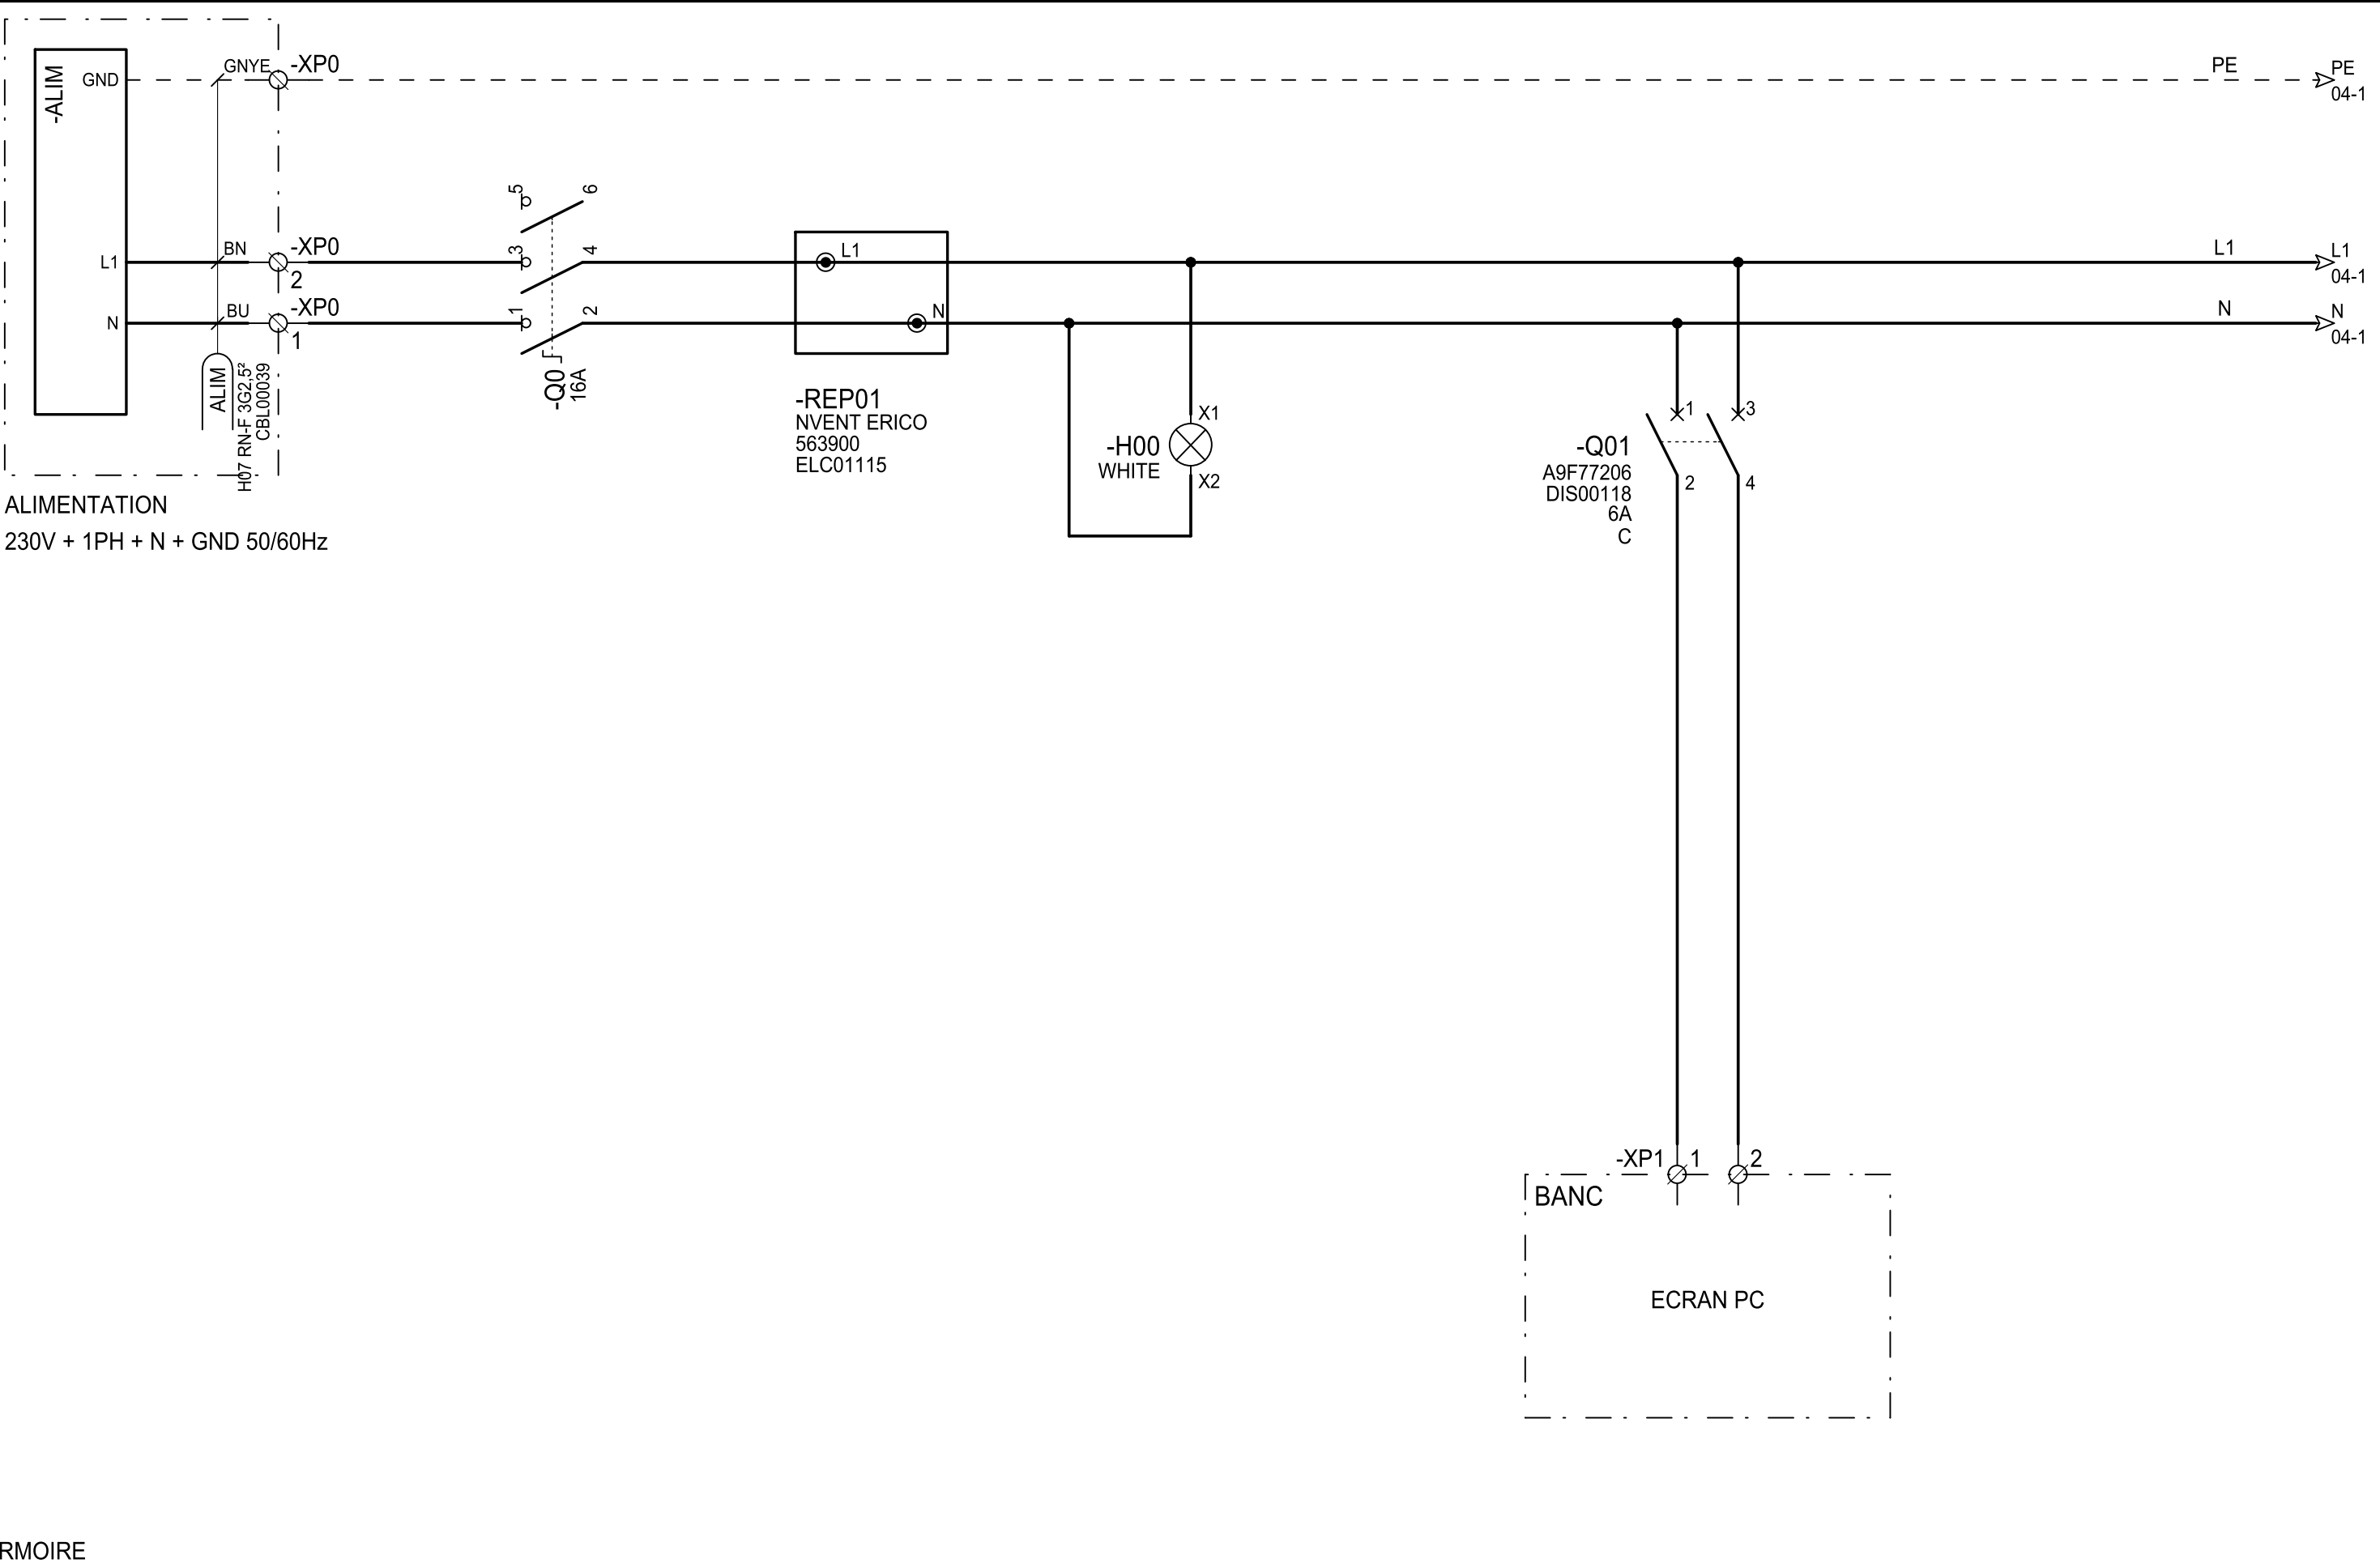


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecaticid.service@ceva.com		Date of creation : 18/03/2025		SCHEMA DE PUISSANCE			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID			COUNTRY : INTERNE	
					Designed by : MB		POWER DIAGRAM							ARTICLE :		SMXA04264			INDEX : V1	
					ENVIRONNEMENT : Elec_IEC V5R2_ECATID									FOLIO : 03/22						

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----

04/22


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

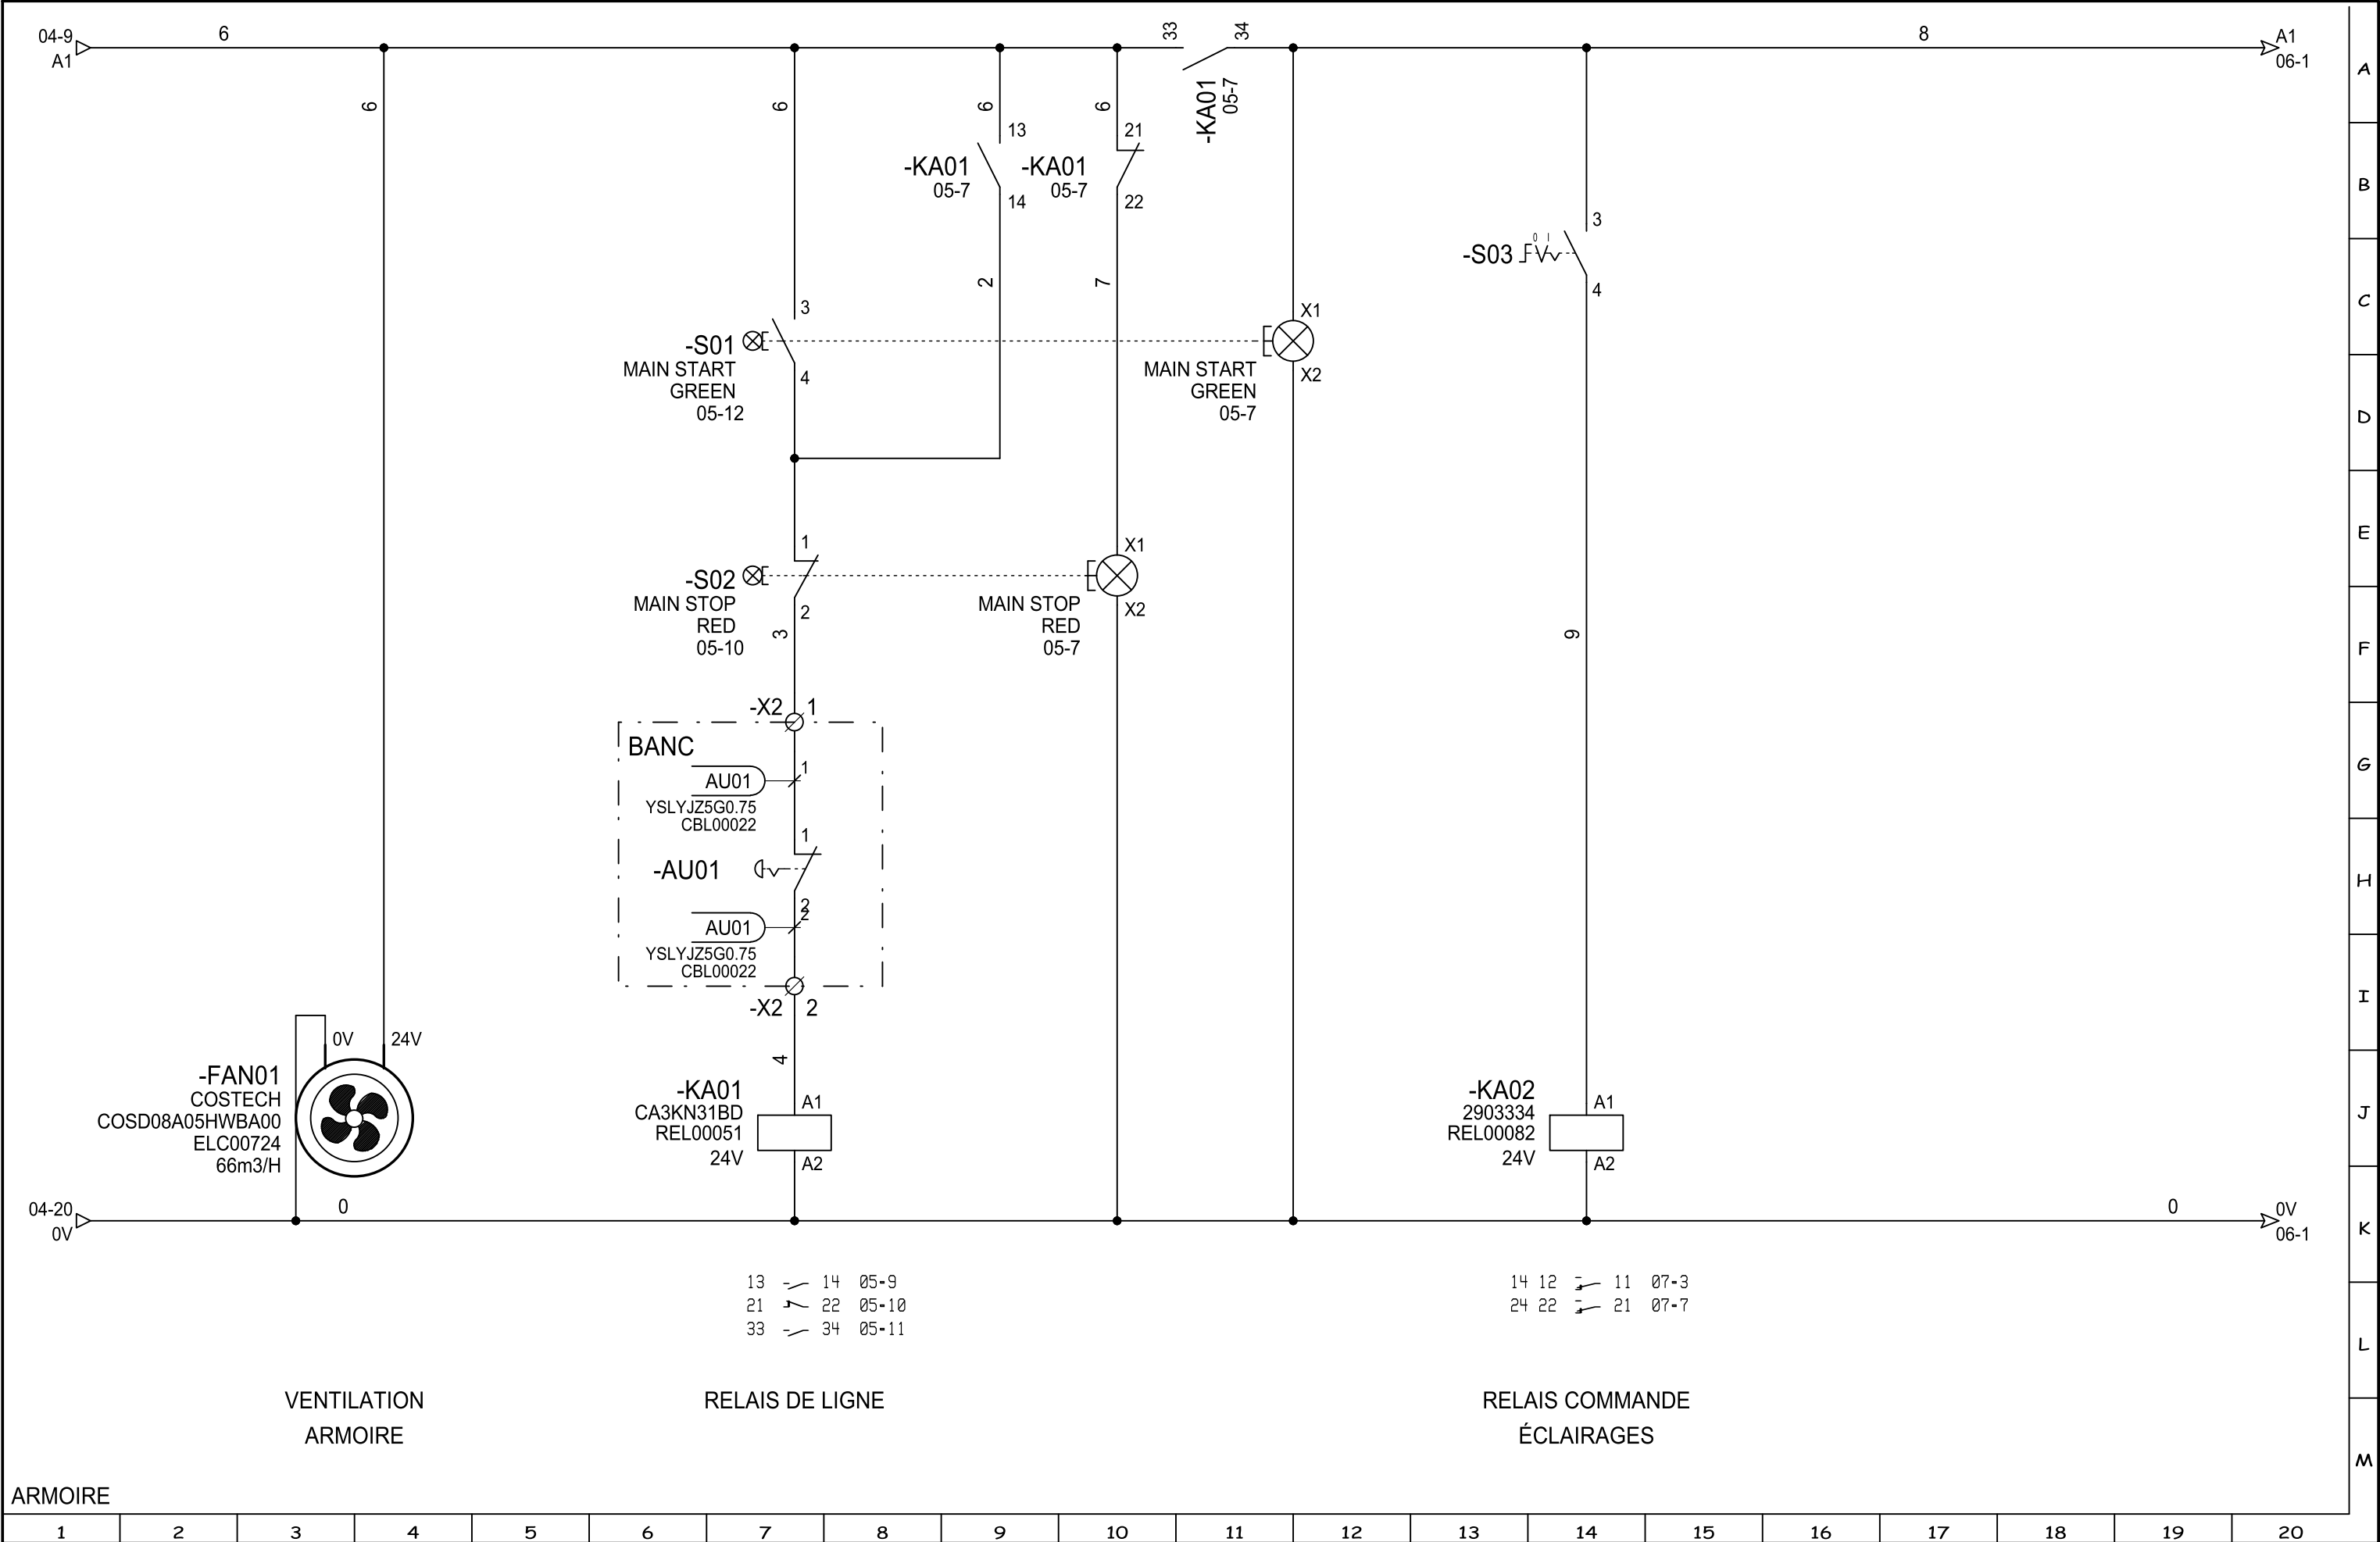

ARMOIRE

ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE	Tél : (33).2.98.85.31.36	Date of creation : 18/03/2025	SCHEMA DE COMMANDE	 Ecat-iD Campus	CONTRACT : INTERNE	CUSTOMER : ECAT-ID	COUNTRY : INTERNE
	Fax : (33).2.98.85.31.38	Designed by : MB	CONTROL DIAGRAM		ARTICLE : SMXA04264	INDEX : V1	
	E-mail : ecatid.service@ceva.com	ENVIRONNEMENT : Elec_IEC V5R2_ECATID	FOLIO : 05/22				


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

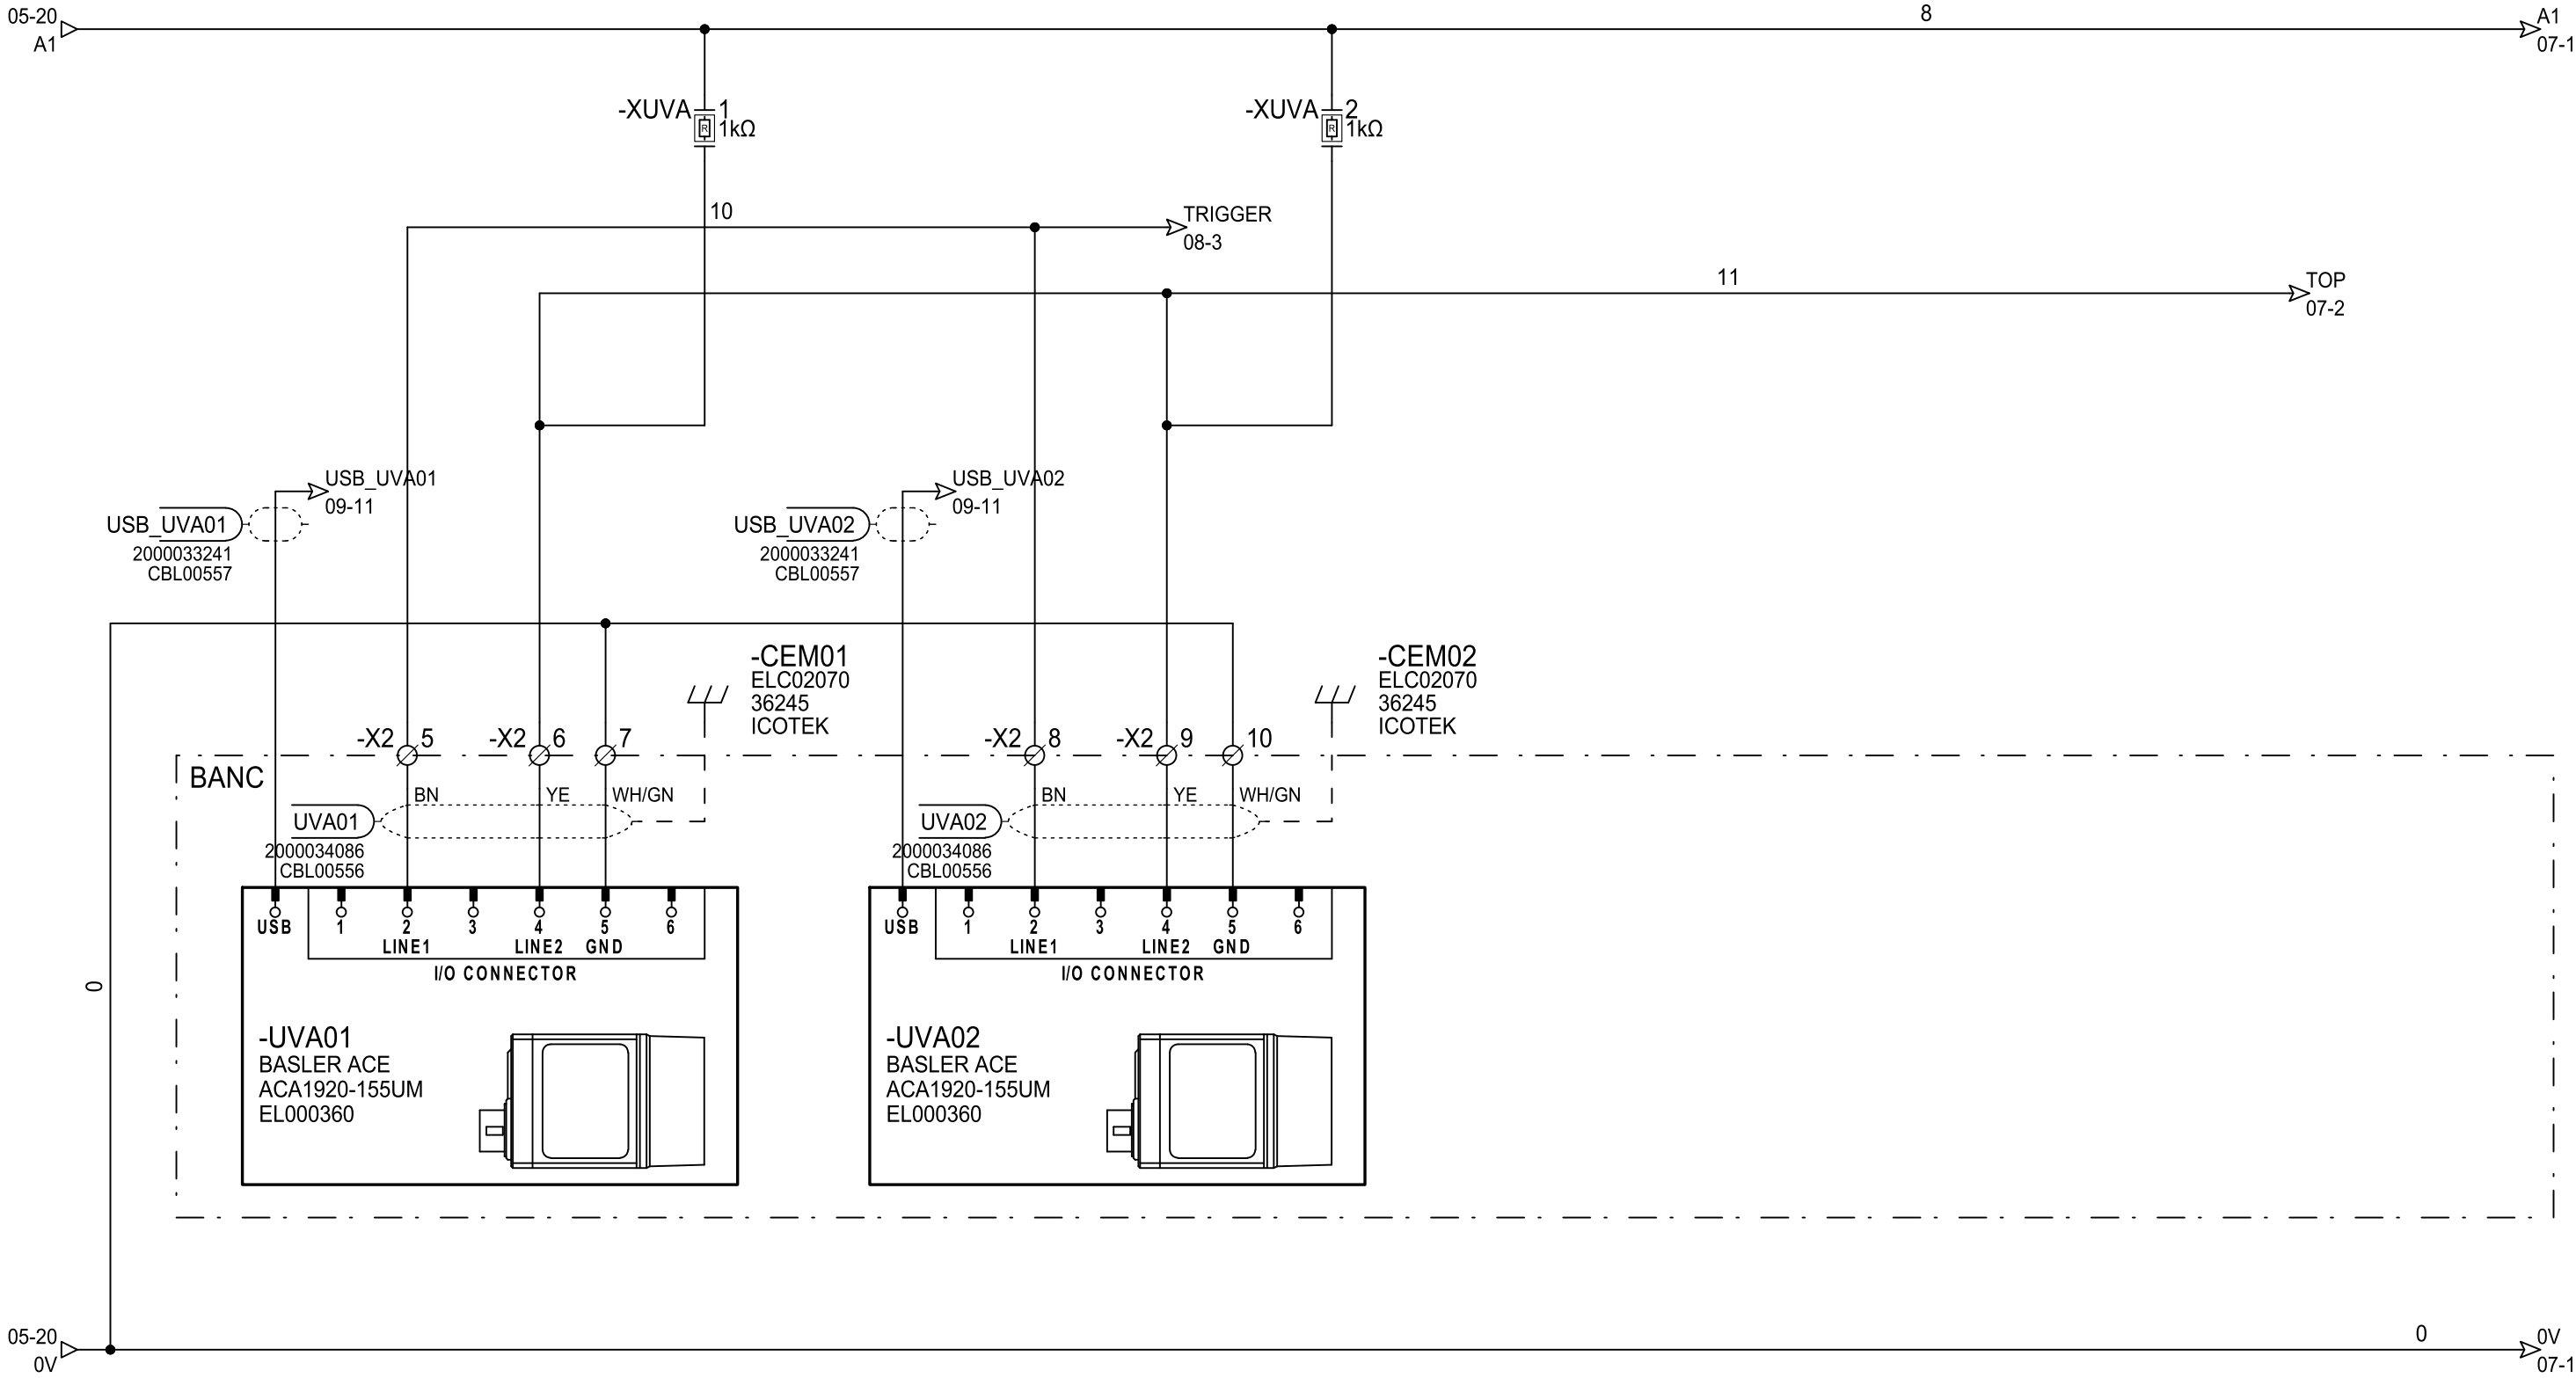

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatic.service@ceva.com		Date of creation : 18/03/2025		SCHEMA DE COMMANDE			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
					Designed by : MB		CONTROL DIAGRAM							ARTICLE : SMXA04264		INDEX : V1			
					ENVIRONNEMENT : Elec_IEC V5R2_ECATIC														
FOLIO : 06/22																			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

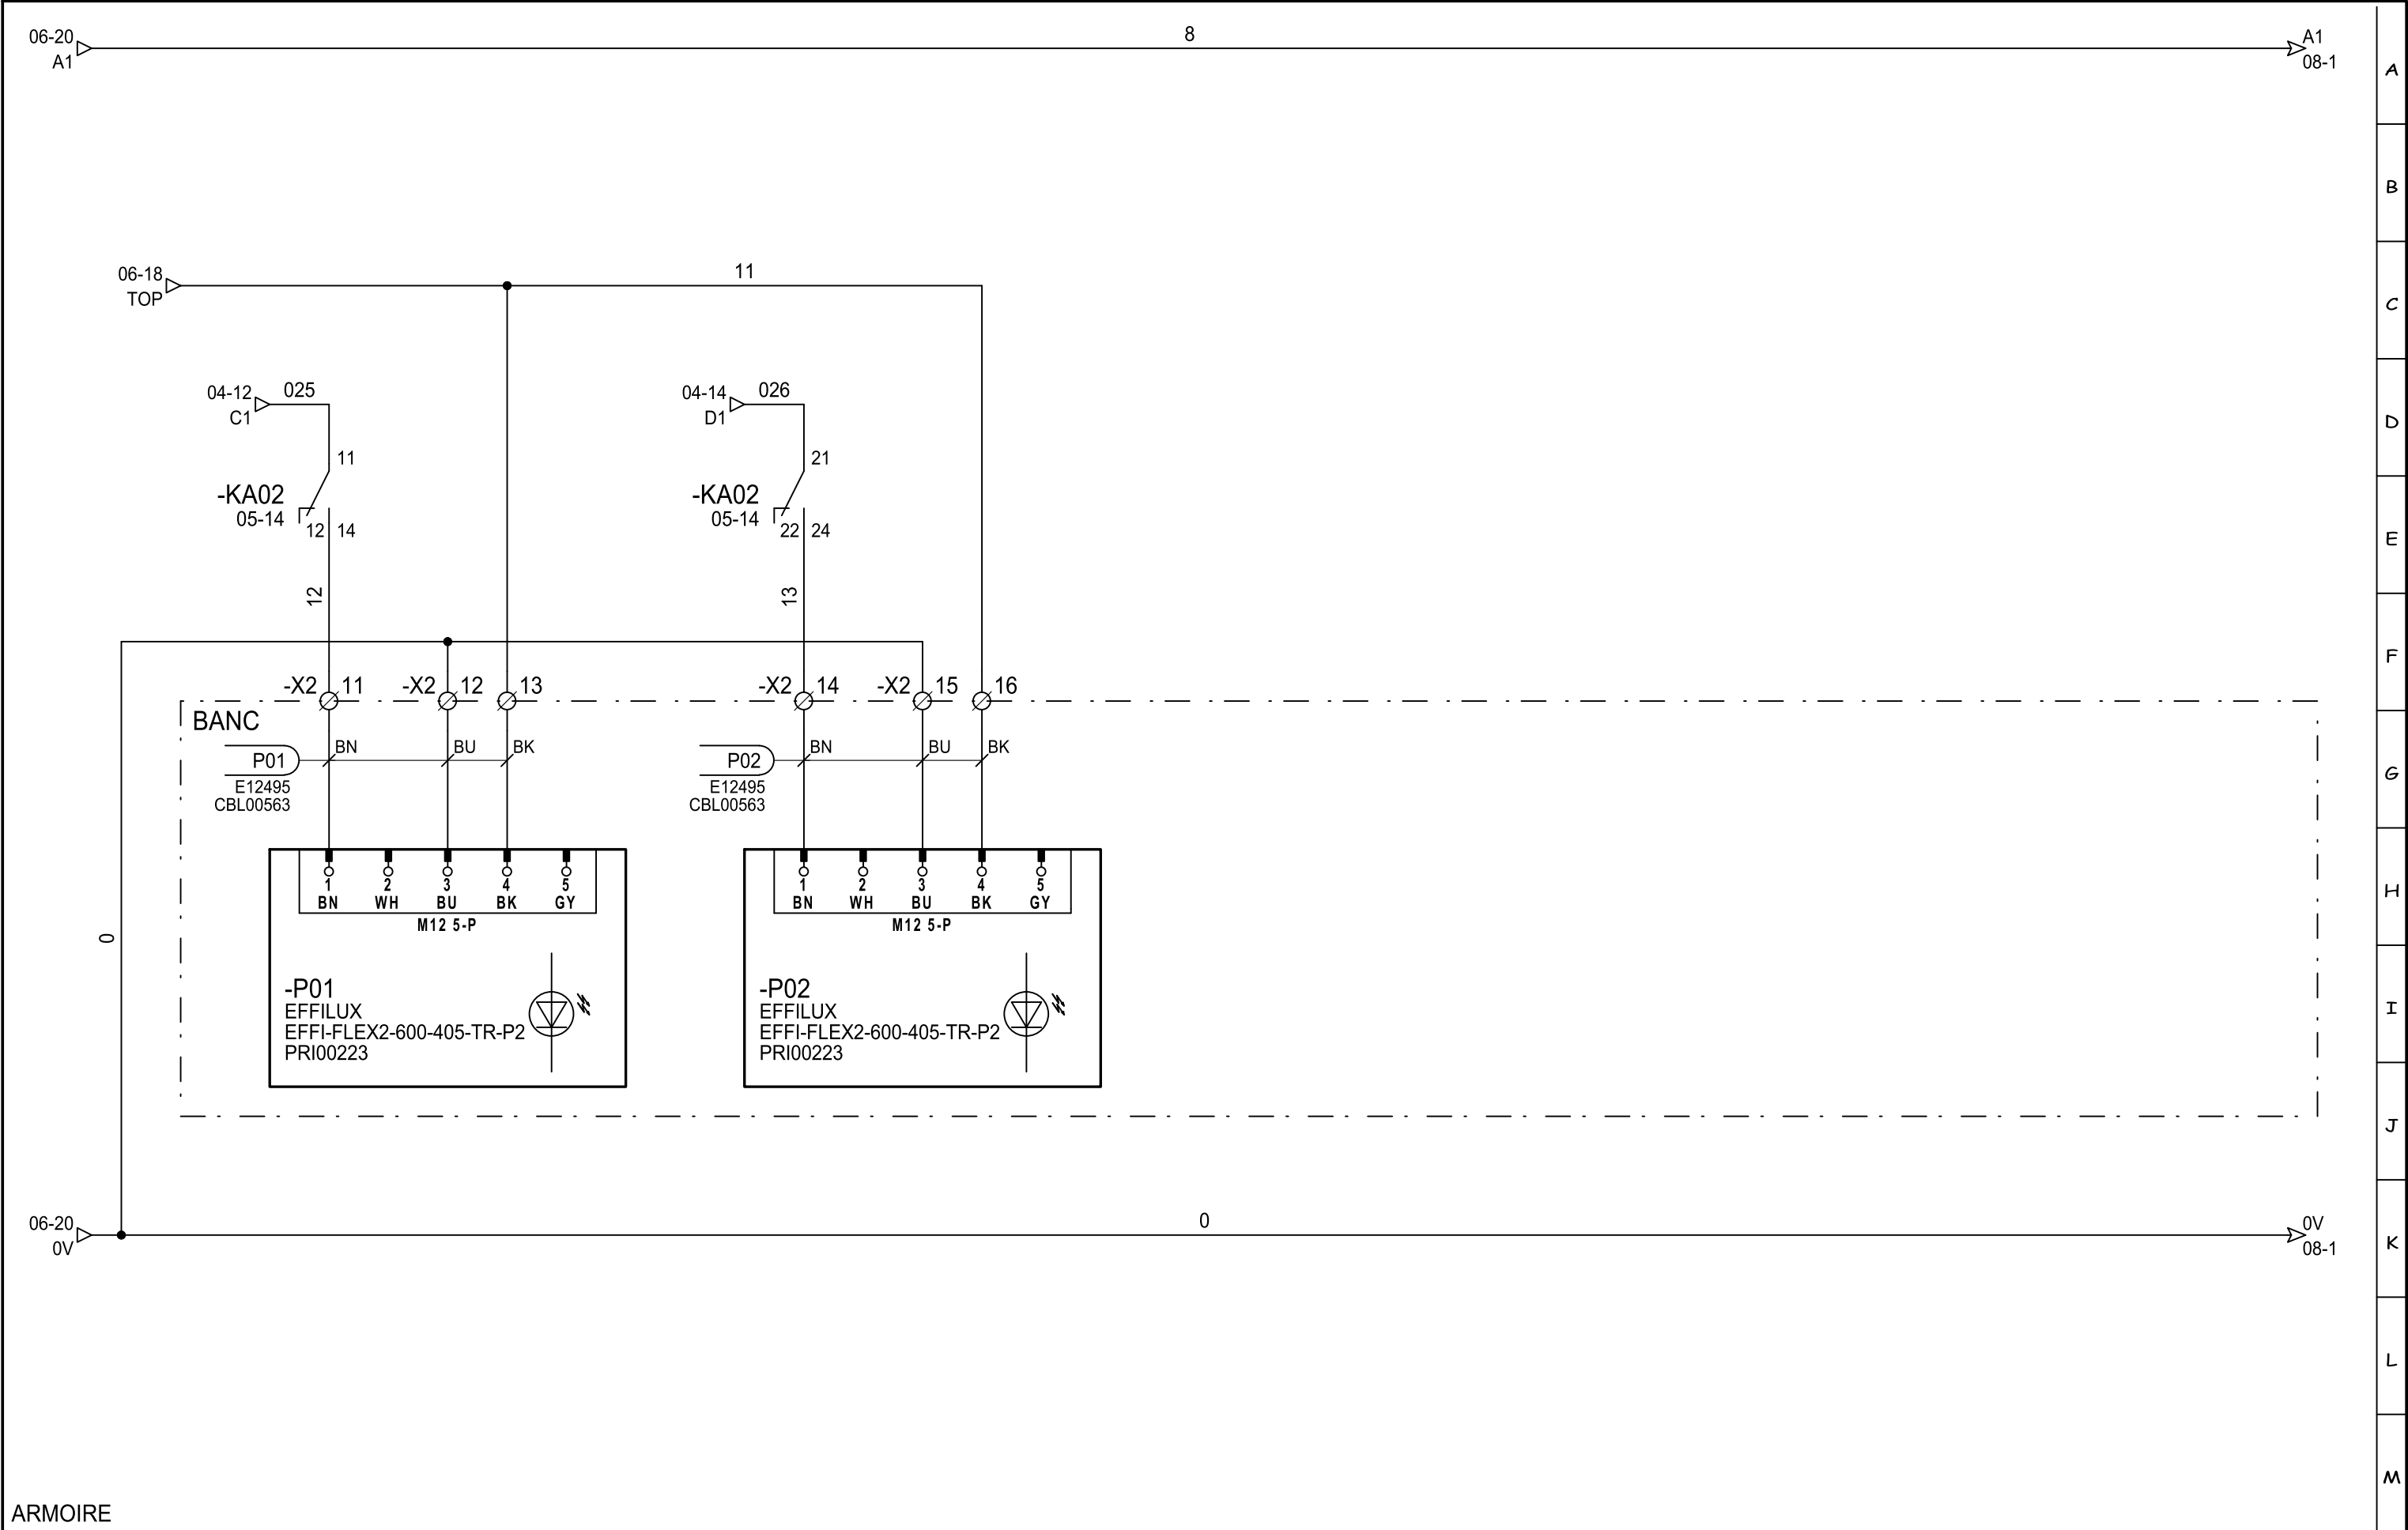

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 18/03/2025		SCHEMA DE COMMANDE			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
					Designed by : MB		CONTROL DIAGRAM							ARTICLE : SMXA04264		INDEX : V1			
			Fax : (33).2.98.85.31.38		E-mail : ecatic.service@ceva.com		ENVIRONNEMENT : Elec_IEC V5R2_ECATID									FOLIO : 07/22			


THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

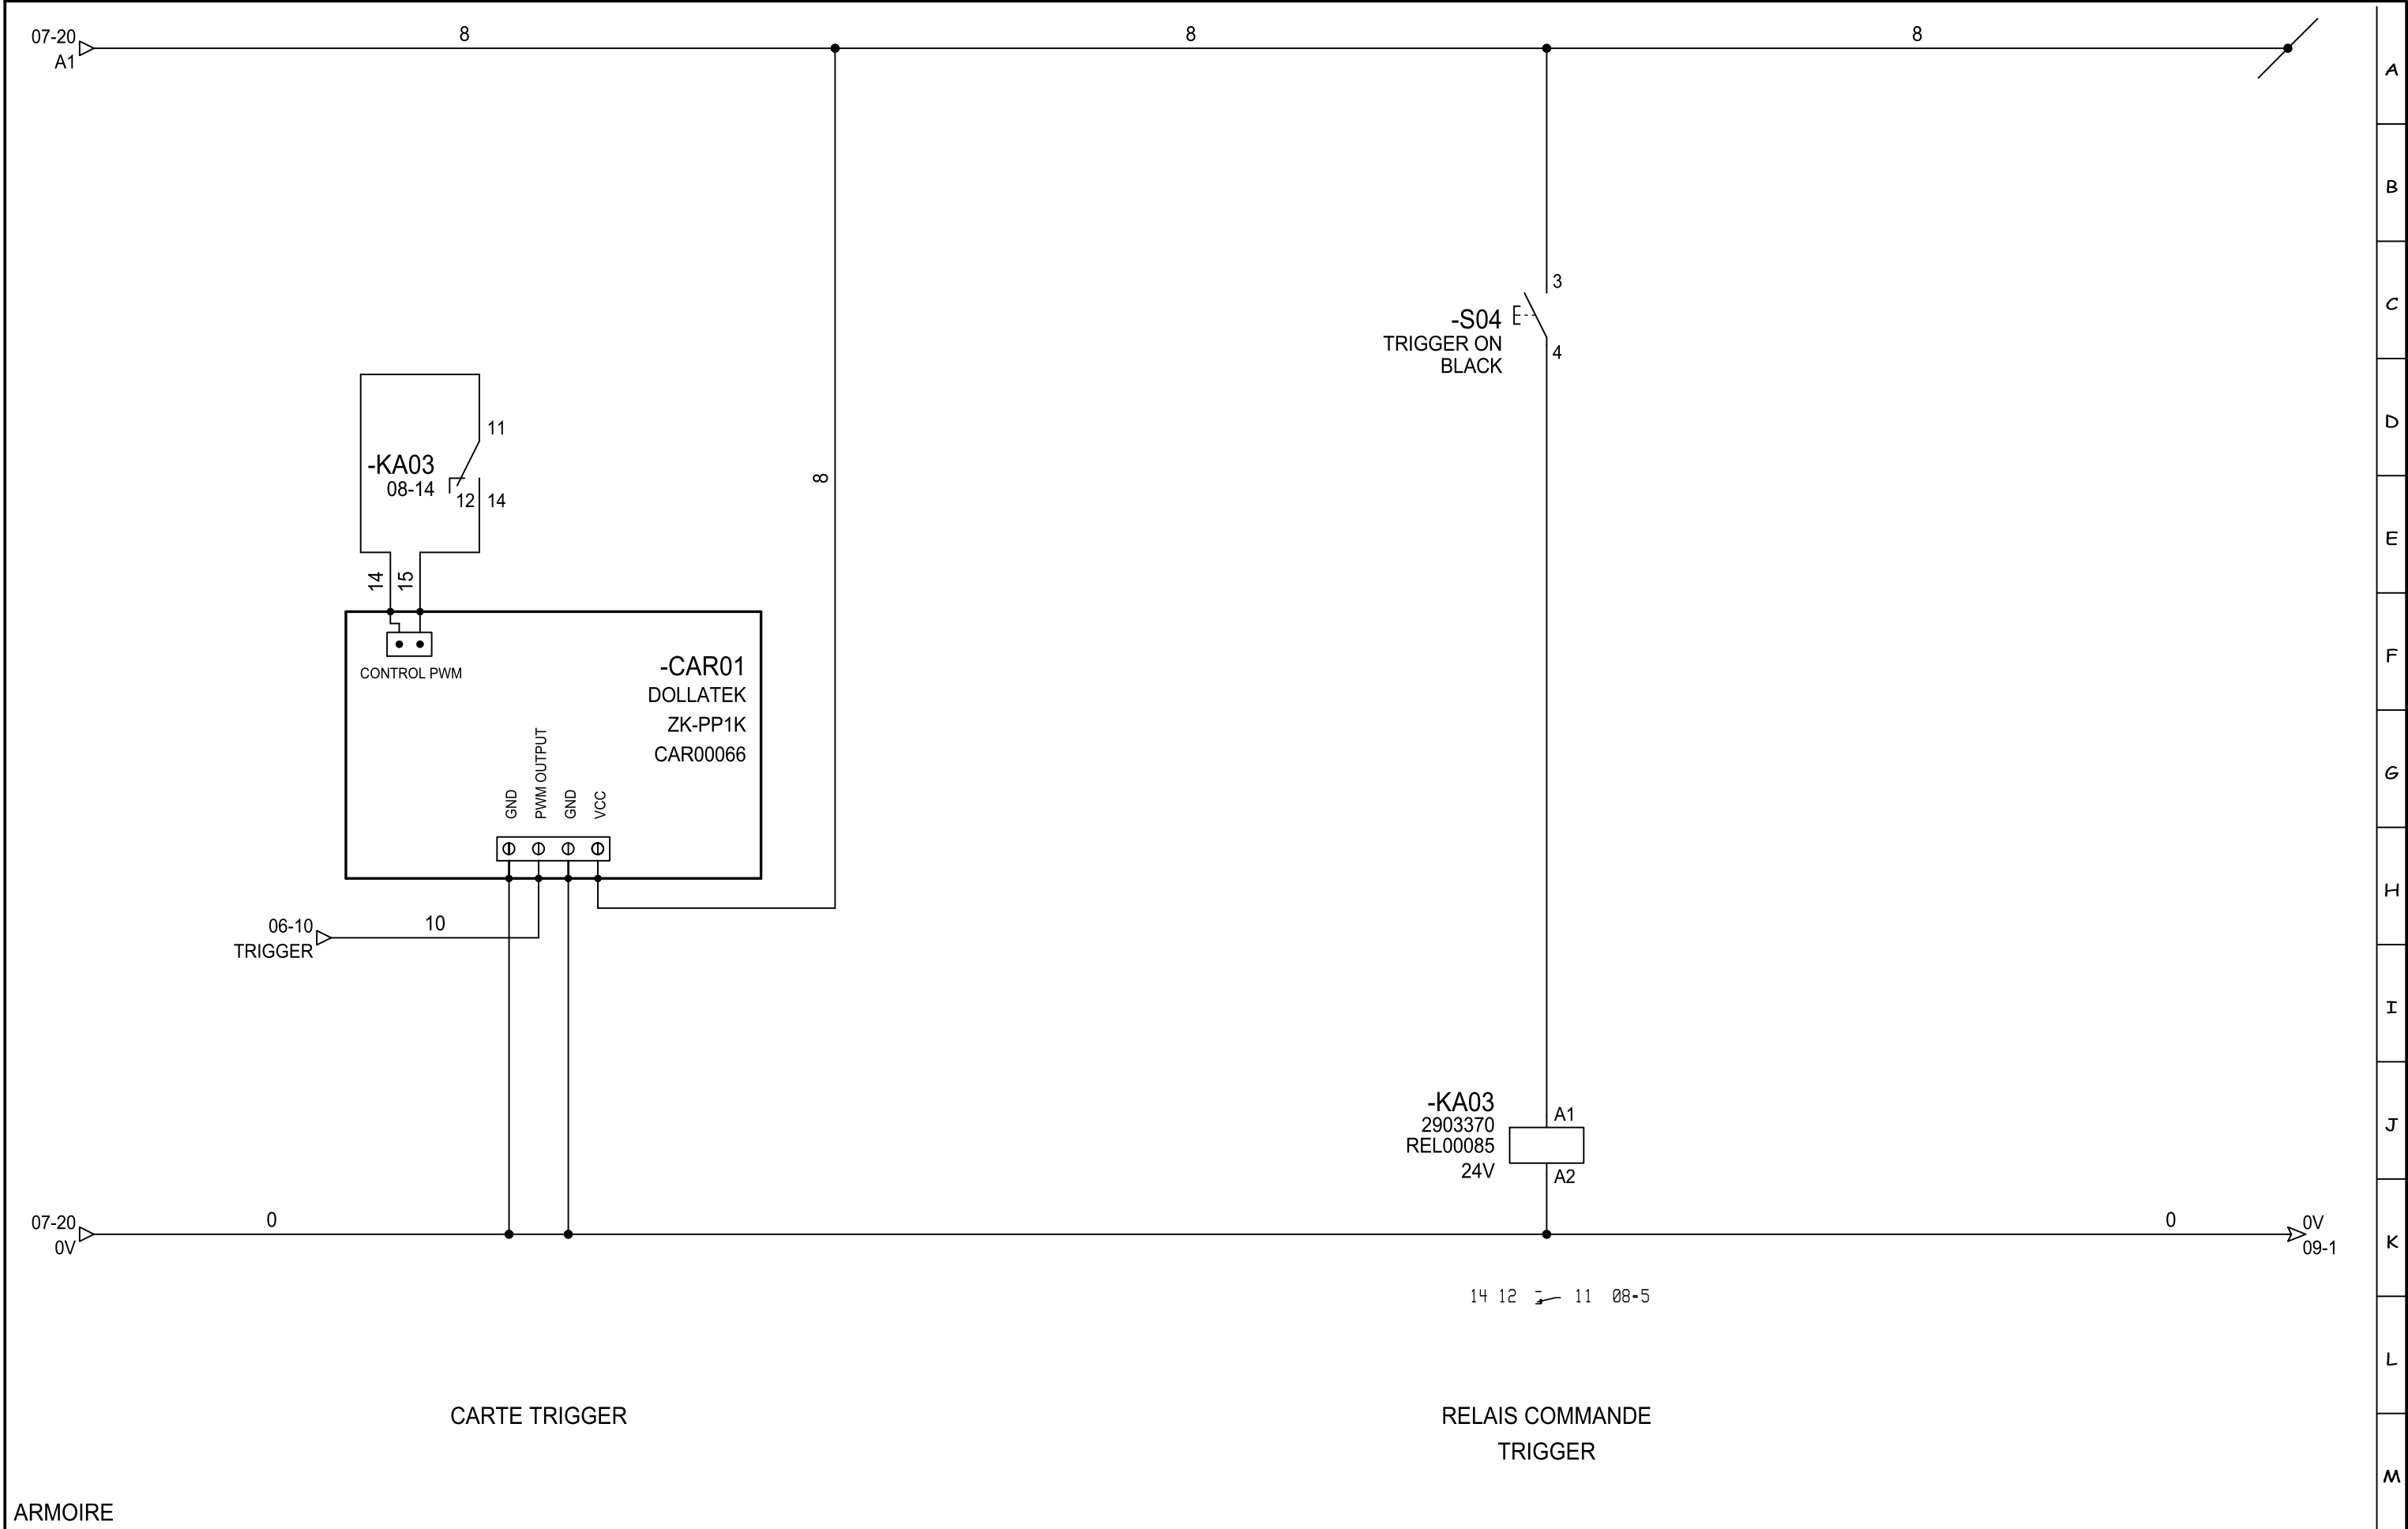

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatid.service@ceva.com		Date of creation : 18/03/2025		SCHEMA DE COMMANDE				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
					Designed by : MB		CONTROL DIAGRAM								ARTICLE : SMXA04264		INDEX : V2			
					ENVIRONNEMENT : Elec_IEC V5R2_ECATID				FOLIO : 08/22											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

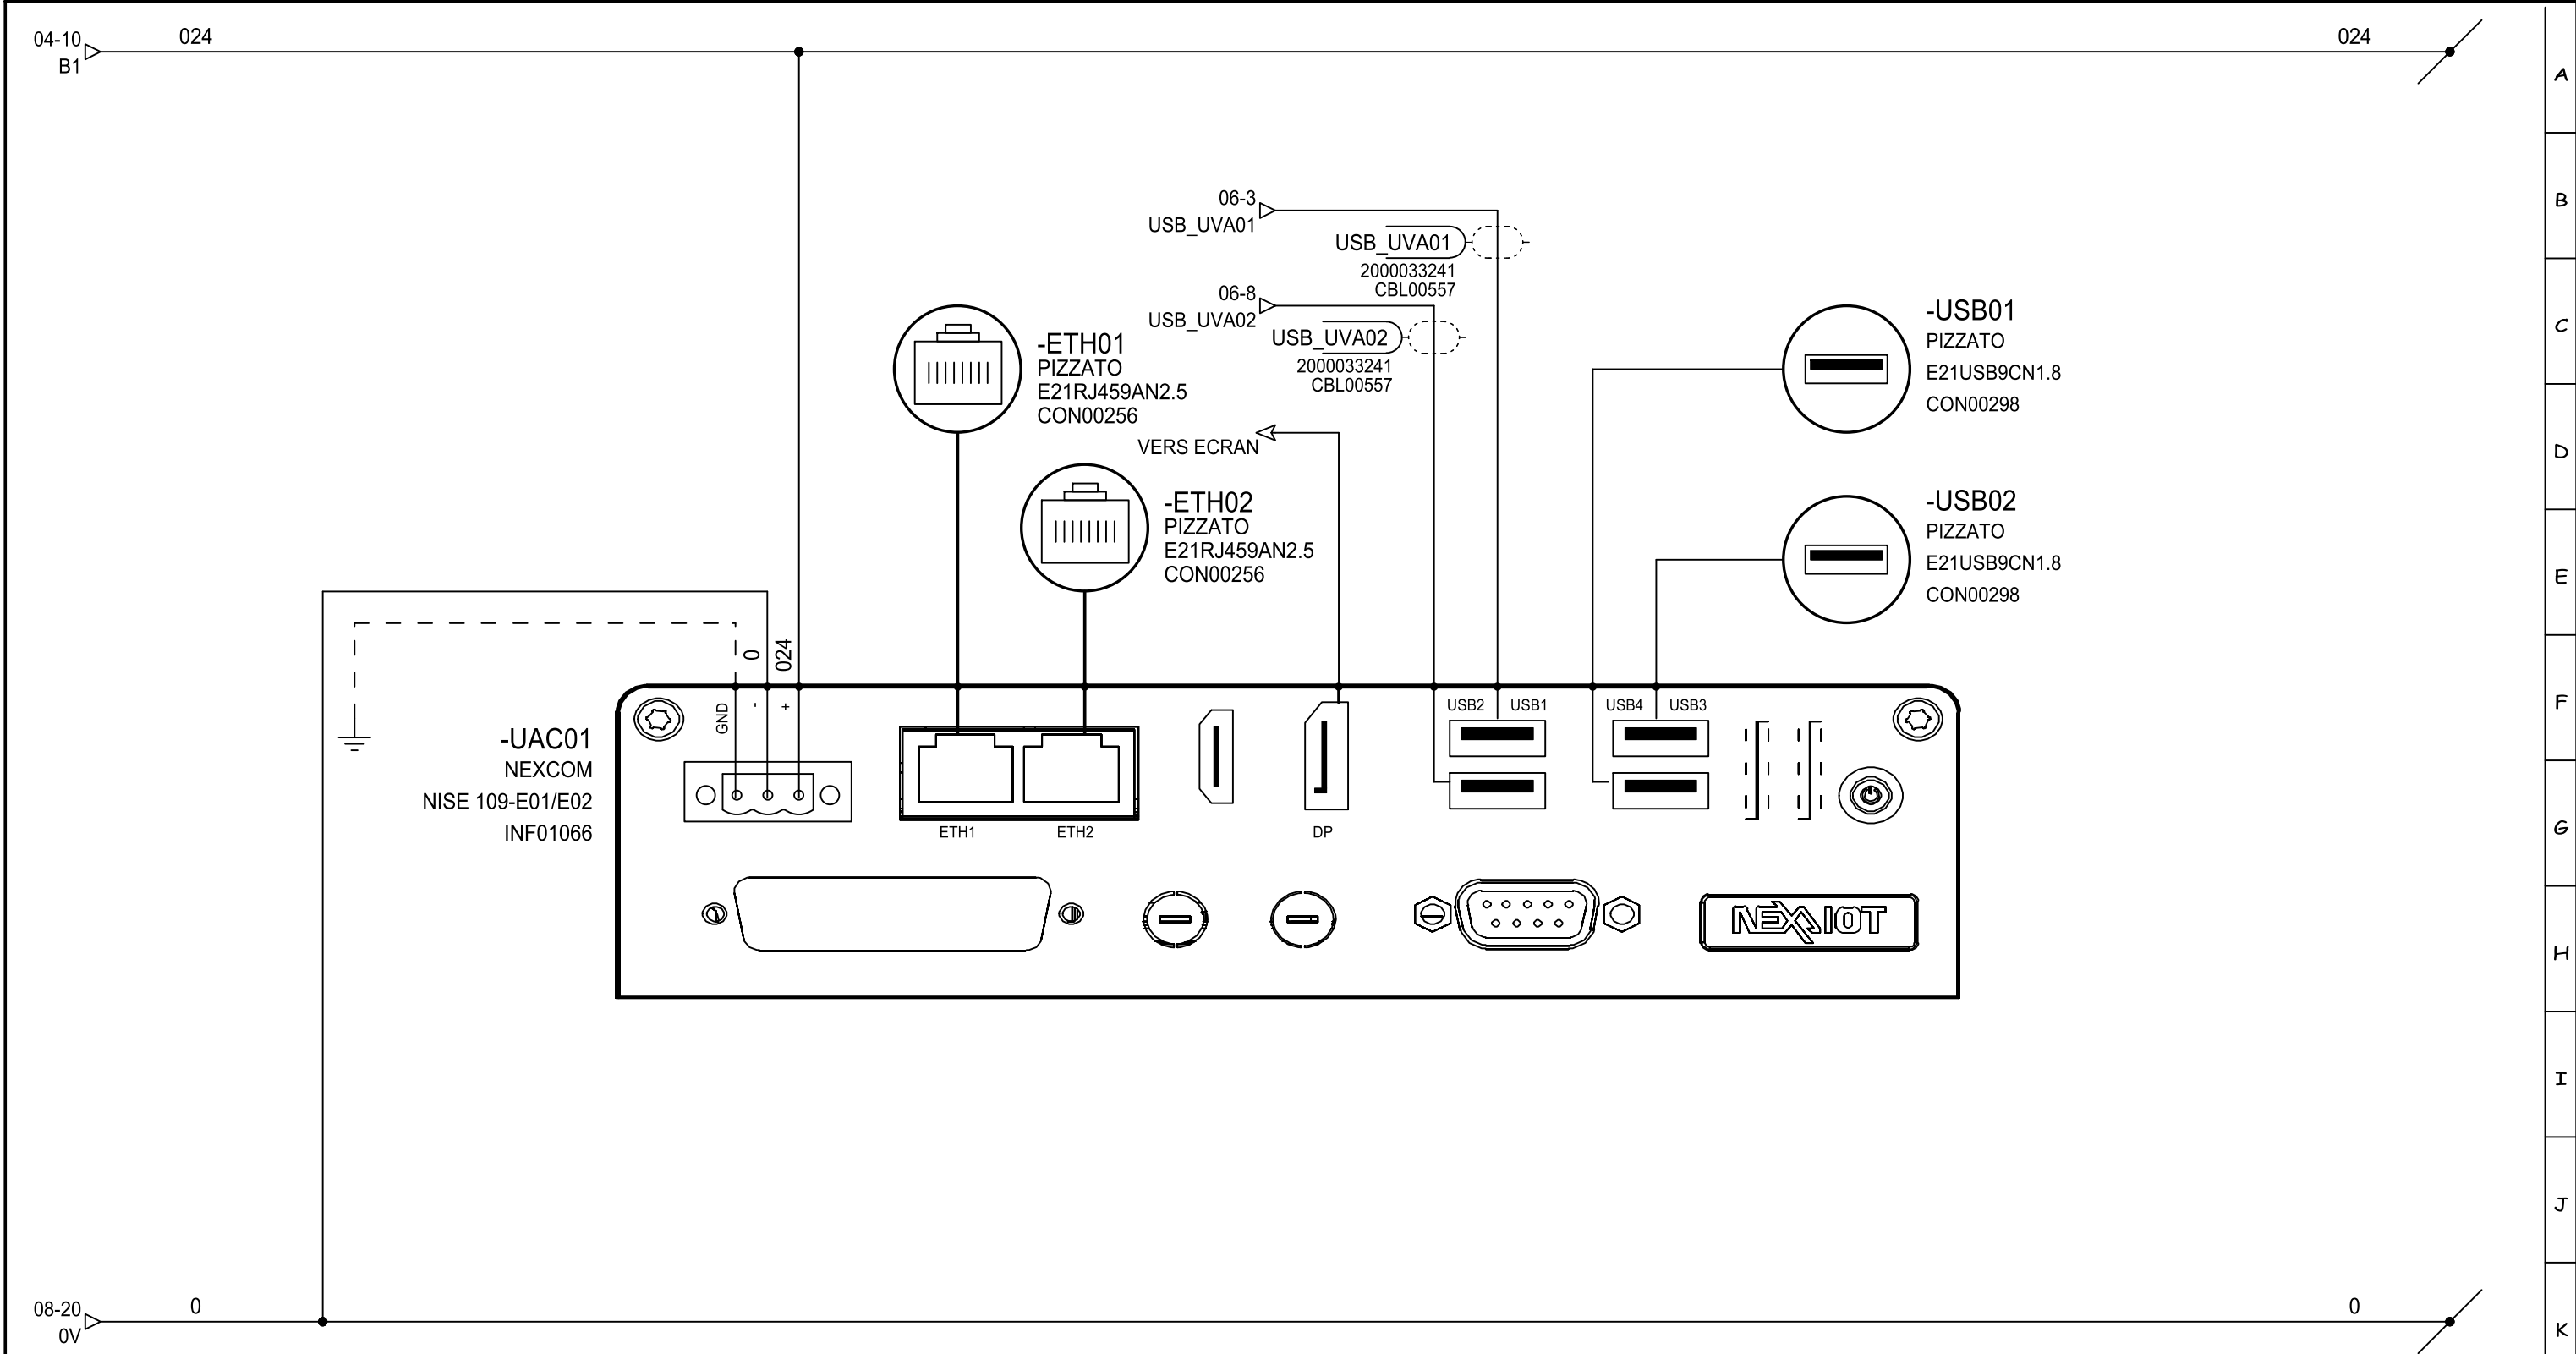


IMPLANTATION PC

ARMOIRE																					
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20		
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 18/03/2025		IMPLANTATION PC/IHM				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID			COUNTRY : INTERNE	
			Fax : (33).2.98.85.31.38		Designed by : MB		LAYOUT OF DISPLAY UNIT								ARTICLE : SMXA04264			INDEX : V1			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 09/22						

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.


BORNIER DE PUISSANCE : XP0
POWER TERMINAL BLOCK : XP0

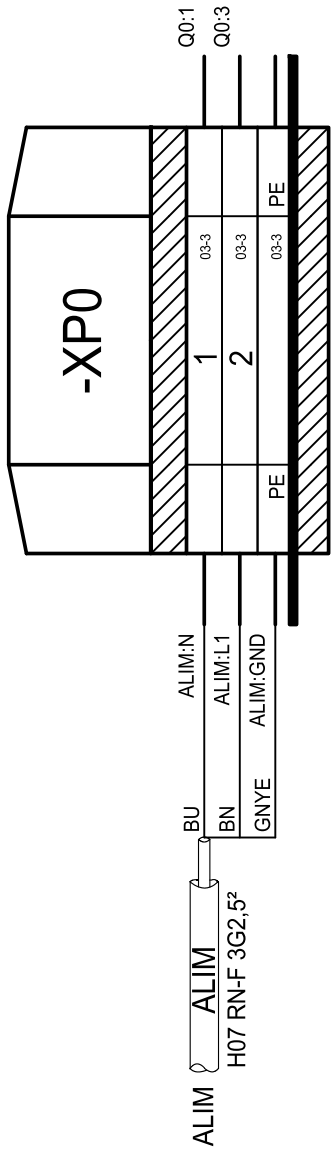

ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatid.service@ceva.com		Date of creation : 18/03/2025		BORNIER : XP0			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID			COUNTRY : INTERNE	
					Designed by : MB		TERMINAL BLOCK : XP0							ARTICLE : SMXA04264		INDEX : V2				
					ENVIRONNEMENT : Elec_IEC V5R2_ECATID															
																			FOLIO : 10/22	

A
B
C
D
E
F
G
H
I
J
K
L
M



ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE


E-mail : ecatid.service@ceva.com

ENVIRONNEMENT : Elec IEC V5R2 ECATID



FOLIO : 11/22

BORNIER DE COMMANDE : X2

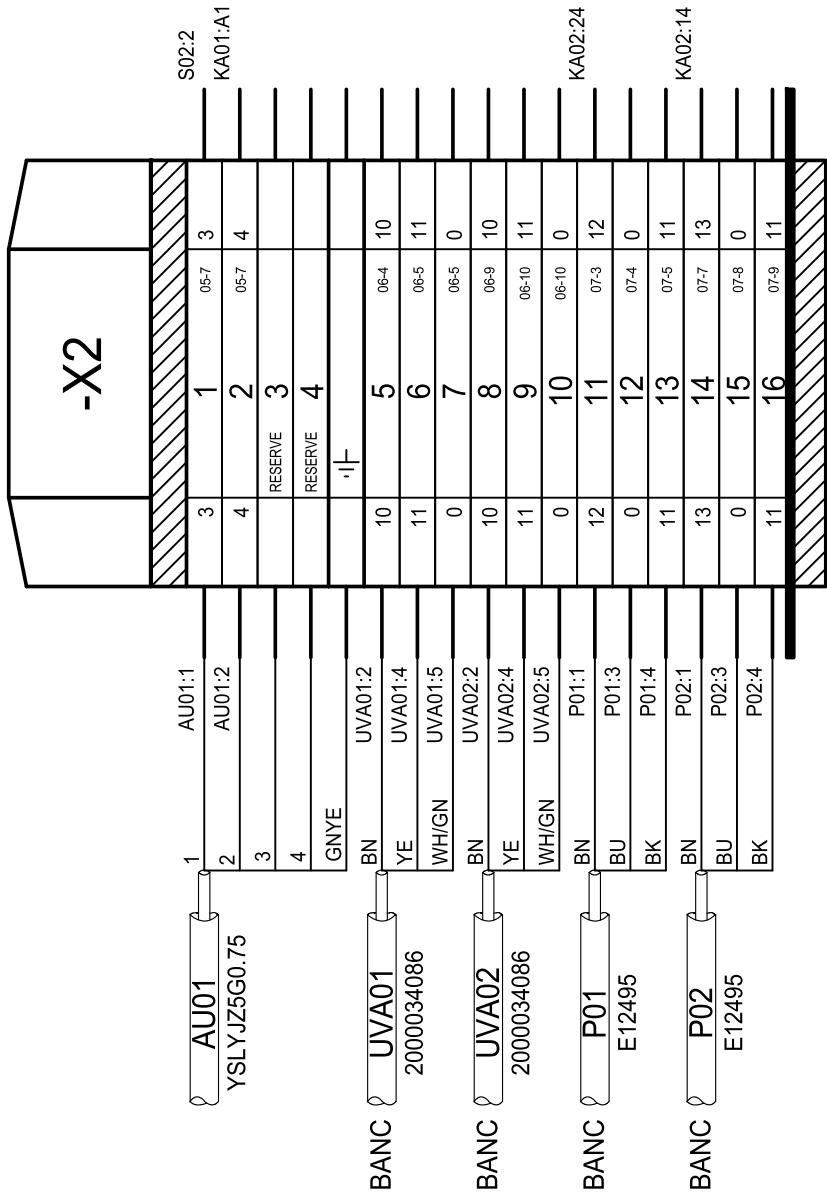


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36 Fax : (33).2.98.85.31.38 E-mail : ecatic.service@ceva.com		Date of creation : 18/03/2025		BORNIER : X2			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
					Designed by : MB		TERMINAL BLOCK : X2							ARTICLE : SMXA04264		INDEX : V2			
					ENVIRONNEMENT : Elec_IEC V5R2_ECATICID			FOLIO : 12/22											

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

BORNIER DE COMMANDE : XUVA

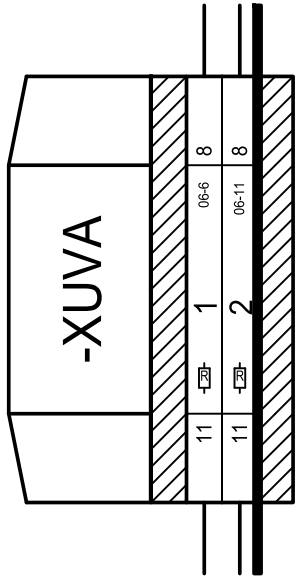


ARMOIRE

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE		Tél : (33).2.98.85.31.36		Date of creation : 18/03/2025		BORNIER : XUVA				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
		Fax : (33).2.98.85.31.38		Designed by : MB		TERMINAL BLOCK : XUVA								ARTICLE : SMXA04264		INDEX : V2			
		E-mail : ecaticid.service@ceva.com				ENVIRONNEMENT : Elec_IEC V5R2_ECATICID								FOLIO : 13/22					

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION FACADE ARMOIRE

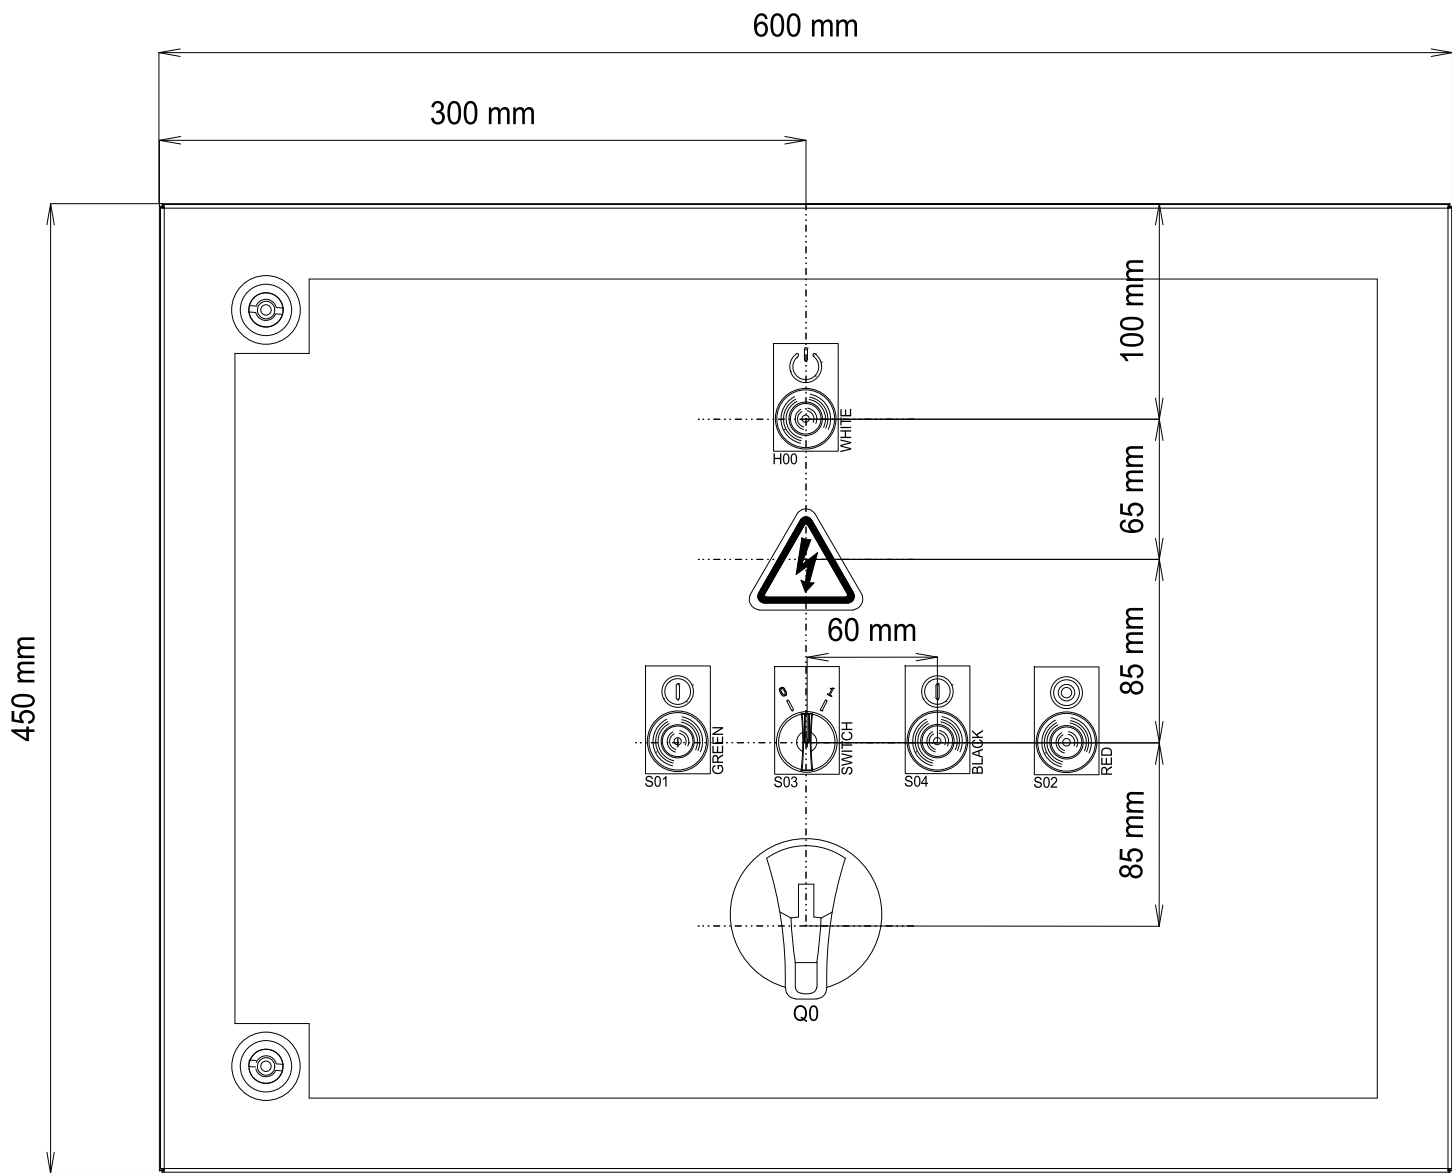

H450xL600xP250
ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
18/03/2025

Designed by :
MB

IMPLANTATION FACADE ARMOIRE

CABINET FRONT LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
INTERNE

CUSTOMER :
ECAT-ID

ARTICLE :

SMXA04264

COUNTRY :
INTERNE



INDEX : V2

FOLIO :
14/22

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

IMPLANTATION CÔTÉS ARMOIRE

CÔTÉ GAUCHE

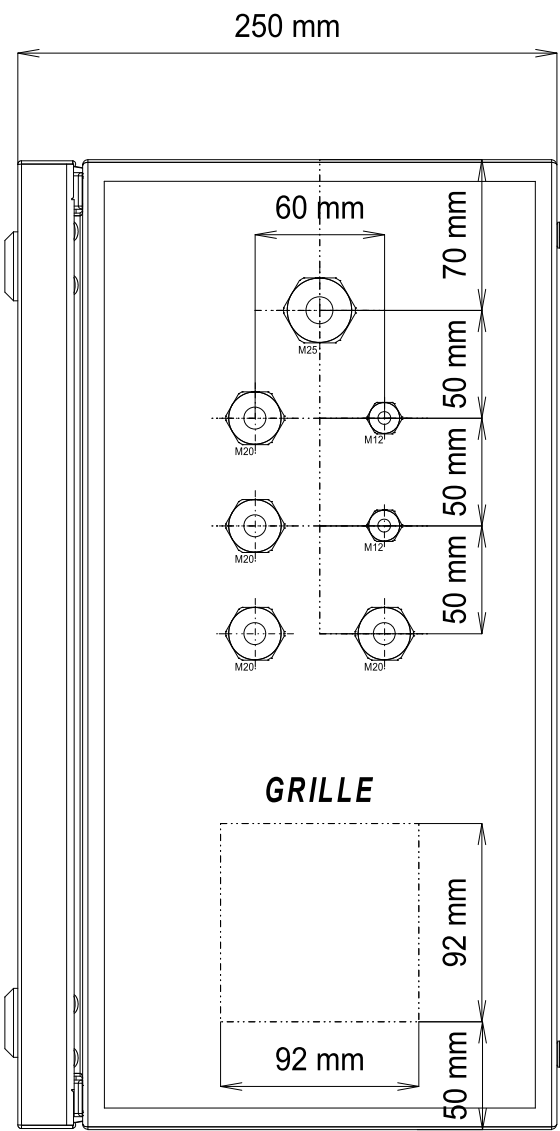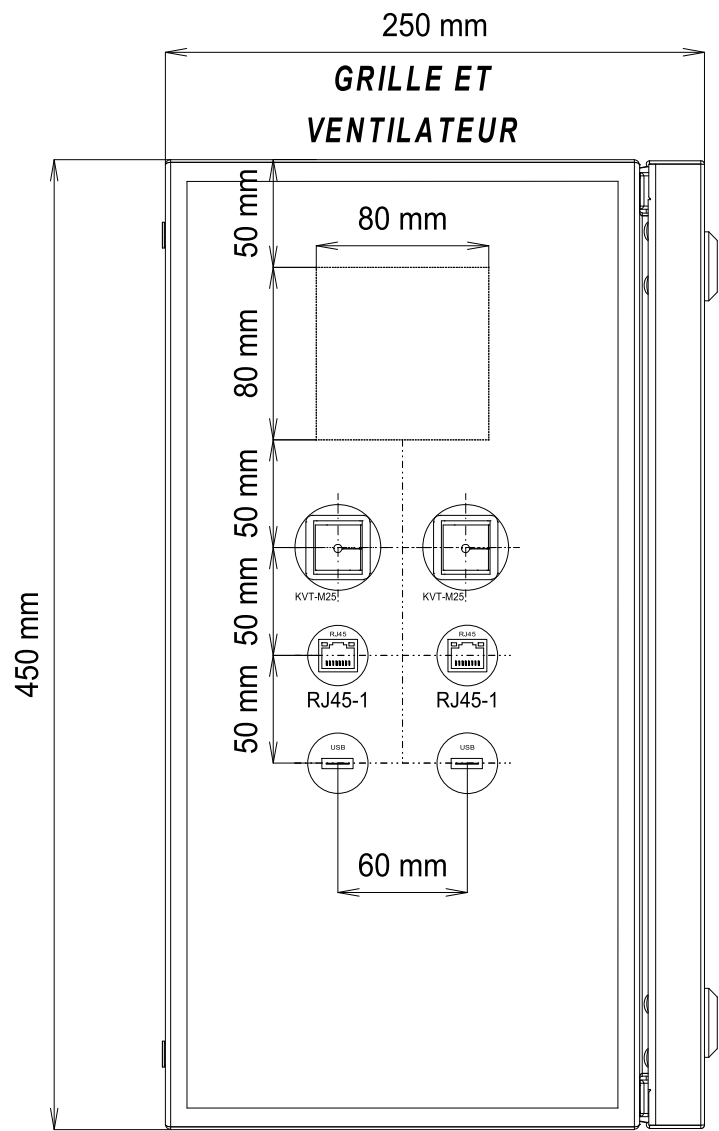

CÔTÉ DROIT

H450xL600xP250
ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
18/03/2025

Designed by :
MB

IMPLANTATION CÔTÉS ARMOIRE

CABINET SIDE LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :

INTERNE

CUSTOMER :

ECAT-ID

ARTICLE :

SMXA04264

COUNTRY :


INTERNE

INDEX : V2

FOLIO :

15/22

IMPLANTATION PLATINE ARMOIRE

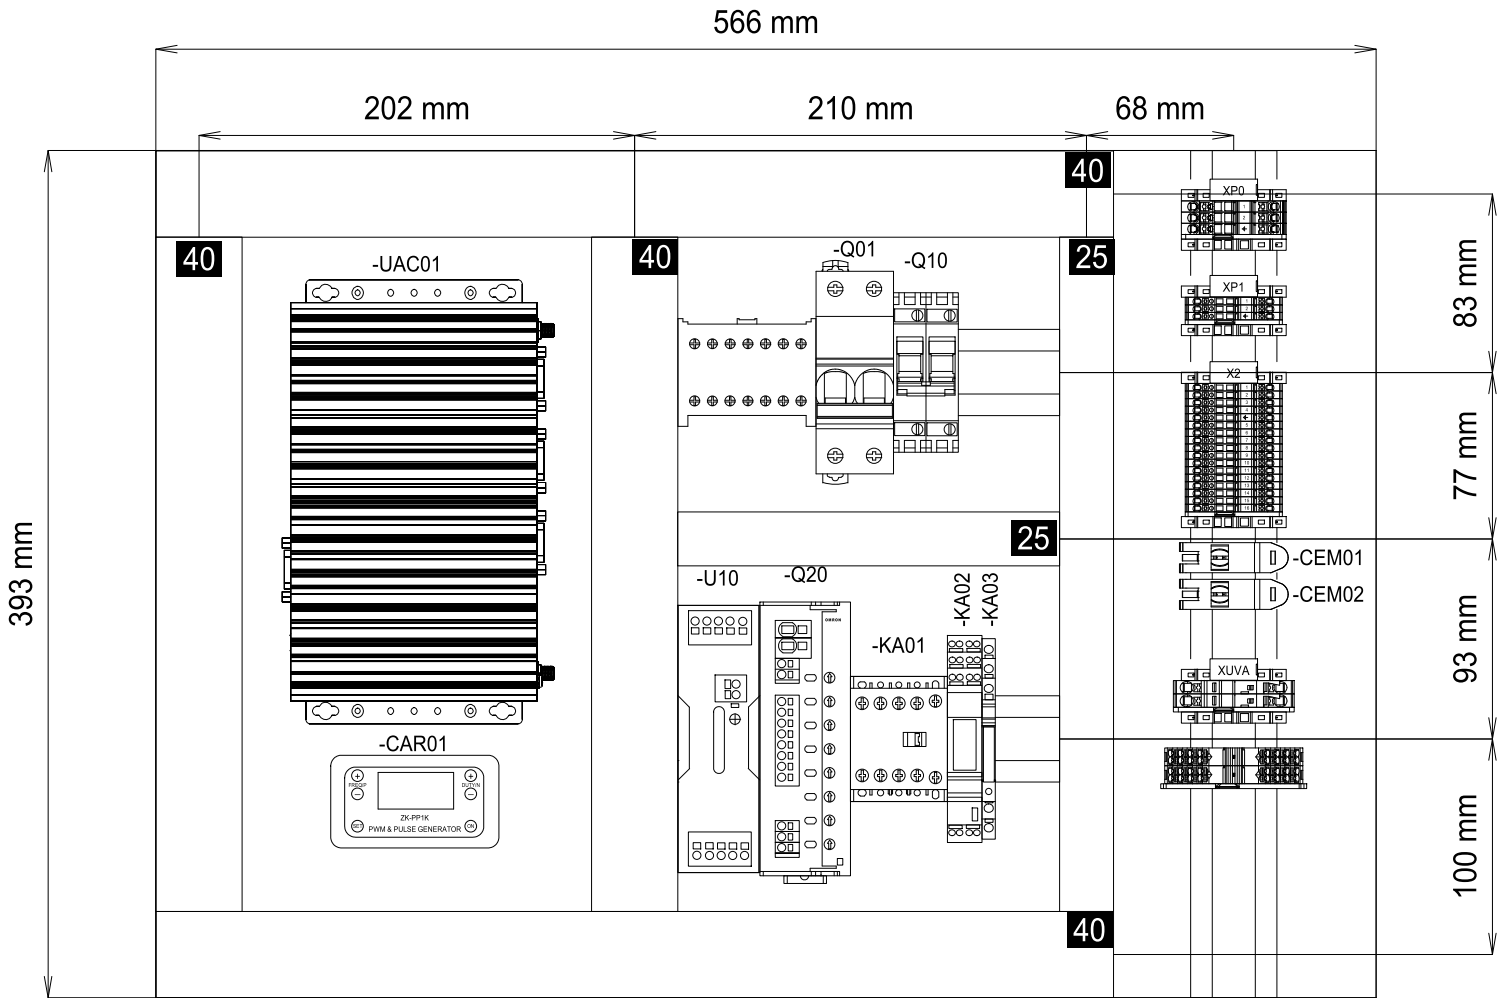

H450xL600xP250
ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
18/03/2025

Designed by :
MB

IMPLANTATION ARMOIRE

CABINET LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :

INTERNE

CUSTOMER :

ECAT-ID

ARTICLE :

SMXA04264

COUNTRY :

INTERNE

INDEX : V2

FOLIO :

16/22

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

H450xL600xP250
ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
18/03/2025

Designed by :
MB

IMPLANTATION FOND ARMOIRE

CABINET BOTTOM LAYOUT

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :
INTERNE

CUSTOMER :
ECAT-ID

ARTICLE :
SMXA04264

COUNTRY :
INTERNE

INDEX :
V1

FOLIO :
17/22

THIS DOCUMENT IS THE PROPERTY OF ECAT-ID & REMAIN CONFIDENTIAL IT CANNOT BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT OUR APPROVAL IN WRITING.

LOCALISATION	FOLIO	REPERE	DESIGNATION	QTE	REFERENCE	CODE ECAT-ID	FABRICANT	FILTRE
ARMOIRE	01	ARMOIRE	COFFRET INOX 450x600x250	1	EK0600450250001		IRINOX	ARMOIRE
ARMOIRE	03	Q0	POIGNEE ROUGE IP65 POUR CDE EXTERIEURE FRONTALE ET LATERALE	1	14741111	SEC00042	SOCOMEK	ARMOIRE
ARMOIRE	03	Q0	INTERRUPTEUR-SECTIONNEUR SIRCO M 3x16A NU	1	22003000	SEC00066	SOCOMEK	ARMOIRE
ARMOIRE	03	Q0	CACHE-BORNES POUR SIRCO M 3P 16...40A	1	22943005	SEC00071	SOCOMEK	ARMOIRE
ARMOIRE	03	Q0	KIT DE MONTAGE SUR PORTE POUR SIRCO M, 16...80A, 3/4P	1	22993409	SEC00091	SOCOMEK	ARMOIRE
ARMOIRE	03	Q01	DISJONCTEUR iC60N 2P 6A, 440VAC/6kA 133VDC/6kA, COURBE C	1	A9F77206	DIS00118	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	03	REP01	REPARTITEUR BIPOLAIRE BD 80/100 A, 6 CONNEXIONS	1	563900	ELC01115	NVENT ERICO	ARMOIRE
ARMOIRE	04	Q10	DISJONCTEUR MAGNETOTHERMIQUE 2P 3A	1	GB2DB08	DIS00116	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	04	Q20	DISJONCTEUR ELECTRONIQUE, 24VDC, 8X2/3/4/6/8/10A	1	S8V-CP0824	DIS00323	OMRON	ARMOIRE
ARMOIRE	04	U10	SOURCE DE COURANT 100-240VAC/24VDC, 10A, 240W	1	S8VK-S24024	ALM00217	OMRON	ARMOIRE
ARMOIRE	05	FAN01	GRILLE POUR VENTILATEUR 80x80	1	COS80	ELC00725	COSTECH	ARMOIRE
ARMOIRE	05	FAN01	VENTILATEUR 66M3/H 24VDC	1	COSD08A05HWBA00	ELC00724	COSTECH	ARMOIRE
ARMOIRE	05	FAN01	GRILLE DE SORTIE POUR VENTILATEUR 92x92, RAL 7035	2	NSYCAG92LPF	ELC00699	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	05	KA01	CONTACTEUR AUXILIAIRE 3F/1O VIS 24VDC	1	CA3KN31BD	REL00051	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	05	KA01	BLOC VARISTOR 12-24V	1	LA4KE1B	REL00124	SCHNEIDER ELECTRIC	ARMOIRE
ARMOIRE	05	KA02	RELAIS RIFLINE 2 CONTACT	1	2903334	REL00082	PHOENIX CONTACT	ARMOIRE
ARMOIRE	06	CEM01	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	06	CEM02	BRIDE CEM SF/SKL 6-8	1	36245	ELC02070	ICOTEK	ARMOIRE
ARMOIRE	08	CAR01	GENERATEUR DE SIGNAUX PWM 1HZ ~ 150KHZ, GENERATEUR BIMODE GE	1	ZK-PP1K	CAR00066	DOLLATEK	ARMOIRE
ARMOIRE	08	KA03	RELAIS RIFLINE 1 CONTACT	1	2903370	REL00085	PHOENIX CONTACT	ARMOIRE
ARMOIRE	09	ETH01	CABLE DEPORT DE PORT ETHERNET	1	E21RJ459AN2.5	CON00256	PIZZATO	ARMOIRE
ARMOIRE	09	ETH02	CABLE DEPORT DE PORT ETHERNET	1	E21RJ459AN2.5	CON00256	PIZZATO	ARMOIRE
ARMOIRE	09	UAC01	PC INDUSTRIEL INTEL® CELERON® PROCESSOR J6412 QUAD CORE, 2.0	1	NISE 109-E01/E02	INF01066	NEXCOM	ARMOIRE
ARMOIRE	09	USB01	CABLE DEPORT DE PORT USB	1	E21USB9CN1.8	CON00298	PIZZATO	ARMOIRE
ARMOIRE	09	USB02	CABLE DEPORT DE PORT USB	1	E21USB9CN1.8	CON00298	PIZZATO	ARMOIRE

ECAT-ID
Z.I DE KERIEL
29800 PLOUEDERN
FRANCE

Tél : (33).2.98.85.31.36

Fax : (33).2.98.85.31.38

E-mail : ecatid.service@ceva.com

Date of creation :
18/03/2025

Designed by :
MB

NOMENCLATURE ARMOIRE FRANCAIS

FRENCH ENCLOSURE PART LIST

ENVIRONNEMENT : Elec_IEC V5R2_ECATID



Ecat-iD Campus

CONTRACT :

INTERNE

CUSTOMER :

ECAT-ID

ARTICLE :

SMXA04264

COUNTRY :

INTERNE

INDEX : V2

FOLIO :

18/22

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 18/03/2025		NOMENCLATURE FI FRANCAIS			 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
			Fax : (33).2.98.85.31.38		Designed by : MB		FRENCH FI PARTS LIST							ARTICLE : SMXA04264		INDEX : V2			
			E-mail : ecatic.service@ceva.com			ENVIRONNEMENT : Elec_IEC V5R2_ECATID			FOLIO : 19/22										

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	
ECAT-ID Z.I DE KERIEL 29800 PLOUEDERN FRANCE			Tél : (33).2.98.85.31.36		Date of creation : 18/03/2025		NOMENCLATURE BORNIERS FRANCAIS				 Ecat-iD Campus				CONTRACT : INTERNE		CUSTOMER : ECAT-ID		COUNTRY : INTERNE	
			Fax : (33).2.98.85.31.38		Designed by : MB		FRENCH TERMINAL BLOCK PARTS LIST								ARTICLE : SMXA04264		INDEX : V2			
			E-mail : ecatic.service@ceva.com				ENVIRONNEMENT : Elec IEC V5R2 ECATIC										FOLIO : 22/22			