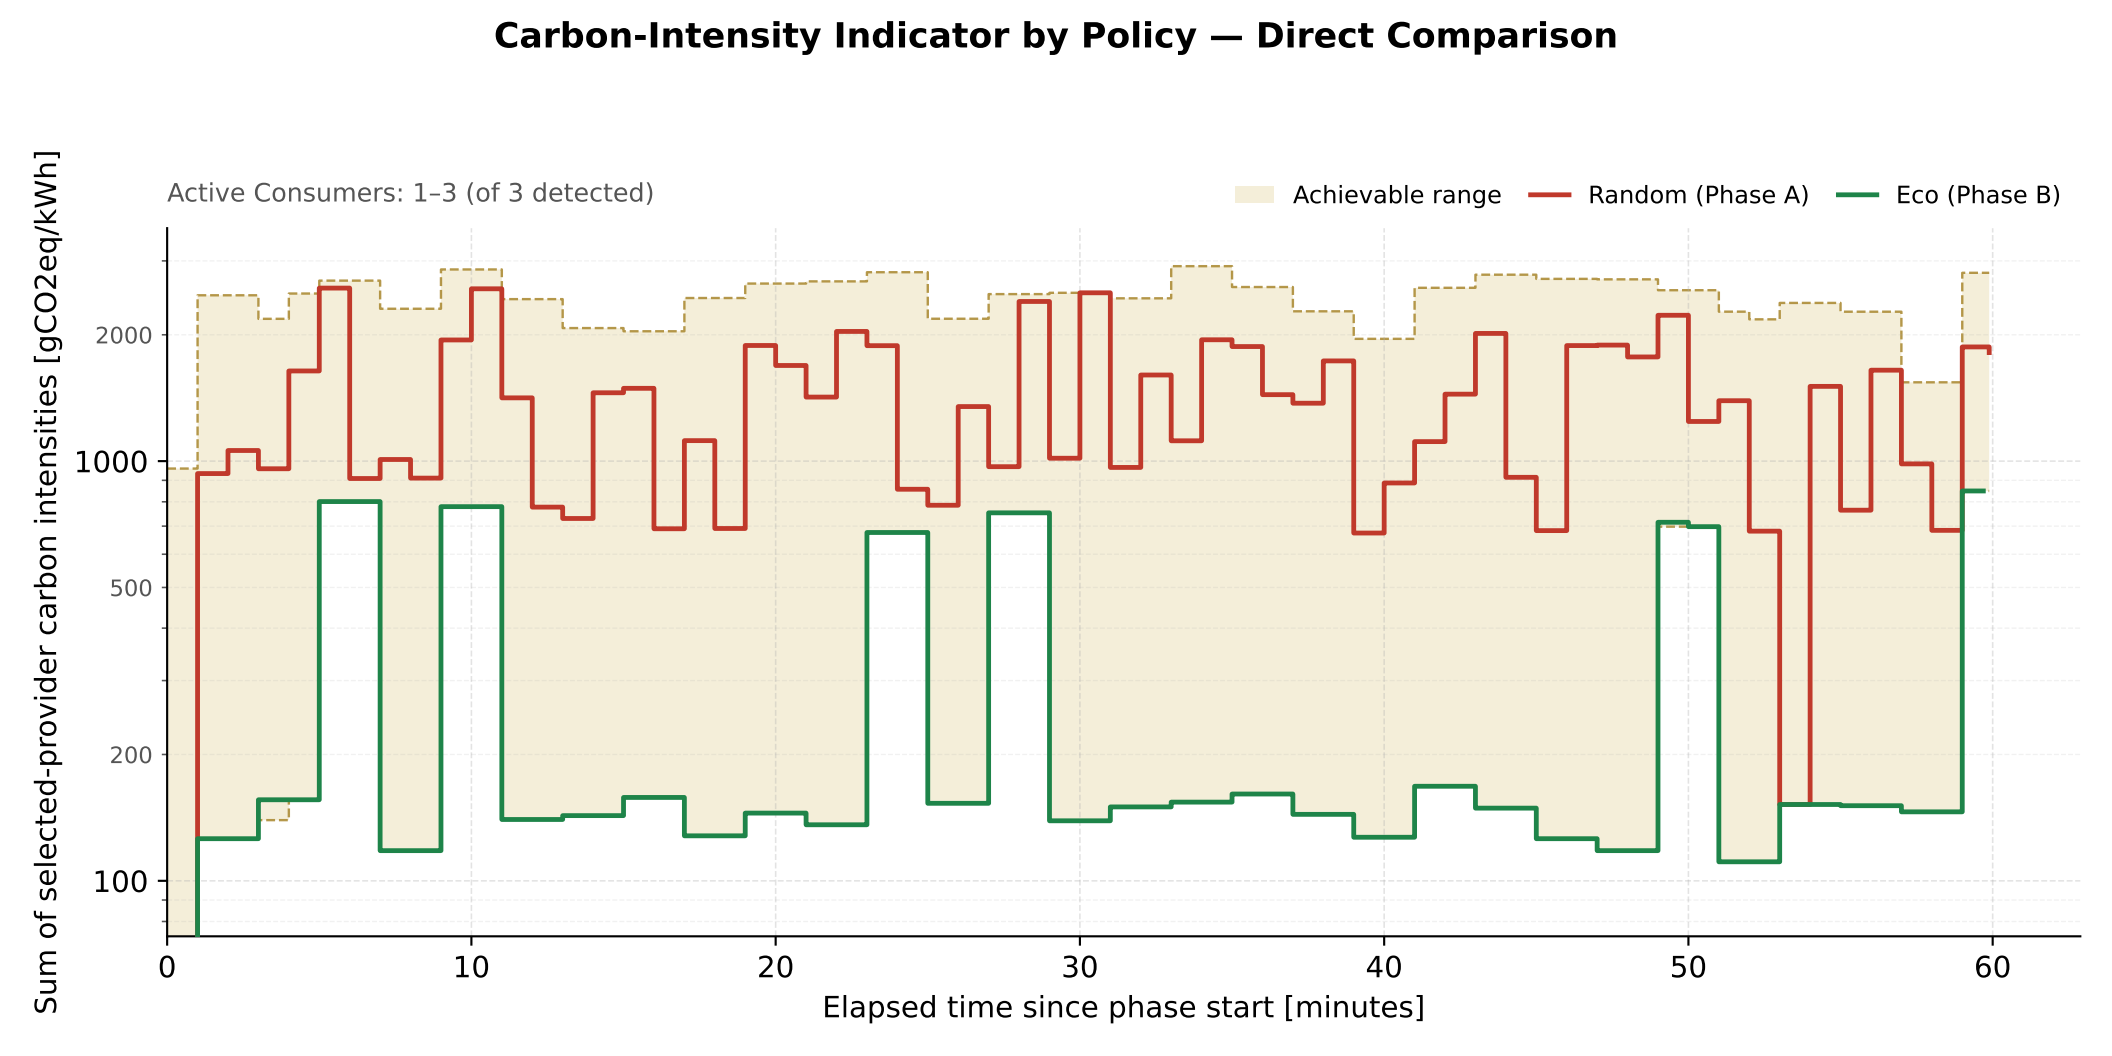
Carbon-Intensity Indicator by Policy — Direct Comparison
Active Consumers: 1–3 (of 3 detected)
Achievable range
Random (Phase A)
Eco (Phase B)
Sum of selected-provider carbon intensities [gCO2eq/kWh]
2000
1000
500
200
100
0
10
20
30
40
50
60
Elapsed time since phase start [minutes]