

31K

Total Samples

309K

Total Readings (Selected Pa...

41.56

Avg Value

45.21

Avg Value Last 7 Days

359.99

Max Value

0.00

Min Value

- Parameter
- ☐ Select all

☐ (Blank)

☐ Chlorophyll

☐ Conductivity

☐ Dissolved Oxygen


☐ DO_Saturation

☐ pH


☐ Salinity

☐ Temperature

Avg Value This Month and Avg Value Last 7 Days by Year

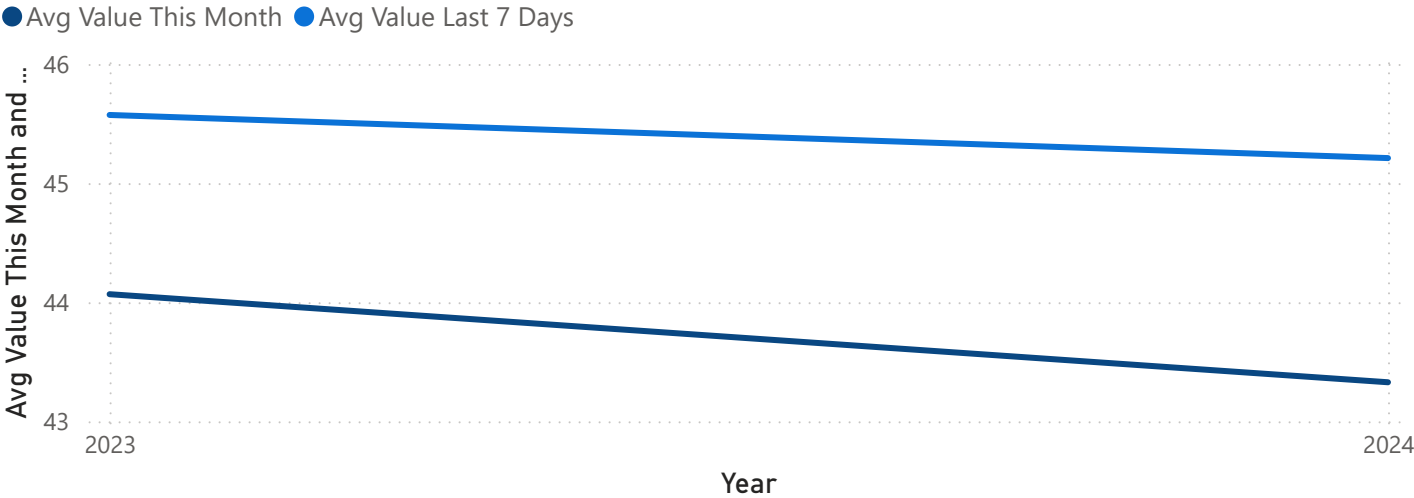

Avg Value by Month

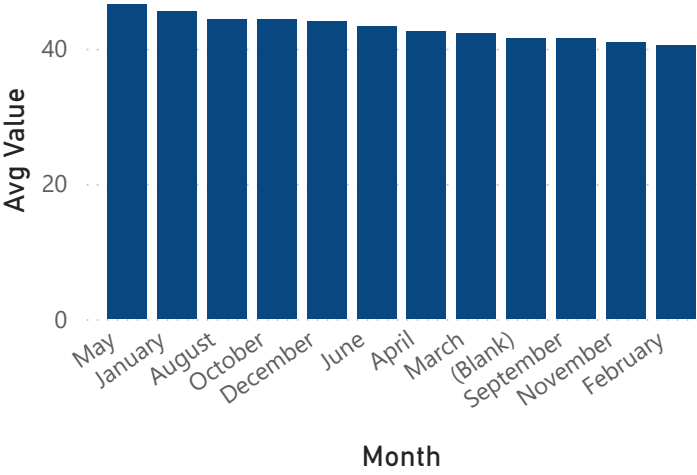


Year	Quarter	Month	Day	Attribute	Sum of Value
2024	Qtr 1	January	1	Chlorophyll	2.44
2024	Qtr 1	January	1	Conductivity	50.48
2024	Qtr 1	January	1	Dissolved Oxygen	6.10
2024	Qtr 1	January	1	DO_Saturation	92.38
2024	Qtr 1	January	1	pH	7.94
2024	Qtr 1	January	1	Salinity	33.01
2024	Qtr 1	January	1	Temperature	27.99
2024	Otr 1	Januarr	1	Turbidity	2.13
Total					12,839,354.31

- Parameter
- (Blank)
 - Chlorophyll
 - Conductivity
 - Dissolved Oxygen
 - DO_Saturation
 - pH


Parameter	Avg Value
	97.20
Chlorophyll	2.87
Conductivity	47.16
Dissolved Oxygen	6.73
DO_Saturation	96.53
pH	8.06
Salinity	31.12
Temperature	24.76
Turbidity	4.05
Total	41.56

Avg Value This Month by Month

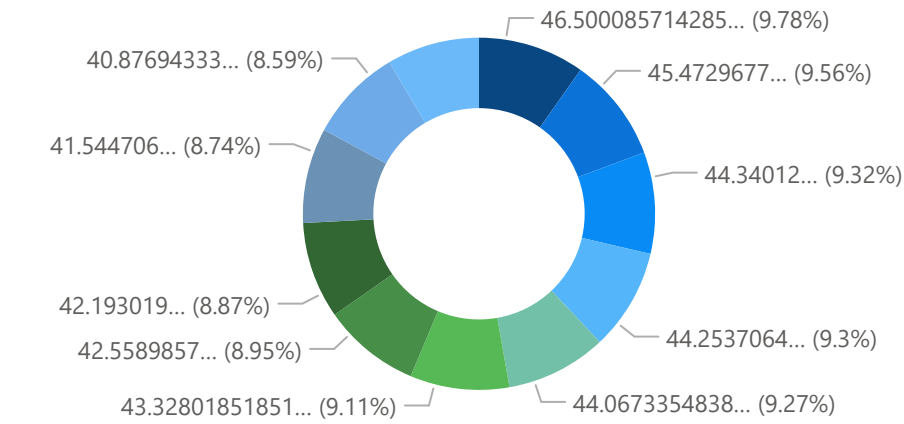


- Month
- May
 - January
 - August
 - October
 - December
 - June
 - April

Avg Value This Month by Month and Parameter

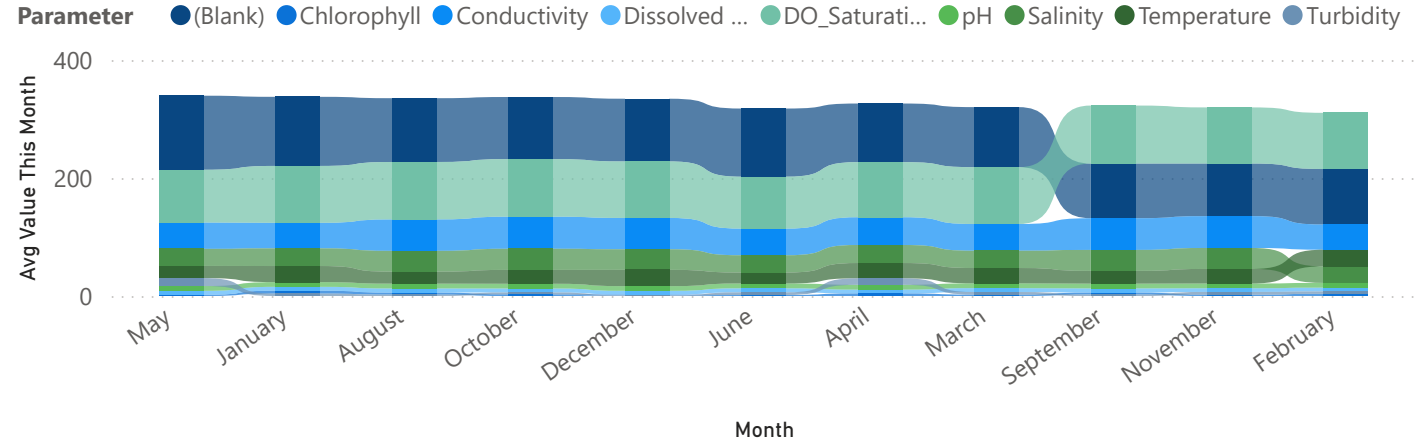

Avg Value by Month

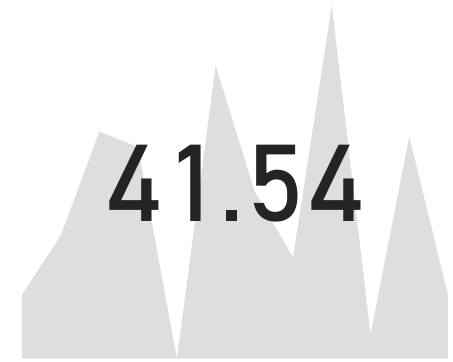

Std Dev Value by Month




Variance From Overall by Month




FullDate

4/08/2023 27/06/2024

Active Parameters and Avg Value This Month by DayOfWeek

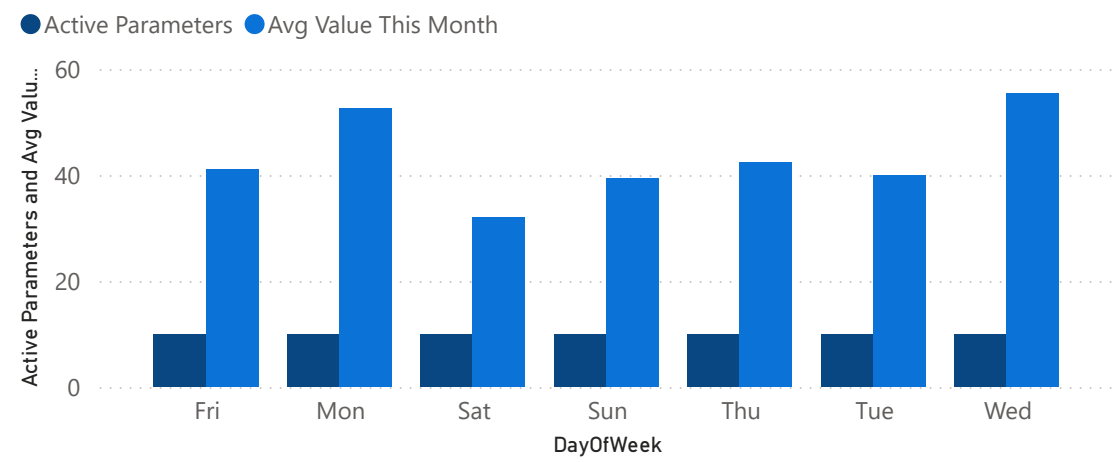

Variance From Overall by Parameter

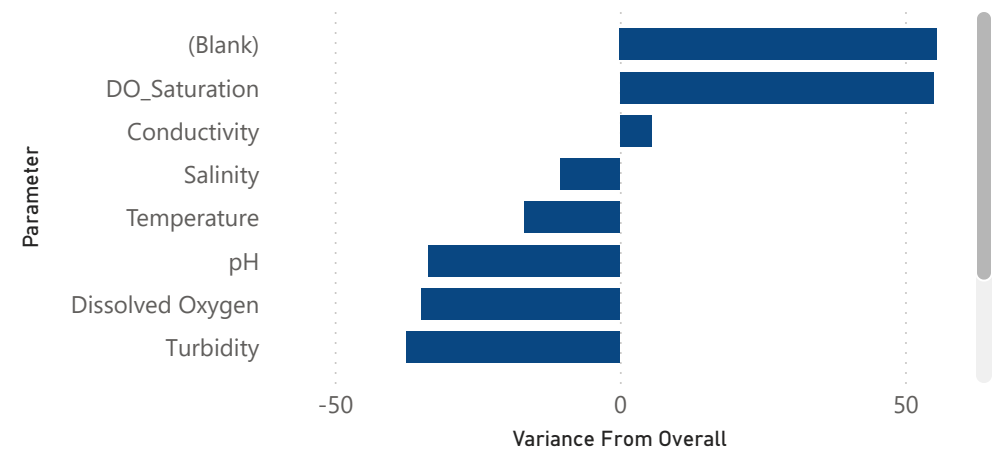

4/08/2023 12:00:00 AM

Earliest FullDate

Avg Value by YearMonth



Max Value by DayOfWeek




Min Value by DayOfWeek




✓ All Values Within Expected Range

Quality Issues


Sum of Value by Attribute

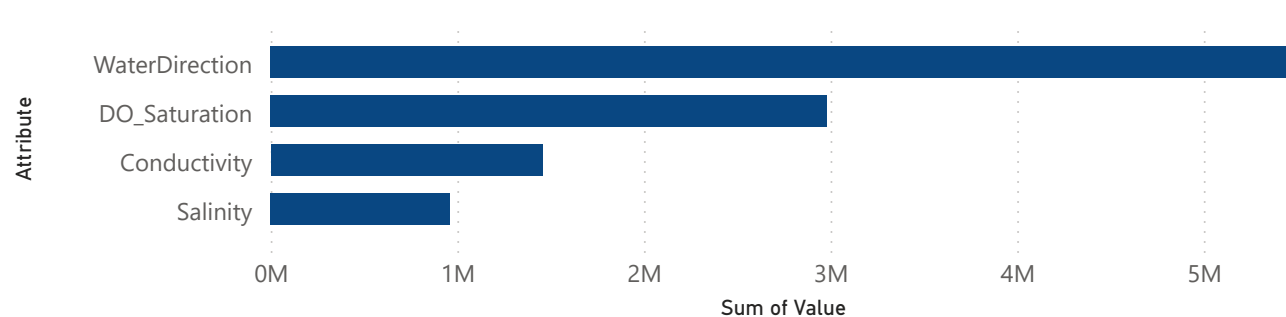

Variance From Overall by Value

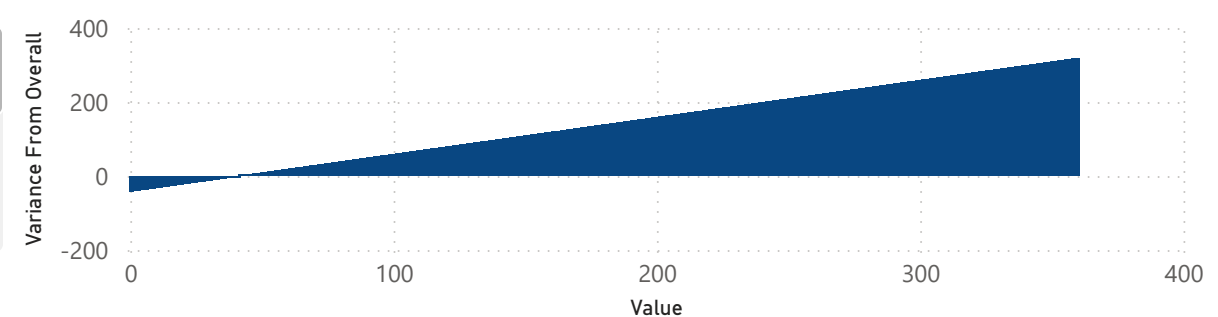

Avg Value by Year

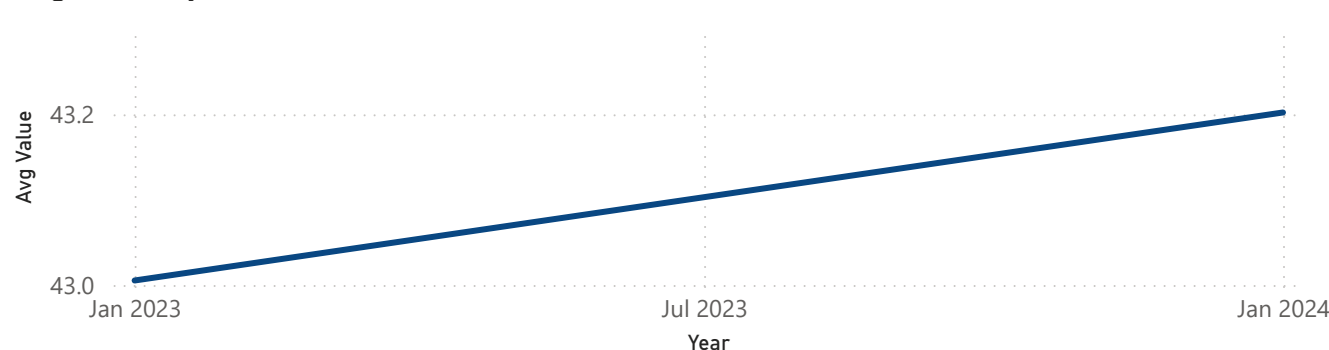

Attribute	Sum of Value	Unit
WaterDirection	5,484,888.77	
DO_Saturation	2,982,131.55	%
Conductivity	1,457,036.62	µS/cm
Salinity	961,398.23	PSU
Temperature	764,811.89	°C
WaterSpeed	518,658.15	
pH	248,944.56	scale
Total	12,839,354.31	