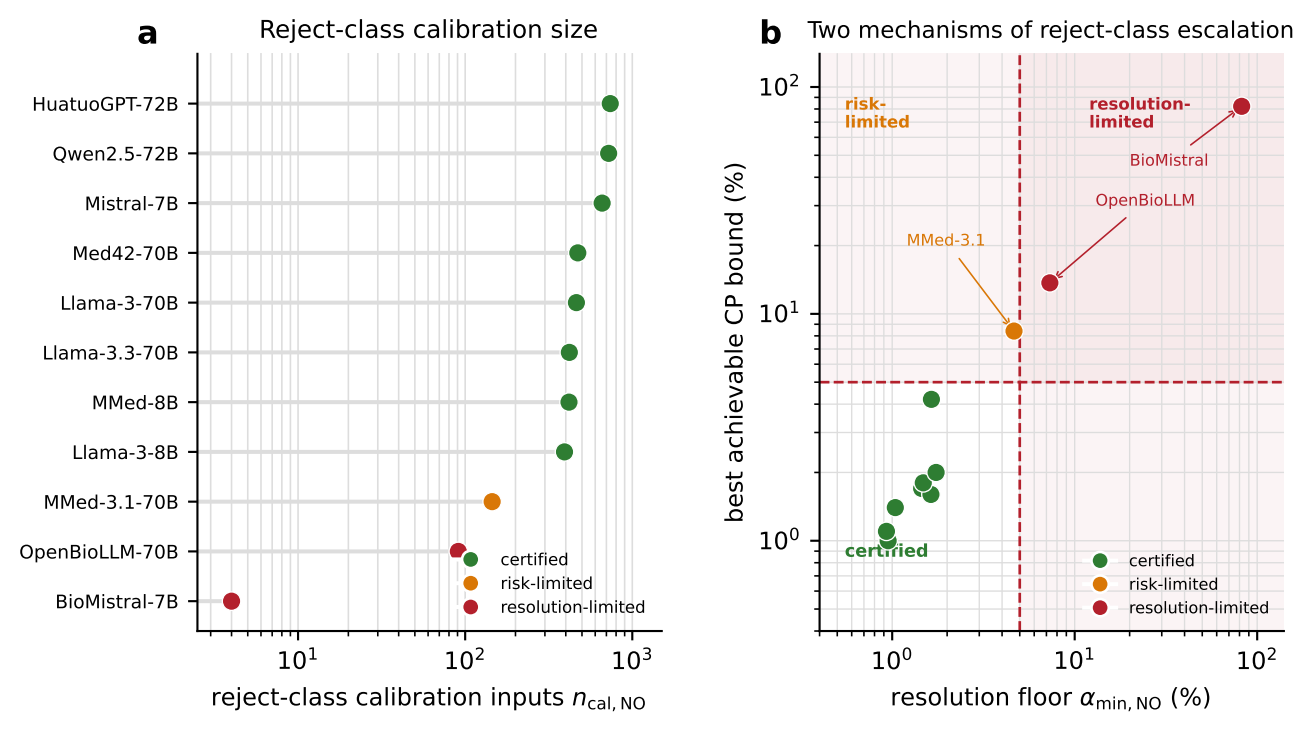
a
Reject-class calibration size
HuatuoGPT-72B
Qwen2.5-72B
Mistral-7B
Med42-70B
Llama-3-70B
Llama-3.3-70B
MMed-8B
Llama-3-8B
MMed-3.1-70B
OpenBioLLM-70B
BioMistral-7B
certified
risk-limited
resolution-limited
10^1
10^2
10^3
reject-class calibration inputs $n_{\mathrm{cal,NO}}$
b
Two mechanisms of reject-class escalation
risk-limited
resolution-limited
BioMistral
OpenBioLLM
MMed-3.1
certified
certified
risk-limited
resolution-limited
best achievable CP bound (%)
10^2
10^1
10^0
10^0
10^1
10^2
resolution floor $\alpha_{\mathrm{min,NO}}$ (%)