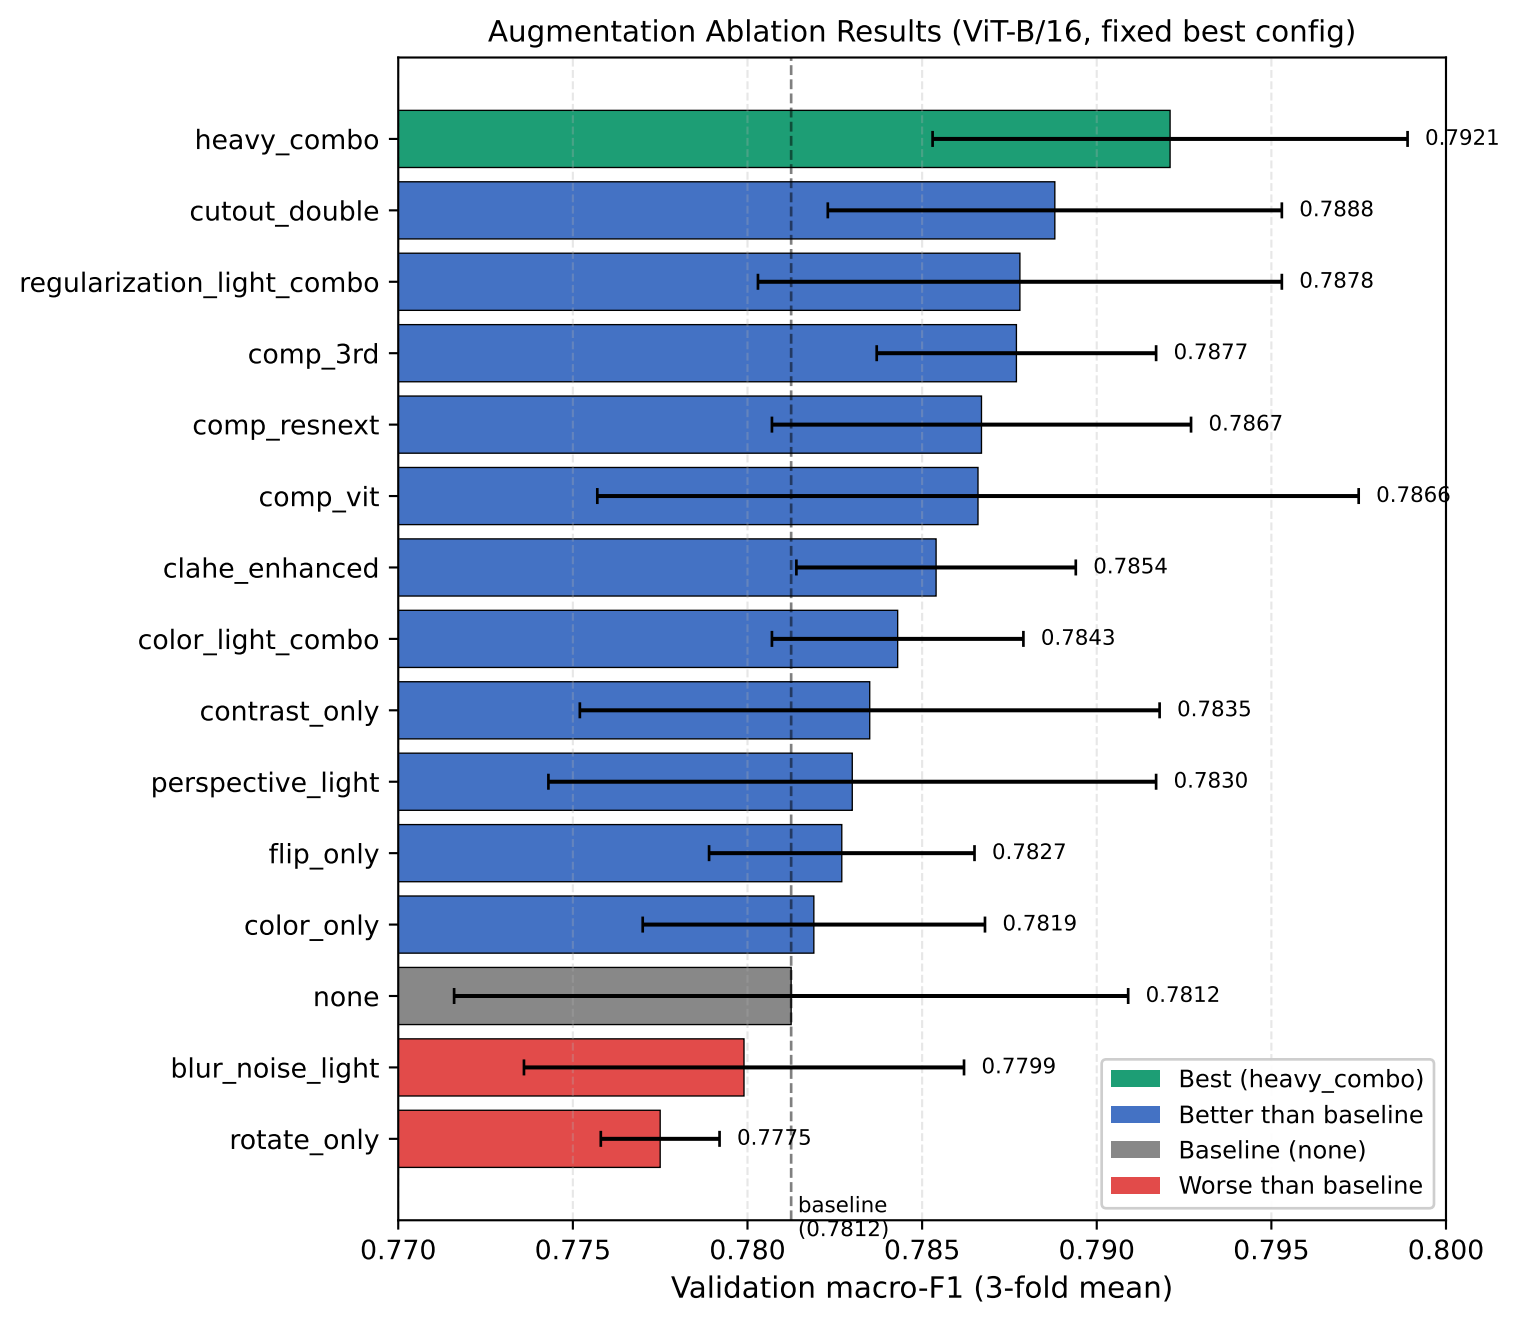
Augmentation Ablation Results (ViT-B/16, fixed best config)
heavy_combo
cutout_double
regularization_light_combo
comp_3rd
comp_resnext
comp_vit
clahe_enhanced
color_light_combo
contrast_only
perspective_light
flip_only
color_only
none
blur_noise_light
rotate_only
0.7921
0.7888
0.7878
0.7877
0.7867
0.7866
0.7854
0.7843
0.7835
0.7830
0.7827
0.7819
0.7812
0.7799
0.7775
baseline
(0.7812)
Best (heavy_combo)
Better than baseline
Baseline (none)
Worse than baseline
0.770
0.775
0.780
0.785
0.790
0.795
0.800
Validation macro-F1 (3-fold mean)