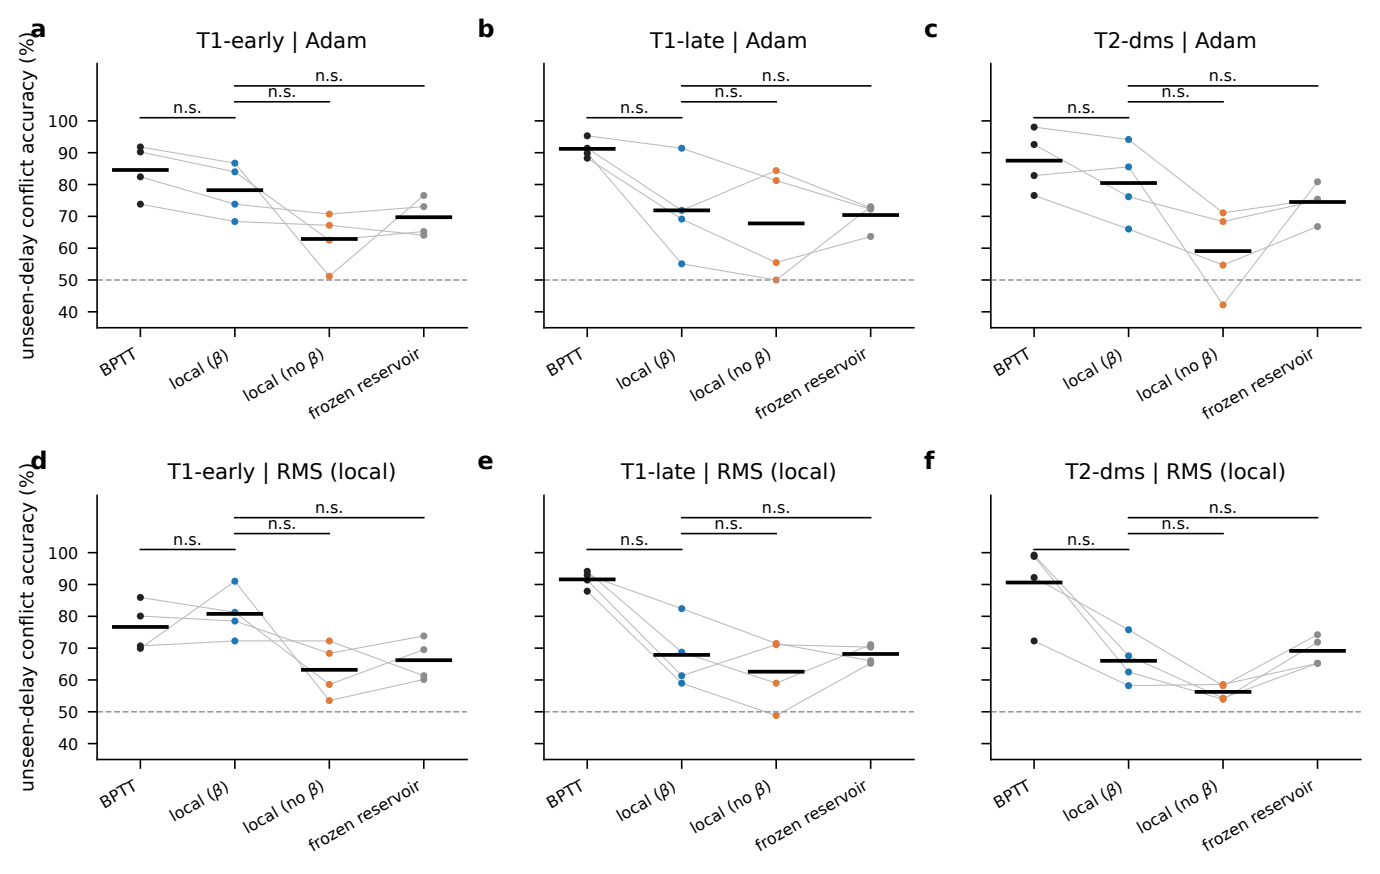
a
T1-early | Adam
b
T1-late | Adam
c
T2-dms | Adam
d
T1-early | RMS (local)
e
T1-late | RMS (local)
f
T2-dms | RMS (local)
unseen-delay conflict accuracy (%)
n.s.
n.s.
n.s.
100
90
80
70
60
50
40
BPTT
local (β)
local (no β)
frozen reservoir