


Site Description and Dataset Overview (Yongyeon WWTP, Ulsan, South Korea)

Satellite preview annotated for study context; operational metadata summarized for Section 2.1

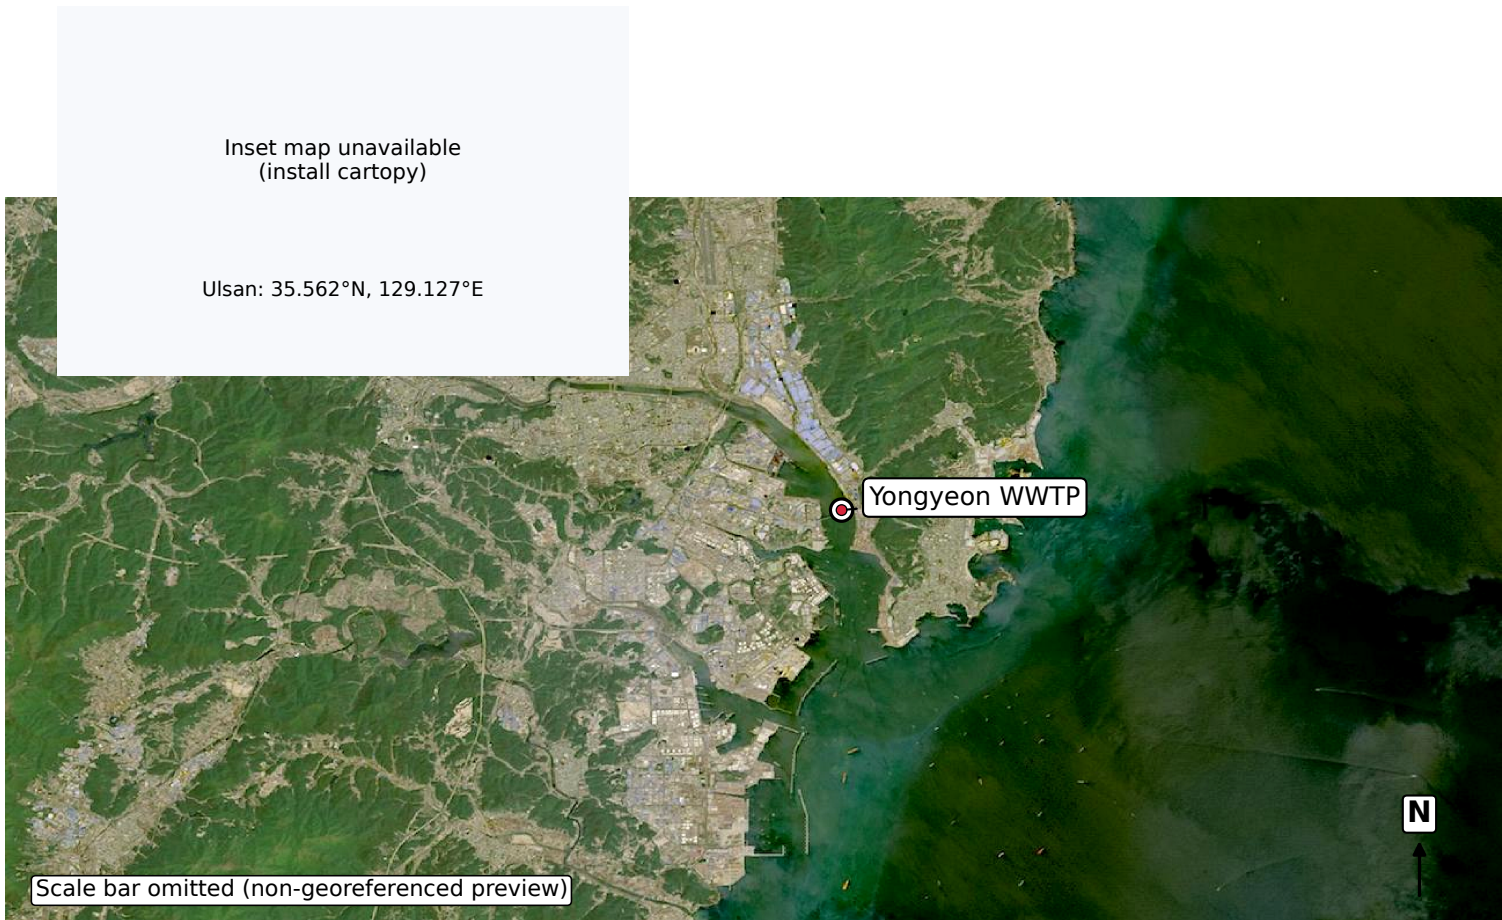

Facility Context

- Location: Seosaeng-myeon, Ulju-gun, Ulsan (35.56233°N, 129.1269°E)
- Large municipal WWTP supporting urban + industrial wastewater treatment
- Typical daily inflow capacity: ~200,000–250,000 m³/day
- Co-treatment includes municipal wastewater and food waste

Dataset Scope

- Monitoring period: 2021-01-04 to 2023-10-31
- Sampling frequency: Daily aggregates
- Approximate sample size: $n \approx 1,031$ days
- Interpolated entries noted around 2023-07-25 to 2023-07-28

Measurements and Compliance (TMS)

Influent/Effluent variables:
Inflow/Outflow (m³/day), BOD, TOC, SS, TN, TP (mg/L), Coliform (MPN/100 mL).

TMS compliance monitoring enables automated real-time reporting of key effluent indicators (TOC, TN, TP) to K-eco for regulatory quality control.