



FRVT VERIFICATION
BIOIDTECHSWISS-000
MON AUG 3 10:56:47 2020

REPORT:

BIOIDTECHSWISS_000: Error tradeoff characteristics by dataset

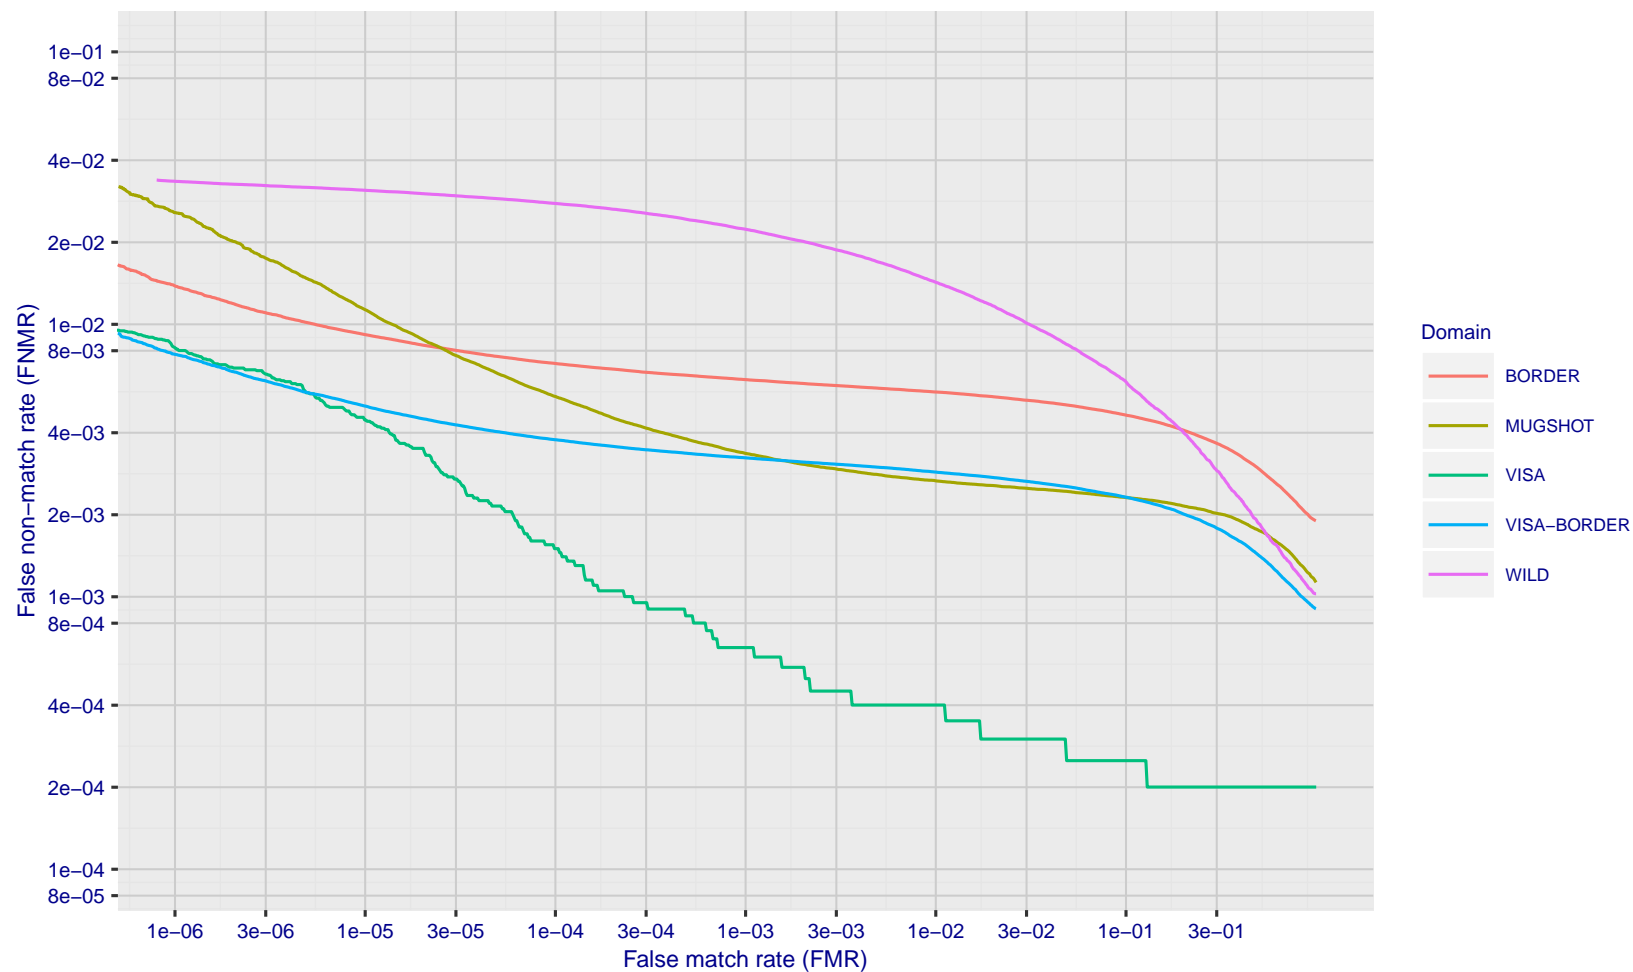


Figure 1: Error tradeoff characteristics for bioidtechswiss-000 on datasets used in FRVT.

BIOIDTECHSWISS_000: Error rate dependence on threshold

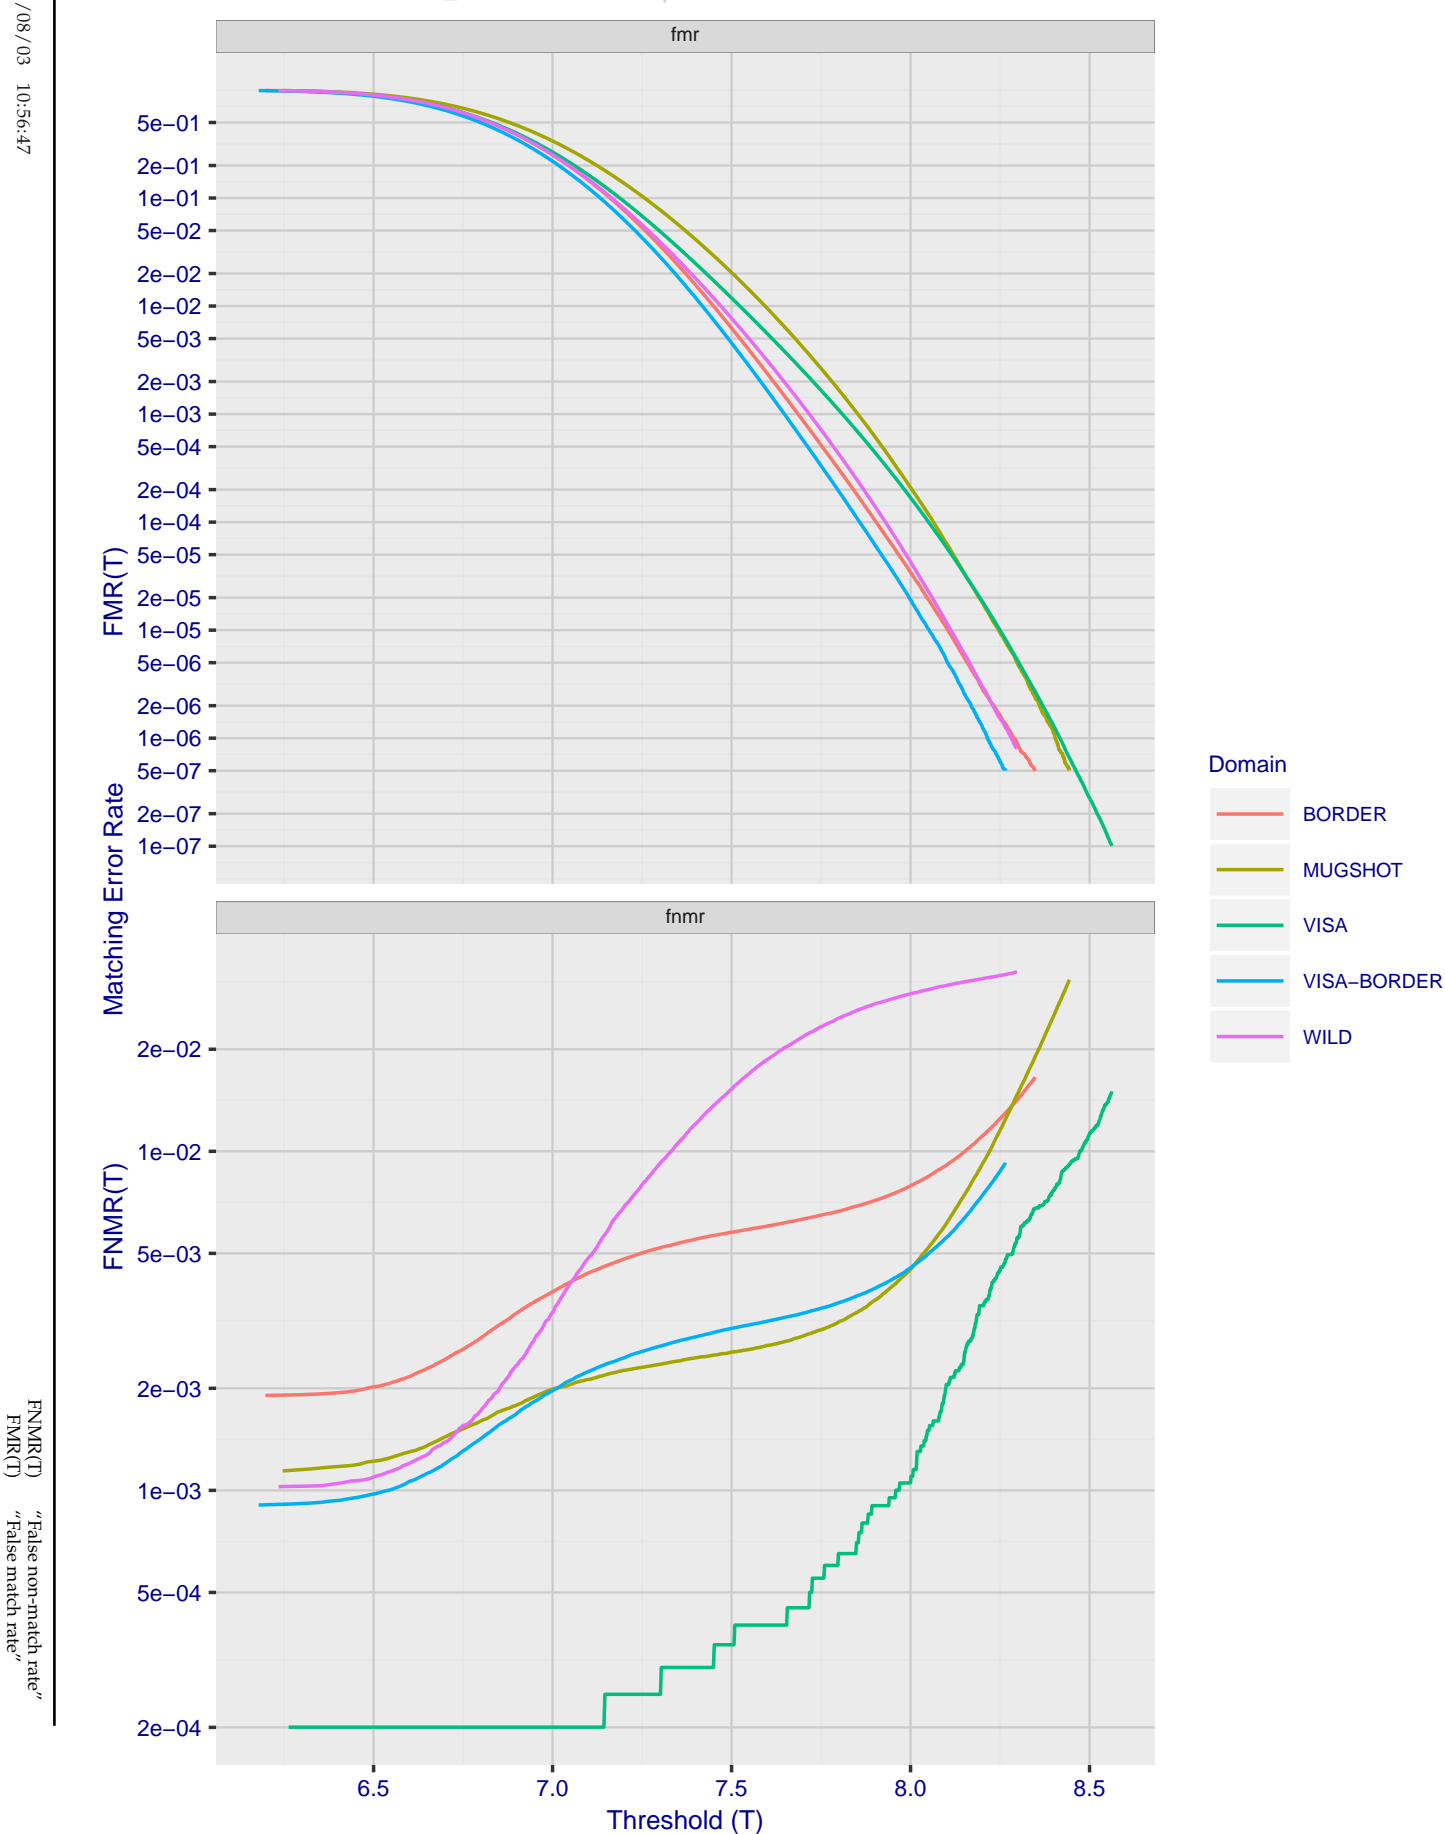


Figure 2: Dependence of FNMR and FMR on threshold for bioidtechswiss-000 by datasets.

BIOIDTECHSWISS_000: Error tradeoff characteristics vs. more accurate algorithms by dataset

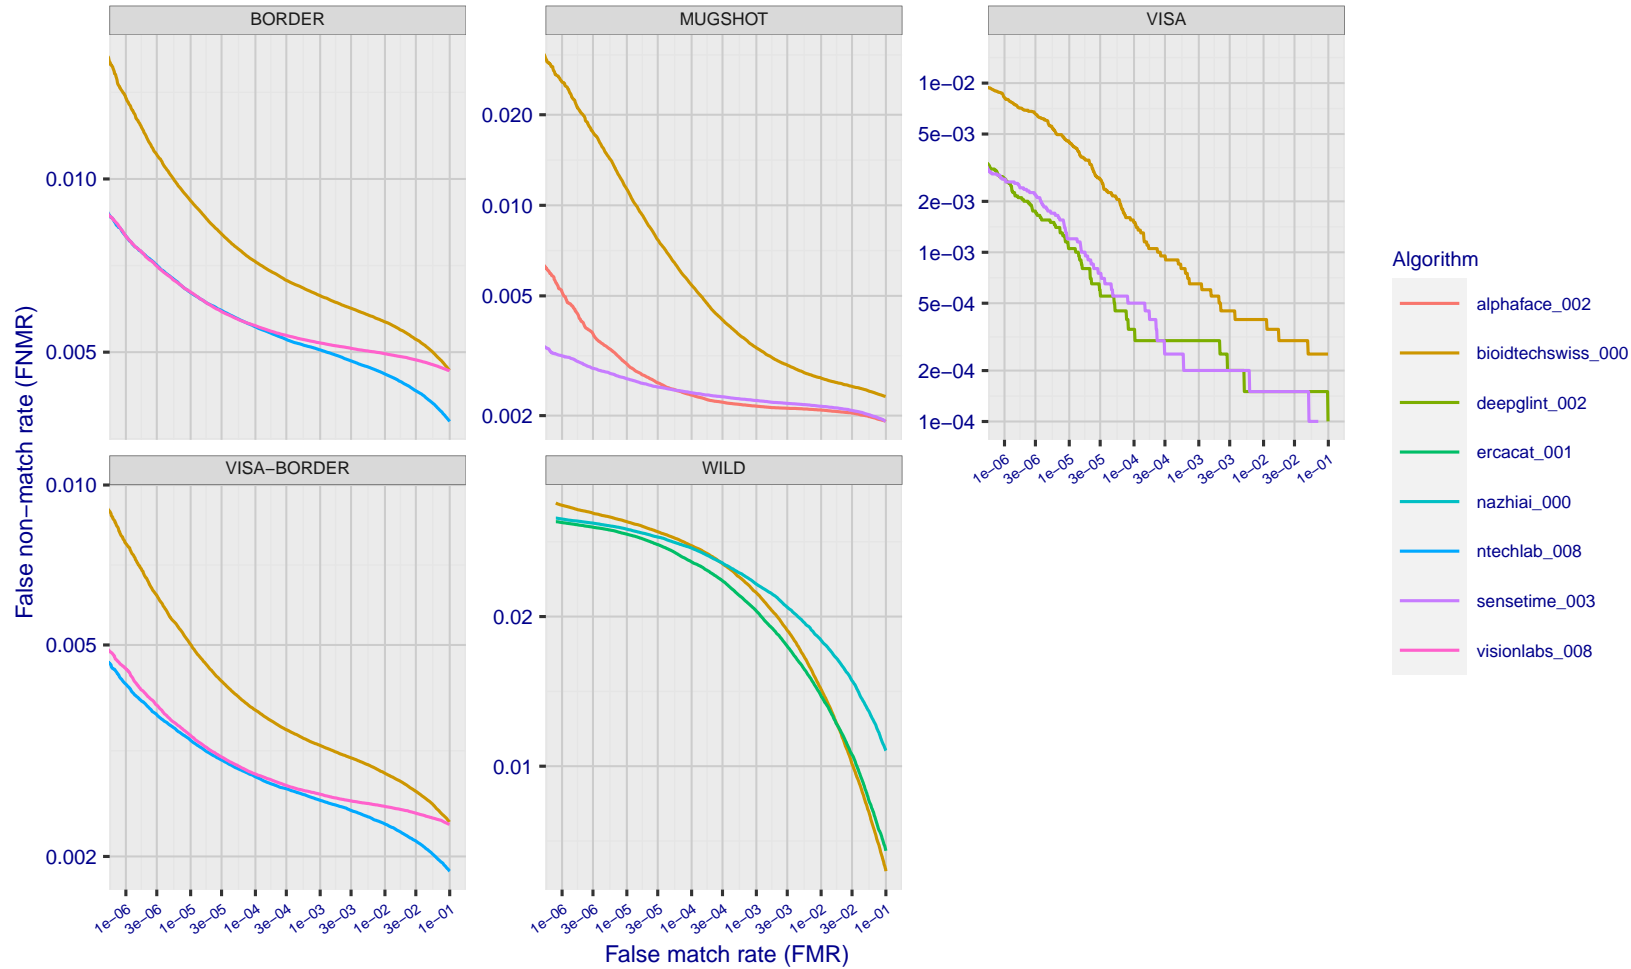


Figure 3: Error tradeoff characteristics for bioidtechswiss-000 vs. the two most accurate algorithms on the respective datasets.