
Yusan_Engineering_2 / Main_System [S7-1500R/H-Station] / PLC_1 [CPU 1518HF-4 PN] / Program blocks

Main [OB1]


Main Properties							
General							
Name	Main	**Number**	1	**Type**	OB	**Language**	LAD
Numbering	Automatic						
Information							
Title	"Main Program Sweep (Cycle)"	**Author**		**Comment**		**Family**	
Version	0.1	**User-defined ID**					

Main			
Name	**Data type**	**Default value**	**Comment**
Input			
Initial_Call	Bool		Initial call of this OB
Remanence	Bool		=True, if remanent data are available
Temp			
Fault_Handshake_Infeed_1	Bool		
Fault_Handshake_Outfeed_1	Bool		
Fault_Handshake_Infeed_2	Bool		
Fault_Handshake_Infeed_3	Bool		
Fault_Handshake_Outfeed_2	Bool		
Fault_Handshake_Outfeed_3	Bool		
Constant			


Network 1: START PLC

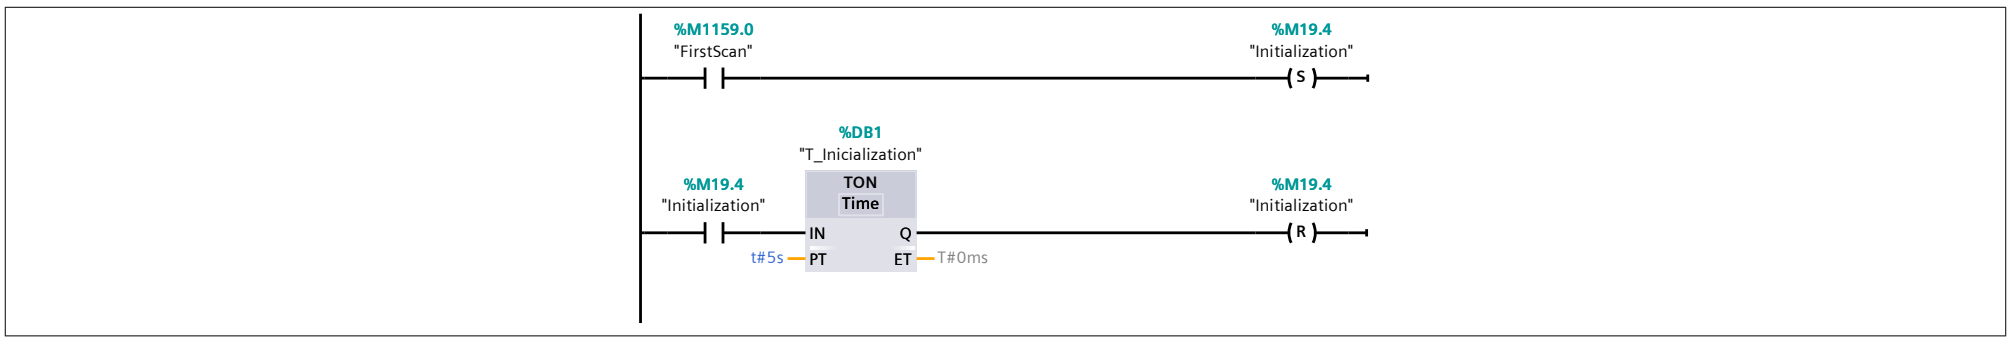

Network 2: INPUTS

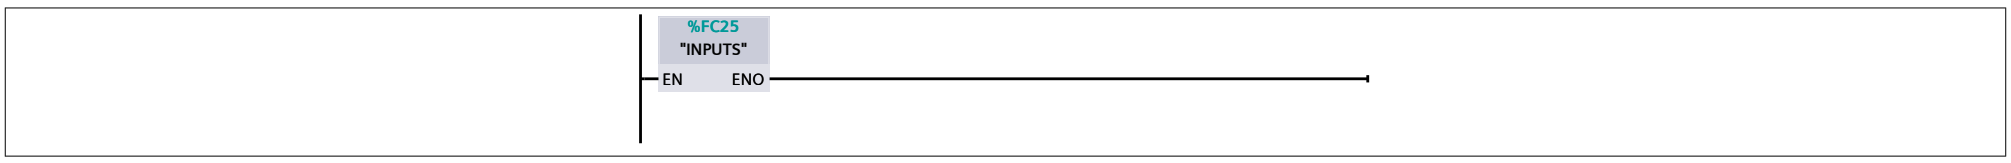


Network 3: MQTT

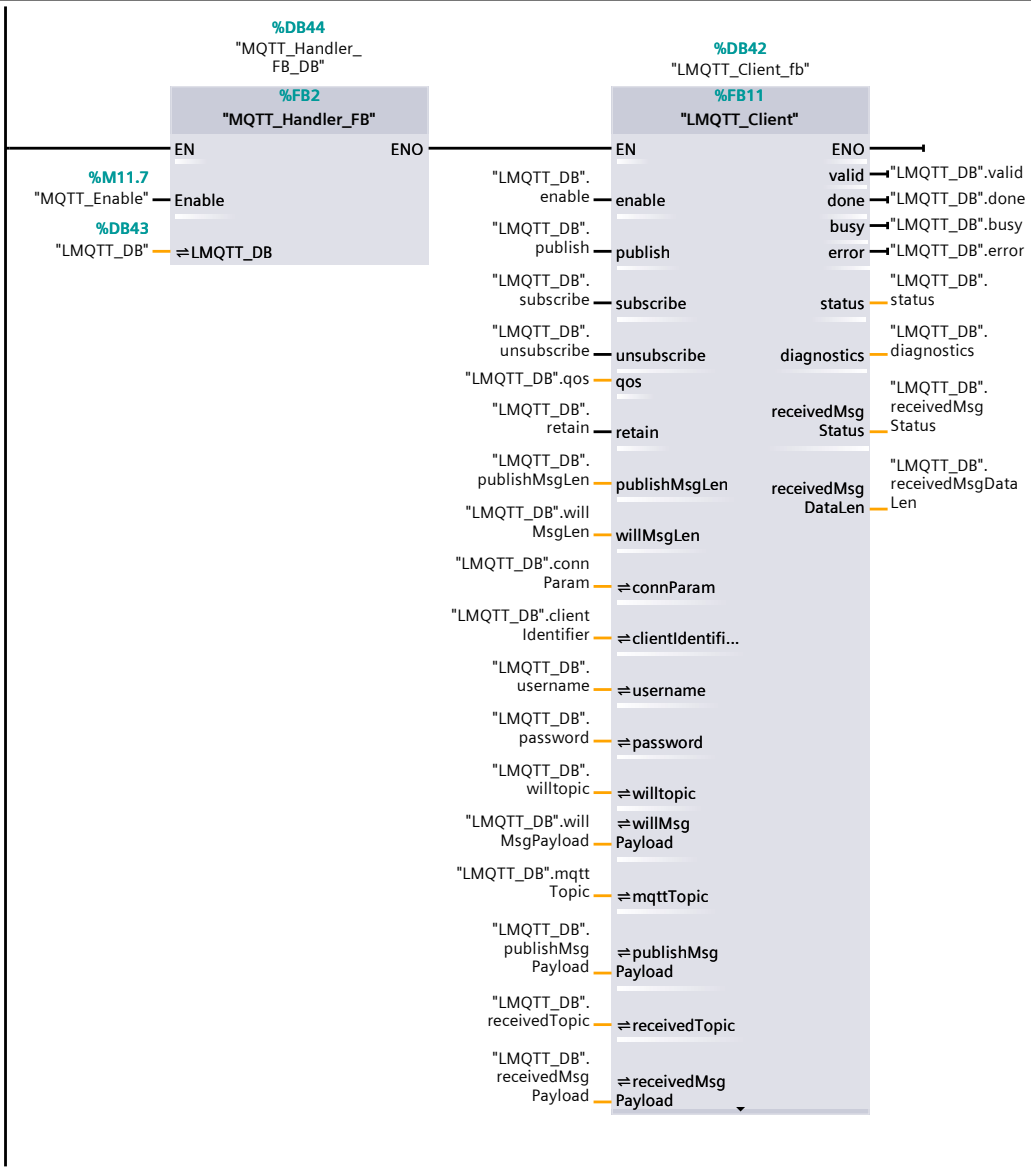


Network 4: Absolute Encoders




Network 5: Errors

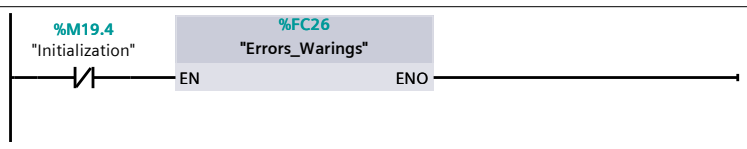


Network 6: AUTO TEST 1

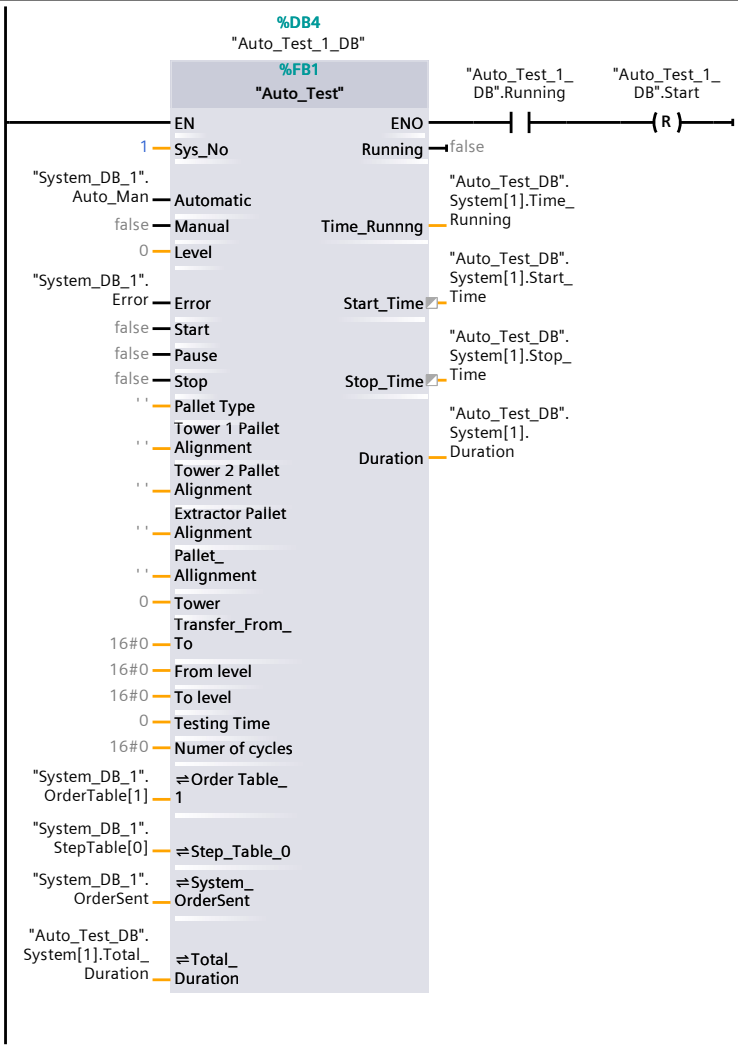


Network 7: AUTO TEST 2

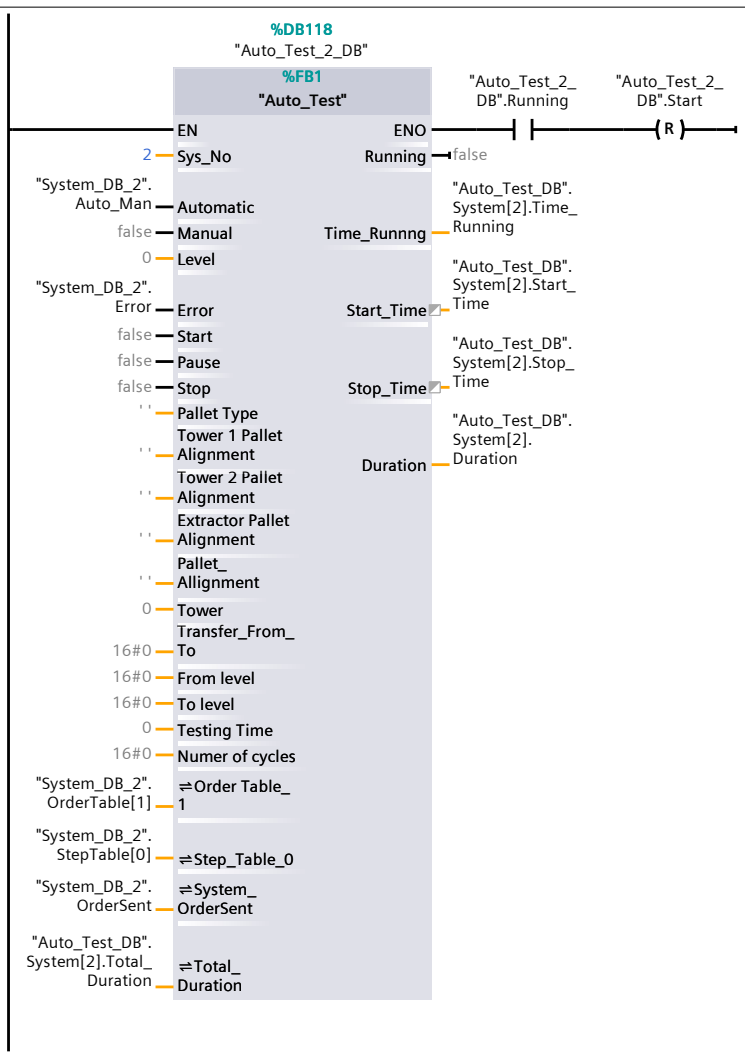


Network 8: AUTO TEST 3

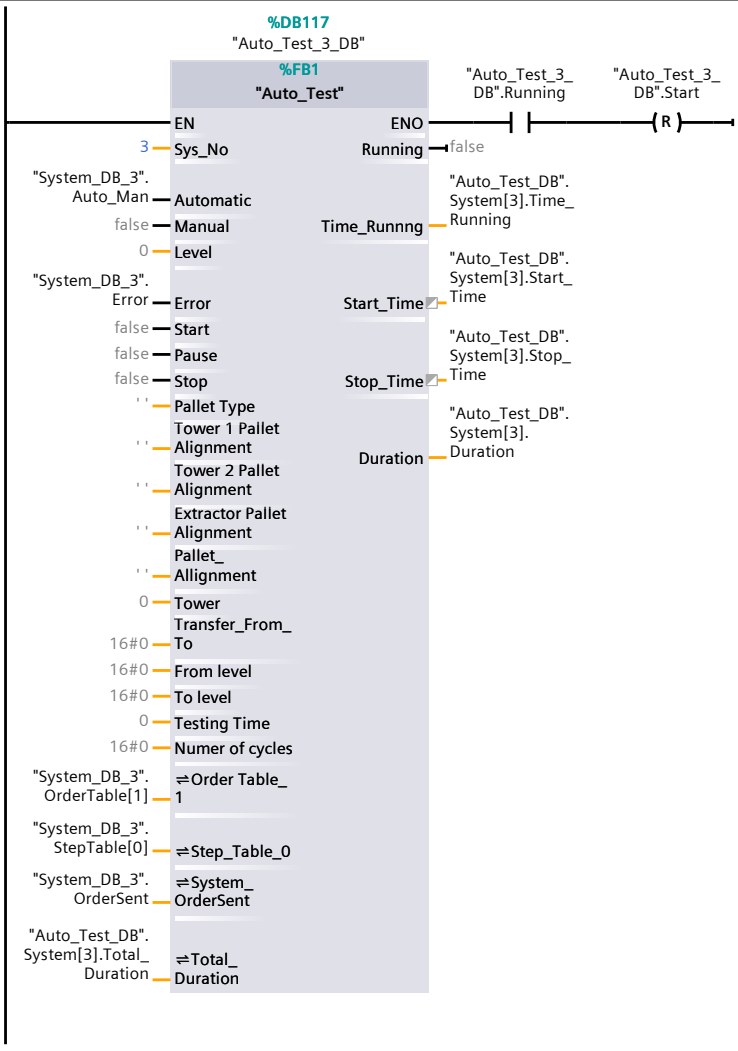


Network 9: AUTO TEST 4

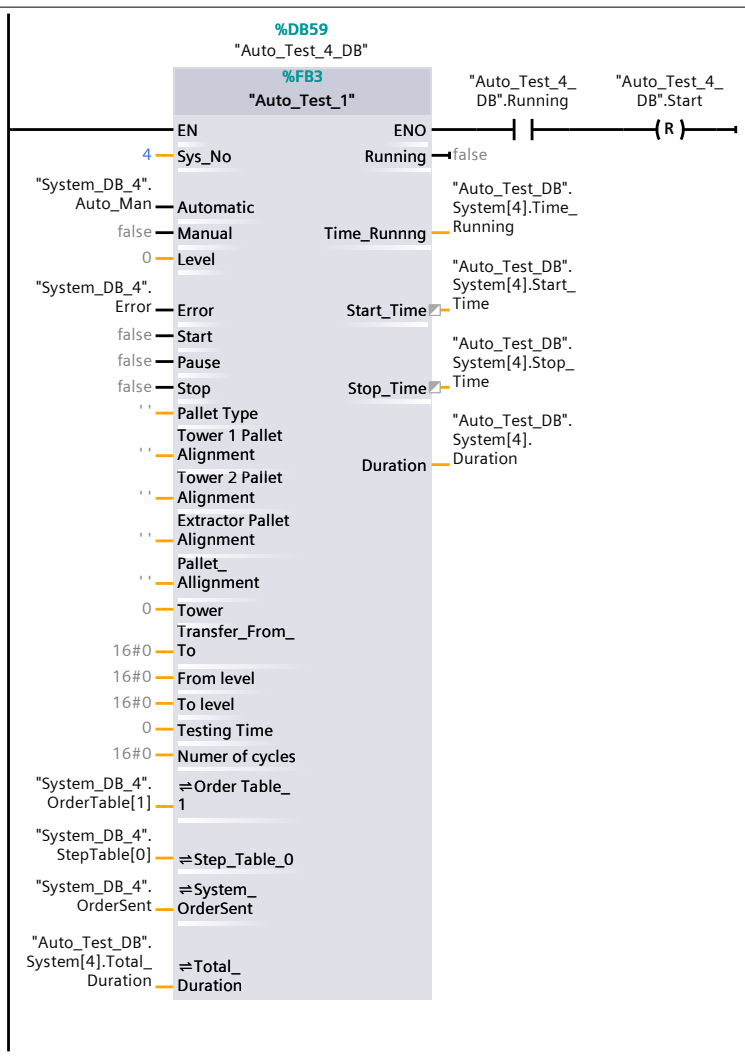


Network 10: AUTO TEST 5

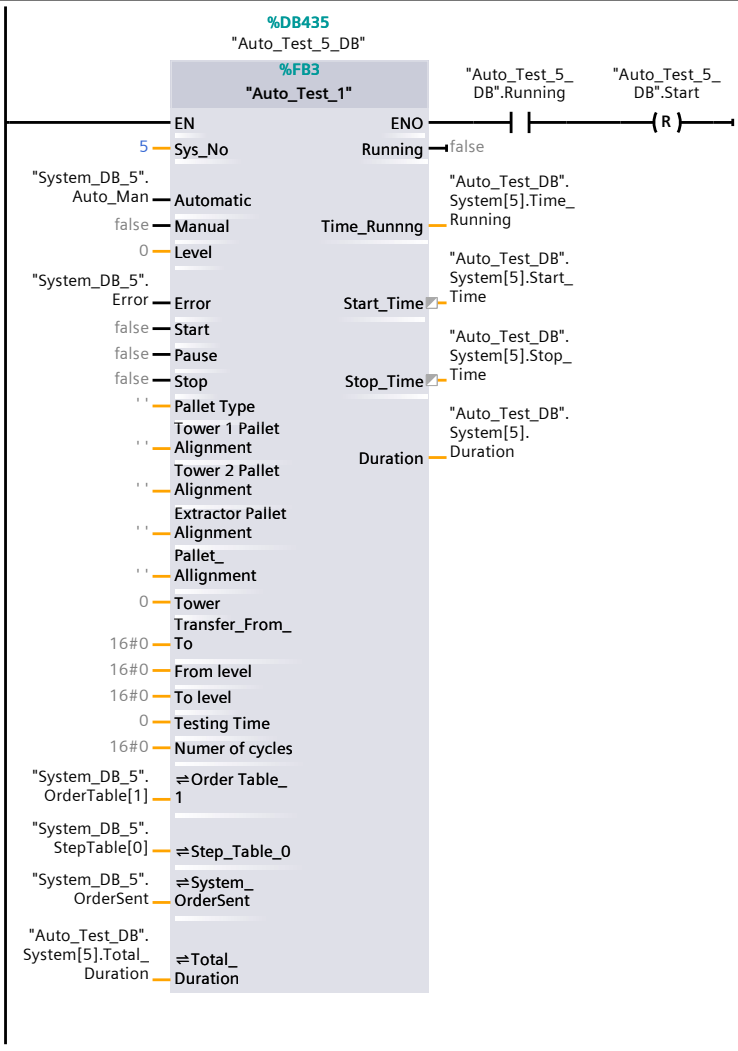


Network 11: Conveyors Transfer

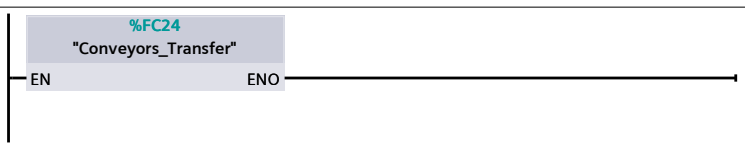


Network 12: Bypasses

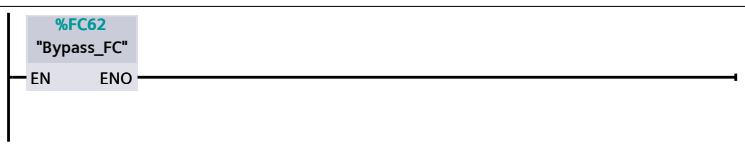


Network 13: LOCAL MODE Hmis (Keys)

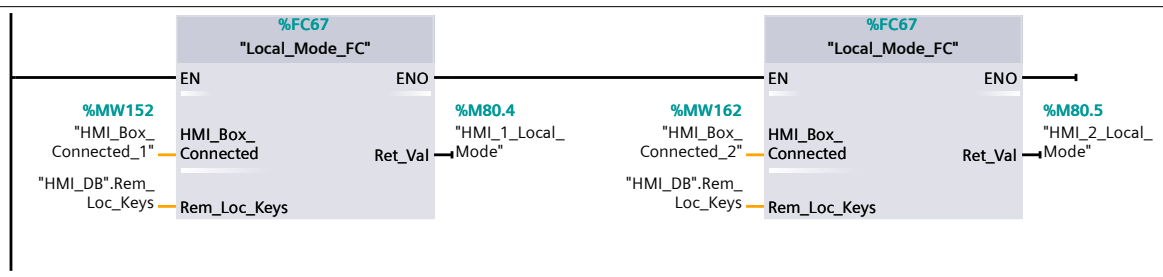


Network 14: VTD / Extractor Conveyor 1

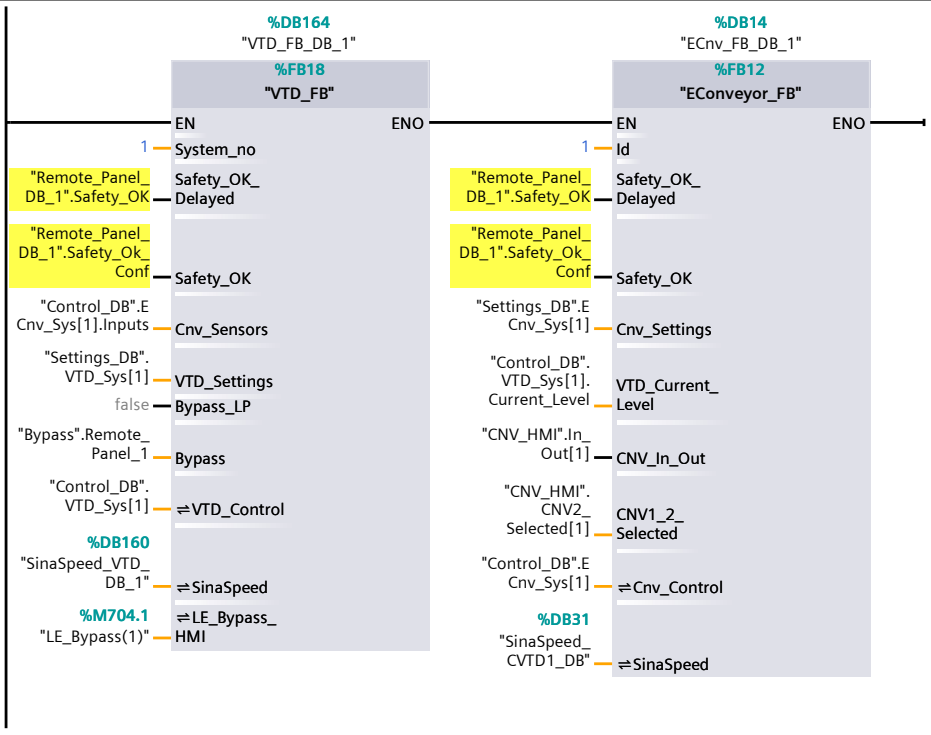


Network 15: VTD / Extractor Conveyor 2

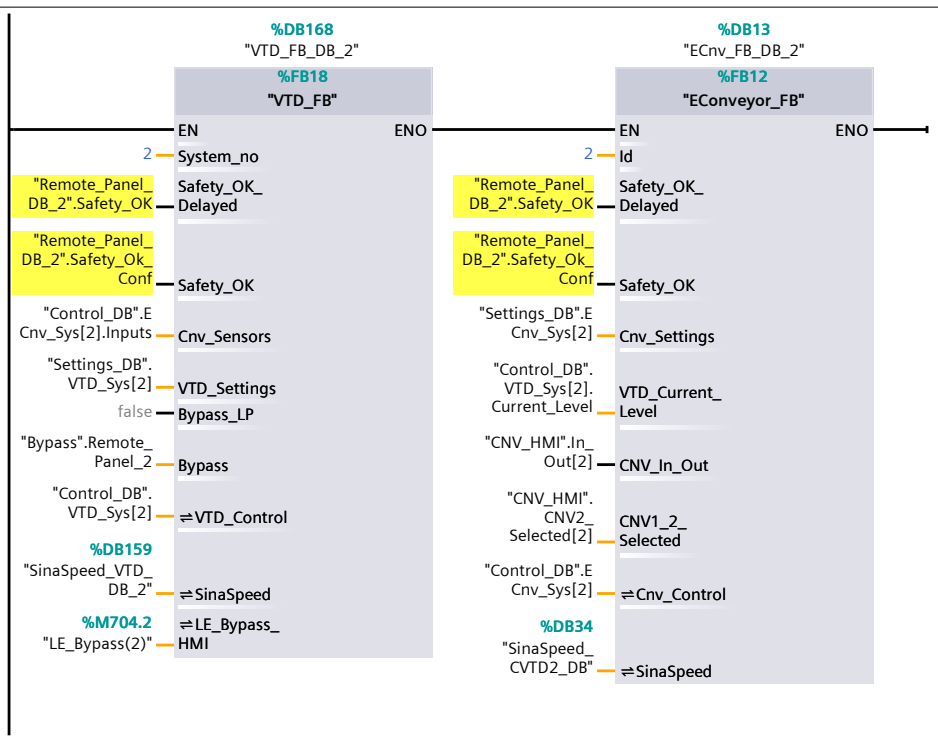


Network 16: VTD / Extractor Conveyor 3

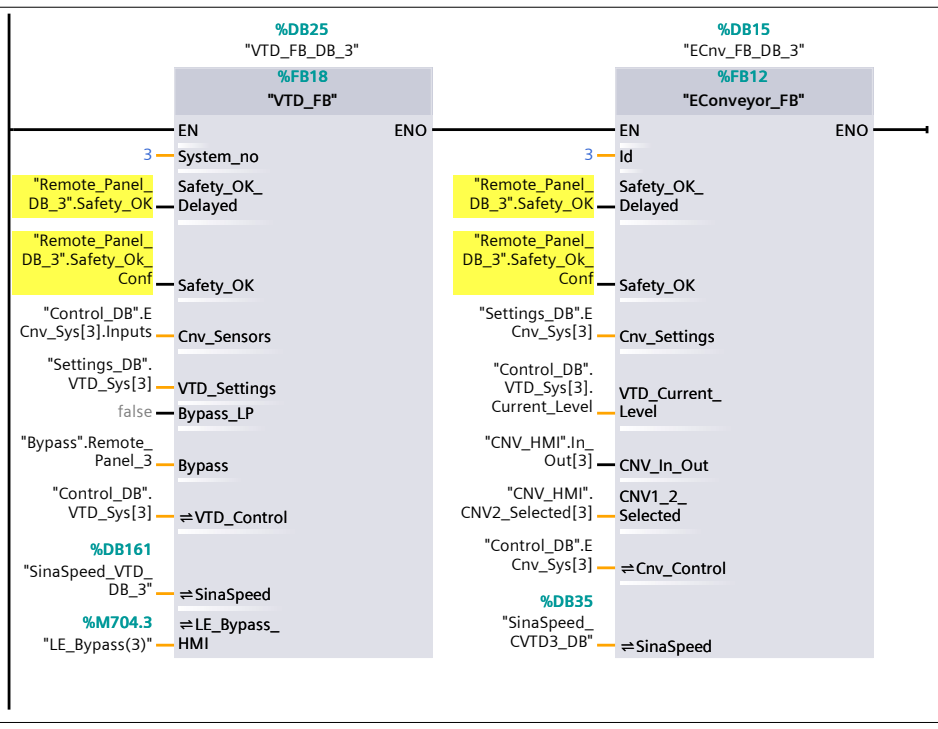


Network 17: VTD / Extractor Conveyor 4

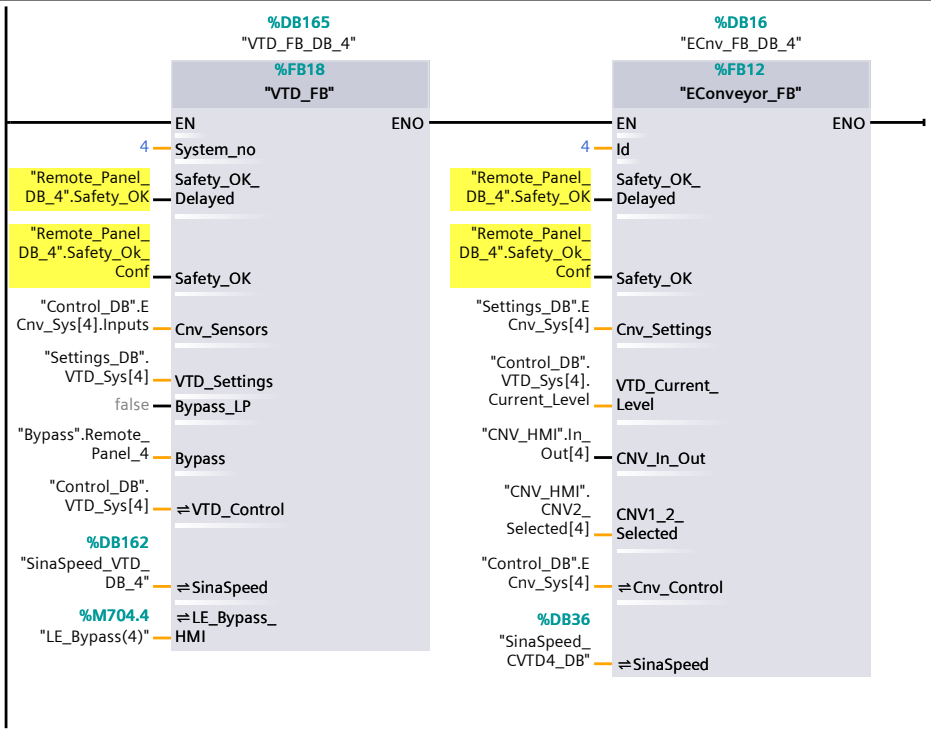

Network 18: VTD / Extractor Conveyor 5

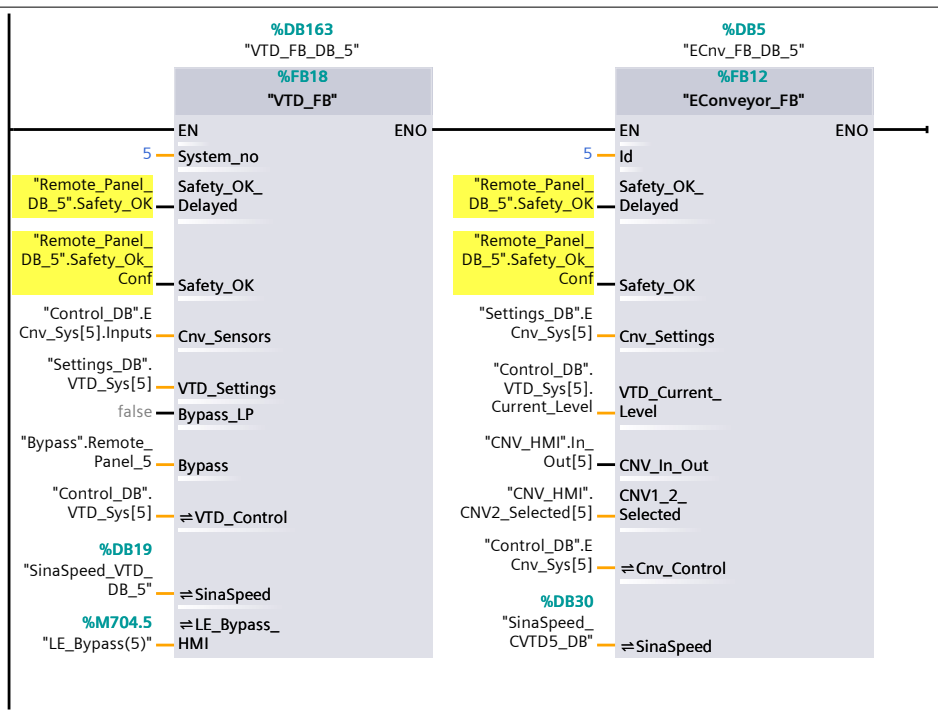


Network 19: SYSTEM 1

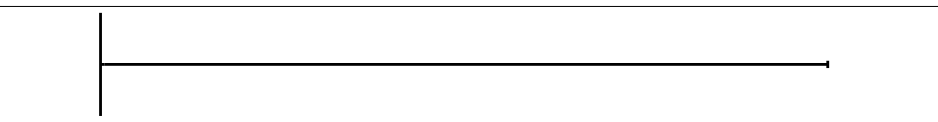


Network 20: Level Conveyors Tower 1 - SYSTEM 1




Network 21: Level Conveyors Tower 2 - SYSTEM 1

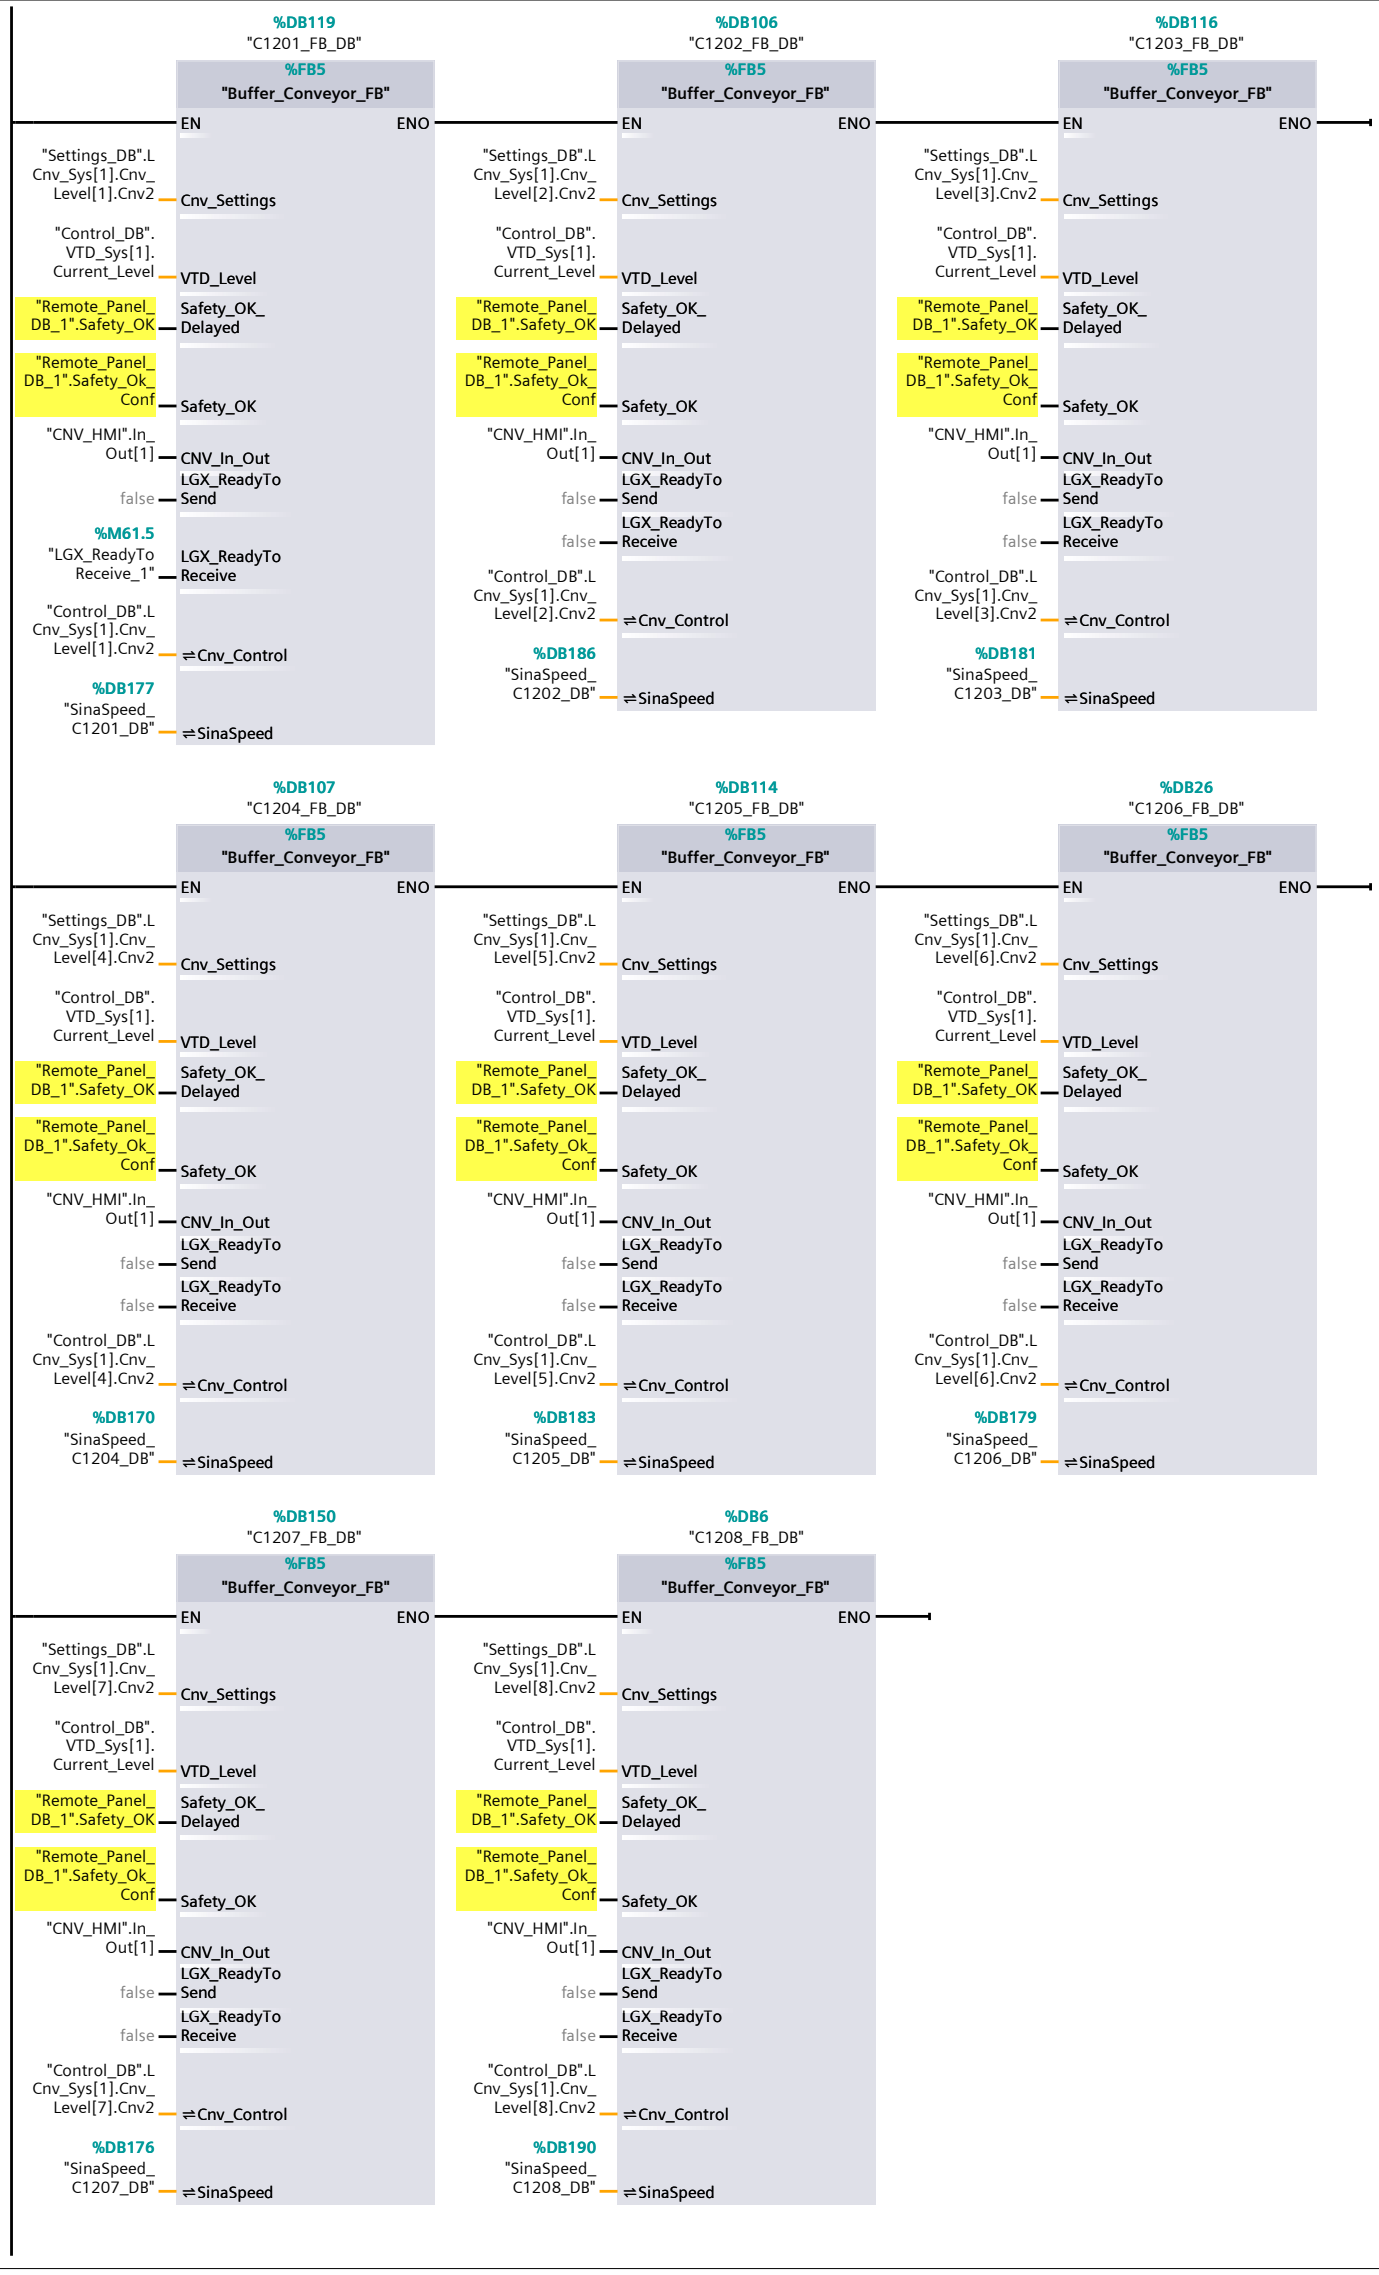


Network 22: SAFETY STOPPERS Tower 1 - SYSTEM 1

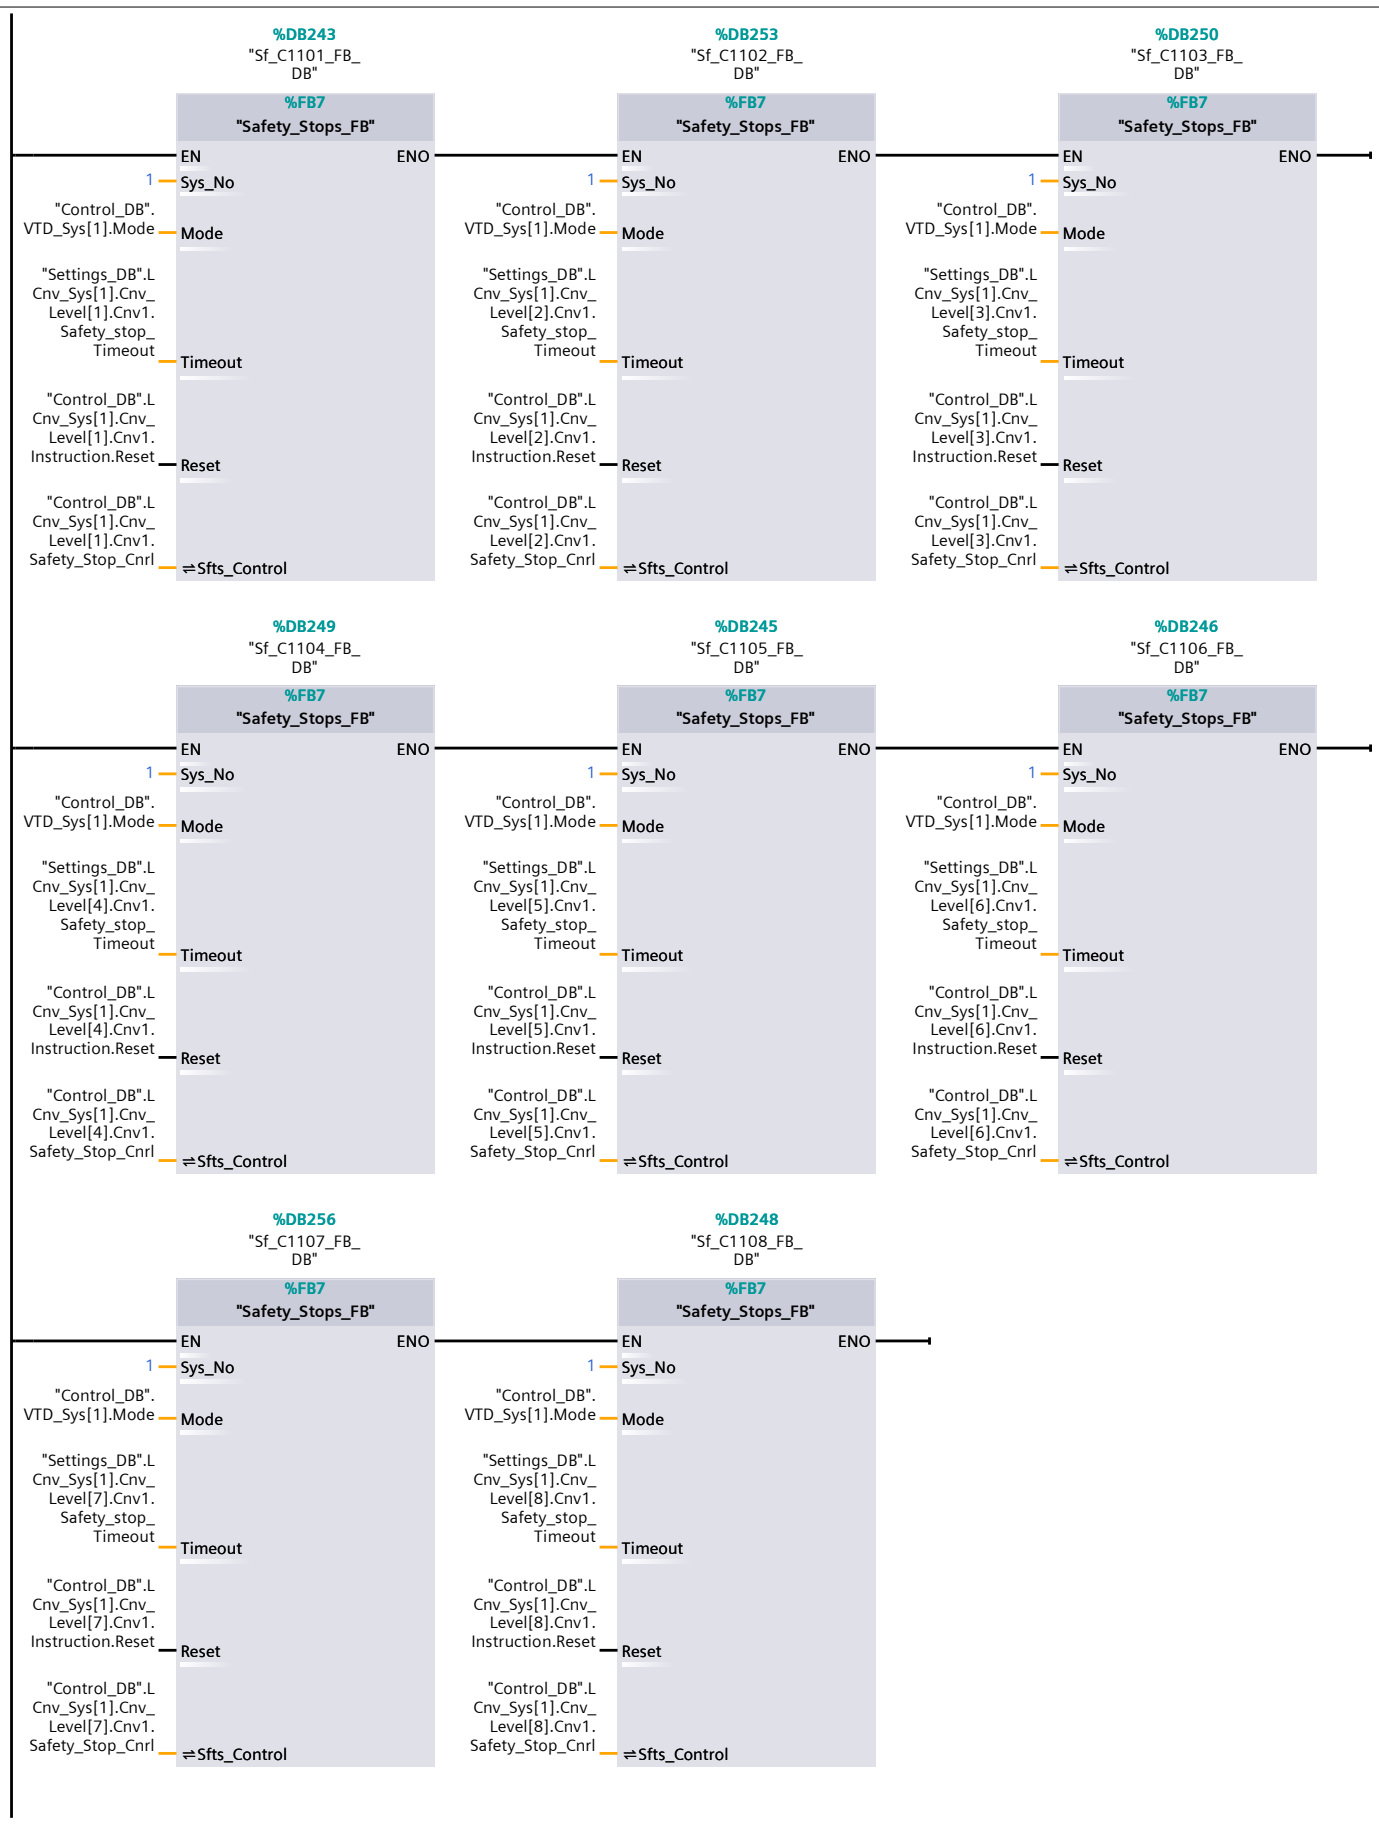

Network 23: SAFETY STOPPERS Tower 2 - SYSTEM 1

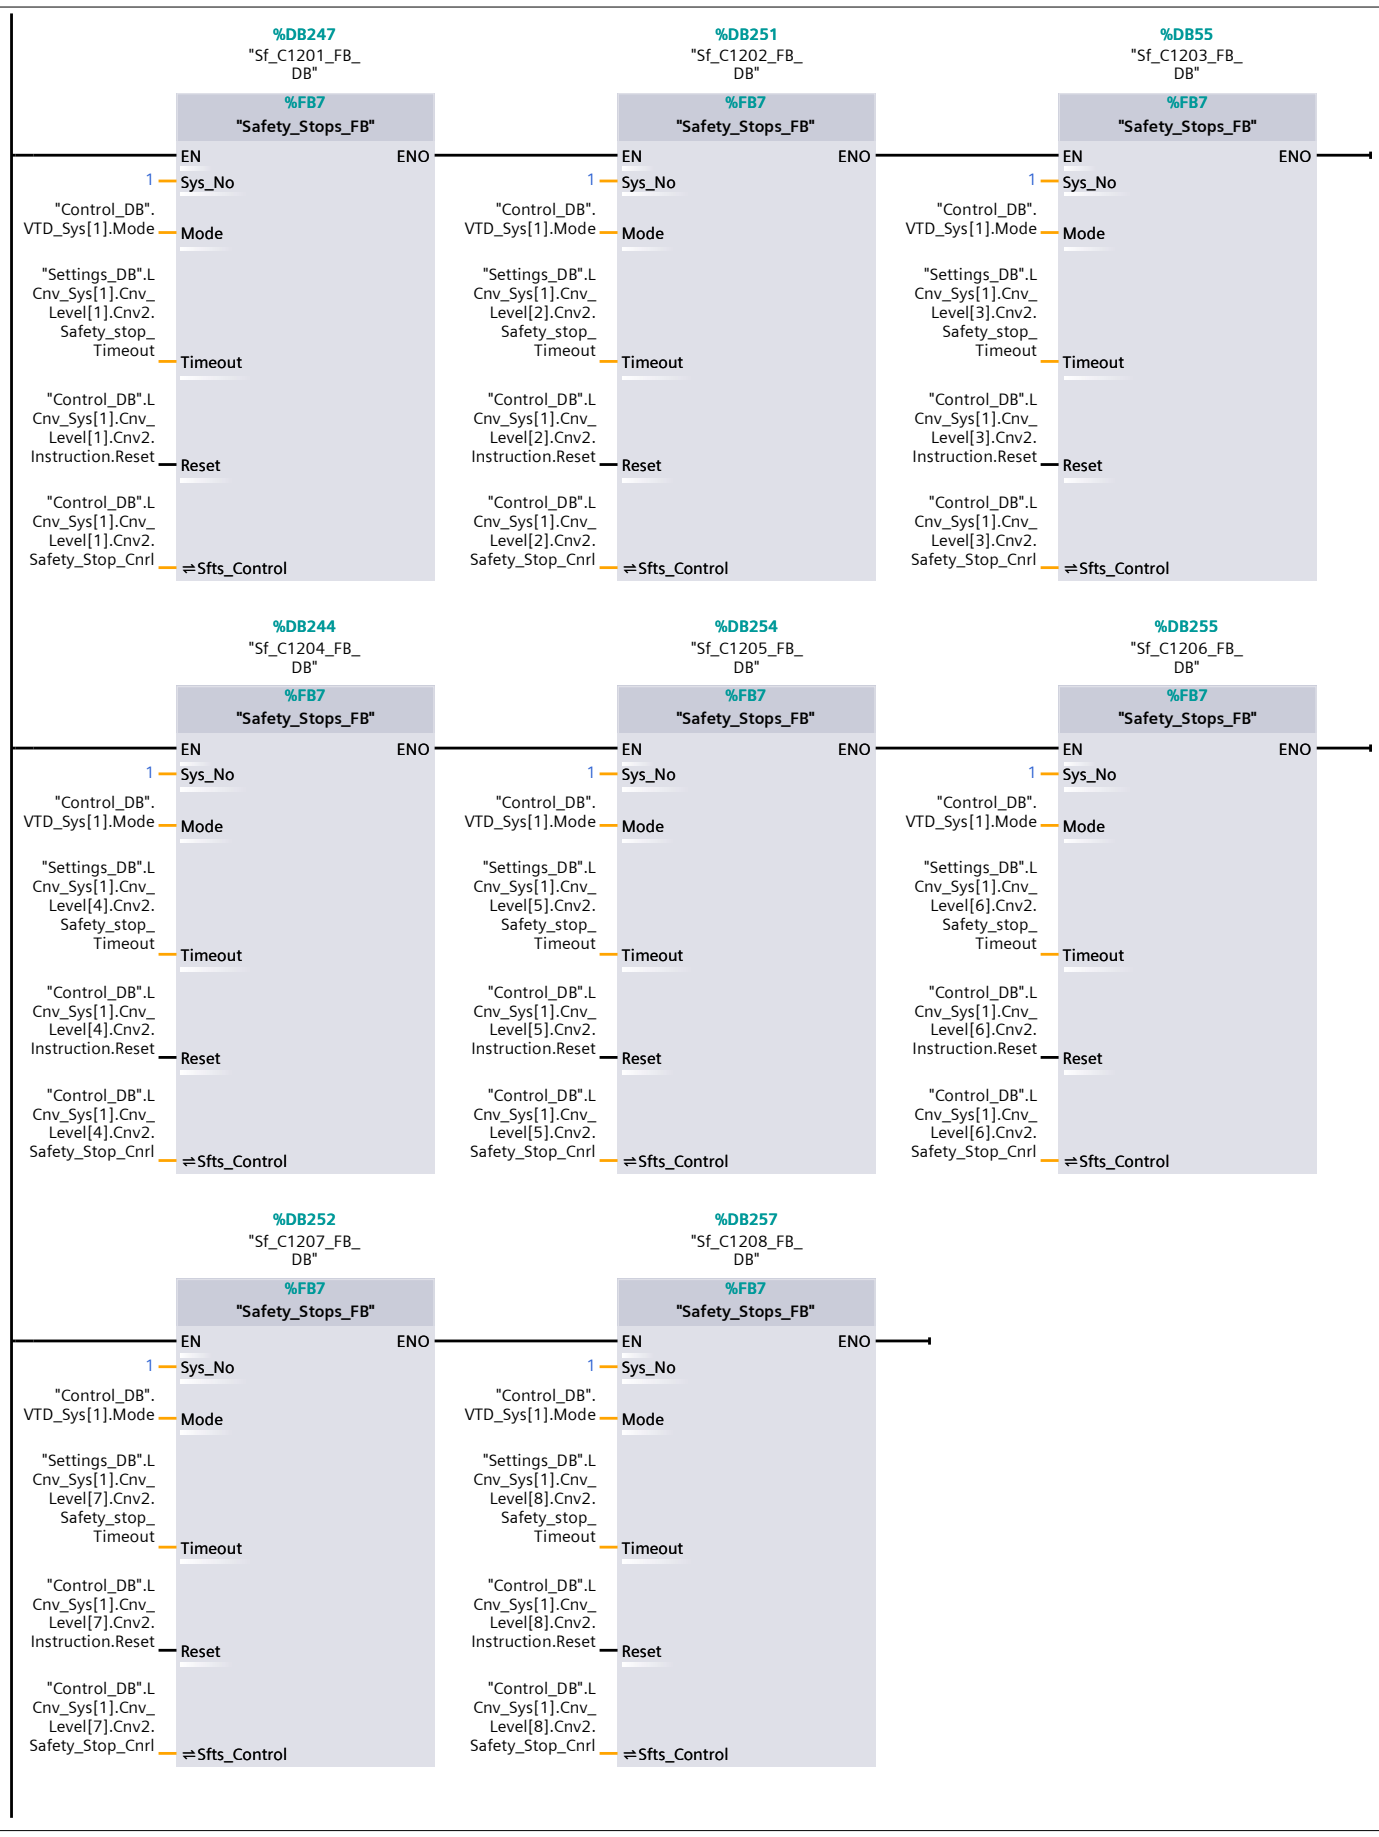

Network 24: SYSTEM 2



Network 25: Level Conveyors Tower 1 - SYSTEM 2



Network 26: Level Conveyors Tower 2 - SYSTEM 2




Network 27: SAFETY STOPPERS Tower 1 - SYSTEM 2



Network 28: SAFETY STOPPERS Tower 2 - SYSTEM 2



Network 29: SYSTEM 3



Network 30: Level Conveyors Tower 1 - SYSTEM 3



Network 31: Level Conveyors Tower 2 - SYSTEM 3




Network 32: SAFETY STOPPERS Tower 1 - SYSTEM 3



Network 33: SAFETY STOPPERS Tower 2 - SYSTEM 3



Network 34: SYSTEM 4




Network 35: Level Conveyors Tower 1 - SYSTEM 4



Network 36: SAFETY STOPPERS Tower 1 - SYSTEM 4




Network 37: SYSTEM 5




Network 38: Level Conveyors Tower 1 - SYSTEM 5




Network 39: SAFETY STOPPERS Tower 1 - SYSTEM 5

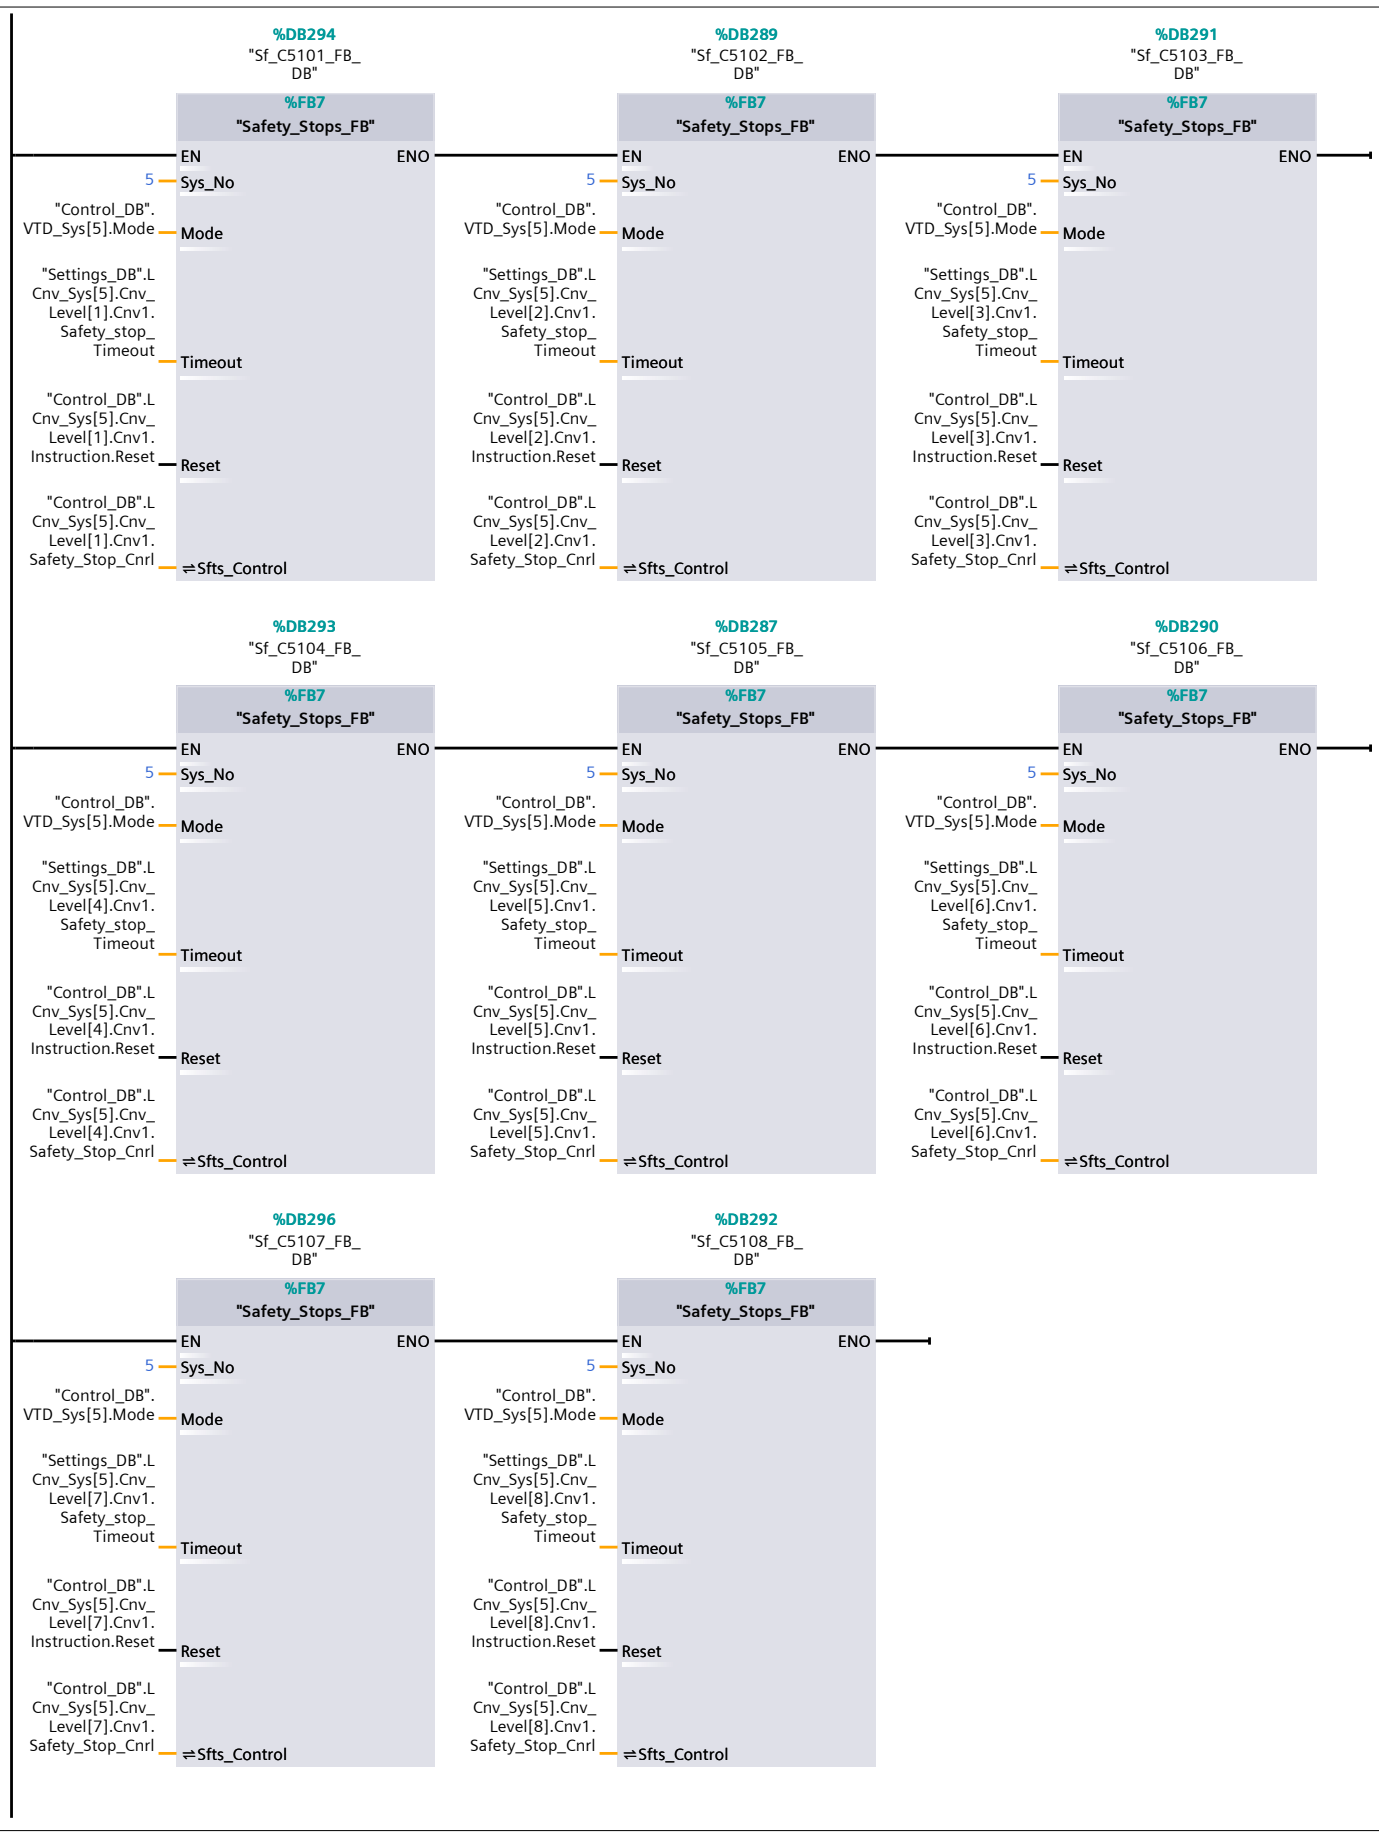


Network 40: Light bars

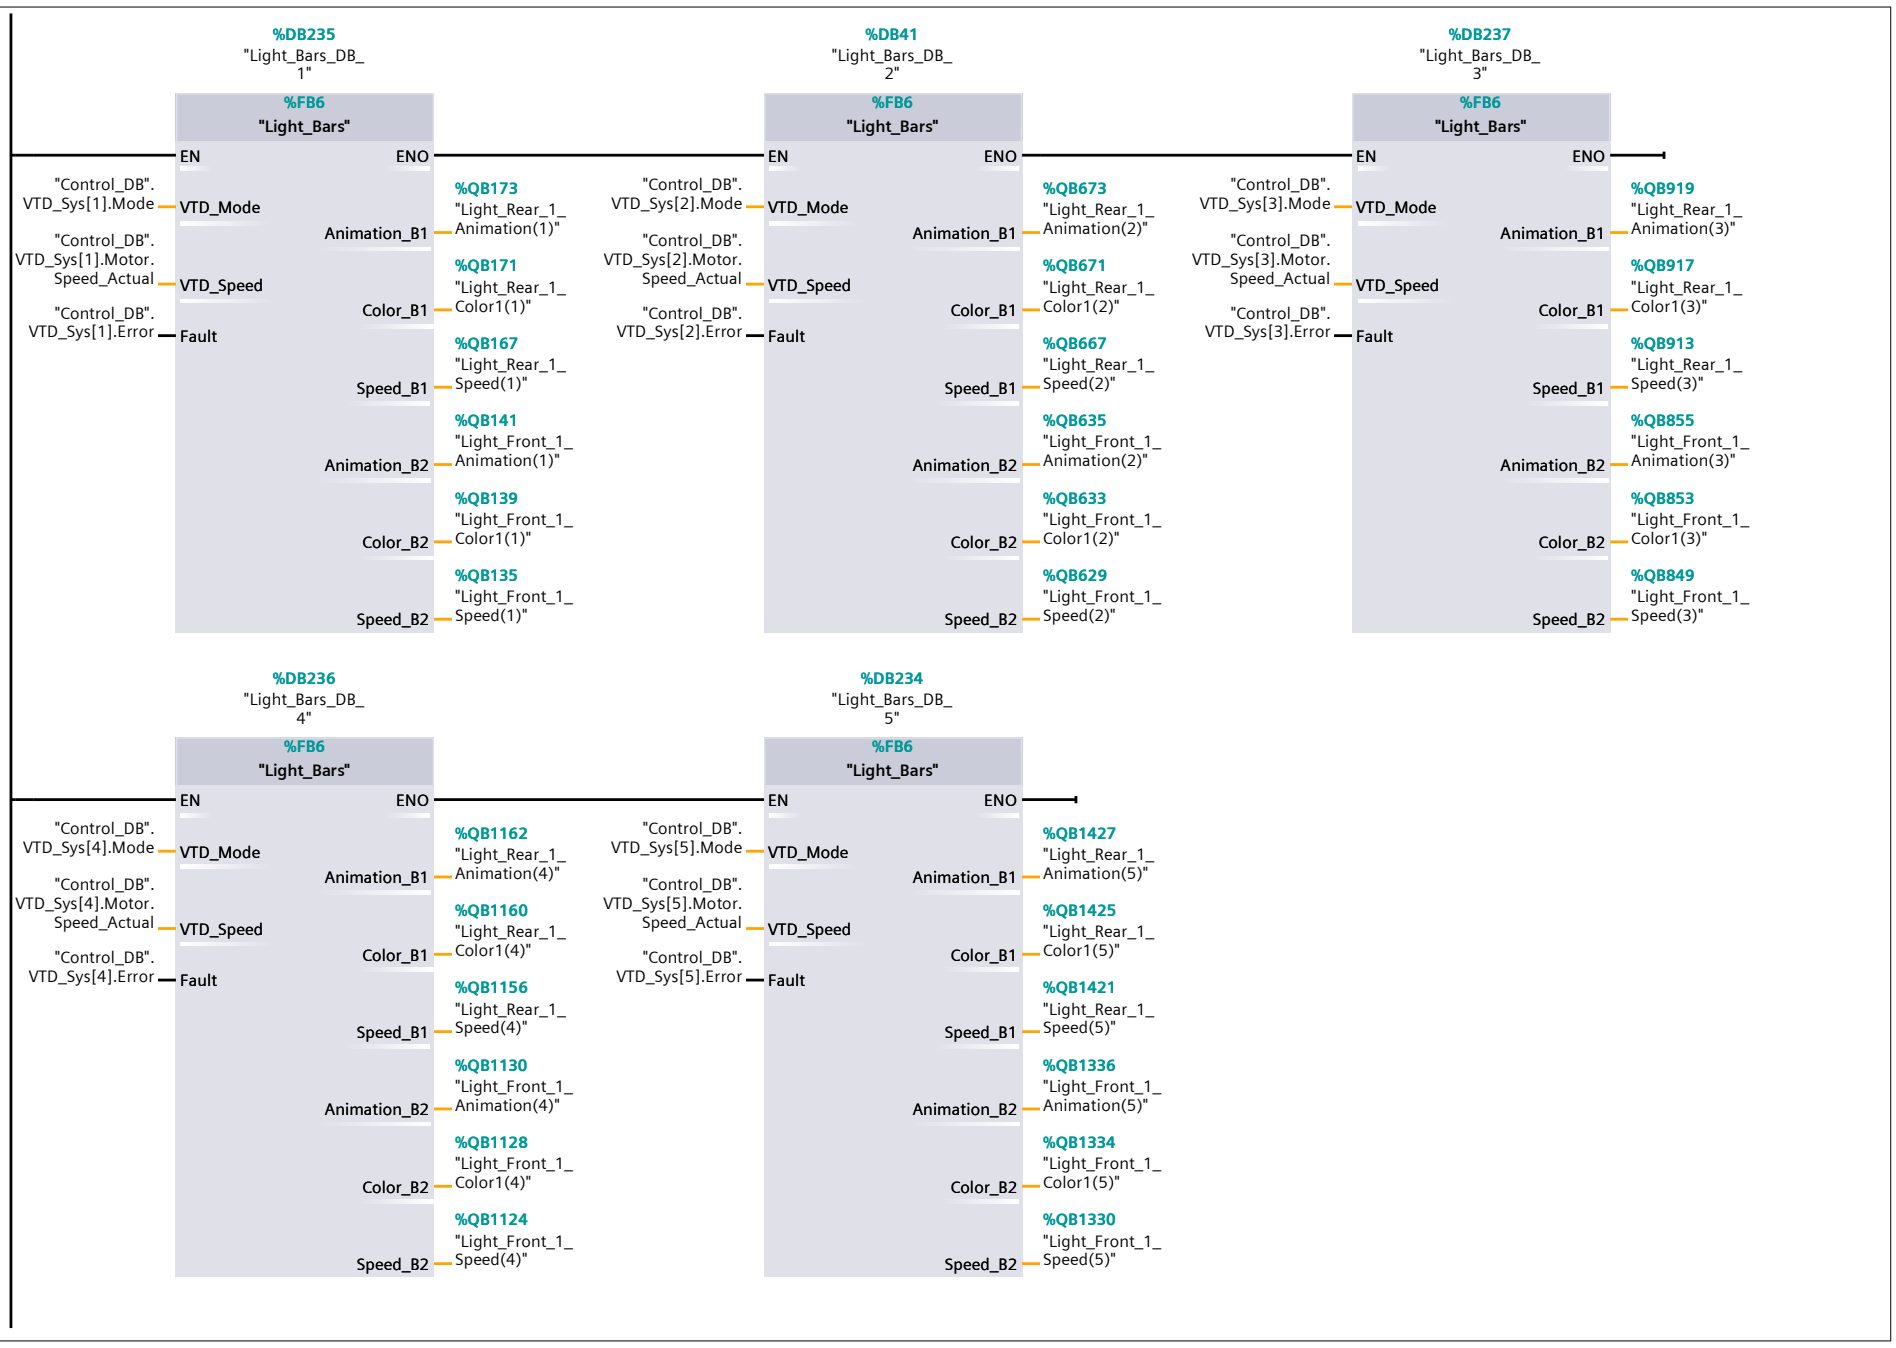


Network 41: Barcode - System 1

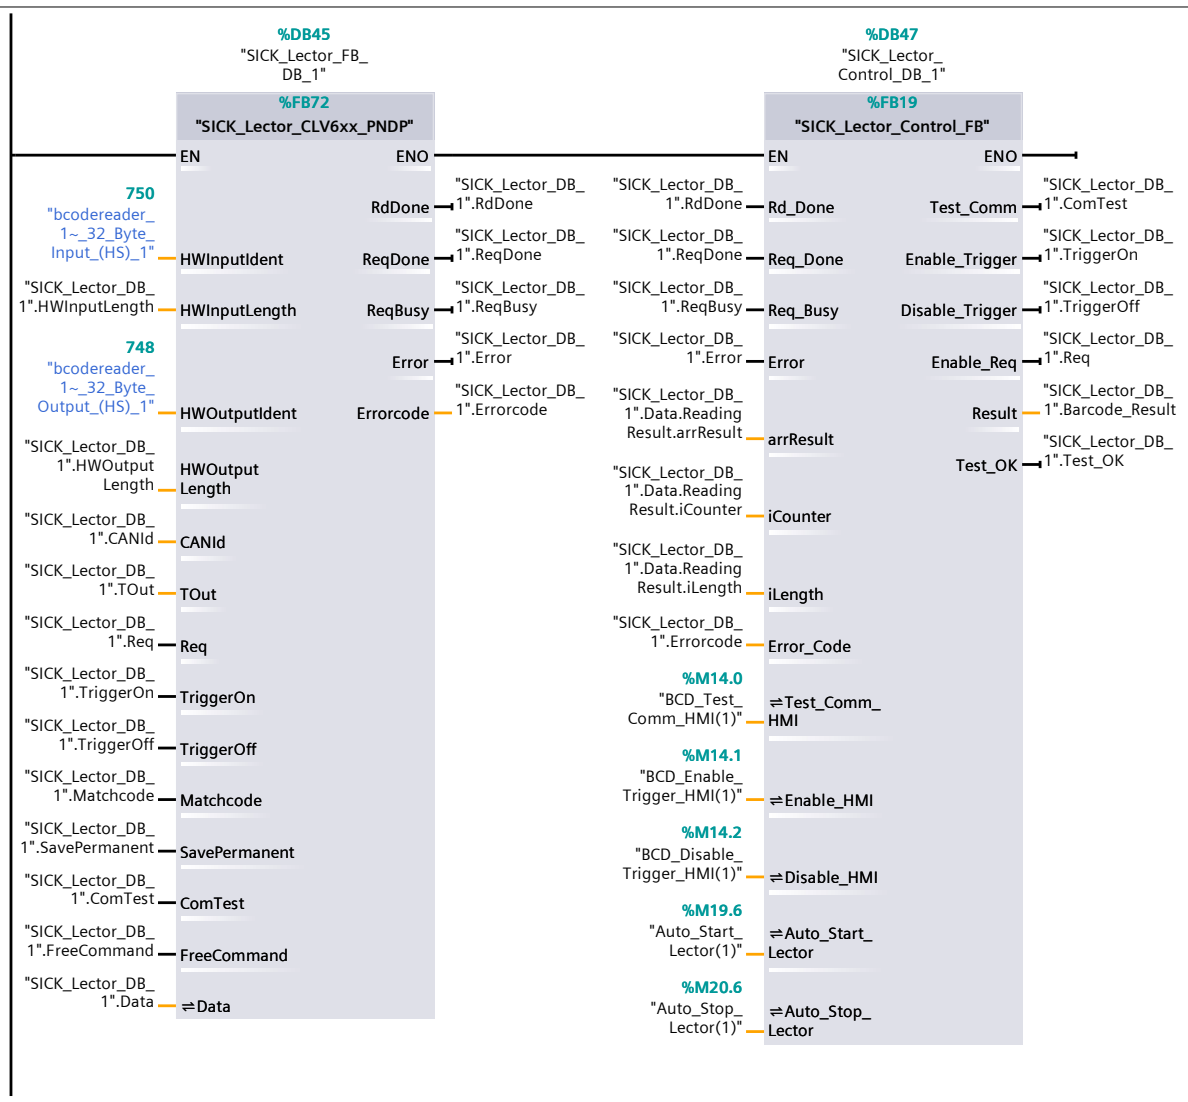


Network 42: Barcode - System 2

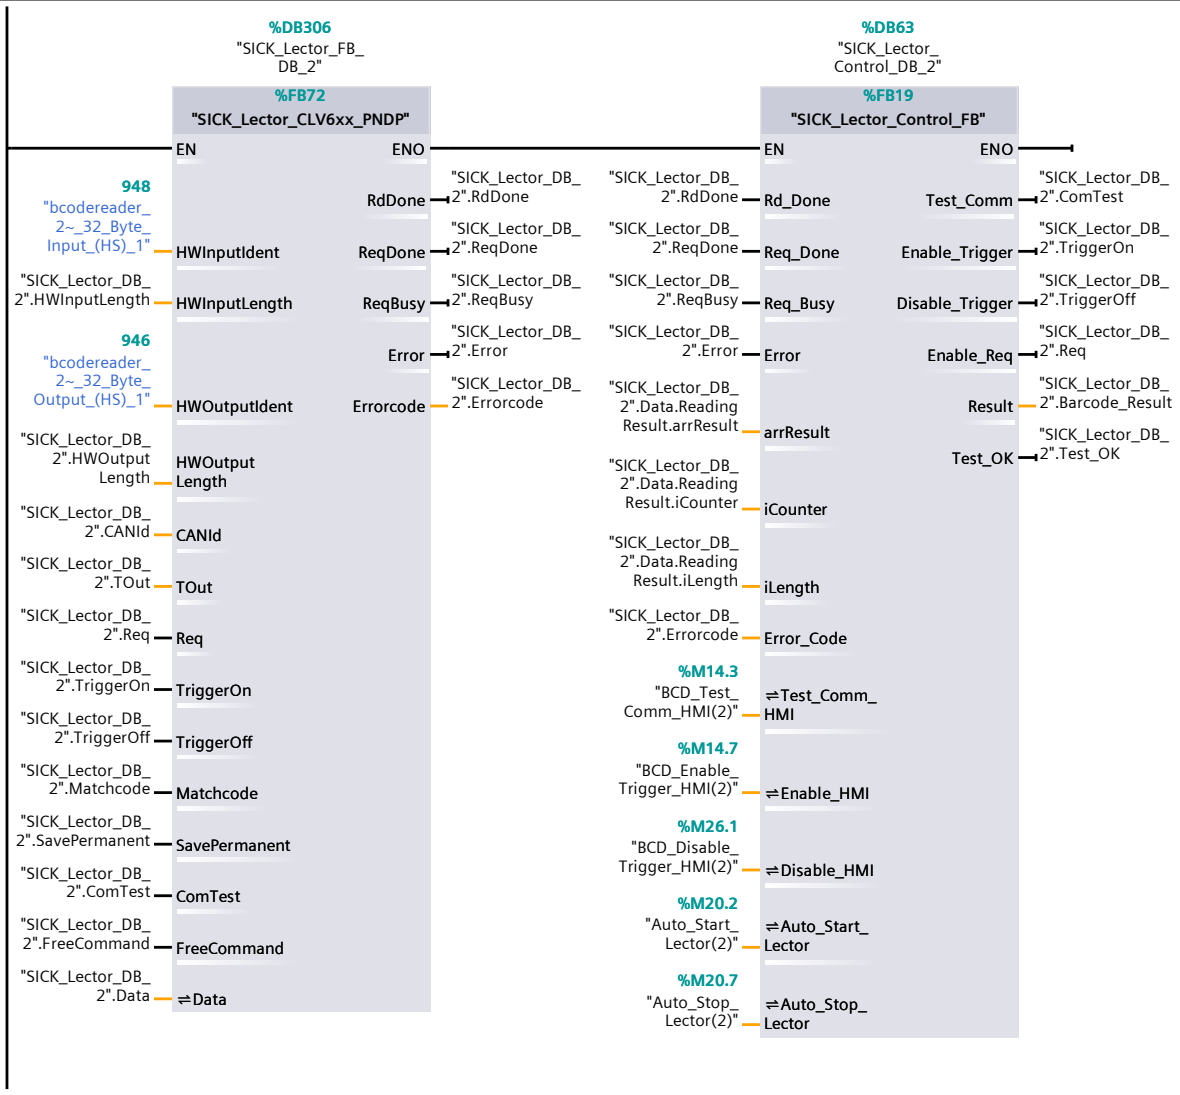


Network 43: Barcode - System 3

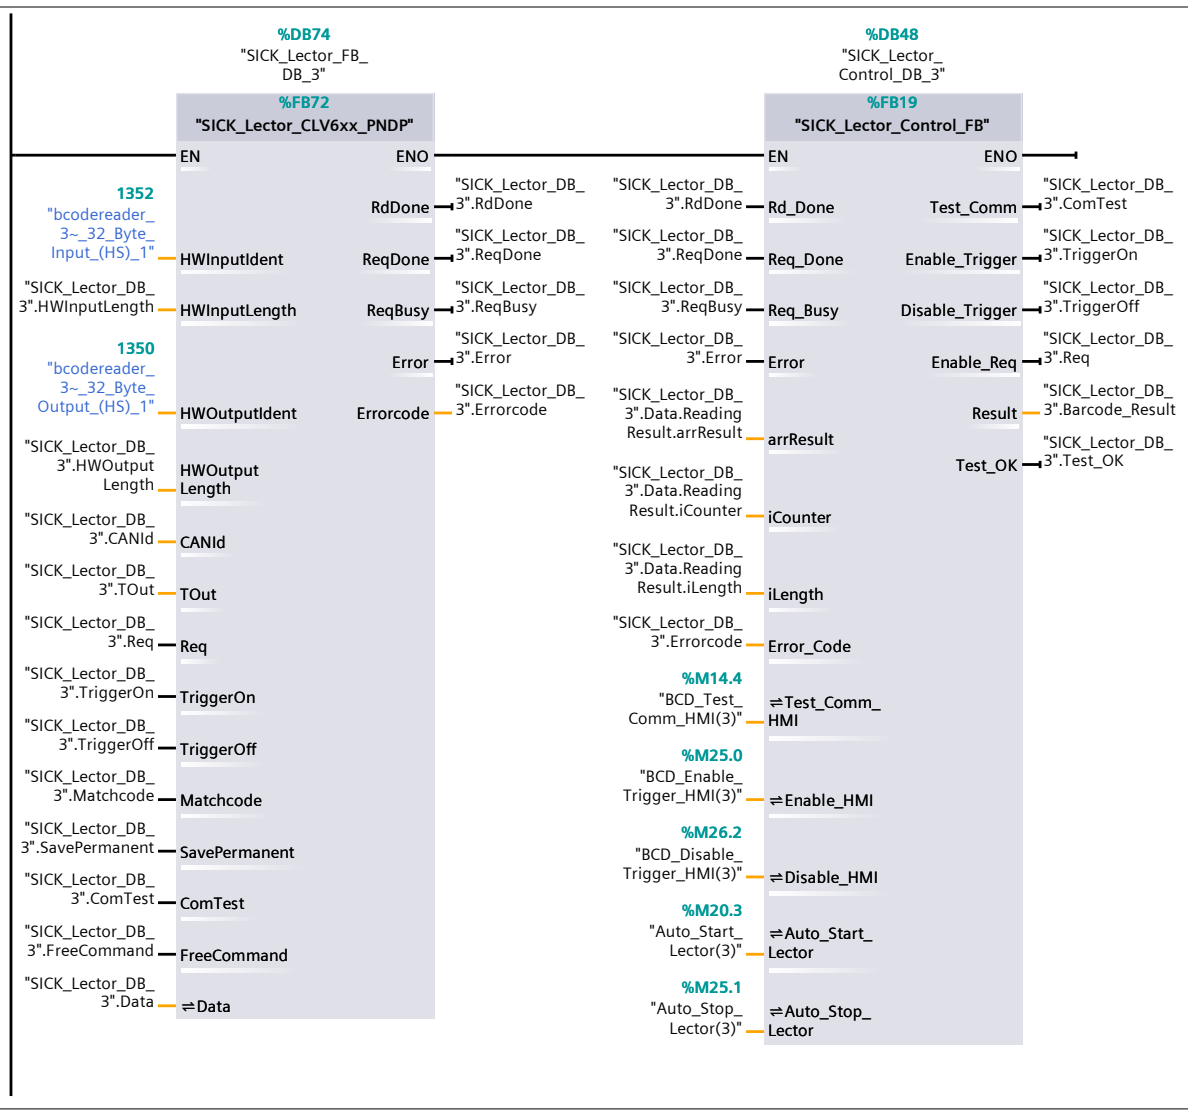


Network 44: Barcode - System 4

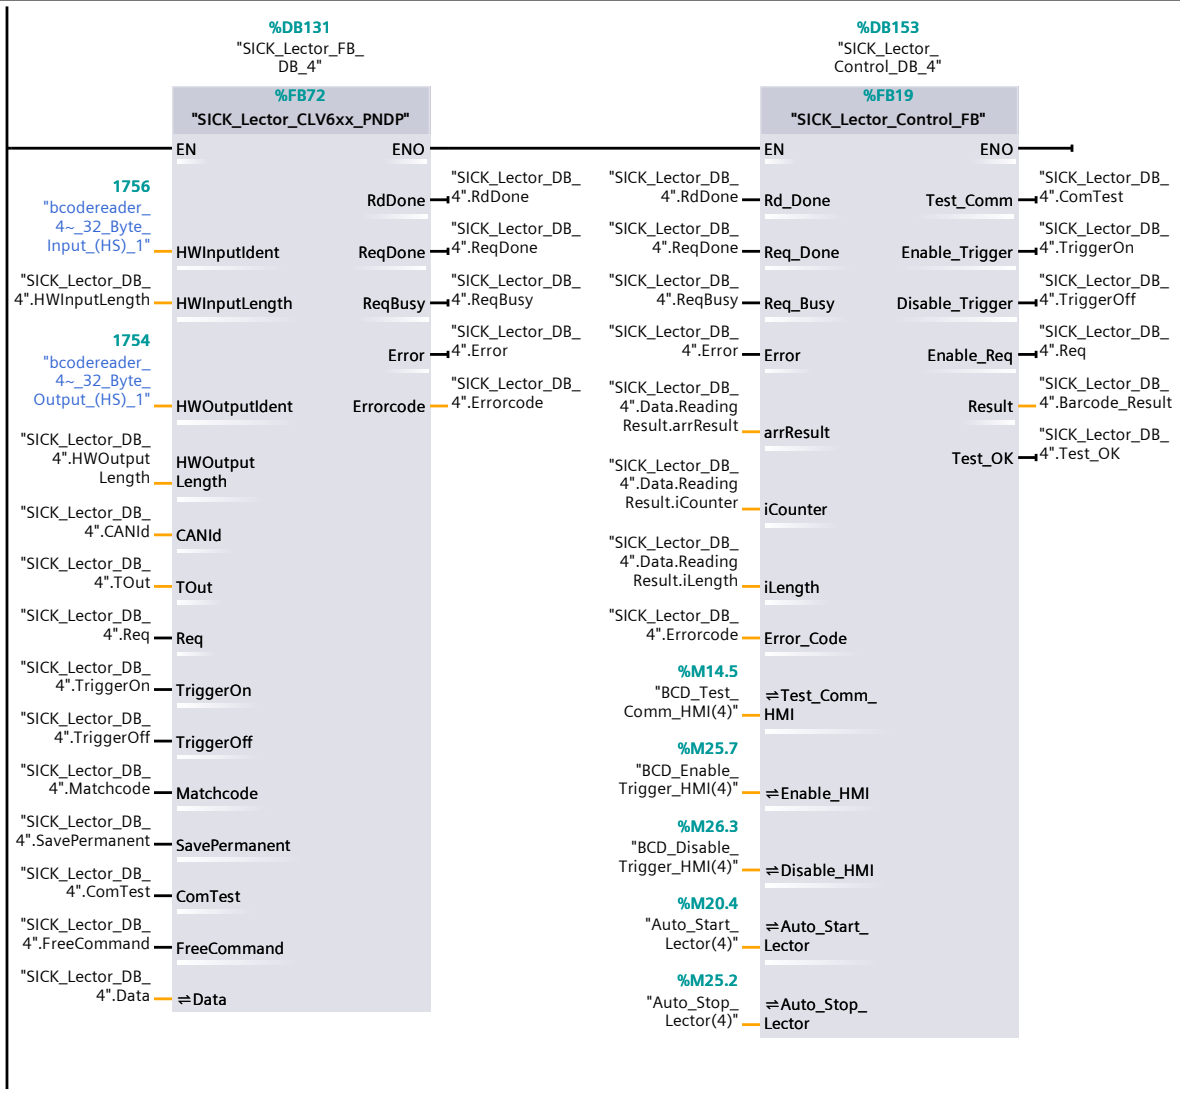


Network 45: Barcode - System 5

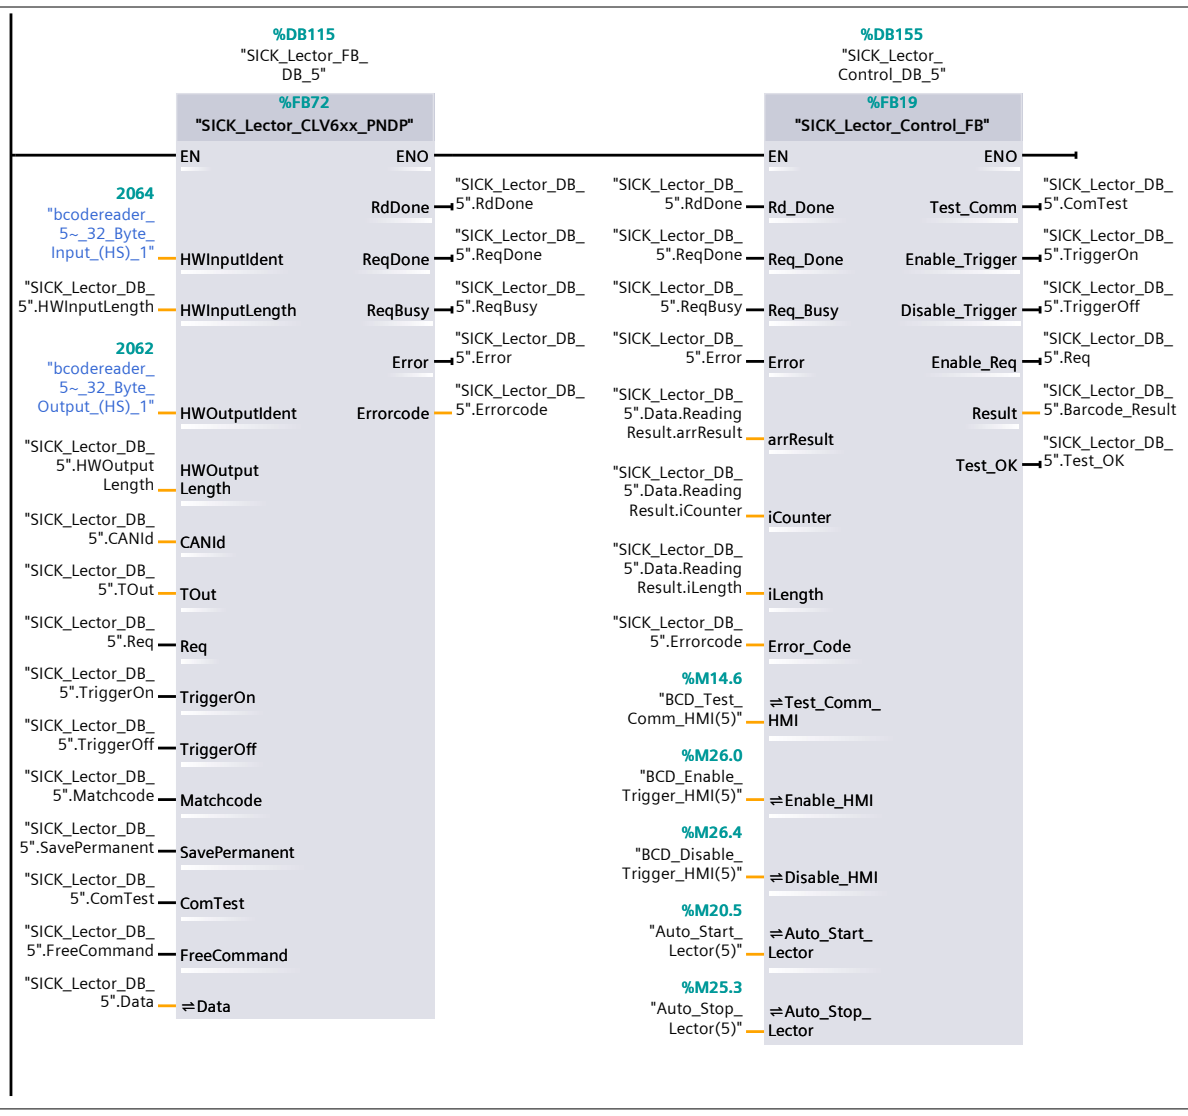


Network 46: Barcode Stations

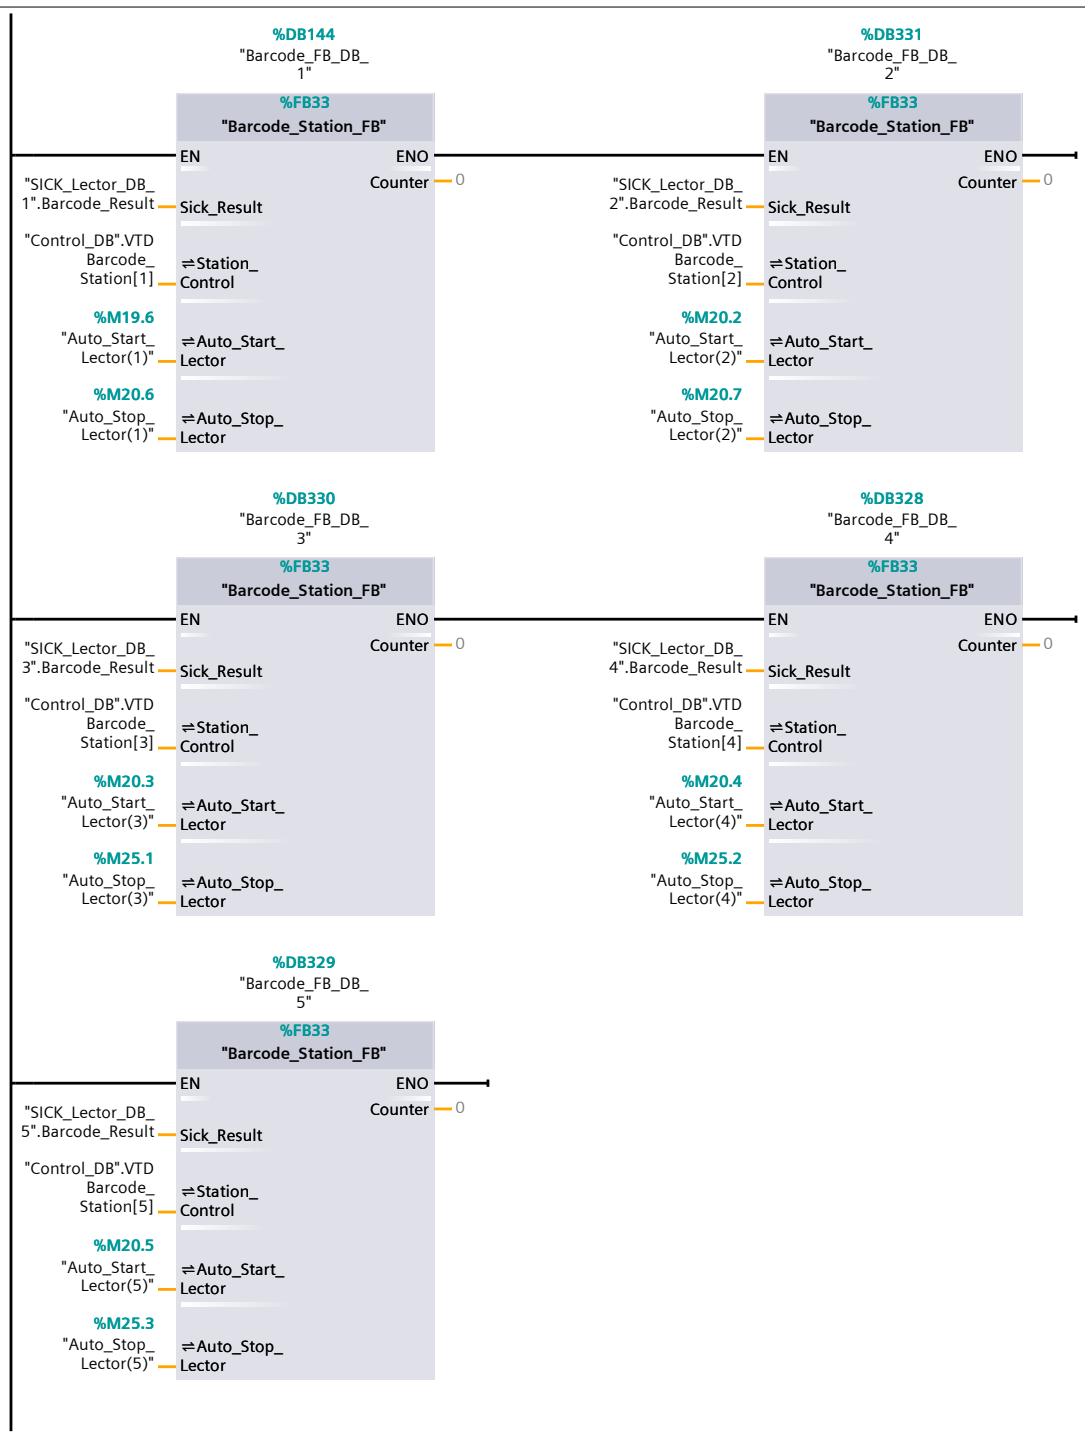

Network 47: Stack Lights

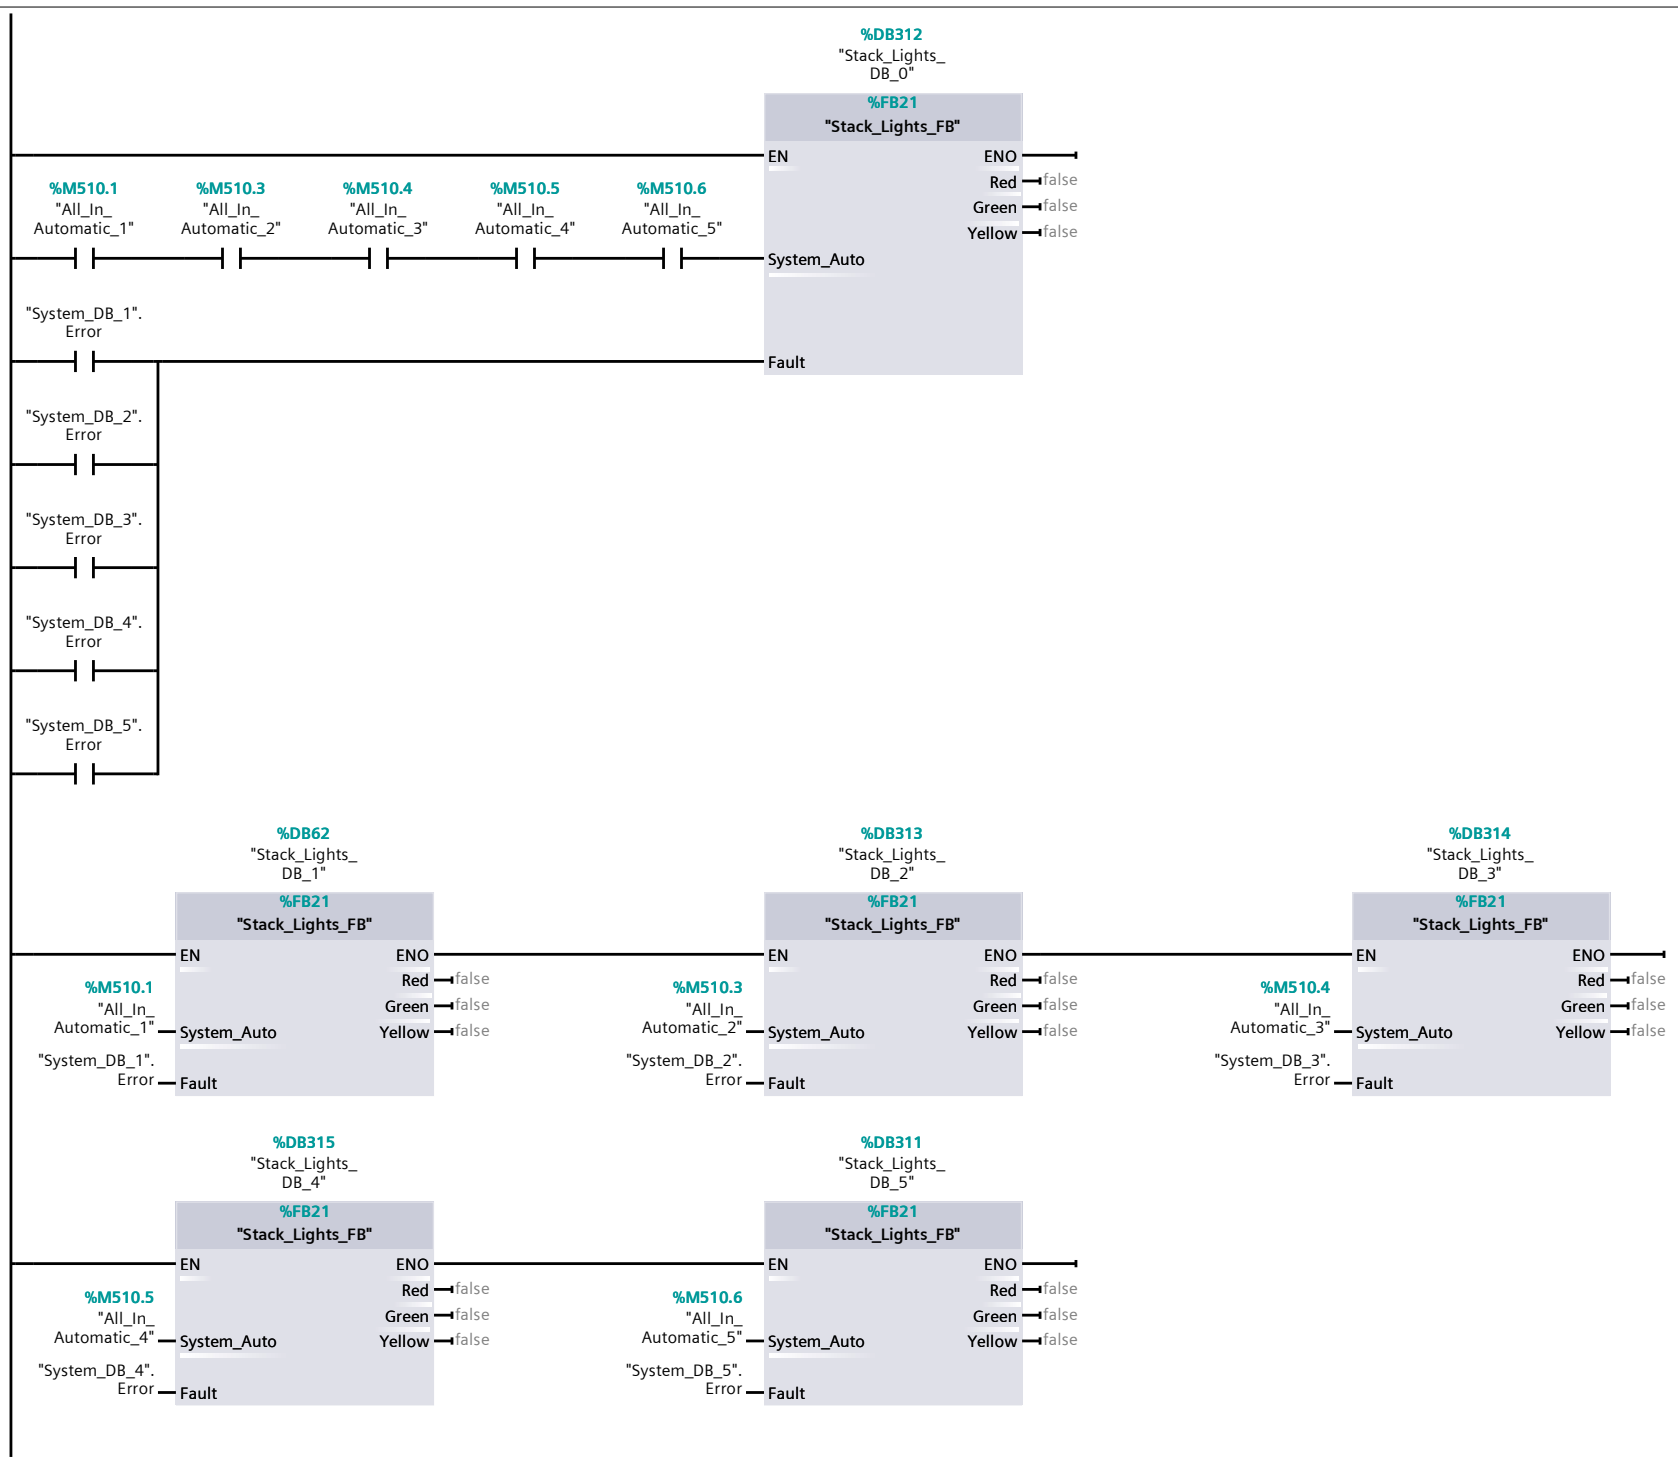


Network 48: OPC CONTROL

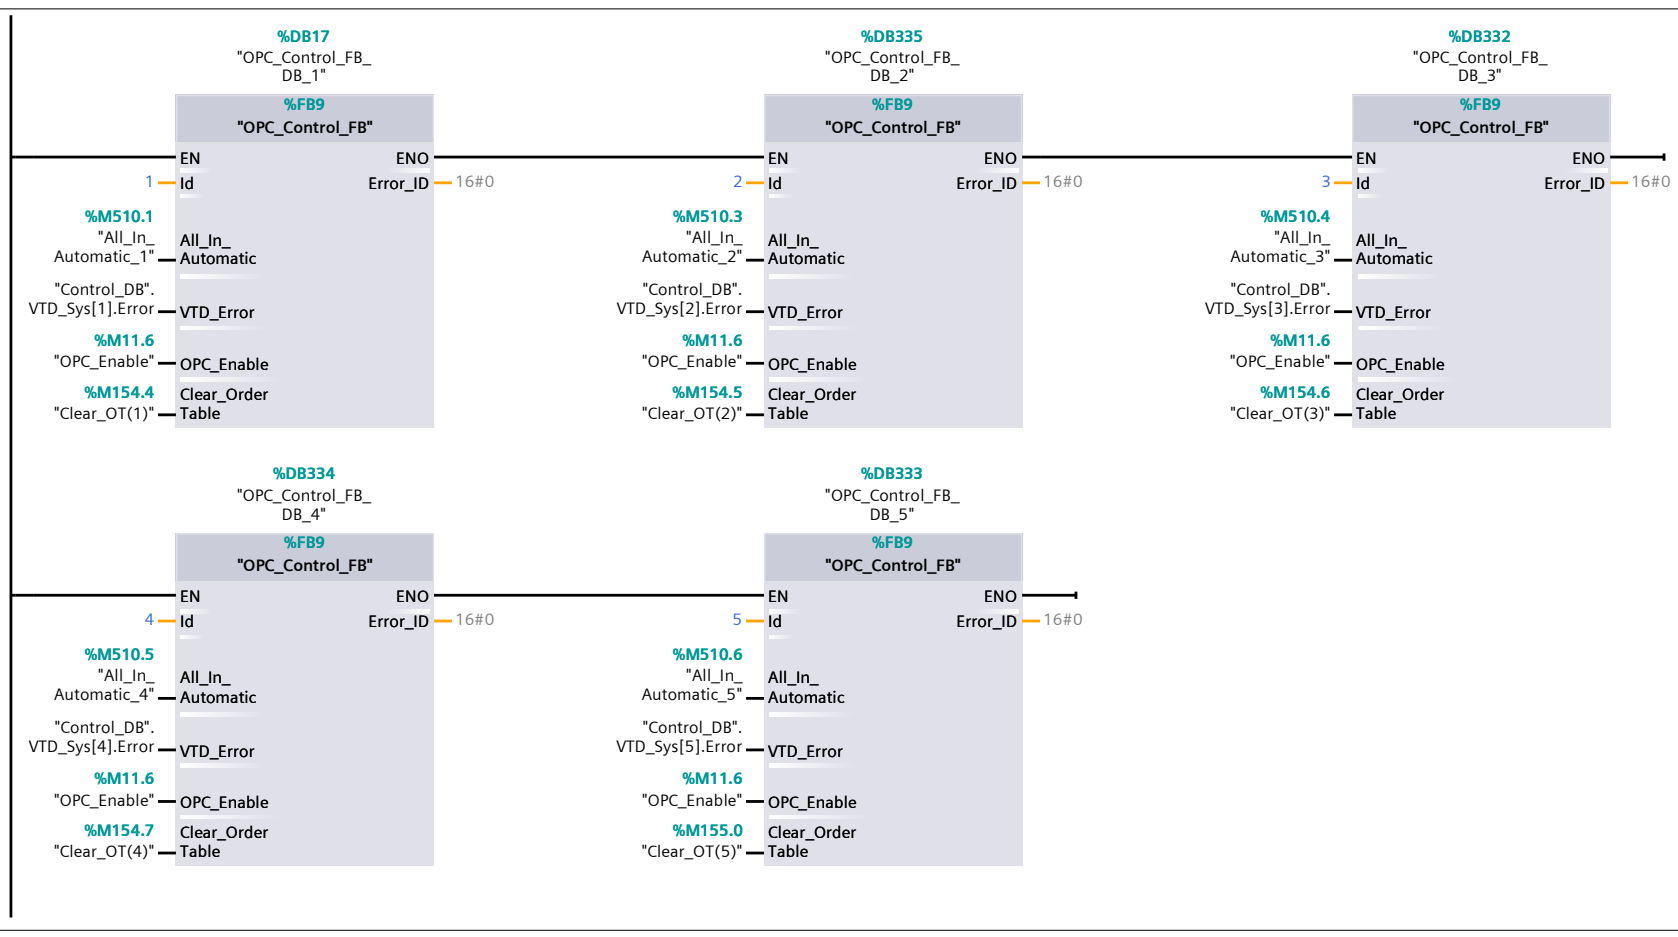


Network 49: Shuttle TCPs

Network 49: Shuttle TCPs (1.1 / 4.1)

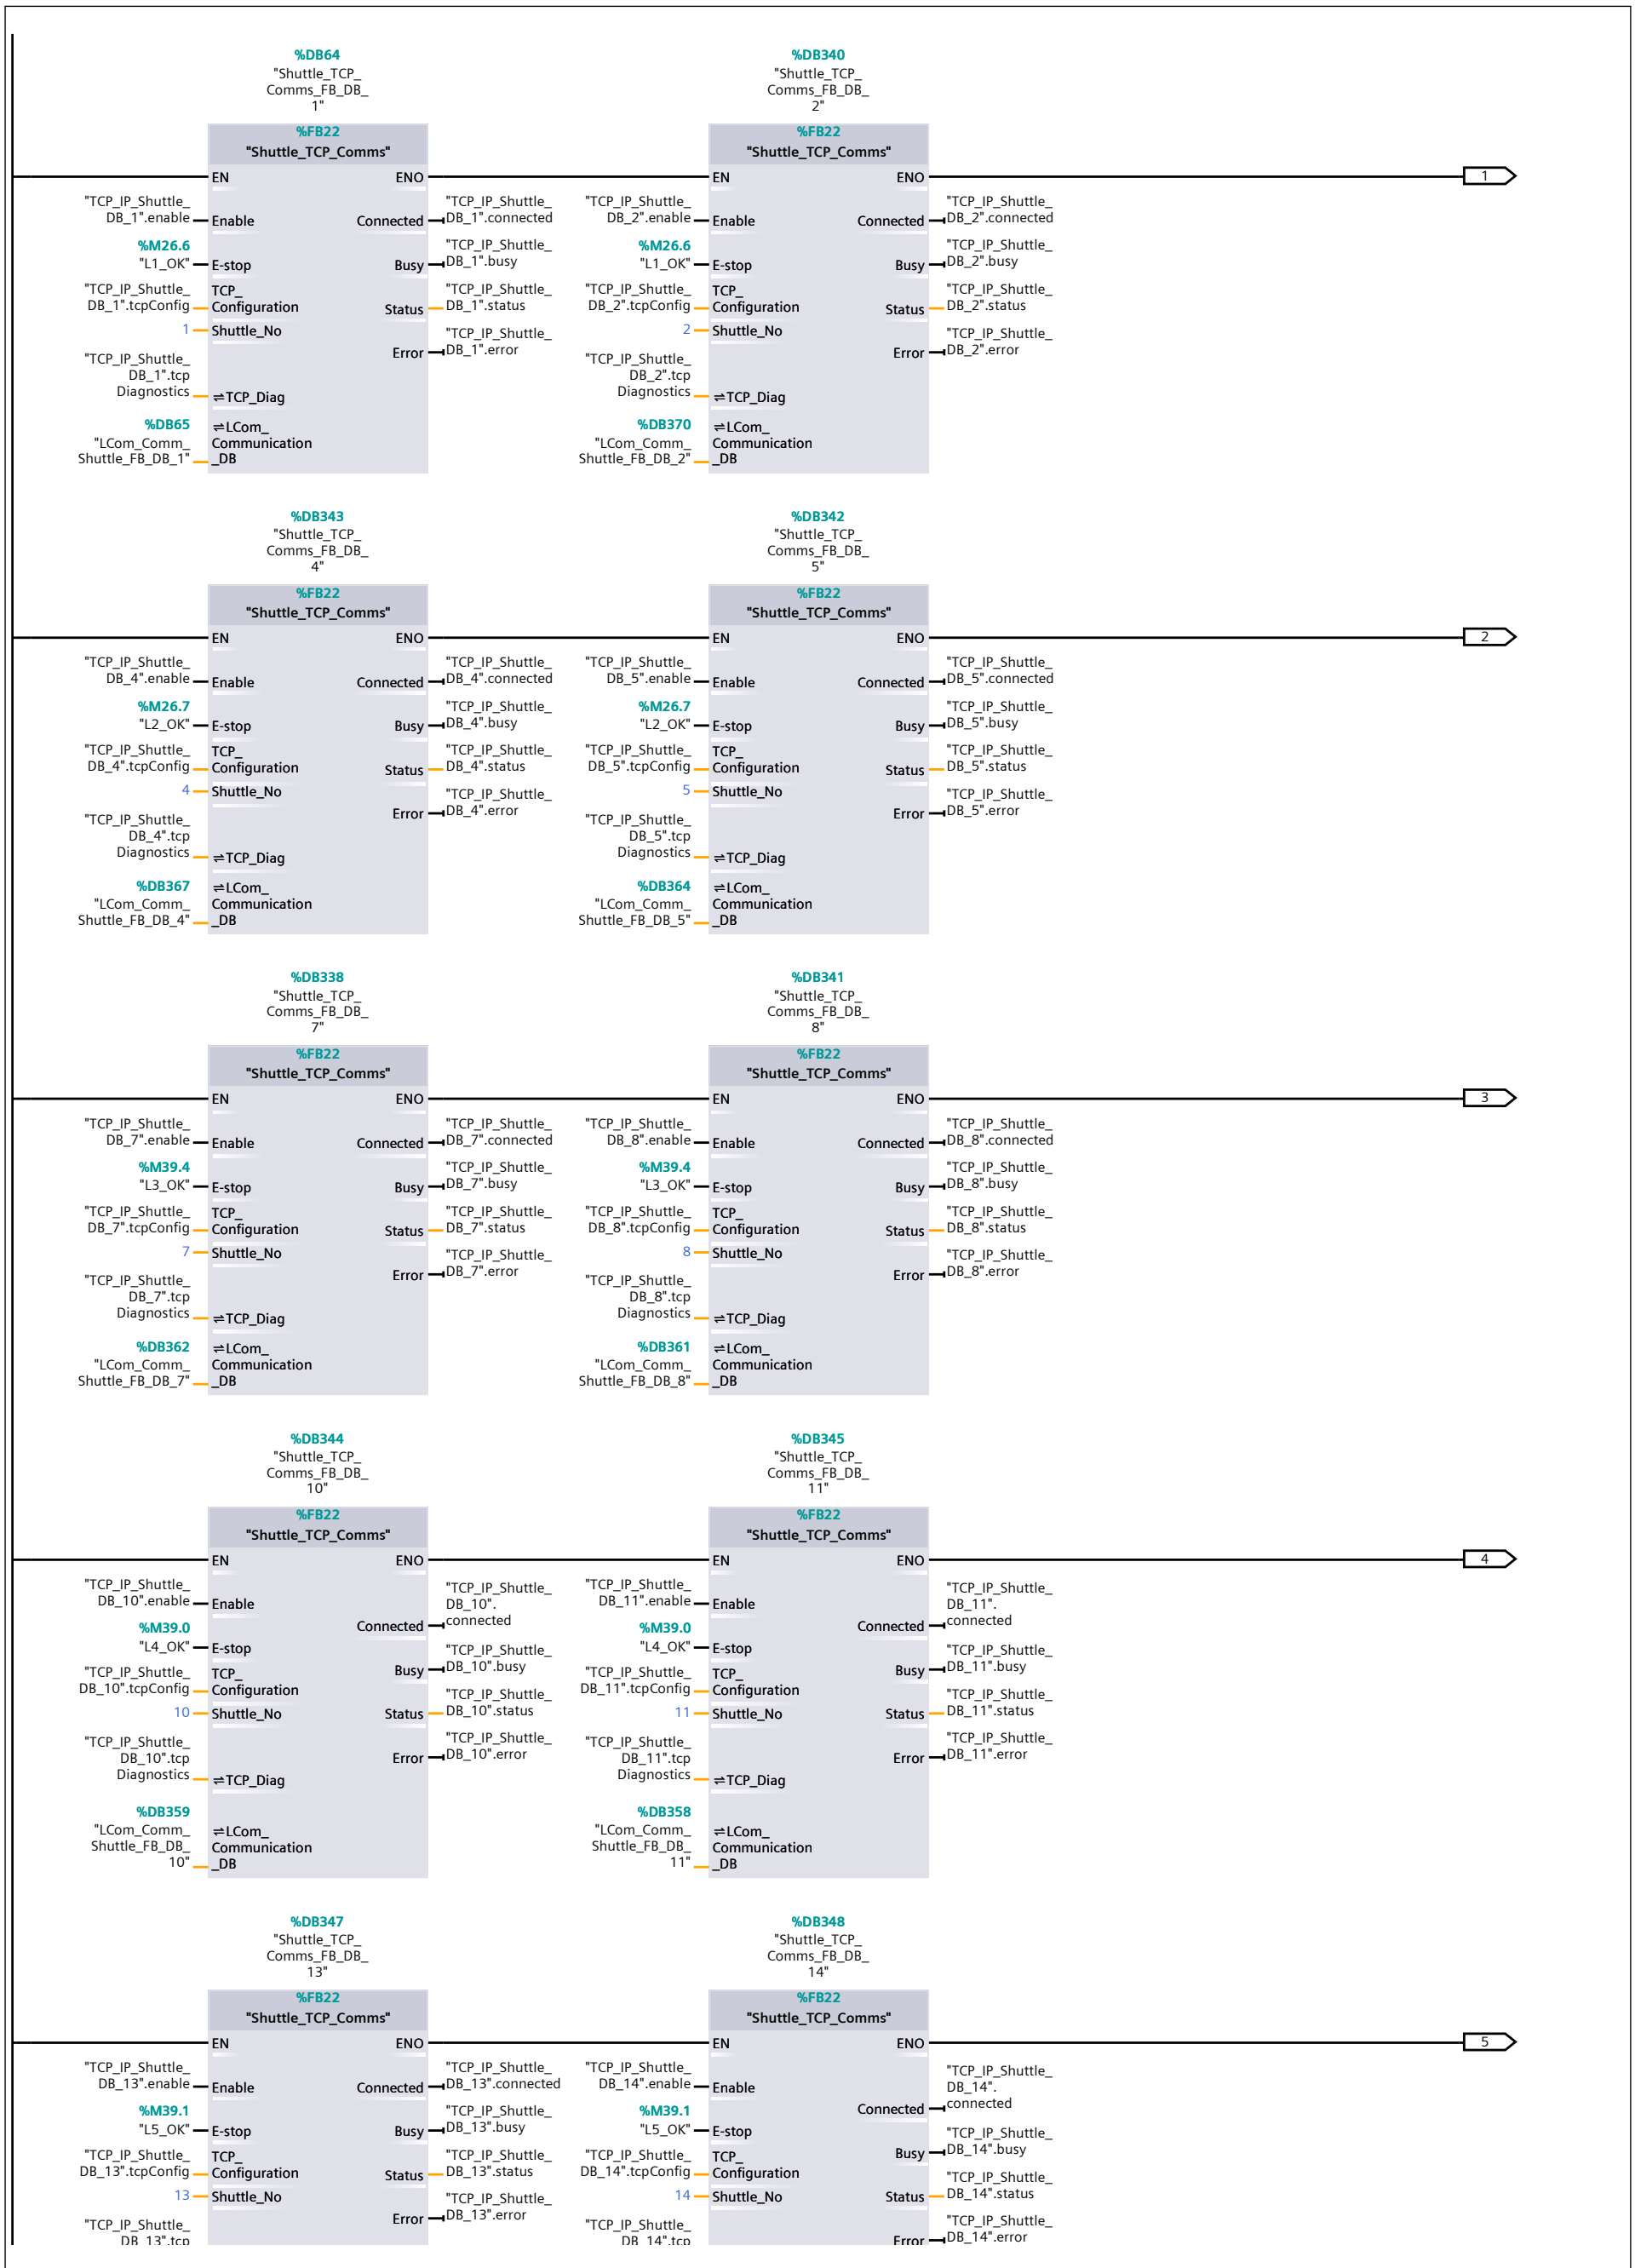

Network 49: Shuttle TCPs (2.1 / 4.1)


1.1 (Page1 - 30)

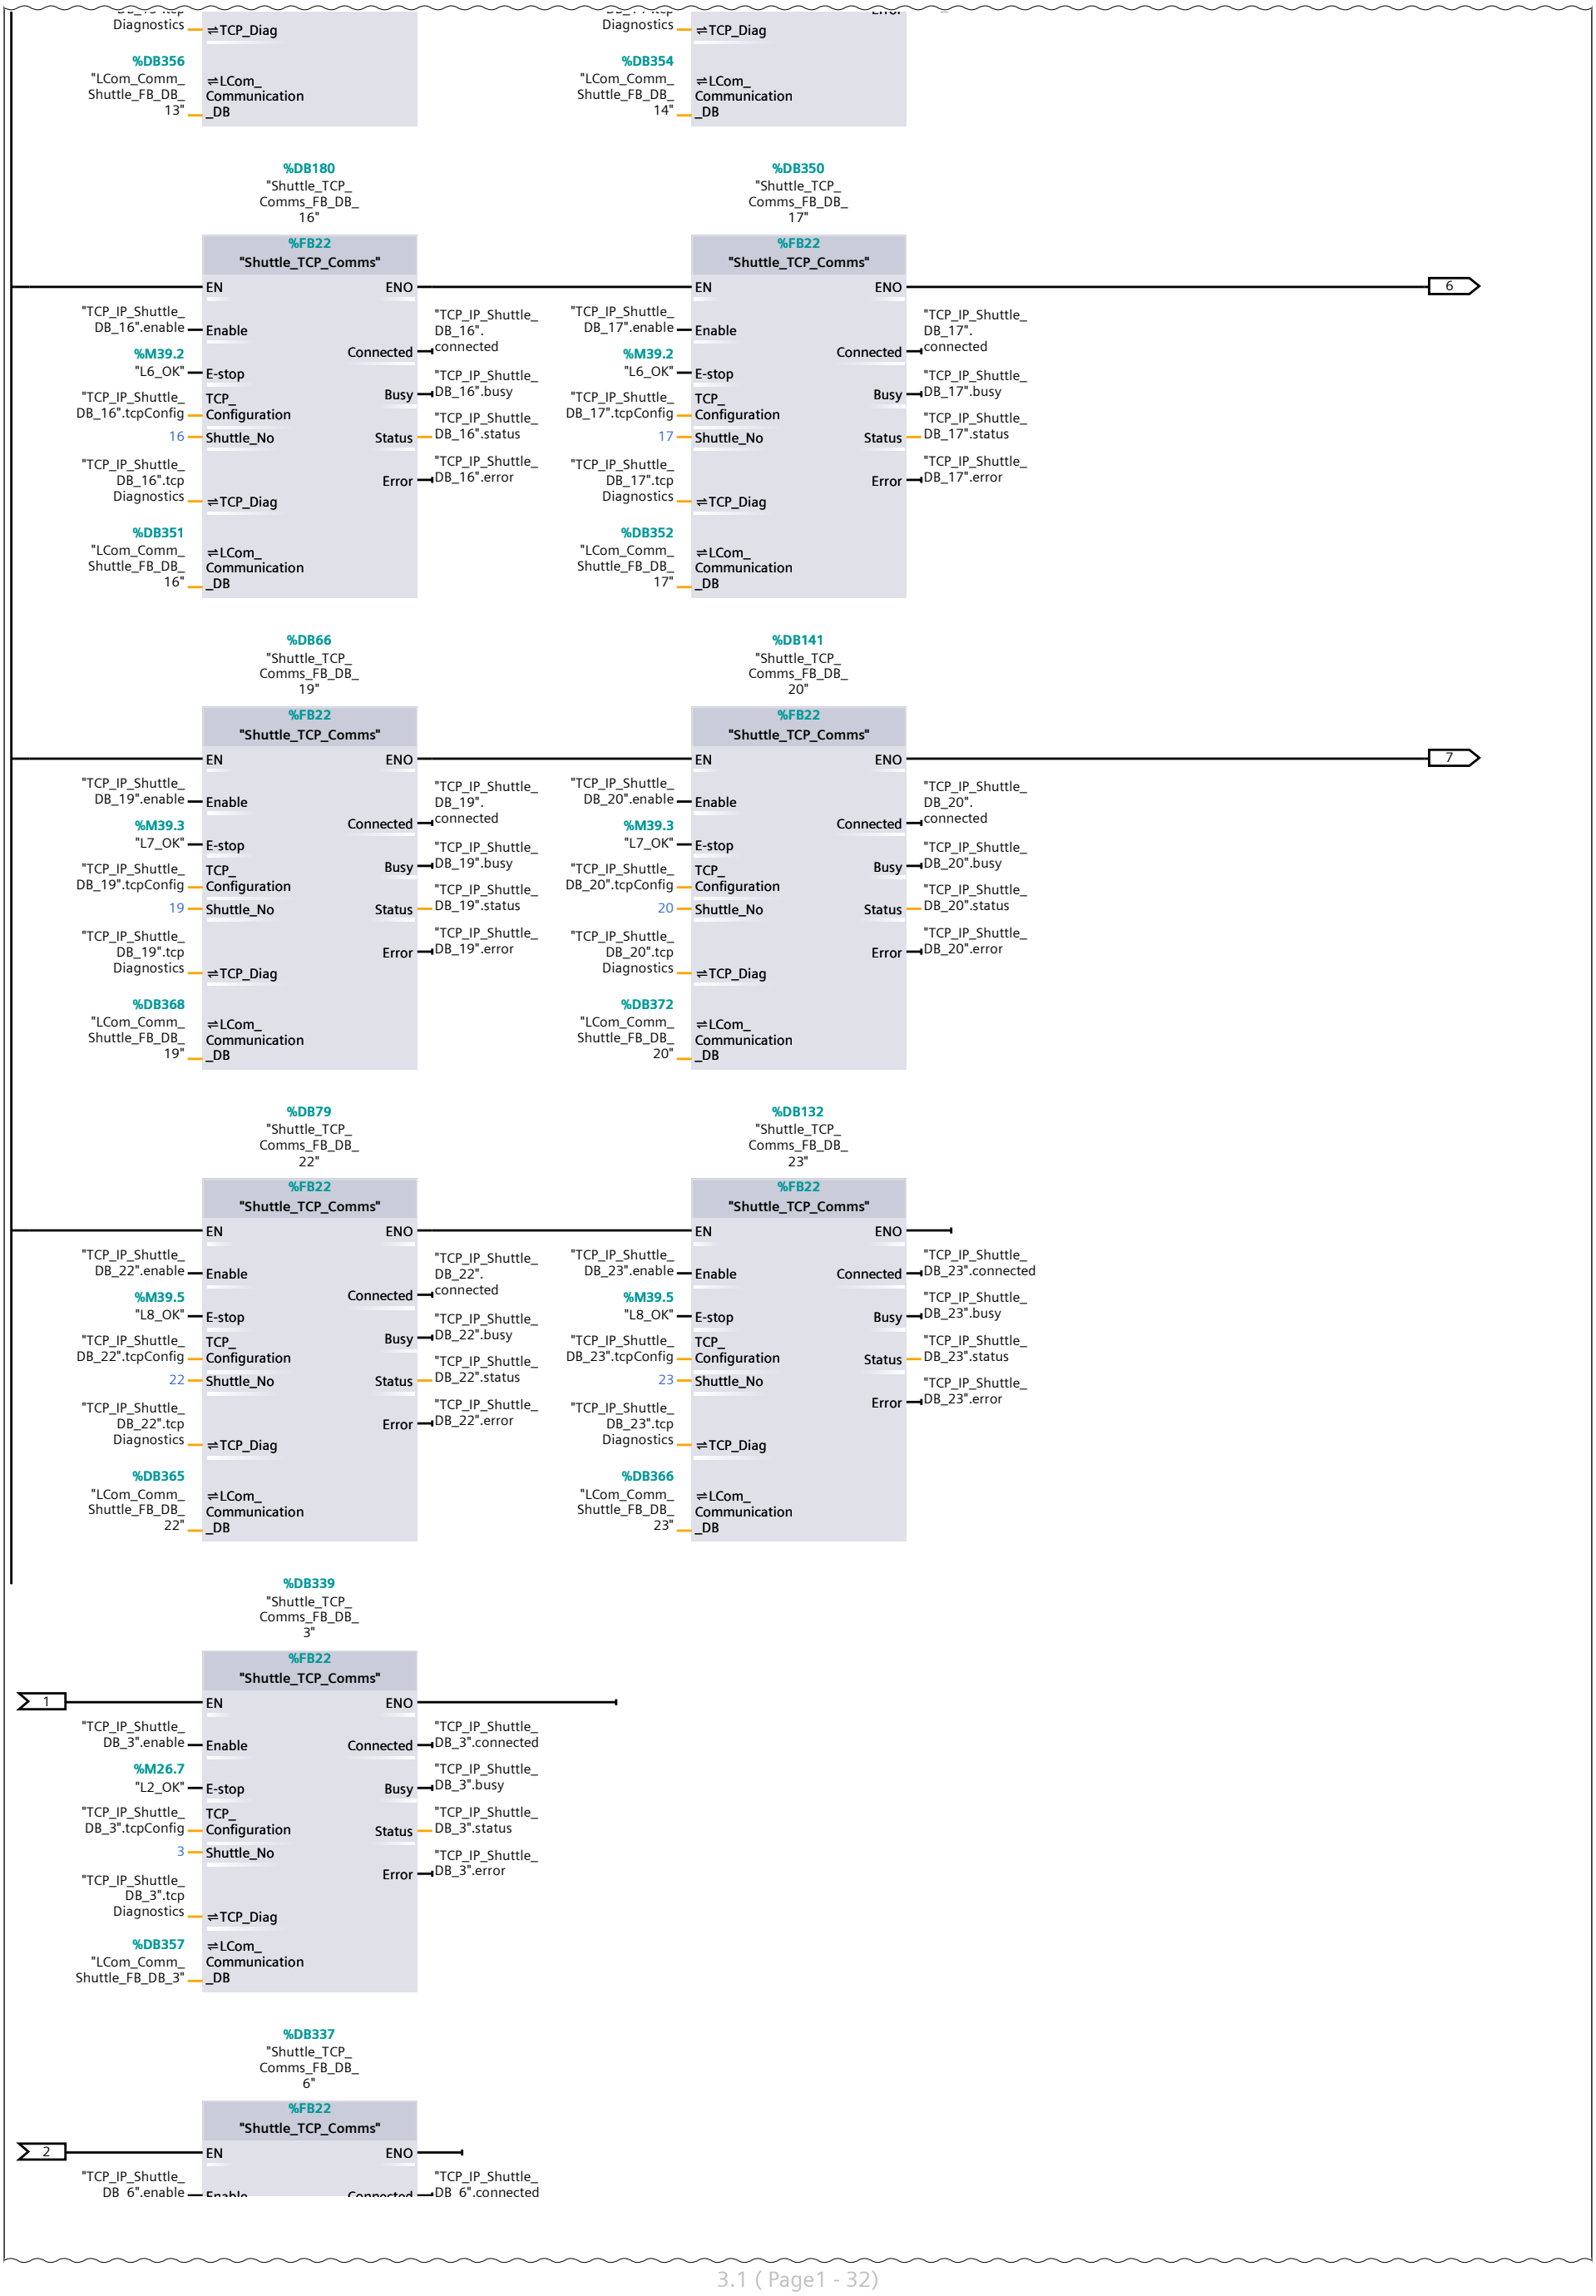

3.1 (Page1 - 32)

Network 49: Shuttle TCPs (3.1 / 4.1)


2.1 (Page1 - 31)

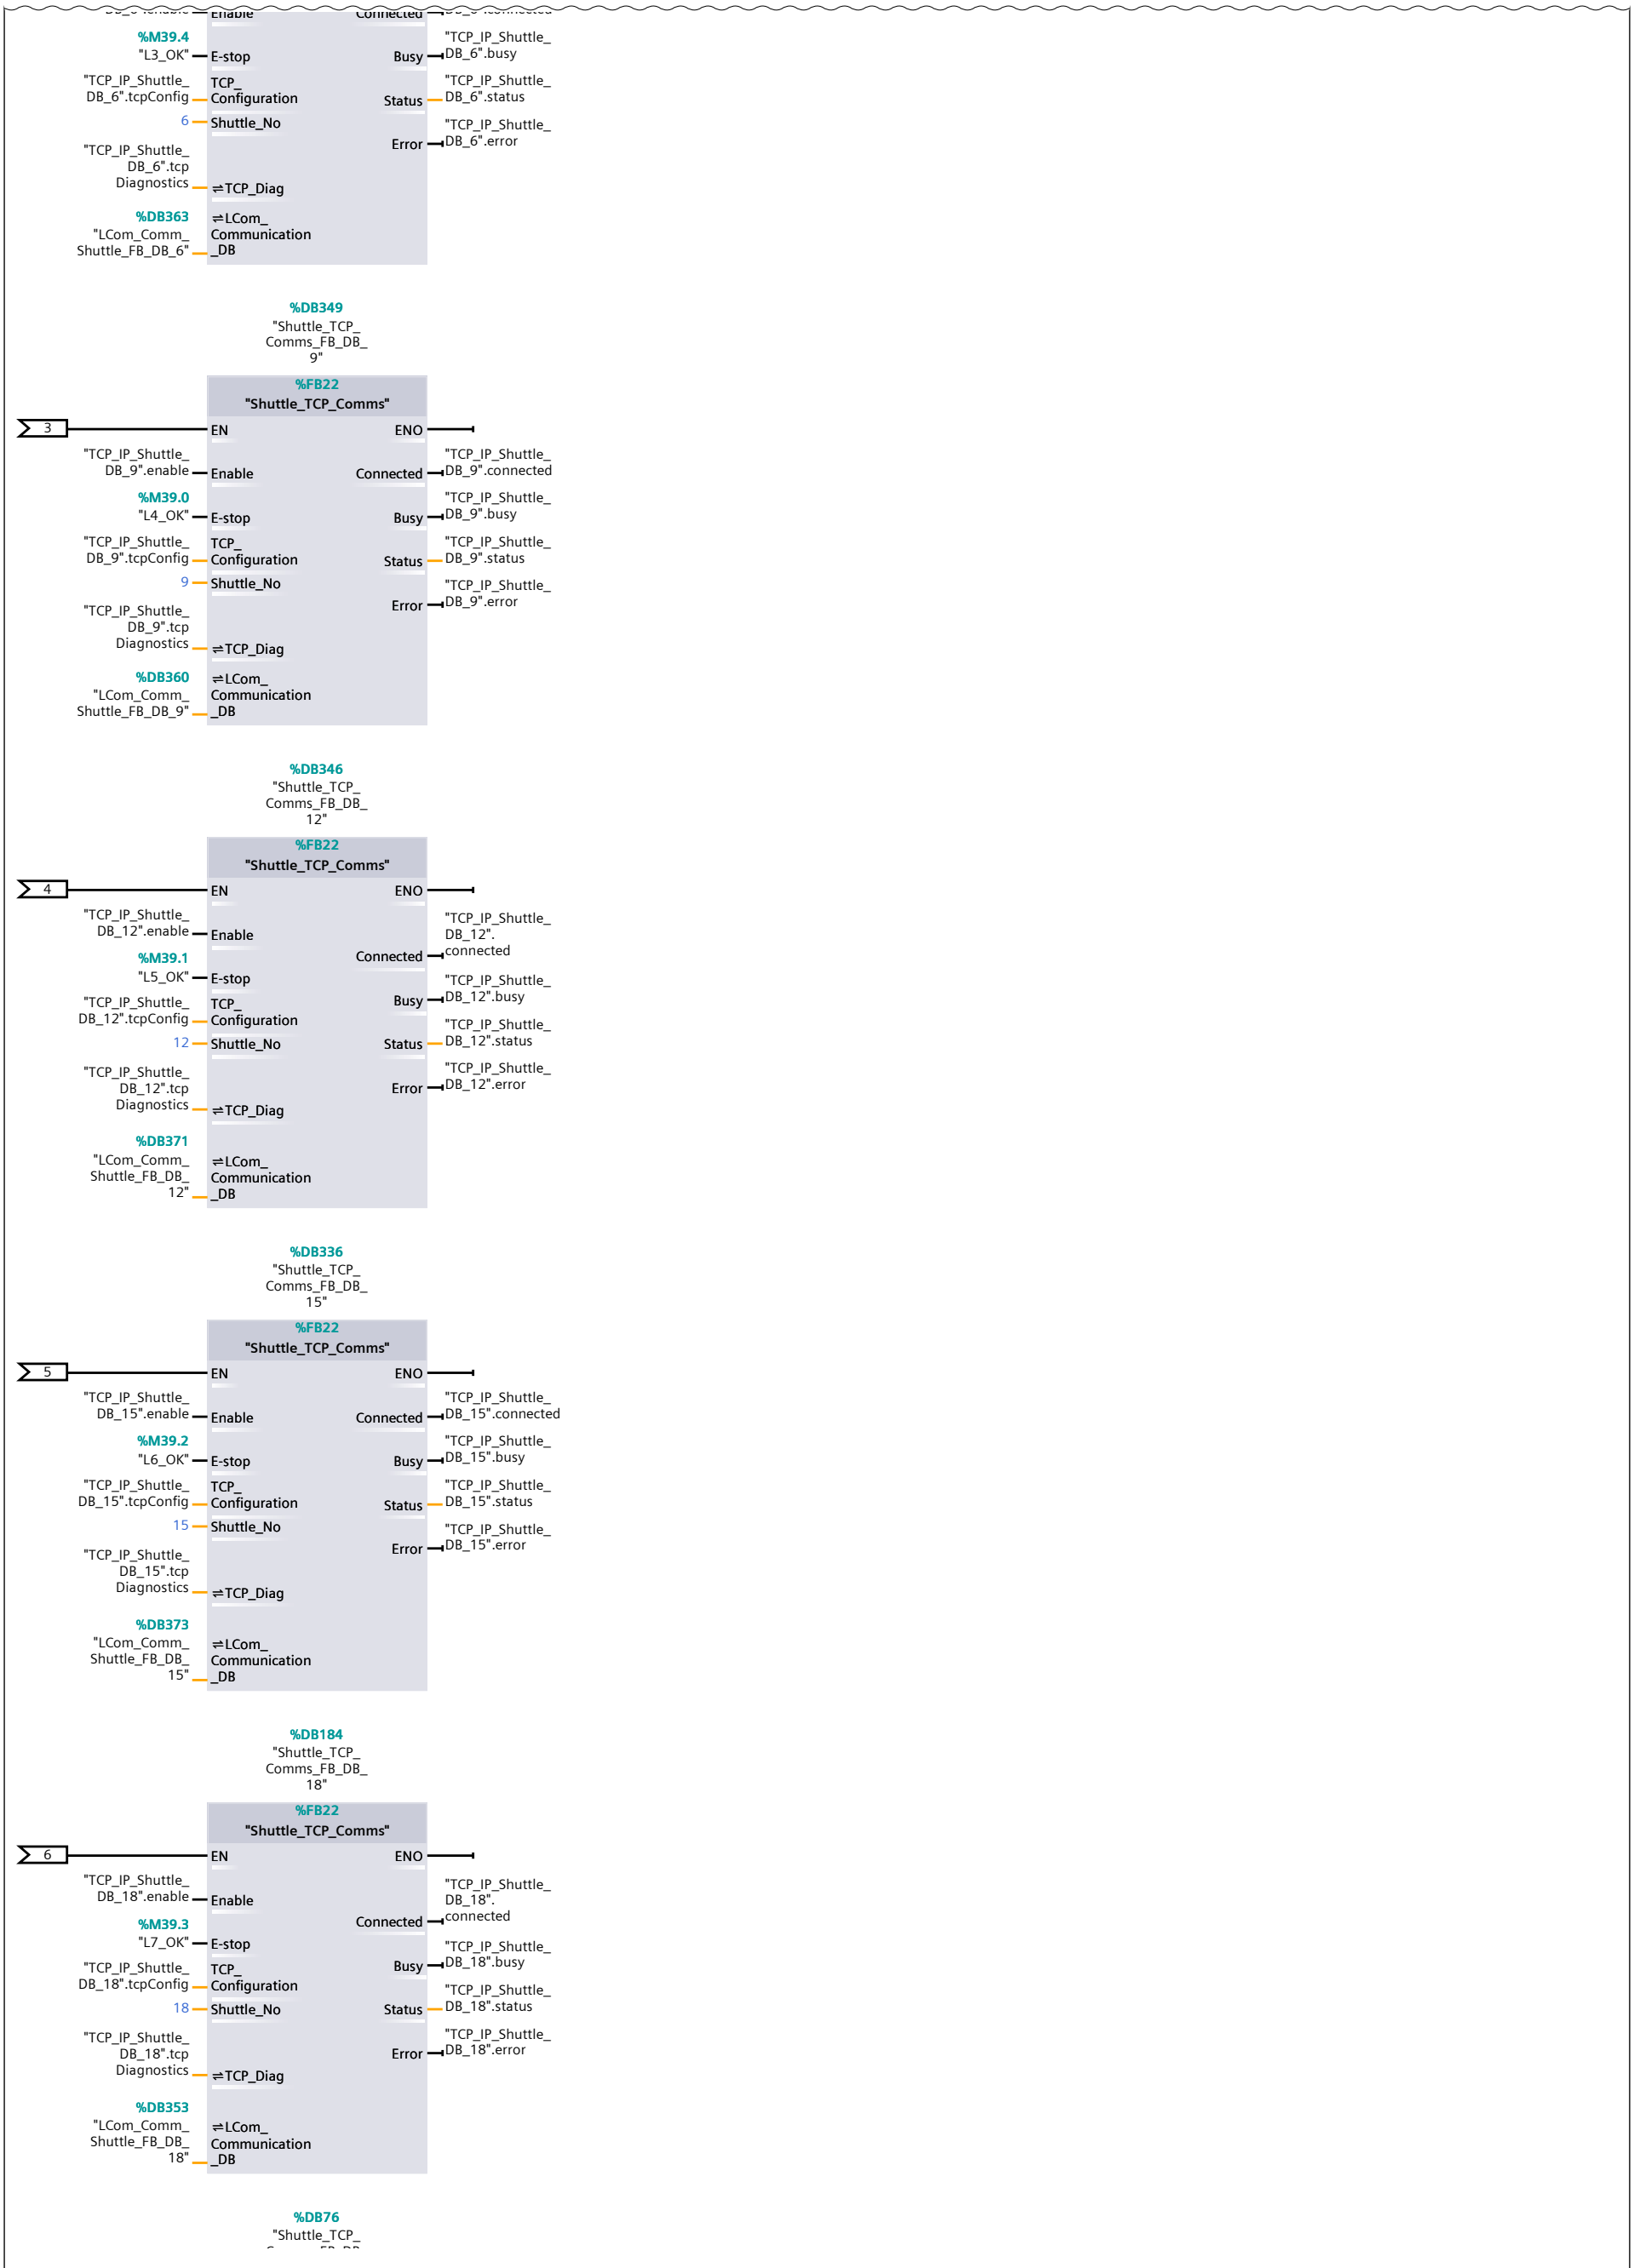

4.1 (Page1 - 33)


Network 49: Shuttle TCPs (4.1 / 4.1)

3.1 (Page1 - 32)

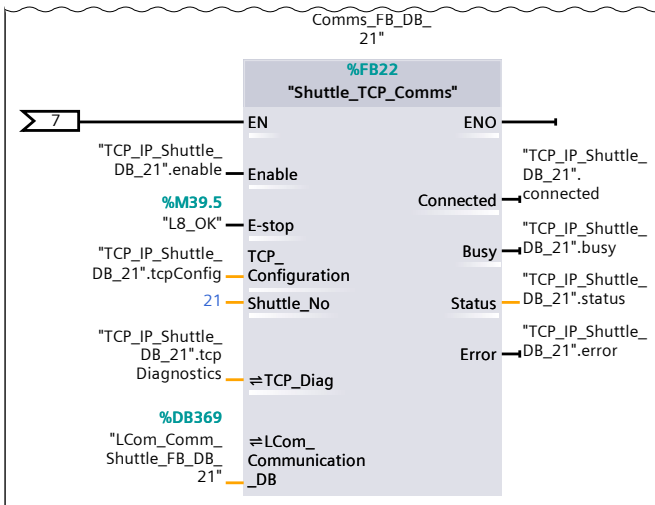

Network 50: GATE STATIONS SYSTEMS 1,2 (Gates 1 and 2)

Network 50: GATE STATIONS SYSTEMS 1,2 (Gates 1 and 2) (1.1 / 2.1)

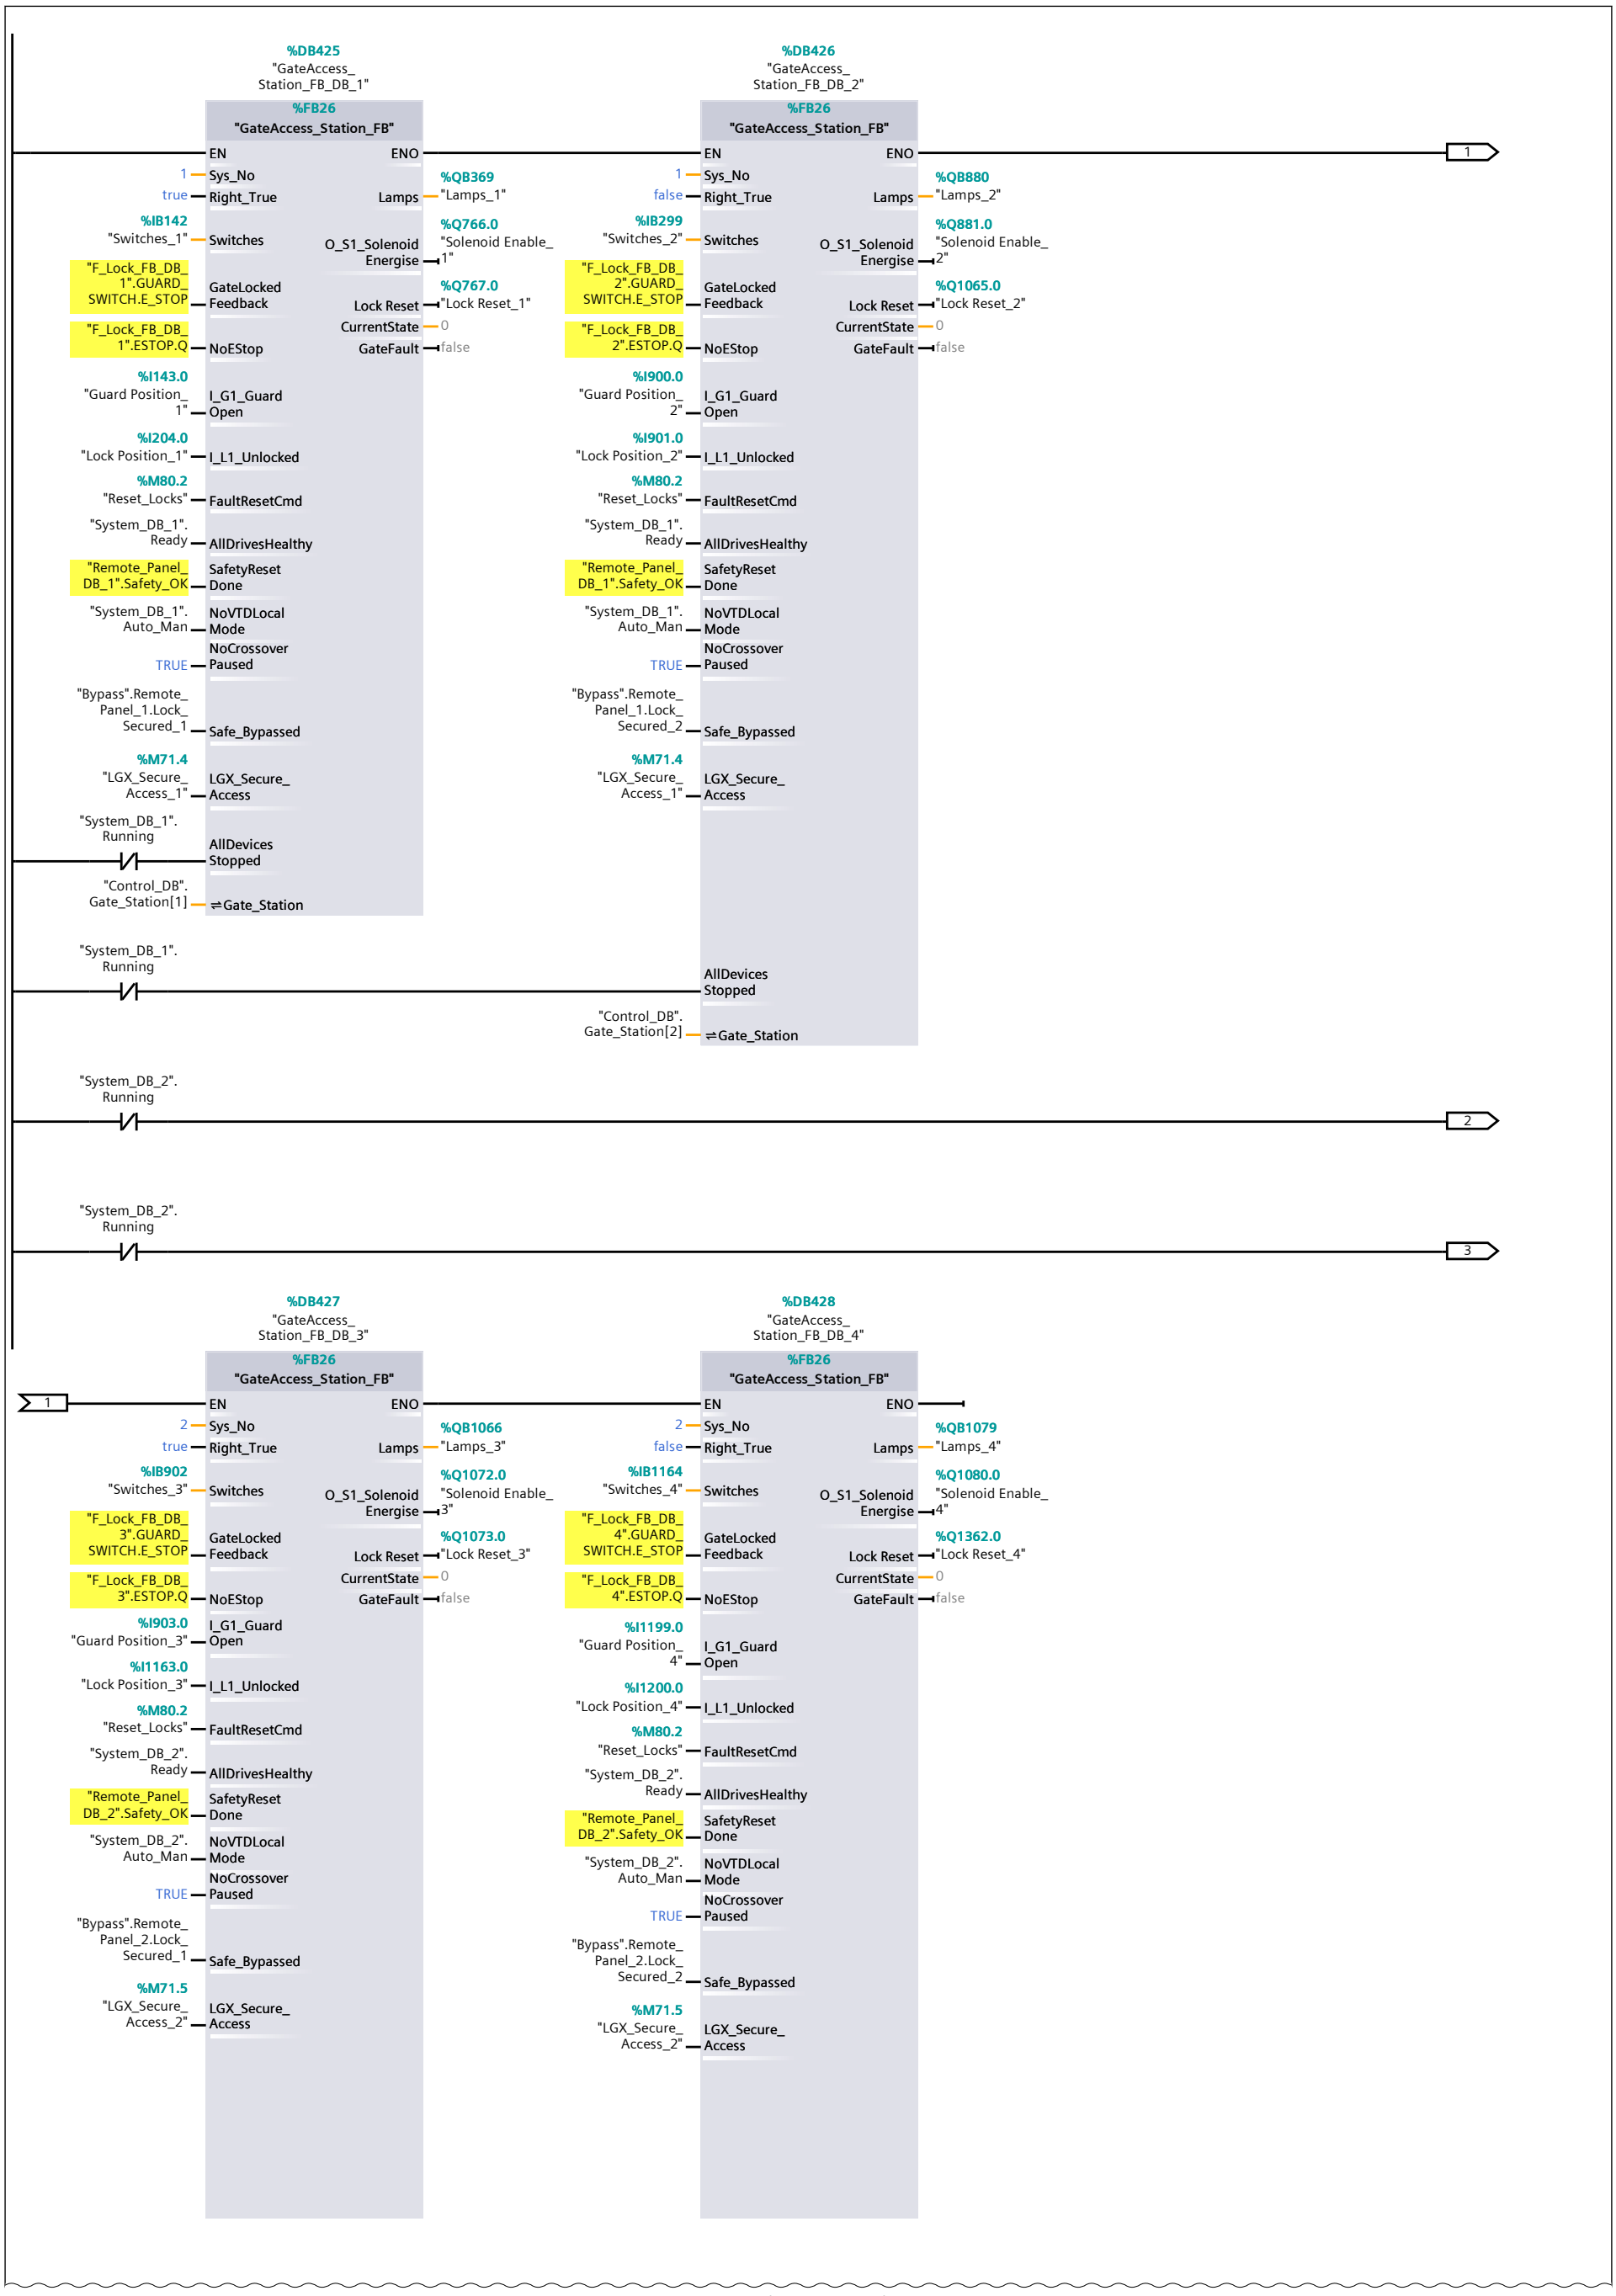


Network 50: GATE STATIONS SYSTEMS 1,2 (Gates 1 and 2) (2.1 / 2.1)


1.1 (Page1 - 35)




Network 51: GATE STATIONS SYSTEMS 3 (Gates 1 and 2)

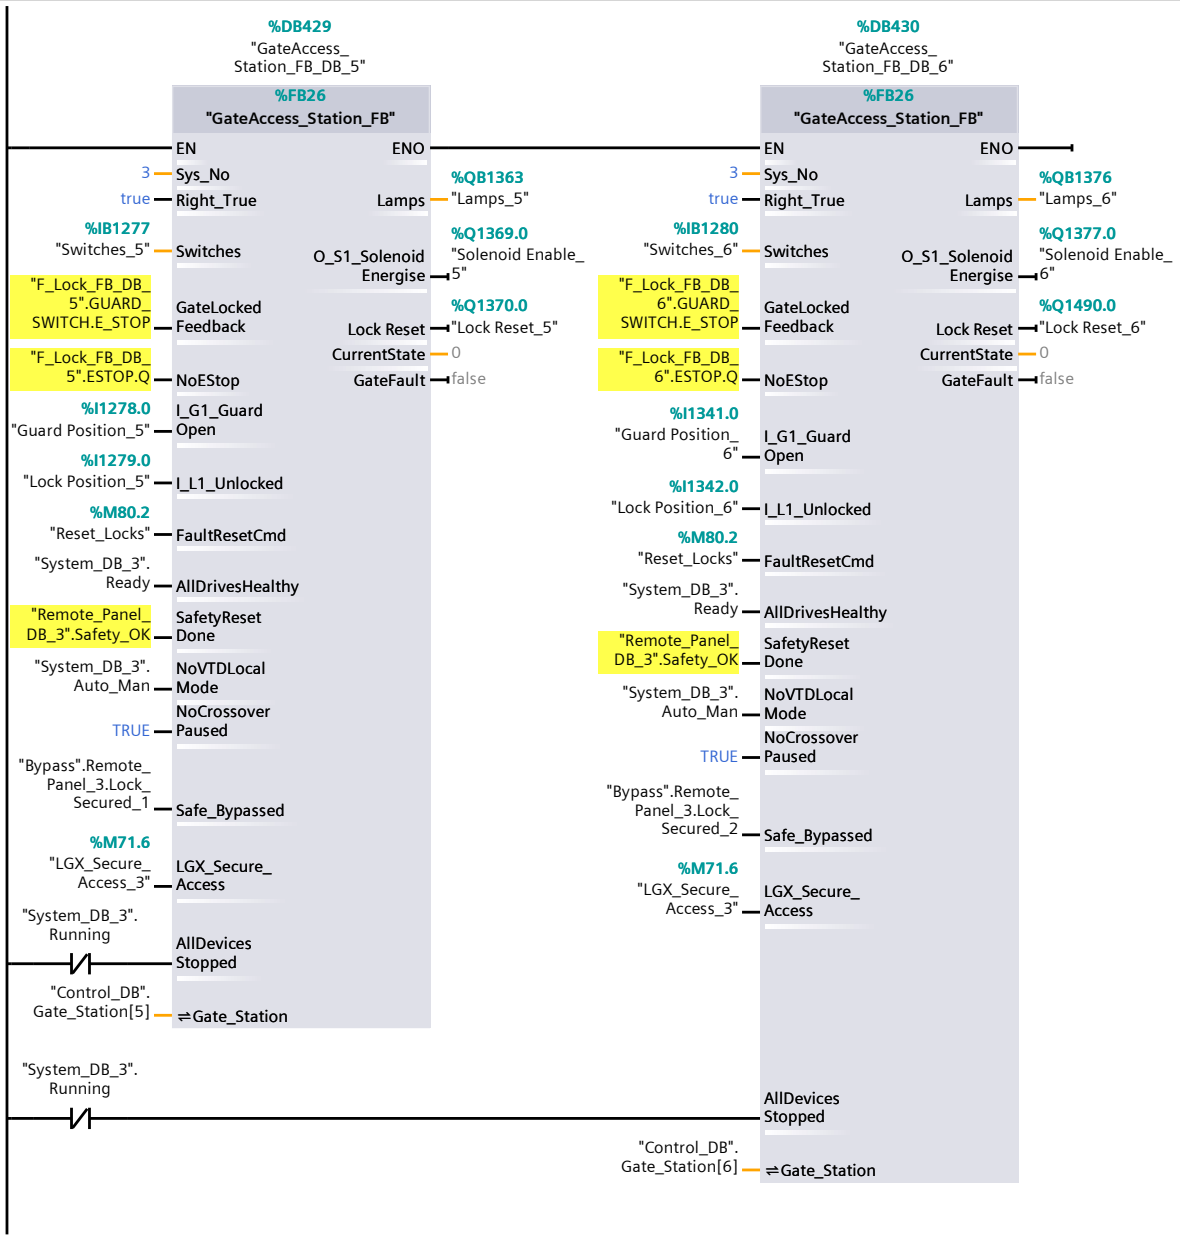

Network 52: GATE STATIONS SYSTEMS 4,5 (Gate 1)

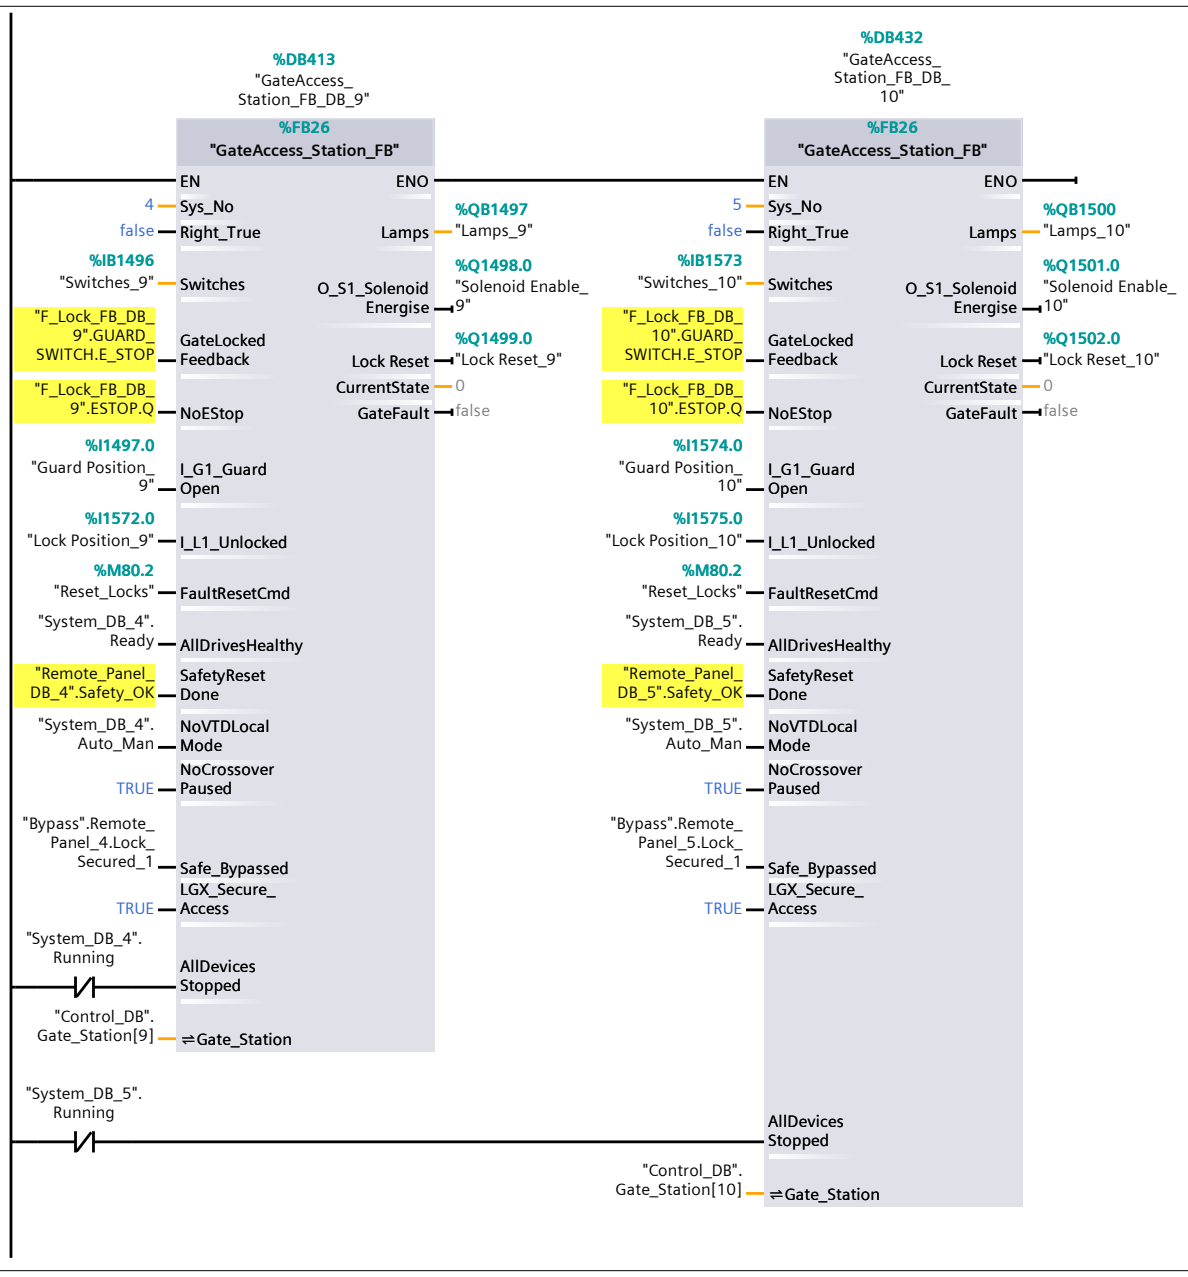


Network 53: Gate Stations Left and Right, Level 1 and Level 2

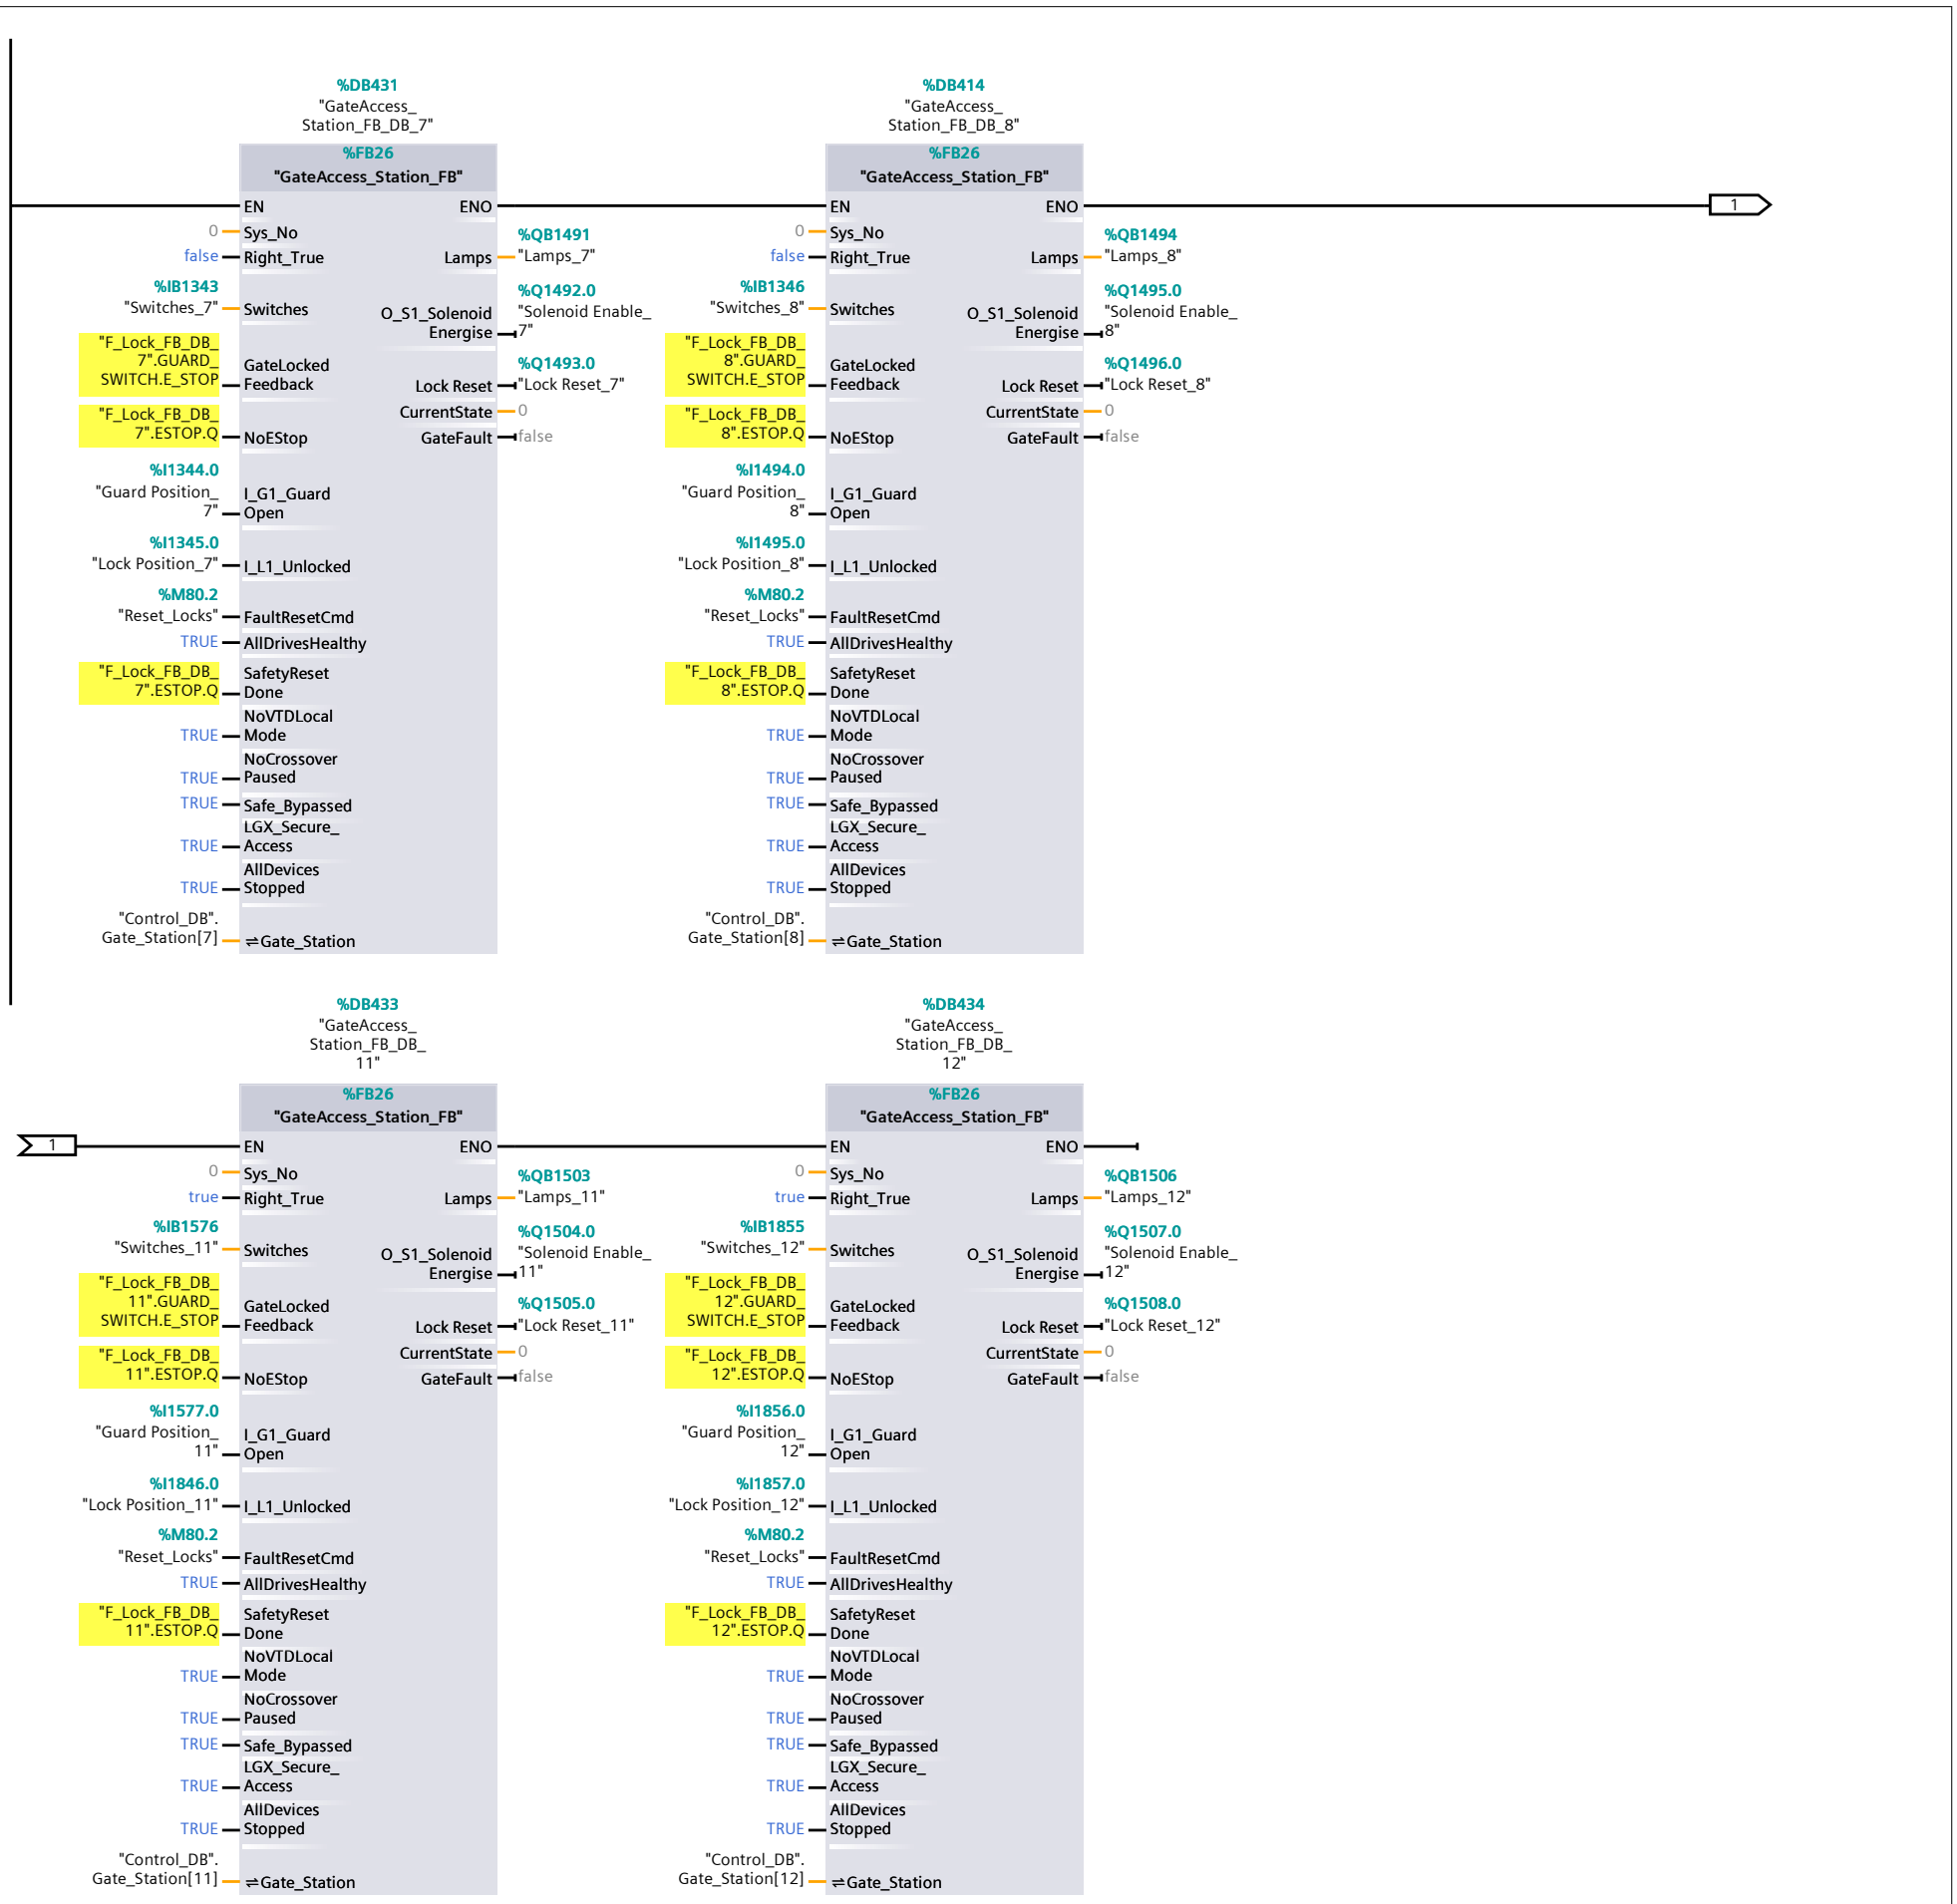

Network 54: Order Tables System

Network 54: Order Tables System (1.1 / 2.1)

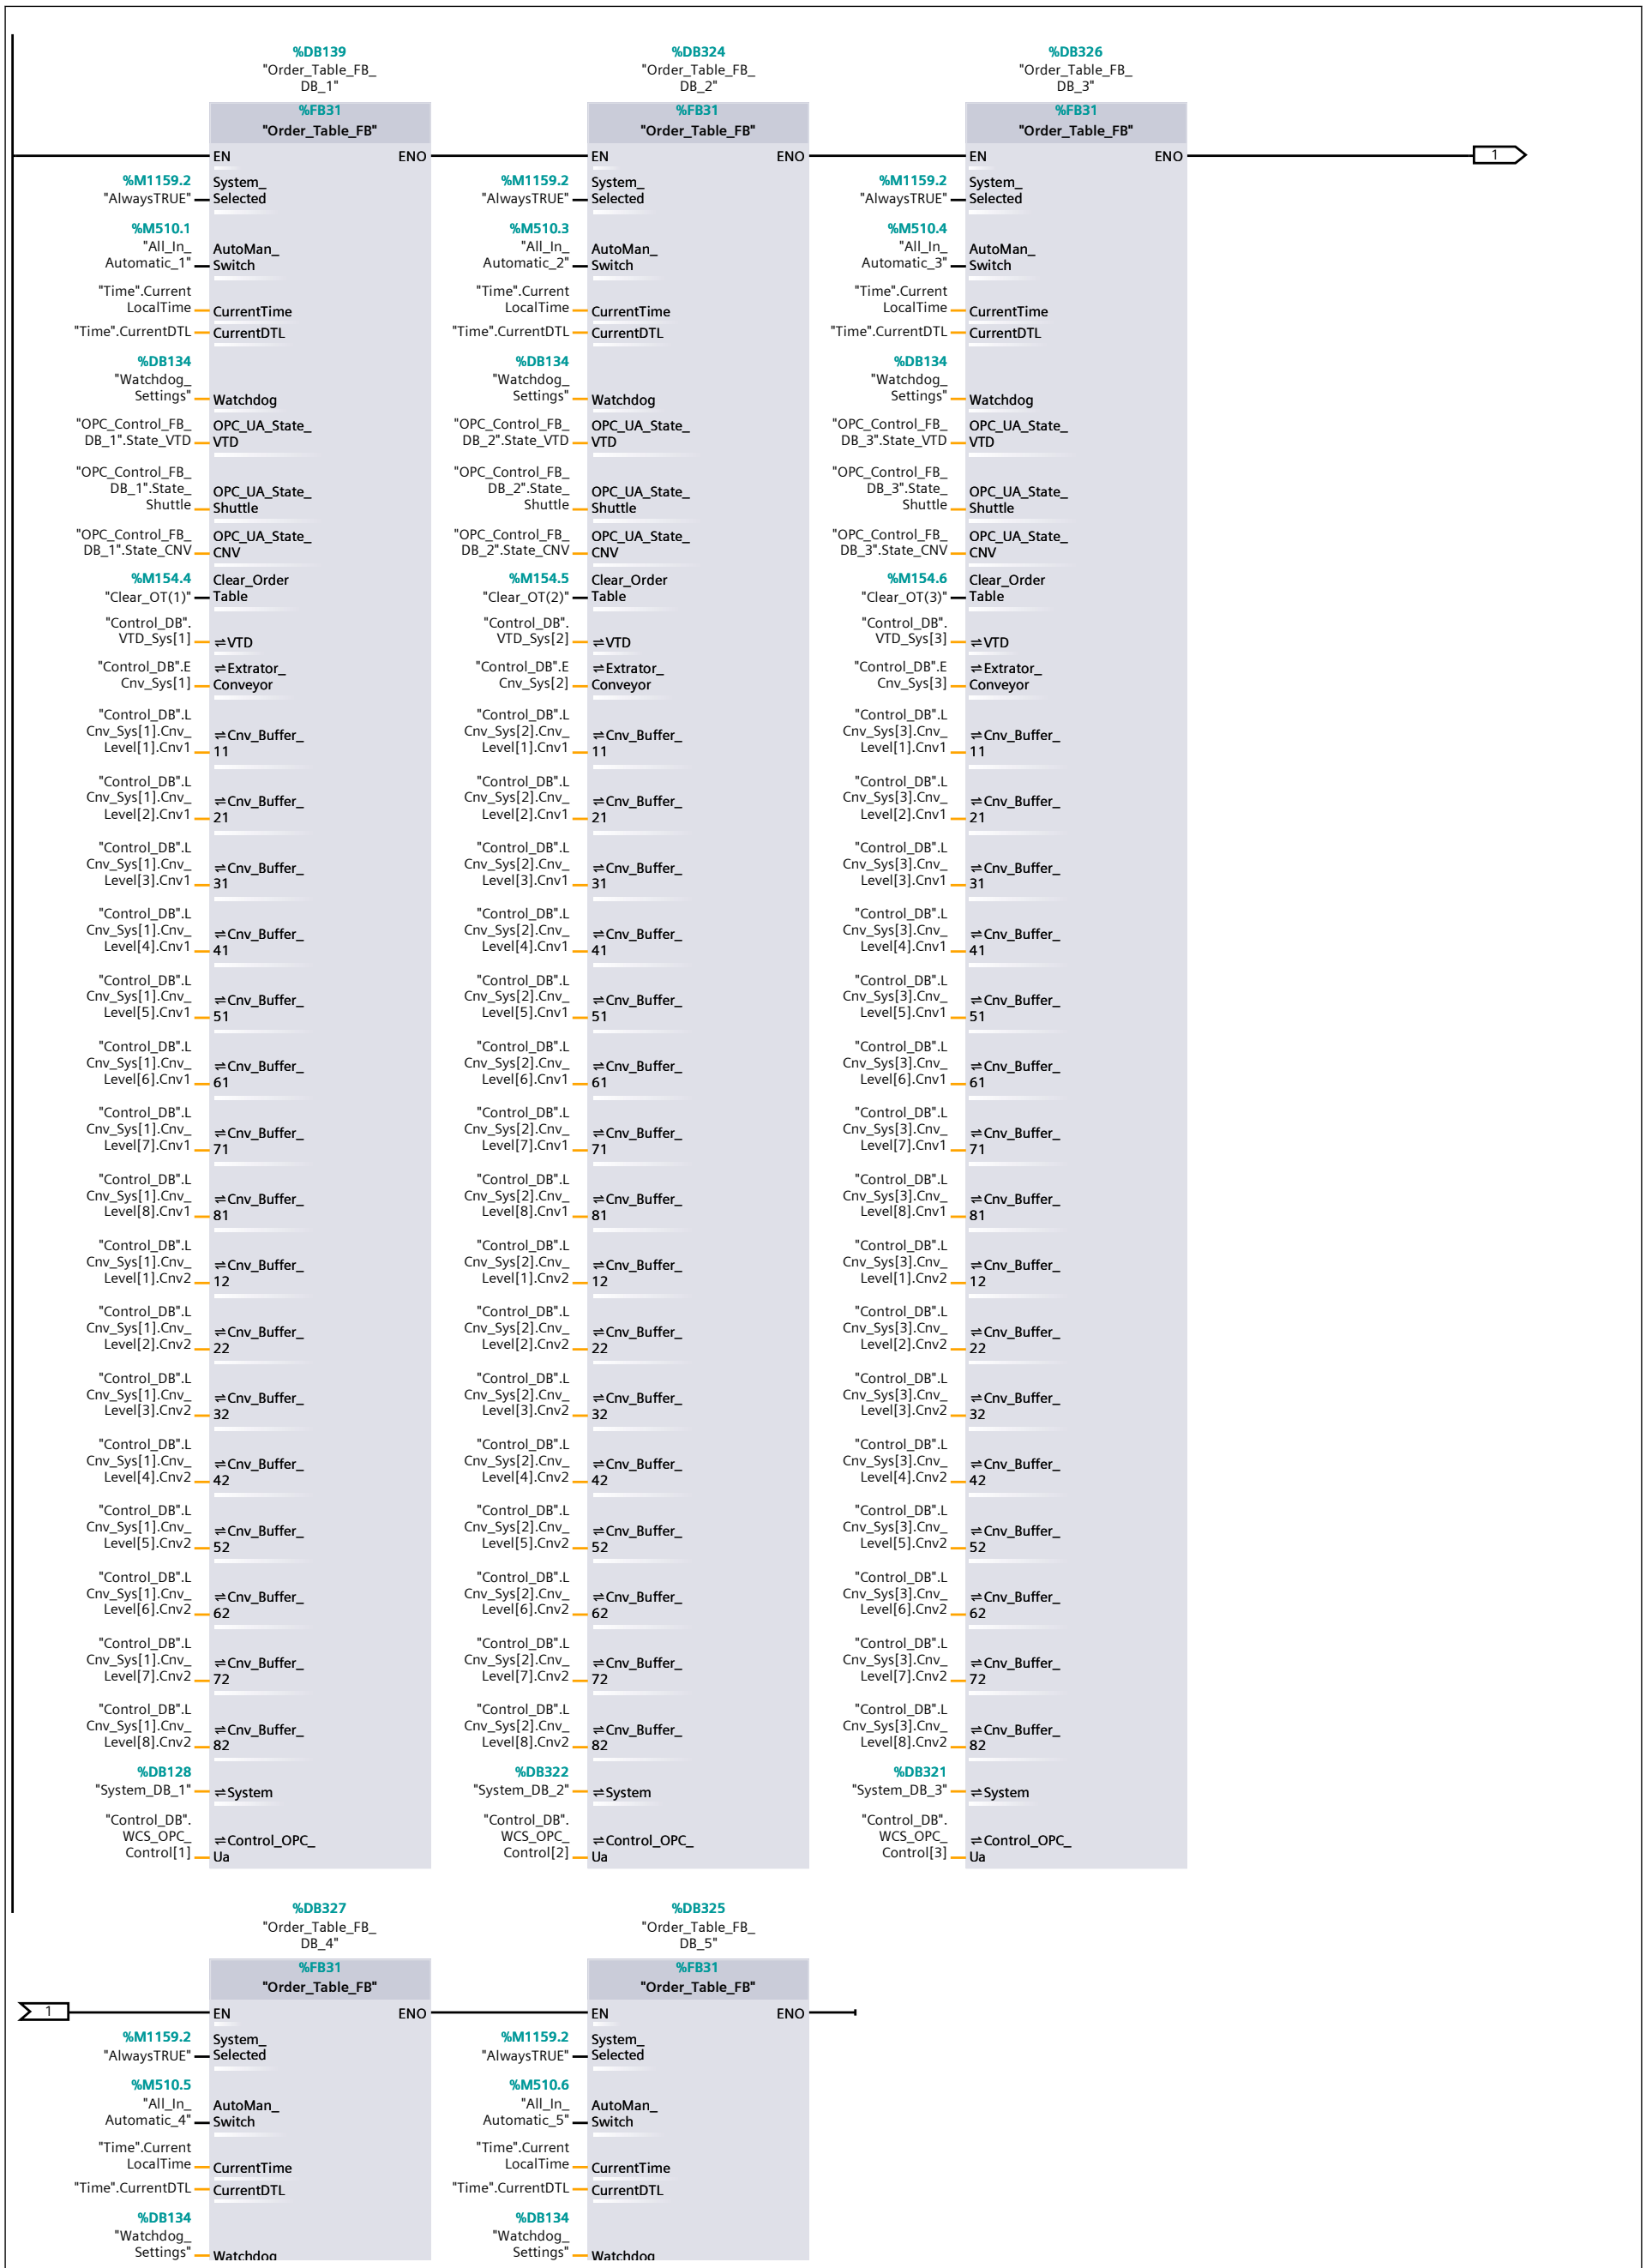


Network 54: Order Tables System (2.1 / 2.1)


"OPC_Control_FB_DB_4".State_VTD	OPC_UA_State_VTD
"OPC_Control_FB_DB_4".State_Shuttle	OPC_UA_State_Shuttle
"OPC_Control_FB_DB_4".State_CNV	OPC_UA_State_CNV
%M154.7 "Clear_OT(4)"	Clear_Order Table
"Control_DB".VTD_Sys[4]	⇌VTD
"Control_DB".ECnv_Sys[4]	⇌Extrator_Conveyor
"Control_DB".Lcnv_Sys[4].Cnv_Level[1].Cnv1	⇌Cnv_Buffer_11
"Control_DB".Lcnv_Sys[4].Cnv_Level[2].Cnv1	⇌Cnv_Buffer_21
"Control_DB".Lcnv_Sys[4].Cnv_Level[3].Cnv1	⇌Cnv_Buffer_31
"Control_DB".Lcnv_Sys[4].Cnv_Level[4].Cnv1	⇌Cnv_Buffer_41
"Control_DB".Lcnv_Sys[4].Cnv_Level[5].Cnv1	⇌Cnv_Buffer_51
"Control_DB".Lcnv_Sys[4].Cnv_Level[6].Cnv1	⇌Cnv_Buffer_61
"Control_DB".Lcnv_Sys[4].Cnv_Level[7].Cnv1	⇌Cnv_Buffer_71
"Control_DB".Lcnv_Sys[4].Cnv_Level[8].Cnv1	⇌Cnv_Buffer_81
"Control_DB".Lcnv_Sys[4].Cnv_Level[1].Cnv2	⇌Cnv_Buffer_12
"Control_DB".Lcnv_Sys[4].Cnv_Level[2].Cnv2	⇌Cnv_Buffer_22
"Control_DB".Lcnv_Sys[4].Cnv_Level[3].Cnv2	⇌Cnv_Buffer_32
"Control_DB".Lcnv_Sys[4].Cnv_Level[4].Cnv2	⇌Cnv_Buffer_42
"Control_DB".Lcnv_Sys[4].Cnv_Level[5].Cnv2	⇌Cnv_Buffer_52
"Control_DB".Lcnv_Sys[4].Cnv_Level[6].Cnv2	⇌Cnv_Buffer_62
"Control_DB".Lcnv_Sys[4].Cnv_Level[7].Cnv2	⇌Cnv_Buffer_72
"Control_DB".Lcnv_Sys[4].Cnv_Level[8].Cnv2	⇌Cnv_Buffer_82
%DB320 "System_DB_4"	⇌System
"Control_DB".WCS_OPC_Control[4]	⇌Control_OPC_Ua

"OPC_Control_FB_DB_5".State_VTD	OPC_UA_State_VTD
"OPC_Control_FB_DB_5".State_Shuttle	OPC_UA_State_Shuttle
"OPC_Control_FB_DB_5".State_CNV	OPC_UA_State_CNV
%M155.0 "Clear_OT(5)"	Clear_Order Table
"Control_DB".VTD_Sys[5]	⇌VTD
"Control_DB".ECnv_Sys[5]	⇌Extrator_Conveyor
"Control_DB".Lcnv_Sys[5].Cnv_Level[1].Cnv1	⇌Cnv_Buffer_11
"Control_DB".Lcnv_Sys[5].Cnv_Level[2].Cnv1	⇌Cnv_Buffer_21
"Control_DB".Lcnv_Sys[5].Cnv_Level[3].Cnv1	⇌Cnv_Buffer_31
"Control_DB".Lcnv_Sys[5].Cnv_Level[4].Cnv1	⇌Cnv_Buffer_41
"Control_DB".Lcnv_Sys[5].Cnv_Level[5].Cnv1	⇌Cnv_Buffer_51
"Control_DB".Lcnv_Sys[5].Cnv_Level[6].Cnv1	⇌Cnv_Buffer_61
"Control_DB".Lcnv_Sys[5].Cnv_Level[7].Cnv1	⇌Cnv_Buffer_71
"Control_DB".Lcnv_Sys[5].Cnv_Level[8].Cnv1	⇌Cnv_Buffer_81
"Control_DB".Lcnv_Sys[5].Cnv_Level[1].Cnv2	⇌Cnv_Buffer_12
"Control_DB".Lcnv_Sys[5].Cnv_Level[2].Cnv2	⇌Cnv_Buffer_22
"Control_DB".Lcnv_Sys[5].Cnv_Level[3].Cnv2	⇌Cnv_Buffer_32
"Control_DB".Lcnv_Sys[5].Cnv_Level[4].Cnv2	⇌Cnv_Buffer_42
"Control_DB".Lcnv_Sys[5].Cnv_Level[5].Cnv2	⇌Cnv_Buffer_52
"Control_DB".Lcnv_Sys[5].Cnv_Level[6].Cnv2	⇌Cnv_Buffer_62
"Control_DB".Lcnv_Sys[5].Cnv_Level[7].Cnv2	⇌Cnv_Buffer_72
"Control_DB".Lcnv_Sys[5].Cnv_Level[8].Cnv2	⇌Cnv_Buffer_82
%DB323 "System_DB_5"	⇌System
"Control_DB".WCS_OPC_Control[5]	⇌Control_OPC_Ua

Network 55: LOGISTEX

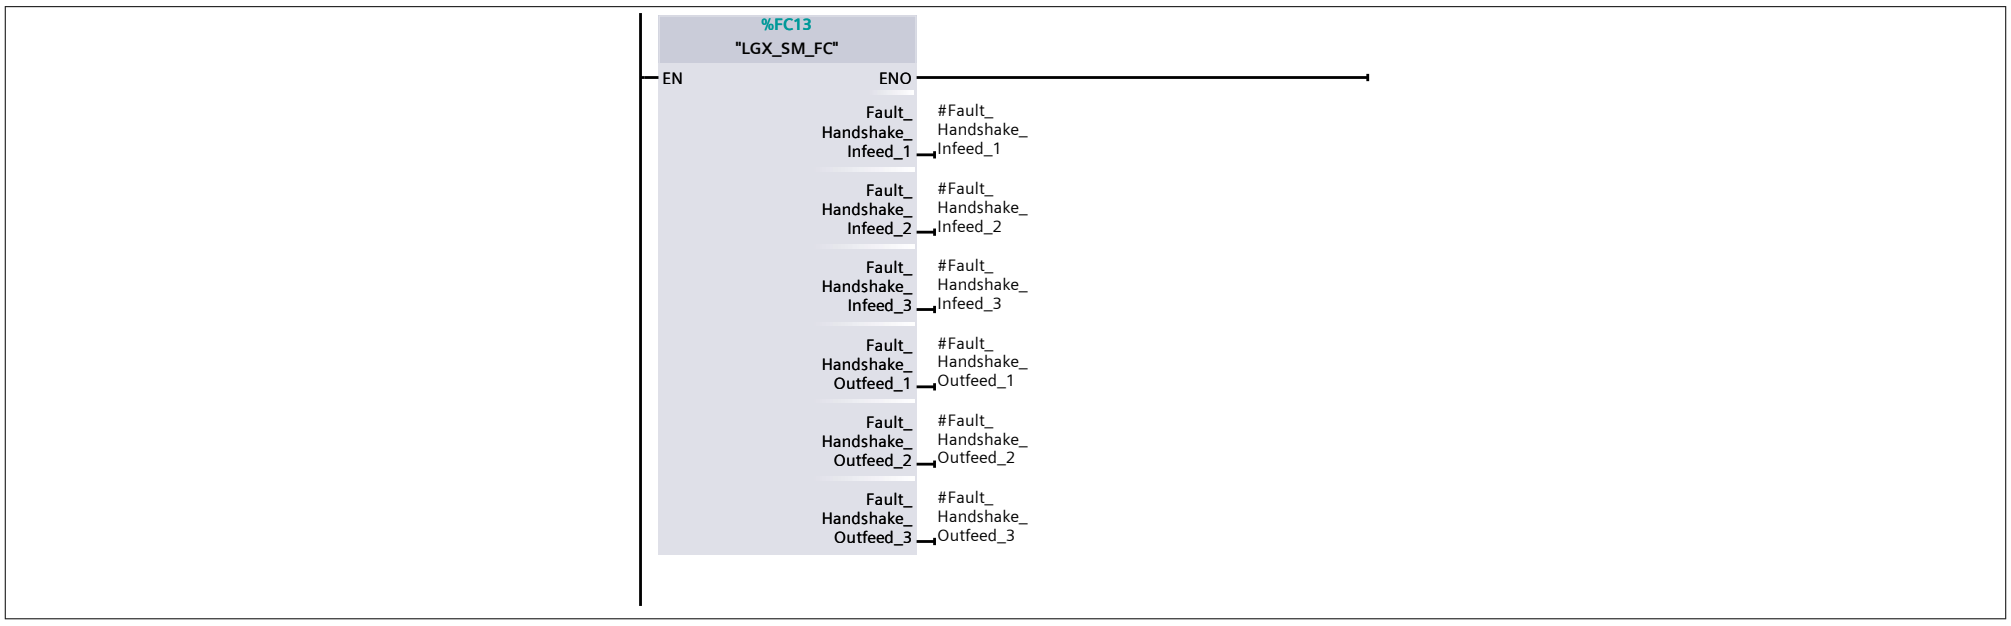

Network 56: CLOCK AND HEARTBEATING *

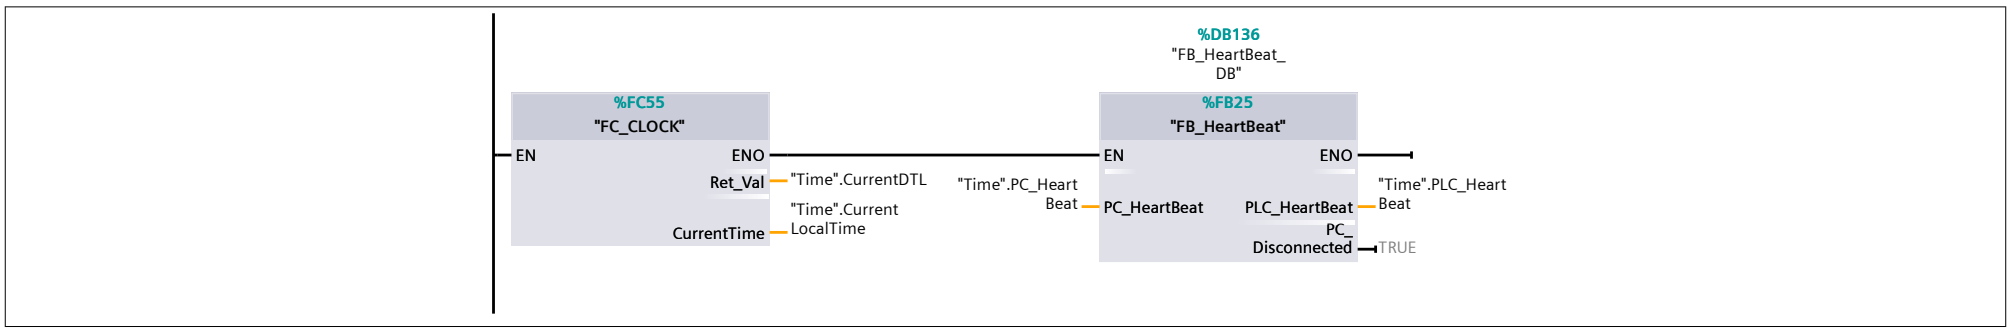

Network 57: Outputs

