


Q1.2 Predictive validity — calibrated v3.5 tracks BOPTEST for 24 h; raw v3.5 holds a systematic bias

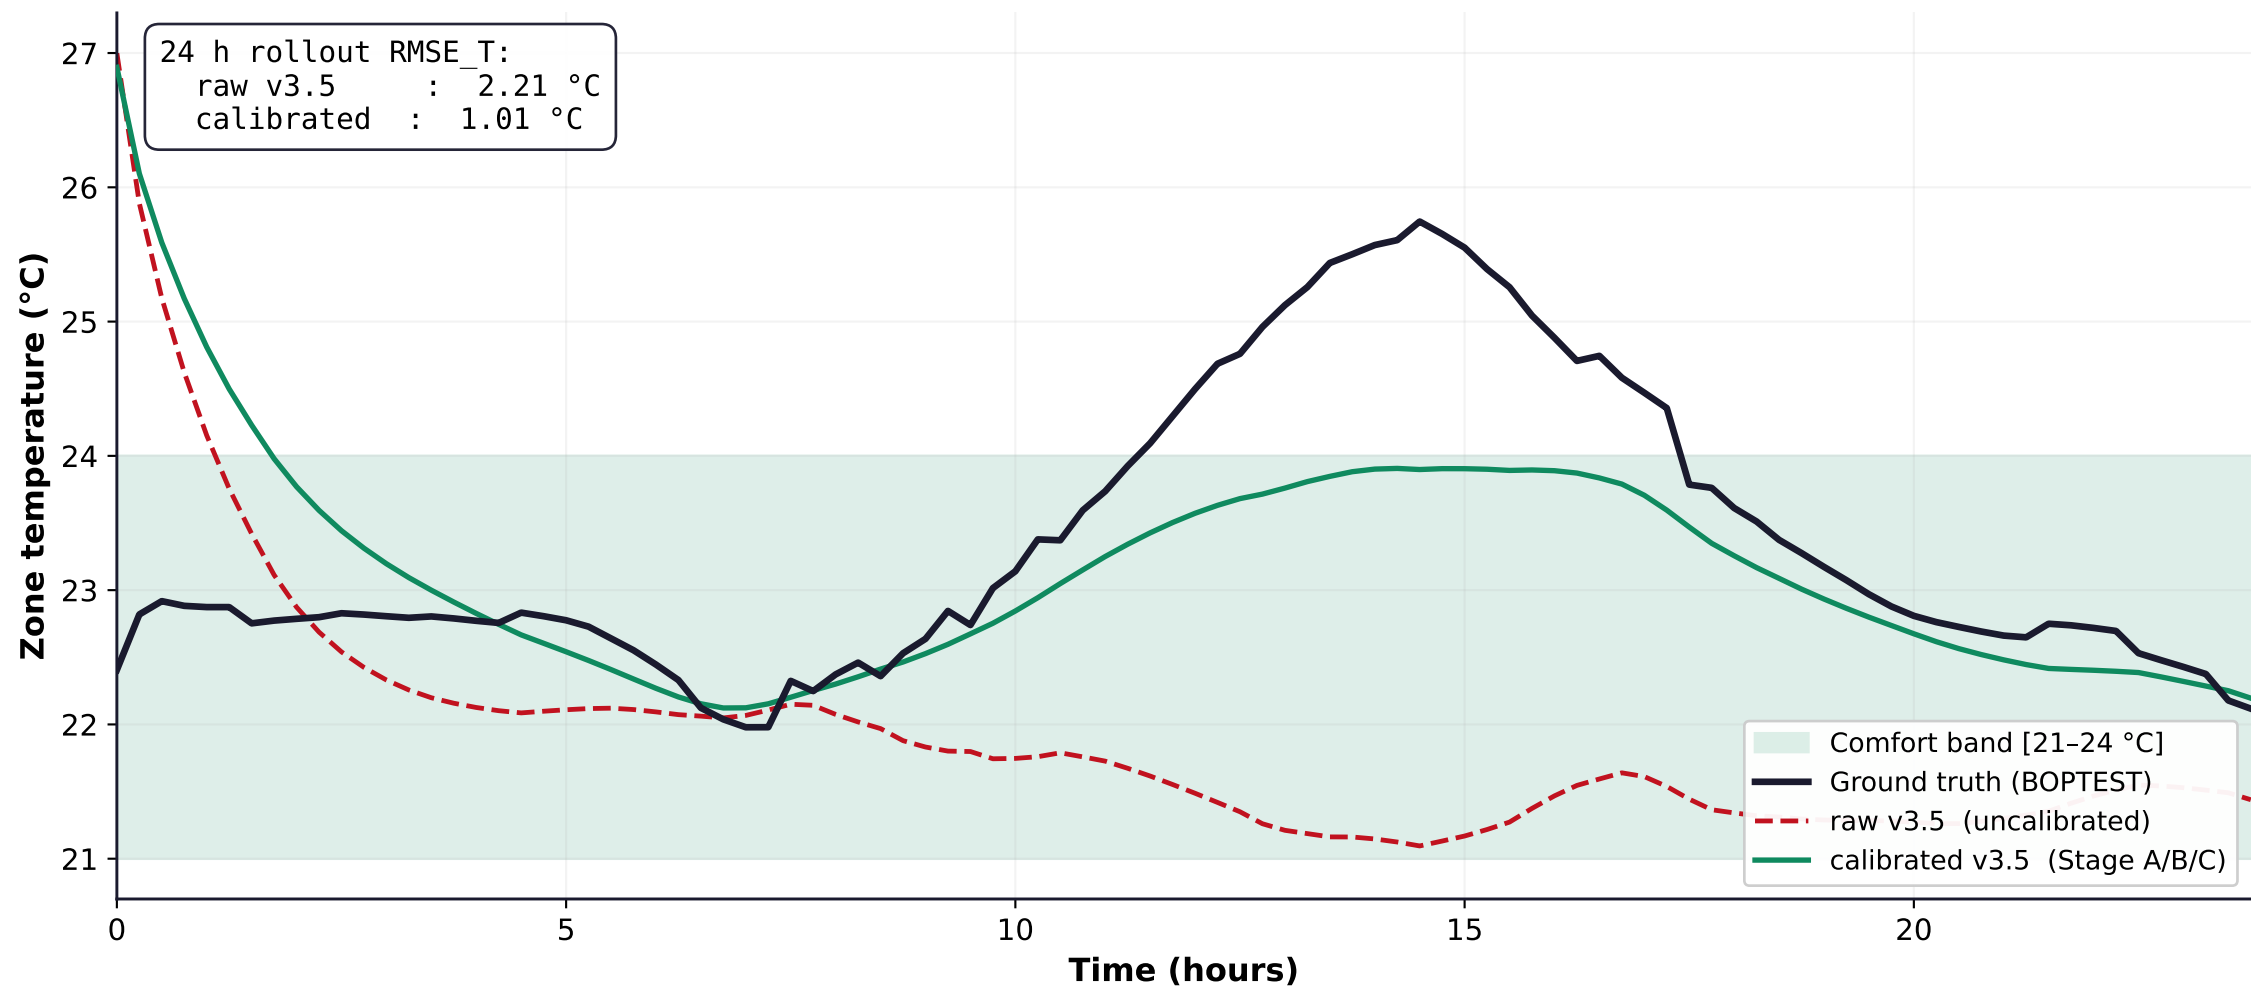

One held-out 24 h episode of the prepared 15-min corpus. Episode id: bestest_air_article7_style_15min__peak_heat_window_hdrl