


Q1.1 Replicative validity (one step) — Stage A/B/C calibration roughly halves both errors

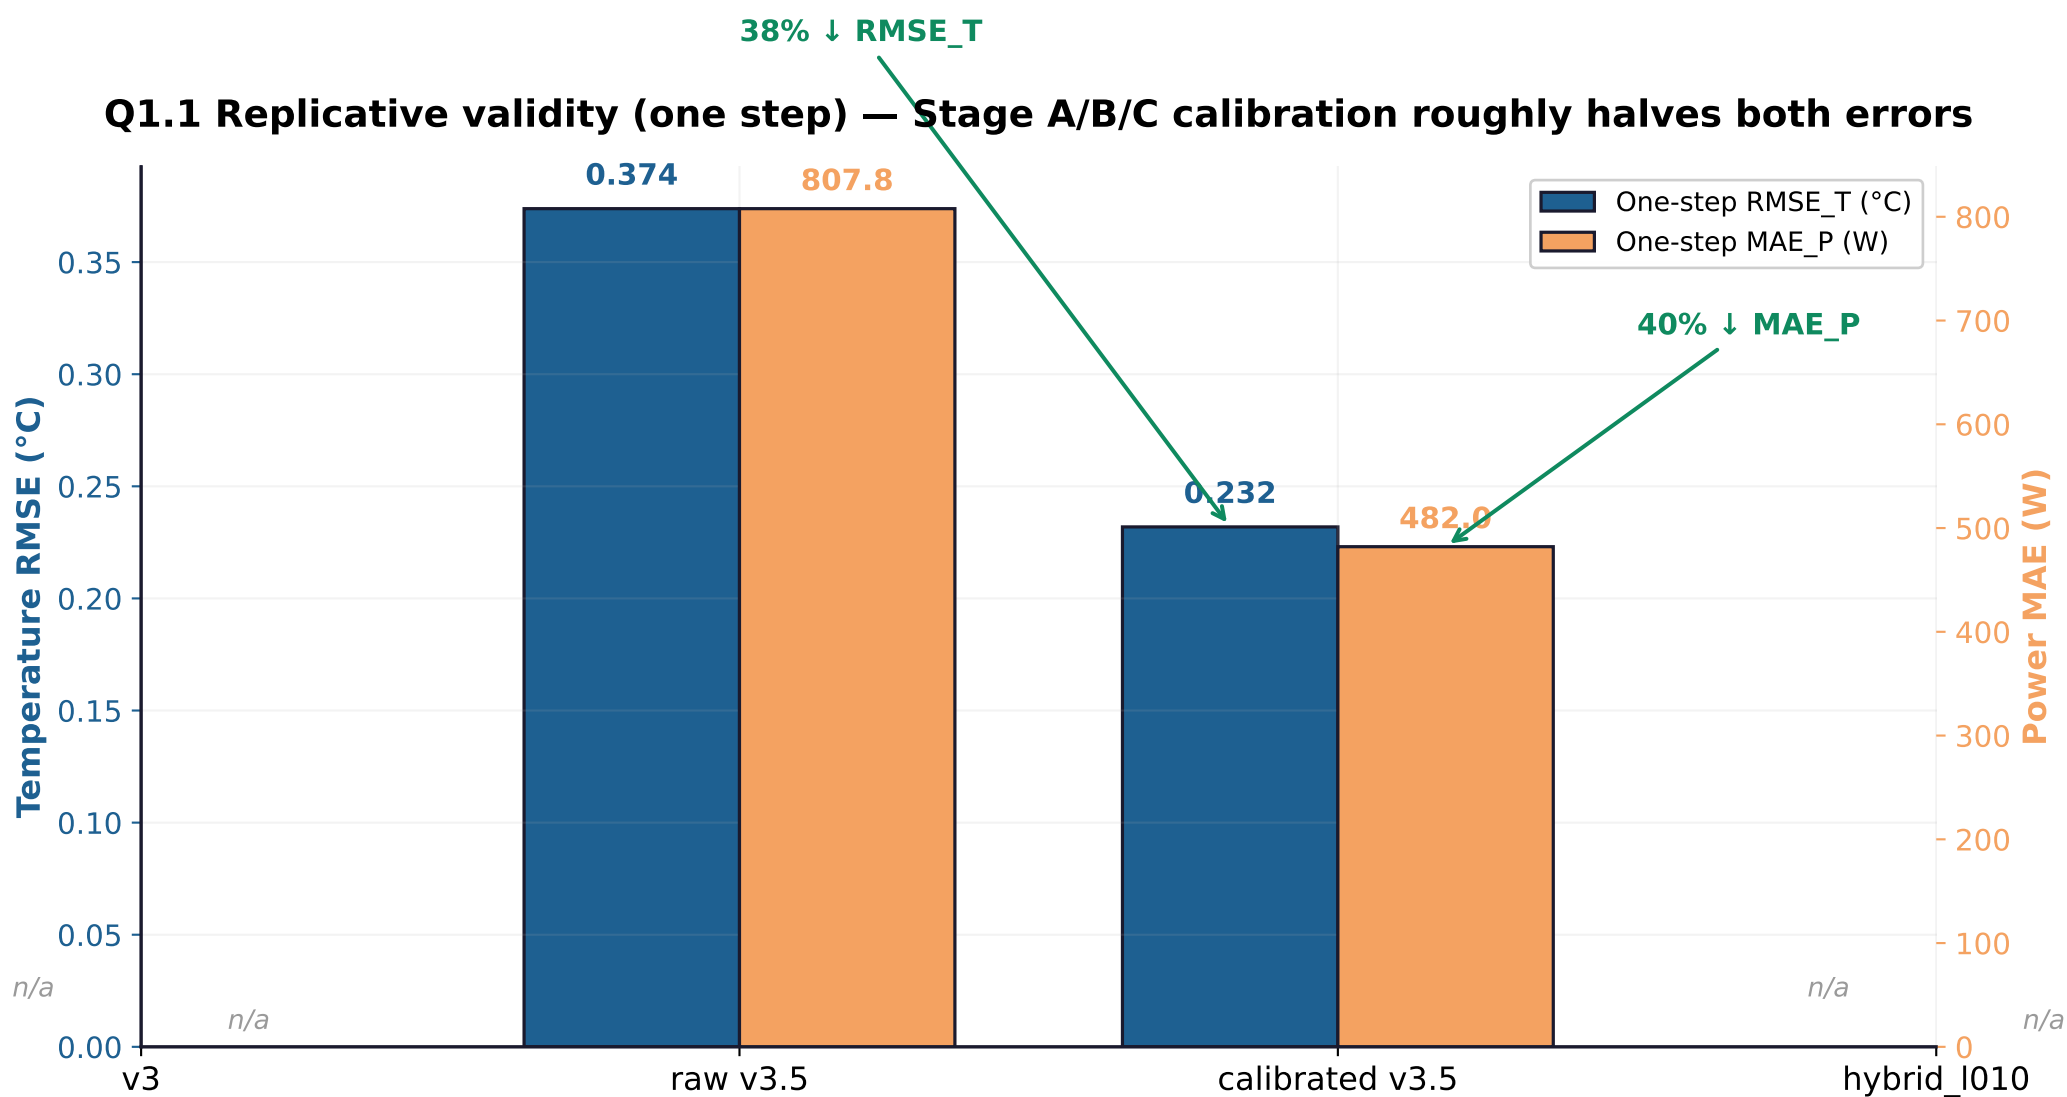

v3 and hybrid have no single-step temperature replicative metric reported in Block 1; their fidelity is judged via multi-horizon rollout (Q1.2) and live closed-loop transfer.