



Live BOPTEST closed-loop traces: pure v3 vs direct v3.5 vs hybrid

(a) Zone temperature and ambient disturbance

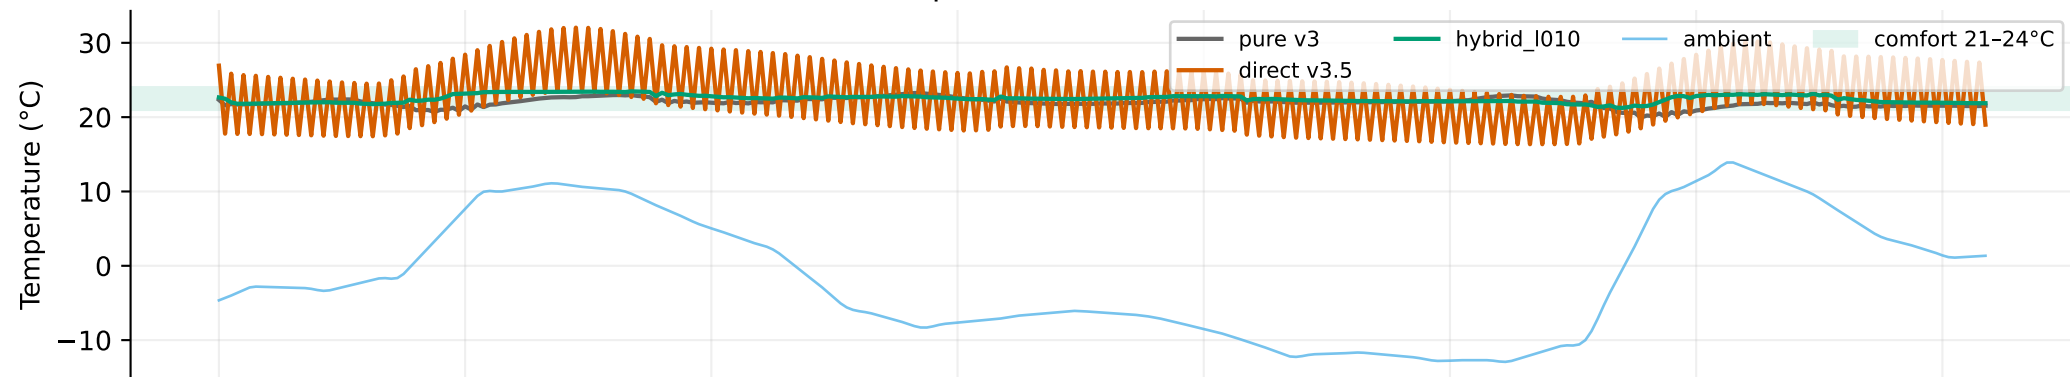

(b) Supply-temperature command

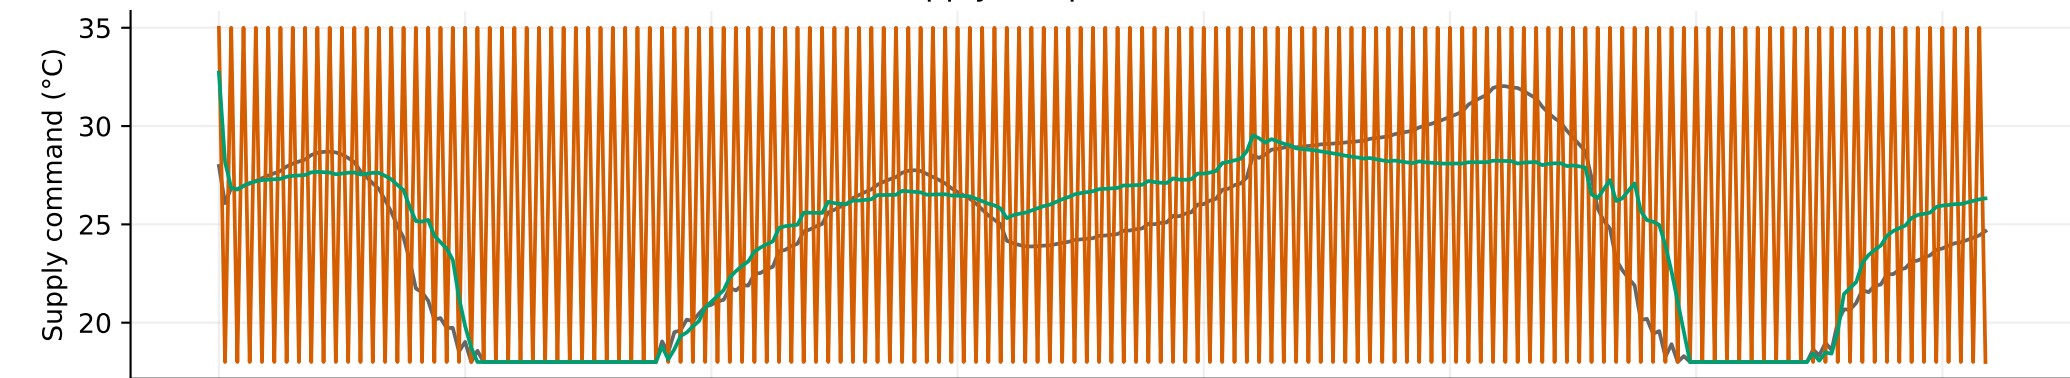

(c) HVAC power

