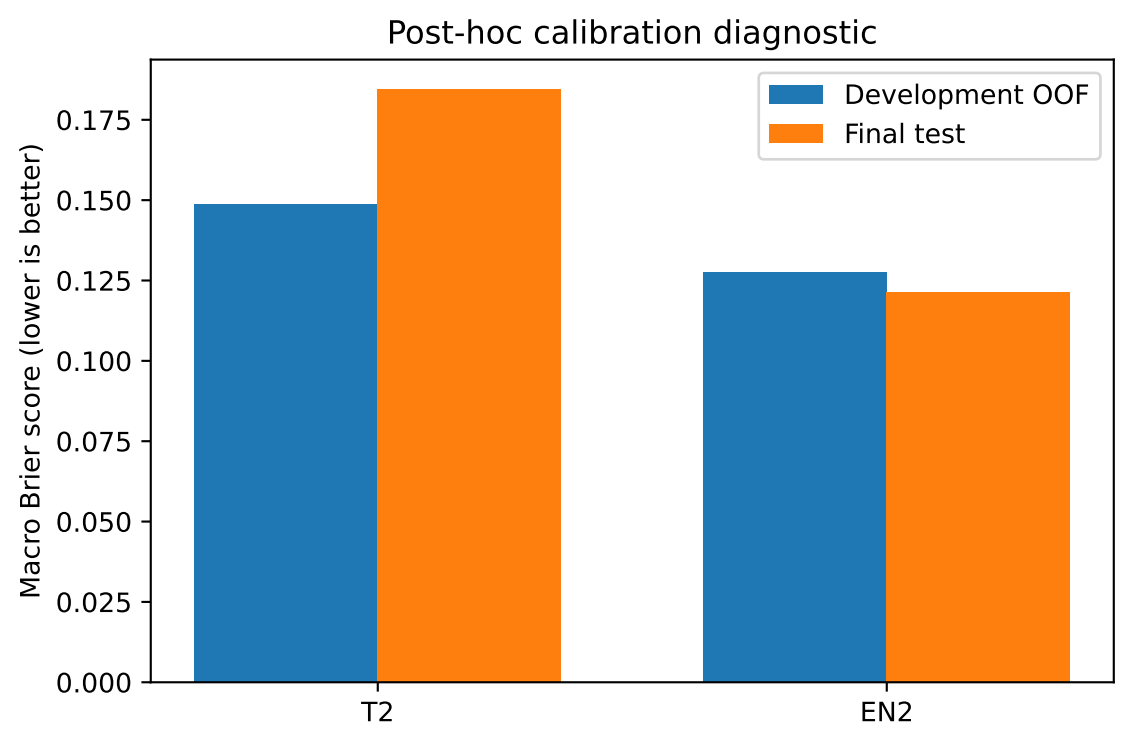
Post-hoc calibration diagnostic
Development OOF
Final test
Macro Brier score (lower is better)
0.000
0.025
0.050
0.075
0.100
0.125
0.150
0.175
T2
EN2