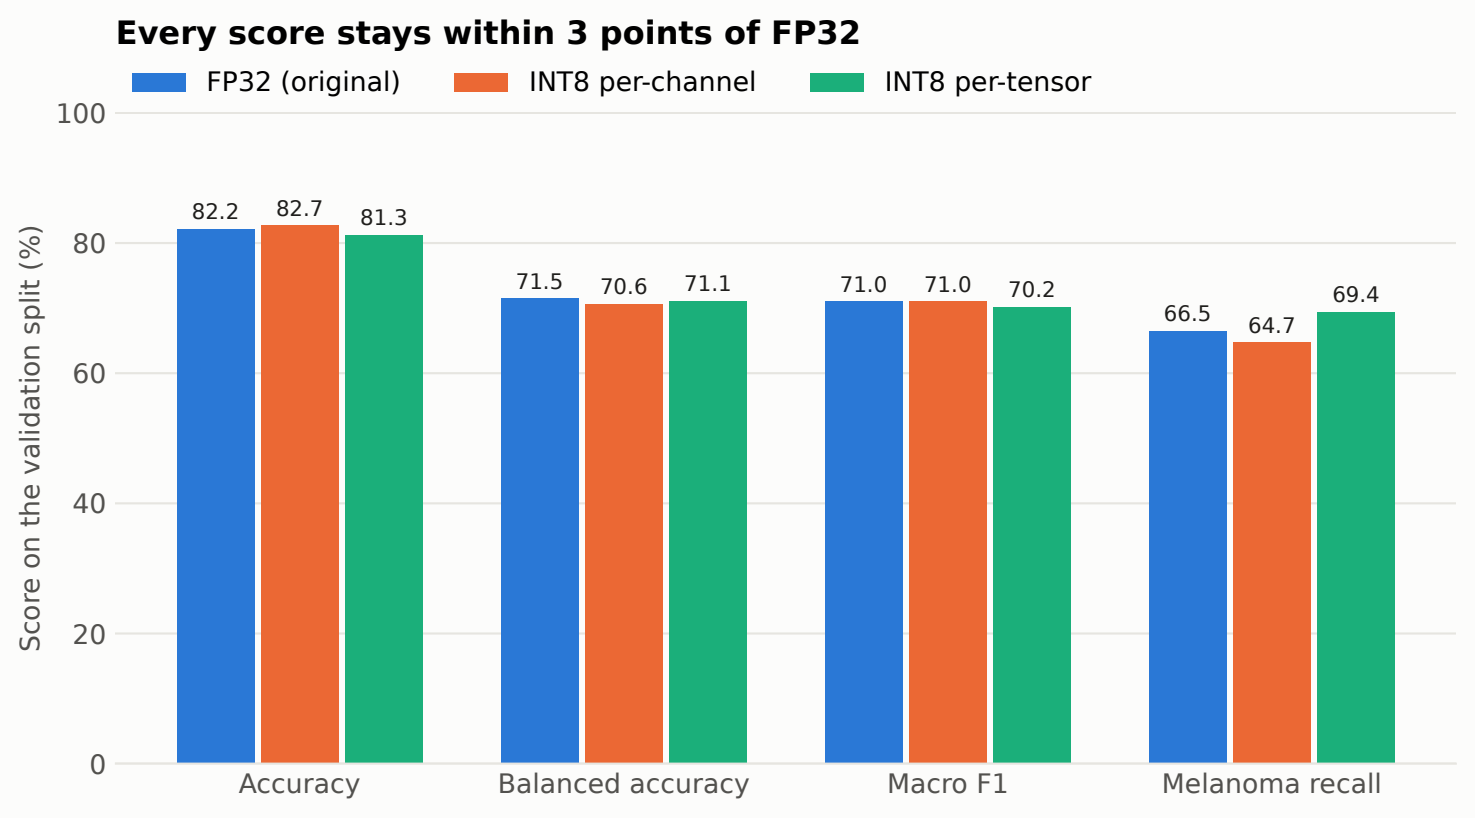
Every score stays within 3 points of FP32
FP32 (original)
INT8 per-channel
INT8 per-tensor
Score on the validation split (%)
100
80
60
40
20
0
82.2
82.7
81.3
71.5
70.6
71.1
71.0
71.0
70.2
66.5
64.7
69.4
Accuracy
Balanced accuracy
Macro F1
Melanoma recall