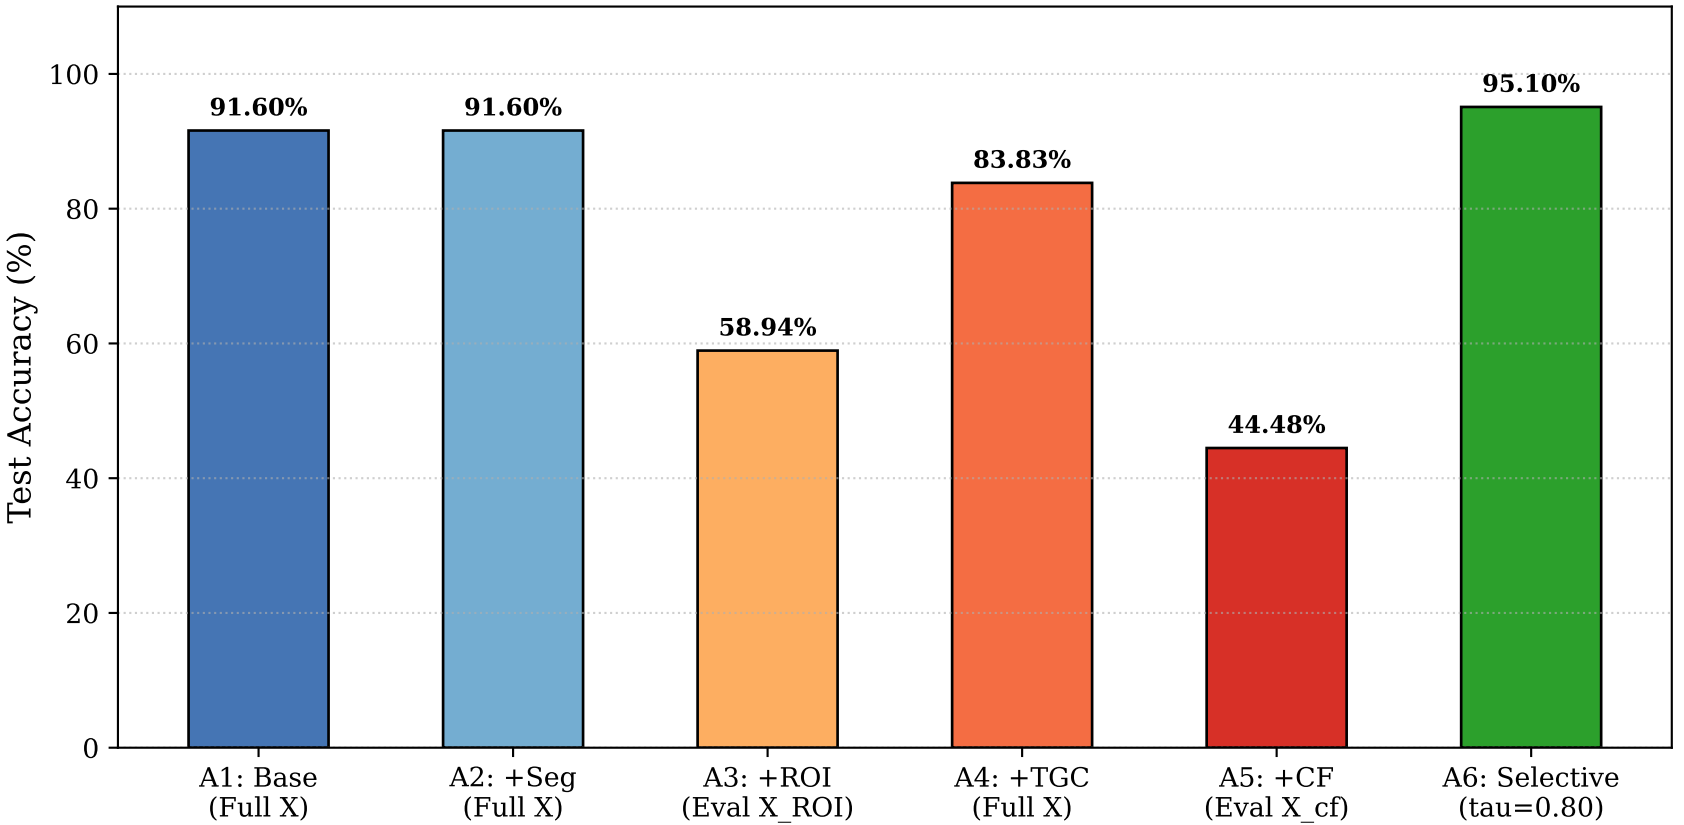
Progressive Ablation Ladder: Test Set Accuracy Across Configurations
Test Accuracy (%)
0
20
40
60
80
100
91.60%
91.60%
58.94%
83.83%
44.48%
95.10%
A1: Base
(Full X)
A2: +Seg
(Full X)
A3: +ROI
(Eval X_ROI)
A4: +TGC
(Full X)
A5: +CF
(Eval X_cf)
A6: Selective
(tau=0.80)