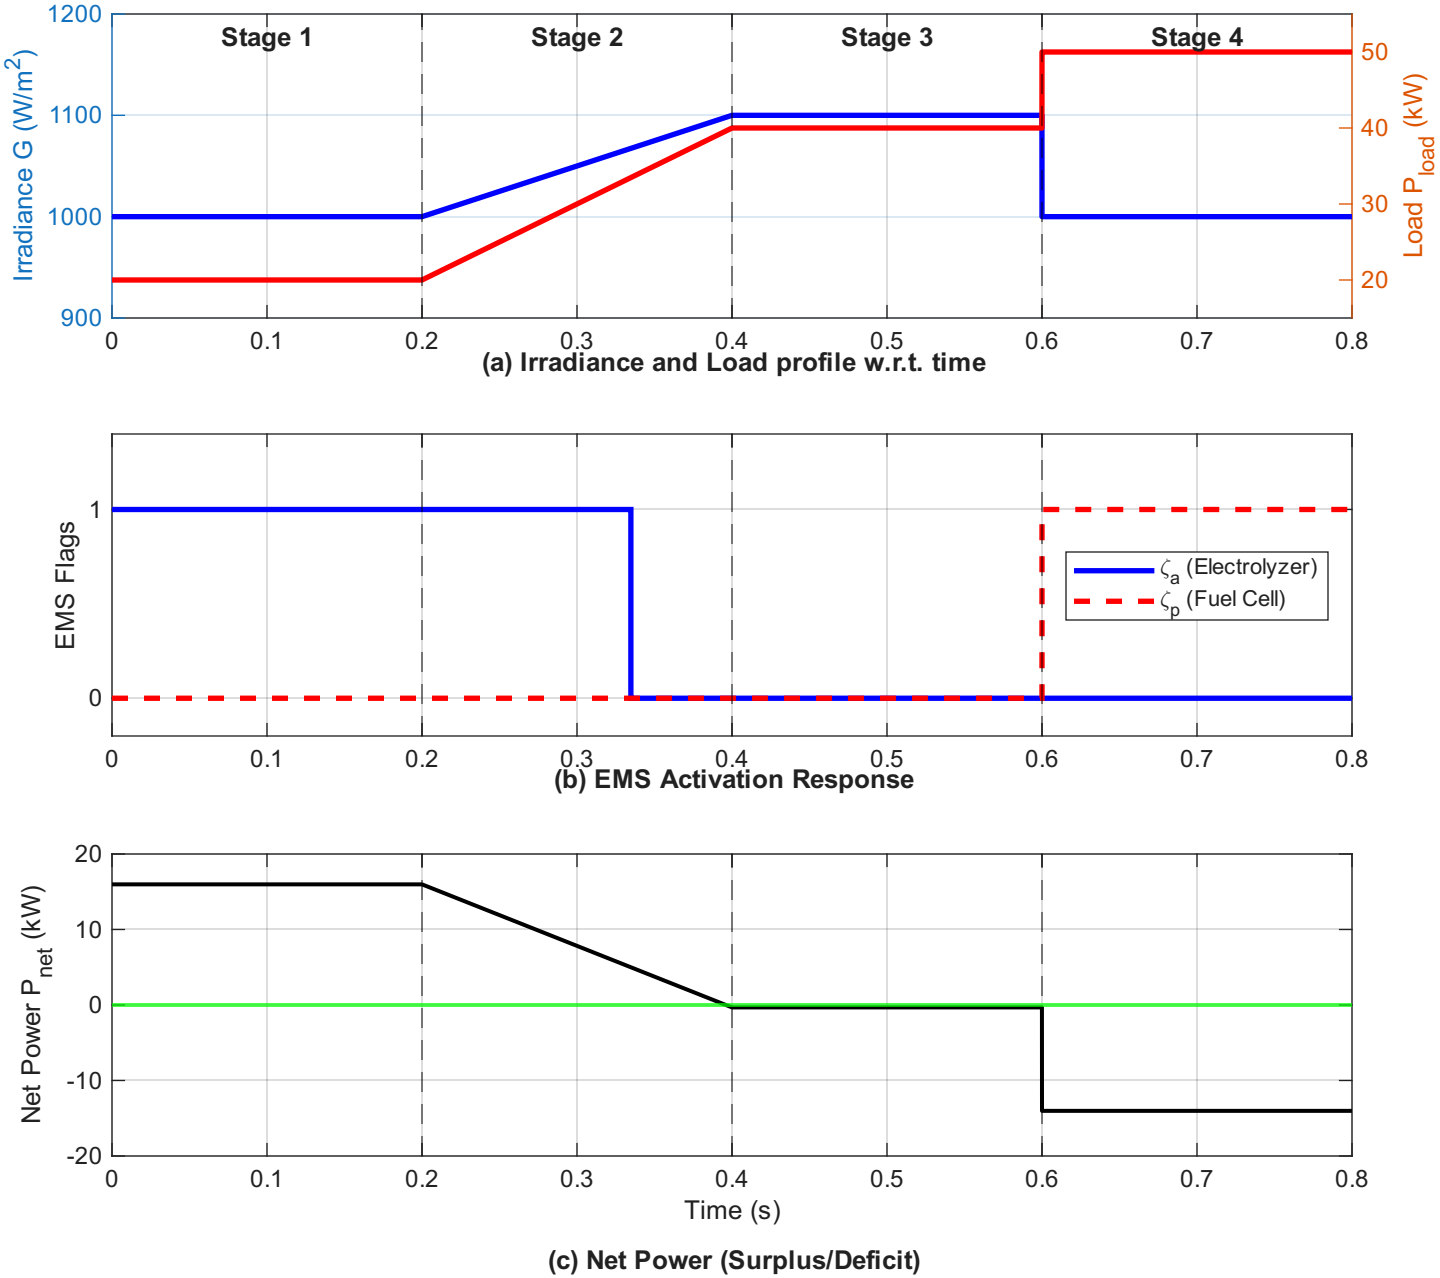
Stage 1
Stage 2
Stage 3
Stage 4
Irradiance G (W/m2)
Load Pload (kW)
1200
1100
1000
900
50
40
30
20
0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
0.8
(a) Irradiance and Load profile w.r.t. time
EMS Flags
1
0
ζa (Electrolyzer)
ζp (Fuel Cell)
(b) EMS Activation Response
Net Power Pnet (kW)
20
10
0
-10
-20
Time (s)
(c) Net Power (Surplus/Deficit)