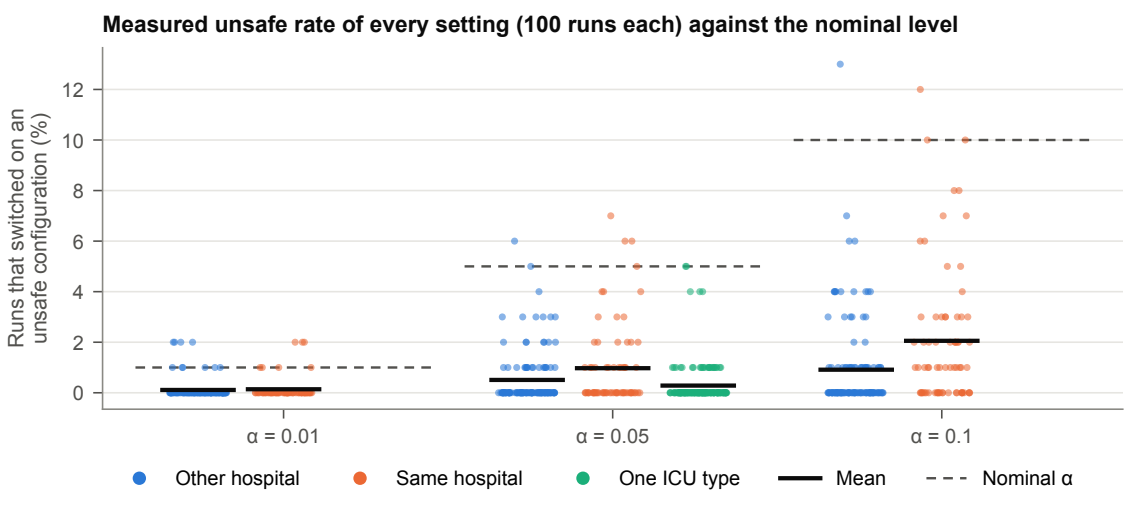
Measured unsafe rate of every setting (100 runs each) against the nominal level
Runs that switched on an unsafe configuration (%)
12
10
8
6
4
2
0
α = 0.01
α = 0.05
α = 0.1
Other hospital
Same hospital
One ICU type
Mean
Nominal α