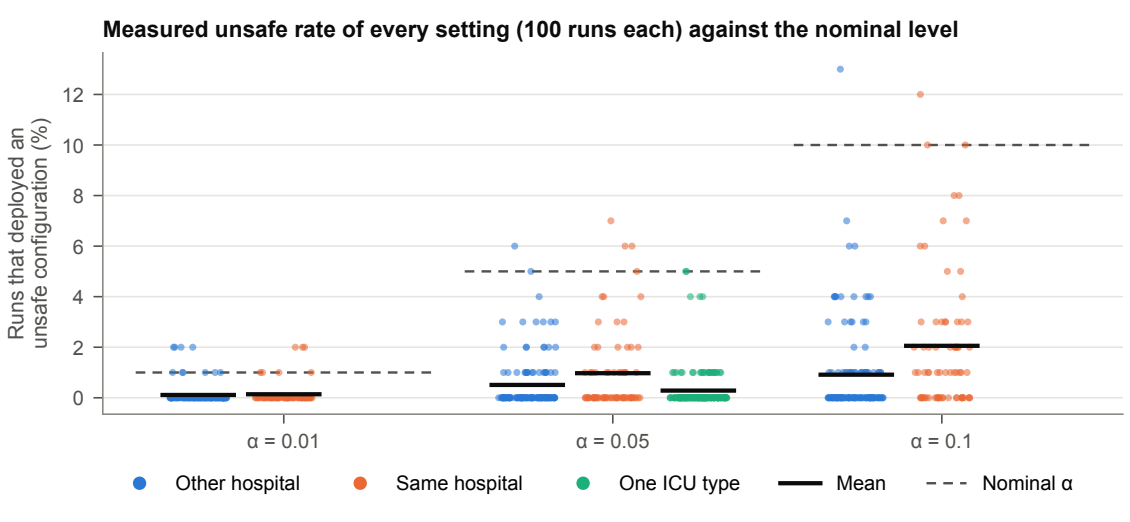
Measured unsafe rate of every setting (100 runs each) against the nominal level
Runs that deployed an unsafe configuration (%)
0
2
4
6
8
10
12
α = 0.01
α = 0.05
α = 0.1
Other hospital
Same hospital
One ICU type
Mean
Nominal α