


A

A

B

LEGEND

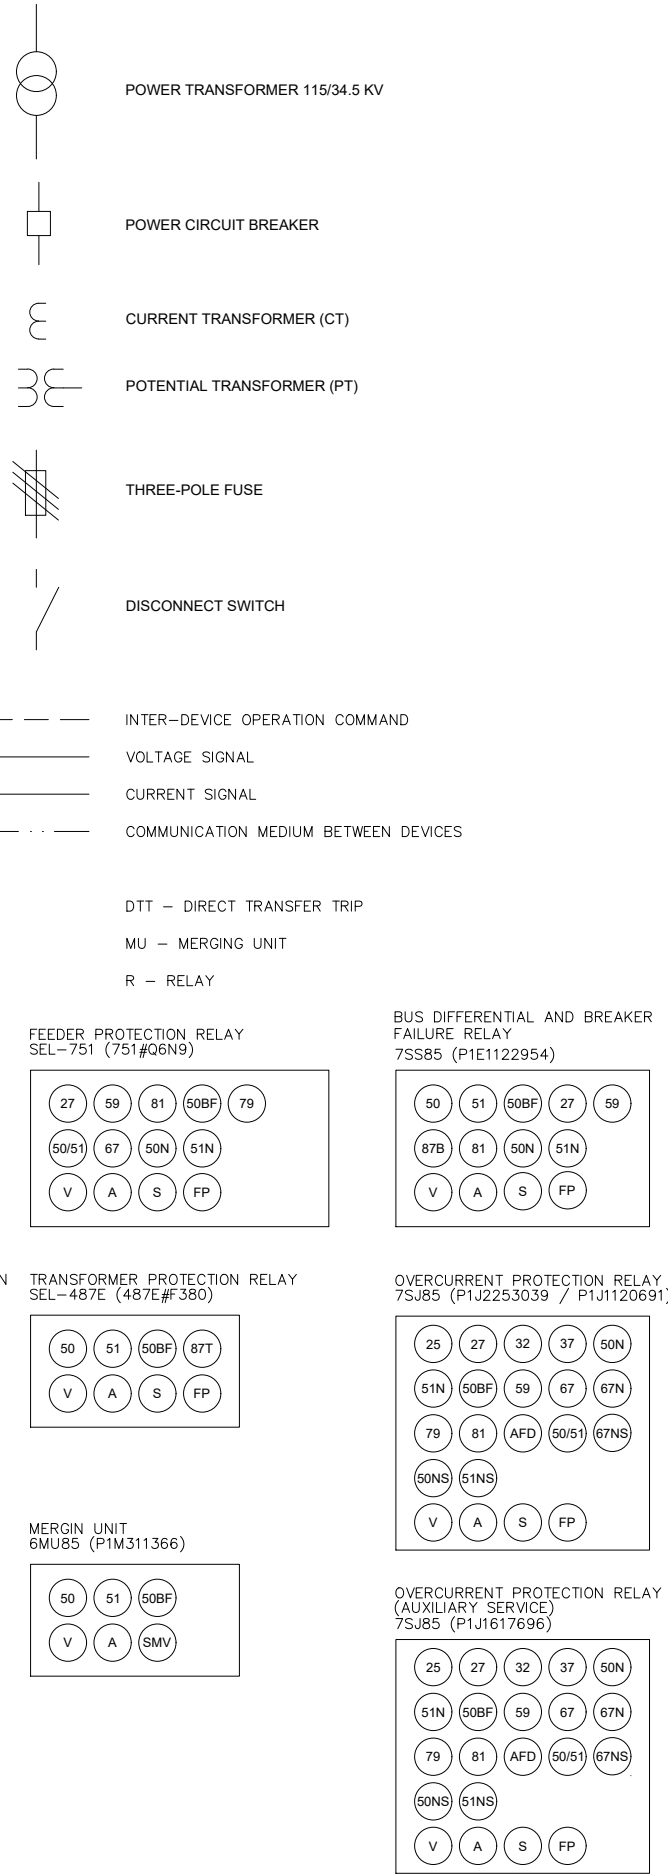

- NOTES:
- THE SEL-751, SEL-487E, SEL-411L, SEL-451, 75S85 AND 75J85 RELAYS OFFER AN EXTENSIVE SET OF PROTECTION FUNCTIONS. THE CUSTOMER SHALL BE RESPONSIBLE FOR SPECIFYING WHICH FUNCTIONS ARE TO BE ENABLED AND DETERMINING THEIR SETTINGS, WITHIN THE HARDWARE AND SOFTWARE CONSTRAINTS OF EACH RELAY.
 - THE IEC 61850 COMMUNICATION NETWORK ENABLES HIGH-SPEED DATA EXCHANGE ACROSS ALL DEVICES, PROVIDING REDUNDANCY FOR TRIPS, PERMISSIVES, AND METERING. NEVERTHELESS, ALTERNATIVE BAY-LEVEL PROTOCOLS, SUCH AS DNP3, MAY BE IMPLEMENTED SUBJECT TO THE SOFTWARE LIMITATIONS OF EACH RELAY.
 - PROVISION IS MADE FOR DIRECT TRANSFER TRIP (DTT) TO REMOTE-END SUBSTATIONS. THE TRANSMISSION MEDIUM (ETHER POWER LINE CARRIERWAVE TRAP OR FIBER OPTIC MULTIPLEXER) SHALL BE VERIFIED.
 - WHEN UTILIZING A CIRCUIT BREAKER INSTEAD OF A FUSE, A DEDICATED PROTECTION RELAY OR TRIP UNIT IS REQUIRED TO PROTECT THE AUXILIARY POWER TRANSFORMERS. THE SUITABILITY OF THE 75J85 RELAY FOR THIS APPLICATION SHALL BE VERIFIED.

INFORMACIÓN DISEÑO CONTRATADO			
NOMBRE DE LA EMPRESA:			
DISEÑADO: X			
AFROBADO: X			
ING. DE CONTRATO: X			
FORMATO "A1" (594x841mm)			

REVISIONES									
REV.	DIBUJADO	DISEÑO	CIV	APROBADO	CIV	FECHA	DESCRIPCIÓN		
X	X	X	X	X	X	X	X		

PLANOS DE REFERENCIAS	
CODIGO DEL PLANO	DESCRIPCIÓN
XXX	

PLANOS DE REFERENCIAS	
CODIGO DEL PLANO	DESCRIPCIÓN

NEGOCIO O FILIAL:		ACE:
ÁREA GEOGRÁFICA:	ORP:	
DISEÑADO POR:	REVISADO POR:	CIV:
AFROBADO POR:	INGENIERO POR:	XXX

INSTALACIÓN:	SUBESTACION "C"
TÍTULO:	REHABILITACION SUBESTACION "C" 115/34.5 KV
DESCRIPCIÓN:	DETAILED SINGLE-LINE DIAGRAM
ESCALA:	XX
FECHA:	XXX
CÓDIGO DEL PLANO:	XXX
HJUA:	1
REV.:	DE: 1