
REFERENCE	Combined Sewer Overflow LCP - Form 2a					
COMPARTMENT						
TYPE/ SIZE	32A BS88	2A BS88	DOL 6A BS88			
WB REF						
DESCRIPTION	MAINS INCOMER	24V DC CONTROL SUPPLY	CSO SCREEN NO. 1	CSO LEVEL INSTRUMENT	TELEMETRY OUTSTATION	LINK TO DT LCP
TAG			42056-CO1-NA1-SCH01-SC001	42056-DT1-NA1-STO01-LX001		

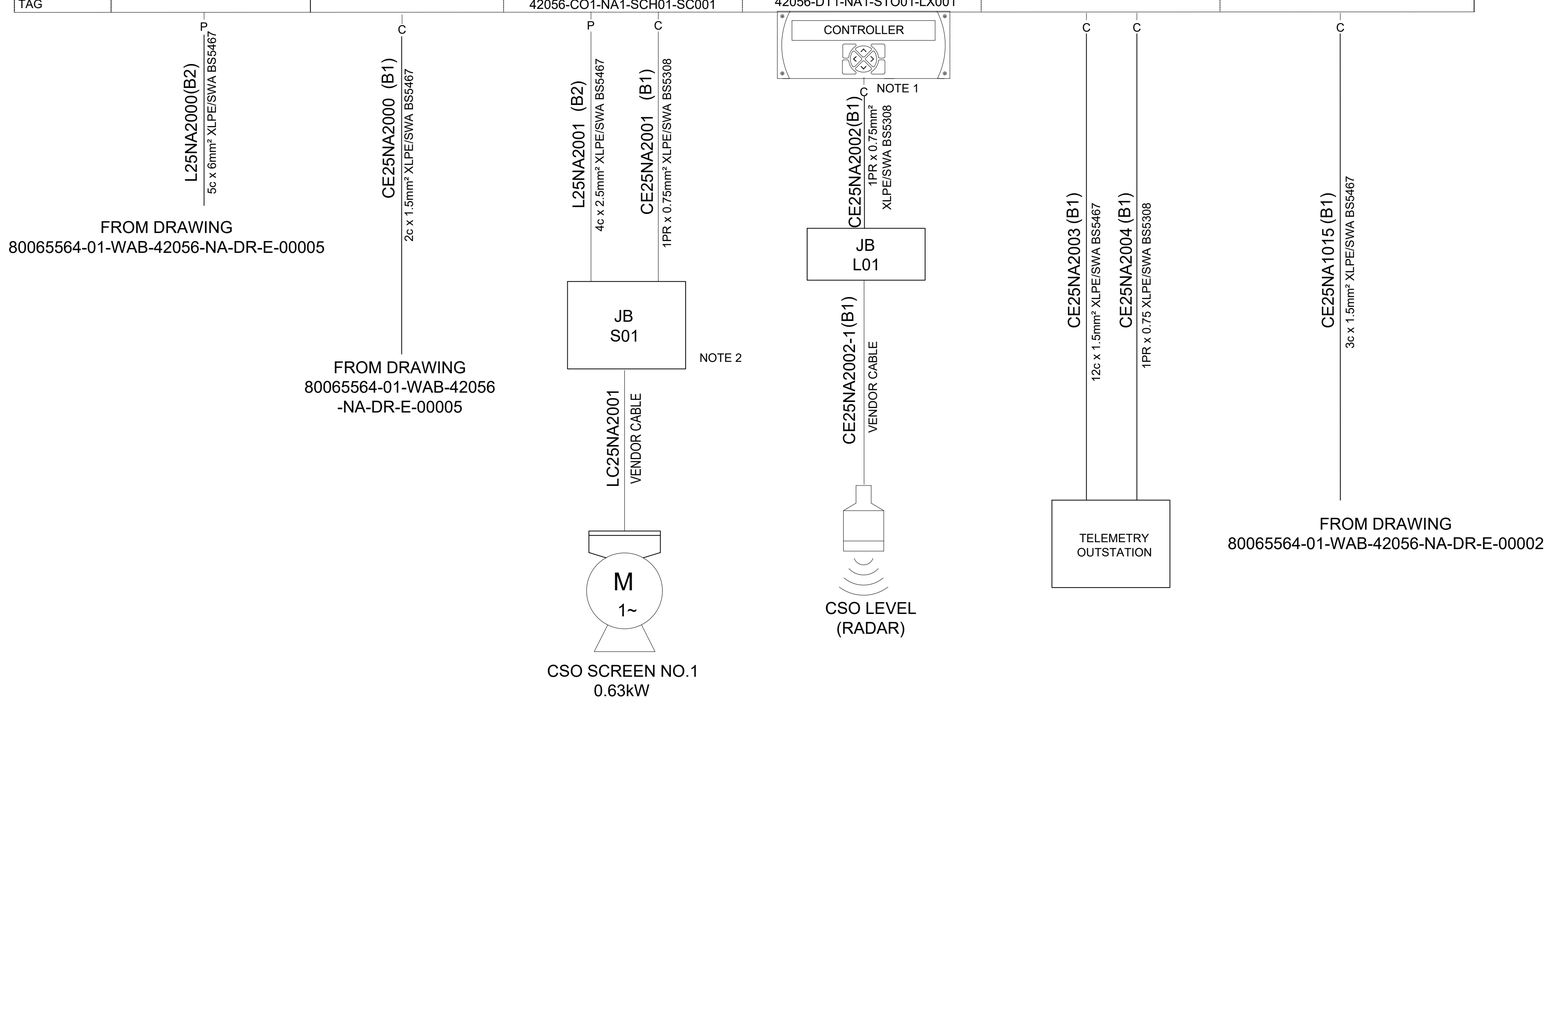

WARD & BURKE

BIM QUALITY SHEET NO:

COPYRIGHT: This drawing is protected by copyright and is not to be reproduced in part or whole form without the prior and written consent of Ward & Burke.

NOTES

1. LEVEL CONTROLLERS MOUNTED ON PANEL DOORS
2. INSOLATOR ISOLATION PROVIDES ISOLATION FROM THE LCP SOURCE TO ENSURE ISOLATOR IS DEAD ON THE SUPPLY SIDE WHEN ENCLOSURE IS OPEN

REV NO:	DESCRIPTION	DATE	BY
P01	For Information	16/06/25	DG
P02	For Information	11/07/25	DG
C01	For Information	21/04/26	AS

United Utilities
Water for the North West

PROJECT:
Gaskell Street

TITLE:
CSO BCD

DRAWN BY:	CHECKED BY:	DATE:
AS	DG	21/04/2026

SHEET SIZE:	PROJECT NUMBER:
A1	C821 - GASKST

W&B DRAWING No: **GASKST-WAB-01-XX-DR-W-60102** REV: C01

CLIENT DRAWING No: 80065564-01-WAB-42056-NA-DR-E-00003 SCALE: NTS

CAD FILE: GASKST-WAB-01-XX-M2-W-60100-BCD

SUITABILITY CODE: CR - Construction Record