


### C.3. Electrical – Single Line Drawing (SLD):

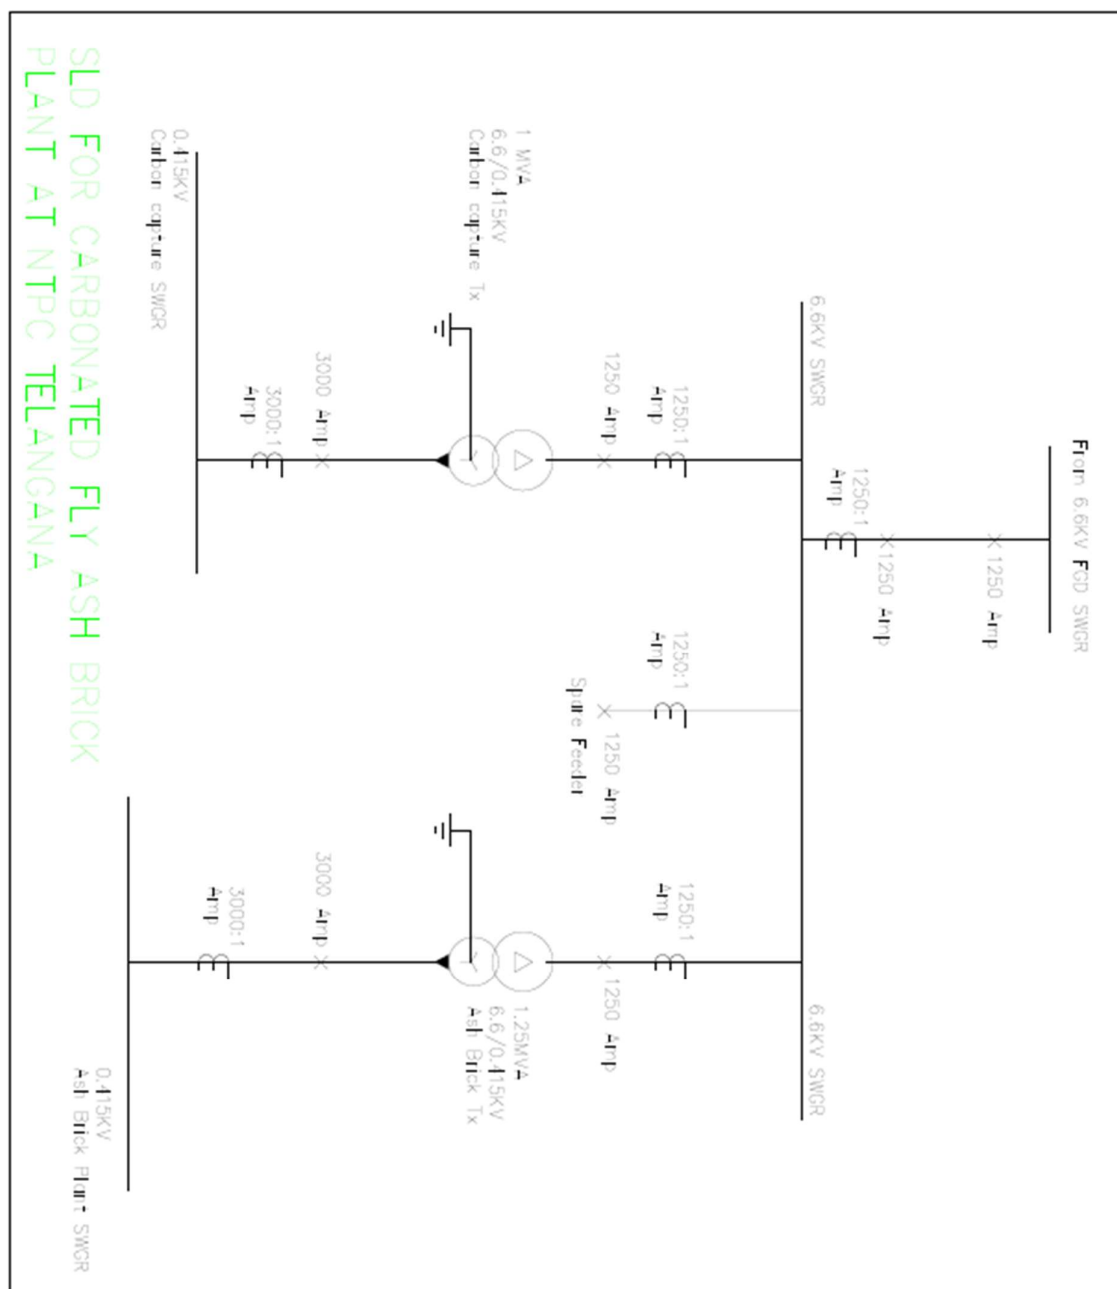

### C.4. Terminal Points:

S.No.	Resource point	Approx Distance (Meter)
1.	Flue gas	200 meters from Plot-A
2.	Electricity	200 meters from Plot-A
3.	Aux Steam	1500 meters from Plot-B
4.	DM water	300 meters from Plot-A

5.	Service Water	300 meters from Plot-A
6.	Fire Hydrant	300 meters from Plot-A
7.	Treated Effluent	1500 meters from Plot-A