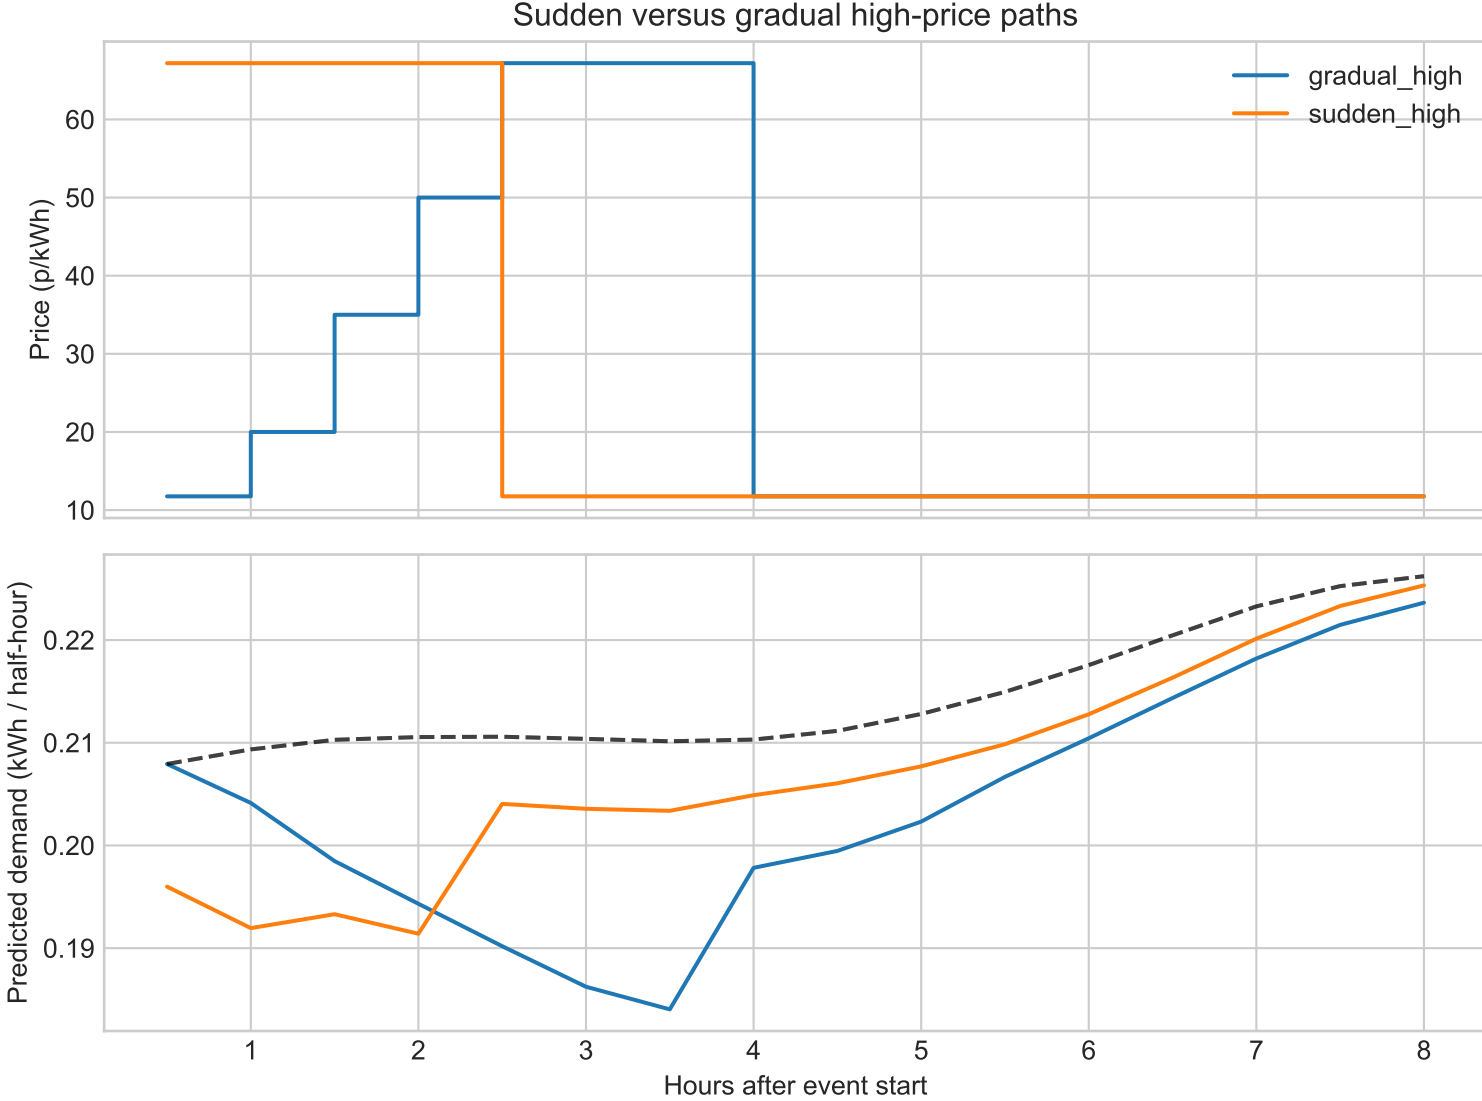
Sudden versus gradual high-price paths
gradual_high
sudden_high
Price (p/kWh)
60
50
40
30
20
10
Predicted demand (kWh / half-hour)
0.22
0.21
0.20
0.19
1
2
3
4
5
6
7
8
Hours after event start