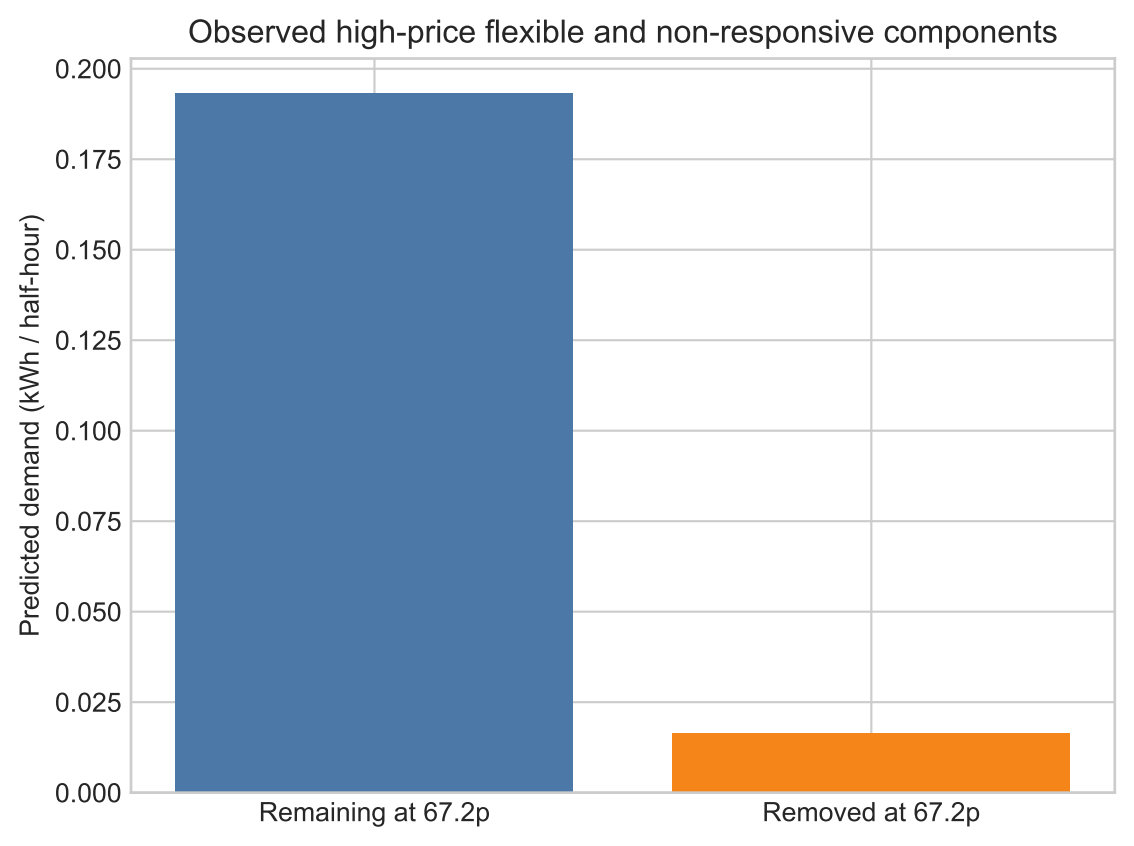
Observed high-price flexible and non-responsive components
Predicted demand (kWh / half-hour)
0.200
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
Remaining at 67.2p
Removed at 67.2p