


Sawtooth ICA component

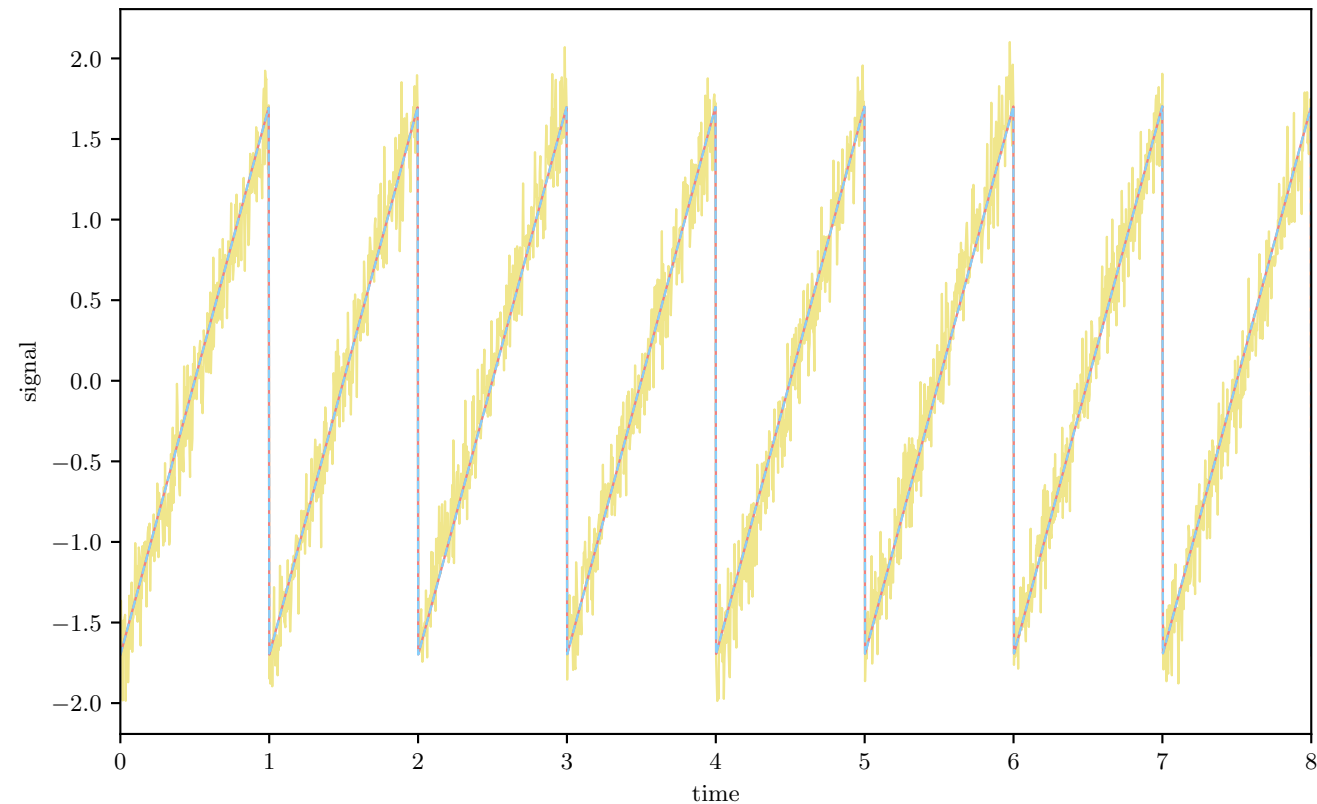

90% Confidence intervals:

$$\text{parameter estimators} = \left[q_{50\%} \right]_{q_{05\%} - q_{95\%}}^{q_{95\%} - q_{50\%}}$$

$$\text{Amplitude } A = 1.704^{+0.011}_{-0.011}$$

$$\text{Period } T = 1.0001^{+0.0002}_{-0.0001}$$

$$\text{Phase } \frac{\phi}{\pi} = 0.002^{+0.002}_{-0.001}$$

$$\text{Noise } \sigma = 0.177^{+0.005}_{-0.005}$$

True value of Period $T = 1.00$

Maxima A Posteriori:

$$(A = 1.70, T = 1.00, \phi = 0.00, \sigma = 0.18)$$