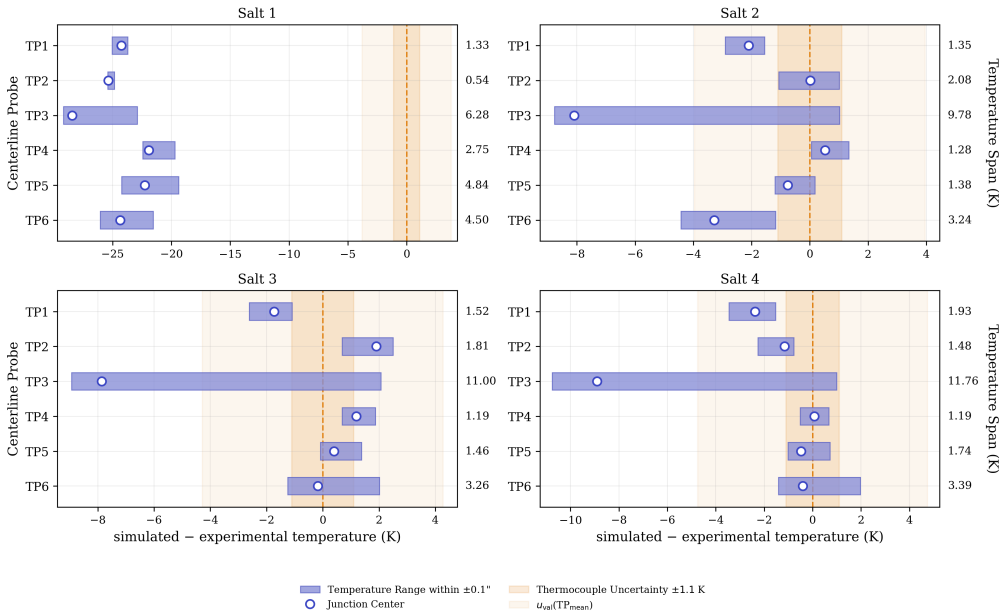


Figure 6.11: Position Sensitivity for Salt Centerline Probes

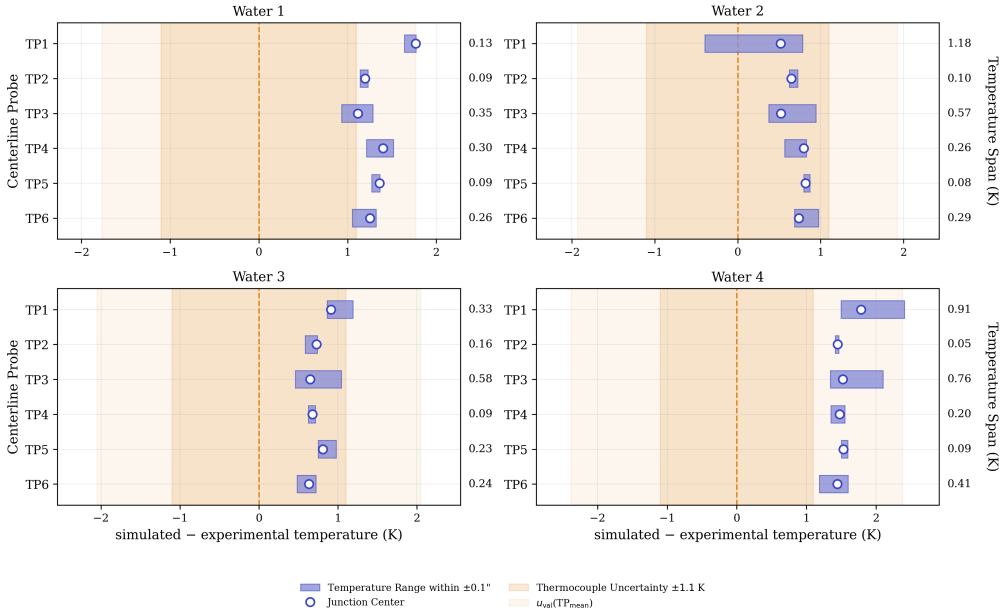


Figure 6.12: Position Sensitivity for Water Centerline Probes