

User Manual

CoreBus (version 3.5.1)

[Support the project](#)

andrey.abdulkayumov@gmail.com

Table of contents

Brief description.....	3
No protocol	5
Single send.....	6
Cyclic sending.....	6
Sending files.....	7
Modbus	8
Normal operation	9
Reading Modbus registers.....	9
Writing Modbus Registers	10
0x05 Write one flag.....	10
0x0F Write multiple flags	10
0x06 Write one register.....	11
0x10 Write multiple registers.....	11
Submissions	13
Modbus monitoring.....	14
Monitoring control field.....	15
List form of registers.....	16
Conversion by formula.....	17
Logging.....	18
Chart.....	19
Modbus scanner	20
Macros.....	22
Editing a Macro.....	23
Download link.....	27
Version history.....	28

Brief description

CoreBus (formerly known as “Terminal Program”) is a cross-platform terminal for working with serial ports and TCP sockets with support for Modbus TCP / RTU / ASCII protocols.

Main features of the application:

1. Three operating modes: “No protocol”, “Modbus” and “Modbus monitoring”.
2. "No protocol":
 - Working with data in string or byte format.
 - Support for different encodings.
 - Three sending modes: single, cyclic, file sending.
3. "Modbus":
 - Supports various variations of the Modbus protocol: TCP, RTU, ASCII and RTU / ASCII over TCP.
 - Convenient operation with recording functions.
 - Ability to work with float numbers.
 - Ability to work with binary data.
 - Modbus scanner that searches for devices on the communication line.
4. "Modbus monitoring":
 - Convenient display of registers.
 - Conversion to numeric types (Int16/32, float, etc.).
 - Conversions according to a given formula.
 - Plotting a chart in real time.
 - Logger.
5. Macros:
 - Separate macros for each operating mode.
 - A macro consists of an unlimited number of commands (actions).
 - For Modbus macros, it is possible to set a common Slave ID for the entire macro.
 - Import and export of macros.
6. Dark and light application themes.
7. Presets with custom settings.
8. User manual (Russian, English).

9. Multi-language interface support: Russian, English, Hindi, Chinese (Simplified), German, Spanish, French, Korean, Portuguese.
10. Cross-platform: Windows, Linux.

The application was tested on Windows 10/11, Linux Ubuntu.

A demonstration of the application can be viewed by following the [link](#).

No protocol

In the transfer field, the user writes the data that needs to be sent. The receive field contains the data sent by the server or external device. You can work with both bytes and string data in different encodings.


Supported protocols:

- UART
- TCP

There are three sending modes:

- Single
- Cyclic
- Files


The sending type is selected in the drop-down list in the upper right corner.

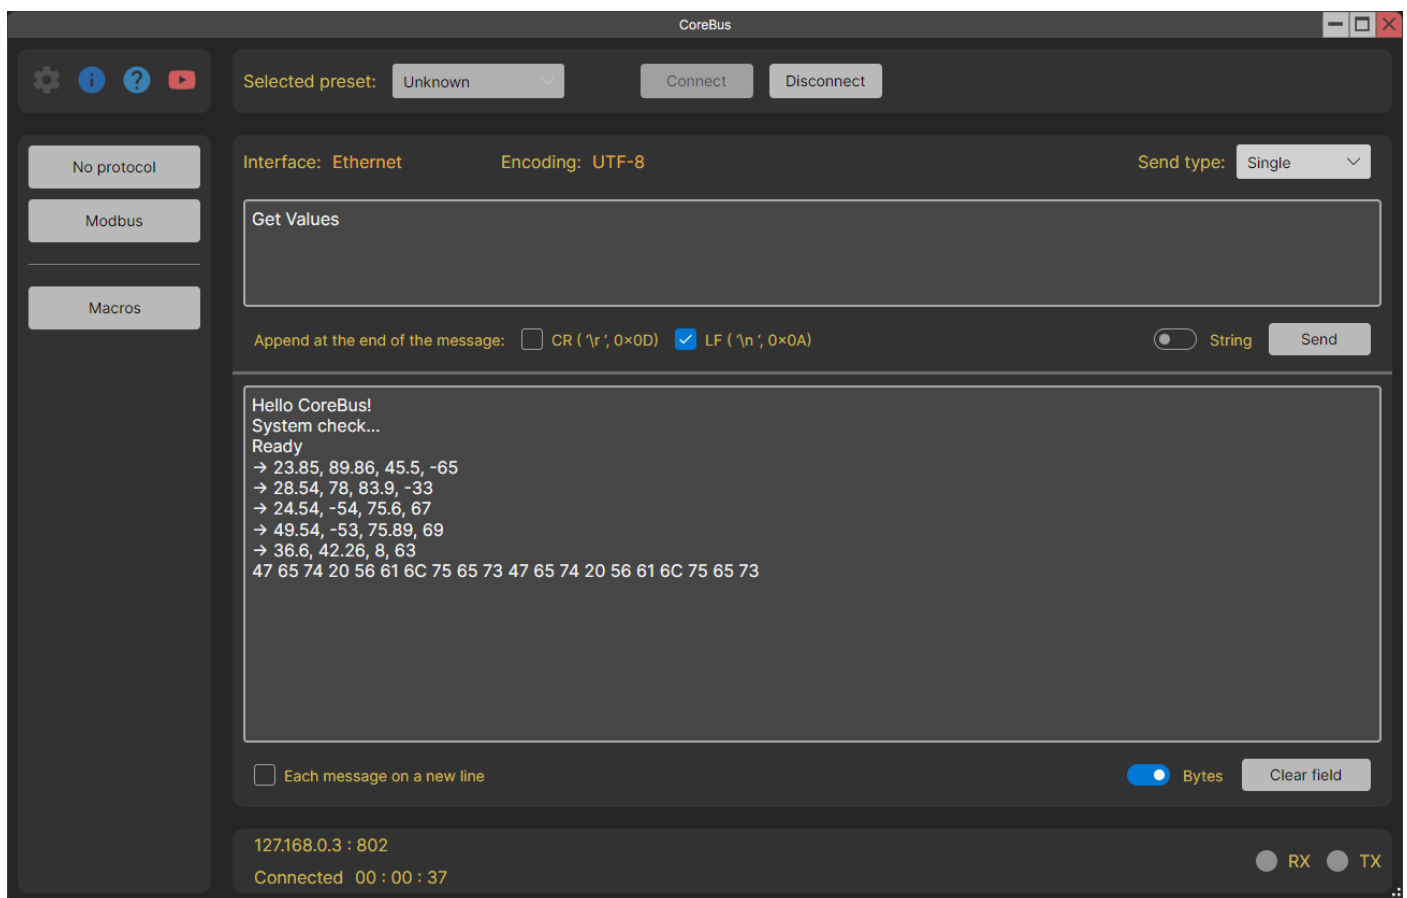

Single send

In this mode, you can send bytes or a string to the connected host. Sending occurs once by clicking on the “Send” button. You can also add special characters at the end of the message.

The string encoding is set in the mode settings.

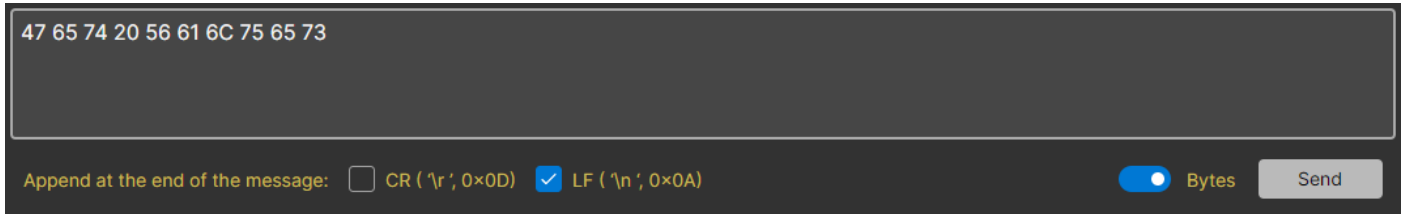


The interface for the 'Single send' mode. It features a large text input area at the top containing the hexadecimal string '47 65 74 20 56 61 6C 75 65 73'. Below the input area, there is a section for 'Append at the end of the message:' with two checkboxes: 'CR ('\r', 0x0D)' which is unchecked, and 'LF ('\n', 0x0A)' which is checked. To the right of these checkboxes is a toggle switch currently set to 'Bytes' (indicated by a blue dot), and a 'Send' button.

Cyclic sending

This mode allows you to send a message to the host automatically at a specified time interval.

The functionality of the “Request” line is similar to the normal mode of operation. And in the “Response” line, you can add service information to the message itself: the date the message was received in the format DD.MM.YYYY, time in the format HH:MM:SS, custom lines at the beginning and/or end of the message and service characters.

The string encoding is the same as in normal mode.

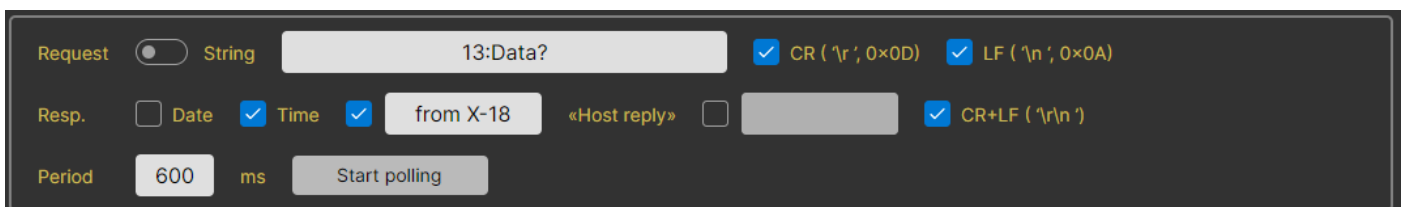


The interface for the 'Cyclic sending' mode. It is divided into three sections: 'Request', 'Resp.', and 'Period'. The 'Request' section has a toggle switch set to 'String', a text input field containing '13:Data?', and two checked checkboxes for 'CR ('\r', 0x0D)' and 'LF ('\n', 0x0A)'. The 'Resp.' section has three checkboxes: 'Date' (unchecked), 'Time' (checked), and a custom line input field containing 'from X-18'. There is also a checkbox for '«Host reply»' which is unchecked, and a checked checkbox for 'CR+LF ('\r\n ')'. The 'Period' section has a text input field for '600' and a unit selector set to 'ms', followed by a 'Start polling' button.

Sending files

This mode allows you to send files. The specified encoding is not used in this mode.

Files can be reused multiple times. They are added to a special folder, so they do not need to be added every time the application is launched.

While the file is being sent, the message “Sending file...” appears. Then she disappears.

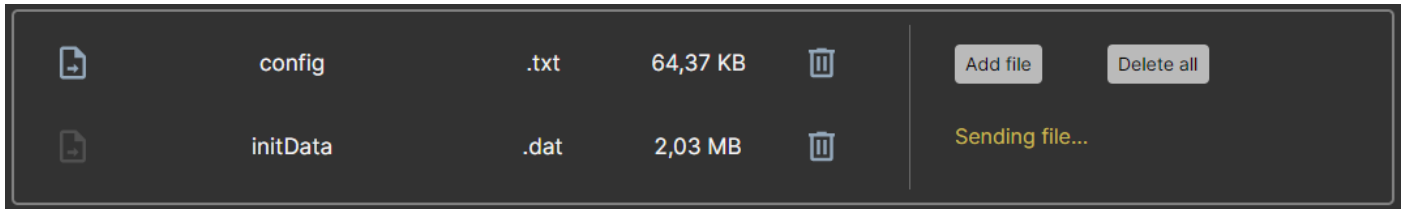

Important note!

Sometimes it may seem that the application is not accepting data in “No Protocol” mode. The receive field is empty or contains garbage, although the host sent meaningful data.

Explanation:

This may be because the Receive field's String/Bytes selector is set to display a string, and the host is sending a set of bytes that could not be converted to a string.

If string display is selected in this selector, the application attempts to convert all received bytes into a string of the specified encoding.

Solution:

Set the “String / Bytes” selector in the receive field to the “Bytes” state.

Modbus

The user can interact with selected Modbus registers using the appropriate interface elements. For further decryption of the transaction, there is a section with views.

Supported protocols:

- Modbus TCP
- Modbus RTU
- Modbus ASCII
- Modbus RTU over TCP
- Modbus ASCII over TCP

The screenshot shows the CoreBus Modbus interface. On the left, there are buttons for 'No protocol', 'Modbus', and 'Macros'. The main area displays a table of transactions with columns for ID, Function, Address, and Data. The 'Selected preset' is 'Unknown', and there are 'Connect' and 'Disconnect' buttons. The 'Protocol' is set to 'Modbus RTU'. On the right, there are configuration options for 'Number format' (hex/dec), 'Slave ID' (hex), 'Checksum', 'Address' (hex), 'Register count', and buttons for 'Read' and 'Write'. At the bottom, there is a section for 'Last request' and 'Exchange history' showing a hex view of the data. The status bar at the bottom indicates 'COM3 : 9600 : None : 8 : 1' and 'Connected 00 : 00 : 46'.

ID	Function	Address	Data
0	0x03 (read)	0x0 (0)	0x1234 (4660)
1	0x04 (read)	0x23 (35)	Modbus error. Code: 2
2	0x0F (write)	0x4 (4) 0x5 (5) 0x6 (6)	0 1 0
3	0x06 (write)	0x1 (1)	0x4FDA (20442)
4	0x10 (write)	0x2 (2) 0x3 (3)	0x1234 (4660) 0x6656 (26198)

Number format: ☒ hex ☐ dec

Slave ID (hex): 7 ☒ Checksum

Address (hex): 2 Register count: 1

0x04 Read input registers

0x06 Write single register

4FDA hex

Last request Exchange history Binary representation Float value

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
Request	07	10	00	02	00	03	06	12	34	66	56	56	87	7D	60
Resp.	07	10	00	02	00	03	21	AE							

COM3 : 9600 : None : 8 : 1

Connected 00 : 00 : 46

RX TX

Normal operation

During normal operation, Modbus registers can be read or written.

The “Number Format” switches change the number format in the “Slave ID” and “Address” fields. The selected format is indicated in brackets next to these fields.

The screenshot shows a dark-themed interface with the following elements:

- Number format:** Two radio buttons, "hex" (selected) and "dec".
- Slave ID (hex):** A text input field containing "7" and a checked "Checksum" checkbox.
- Address (hex):** A text input field containing "2".
- Register count:** A text input field containing "1".
- Function code:** A dropdown menu currently showing "0x04 Read input registers".
- Action buttons:** "Read" and "Write" buttons.
- Data field:** A large text input field containing the hexadecimal value "4FDA".
- Format selector:** A dropdown menu currently showing "hex".

This mode is the richest in functionality, so let's look at it in more detail.

Reading Modbus registers

Select the function, start address, register count and press the “Read” button.


This close-up view highlights the configuration for reading registers:

- Address (hex):** Input field with "2".
- Register count:** Input field with "1".
- Function code:** Dropdown menu set to "0x04 Read input registers".
- Action:** The "Read" button is visible.

Writing Modbus Registers

Each function has its own design option. The starting address for all functions is the value from the "Address" field.


0x05 Write one flag

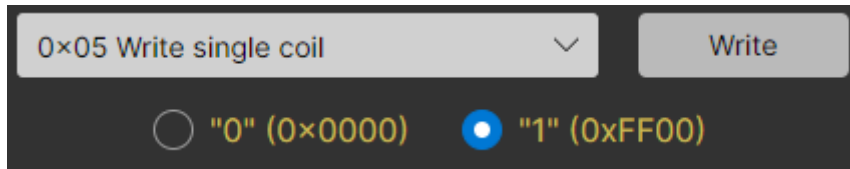

The screenshot shows a software interface for writing a single coil. At the top, there is a dropdown menu with the text "0x05 Write single coil" and a downward arrow. To the right of the dropdown is a button labeled "Write". Below the dropdown, there are two radio button options: "0" (0x0000) and "1" (0xFF00). The "1" option is selected, indicated by a blue dot in the center of the radio button.

According to the protocol documentation, the data field must contain only one of two values. 0x0000 is a logical zero, and 0xFF00 is a logical one. Therefore, select the desired value and press the "Write" button.

0x0F Write multiple flags

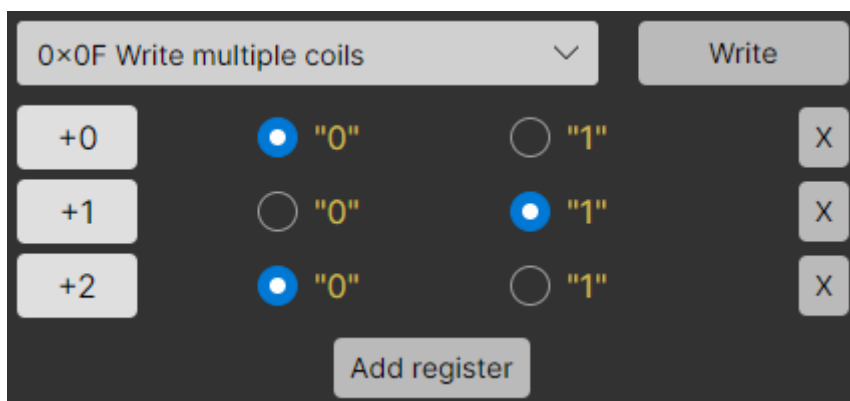

The screenshot shows a software interface for writing multiple coils. At the top, there is a dropdown menu with the text "0x0F Write multiple coils" and a downward arrow. To the right of the dropdown is a button labeled "Write". Below the dropdown, there is a table with three rows. Each row has an offset value in a box on the left, two radio button options in the middle, and a delete button (labeled 'X') on the right. The first row has offset "+0", with "0" selected. The second row has offset "+1", with "1" selected. The third row has offset "+2", with "0" selected. At the bottom of the table is a button labeled "Add register".


Offset	0 (0x0000)	1 (0xFF00)	Delete
+0	☒	☐	X
+1	☐	☒	X
+2	☒	☐	X

Using the "Add register" button, we create the required number of flags, set the value and click the "Write" button.

To the left of the register values, we have offset values relative to the starting address.

On the right are delete buttons for each register.


0x06 Write one register

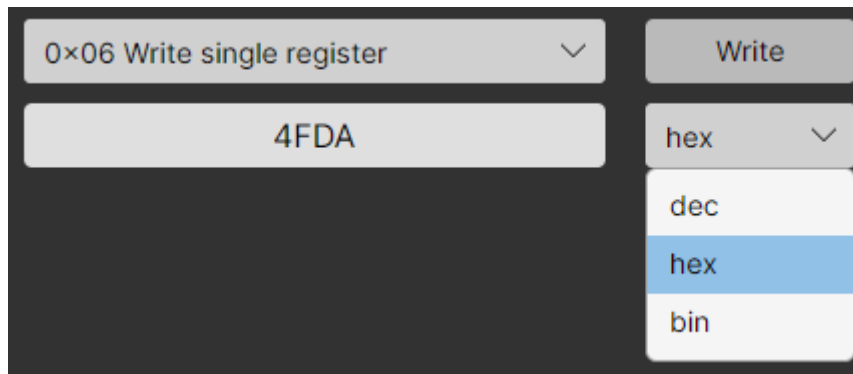

Using this function, you can write to 16-bit registers.

The format of the number to be written is selected in the drop-down list to the right of the input field. When changing the format, the number is automatically converted.

0x10 Write multiple registers

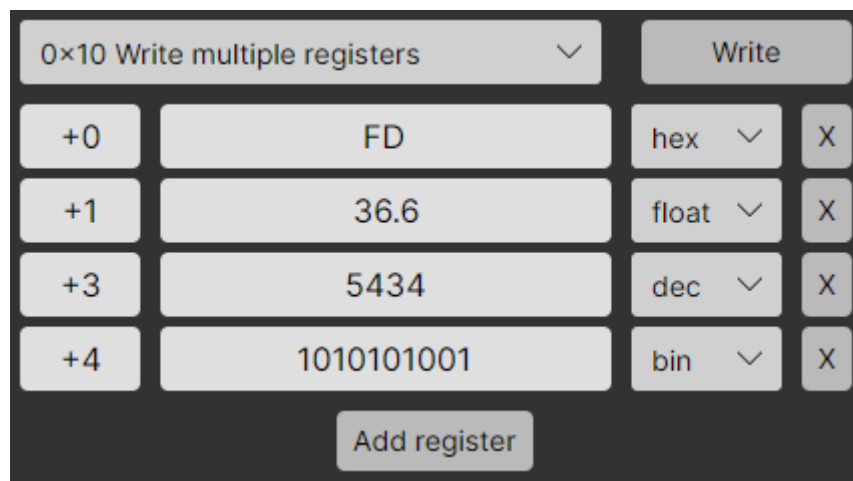

The control here is similar to the “0x0F Write multiple flags” function.

This function makes it possible to write numbers of the float type.

Such numbers occupy 2 words or 4 bytes. Therefore, the next register has an offset of not +1, but +2 addresses.

Sometimes it happens that a device may use an atypical format to decrypt float numbers. And to adapt to a specific device, you can select the desired recording format in the settings.

Settings

Preset: Unknown

Connection

No protocol

Modbus

Application

Write timeout

300

ms

Read timeout

300

ms

Log timestamp

Date and time

Float number format

AB CD (12 34 56 78)

BA DC (34 12 78 56)

CD AB (56 78 12 34)

DC BA (78 56 34 12)

Modbus mode settings page.

Submissions

You can simply view the register values in a table view. But unfortunately, these numbers do not always make sense. And sometimes they need to be “deciphered”. Therefore, for interpreting data, the terminal provides an area with views.

There are 4 types of views in total:

Last request

Exchange history

Binary representation

Float value

Request

Resp.

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17
07	04	00	00	00	06	70	6E									
07	04	0C	00	AC	FF	53	51	EC	41	00	3D	71	41	9C	78	46

Last request

Last request	Exchange history	Binary representation	Float value
16:32:26.771 → 07 04 00 00 00 06 70 6E			
16:32:26.782 ← 07 04 0C 00 AC FF 53 51 EC 41 00 3D 71 41 9C 78 46			
16:34:27.609 → 07 0F 00 00 00 02 01 02 DF 7C			
16:34:27.624 ← 07 0F 00 00 00 02 D4 6C			
16:34:35.597 → 07 06 00 00 4F DA 3C 07			
16:34:35.607 ← 07 06 00 00 4F DA 3C 07			

Exchange history

Last request	Exchange history	Binary representation	Float value
Address 0x00			
Value 0 1 0 1 0 0 1 1 0 1 0 0 0 0 1 0			
Address 0x01			
Value 0 0 0 0 0 1 0 0 0 1 0 0 0 1 0 0			

Binary representation

Last request	Exchange history	Binary representation	Float value
0x0000			
AB CD	6,244814E-39	AB CD	-6,360643E+34
BA DC	512	BA DC	1997
CD AB	9,5E-44	CD AB	1,4783099E-38
DC BA	2,4394E-41	DC BA	-1,0864843E-19
0x0002			
AB CD	-4,0375705E+36	AB CD	6,134182E-28
BA DC	126,45	BA DC	36,6
CD AB	5,453988E+23	CD AB	2,7162027E+23
DC BA	-2,7184498E+23	DC BA	2,7184077E+23
0x0004			
AB CD	1,1599296E-05	AB CD	1,1599296E-05
BA DC	45,9	BA DC	45,9
CD AB	-6,336859E-23	CD AB	-6,336859E-23
DC BA	-1,594997E-23	DC BA	-1,594997E-23

Representation of a float number

Modbus monitoring

A special mode designed for visual control of the connected device.

In this mode, Modbus registers are displayed, the values of which are updated with a specified period. For convenient display, these values can be converted to the selected type, converted using a formula and displayed on a graph.

The transition to it occurs by pressing the “Monitoring” switch in Modbus mode.

CoreBus

Selected preset: Unknown [Connect] [Disconnect]

Protocol: Modbus RTU [Clear data] [Scanner] [Monitoring]

Chart [x] [Stop polling]

Slave ID (hex) 7 Number format [hex] [dec] Period 200 ms

Poll function 0x04 Read input registers

Logging [Recording start: 06.05.2026 13:35:56]

☐	Address (hex)	Alias	Value (hex)	Typed value	Converted value	Chart / Log
☐	0	Counter	29C	668	UInt16	668 f(x) ☒
☐	1	Reverse counter	FD63	-669	Int16	-669 f(x) ☒
☐	6	Sin	7155	2,02	Float	14,06 f(x) ☒
☐	7		4001			
☒	4	Magic value	C28F	28,47	Float	76,47 f(x) ☐
☐	5		41E3			
☐	9	Random value	8AA1	35489	UInt16	35489 f(x) ☐

Add register

COM3 : 9600 : None : 8 : 1
Connected 00 : 01 : 54

RX TX

Globally, the working field is divided into two parts. The upper part is responsible for managing monitoring. And at the bottom there is a list of polled registers.


Important!

Registers are polled with a specified period. If the device fails to respond during the current polling cycle, the next polling cycle is skipped until a response is received or an error occurs. Thus, a situation is possible when the period is set to 10 ms, and the actual data update occurs at intervals of 150 - 200 ms.

Monitoring control field

It consists of three groups of elements. Let's look at them from left to right.

UI element management group.



At the top is a button that opens the chart.


Below is a button that deletes selected registers.

Monitoring settings group.

Here you can select the required polling parameters. As well as the number format that will be applied to the “Slave ID” field and the “Address” and “Value” fields in the list of registers.

A logging group that has two states.


Inactive.

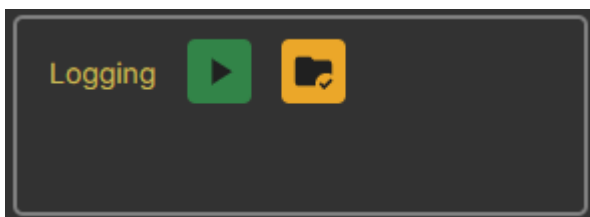

There are only two buttons here.

On the left is a button to start logging, and on the right is a button to open a folder with logs.

Active.

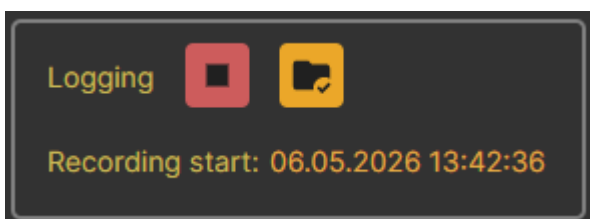

The start button turns into a stop logging button.

And the date and time the recording started appears at the bottom.

List form of registers

Each line is one 16-bit Modbus register.

Let's look at the list elements using this example.

☐	Address (hex)	Alias	Value (hex)	Typed value	Converted value	Chart / Log		
☐	2	Magic value	C28F	4,68	Float	52,68	f(x)	☒
☒	3		4095					

The checkmarks on the left mark the case for deletion or simply for visual highlighting among other elements of the list. The register with address 3 is highlighted in the picture.

1. Address

Contains the address of the register. May be in HEX or DEC format.

2. Alias

An arbitrary symbolic name. If it is empty, then on the graph and in the log the register will have the name “Address + address value”.

For example, “Address 3”, “Address 75”, etc.

3. Value

"Raw" register value. May be in HEX or DEC format.

4. Typed value

A register value cast to one of the available types. If the type takes up more than 16 bits, then the following values are also captured during conversion (as in the picture).

For example, the float type takes up 32 bits, which means that two Modbus registers are required to convert a value to this type.

5. Converted value

A typed value converted using a given formula. The formula is specified in a window that opens by clicking on the “f(x)” button. See below for more details.

In the example in the picture the formula is “0.5*x”.

6. Chart / Log

This selection means that the converted value of this register will be displayed on the chart and written to the log.

Values in the “Value”, “Typed value”, and “Converted value” columns are highlighted if they have changed since the last polling iteration.


The values above have been changed and are therefore “highlighted”.

Value (hex)	Typed value		Converted value	
2B46	11078	UInt16 ▾	11126	f(x)
4095	16533	UInt16 ▾	16533	f(x)


Conversion by formula

A custom formula converts the value from the “Typed value” column and writes it to the “Converted value” column. By default, the formula is "x", i.e. the field contains a copy of the value from the “Typed value” column.

Formula editing is available in the inactive state. And during a polling, only viewing is allowed.

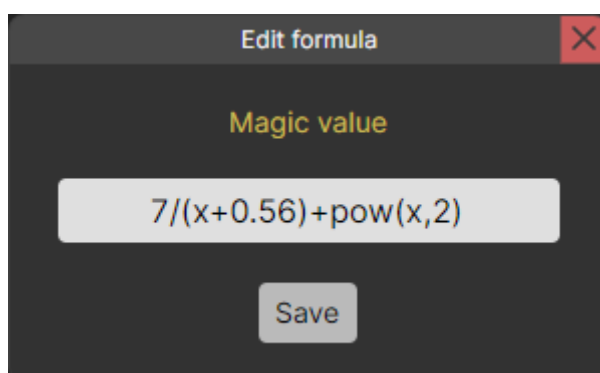

You can also view the formula by hovering the cursor over the “f(x)” button.

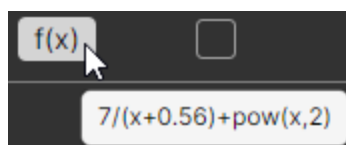

Important!

Trigonometric functions take an argument and return a result in radians.

Logging

The application supports logging function. You can start and stop it at any time using the buttons in the monitoring control field (see above).

Only those registers that have the “Chart / Log” checkbox checked in the list of registers are written to the log. The values are taken from the “Converted value” column and stored in full form - without rounding, as a double number.

The log file is saved in .txt format. You can add a timestamp to each entry. Its format is configured in the “Settings” → “Modbus” → “Log timestamp” section.

Several label formats are available:


- None
- Time only
- Date and time
- ISO 8601

The default format is “Date and Time”.

Chart

The application can build a chart in real time.

The chart displays only those registers that are marked with the “Chart / Log” checkbox in the register list form. The values are taken from the “Converted value” column.

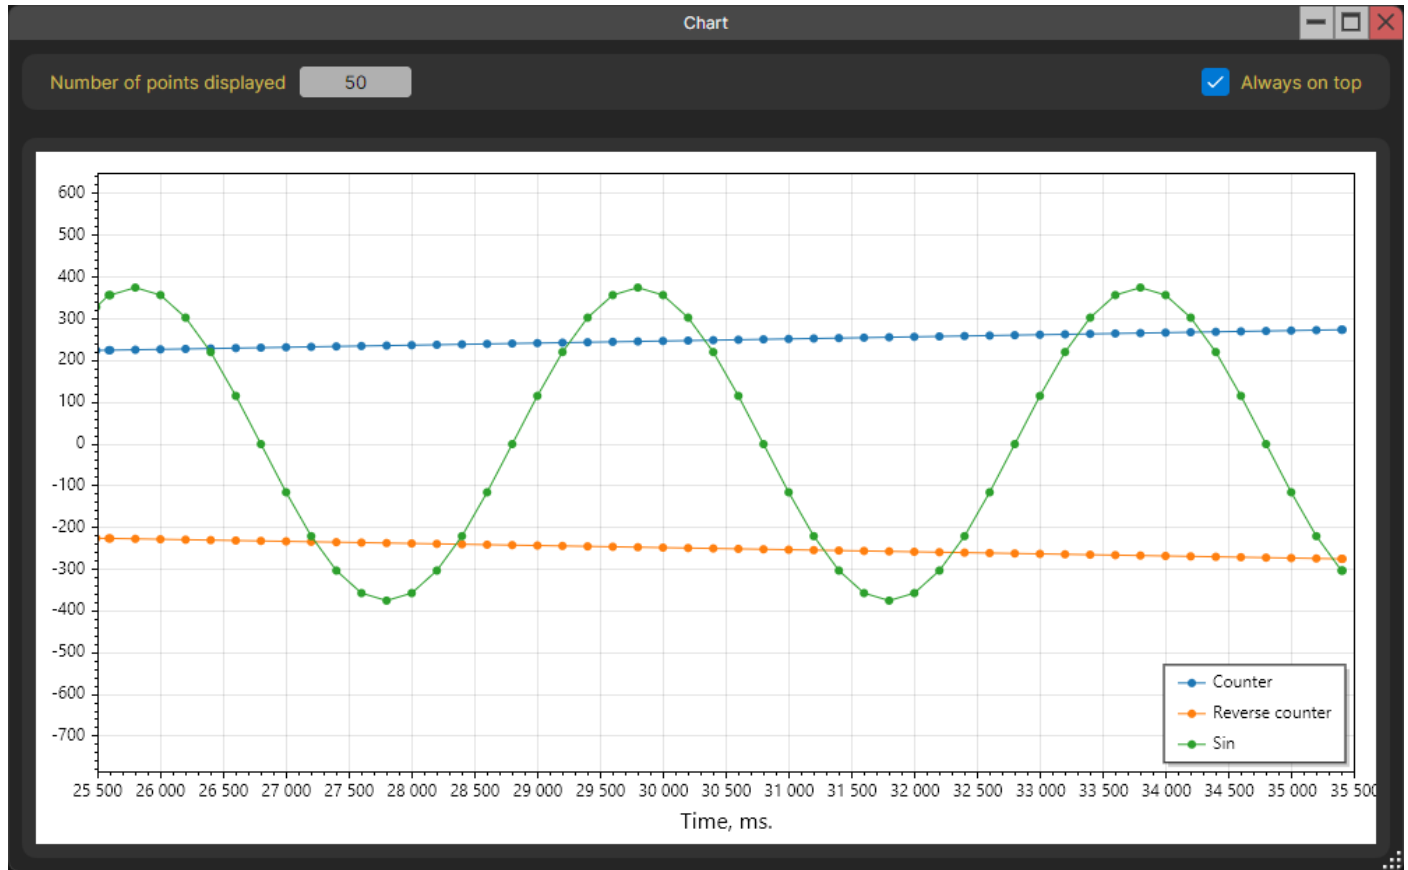

Only two settings are available to the user:

- Select the number of points to be displayed.
- Placement of the chart window on top of all windows.

Both settings are remembered after closing the application.

Modbus scanner

The Modbus scanner is used to search for slave devices on the communication line. This function is only available when connected via a serial port, because when connecting via TCP/IP, it makes no sense.

The search can take place via the Modbus RTU or Modbus ASCII protocol. The protocol type is selected in the drop-down list.

The “Devices” field will display the addresses of the found devices. If after the end of the search this field is empty, this means that no device responded in the entire range of valid addresses (1 - 255). Broadcast address 0 is not taken into account because according to the documentation, devices should not respond to it.

The top right field indicates the PDU that is being queried.

It is important to understand how the pause between sending messages works. This pause consists of two components - a user timeout, which is indicated in the “Pause” field, and a read timeout, during which the application waits for a response from the device. The reading timeout is set in the settings.

Important!!!

It is possible that after polling all addresses, the “Devices” field is empty. At the same time, it is reliably known that there are properly functioning devices on the communication line.

This could be due to two reasons:

1. For some reason, the slave device did not have time to process the message and send a response. In such cases, it is recommended to increase the user timeout in the “Pause” field.
2. The device you are looking for does not respond to the specified polling function. You can try to search for it by selecting any other function in the “Function template” drop-down list.

Modbus scanner

Devices

Search request PDU

03 00 01 00 02

Function template0x03

ProtocolModbus RTU

Pause200ms

Read timeout300ms

Start search

Inactive state

Modbus scanner

Devices

Slave ID:
dec: 42
hex: 2A

Slave ID:
dec: 98
hex: 62

Slave ID:
dec: 182
hex: B6

Search request PDU

03 00 01 00 02

Function template0x03

Current ID: 196 (0xC4)

77%

ProtocolModbus RTU

Pause200ms

Read timeout300ms

Stop search


Search state

Macros

The application allows for working with macros. They are available for all modes. Macros support sending multiple messages at once.

All macros are presented on the workspace in the form of buttons with appropriate names. When you hover over any of the macros, edit and delete buttons appear.

It is also possible to import and export a macro file for each mode. This is convenient to use when you need to transfer macros to several PCs.

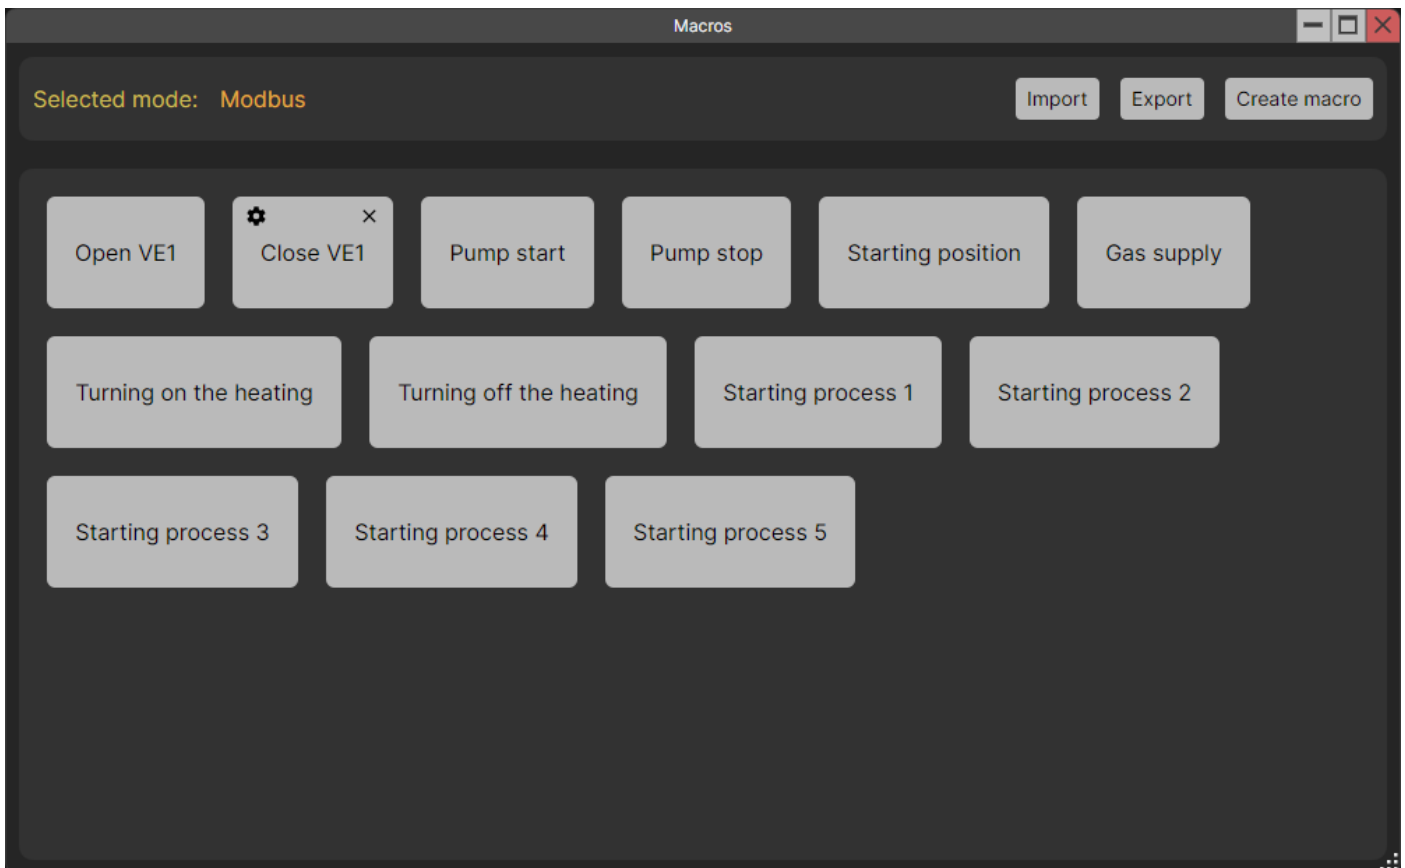

Editing a Macro

The macro is divided into commands. Each command is sending one message.

When you open the macro editing window, the original window with the work field is hidden. And after closing the editing window, it appears again. This is made for more independent work with windows.

In editing mode, it is possible to send individual commands or the entire macro. For this purpose, there are corresponding buttons in the macro header and for each command in the list form.

The working field is divided into four parts.


At the top there is a field for editing the name of the macro, and to the left of it there are buttons for saving and running the macro. Before saving or launching, a check occurs. If there are errors, a message appears listing all the errors found.

The lower part is divided in half. On the left there is a list with all the macro commands and a button to add a command, and on the right there is a form for editing the selected command. The command being edited is highlighted in the list.

For the “Modbus” mode, it is possible to set a common Slave ID for the entire macro.

The screenshot shows the 'Edit macro' window. At the top, there's a title bar 'Edit macro' with a close button. Below it, a 'Name' field contains 'Extended Macro'. To the left of the name field are a save icon and a play icon. Below the name field, there's a checkbox 'Use a single Slave ID for the whole macro' which is checked. Below that, a 'Slave ID' field contains '2', and radio buttons for 'hex' (selected) and 'dec'. Below this, there's a list of commands: 'ADC Configuration', 'Setting up the relay unit' (highlighted), and 'Filling in system data'. Each command has a play icon, a settings gear icon, and a delete 'X' icon. At the bottom of the list is an 'Add command' button. To the right of the list, there's a detailed view of the selected command 'Setting up the relay unit'. It has a 'Command name' field with the same text. Below that, a 'Number format' section with 'hex' (selected) and 'dec' radio buttons. Then, a 'Using a single Slave ID' checkbox (checked) and a 'Checksum' checkbox (checked). Below that, a 'Start address (hex)' field with '0'. Then, radio buttons for 'Read' and 'Write' (selected). Below that, a dropdown menu showing '0x06 Write single register'. At the bottom, a field contains the hex value '1000010101011' and a dropdown menu showing 'bin'.

Let's look at the elements of each command from the list.



From left to right.

- **Command launch button.**
If the command contains no errors and the host is connected, the message will be sent. Otherwise, a message will appear describing the error.
- **Field with the command name.**
It is only available for selection and copying. The command name can only be changed in the editing form.
- **Button to open/close the command editing form.**
The command being edited is highlighted in the list. You can also, without closing the edit form for the current team, click on the same button for another team and edit it.
- **Delete command button.**
You can't just delete it; you need to confirm the deletion in the dialog box.

Each operating mode has its own command editing form. Let's look at them separately.

"No protocol" mode command

The interaction in this window is similar to the usual “No protocol” mode.

Important!

The encoding of a string in a macro is autonomous.

It does not depend on the general encoding specified in the application settings.



The image shows a configuration window for a "No Protocol" mode command. The window has a dark background with light-colored text and controls.

- Command name:** A text field containing "No Protocol" mode command.
- Encoding:** A dropdown menu set to "UTF-32".
- String:** A toggle switch that is currently turned off.
- Message content:** A large text area containing the text "15:TEMP?".
- Append at the end of the message:** A section with two checked checkboxes:
 - ☒ CR ('\r' ; 0x0D)
 - ☒ LF ('\n' ; 0x0A)


Modbus mode command

The control in this window is also similar to the usual “Modbus” mode.

Important!

The format of a float number in a macro is self-contained.

It does not depend on the format selected in the application settings.

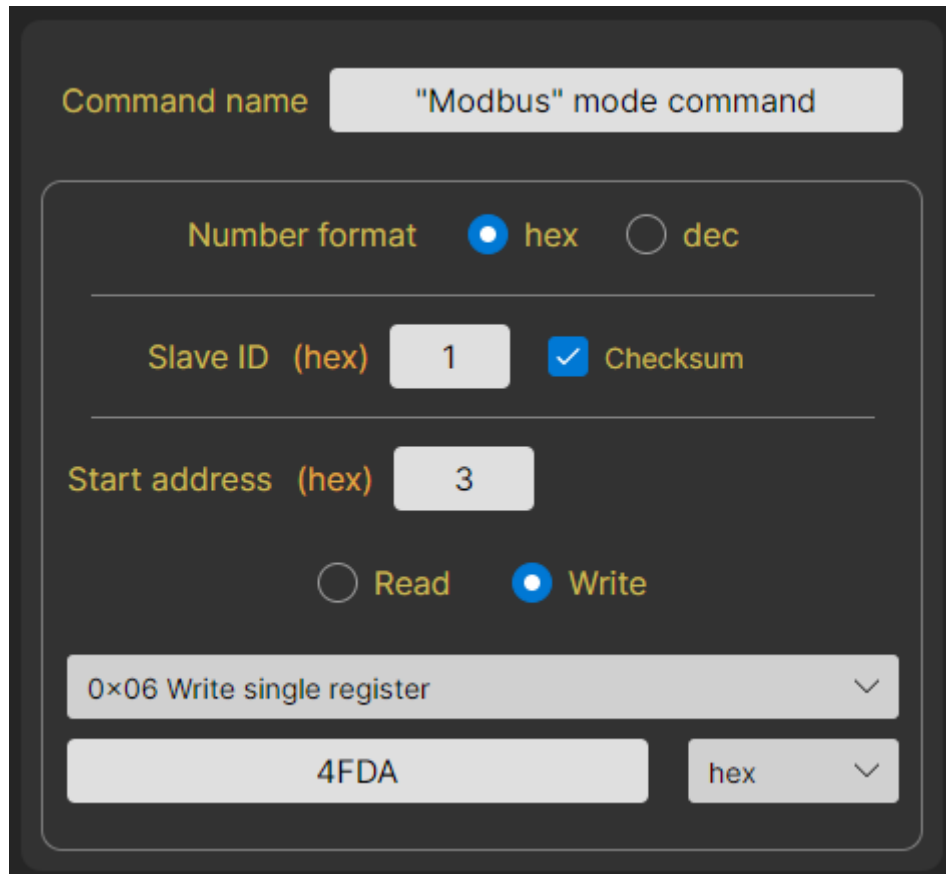

The image shows a configuration window for a Modbus mode command. It has a dark background with light-colored text and controls. At the top, the 'Command name' is set to '"Modbus" mode command'. Below this, there's a section for 'Number format' with radio buttons for 'hex' (selected) and 'dec'. A horizontal line separates this from the 'Slave ID (hex)' field, which contains the value '1', and a checked 'Checksum' checkbox. Another horizontal line follows. The 'Start address (hex)' field contains the value '3'. Below this are radio buttons for 'Read' and 'Write', with 'Write' being selected. A dropdown menu shows '0x06 Write single register'. At the bottom, there's a text field containing '4FDA' and a dropdown menu set to 'hex'.

Command name "Modbus" mode command

Number format ☒ hex ☐ dec

Slave ID (hex) 1 ☒ Checksum

Start address (hex) 3

☐ Read ☒ Write

0x06 Write single register

4FDA hex

Download link

[All versions are here.](#)

Version history

3.5.1

Enhancements:

- Added support for Korean and Portuguese languages.

Bug fixes:

- When writing multiple flags (function 0x0F), the last byte of data was lost if it was equal to 0.
- Fixed incorrect display of float numbers in Modbus monitoring mode.

3.5.0

Enhancements:

- Added support for multiple interface languages: Russian, English, Hindi, Chinese (Simplified), German, Spanish, French.

3.4.0

Enhancements:

- Modbus: monitoring mode added.
- Modbus scanner: added templates for polling functions.
- Minor fixes and refactorings.

3.3.3

Enhancements:

- Now, when working with macros, only one window is used (working field or editing). The unused window is hidden.
- Refactoring Unit tests.

3.3.2

Enhancements:

- Modbus: now if a timeout is triggered, the contents of the request are displayed.
- The functionality of the "About Application" window has been expanded.

Bug fixes:

- Rare freeze when writing/reading Modbus.
- Continues cyclic polling if an error occurs.
- Incorrect display of the number of Modbus registers written after sending a macro command.
- When sending individual macro commands, a single Slave ID is not taken into account.
- When using a single Slave ID, errors from the Slave ID fields of commands are taken into account in the macro.

3.3.1

Changes:

- The Modbus scanner has added a choice of protocol (Modbus RTU or Modbus ASCII), which is used to search for devices.
- Shortened some names in the UI.

3.3.0

Changes:

- Added the ability to use a single Slave ID for a Modbus macro.
- Now all errors that appear when running a macro are collected into a single message, rather than being shown separately.
- Improvements have been added to make working with the macro window more convenient.
- Fixed a bug with getting an incorrect path when selecting a folder or file.
- Optimizations.
- Refactoring.

3.2.1

Changes:

- MessageBox now has icons that depend on the type of message.
- An “Error Report” has become available in the MessageBox, which appears for messages with an error type. The report can be viewed in a separate window, copied to the clipboard or to a text file.

3.2.0

Changes:

- Work with macros has been expanded. The macro is divided into commands. Now you can send multiple messages at once in one macro.
- DI has been introduced into the project.
- Refactoring. Reduced connectivity between components.
- Minor bugs fixed.

3.1.0

Changes:

- Added support for Modbus RTU over TCP.
- Added support for Modbus ASCII over TCP.
- Added the ability to work with bytes in the "No protocol" mode.
- Added macros.
- Added user manual.
- Bug fixes, minor improvements and refactorings.

3.0.0

Changes:

- The project has been moved from WPF to AvaloniaUI.
- Changed design.
- Added Modbus scanner.
- Modbus: Each recording function has its own design option.
- Modbus: added exchange history maintenance.
- Modbus: added the ability to work with binary data.
- Modbus: added the ability to work with float data.
- Errors in version 2.7.0 have been fixed.

2.7.0

Changes:

- First public version.