
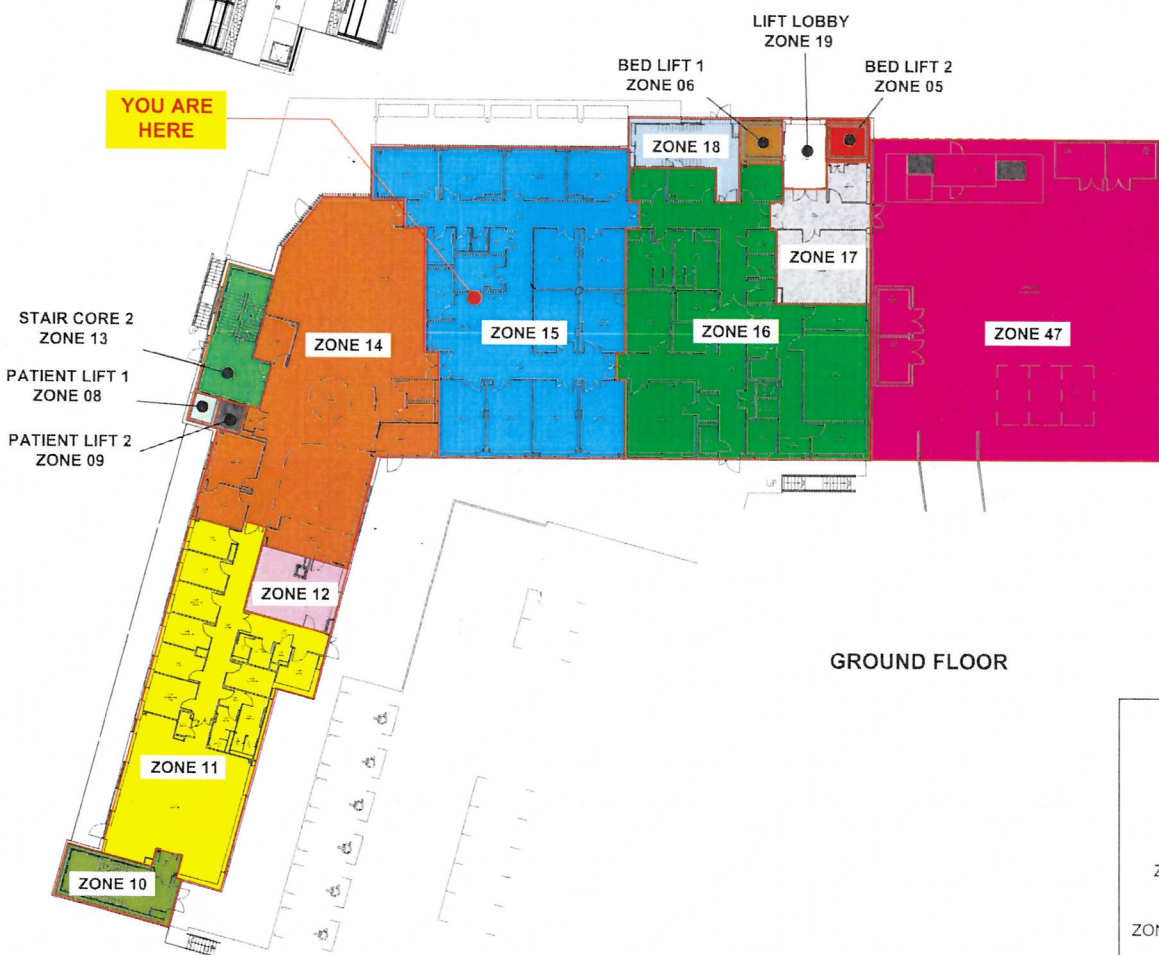
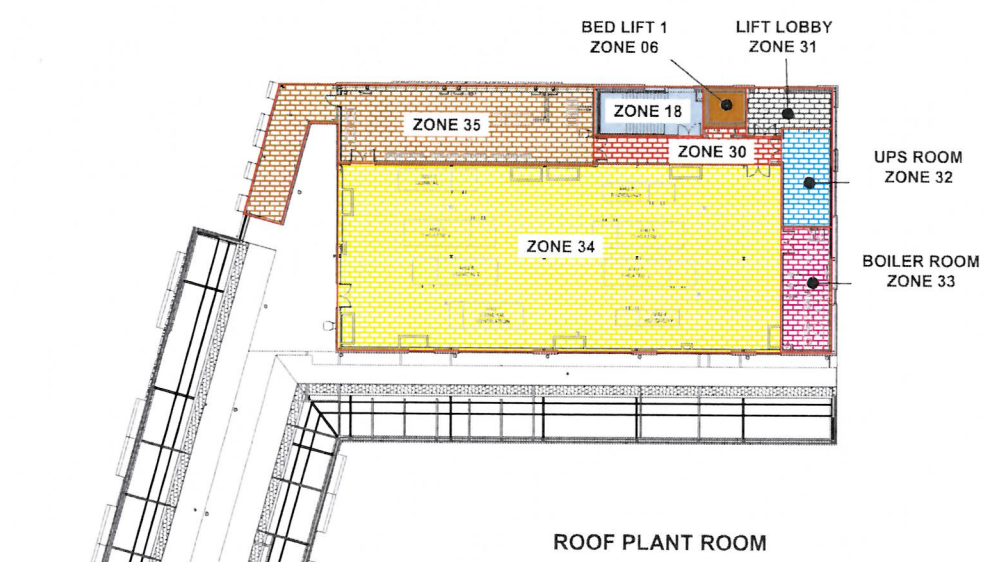


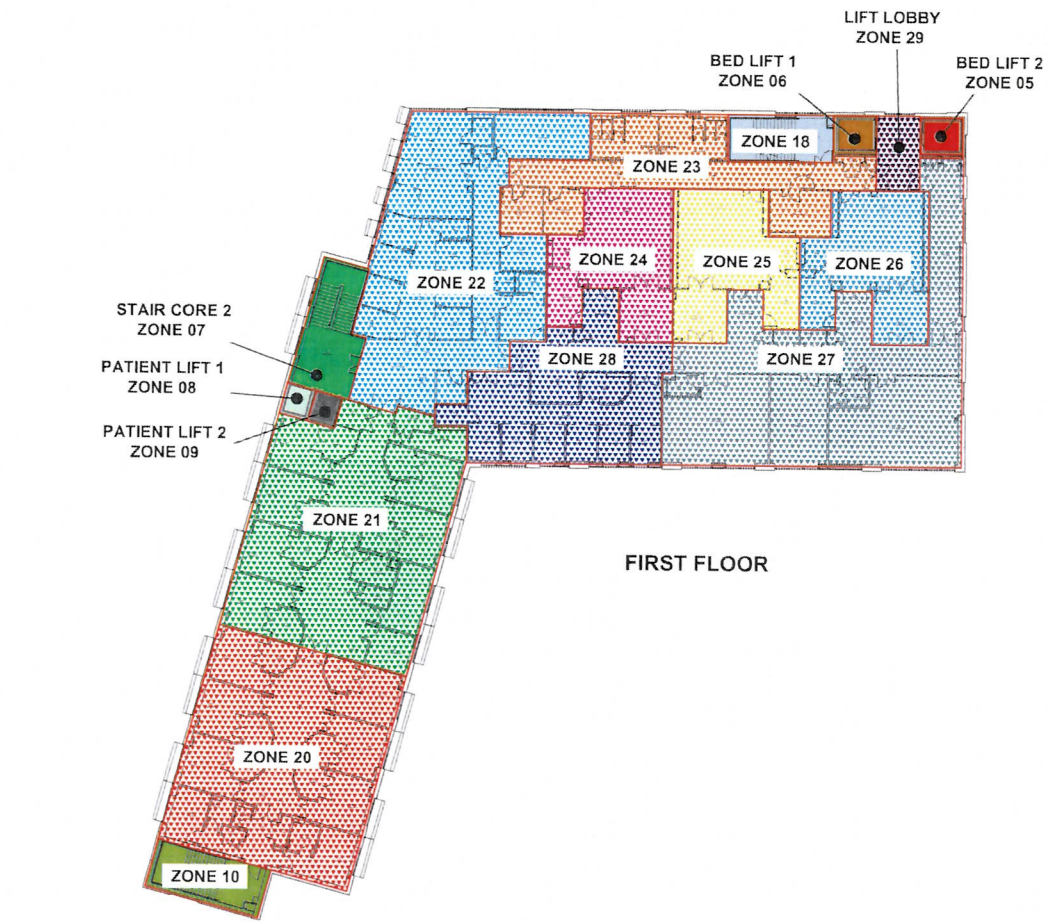

ZONES NOT SHOWN ON DRAWING:

ZONE 04 - BASEMENT SPRINKLER SYSTEM
 ZONE 36 - GROUND FLOOR SPRINKLER LINK
 ZONE 37 - FIRST FLOOR SPRINKLER LINK
 ZONE 38 - PLANT ROOM SPRINKLER LINK
 ZONE 39 - AHU 3 (THEATRE 1) DUCT PROBE SENSORS
 ZONE 40 - AHU 1 (THEATRE 2) DUCT PROBE SENSORS
 ZONE 41 - AHU 2 (THEATRE 3) DUCT PROBE SENSORS
 ZONE 42 - AHU 4 (RECOVERY WARD) DUCT PROBE SENSORS
 ZONE 43 - AHU 5 (CLINICAL 1) DUCT PROBE SENSORS
 ZONE 44 - AHU 6 (CLINICAL 2) DUCT PROBE SENSORS
 ZONE 45 - AHU 7 (GENERAL VENTILATION) DUCT PROBE SENSORS
 ZONE 46 - AHU 8 (RADIOLOGY) DUCT PROBE SENSORS

FIRE ALARM ZONE CHART

PLEXUS
Fire & Security

PLEXUS FIRE AND SECURITY
 PICTON HOUSE, BAILEY COURT
 FFORESTFACH, SWANSEA, SA5 4DE
 TEL: 01792 561333
 WWW.PLEXUSFS.CO.UK

Lorne Stewart
Engineering

Site Details SANCTA MARIA HOSPITAL LANGDON ROAD, SWANSEA, SA1 8QY			
Drawing Title SANCTA MARIA HOSPITAL FIRE ALARM ZONE CHART			
Panel Number NODE 2	Site ID: 102788	Drawn By GH	Checked ME
Drawing No 703001/1384/FAZ/002		Rev A	