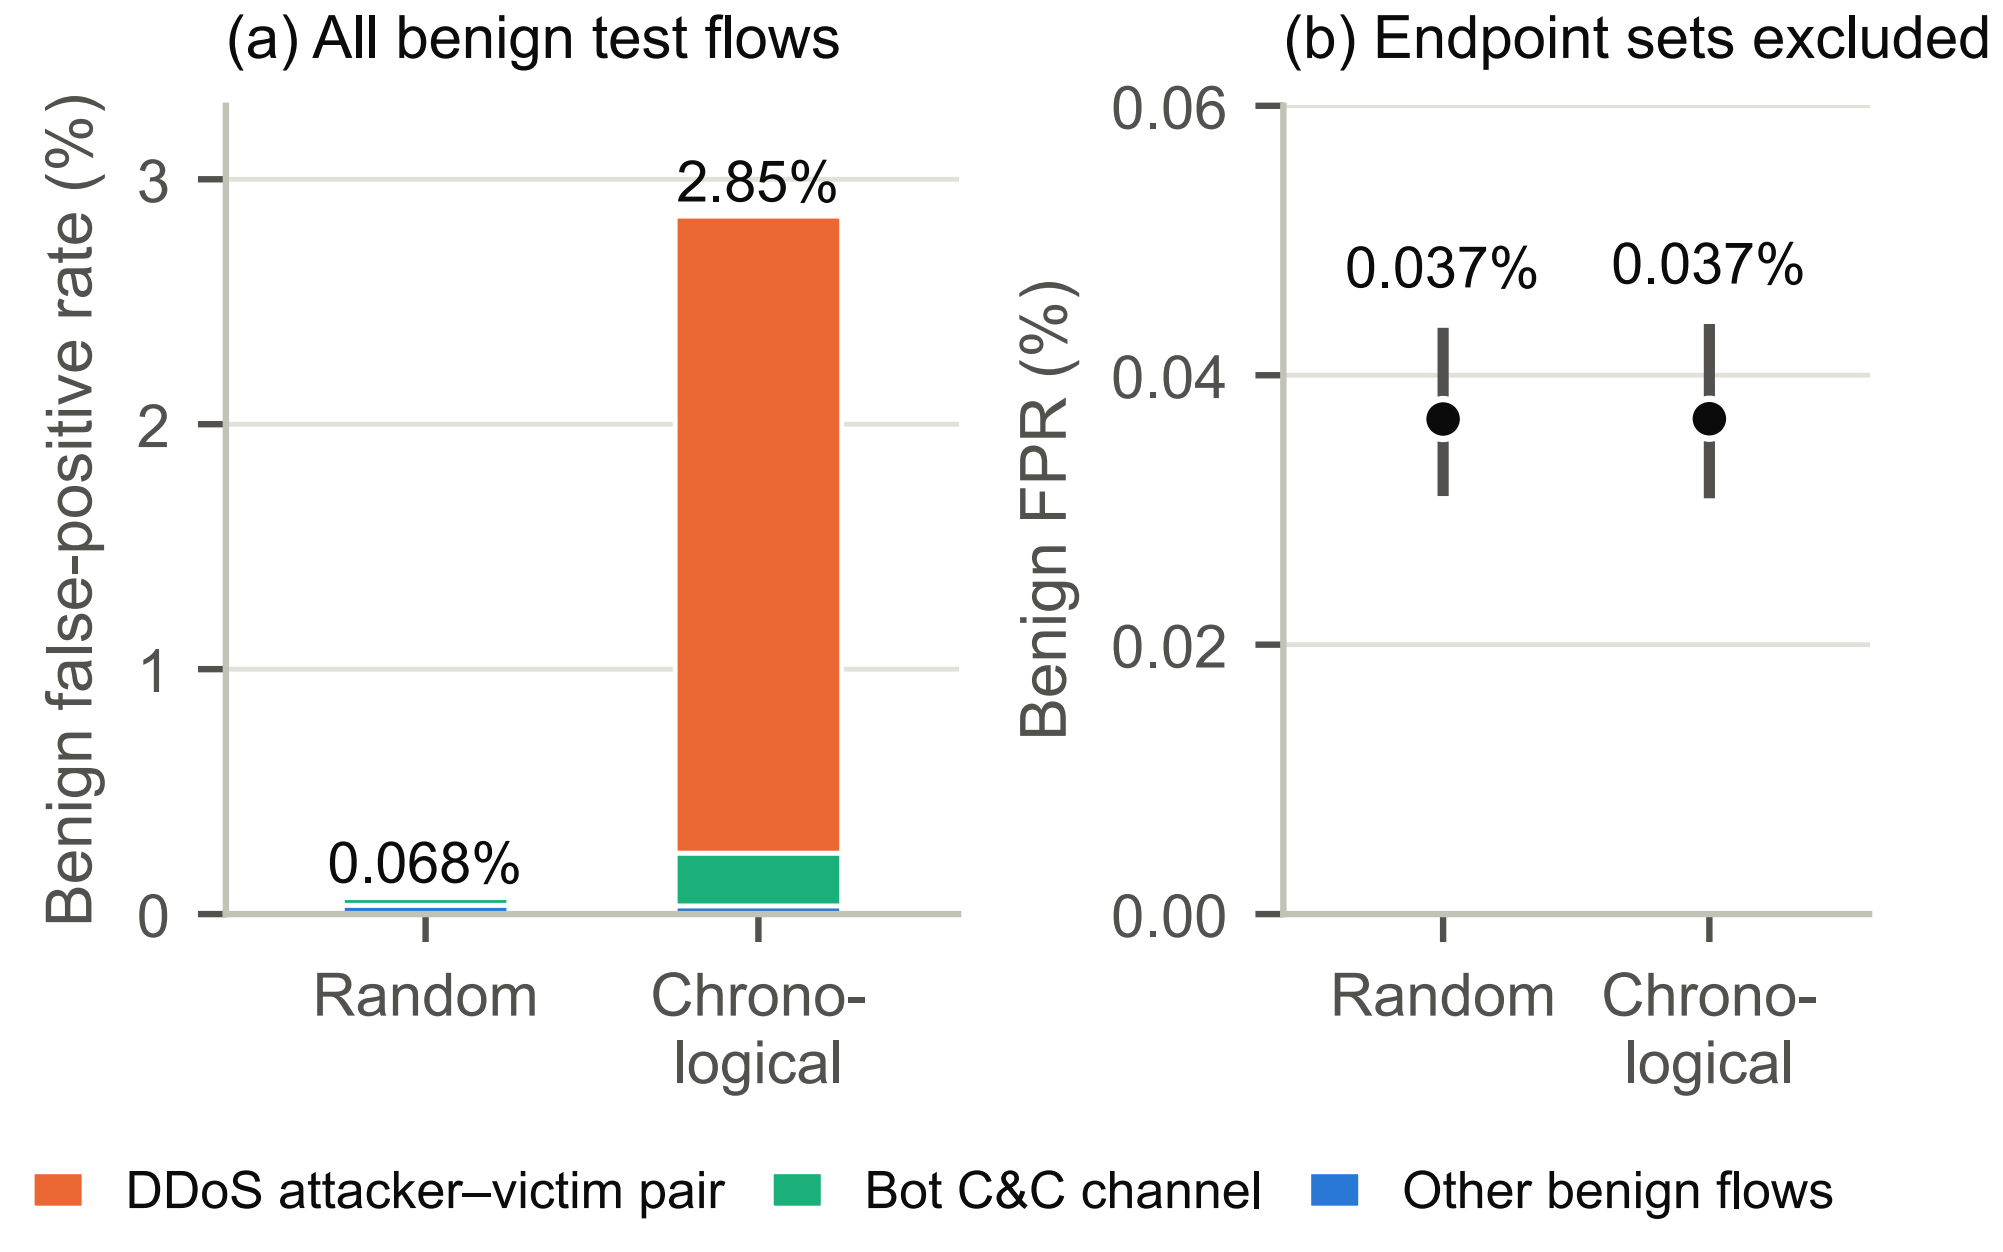
(a) All benign test flows
Benign false-positive rate (%)
3
2
1
0
2.85%
0.068%
Random
Chrono-
logical
(b) Endpoint sets excluded
Benign FPR (%)
0.06
0.04
0.02
0.00
0.037%
0.037%
Random
Chrono-
logical
DDoS attacker–victim pair
Bot C&C channel
Other benign flows