


# Cooling Control - CHW Valve

## Enable Conditions

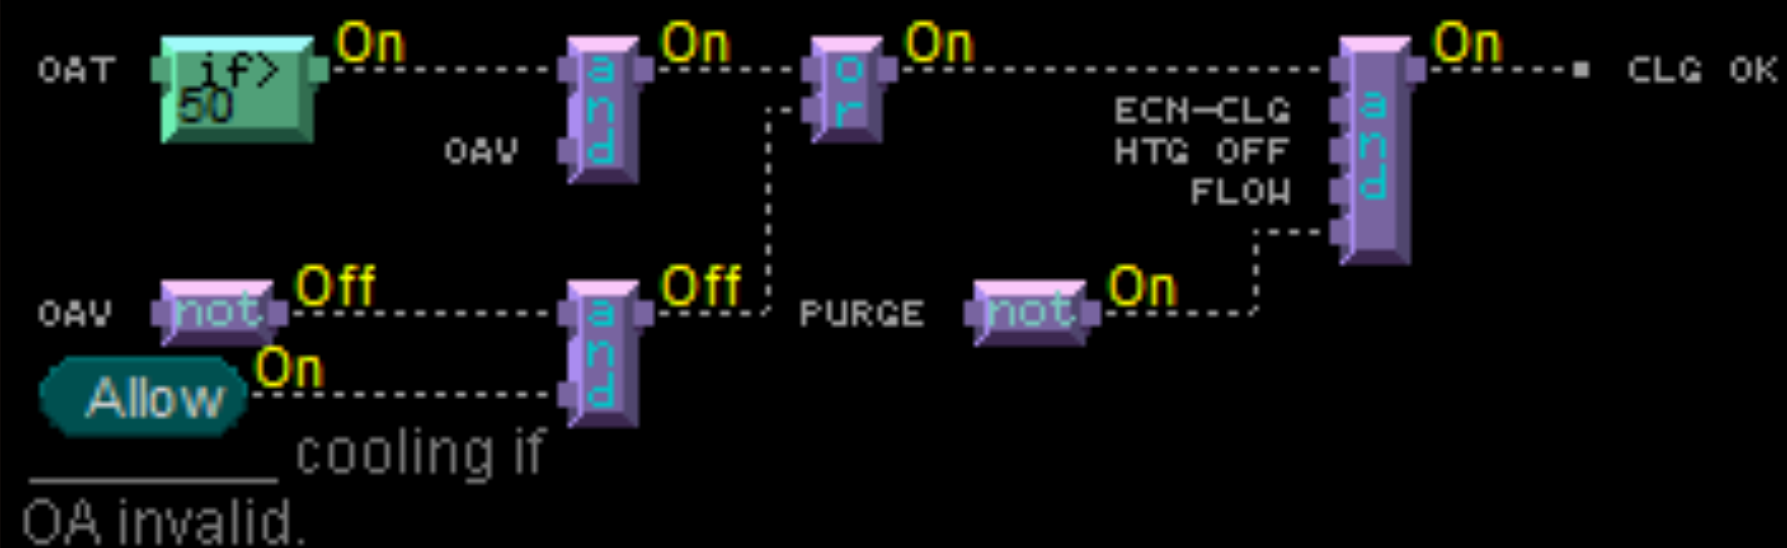

CLG OK is Cooling allowed.

OAT 66.09 Outside Air Temp

SAT 66.2 Supply Air Temp

SA STPT 63 Supply Air Setpoint

