


SR207-201  
KS201-876  
DIST. I/O

FÄLT

FÄLT (EX-ZON)


|       |       |    |     |   |
|-------|-------|----|-----|---|
| NOD   | 1.149 | EX | SIL | 1 |
| MTU   | 07    |    |     | 2 |
| KANAL | 09    |    |     | 3 |
| TAG   | MV1   |    |     | 4 |

.M1  
FOAR-PG 2x1,0

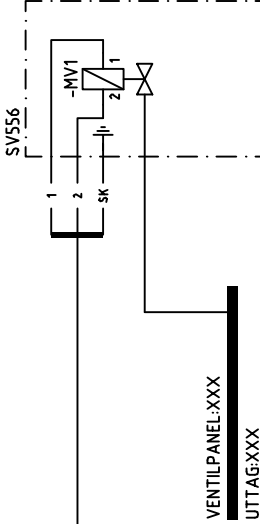

|       |       |    |     |   |
|-------|-------|----|-----|---|
| NOD   | 1.149 | EX | SIL | 1 |
| MTU   | 07    |    |     | 2 |
| KANAL | 10    |    |     | 3 |
| TAG   | GSO   |    |     | 4 |

.M2  
FOAR-PG 2x2x1,0



|       |       |    |     |   |
|-------|-------|----|-----|---|
| NOD   | 1.149 | EX | SIL | 1 |
| MTU   | 07    |    |     | 2 |
| KANAL | 11    |    |     | 3 |
| TAG   | GSS   |    |     | 4 |

| Apparat nr. | Antal | Fabrikat | Typ, Benämning, Data etc |
|-------------|-------|----------|--------------------------|
| -MV1        | 1     | XYZ      | 24VDC, FC, SIL2, Ex d    |
| -S1         | 1     | XYZ      | IND.VAKT 2NC             |

|                     |         |                 |               |              |         |                  |                |
|---------------------|---------|-----------------|---------------|--------------|---------|------------------|----------------|
| PILOTANLÄGGNING DRI |         | Text            | ON/OFF VENTIL | Orig. format | A4      | Dok. status      | ARBETSHANDLING |
| GASVÄRMNING         |         | Process/ Anl.   |               | 271SV556     |         | Anl.del          |                |
| Leverantör          |         | HYBRIT referens |               | Ritn. nr     |         | 271SV556-0001-EA |                |
| Rev                 | Ändring | Datum           | Inf av        | Godk         | Företag | Rev              |                |
|                     |         |                 |               |              |         | 00               |                |