



INSTALL NOTE: EACH BOARD SHALL REQUIRE 4 M3 X 10 MM SCREWS AND WASHERS WITH NON CONDUCTIVE PADDING BETWEEN METAL

**Board Installation
Rear View**

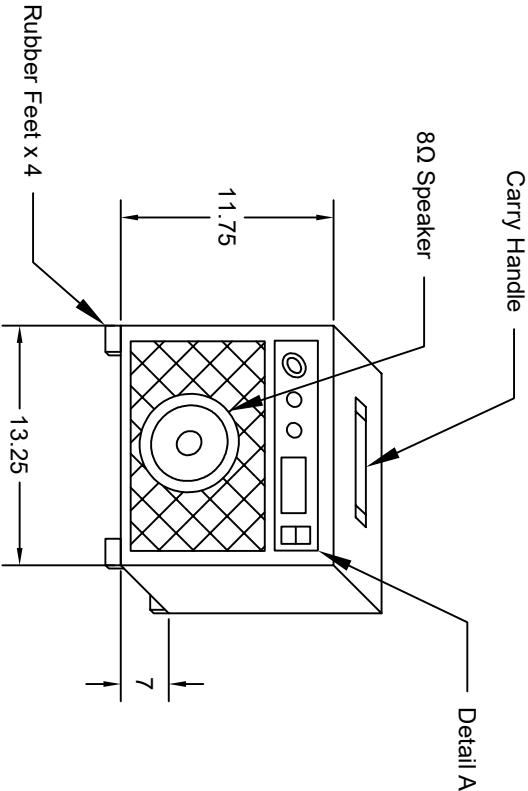

Speaker Enclosure

**DETAIL A:
FRONT PANEL**

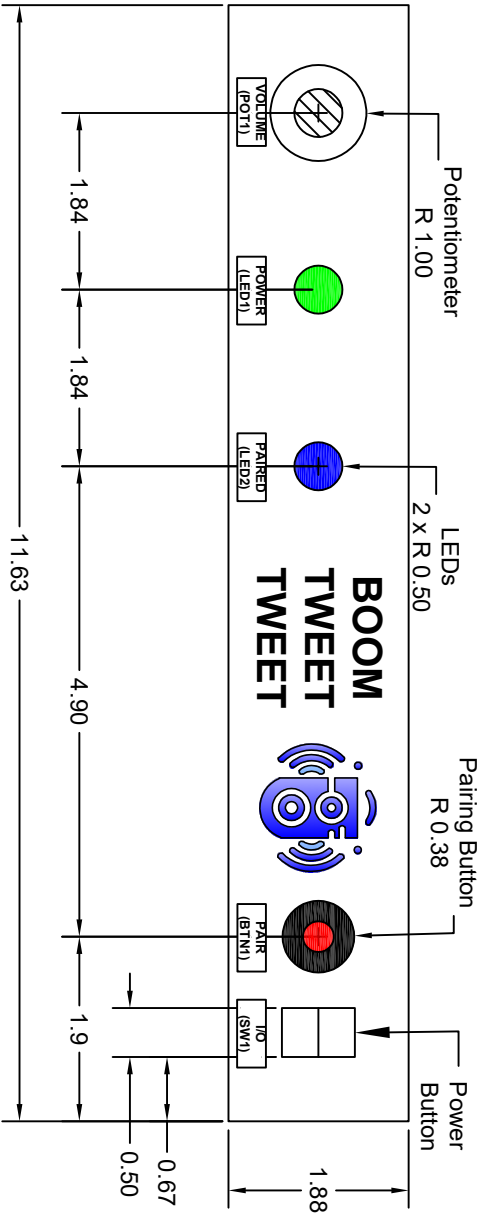

INSTALL NOTE: FOR CONNECTIONS REFER TO WIRING DIAGRAM

COMPANY NAME		SAN DIEGO STATE UNIVERSITY			
DEPARTMENT NAME		COLLEGE OF ENGINEERING			
DRAWING NAME		SPEAKER ENCLOSURE			
APPROVALS	DATE	COURSE NO.			
DRAWN R. HERNANDEZ	10/18/24	EE 492			
CHECKED		DRAWING NO.			
ISSUED		TB 01			
NOTES		SCALE AS SHOWN			
ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED		SHEET AS SHOWN			