


INSTALL NOTE: EACH BOARD SHALL REQUIRE 4 M3 X 10 MM SCREWS AND WASHERS WITH NON CONDUCTIVE PADDING BETWEEN METAL


Board Installation

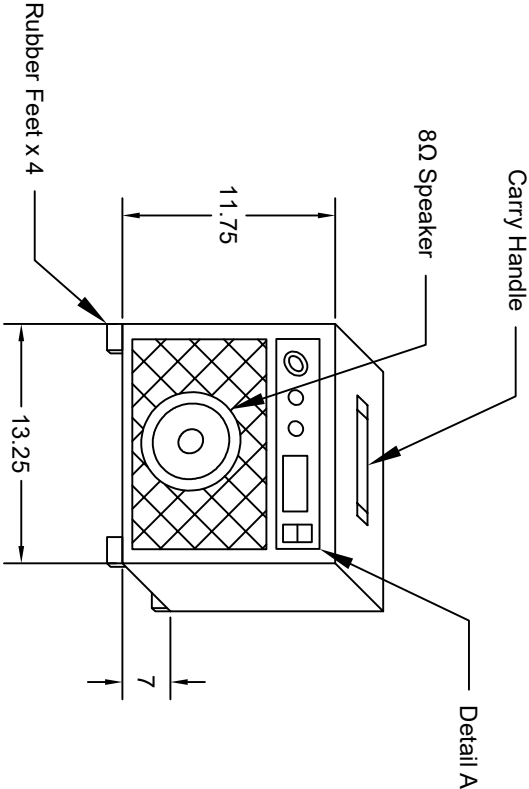

INSTALL NOTE: FOR CONNECTIONS REFER TO WIRING DIAGRAM

Speaker Enclosure

**DETAIL A:
FRONT PANEL**

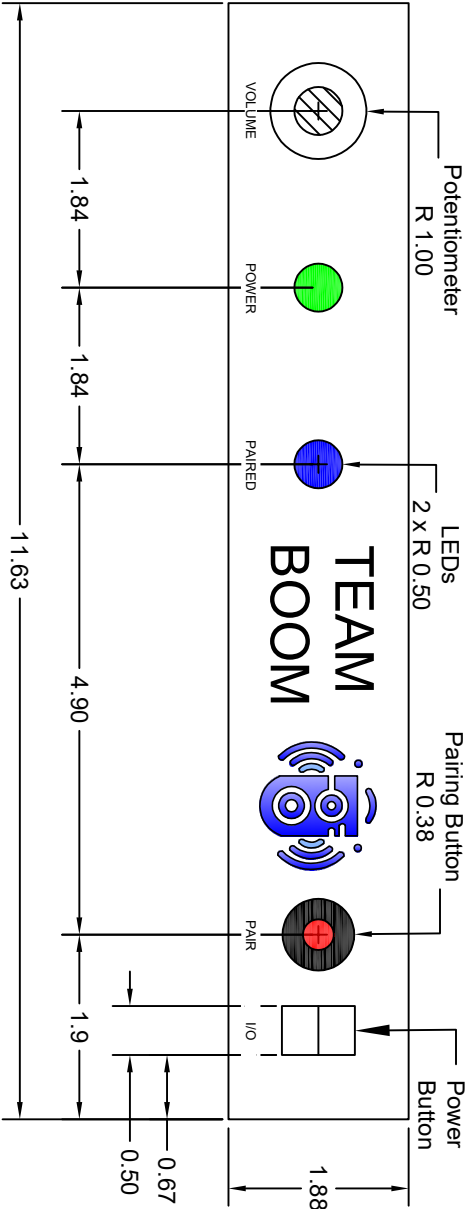

COMPANY NAME		SAN DIEGO STATE UNIVERSITY	
DEPARTMENT NAME		COLLEGE OF ENGINEERING	
APPROVALS		DATE	
DRAWN R. HERNANDEZ			
CHECKED			
ISSUED			
NOTES: ALL DIMENSIONS IN INCHES UNLESS OTHERWISE SPECIFIED			
DRAWING NAME		COURSE NO.	
SPEAKER ENCLOSURE		EE 492	
		DRAWING NO.	
		TB 01	
		SCALE	
		AS SHOWN	
		SIZE	
		A	
		REV.	
		A	