

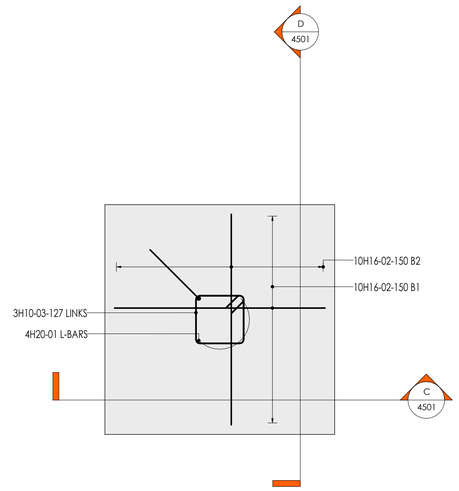


F2 Plan
(Scale: 1 : 20)

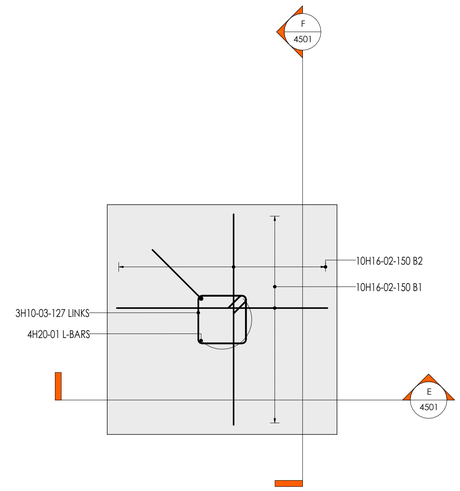


F3 Plan
(Scale: 1 : 20)

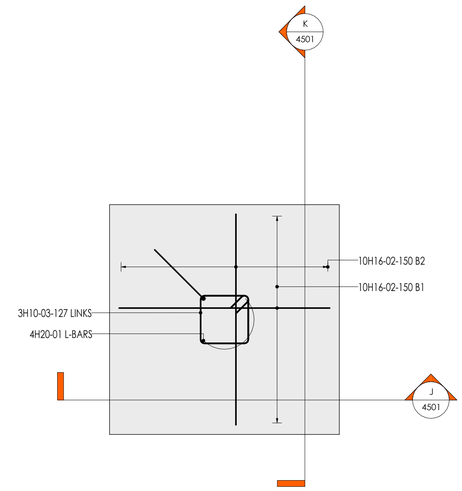

F5 Plan
(Scale: 1 : 20)

TYPICAL DETAIL C1 - COLUMN STARTERS AND KICKER


After SMDSC 4th ed. MD C1 / MD F1 - confirm with design

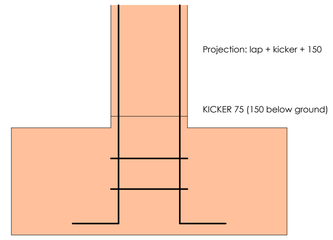


Starter links H10-300, 3 min., in the base

Starters fixed to a template before the pour


TD C1 - COLUMN STARTERS AND KICKER

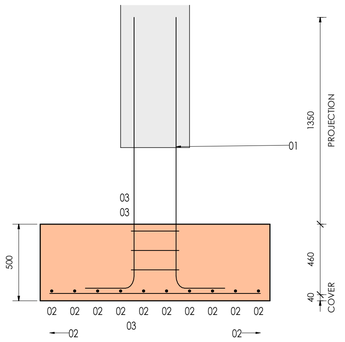


F2 Section C-C
(Scale: 1 : 20)

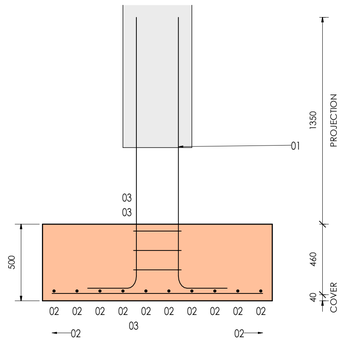


F3 Section E-E
(Scale: 1 : 20)

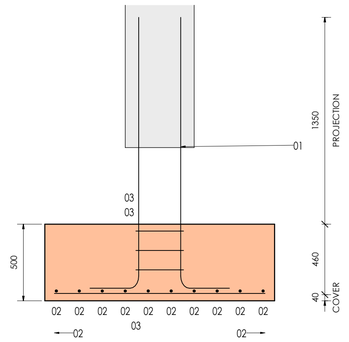


F5 Section J-J
(Scale: 1 : 20)

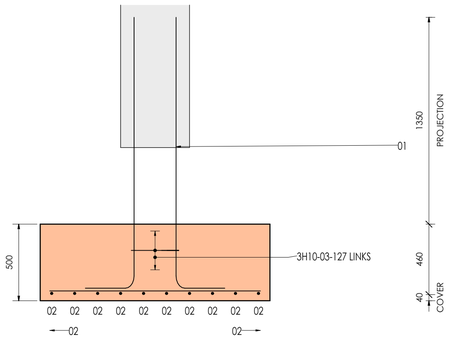

F2 Section D-D
(Scale: 1 : 20)

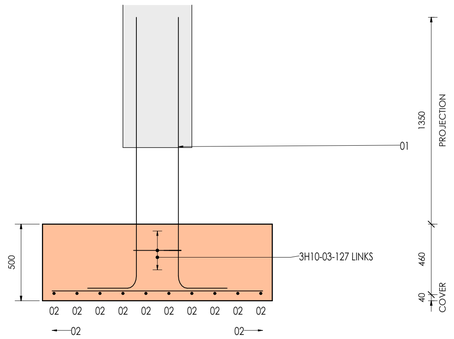


F3 Section F-F
(Scale: 1 : 20)

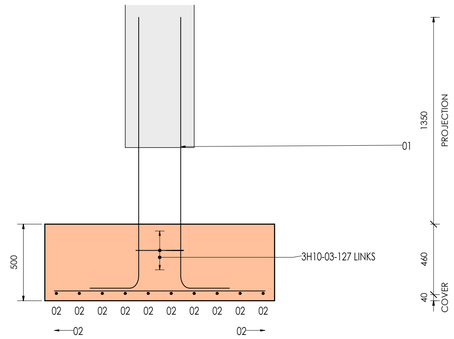


F5 Section K-K
(Scale: 1 : 20)

SLAB / BASE (SECTION)



WALL (PLAN SECTION)
Near face



Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: foundations C32/40.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4501-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10): foundations 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Foundations: bottom mat on 30 mm spacers on the blinding; starter bars fixed to a template; lacers tied to every bent-up leg. Multi-column bases and rafts: top mat on chairs and edge U-bars to BS 7973, sized for the pour sequence (SMDSC 4th ed. 6.7.2).
13. Buildability check: A+ (100/100; 0 error(s), 0 warning(s)) - see the RC QA report.
14. Typical details: TD C1 (MD C1 / MD F1) on drawing 4501 (after the SMDSC 4th ed. model details; confirm with design).

Rev.	Date	Description	Drawn by	Check by

nosa

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
T: +350 20075000
M: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Foundations reinforcement - F2, F3, F5

Drawing status: Project Status

Scale:	Size:	Date:	Drawn by:	Revision:
As shown	ISO A1	26/10/26	Author	

Drawing Number:

Project Number	Originator	Functional Breakdown	Spatial Breakdown	Form identifier	Discipline	Number
12345	NOSA	ZZ	ZZZ	D	S	4501