
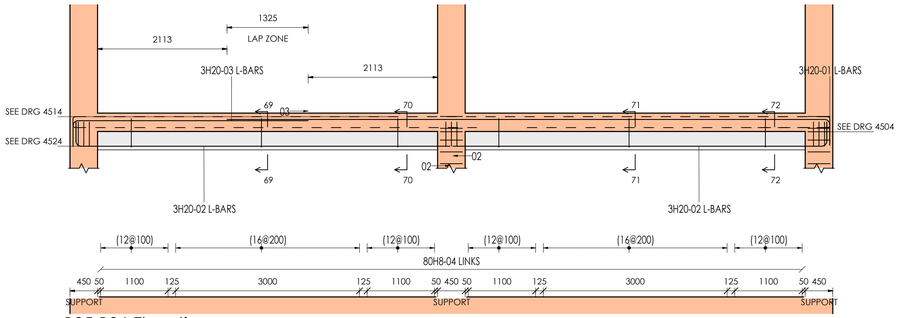



B35-B36 Elevation

(Scale: 1 : 50)

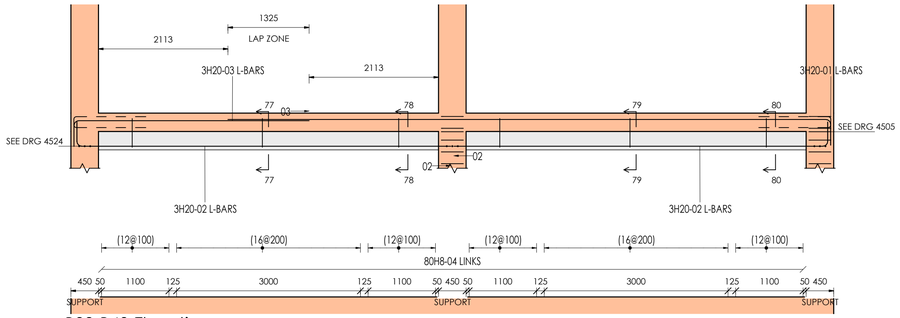


B39-B40 Elevation

(Scale: 1 : 50)




B35-B36 Section 69-69

(Scale: 1 : 20)




B35-B36 Section 70-70

(Scale: 1 : 20)




B35-B36 Section 71-71

(Scale: 1 : 20)




B39-B40 Section 77-77

(Scale: 1 : 20)




B39-B40 Section 78-78

(Scale: 1 : 20)




B39-B40 Section 79-79

(Scale: 1 : 20)




B35-B36 Section 72-72

(Scale: 1 : 20)




B39-B40 Section 80-80

(Scale: 1 : 20)

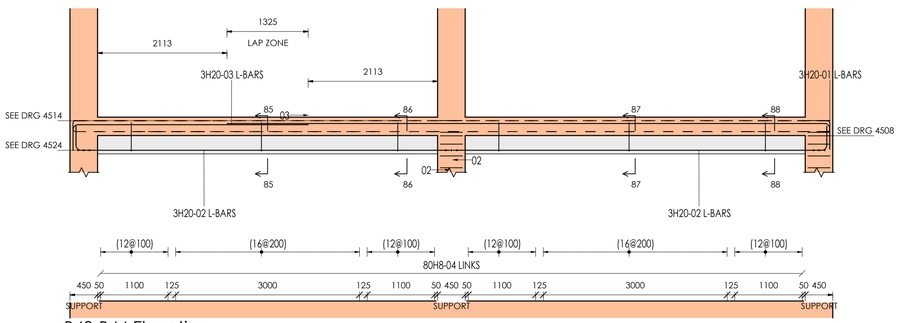


B43-B44 Elevation

(Scale: 1 : 50)

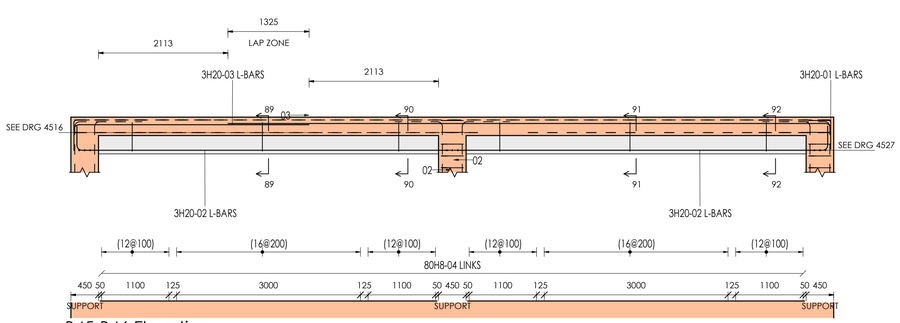


B45-B46 Elevation

(Scale: 1 : 50)




B43-B44 Section 85-85

(Scale: 1 : 20)




B43-B44 Section 86-86

(Scale: 1 : 20)




B43-B44 Section 87-87

(Scale: 1 : 20)




B45-B46 Section 89-89

(Scale: 1 : 20)




B45-B46 Section 90-90

(Scale: 1 : 20)




B45-B46 Section 91-91

(Scale: 1 : 20)



B43-B44 Section 88-88


(Scale: 1 : 20)




B45-B46 Section 92-92

(Scale: 1 : 20)

SLAB / BASE (SECTION)



WALL (PLAN SECTION)
Near face



Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: beams C32/40.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4529-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10); beams 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Beams: links tied to every corner bar and to alternate bars elsewhere; top bars carried on the links, bottom bars on spacers to BS 7973 at 1.0 m centres max. Cages may be prefabricated, lifting points by the contractor.

Rev.	Date	Description	Drawn by	Check by

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
t: +350 20075900
M: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Beams reinforcement - B35-B36, B39-B40, B43-B44, B45-B46

Drawing status: Project Status

Scale:	Size:	Date:	Drawn by:	Revision:
As shown	ISO A1	26/10/26	Author	

Drawing Number:

Project Number		Originator		Functional Breakdown		Spatial Breakdown		Form Identifier		Discipline		Number
12345	-	NOSA	-	ZZ	-	ZZZ	-	D	-	S	-	4526