
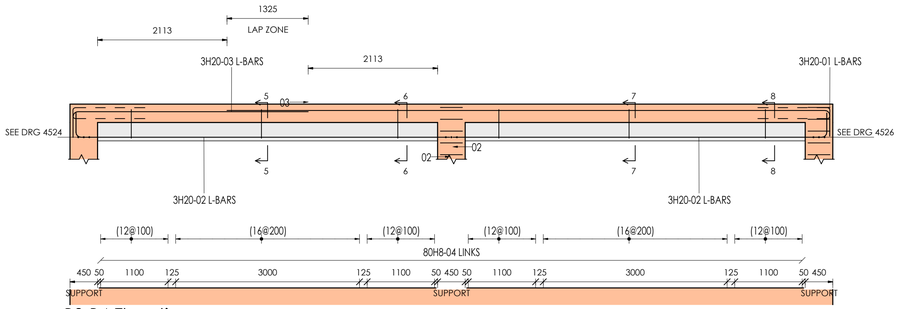



B3-B4 Elevation

(Scale: 1 : 50)

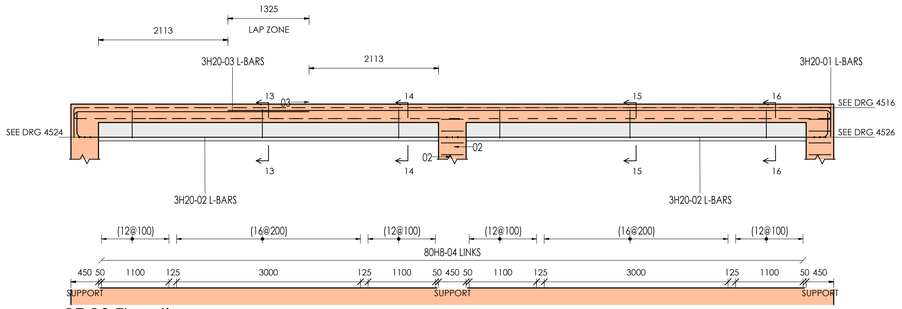


B7-B8 Elevation

(Scale: 1 : 50)




B3-B4 Section 5-5

(Scale: 1 : 20)




B3-B4 Section 6-6

(Scale: 1 : 20)




B3-B4 Section 7-7

(Scale: 1 : 20)




B7-B8 Section 13-13

(Scale: 1 : 20)




B7-B8 Section 14-14

(Scale: 1 : 20)




B7-B8 Section 15-15

(Scale: 1 : 20)




B3-B4 Section 8-8

(Scale: 1 : 20)




B7-B8 Section 16-16

(Scale: 1 : 20)

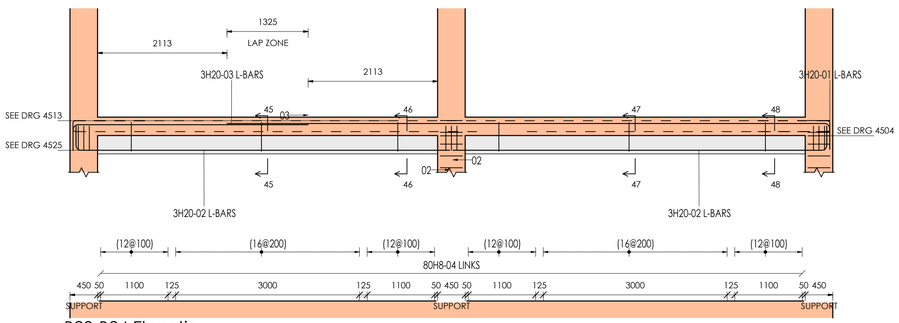


B23-B24 Elevation

(Scale: 1 : 50)

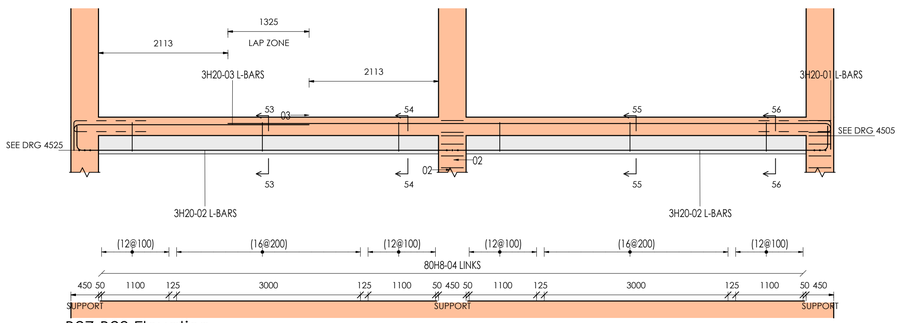


B27-B28 Elevation

(Scale: 1 : 50)




B23-B24 Section 45-45

(Scale: 1 : 20)




B23-B24 Section 46-46

(Scale: 1 : 20)




B23-B24 Section 47-47

(Scale: 1 : 20)




B27-B28 Section 53-53

(Scale: 1 : 20)




B27-B28 Section 54-54

(Scale: 1 : 20)




B27-B28 Section 55-55

(Scale: 1 : 20)



B23-B24 Section 48-48


(Scale: 1 : 20)




B27-B28 Section 56-56

(Scale: 1 : 20)

SLAB / BASE (SECTION)



WALL (PLAN SECTION)
Near face



Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: beams C32/40.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4529-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10); beams 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Beams: links tied to every corner bar and to alternate bars elsewhere; top bars carried on the links, bottom bars on spacers to BS 7973 at 1.0 m centres max. Cages may be prefabricated, lifting points by the contractor.

Rev.	Date	Description	Drawn by	Check by

nosa

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
T: +350 20075900
M: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Beams reinforcement - B3-B4, B7-B8, B23-B24, B27-B28

Drawing status: Project Status

Scale:	Size:	Date:	Drawn by:	Revision:
As shown	ISO A1	26/10/26	Author	

Drawing Number:

Project Number	Originator	Functional Breakdown	Spatial Breakdown	Form Identifier	Discipline	Number
12345	NOSA	ZZ	ZZZ	D	S	4527