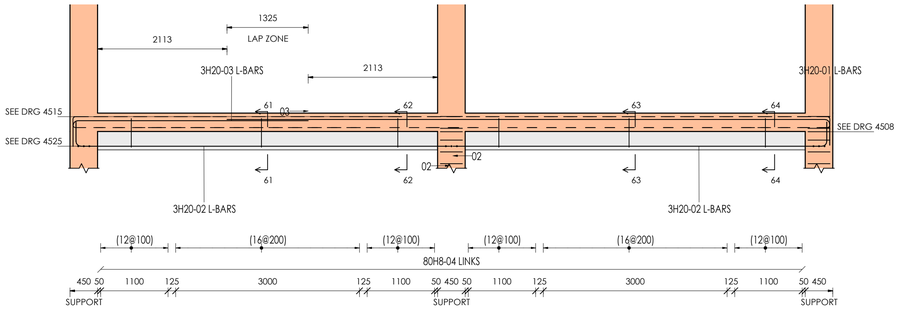
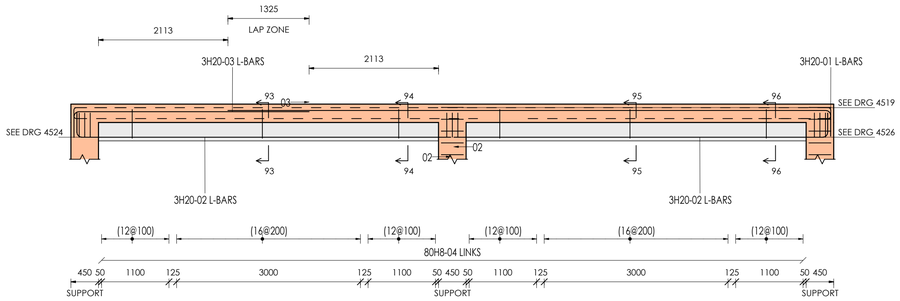




B31-B32 Elevation

(Scale: 1 : 50)





B47-B48 Elevation

(Scale: 1 : 50)





B31-B32 Section 61-61

(Scale: 1 : 20)





B31-B32 Section 62-62

(Scale: 1 : 20)





B31-B32 Section 63-63

(Scale: 1 : 20)





B47-B48 Section 93-93

(Scale: 1 : 20)





B47-B48 Section 94-94

(Scale: 1 : 20)





B47-B48 Section 95-95

(Scale: 1 : 20)



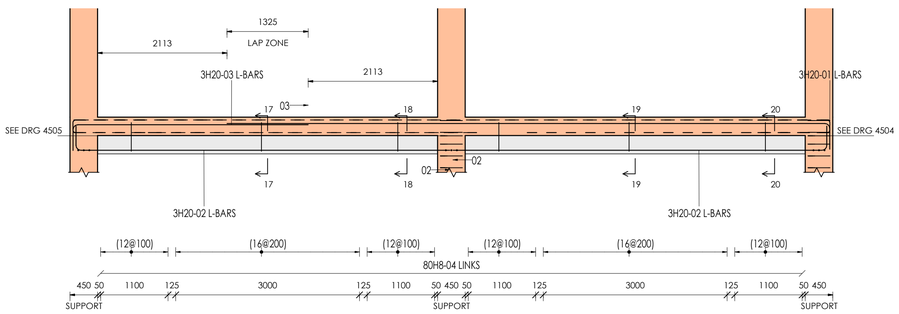

B31-B32 Section 64-64

(Scale: 1 : 20)



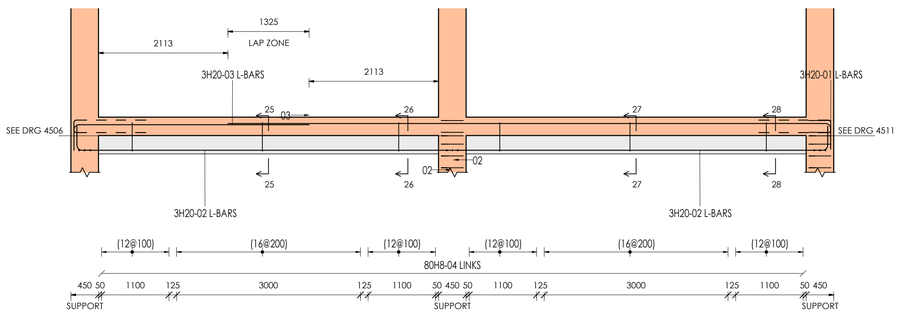

B47-B48 Section 96-96

(Scale: 1 : 20)





B9-B10 Elevation

(Scale: 1 : 50)





B13-B14 Elevation

(Scale: 1 : 50)





B9-B10 Section 17-17

(Scale: 1 : 20)





B9-B10 Section 18-18

(Scale: 1 : 20)





B9-B10 Section 19-19

(Scale: 1 : 20)





B13-B14 Section 25-25

(Scale: 1 : 20)





B13-B14 Section 26-26

(Scale: 1 : 20)





B13-B14 Section 27-27

(Scale: 1 : 20)




B9-B10 Section 20-20


(Scale: 1 : 20)





B13-B14 Section 28-28

(Scale: 1 : 20)

SLAB / BASE (SECTION)




WALL (PLAN SECTION)
Near face




Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: beams C32/40.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4529-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10); beams 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Beams: links tied to every corner bar and to alternate bars elsewhere; top bars carried on the links, bottom bars on spacers to BS 7973 at 1.0 m centres max. Cages may be prefabricated, lifting points by the contractor.

| Rev. | Date | Description | Drawn by | Check by |
|---|---|---|---|---|

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
T: +350 20075900
M: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Beams reinforcement - B9-B10, B13-B14, B31-B32, B47-B48

Drawing status: Project Status

| Scale: | Size: | Date: | Drawn by: | Revision: |
|---|---|---|---|---|
| As shown | ISO A1 | 26/10/26 | Author | |

Drawing Number:

| Project Number | Originator | Functional Breakdown | Spatial Breakdown | Form Identifier | Discipline | Number |
|---|---|---|---|---|---|---|
| 12345 | NOSA | ZZ | ZZZ | D | S | 4528 |