





C1 Elevation
(Scale: 1 : 50)





C2 Elevation
(Scale: 1 : 50)





C3 Elevation
(Scale: 1 : 50)




C4 Elevation
(Scale: 1 : 50)





C5 Elevation
(Scale: 1 : 50)





ρ = 1.24 % - 8H20, As 2513 mm²

C1 Section 1-1
(Scale: 1 : 20)





ρ = 1.24 % - 8H20, As 2513 mm²

C2 Section 2-2
(Scale: 1 : 20)





ρ = 1.24 % - 8H20, As 2513 mm²

C3 Section 3-3
(Scale: 1 : 20)




ρ = 0.93 % - 8H20, As 2513 mm²

C4 Section 4-4
(Scale: 1 : 20)

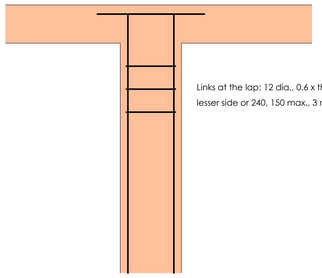



ρ = 1.58 % - 8H20, As 2513 mm²

C5 Section 5-5
(Scale: 1 : 20)

TYPICAL DETAIL C4 - COLUMN TOP DETAIL


After SMDSC 4th ed. MD C4 - confirm with design





Bars bent into the slab when it is at least 200 deep
(H20), 250 (H25), 300 (H32); else Detail B of MD C4

TD C4 - COLUMN TOP DETAIL

SLAB / BASE (SECTION)




WALL (PLAN SECTION)
Near face




Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: columns C40/50.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4501-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10): columns 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed. UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Columns: starter bars fixed to a template before the base is cast, 75 mm kicker; links tied to every bar they restrain. Cages may be prefabricated.
13. Typical details: TD C4 (MD C4) on drawing 4501 (after the SMDSC 4th ed. model details; confirm with design).

| Rev. | Date | Description | Drawn by | Check by |
|---|---|---|---|---|

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
t: +350 20075000
m: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Columns reinforcement

Drawing status: Project Status

| Scale: | Size: | Date: | Drawn by: | Revision: |
|---|---|---|---|---|
| As shown | ISO A1 | 10/24/26 | Author | |

Drawing Number:

| Project Number | Originator | Functional Breakdown | Spatial Breakdown | Form identifier | Discipline | Number |
|---|---|---|---|---|---|---|
| 12345 | NOSA | ZZ | ZZZ | D | S | 4501 |