




W1 Elevation
(Scale: 1 : 50)

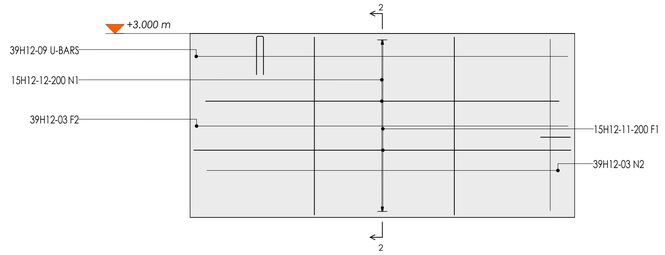

W2 Elevation
(Scale: 1 : 50)

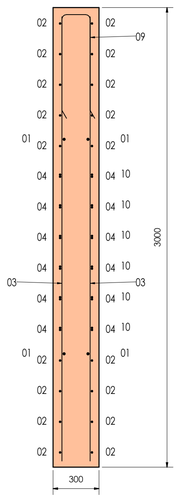


W1 Section 1-1
(Scale: 1 : 20)

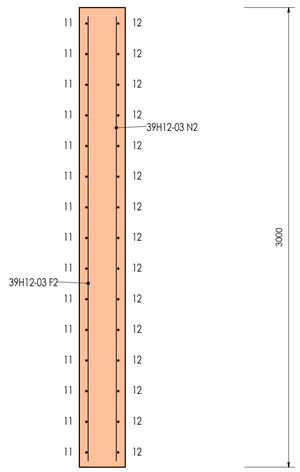

W2 Section 2-2
(Scale: 1 : 20)

TYPICAL DETAIL W1 - WALL BASE, KICKER AND TOP

After SMDSC 4th ed, MD W1 - confirm with design

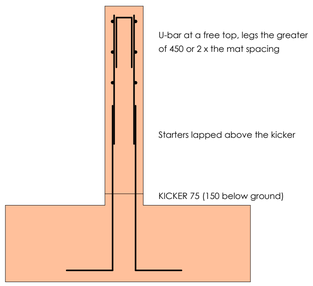


Bars to Table 6.6 where the design gives none;
horizontal bars outside the verticals

TD W1 - WALL BASE, KICKER AND TOP

TYPICAL DETAIL W4 - WALL OPENING


After SMDSC 4th ed, MD W4 - confirm with design




Trimmers one size up from the verticals,
tension anchorage past the opening
U-bars the size of the horizontals, round it,
enclosing the trimmers; wall 175 min.

TD W4 - WALL OPENING

SLAB / BASE (SECTION)



WALL (PLAN SECTION)
Near face



Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: walls C32/40.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4504-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10): walls 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed, Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Walls: the two faces held apart by spacers or links at 1.0 m centres max; horizontal bars outside the vertical bars unless shown otherwise.
13. Buildability check: A (94/100: 0 error(s), 2 warning(s)) - see the RC QA report.
14. Typical details: TD W4 (MD W4), TD W1 (MD W1) on drawing 4504 (after the SMDSC 4th ed. model details; confirm with design).

Rev.	Date	Description	Drawn by	Check by

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
t: +350 20075000
m: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Walls reinforcement

Drawing status: Project Status

Scale:	Size:	Date:	Drawn by:	Revision:
As shown	ISO A1	10/24/26	Author	

Drawing Number:

Project Number	Originator	Functional Breakdown	Spatial Breakdown	Form identifier	Discipline	Number
12345	NOSA	ZZ	ZZZ	D	S	4504