

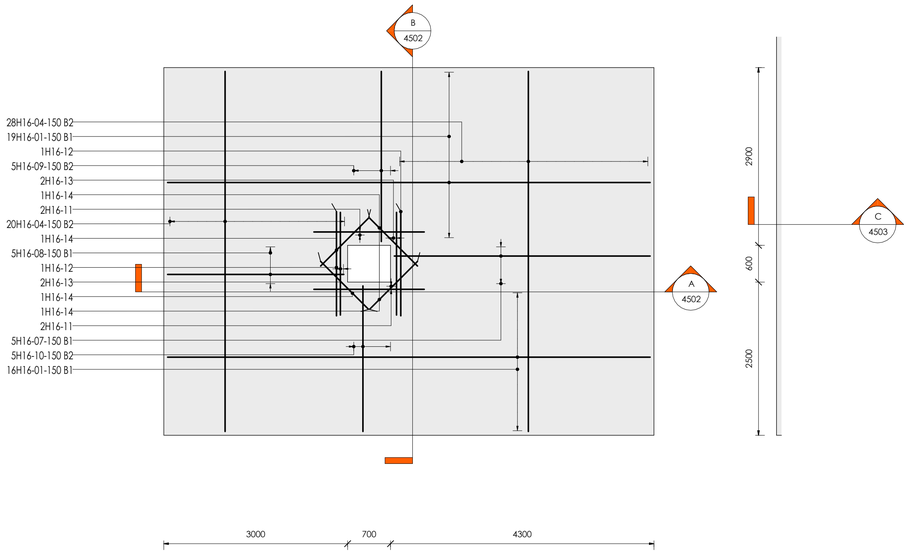



S1 Plan
(Scale: 1 : 50)




S1 Section A-A
(Scale: 1 : 25)




S1 Section B-B
(Scale: 1 : 25)

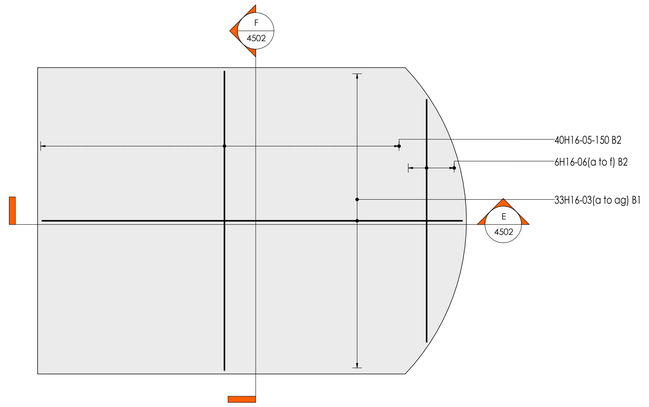

S3 Plan
(Scale: 1 : 50)




S3 Section E-E
(Scale: 1 : 25)



S3 Section F-F
(Scale: 1 : 25)

TYPICAL DETAIL OP1 - SLAB OPENING TRIMMING


After SMDSC 4th ed. MD OP1 / 6.2.2.12 - confirm with design

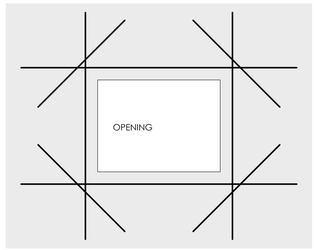


Trimmers of the area cut, half each side,
l_bd (450 min.) past the opening, clear of the mat
Openings 500-1000 in slabs over 250: corner
diagonals top and bottom, outside the opening

TD OP1 - SLAB OPENING TRIMMING

SLAB / BASE (SECTION)



WALL (PLAN SECTION)
Near face



Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: slabs C32/40.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4502-01, 4502-02.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10): slabs 40.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1: centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face: 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Slabs: bottom mat on spacers, top mat on chairs to BS 7973 chosen by the contractor (SMDSC 4th ed. 4.2.6); bars tied at alternate intersections, at every one along edges and round openings.
13. Buildability check: A+ (100/100; 0 error(s), 0 warning(s)) - see the RC QA report.
14. Typical details: TD OP1 (MD OP1 / 6.2.2.12) on drawing 4502 (after the SMDSC 4th ed. model details; confirm with design).

Rev.	Date	Description	Drawn by	Check by

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
t: +350 20075000
M: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Slabs reinforcement - S1, S3

Drawing status: Project Status

Scale:	Size:	Date:	Drawn by:	Revision:
As shown	ISO A1	10/24/26	Author	

Drawing Number:

Project Number	Originator	Functional Breakdown	Spatial Breakdown	Form Identifier	Discipline	Number
12345	NOSA	ZZ	ZZZ	D	S	4502