




C1 Elevation
(Scale: 1 : 50)




C2 Elevation
(Scale: 1 : 50)




C3 Elevation
(Scale: 1 : 50)



C4 Elevation
(Scale: 1 : 50)




C5 Elevation
(Scale: 1 : 50)




ρ = 1.24 % - 8H20, As 2513 mm²

C1 Section 1-1
(Scale: 1 : 20)




ρ = 1.24 % - 8H20, As 2513 mm²

C2 Section 2-2
(Scale: 1 : 20)




ρ = 1.24 % - 8H20, As 2513 mm²

C3 Section 3-3
(Scale: 1 : 20)



ρ = 0.93 % - 8H20, As 2513 mm²

C4 Section 4-4
(Scale: 1 : 20)




ρ = 1.58 % - 8H20, As 2513 mm²

C5 Section 5-5
(Scale: 1 : 20)

TYPICAL DETAIL C4 - COLUMN TOP DETAIL

After SMDSC 4th ed. MD C4 - confirm with design

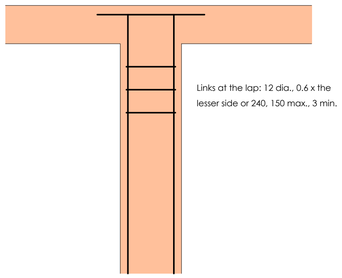


Links at the lap: 12 dia., 0.6 x the lesser side or 240, 150 max., 3 min.


Bars bent into the slab when it is at least 200 deep (H20), 250 (H25), 300 (H32); else Detail B of MD C4

TD C4 - COLUMN TOP DETAIL

SLAB / BASE (SECTION)



WALL (PLAN SECTION)
Near face



Far face

1 = outer layer, 2 = second layer

RC layer notation

REINFORCEMENT NOTES

1. Read with the general arrangement drawings and the general notes (0900). Do not scale from this drawing.
2. Concrete: columns C40/50.
3. Reinforcement: high yield ribbed bars B500B to BS 4449, scheduled to BS 8666:2020. Bar schedules: 4501-01.
4. Nominal cover c_nom to all reinforcement, links included (includes delta c_dev = 10): columns 50.
5. Maximum aggregate size 20 mm.
6. Bar notation: number, type and size, mark, centres, layer, e.g. 20H16-63-150 B1; centres and layer not given for beams and columns. Link zones (13@100): 13 links at 100 centres.
7. Layers: T top, B bottom, N near face, F far face; 1 outer layer, 2 second layer (see the layer notation key). EF each face, EW each way, ES each side, STG staggered, ALT alternate, ABR alternate bar reversed, UB U-bars (SMDSC 4th ed. Appendix I).
8. Laps and anchorages to the table in the general notes (0900) unless dimensioned; laps of adjacent bars staggered unless shown otherwise.
9. Bars bent cold to BS 8666; none heated, welded or rebent on site without approval.
10. Construction joints, holes and cast-in items only as shown or agreed.
11. Reinforcement inspected before concreting; no bar substituted without approval.
12. Fixing: Columns: starter bars fixed to a template before the base is cast, 75 mm kicker; links tied to every bar they restrain. Cages may be prefabricated.
13. Typical details: TD C4 (MD C4) on drawing 4501 (after the SMDSC 4th ed. model details; confirm with design).

Rev.	Date	Description	Drawn by	Check by

NOSA Ltd.
Suite 9.1, 9th Floor, ICC
2A Main Street
Gibraltar, GX11 1AA
T: +350 20075000
M: +350 58008085 / +35057056000
e: info@nosa.gi

Client: Client X

Project Title: 1st Rock Street

Drawing Description: Columns reinforcement

Drawing status: Project Status

Scale:	Size:	Date:	Drawn by:	Revision:
As shown	ISO A1	10/24/26	Author	

Drawing Number:

Project Number		Originator		Functional Breakdown		Spatial Breakdown		Form Identifier		Discipline		Number
12345	-	NOSA	-	ZZ	-	ZZZ	-	D	-	S	-	4501