


TYPE	LAMPS/ PWR	MOUNTING TYPE	DESCRIPTION	ACCEPTABLE MANUFACTURERS	REMARKS
AL1	LED / 79W	CEILING PENDANT	LINEAR LED HIGH BAY, 4 FOOT, 11000 LUMENS, WIDE DISTRIBUTION, FROSTED LENS, 120/277V, 80 CRI, 5000K, 0-10V DIMMING	METALUX 41LED-LD5-11-W-FL-UNV-L850-CD	OR EQUAL
AL1E	LED / 79W	CEILING PENDANT	LINEAR LED HIGH BAY, 4 FOOT, 11000 LUMENS, WIDE DISTRIBUTION, FROSTED LENS, 120/277V, 80 CRI, 5000K, 14W EMERGENCY BATTERY PACK, 0-10V DIMMING	METALUX 41LED-LD5-11-W-FL-UNV-L850-EL14WCD	OR EQUAL
EM	LED / 1.34W	WALL/ PENDANT	ALL-PRO EXIT, RED GREEN SELECTABLE, NICKEL CADMIUM BATTERY BACKUP, WHITE FINISH, 120/277V	SURE-LITES APX7RG	OR EQUAL
WL1	LED / 20.1W	WALL MOUNT	IMPACT ELITE LED SMALL TRAPEZOID, 1 SQUARE (16 LED), 350MA, 70CRI, 5000K, 120/277V, BRONZE FINISH, COLD RATED BATTERY PACK WITH BACK BOX, DIMMING OCCUPANCY SENSOR WITH BLUETOOTH INTERFACE, 8-20' MOUNTING	MCGRAW-EDISON IST-SA1A-750-U-SL3-BZ-CBP-SPB2	OR EQUAL
WL2	LED / 32W	WALL MOUNT	WALL MOUNTED LED LUMINAIRE, RATED FOR OUTDOOR USE, 4400 LUMENS, 4000K, 80 CRI, 120/277V	LITHONIA TWX2 LED P2-40K-MVOLT	OR EQUAL
AL2	LED / 24W	TROFFER	2'X2' LED TROFFER PANEL, 5000 LUMENS, VERY HIGH EFFICACY, 120-277V, 80CRI, 4000K, 0-10V DIMMING	METALUX 22CZ2-50VHE-UNV-L835-CD1-U	OR EQUAL
AL2E	LED / 24W	TROFFER	2'X2' LED TROFFER PANEL, 5000 LUMENS, VERY HIGH EFFICACY, 120-277V, 14W EMERGENCY BATTERY PACK, 80CRI, 4000K, 0-10V DIMMING	METALUX 22CZ2-50VHE-UNV-E10W-L835-CD1-U	OR EQUAL
AL3	LED / 40W	CEILING PENDANT	LINEAR LED LOW BAY, 24" LENGTH, 4000 LUMENS, 120-277V, 5000K, 80CRI, RATED FOR WET LOCATIONS	LITHONIA DMW2-L24-4000LM-AFL-MD-MVOLT-GZ10-50K-80CRI-WLFEND2	OR EQUAL
AL3E	LED / 40W	CEILING PENDANT	LINEAR LED LOW BAY, 24" LENGTH, 4000 LUMENS, 120-277V, 5000K, 80CRI, 10W EMERGENCY BATTERY PACK, RATED FOR WET LOCATIONS	LITHONIA DMW2-L24-4000LM-AFL-MD-MVOLT-GZ10-50K-80CRI-E10W-WLFEND2	OR EQUAL

LIGHTING FIXTURE
SCHEDULE
NTS

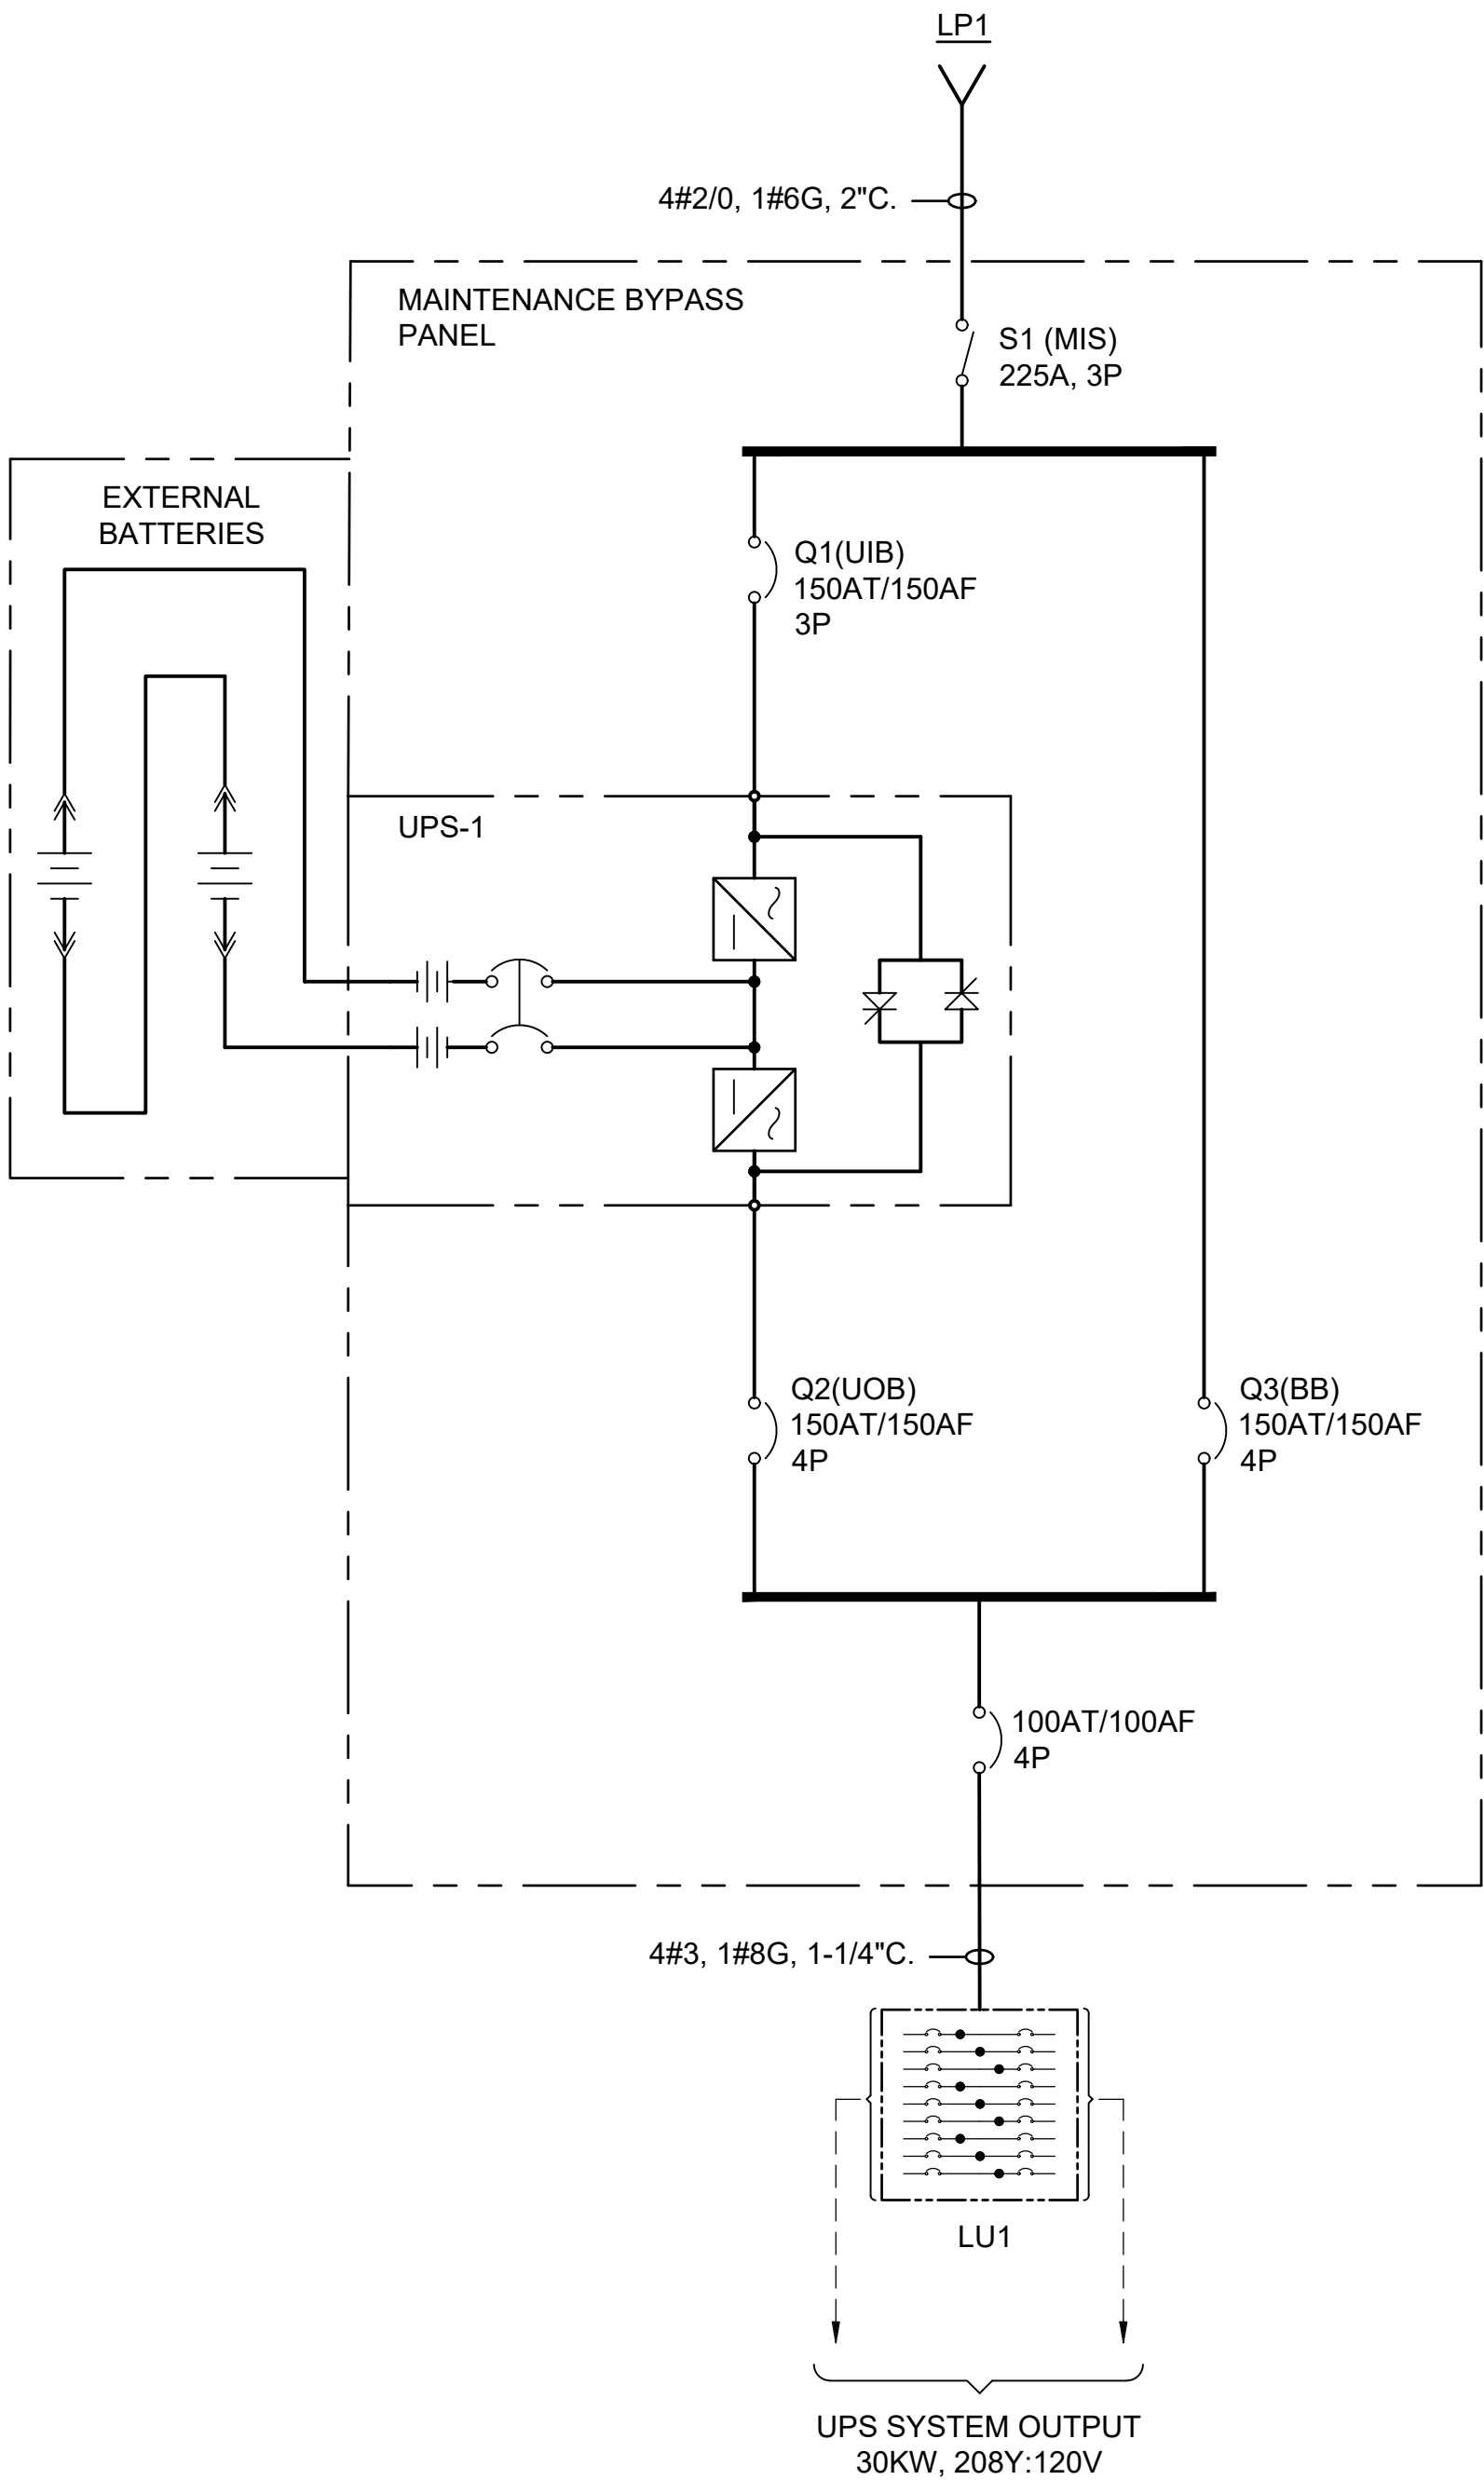

UNINTERRUPTIBLE POWER SUPPLY UPS-1
ONE-LINE DIAGRAM
NTS

NO.	ISSUE	BY	DATE	JOB NO.
				2521-299240
			DATE	FEBRUARY 2026
			DESIGNED	N. IHLE
			DRAWN	E. MCCLEARY
			CHECKED	V. GUPTA
			CROSS CHK	R. WILLIAMS
			APPROVED	A. REED

CDM Smith

801 Cherry Street, Suite 1820
Fort Worth TX 76102-2870
Tel: (817) 332-8727

GAI

Gupta & Associates, Inc.
CONSULTING ENGINEERING
Texas Registration No. F-2593
15717 Neutron Road
Dallas, Texas 75244
Tel: 972-490-7661
www.gaiconsulting.com



TARRANT REGIONAL WATER DISTRICT

**RICHLAND CHAMBERS LAKE PUMP STATION (RC1) AND
CEDAR CREEK LAKE PUMP STATION (CC1) ELECTRICAL SYSTEM**

CC1 - ELECTRICAL

**LIGHTING FIXTURE SCHEDULE AND UNINTERRUPTIBLE
POWER SUPPLY UPS-1 ONE-LINE DIAGRAM**

THIS DOCUMENT IS RELEASED FOR
THE PURPOSE OF INTERIM REVIEW UNDER
AUTHORITY OF
ANDREW A. REED
123384
02/13/2026

PRELIMINARY
NOT FOR CONSTRUCTION, BIDDING
OR PERMIT PURPOSES

0" 1"

BAR IS ONE INCH ON ORIGINAL DRAWING.
IF NOT ONE INCH ON THIS SHEET,
ADJUST SCALE.

SHEET NO.
EB-609

90% SUBMITTAL