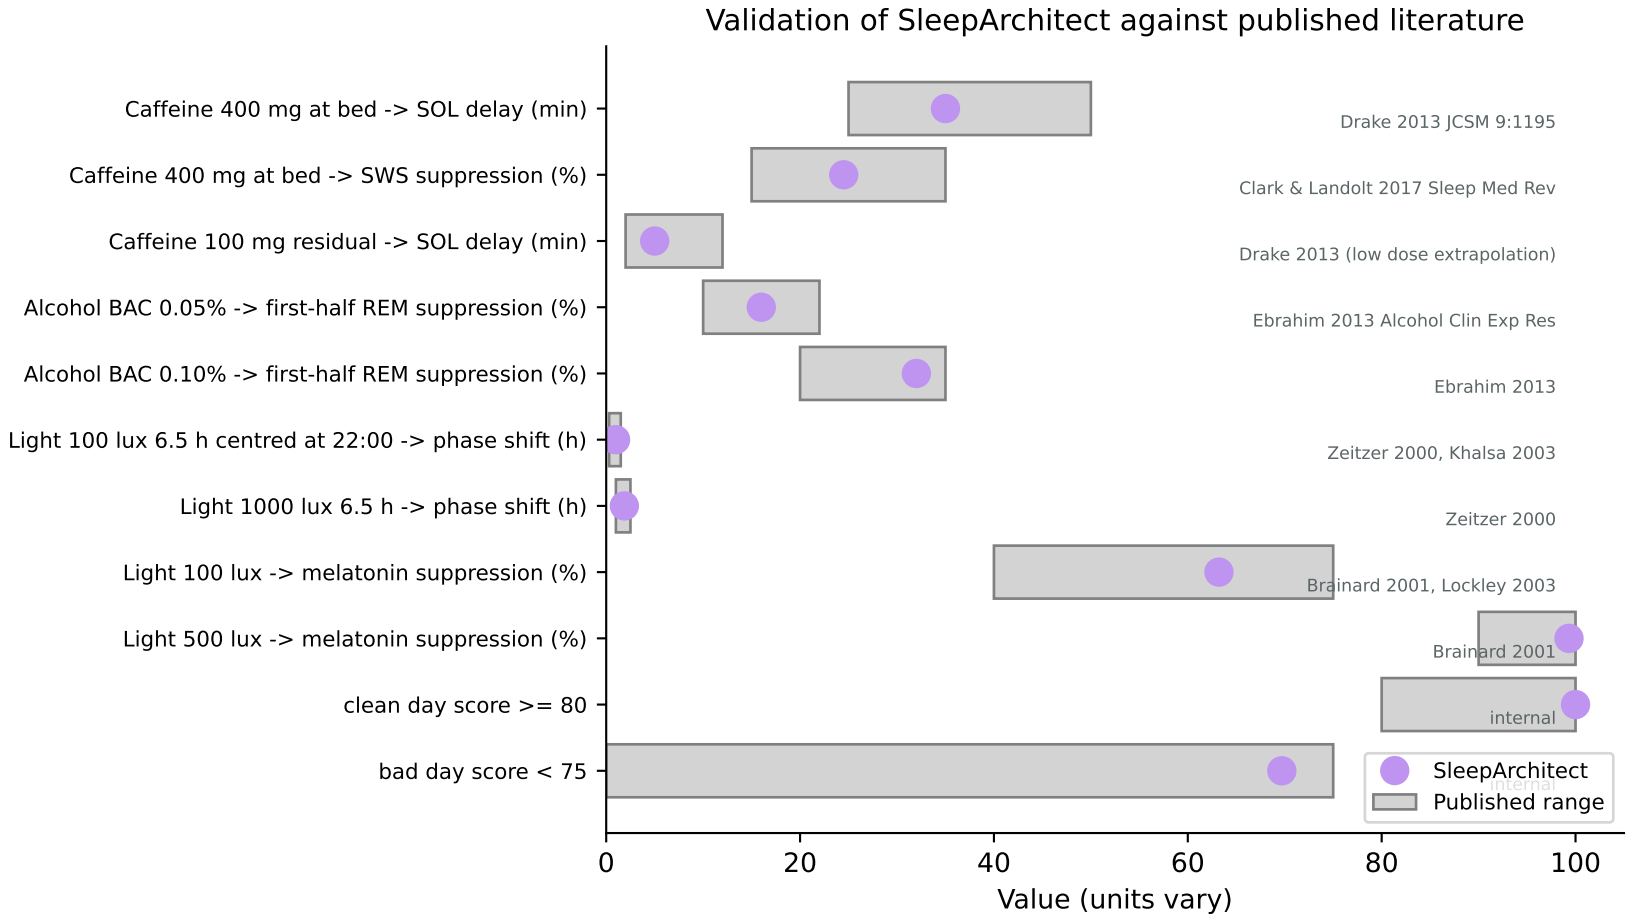
Validation of SleepArchitect against published literature
Caffeine 400 mg at bed -> SOL delay (min)
Caffeine 400 mg at bed -> SWS suppression (%)
Caffeine 100 mg residual -> SOL delay (min)
Alcohol BAC 0.05% -> first-half REM suppression (%)
Alcohol BAC 0.10% -> first-half REM suppression (%)
Light 100 lux 6.5 h centred at 22:00 -> phase shift (h)
Light 1000 lux 6.5 h -> phase shift (h)
Light 100 lux -> melatonin suppression (%)
Light 500 lux -> melatonin suppression (%)
clean day score >= 80
bad day score < 75
Drake 2013 JCSM 9:1195
Clark & Landolt 2017 Sleep Med Rev
Drake 2013 (low dose extrapolation)
Ebrahim 2013 Alcohol Clin Exp Res
Ebrahim 2013
Zeitzer 2000, Khalsa 2003
Zeitzer 2000
Brainard 2001, Lockley 2003
Brainard 2001
internal
internal
SleepArchitect
Published range
0
20
40
60
80
100
Value (units vary)